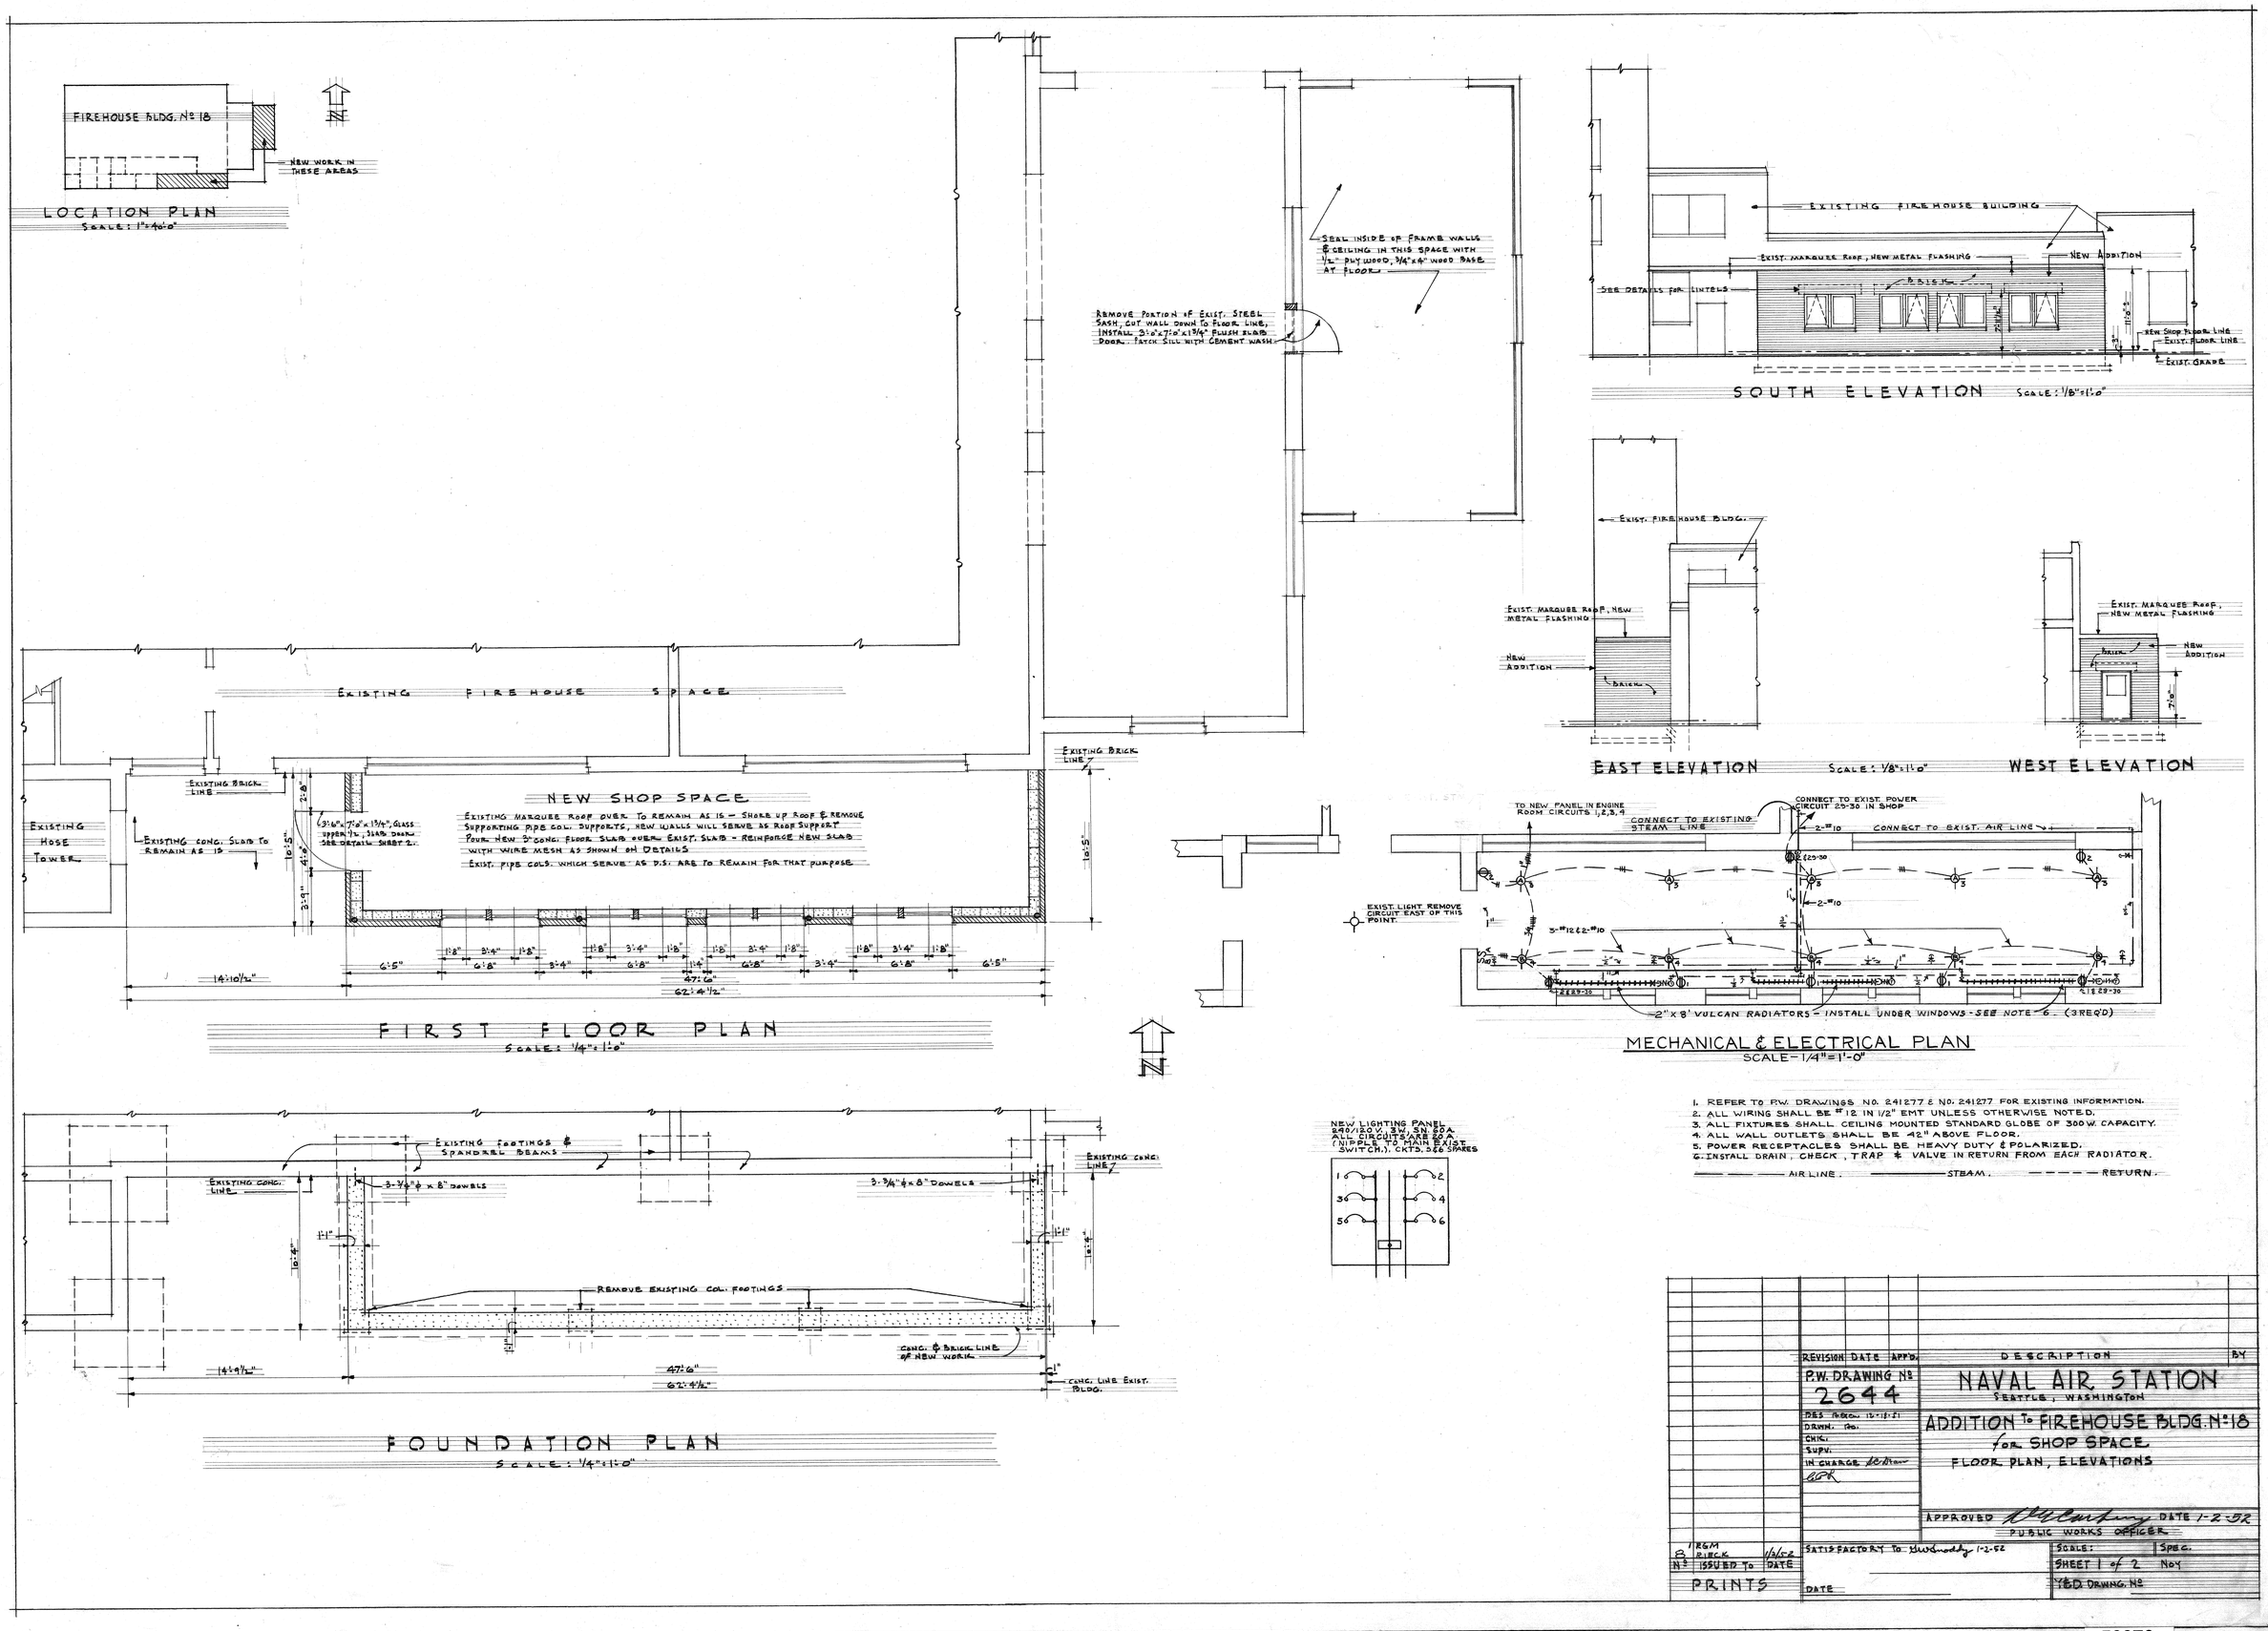

1. REFER TO P.W. DRAWINGS NO. 241277 & NO. 241277 FOR EXISTING INFORMATION.
2. ALL WIRING SHALL BE #12 IN 1/2" EMT UNLESS OTHERWISE NOTED.
3. ALL FIXTURES SHALL CEILING MOUNTED STANDARD GLOBE OF 300W. CAPACITY.
4. ALL WALL OUTLETS SHALL BE 42" ABOVE FLOOR.
5. POWER RECEPTACLES SHALL BE HEAVY DUTY & POLARIZED.
6. INSTALL DRAIN, CHECK, TRAP & VALVE IN RETURN FROM EACH RADIATOR.

——— AIR LINE. ——— STEAM. - - - - - RETURN.

REVISION	DATE	APP'D.	DESCRIPTION	BY
1	R&M			
B	BRICK	1/6/62		
No	ISSUED TO	DATE		
	PRINTS			

P.W. DRAWING No 2644

DES. A.B.C.M. 12-18-61
DRWN. A.G.
CHK.
SUPV.
IN CHARGE
GOK

NAVAL AIR STATION
SEATTLE, WASHINGTON

ADDITION TO FIREHOUSE BLDG. No 18 FOR SHOP SPACE
FLOOR PLAN, ELEVATIONS

APPROVED DATE 1-2-62
PUBLIC WORKS OFFICER

SATISFACTORY TO
DATE

SCALE:
SHEET 1 of 2
SPEC. No
Y&D DRWNG. No

52970