


EXAMPLE: POLE SET 7' MINIMUM TO PROPERTY LINE

NOTE: ALL STRUCTURES, CONSTRUCTION AND MAINTENANCE ACTIVITIES PROHIBITED IN THIS AREA. CLEARANCES MAY BE REQUIRED IF POLES AND WIRES ARE NOT PRESENT. ADDITIONAL CLEARANCES ARE REQUIRED FOR BUILDING MAINTENANCE ACTIVITY.

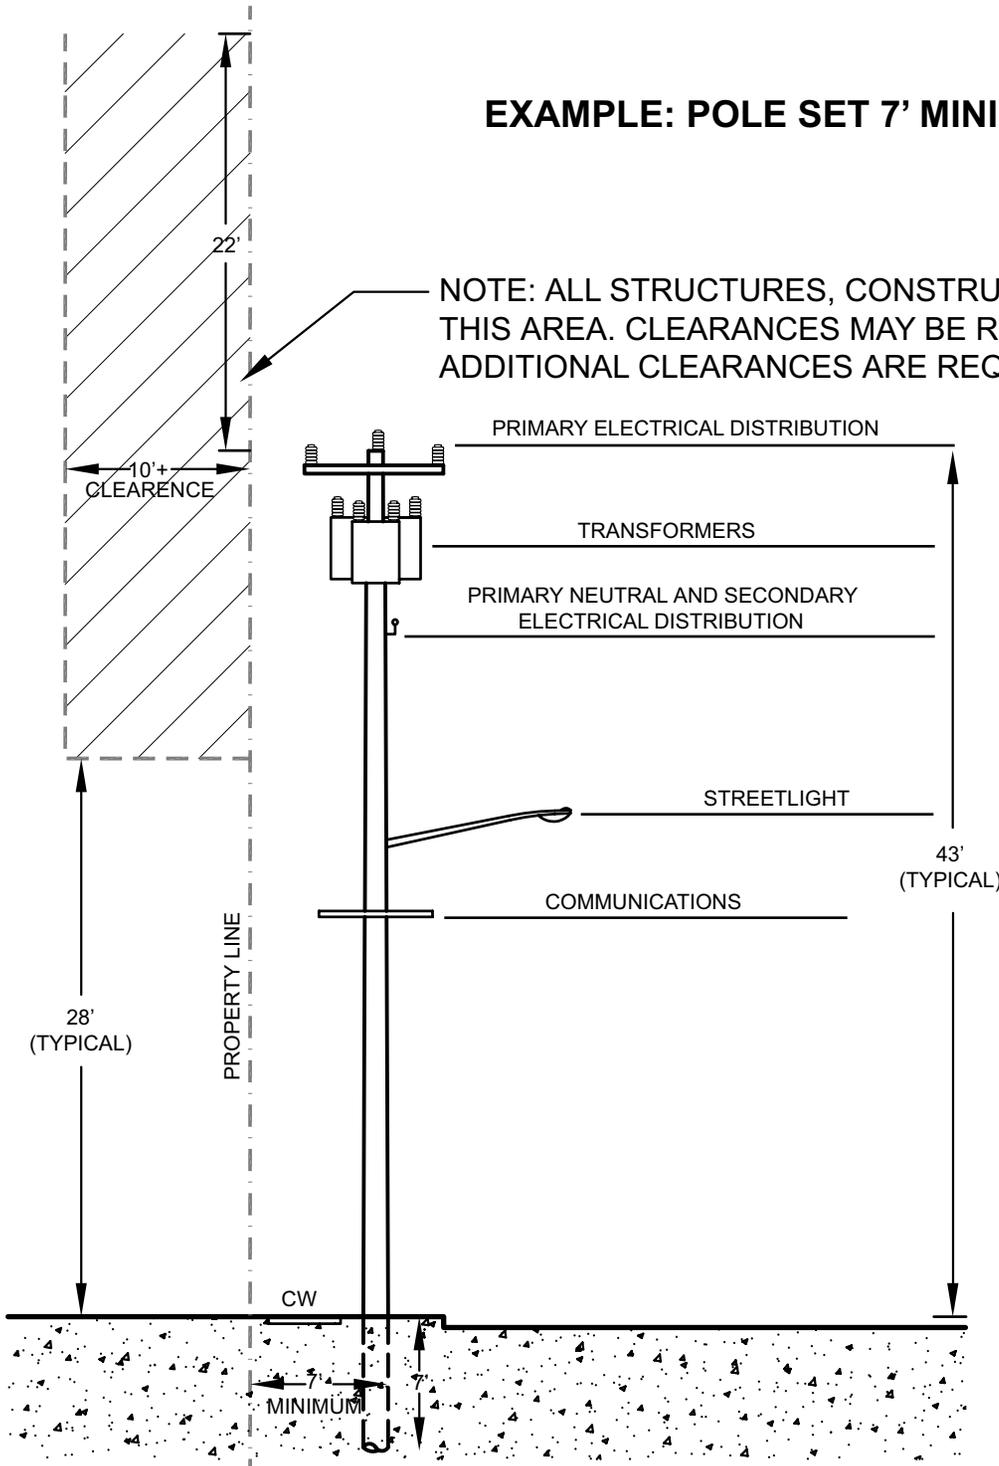

 =MINIMUM SETBACK OF FINISHED BUILDING OR STRUCTURE REQUIRED FOR UTILITY CLEARANCE FROM SCL ELECTRICAL OVERHEAD UTILITY.

TYPICAL SCL CONSTRUCTION

THE SEATTLE CITY LIGHT (SCL) 26KV OVERHEAD POWER DISTRIBUTION REQUIRES A MINIMUM HORIZONTAL AND VERTICAL CLEARANCE FROM BUILDINGS AND STRUCTURES PER THE MOST RESTRICTIVE ELEMENTS AMONGST CURRENT WASHINGTON ADMINISTRATIVE CODE (WAC 296-155-428, WAC 296-24-960), NATIONAL ELECTRIC SAFETY CODE (NECS-2002, RULES 236/237), AND SCL CONSTRUCTION GUIDELINE (D2-3).

POLE LOCATION WITHIN STREET RIGHT-OF-WAY MUST HAVE SDOT APPROVAL.

Figure 4-23

September 2005

Seattle City Light Utility Clearance



NOT TO SCALE