





City of Seattle

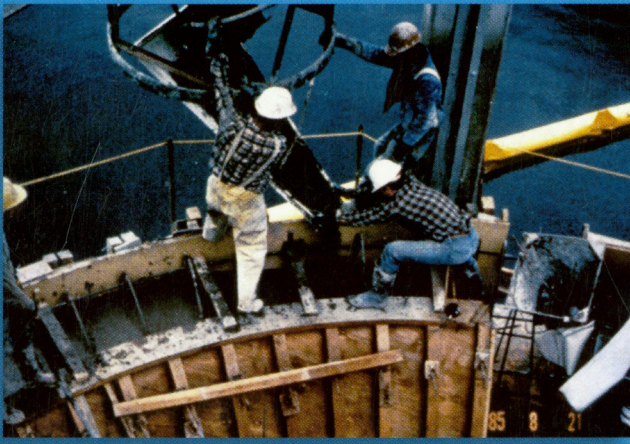


STANDARD PLANS FOR MUNICIPAL CONSTRUCTION

2003 EDITION

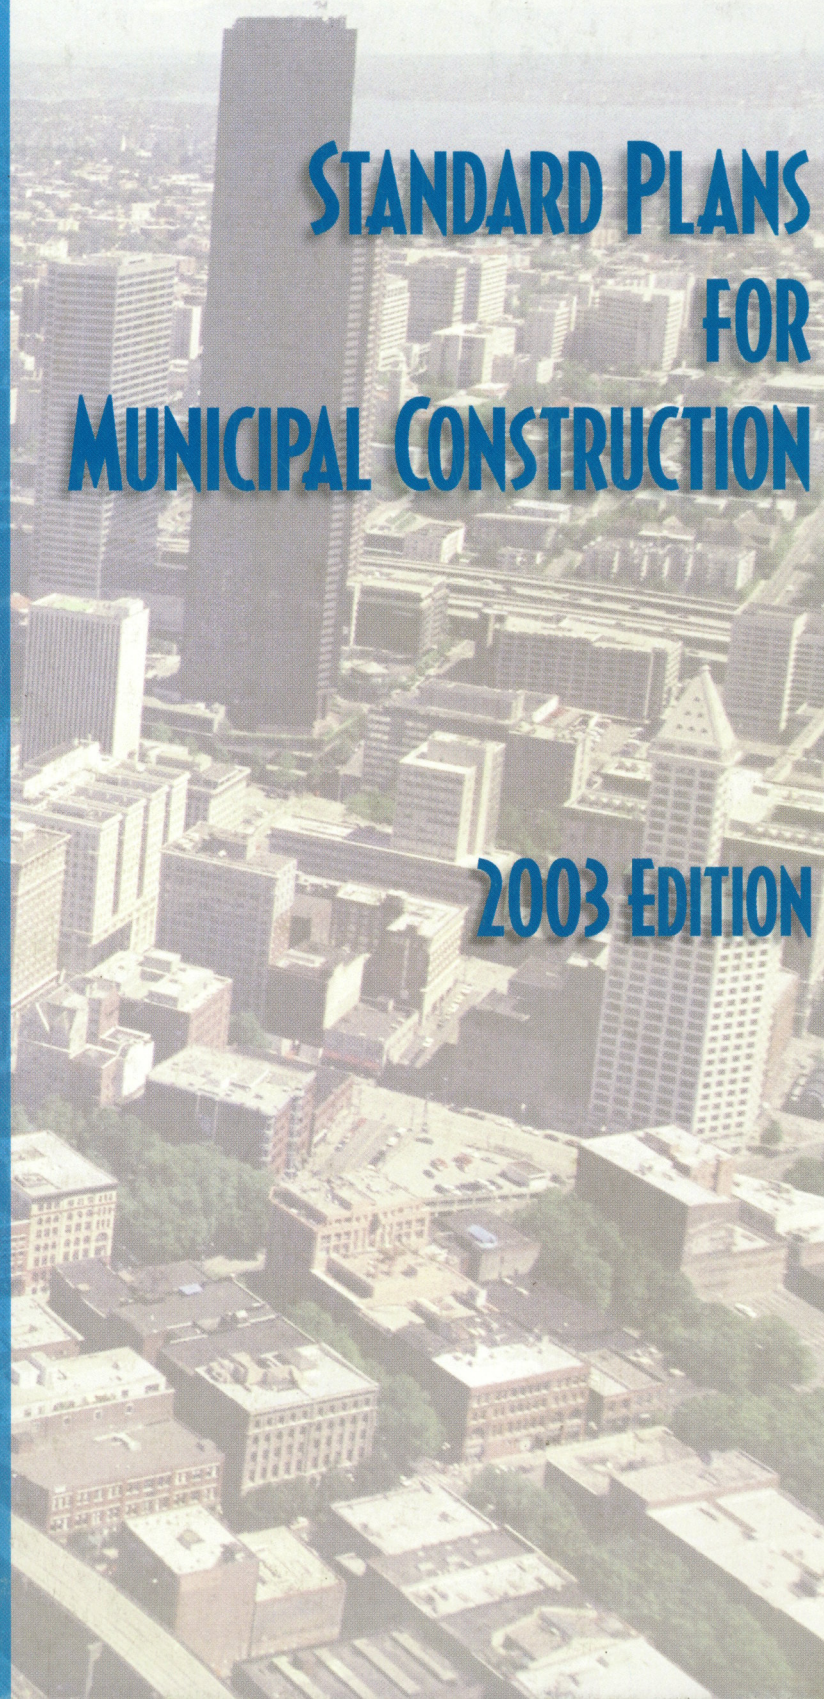

STANDARD PLAN NO 001

REV DATE: 2003

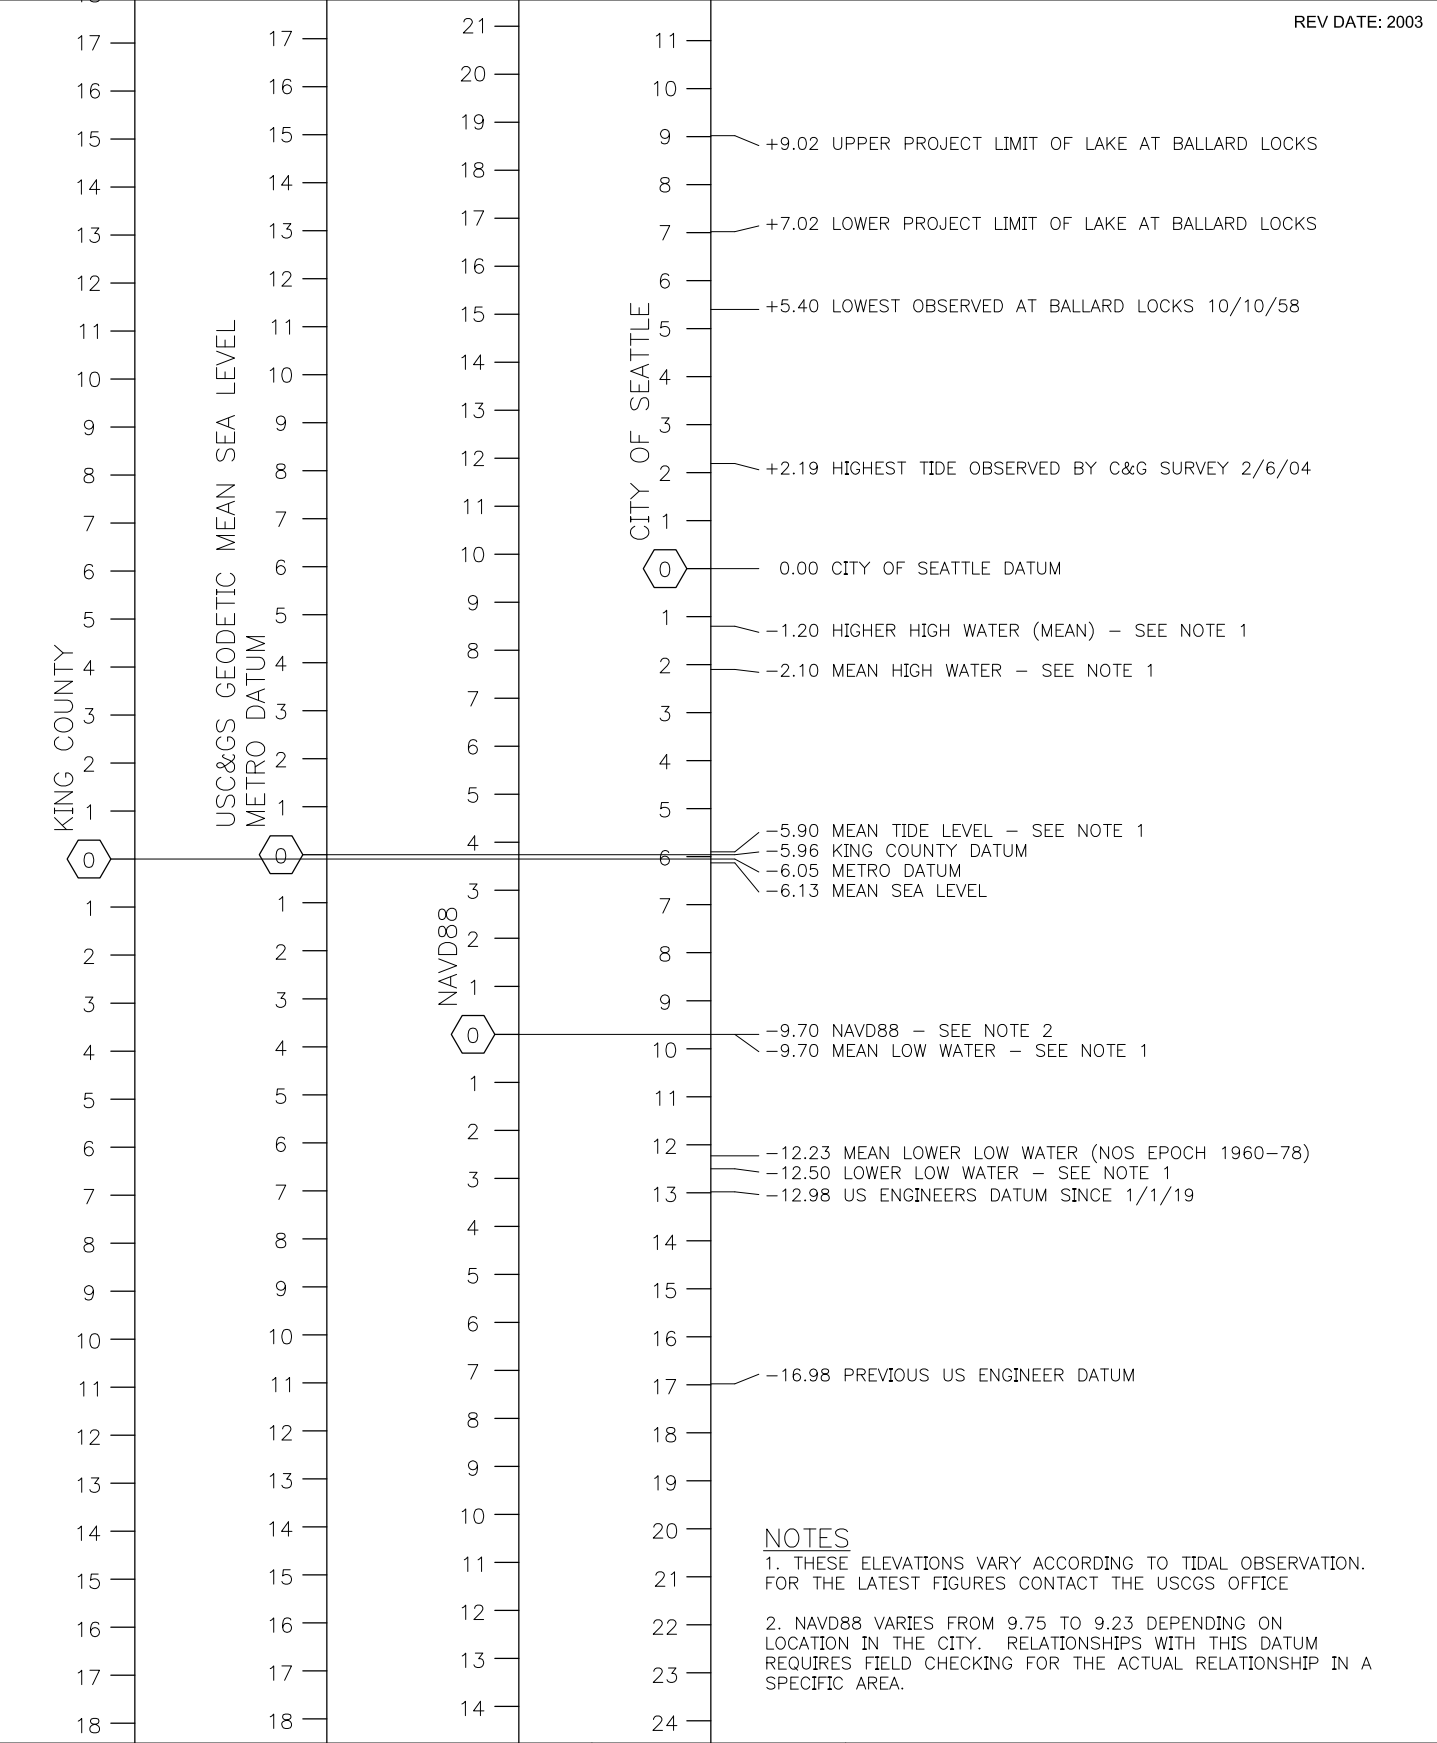

NOTES
 1. THESE ELEVATIONS VARY ACCORDING TO TIDAL OBSERVATION. FOR THE LATEST FIGURES CONTACT THE USCGS OFFICE
 2. NAVD88 VARIES FROM 9.75 TO 9.23 DEPENDING ON LOCATION IN THE CITY. RELATIONSHIPS WITH THIS DATUM REQUIRES FIELD CHECKING FOR THE ACTUAL RELATIONSHIP IN A SPECIFIC AREA.



NOT TO SCALE

ELEVATIONS & DATUMS

STANDARD PLAN NO 002

REV DATE: 2003

ABAN	Abandon(ed)
ABW	Asphalt Bike Way
ACV	Automatic Control Valve
ACP	Asphalt Concrete Pavement
ADA	Americans with Disabilities Act
ADJ	Adjust
AHD	Ahead
AIC	Aerial Interconnect Cable
AL	Aluminum
AP	Angle Point
APP	Approved
APPROX	Approximate
APWA	American Public Works Association
ASPH	Asphalt
ATB	Asphalt Treated Base
AV	Air Valve
AVB	Automatic Vacuum Breaker
AVE	Avenue
AVG	Average
AW	Asphalt Walk
AWG	American Wire Gage
AWWA	American Water Works Assoc.
B&B	Ball & Burlap
BC	Bolt Circle, Back of Curb
BF	Bottom Face
BFV	Butterfly Valve
BK	Back
BLDG	Building
BLK	Block
BLKG	Blocking
BLKHD	Bulkhead
BLRD	Bollard

BLVD	Boulevard
BM	Bench Mark
BO	Blow Off
BOC	Beginning of Curb
BPD	Backflow Prevention Device
BR	Bare Root, Brick
BRG	Bearing
BRKN	Broken
BSMT	Basement
BTW	Between
BV	Ball Valve
BVC	Beginning of Vertical Curve
C&G	Curb & Gutter
CAL	Caliper
CB	Cable, Catch Basin
CBW	Concrete Bike Way
C-C	Center to Center
CC	Concrete Culvert
CD	Conduit
CDF	Controlled Density Fill
CEM	Cement
CF	Cubic Feet
CH	Chamber
CIP	Cast Iron Pipe
CL	Center Line or Class
℄	Center Line
CLF	Chain Link Fence
CLR	Clearance
CMP	Corrugated Metal Pipe
CO	Clean Out
COMP	Compression
CONC	Concrete

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

STANDARD PLAN NO 002

REV DATE: 2003

COND	Condition
CONN	Connect/Connection
CONSTR	Construction
CONT	Continuous
CORP	Corporation
CR	Cross, Curb Radius
CSB	Chief Seattle Base
CULV	Culvert
CW	Concrete Walk
CY	Cubic Yard
DB	Direct Burial Cable
DC	Direct Current
DCVA	Double Check Valve Assembly
DEPT	Department
DGV	District Gate Valve
DIA ϕ	Diameter
DIP	Ductile Iron Pipe
DIPRA	Ductile Iron Pipe Research Assoc.
DR	Drive
DS	Downspout
DWG	Drawing
DWY	Driveway
E	East
EA	Each
ECB	Electrical Cable
ECC	Eccentric
ECD	Electrical Conduit
ED	Electrical Duct
EL/ELEV	Elevation
ELEC	Electric/Electrical
EMH	Electrical Manhole
ENCL	Enclosure

ENGR	Engineer
EOC	End of Curb
EQ	Equal
ESMT	Easement
EV	Electrical Vault
EVC	End of Vertical Curve
EW	Each Way
EX	Existing
EXP	Expansion
FACB	Fire Alarm Cable
FAHH	Fire Alarm Handhole
FC	Face of Curb
FCS	Flow Control Structure
FDN	Foundation
FF	Far Face, Finished Floor
FIG	Figure
FIPT	Female Iron Pipe Thread
FLG	Flange
FLR	Floor
FLT	Flat Bar
FM	Force Main
FO	Fiber Optics
FS	Far Side
FT	Feet
FTG	Footing
G	Gas
G REG	Gas Regulator
GA	Gauge
GAL	Gallon
GALV	Galvanize/Galvanized
GAS V	Gas Valve
GFCI	Ground Fault Circuit Interrupter

REF STD SPEC SEC 1-01.2



City of Seattle


NOT TO SCALE

ABBREVIATIONS

STANDARD PLAN NO 002

REV DATE: 2003

GIP	Galvanized Iron Pipe
GM	Gas Meter
GND	Ground
GP	Guy Pole
GPM	Gallons Per Minute
GR	Grade
GRHH	Ground Rod Handhole
GSP	Galvanized Steel Pipe
GV	Gate Valve
GVC	Gate Valve Chamber
GVL	Gravel
HB	Horizontal Bend
HEX	Hexagon/Hexagonal
HGL	Hydraulic Grade Line
HH	Handhole
HI	High
HORIZ	Horizontal
HPG	High Pressure Gas
HPS	High Pressure Sodium
HR	Hour
HSE	House
HYD	Hydrant
ID	Inside Diameter/Dimension
IE	Invert Elevation
IF	Inside Face
IN	Inch(es)
INL	Inlet
INT	Intersection
INV	Invert (Line)
IP	Iron Pipe
IRC	Irrigation Controller
IRRG	Irrigation

ISO	Isolation Coupling
JB	Junction Box
JT	Joint
KV	Kilovolt
LAL	Limited Access Line
LBS	Pounds
LF	Lineal Feet
LID	Local Improvement District
LIT	Large Inlet Top (Catch Basin)
LOC	Locate/Location
LONGIT	Longitudinal
LP	Light Pole
LS	Lump Sum
LSCAPE	Landscape, Landscaping
LT	Left
LUM	Luminaire
MA	Mast Arm
MAX	Maximum
MCV	Manual Control Valve
MDV	Manual Drain Valve
MH	Manhole
MIC	Monument in Case
MIN	Minimum
MIPT	Male Iron Pipe Thread
MISC	Miscellaneous
MJ	Mechanical Joint
ML 	Monument Line
MNRL AGG	Mineral Aggregate
MOD	Modify/Modified
MON	Monument
MW	Monitor Well
N	North

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

STANDARD PLAN NO 002

REV DATE: 2003

NAD	North American Datum
NAVD	North American Vertical Datum
NF	Near Face
NGVD	National Geodetic Vertical Datum
NIC	Not In Contract
NO	Number
NOM	Nominal
NS	Near Side
NTS	Not To Scale
OC	On Center
OD	Outside Diameter/Dimension
OF	Outside Face
OH	Overhead
PAV	Pavement
PC	Point of Curvature
PCC	Point of Compound Curve
PDP	Perforated Drain Pipe
PE	Plain End
PED	Pedestrian
PH	Phase
PI	Point of Intersection
PL	Plate, Place
ℙ	Property Line
POC	Point on Curve
PP	Power Pole
PPB	Pedestrian Push Button
PR	Pair
PRC	Point of Reverse Curve
PROP	Proposed
PRKG	Parking
PRV	Pressure Reducing Valve
PS	Pipe Sewer Combined

PSD	Pipe Storm Drain
PSDD	Pipe Storm Drain Detention
PSI	Pounds per Square Inch
PSIA	Pounds per Square Inch Absolute
PSIG	Pounds per Square Inch Gauge
PSS	Pipe Sewer Sanitary
PT	Point of Tangency
PVB	Pressure Vacuum Breaker
PVC	Polyvinyl Chloride
PVT	Private
QTY	Quantity
R	Radius
R&R	Remove & Replace
R/W	Right of Way
RCP	Reinforced Concrete Pipe
RD	Roof Drain
RDWY	Roadway
RECONN	Reconnect
RED	Reducer
REF	Refer/Reference
REINF	Reinforcing/Reinforcement
RELOC	Relocate
REM	Remove
REPL	Replace
REQD	Required
RET	Retire/Retired
RET WALL	Retaining Wall
RF	Rock Facing
RGS	Rigid Galvanized Steel
RIT	Round Inlet Top
RLWY	Railway
RP	Rock Pocket

REF STD SPEC SEC 1-01.2



City of Seattle

NOT TO SCALE

ABBREVIATIONS

STANDARD PLAN NO 002

REV DATE: 2003

RPBA	Reduced Pressure Backflow Assembly
RR	Railroad
RS	Rigid Steel
RT	Right
S	South
SB	Sandbox
SCH	Schedule
SCL	Seattle City Light
SDS	Street Designation sign
SD	Service Drain
SDOT	Seattle Department of Transportation
SEC	Section
SHLD	Shield
SHT	Sheet
SL	Sleeve, Street Light
ℒ	Survey Line
SLHH	Street Light Handhole
SNS	Street Name Sign
SP	Strain Pole
SPCS	Spaces
SPEC	Specifications
SPU	Seattle Public Utilites
SQ	Square
SS	Stainless Steel, Side Sewer-Combined
SSD	Sub-Surface Drain
SSS	Side Sewer - Sanitary
SSTONE	Sandstone
ST	Street
STA	Station
STD	Standard
STL	Steel
STL P	Steel Pipe

STM LOG	Steam Log
STRUCT	Structure/Structural
SY	Square Yard
SYS	System
T	Tee
TB	Test Boring
TC	Traffic Control
TCB	Telephone Cable
TCD	Telephone Conduit
TCHH	Traffic Control Handhole
TD	Telephone Duct
TEB	Telephone Enclosure Box
TEL	Telephone
TEMP	Temporary
TF	Top Face
TH	Test Hole
THH	Telephone Handhole
TJO	Transfer of Jurisdiction Ordinance
TMH	Telephone Manhole
TN	Ton
TR	Traffic
TRCB	Traffic Signal Cable
TRCD	Traffic Signal Conduit
TRSCC	Traffic Signal Controller Cabinet
TVCB	Television Cable
TVHH	Television Handhole
TYP	Typical
UG	Underground
UIC	Underground Interconnect
UNC	Unified National Coarse
UP	Utility Pole
V	Valve, Variable

REF STD SPEC SEC 1-01.2




City of Seattle

NOT TO SCALE

ABBREVIATIONS

V/C	Vertical Curve
VAR	Variable/Varies
VB	Vertical Bend
VBOX	Valve Box
VCH	Valve Chamber
VEH	Vehicle
VERT	Vertical
VMS	Variable Message Sign
VO	Vacation Ordinance
W	Water, West
W/	With
WCR	Wheel Chair Ramp
WD	Wood/Wooden
WIF	Wrought Iron Fence
WM	Water Meter, Water Main
WMR	Water Main Radius
WP	Wood Pole
WSP	Wood Stave Pipe
WU	Western Union
WV	Water Valve
WWF	Welded Wire Fabric
XP	Transmission Pole



REF STD SPEC SEC 1-01.2




















City of Seattle

NOT TO SCALE
































ABBREVIATIONS

ITEM	EXISTING	LINE PROPOSED WEIGHT	LINE CAD WEIGHT NOTES	
Signal Controller Cabinet		.014		.020 ECAB PCABII or PCABIII draw to size
Electrical Vault		.014		.020 EVAULT / PEV draw to size
Electrical Cable (direct burial)	ECB	.014	ECB	.024 LT=ECd 6-1-1-1
Electrical Conduit	1" ECD	.014	1" ECD	.024 LT=ECd 6-1-1-1
Electrical Duct	12" X12" ED	.014	12" X12" ED	.024 LT=ECd 6-1-1-1
Combined Electrical & Telephone Duct	12" X12" ED-TD	.014	12" X12" ED-TD	.024 LT=ECd 6-1-1-1
Span Wire		.014		.024
Aerial Interconnect Cable	AIC	.014	AIC	.024
Transmission Pole (steel w/ conc base)	XP	.014		.024 EXP PXP
City Wood Pole	PP	.014		.024 EPP PWP
City Wood Pole w/ HPS	PP	.014		.024 EPPLT PWP+PBARM+PLUM

ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Light Pole (metal) w/ HPS		.014		.024	ELP PLP+PBARM+PLUM
Strain Pole (metal)		.014			ESP/PSP
Combined Lighting Strain Pole HPS		.014		.024	ESPLT PSP+PBARM+PLUM
Luminaire		.014		ELUM	
Mercury Vapor Luminaire		.014		EMVL	
Double Light Pole		.014		EDBLT	
Utility Wood Pole		.014		.024	EPP/PUP
Utility Guy Pole		.014		.024	EPP/PUP
Anchor		.014		.024	EGUY/PGUY
Ground		.014		.024	GND



ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT NOTES
Traffic Signal Mast Arm Pole		.014		.028 ESIG PMAP+PMAST# +PSIGV
Traffic Signal Mast Arm Pole w/ Luminaire		.014		.028 ESIG+ELUM PMAP+PMAST# PLUM+PSIGV
Traffic Signal on Span Wire		.014		.028 ESIG/PSIGV
Multi-Directional Traffic Signal on Span Wire		.014		ESIG
Traffic Signal Conduit		.014		.028 or .031 LT=ECd 6-1-1-1
Traffic Signal Cable		.014		.028 or .031 LT=ECd 6-1-1-1
Detector Loop, Dipole (loop schedule)		.014		.020 ELOOP1 PLOOP## drawn to size
Detector Loop, Quadrapole (loop schedule)		.014		ELOOP2
Pressure Detector		.014		drawn to size

ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Traffic Signal Pole		.014			ETRSP
Signal Pedestal		.014		.020	EPEDP PPEDP
Vehicle Signal		.014			ESIG
Vehicle Signal w/ Backplate		.014		.020	ESIGNBK PSIGV
Vehicle Signal (optically programmed)		.014		.020	ESIGOP PSIGVOP
Pedestrian Signal		.014		.020	EPEDSIG PSIGP
Pedestrian Signal (optically programmed)		.014		.020	EPEDSGOP PSIGPOP
Pedestrian Push Button Pedestal		.014			EPPBP PPPBP
Pedestrian Push Button		.014		.020	EPPB PPPB
Illuminated Sign		.014		.020	EILLSIGN PILLSIGN
Non-illuminated Sign		.014		.020	ENILSIGN PNILSIGN
Junction Box		.014			EJB
Handhole		.014		.020	EHH / PHH#
Traffic Control Handhole		.014		.020	EHH PHH#
Street Light Handhole		.014		.020	EHH PHH#
Ground Rod Handhole		.014		.020	EHH PHH#
Fire Alarm Handhole		.014		.020	EHH



City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
ELECTRICAL

CAD NOTES



Vehicle & Pedestrian Signal Head
(?=Identification Number)

PHEX



Illuminated Traffic Sign
(?=Identification Number)

PBOX



Cable Runs
(?=Run Number per Wiring Schedule)

PTRI



Removal/Relocation Item
(?=Identification Number per Removal/Relocation Plan)

PCIR























Construction Item
(?=Identification Number per Signalization Plan)

POVAL

Signal Poles, Signal Pedestals, Push Button Pedestals &
Push Buttons Identified by Number on Signalization Plan.































ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Cement Concrete Pavement	 <p>6" CONC</p>	.014	 <p>6" CONC PAV</p>	.020	<p>DOTS Color 22 Suggested scale 20 Angle 45</p>
Asphalt Concrete Pavement	 <p>2" ASPH/6" CONC</p>	.014	 <p>8" -402B PAV</p>	.020	<p>DOTS Color 22 Suggested scale 10 Angle 45</p>
Asphalt Concrete Surfacing	 <p>2" ASPH</p>	.014	 <p>2" ASPH</p>	.020	<p>DOTS Color 22 Suggested scale 10 Angle 45</p>
Curb		.014	 <p>TYPE 410C CURB</p>	.028	
Cement Concrete Walk	 <p>CW</p>	.014	 <p>CW</p>	.020 .028	<p>AR-CONC Color 22 Suggested scale 1.0 Angle 45</p>
Curb Ramp		.014		.020 .028	<p>EWCR user modified PWCR user modified AR-CONC</p>
Conc Dwy		.014		.020 .028	<p>AR-CONC Color 22 Suggested scale 1.0 Angle 45</p>
Cement Concrete Bike Way	 <p>3" CBW</p>	.014	 <p>3" CBW</p>	.020	<p>AR-CONC Color 22 Suggested scale 1.0 Angle 45</p>
Asphalt Concrete Bike Way	 <p>3" ABW</p>	.014	 <p>3" ABW</p>	.020	<p>DOTS Color 22 Suggested scale 10 Angle 45</p>
Grading	 <p>GRADED</p>	.014	 <p>TO BE GRADED</p>	.020	<p>SPU Customized Command: ASPH</p>



ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Manholes		.014	MH-7	.031	EMH+ECASTC/ PMH LT=MH
Inlet Type 250A		.014		.031	EINL250A PINL250A
Inlet Type 250B		.014		.031	EINL250B PINL250B
Inlet Type 252		.014		.031	EINL252 PINL252
Inlet Type 268		.014			EINL250A
Catch Basin round inlet top		.014			ECB-RND
Private CB & Inlet		.014			ECB-PRIV
Catch Basin Type 151 (pre 1985)		.014			ECB151
Catch Basin Type 240A		.014		.031	ECB240A PCB240A
Catch Basin Type 240B		.014		.031	ECB240B PCB240B
Catch Basin Type 240C		.014		.031	ECB240C PCB240C
Catch Basin Type 240D				.031	PCB240D
Catch Basin Type 241		.014		.031	ECB241 PCB241
Catch Basin Type 242A		.014		.031	ECB242A PCB242A
Catch Basin Type 242B		.014		.031	ECB242B PCB242B
Catch Basin Type 277A		.014		.031	ECB277A PCB277A
Catch Basin Type 277B		.014		.031	ECB277B PCB277B
Sand Box		.014			ESB
Clean Out		.014		.031	ECO/PCO



ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Concrete Culvert		.014		.024	LT=PSS
Pipe Sewer Combined <1'-0" Dia		.014		.031	LT=PSS
Pipe Sewer Combined ≥1'-0" Dia		.014		.024	LT=PSS DOTS scale 10
Side Sewer Combined		.014		.028	LT=SD
Pipe Sewer Sanitary <1'-0" Dia		.014		.031	LT=PSS
Pipe Sewer Sanitary ≥1'-0" Dia		.014		.024	LT=PSS ANSI31 scale 20 / angle 90
Side Sewer Sanitary		.014		.028	LT=SD
Pipe Storm Drain <1'-0" Dia		.014		.031	LT=PSS
Pipe Storm Drain ≥1'-0" Dia		.014		.024	LT=PSS ANSI31 scale 10
Service Drain		.014		.028	LT=SD
Inlet & CB Connection		.014		.028	LT=SD
Open Ended Pipe		.014		.031	ETIC PTIC
Small Ditch or Stream		.014		.020	LT= ENDITCH LT= PNDITCH
Large Ditch or Stream		.014		.020	LT= WDITCH



NOT TO SCALE

STANDARD SYMBOLS
SEWER & DRAINAGE

ITEM	EXISTING	LINE PROPOSED WEIGHT	LINE WEIGHT	CAD NOTES
Bench Mark (found or set)		.014		ESVBM
Brass Plug/Cap (found or set)		.014		ESVBP
Hub/Tack (found or set)		.014		ESVHUB
Monument in Case (found or set)		.014		ESVMIC
Conc. Mon. (found or set)		.014		ESVMON
Rebar/Cap, Pipe/Cap Rebar, Iron Pipe (found or set)		.014		ESVRB
Tack/Lead, Tack PK Nail, Spike (found or set)		.014		ESVTK
Bench Mark (not found)		.007		ESVNFMBM
Brass Plug/Cap (not found)		.007		ESVNFBP
MIC. (not found)		.007		ESVNFMIC
Conc. Mon. (not found)		.007		ESVNFMON
Rebar/Cap, Pipe/Cap Rebar, Iron Pipe (not found)		.007		ESVNF RB
Tack/Lead, Tack PK Nail, Spike (not found)		.007		ESVNF TK
Survey Shot Point		.014		ESVSHOTP



NOT TO SCALE



























STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Center Line		.014			LT=CENTER3
Monument Line		.014			LT=CENTER3
Survey Line		.014			
Right of Way Line		.028			
Lot & Ownership Line		.014			
Permanent Easement Line		.031		.02	LT=EASEMENT
Temp Const Easement Line				.07	LT=DOT2
Vacated Street or Alley		.028			LT=PSS
State Highway Limited Access Line	STATE LAL	.028			LT=BUILDING
Building		.014			LT=BUILDING
Chain Link Fence		.014		.014	LT=CHAIN_LINK_FENCE
Wood Fence		.014		.014	LT=WOOD_FENCE
Guardrail		.014		.014	LT=GUARD_RAIL
Rock Facing		.014		.012	SPU Customized Command: ROCKWALL
Rock Facing		.014			EROCK
Riprap		.014		.012	ERIPRAP PRIPRAP
Tree <1'-0" DIA		.014	PER DRAWINGS		EDECIDSM/ECONFISM PDECIDSM/PCONFISM draw to scale
Tree ≥1'-0" DIA		.014	PER DRAWINGS		ESTRUNK+ESDCANOP ESTRUNK+PSDCANOP draw to scale



NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC





ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Shrub or Bush		.014		.020	ESHRUB PSHRUB
Ground, Grade Line		.014		.014	LT=DASHED2
Grade (arrow downhill)		.014		.014	
Rail Road Tracks		.014			SPU Customized Command
City Limits		.024			LT=BORDER
Slope Line				.014	
Contours		.014		.014	
Slope Angle Horiz:Vert		.014		.014	
Vertical Curve		.014		.014	
Depression		.014		.014	
Stump		.014			ESTUMP
Top of Cut Toe of Fill				.014	
Dimension Line		.014		.014	
Match Line		.014		.020	
Test Hole & Number (test boring)		.014		.003	ESVBM
Bench Mark		.014			ESVBM
















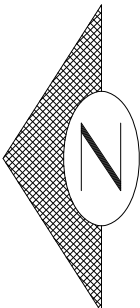





City of Seattle

NOT TO SCALE

STANDARD SYMBOLS
TOPOGRAPHIC & MISC

ITEM	EXISTING	LINE PROPOSED WEIGHT	LINE CAD WEIGHT NOTES		
Monitor Well	MW ○	.014	EMWELL		
Street Name Sign	□	.014	ESNS		
US Mail Box	US □	.014	EMAILUS		
Private Mail Box	□	.014	EMAILPVT		
Bollard	○	.014	EBLRD/PBLRD		
Post	□	.014	EPOST		
Parking Meter	≡	.014	EPRKM		
Rectangular Casting	□	.014	ECASTR		
Circular Casting	○	.014	ECASTC		
Column	○	.014	ECOLUMN		
Jersey Barrier		.014		.020	PJERSEY
Tree Pit	□	.014		.020	PTPIT or draw to scale
North Arrow horizontal					NORTHHOR
North Arrow vertical		.012			NORTHVER



























ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Telephone Cable (direct burial)		.014			LT=TEL 6-1-1 (typical)
Telephone Conduit		.014			
Telephone Duct		.014			
Telephone Enclosure		.014			ETELENCL
Telephone Manhole		.014			draw to scale
Telephone Pole		.014			
Telephone Handhole		.014			EHH draw to scale
Television Cable (direct Burial)		.014			LT=TV 6-1-1-1
Television Handhole		.014			EHH draw to scale
Telegraph Manhole		.014			draw to scale
Steam Log		.014			LT=STEAM 2-2
Steam Vault		.014			draw to scale
Gas Main		.014			LT=GAS 6-1-6 (typical)
Gas Valve		.014			EVALVE
Gas Meter		.014			EGM
Gas Regulator		.014			EGREG
Petroleum or Oil		.014			
Abandon(ed)		.014		.024	



City of Seattle



NOT TO SCALE

STANDARD SYMBOLS
PRIVATE UTILITIES

ITEM	EXISTING	LINE WEIGHT	PROPOSED	LINE WEIGHT	CAD NOTES
Watermain <8"Dia		.014	6" W	.031	LT=WATER 6-6 (typical)
Watermain ≤8"<1'-0"Dia		.014	8" W	.031	
Watermain ≥1'-0"Dia		.014	24" W	.031	DOTS scale 20
11 1/4° Bend w/ Conc Blocking		.014	8" - 11 1/4° HBorVB	.031	EHB11 PHB11 + PCONCBLK
22 1/2° Bend		.014	8" - 22 1/2° HBorVB	.031	EHB22 PHB22
45° Bend		.014	8" - 45° HBorVB	.031	EHB45 PHB45
90° Bend		.014	8" - 90° HBorVB	.031	EHB90 PHB90
Cross		.014	8" X 8" X 6" X 6" CR	.031	ECROSS / PCROSS
Tee		.014	8" X 8" X 6" T	.031	ETEE / PTEE
Pipe Sleeve				.031	PSLEEVE
Plug w/ Conc Blocking		.014	 or 	.031	PTIC + PCONCBLK EPLUG
Hydrant		.014		.031	EHYD + ETEE PHYD + PTEE
Water Meter		.014		.031	EWM / PWM
Valve Box		.014		.031	EVBX
Gate Valve		.014	 4" GV W/VBOX	.031	EVALVE PVALVE
Gate Valve w/ Chamber		.014	 8" GV W/CH	.031	EWGV PWGV
Gate Valve w/ Vault Chamber		.014	 16" GV W/VCH	.031	EWGVVCH PWGVVCH
Reducer		.014	 8" X 4" RED	.031	ERED / PRED



ITEM	EXISTING	LINE PROPOSED WEIGHT	LINE CAD WEIGHT NOTES
Air Valve		.014	.031 EAV / PAV
Blowoff		.014	.031 EBO / PBO
Butterfly Valve w/ Valve Box		.014	.031 EVALVE PVALVE
Butterfly Valve w/ Chamber		.014	.031 EWGV PWGV
Water Chamber		.014	EWCH
Sprinkler Head		.014	ESPRKHD
Irrigation Valve		.014	EIRRGV

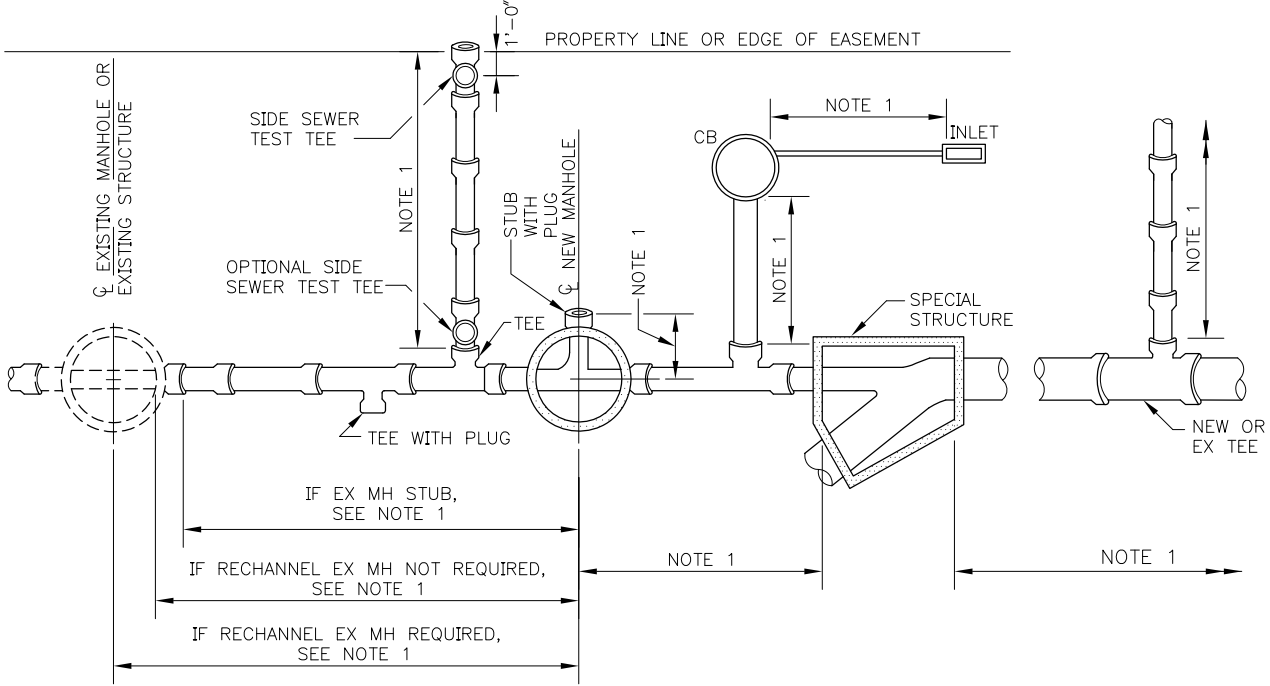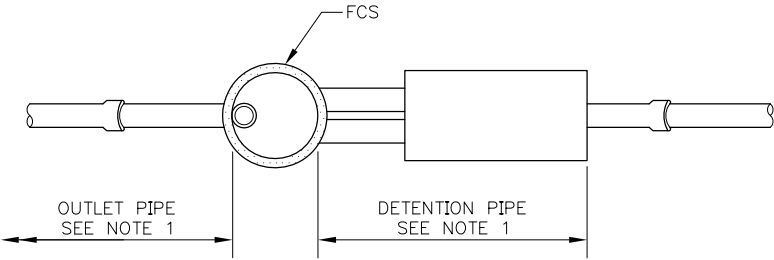

NOTES:

- 1. MEASUREMENT PER LINEAR FOOT. PIPE ENDING IN STRUCTURE MEASURED TO EITHER INSIDE FACE OR TO CENTERLINE OF STRUCTURE AS INDICATED, OR TO TEE OR WYE AS INDICATED.
- 2. TEE OR WYE INCLUDING PLUG - UNIT PRICE EACH
- 3. ALL PIPE SHALL BE MEASURED ON THE SLOPE ALONG THE CENTERLINE OF PIPE TO NEAREST 0.10 LF.



REF STD SPEC DIVISION 7



City of Seattle

NOT TO SCALE


SEWER/DRAINAGE
MEASUREMENT DIAGRAM

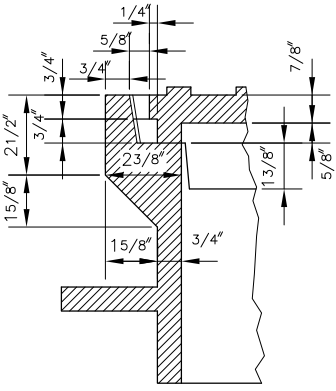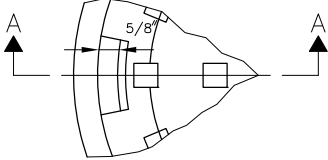


SECTION A-A

NOTES:

1. FRAME AND COVER SHALL BE TESTED FOR ACCURACY OF FIT AND SHALL BE MARKED IN SETS FOR DELIVERY
2. FRAME AND COVER SHALL BE CAST IRON AND HAVE BITUMINOUS COATING APPLIED TO ALL FACES
3. " f " = FINISH
4. CASTINGS IN RIGID PAVEMENT SHALL HAVE REINFORCING STEEL IN THE PAVEMENT.

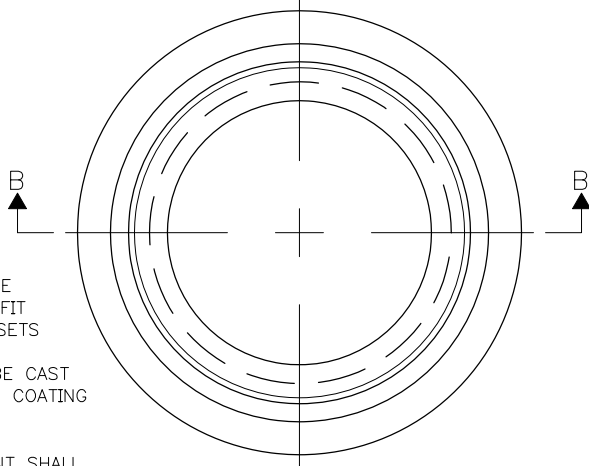


TOP VIEW

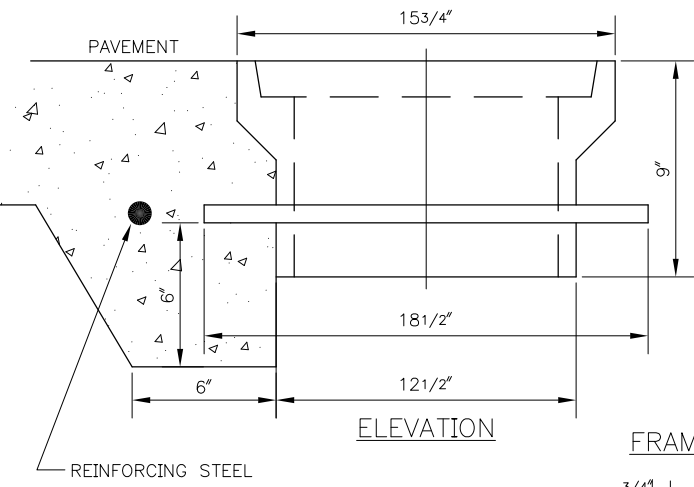


ELEVATION

FRAME

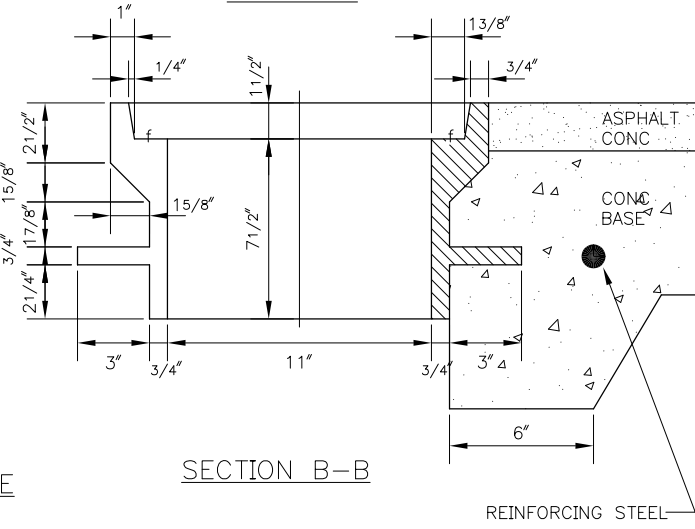

SECTION B-B

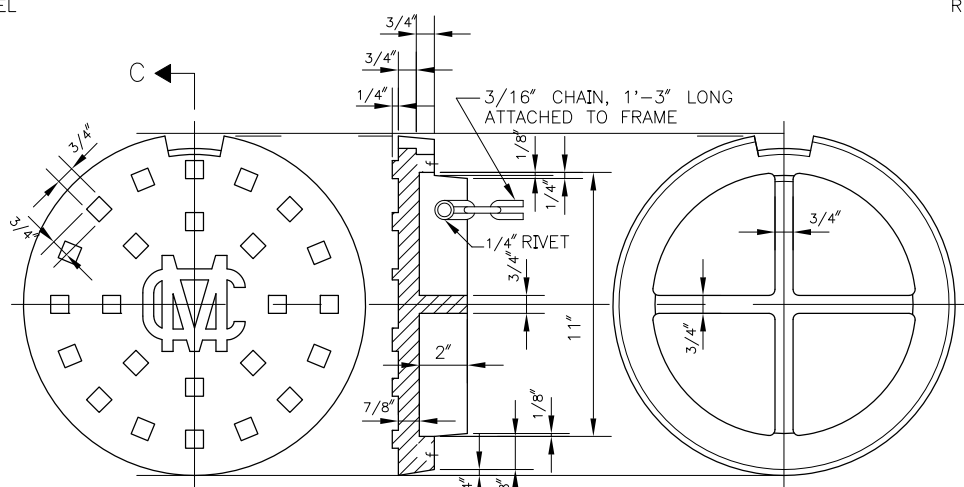

TOP VIEW

SECTION C-C

BOTTOM VIEW

COVER


REF STD SPEC SEC 8-13



City of Seattle

NOT TO SCALE

MONUMENT FRAME & COVER

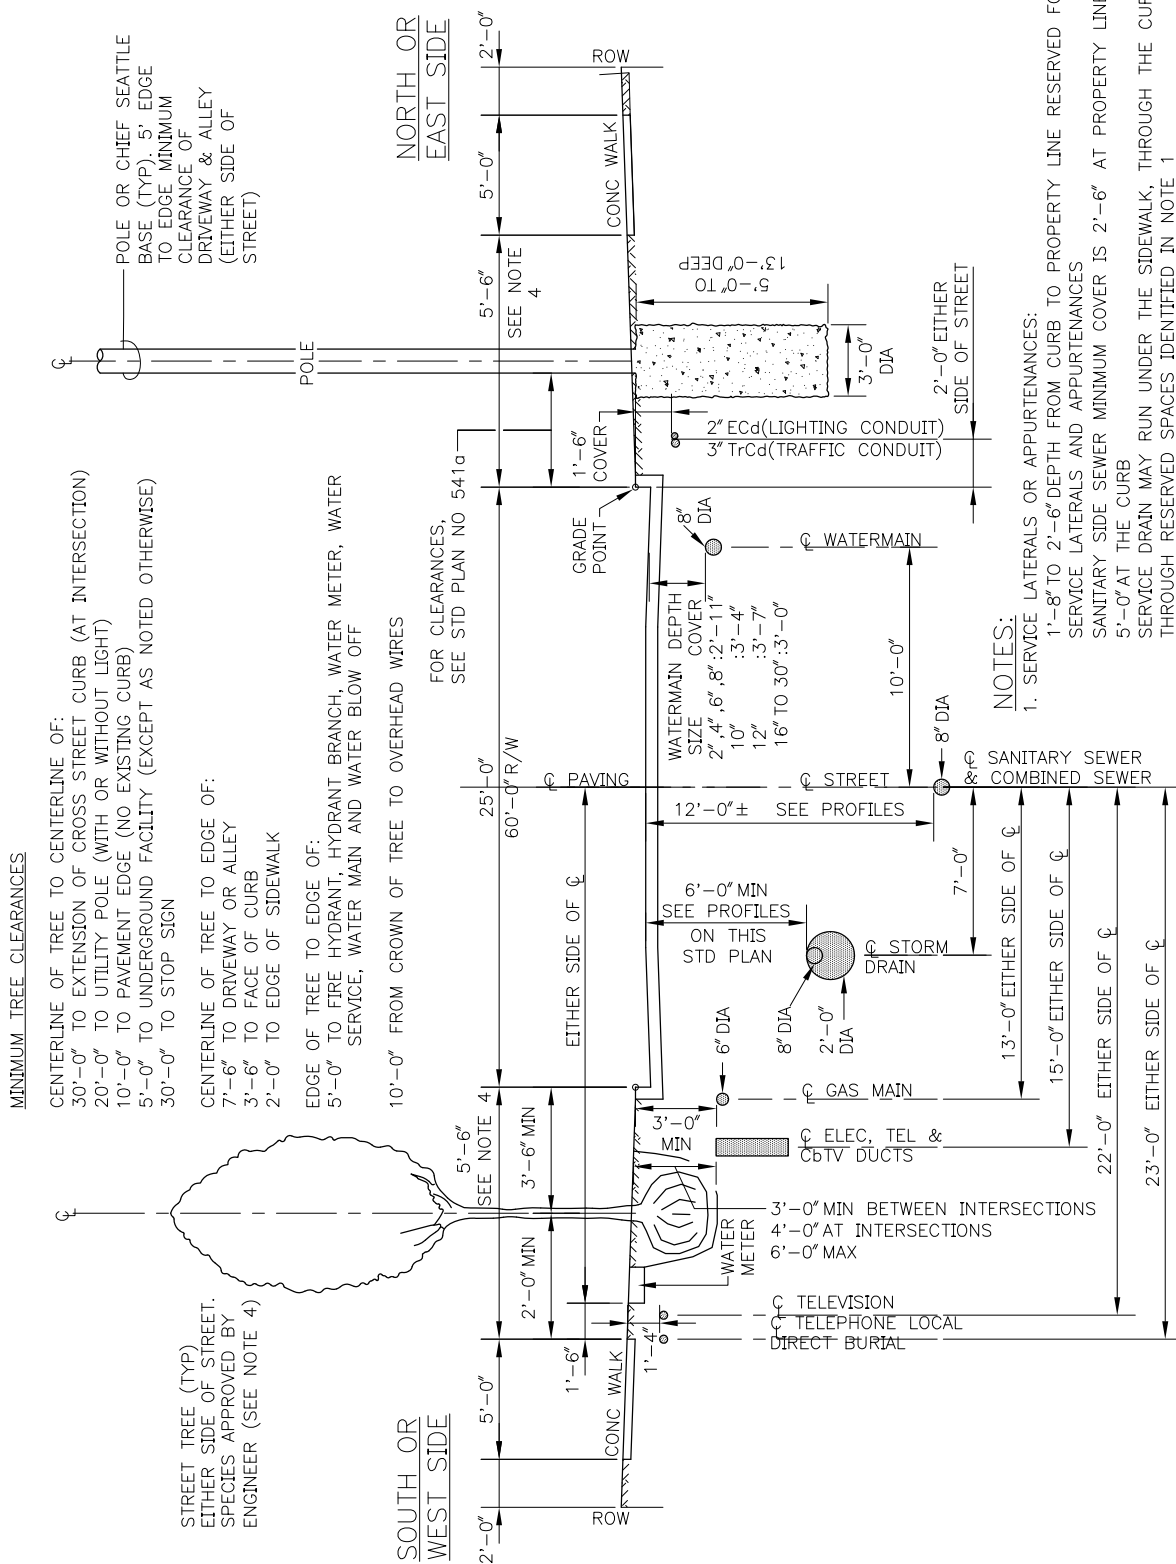

MINIMUM TREE CLEARANCES

CENTERLINE OF TREE TO CENTERLINE OF:
 30'-0" TO EXTENSION OF CROSS STREET CURB (AT INTERSECTION)
 20'-0" TO UTILITY POLE (WITH OR WITHOUT LIGHT)
 10'-0" TO PAVEMENT EDGE (NO EXISTING CURB)
 5'-0" TO UNDERGROUND FACILITY (EXCEPT AS NOTED OTHERWISE)
 30'-0" TO STOP SIGN

CENTERLINE OF TREE TO EDGE OF:
 7'-6" TO DRIVEWAY OR ALLEY
 3'-6" TO FACE OF CURB
 2'-0" TO EDGE OF SIDEWALK

EDGE OF TREE TO EDGE OF:
 5'-0" TO FIRE HYDRANT, HYDRANT BRANCH, WATER METER, WATER SERVICE, WATER MAIN AND WATER BLOW OFF
 10'-0" FROM CROWN OF TREE TO OVERHEAD WIRES

FOR CLEARANCES, SEE STD PLAN NO 541a

- NOTES:**
- SERVICE LATERALS OR APPURTENANCES:
 1'-8" TO 2'-6" DEPTH FROM CURB TO PROPERTY LINE RESERVED FOR SERVICE LATERALS AND APPURTENANCES
 SANITARY SIDE SEWER MINIMUM COVER IS 2'-6" AT PROPERTY LINE AND 5'-0" AT THE CURB
 SERVICE DRAIN MAY RUN UNDER THE SIDEWALK, THROUGH THE CURB OR THROUGH RESERVED SPACES IDENTIFIED IN NOTE 1
 - ELECTRIC POWER, GAS, TELEPHONE, TELEVISION AND TREES SHALL BE INSTALLED IN THE SAME RELATION TO THE CURB ON STREETS WITH PAVEMENT WIDTHS FROM 25'-0" TO 36'-0"
 - LAYOUT IS APPLICABLE TO 60'-0" R/W AND 25'-0" RESIDENTIAL PAVING STRIP, REDUCING CLEARANCE BETWEEN A NEW UTILITY AND EXISTING TREE/PLANTING EXISTING UTILITY OR CHANGING THE 5'-6" WIDTH OF PLANTING STRIP REQUIRES REVIEW AND APPROVAL OF THE ENGINEER AND MAY REQUIRE ADDITIONAL MITIGATING MEASURES


REF STD SPEC SEC 1-07.16, 1-07.17 & 1-07.28



City of Seattle

NOT TO SCALE

STANDARD LOCATIONS FOR UTILITIES (RESIDENTIAL STREET)

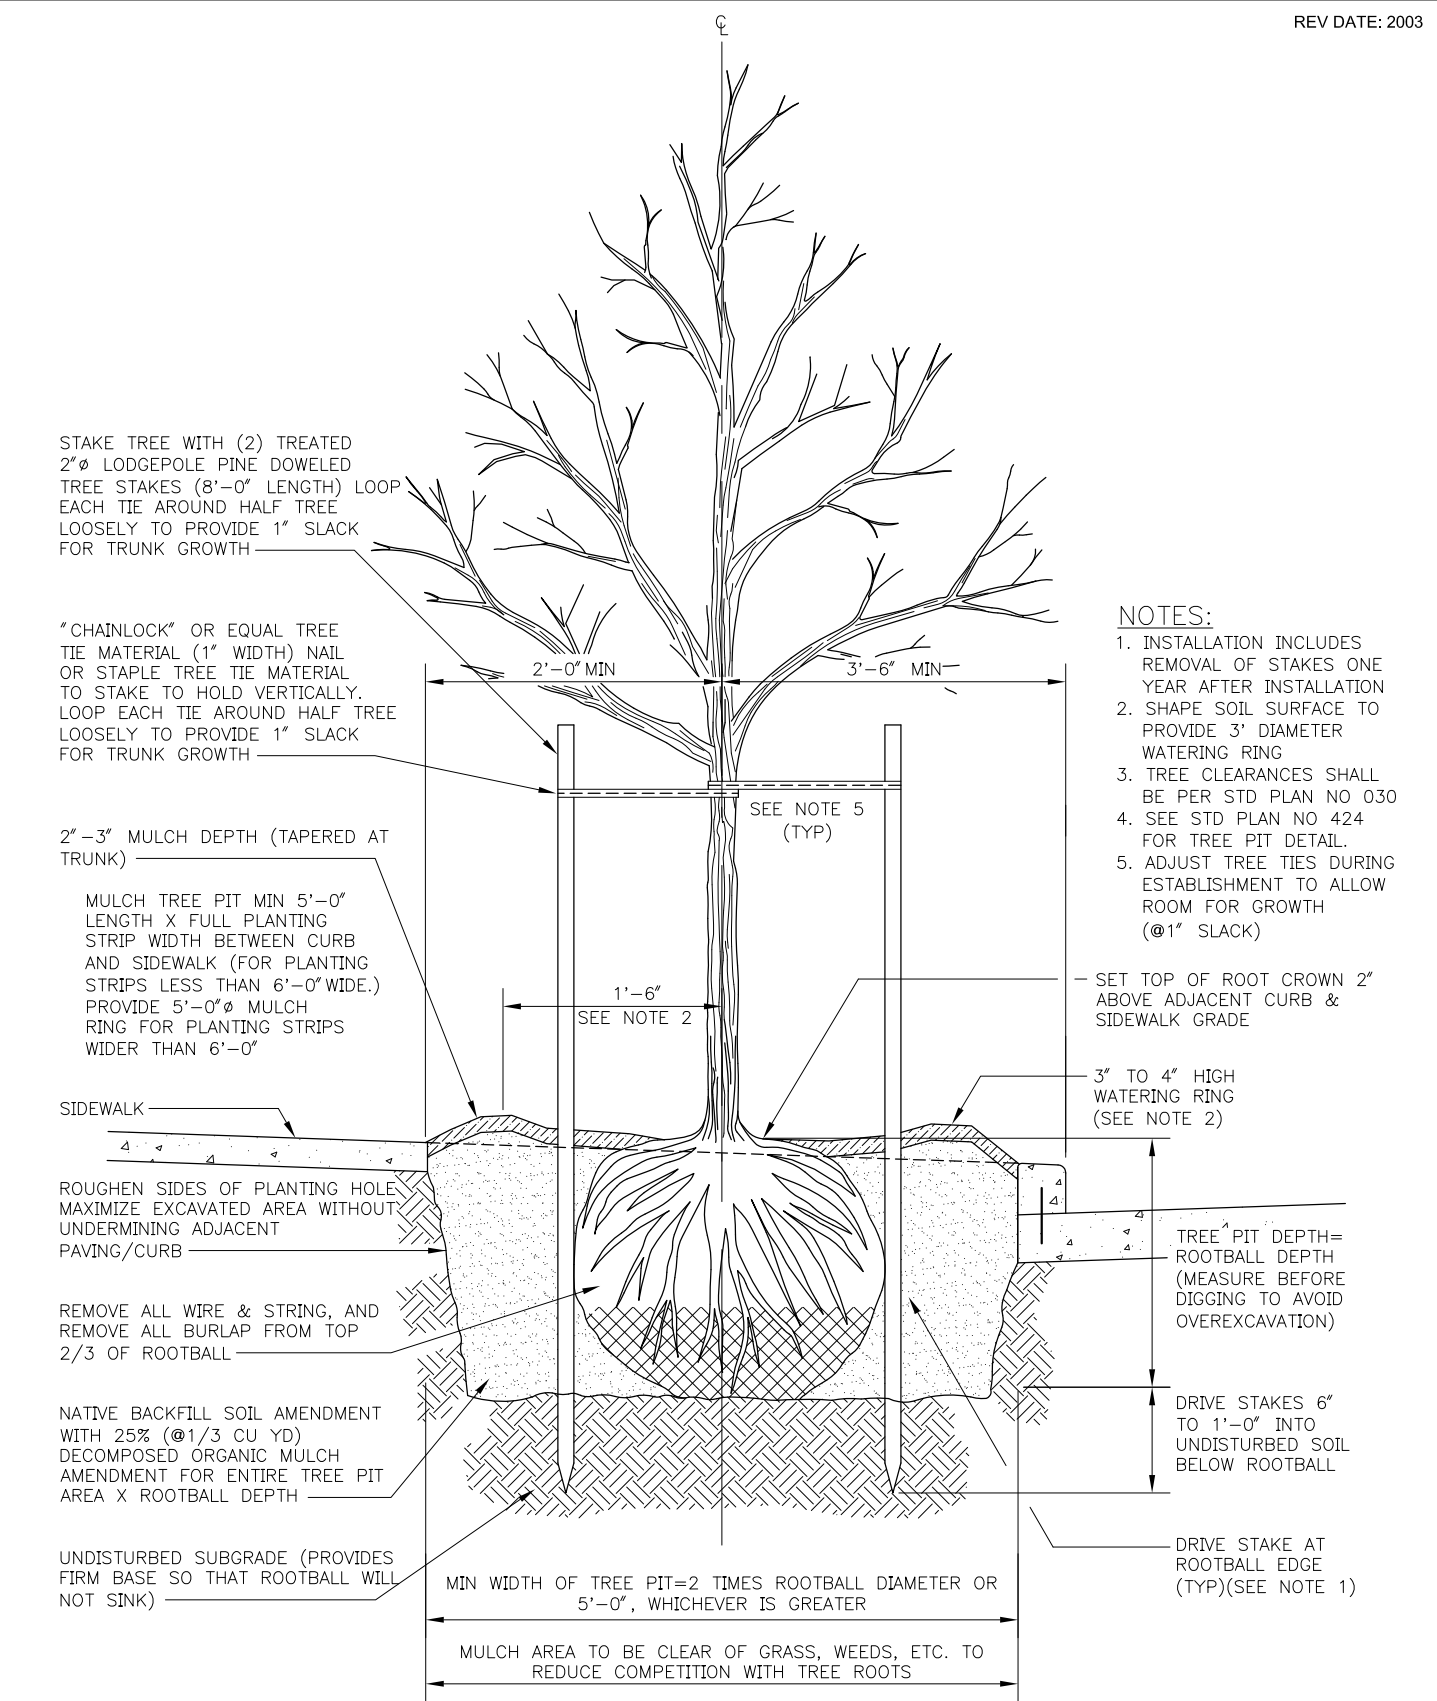

STAKE TREE WITH (2) TREATED 2" Ø LODGEPOLE PINE DOWELED TREE STAKES (8'-0" LENGTH) LOOP EACH TIE AROUND HALF TREE LOOSELY TO PROVIDE 1" SLACK FOR TRUNK GROWTH

"CHAINLOCK" OR EQUAL TREE TIE MATERIAL (1" WIDTH) NAIL OR STAPLE TREE TIE MATERIAL TO STAKE TO HOLD VERTICALLY. LOOP EACH TIE AROUND HALF TREE LOOSELY TO PROVIDE 1" SLACK FOR TRUNK GROWTH

2"-3" MULCH DEPTH (TAPERED AT TRUNK)

MULCH TREE PIT MIN 5'-0" LENGTH X FULL PLANTING STRIP WIDTH BETWEEN CURB AND SIDEWALK (FOR PLANTING STRIPS LESS THAN 6'-0" WIDE.) PROVIDE 5'-0" Ø MULCH RING FOR PLANTING STRIPS WIDER THAN 6'-0"

SIDEWALK

ROUGHEN SIDES OF PLANTING HOLE MAXIMIZE EXCAVATED AREA WITHOUT UNDERMINING ADJACENT PAVING/CURB

REMOVE ALL WIRE & STRING, AND REMOVE ALL BURLAP FROM TOP 2/3 OF ROOTBALL

NATIVE BACKFILL SOIL AMENDMENT WITH 25% (@1/3 CU YD) DECOMPOSED ORGANIC MULCH AMENDMENT FOR ENTIRE TREE PIT AREA X ROOTBALL DEPTH

UNDISTURBED SUBGRADE (PROVIDES FIRM BASE SO THAT ROOTBALL WILL NOT SINK)

MIN WIDTH OF TREE PIT=2 TIMES ROOTBALL DIAMETER OR 5'-0", WHICHEVER IS GREATER

MULCH AREA TO BE CLEAR OF GRASS, WEEDS, ETC. TO REDUCE COMPETITION WITH TREE ROOTS

- NOTES:**
1. INSTALLATION INCLUDES REMOVAL OF STAKES ONE YEAR AFTER INSTALLATION
 2. SHAPE SOIL SURFACE TO PROVIDE 3' DIAMETER WATERING RING
 3. TREE CLEARANCES SHALL BE PER STD PLAN NO 030
 4. SEE STD PLAN NO 424 FOR TREE PIT DETAIL.
 5. ADJUST TREE TIES DURING ESTABLISHMENT TO ALLOW ROOM FOR GROWTH (@1" SLACK)

— SET TOP OF ROOT CROWN 2" ABOVE ADJACENT CURB & SIDEWALK GRADE

3" TO 4" HIGH WATERING RING (SEE NOTE 2)

TREE PIT DEPTH= ROOTBALL DEPTH (MEASURE BEFORE DIGGING TO AVOID OVEREXCAVATION)

DRIVE STAKES 6" TO 1'-0" INTO UNDISTURBED SOIL BELOW ROOTBALL


DRIVE STAKE AT ROOTBALL EDGE (TYP)(SEE NOTE 1)

REF STD SPEC SEC 8-02



NOT TO SCALE

DECIDUOUS TREE PLANTING IN PLANTING STRIP

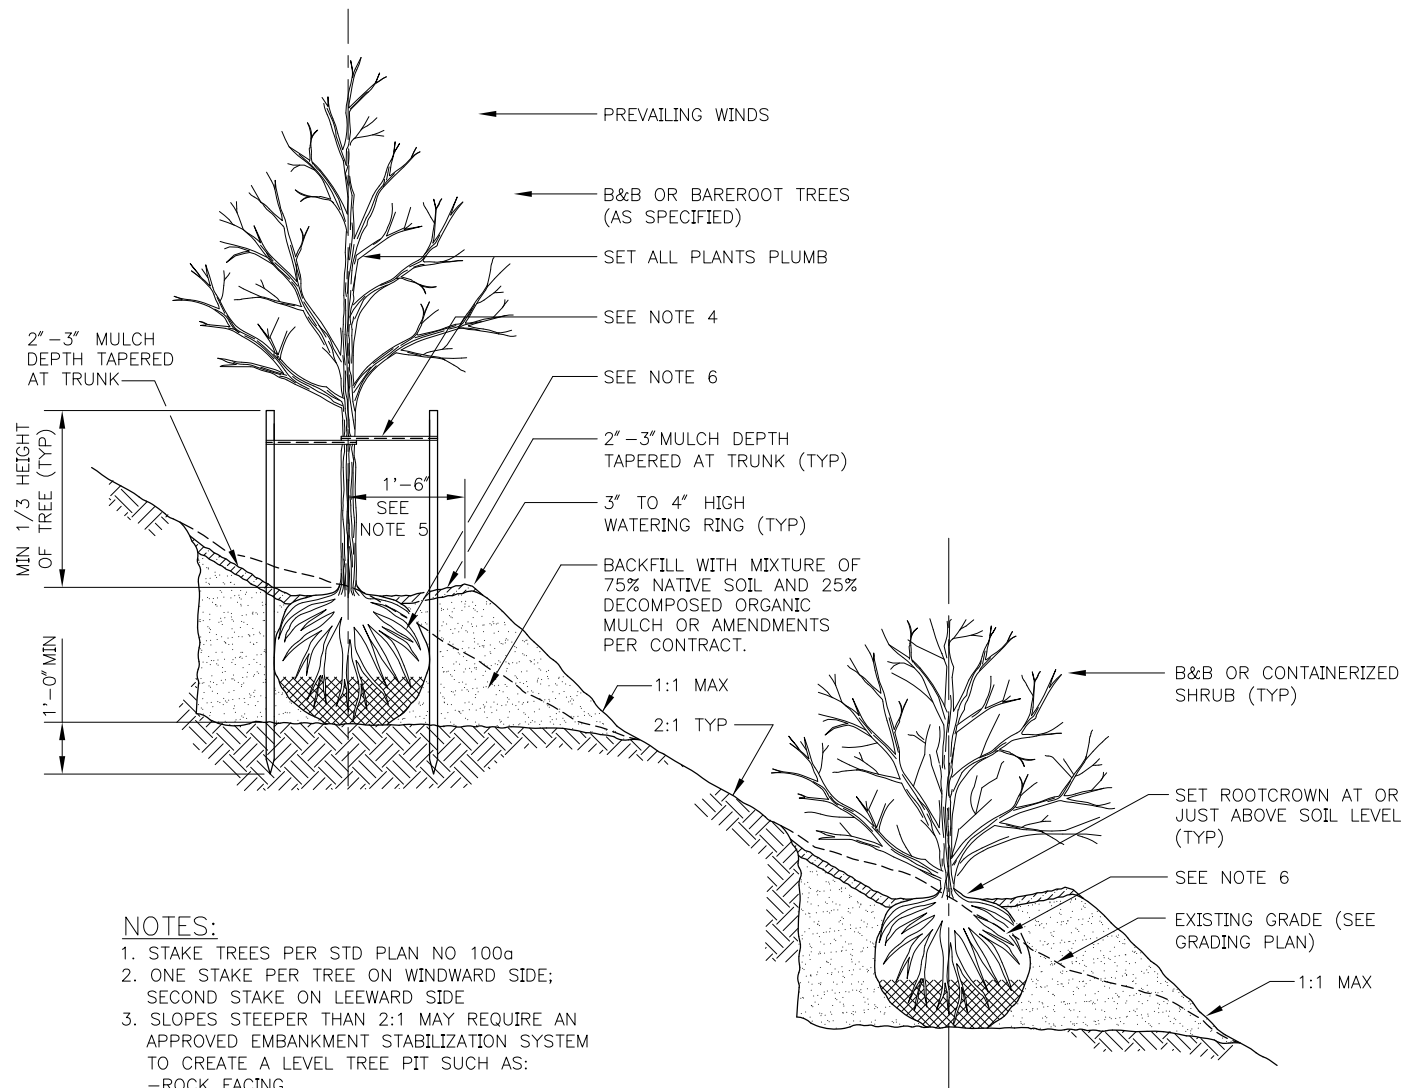

NOTES:

1. STAKE TREES PER STD PLAN NO 100a
2. ONE STAKE PER TREE ON WINDWARD SIDE; SECOND STAKE ON LEEWARD SIDE
3. SLOPES STEEPER THAN 2:1 MAY REQUIRE AN APPROVED EMBANKMENT STABILIZATION SYSTEM TO CREATE A LEVEL TREE PIT SUCH AS:
 - ROCK FACING
 - PRECAST CONCRETE WALL UNITS
 - TIMBER WALL
 - MANUFACTURED SLOPE RETENTION UNITS
4. CHAINLOCK TREE TIE. LOOP EACH TIE AROUND TREE LOOSELY TO PROVIDE 1" SLACK FOR DIAMETER GROWTH.
5. SHAPE SOIL TO PROVIDE 3' DIAMETER OR ROOTBALL DIAMETER, WHICHEVER IS GREATER, WATERING RING.
6. REMOVE ALL WIRE AND STRING. REMOVE TOP 2/3 OF BURLAP.

REF STD SPEC SEC 8-02




NOT TO SCALE

TREE & SHRUB PLANTING ON SLOPES

STANDARD PLAN NO 101

REV DATE: 2003

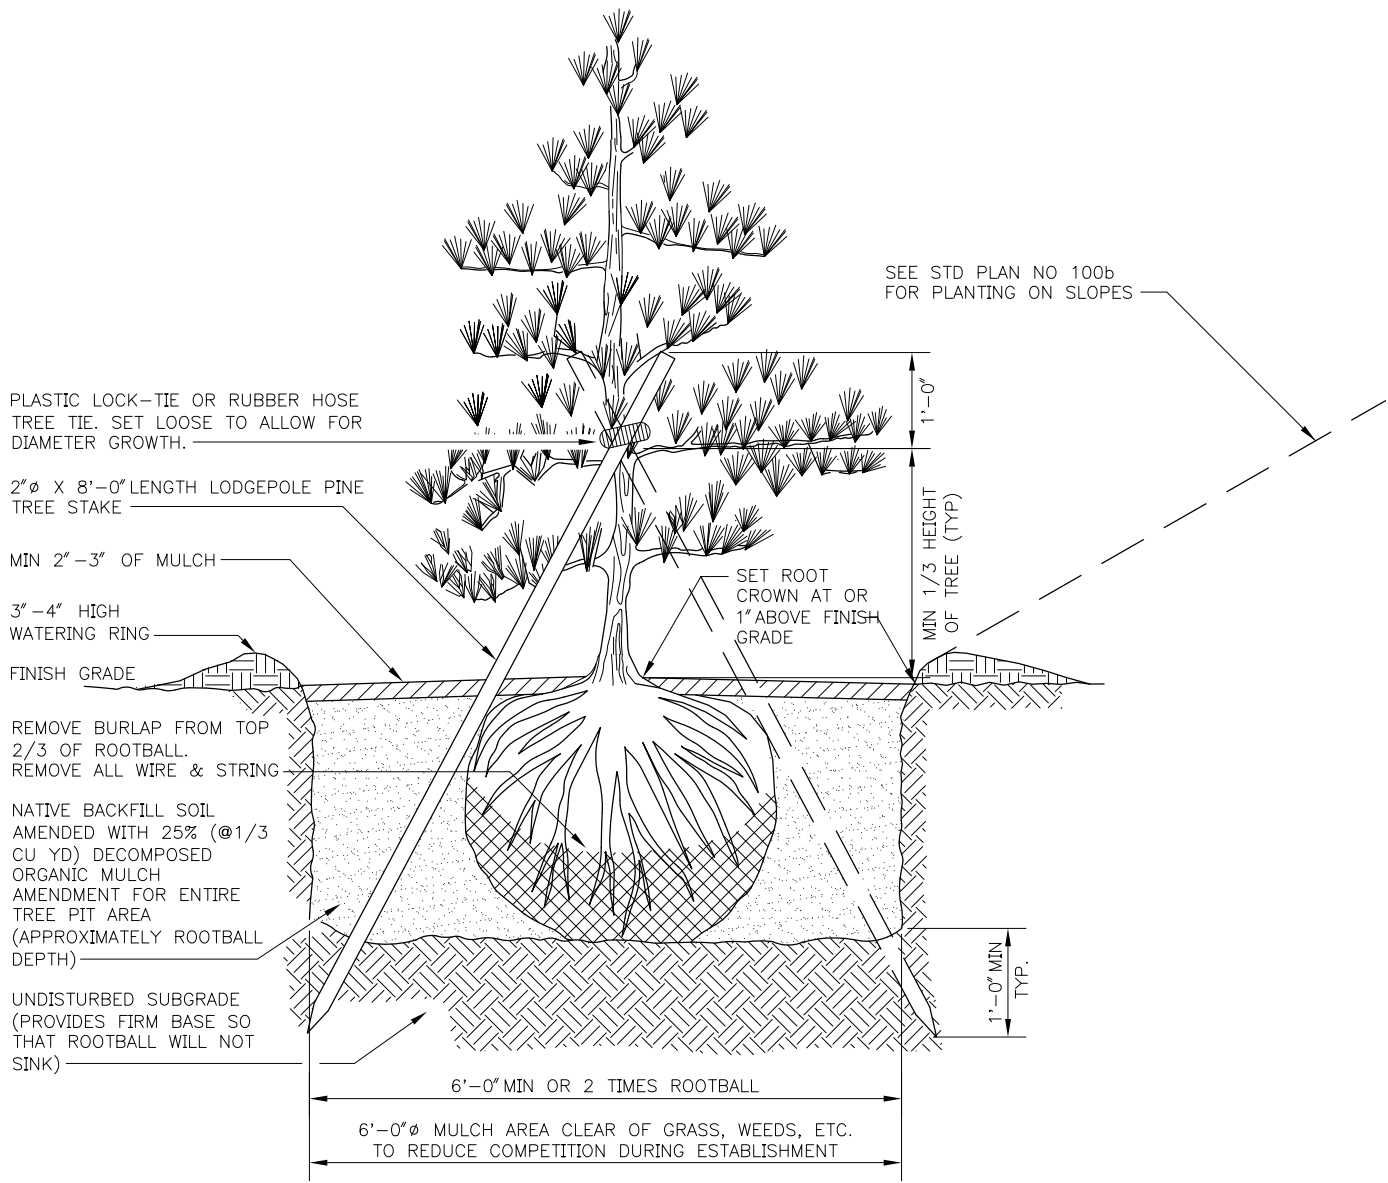

REF STD SPEC SEC 8-02




City of Seattle

NOT TO SCALE

CONIFEROUS TREE PLANTING

STANDARD PLAN NO 110

REV DATE: 2003

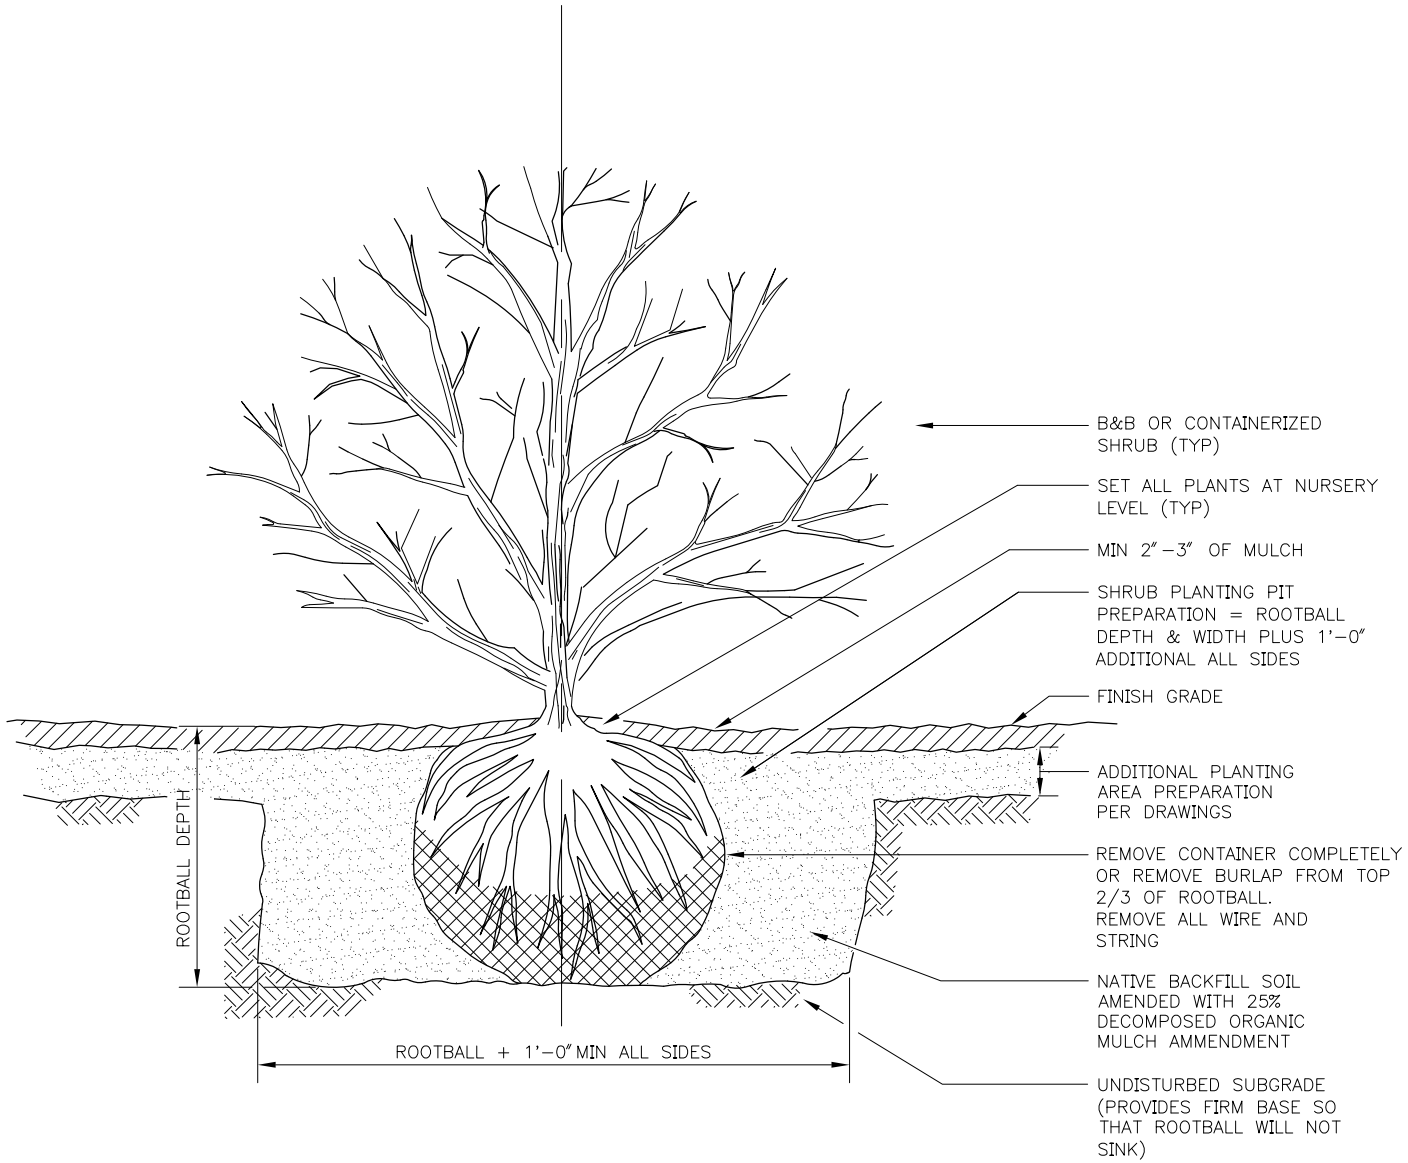


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

SHRUB PLANTING

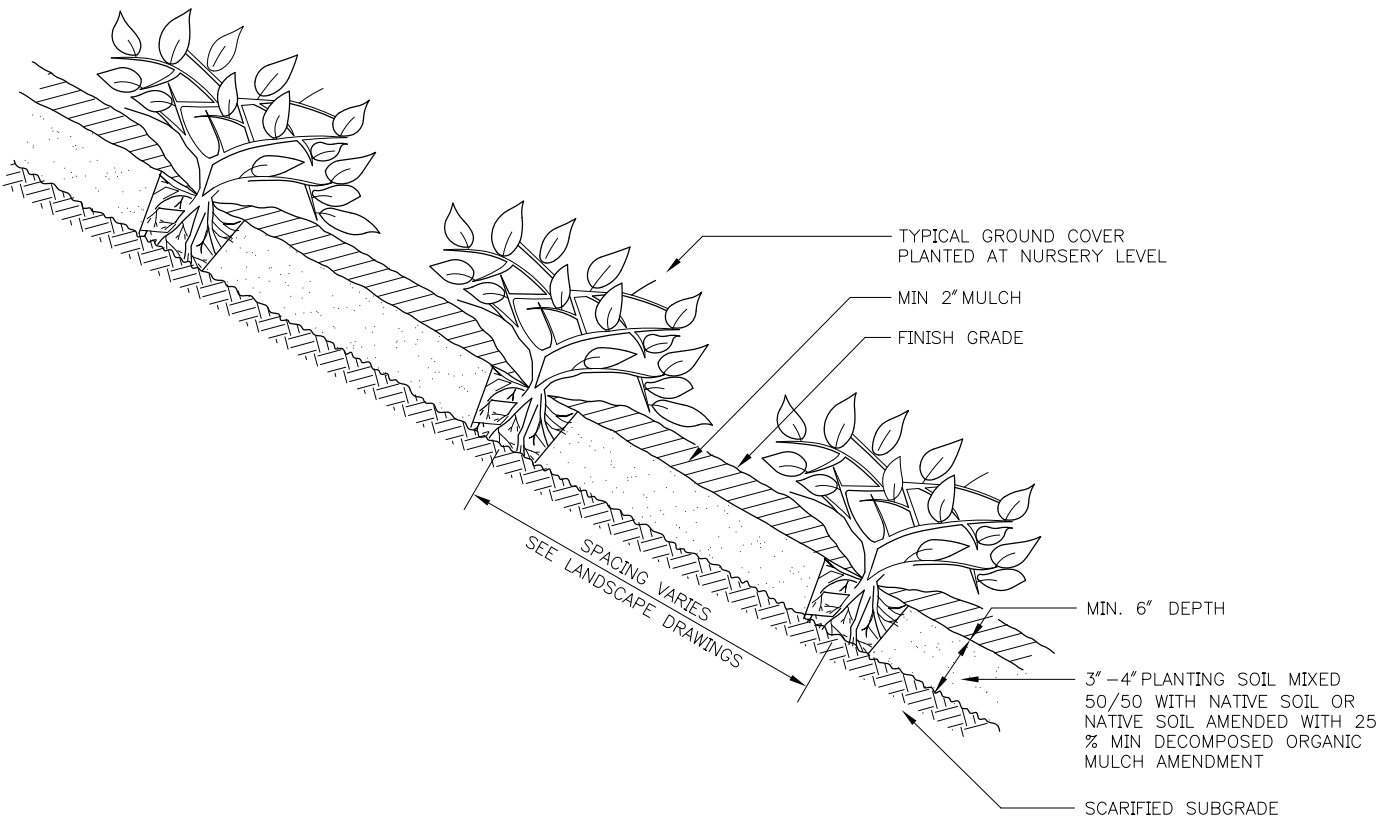


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

GROUND COVER PLANTING

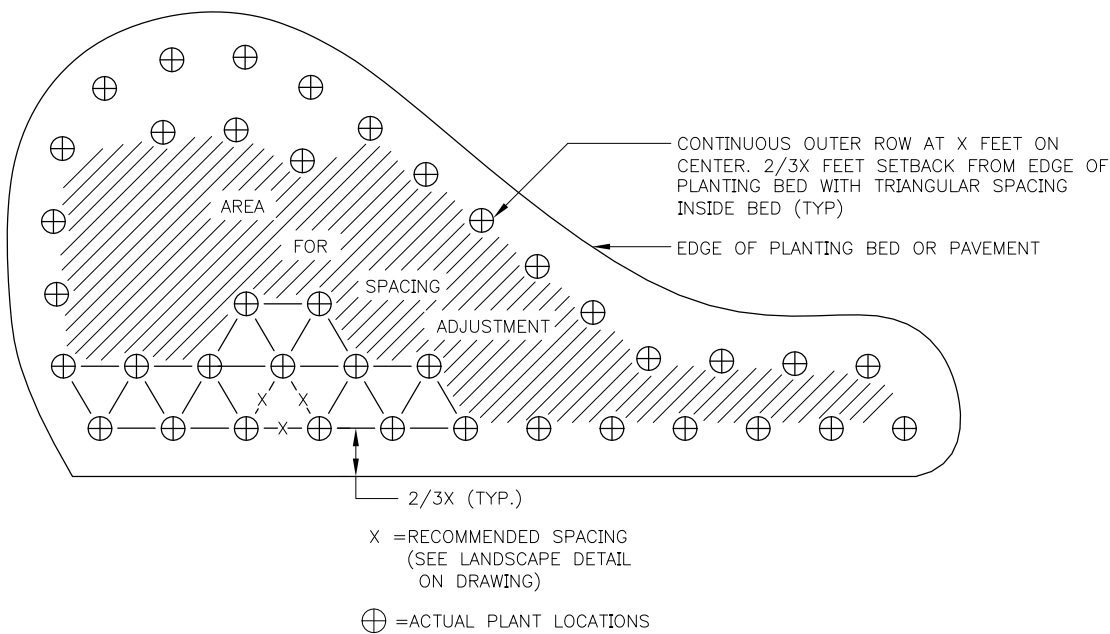

REF STD SPEC SEC 9-14




City of Seattle

NOT TO SCALE

PLANTING PATTERN

STANDARD PLAN NO 113

REV DATE: 2003

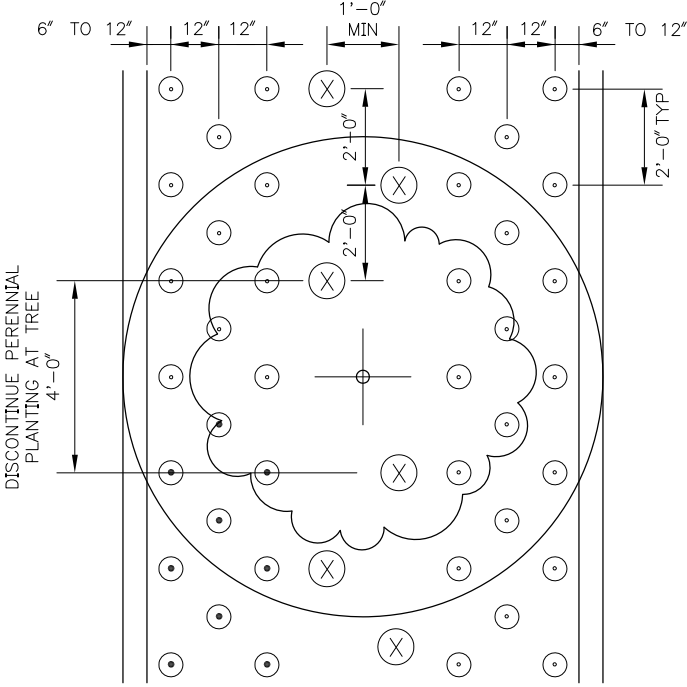


DISCONTINUE PERENNIAL PLANTING AT TREE 4'-0"

QUANT PER 10'-0" LF MEDIAN

○ GROUNDCOVER	30
⊗ SHRUB	5

DETAIL AT TREE PLAN

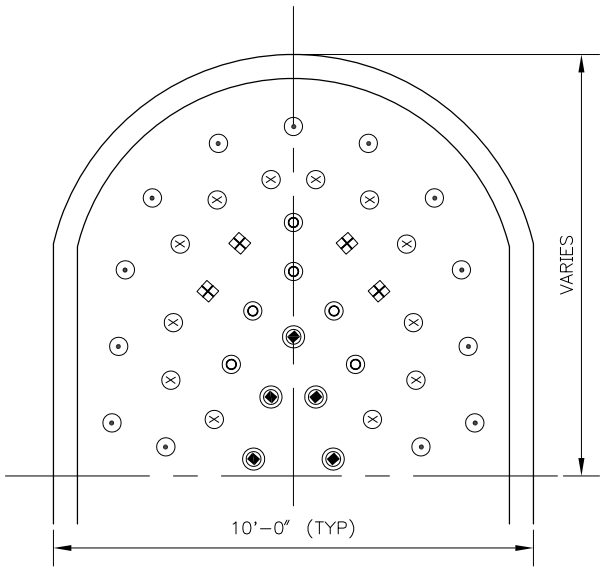

QUANT PER END CAP

◇ PERENNIAL TYPE 1	4
⊙ PERENNIAL TYPE 2	6
⊙ PERENNIAL TYPE 3	5
⊙ EVERGREEN GROUNDCOVER TYPE 1	13
⊗ EVERGREEN GROUNDCOVER TYPE 2	12


END CAP DETAIL

TYP STREET TREE 2" - 2 1/2" CALIPER @ 30' - 0" OC

CHAINLOCK TREE TIE. LOOP EACH TIE AROUND TREE LOOSELY TO PROVIDE 1" SLACK FOR DIAMETER GROWTH

(2) 2" Ø LODGEPOLE PINE DOWELED TREE STAKES (8'-0" LENGTH)

SEE STD PLAN NO 100 FOR SUPPLEMENTAL TREE PLANTING INFORMATION

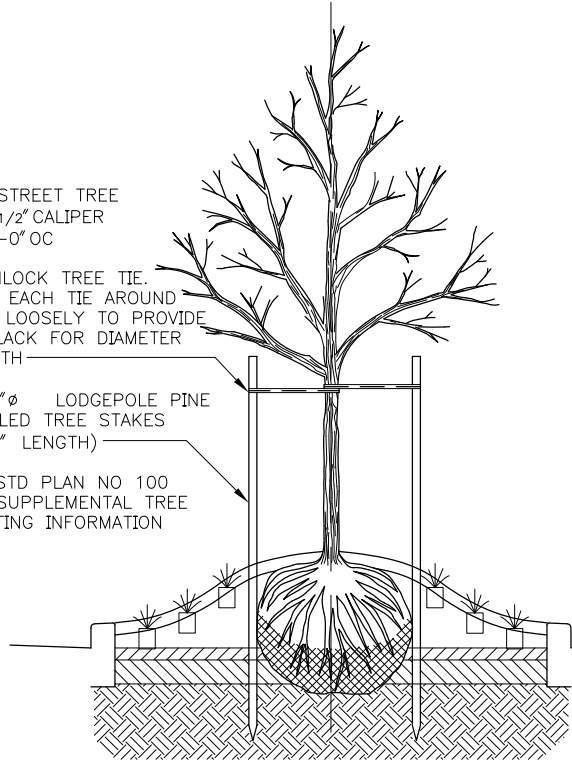


ELEVATION

PLACE 3" OF PLANTING SOIL & MIX WITH SUBSOIL BEFORE ADDING SUBSEQUENT QUANTITIES OF PLANTING SOIL (IN 6" LIFTS) COMPACTED TO 85%

NATIVE SUBGRADE TO BE SCARIFIED TO A DEPTH OF 6" PRIOR TO PLACEMENT OF FILL. CALL FOR INSPECTION BEFORE FILLING

3" BARK MULCH SEE STD PLAN NO'S 110 & 111 FOR SUPPLEMENTAL SHRUB AND GROUNDCOVER PLANTING INFORMATION

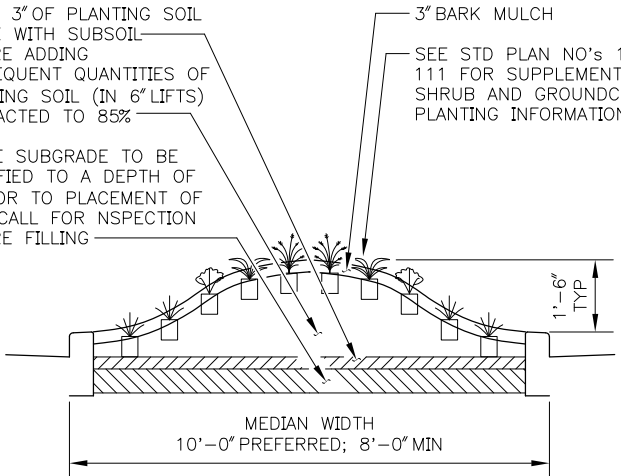

SOIL PREPARATION DETAIL

REF STD SPEC SEC 8-02




City of Seattle

NOT TO SCALE


MEDIAN PLANTING

STANDARD PLAN NO 121


REV DATE: 2003

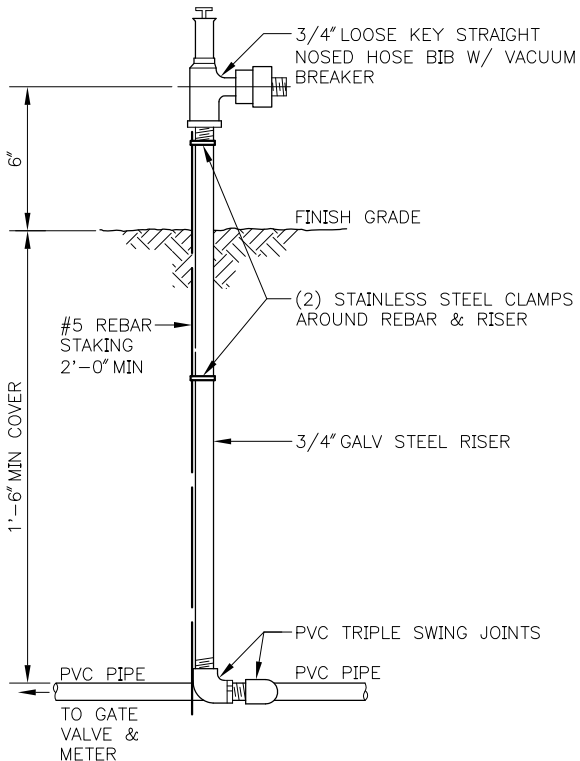


ABOVE GROUND HOSE BIB

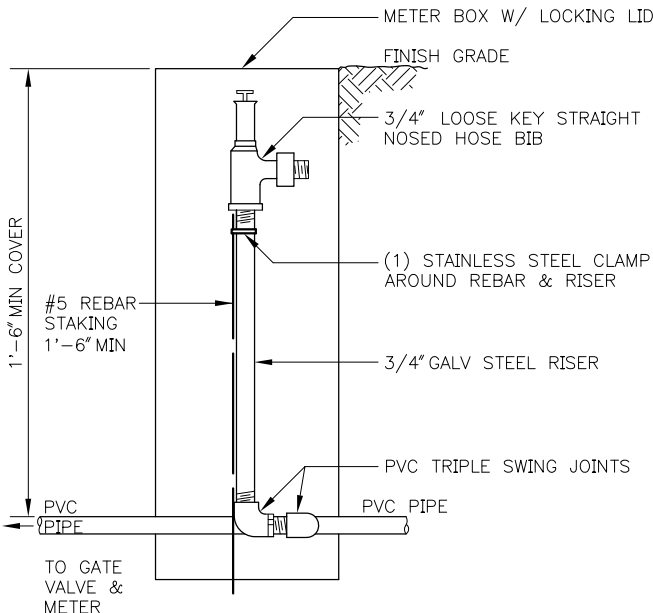

BELOW GROUND HOSE BIB



BRACE DETAIL - PLAN VIEW

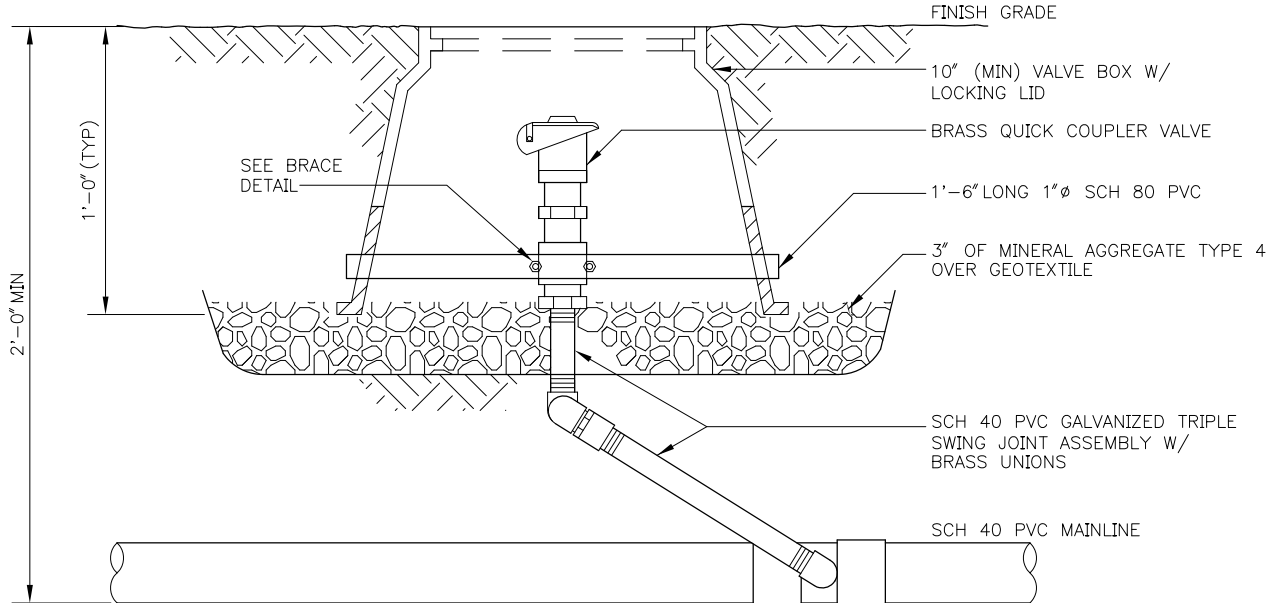

ELEVATION VIEW

QUICK COUPLER VALVE
TURF OR BED AREAS

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE

HOSE BIB ASSEMBLY AND
QUICK COUPLER VALVE

STANDARD PLAN NO 122


REV DATE: 2003

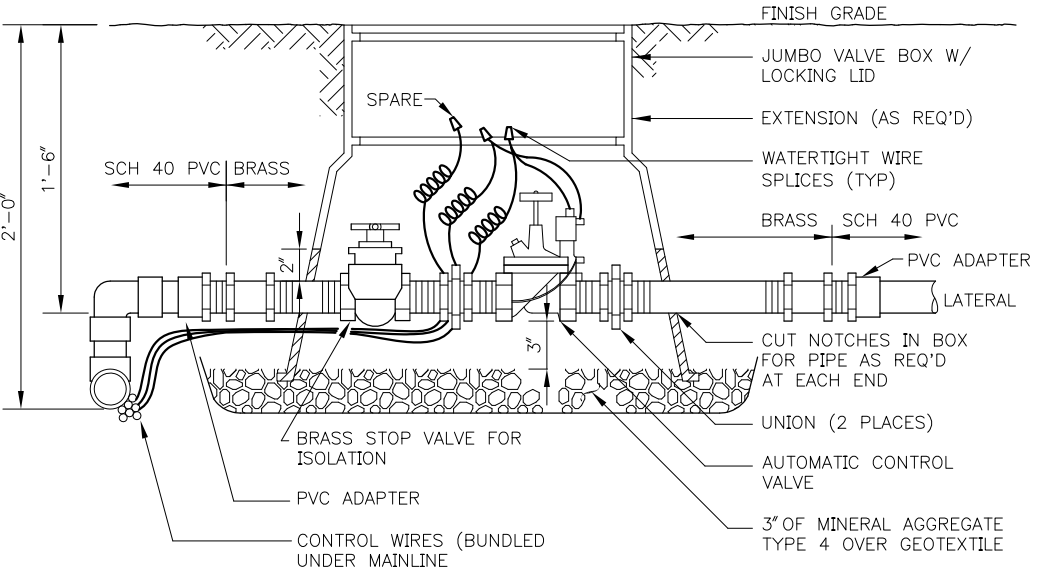

NOTE:

"U" SHAPED CUT-OUT IN VALVE BOX THAT ALLOWS 2" CLEARANCE FROM TOP OF PIPE TO TOP OF "U"

AUTOMATIC CONTROL VALVE

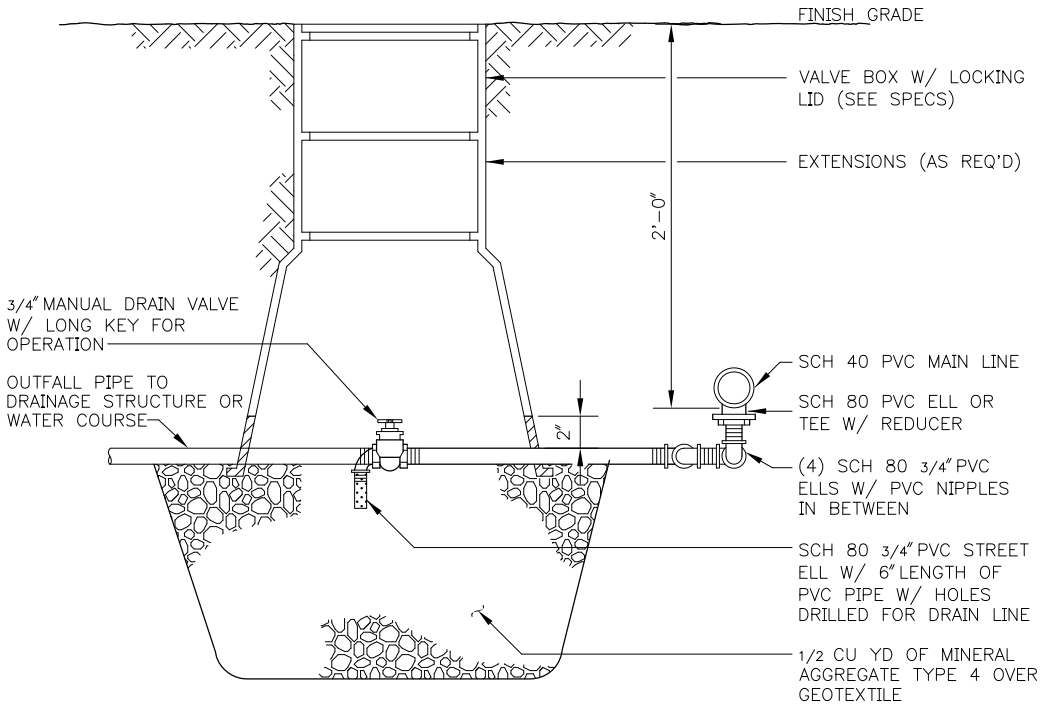

MANUAL DRAIN VALVE

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE

IRRIGATION VALVES

STANDARD PLAN NO 123

REV DATE: 2003

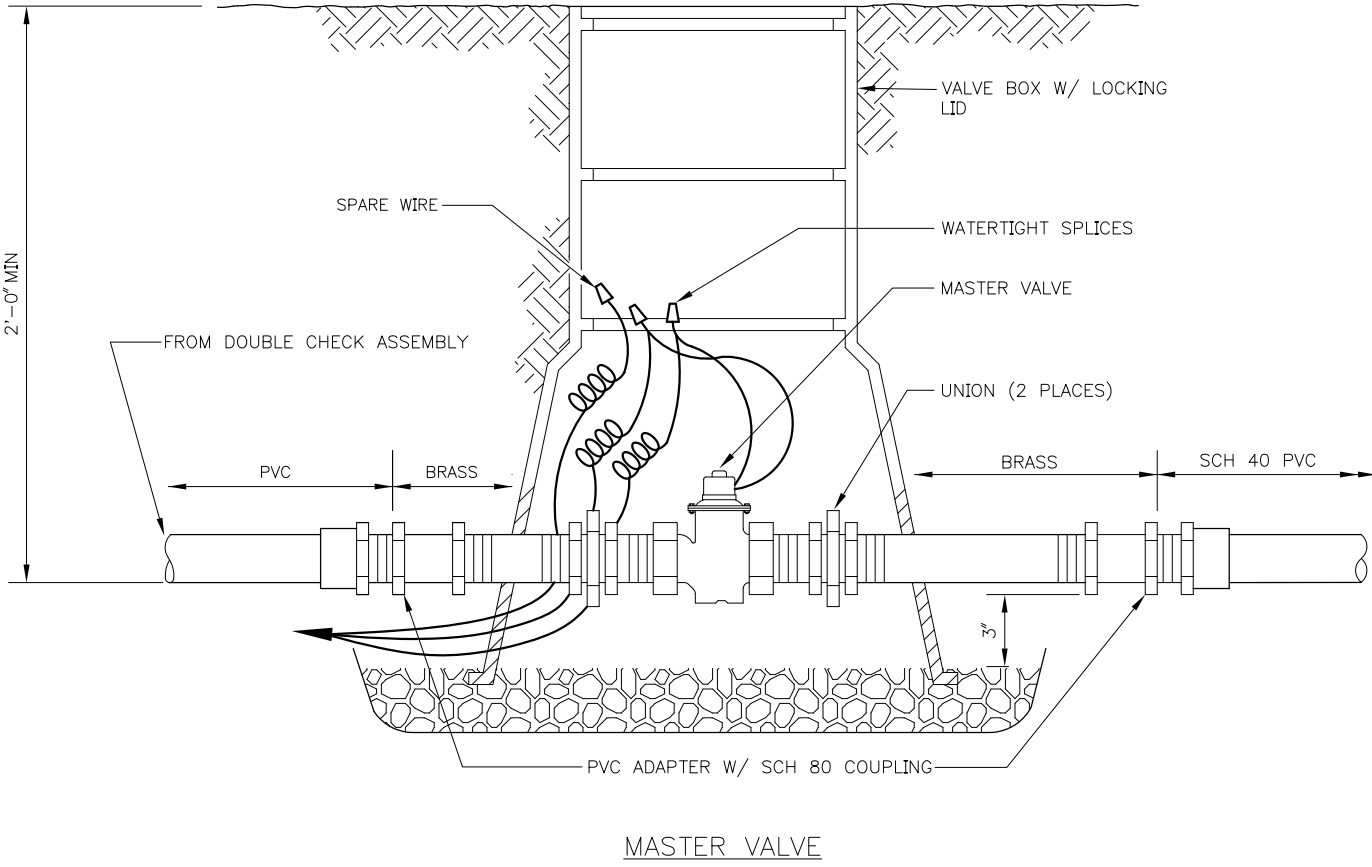

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE

IRRIGATION VALVES

STANDARD PLAN NO 124

REV DATE: 2003

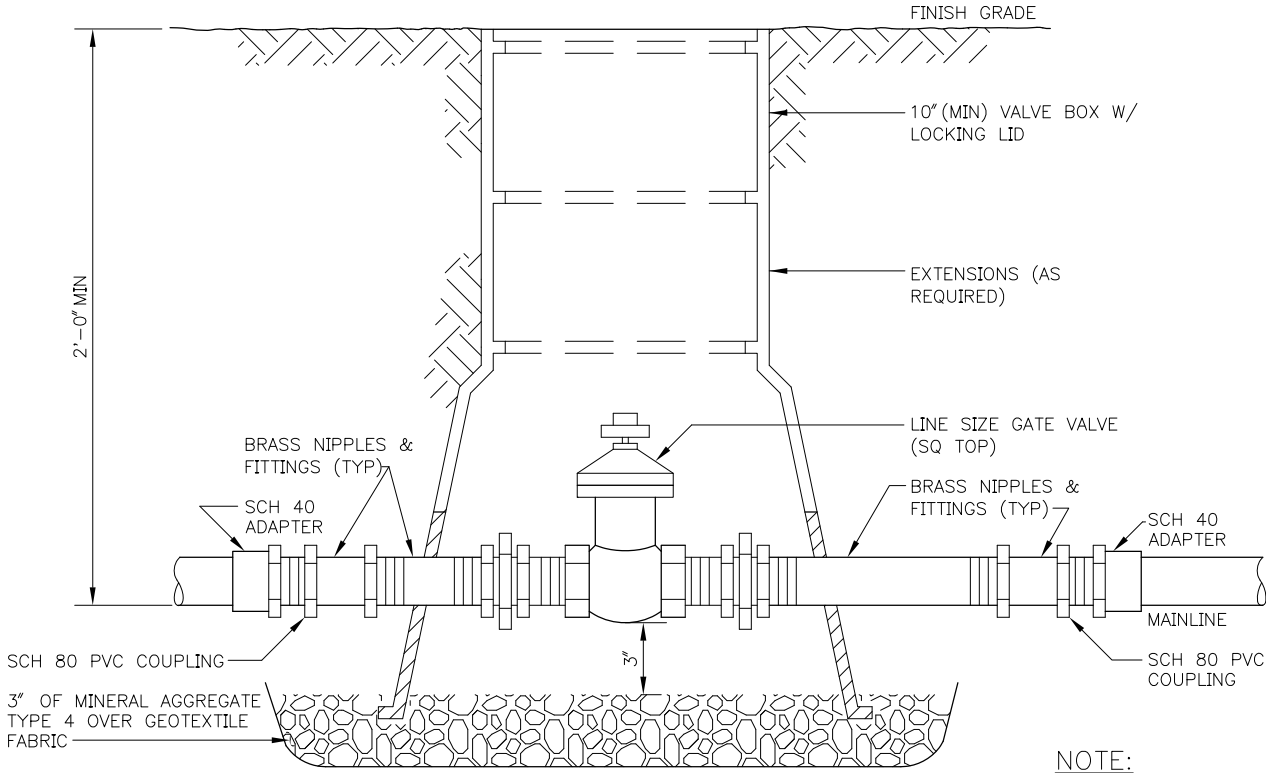

NOTE:
 USE TEFLON TAPE ON
 ALL THREADED
 FITTINGS

GATE VALVE - 2 1/2" & LARGER

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE


IRRIGATION VALVES

STANDARD PLAN NO 125

REV DATE: 2003

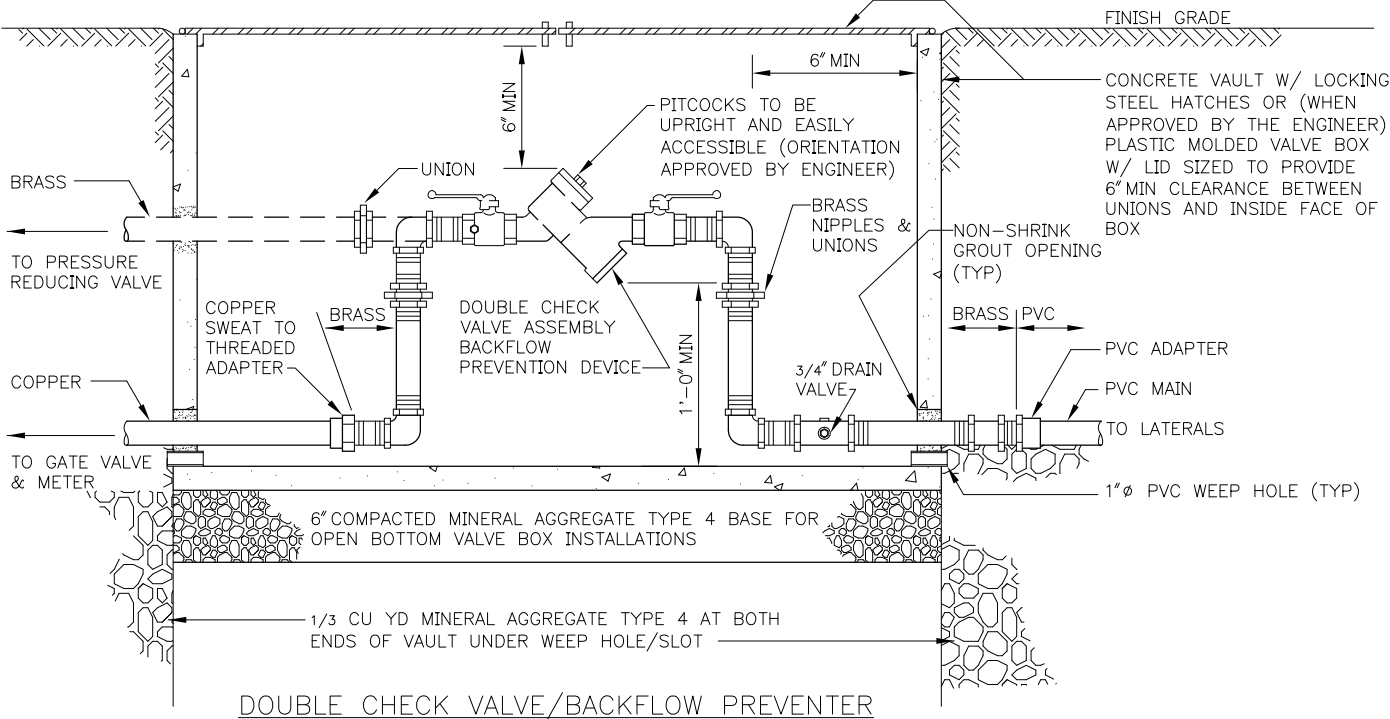

DOUBLE CHECK VALVE/BACKFLOW PREVENTER

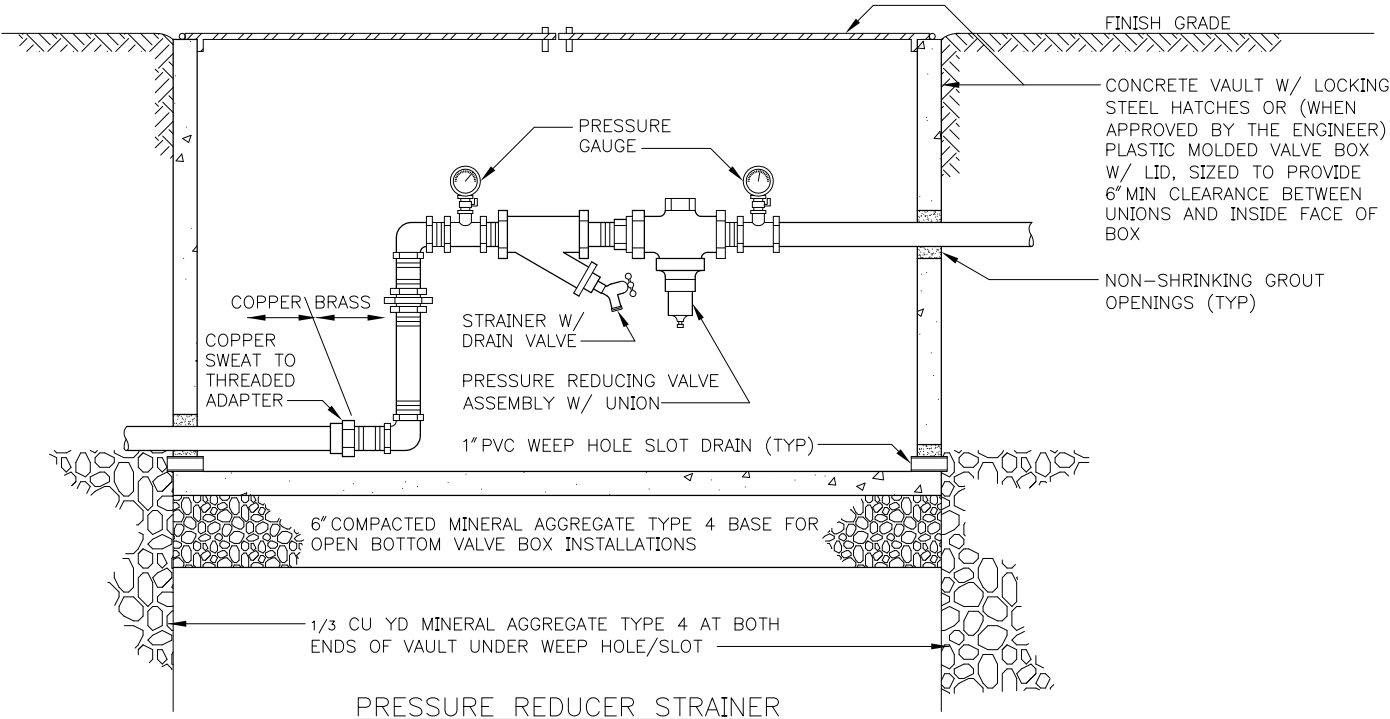

PRESSURE REDUCER STRAINER
(LOCATE DOWNSTREAM FROM BACKFLOW PREVENTION DEVICE)

REF STD SPEC SEC 8-03




City of Seattle

NOT TO SCALE



IRRIGATION VALVES

STANDARD PLAN NO 126

REV DATE: 2003

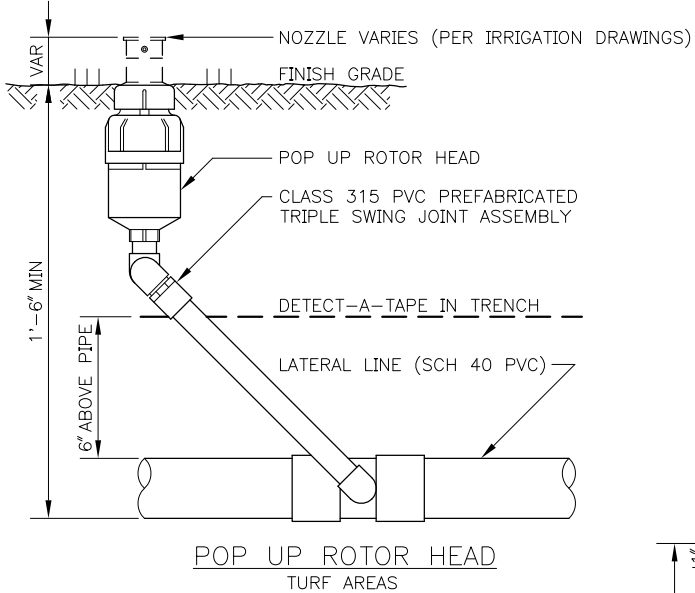

NOTE:
USE TEFLON TAPE ON
ALL THREADED FITTINGS

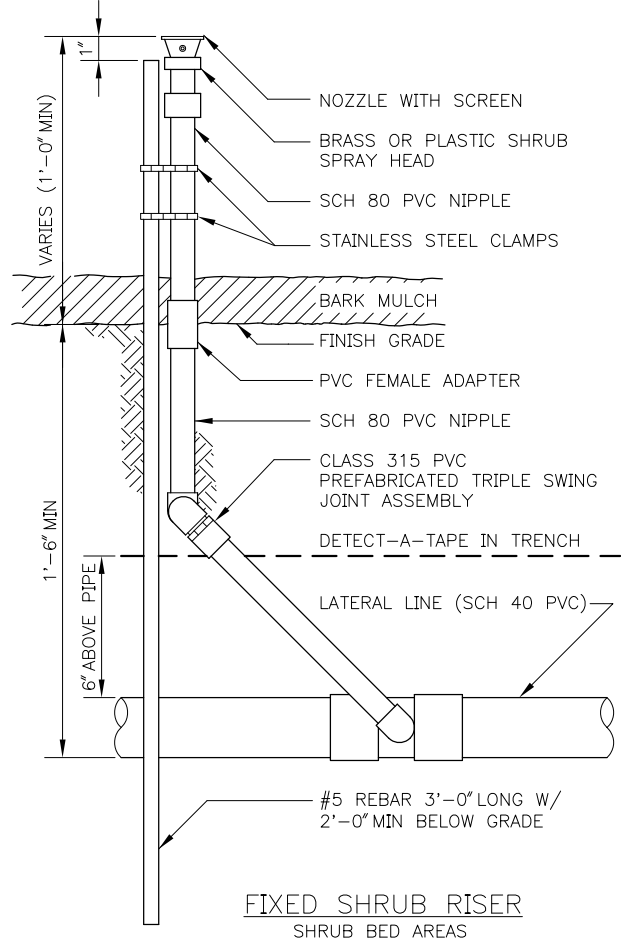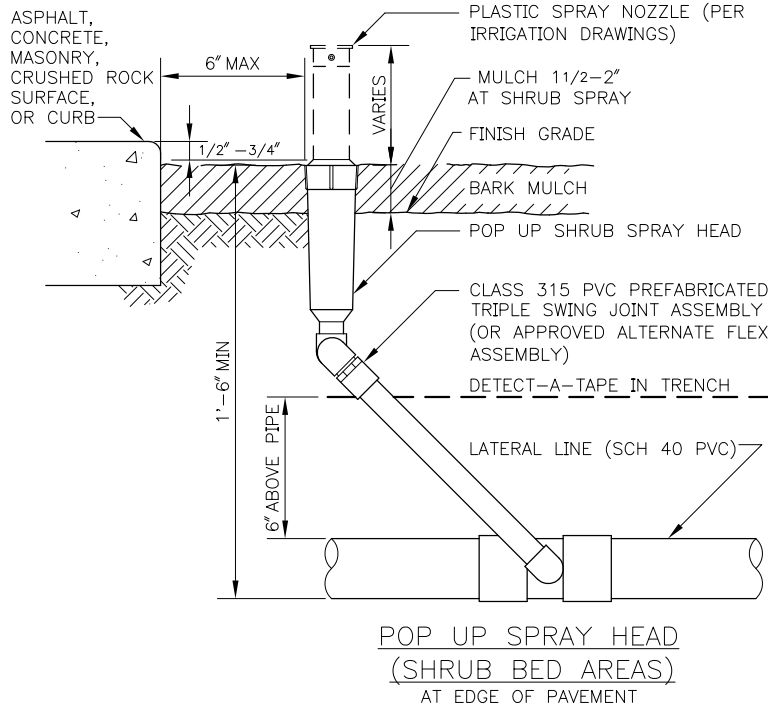

REF STD SPEC SEC 8-03





NOT TO SCALE

POP UP & FIXED
IRRIGATION HEADS

STANDARD PLAN NO 127

REV DATE: 2003

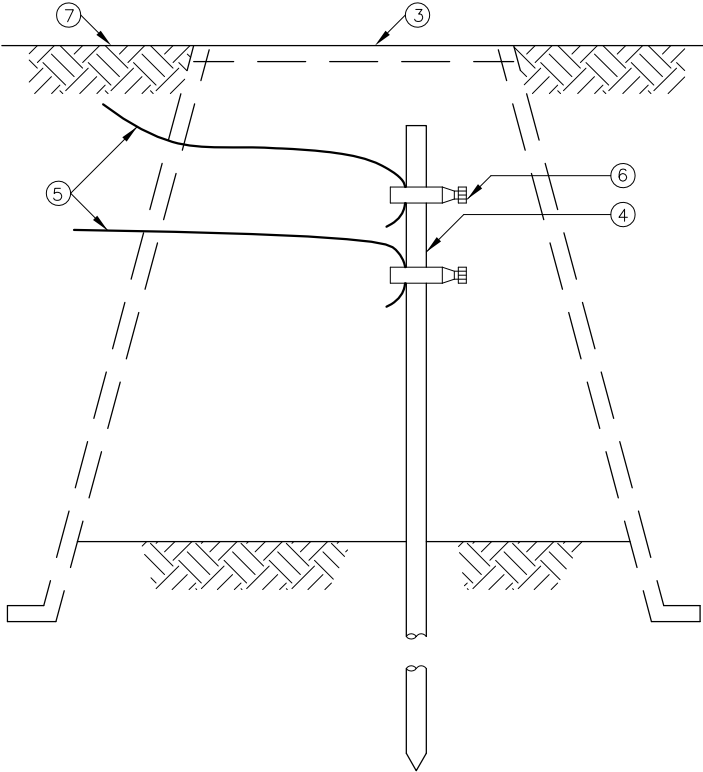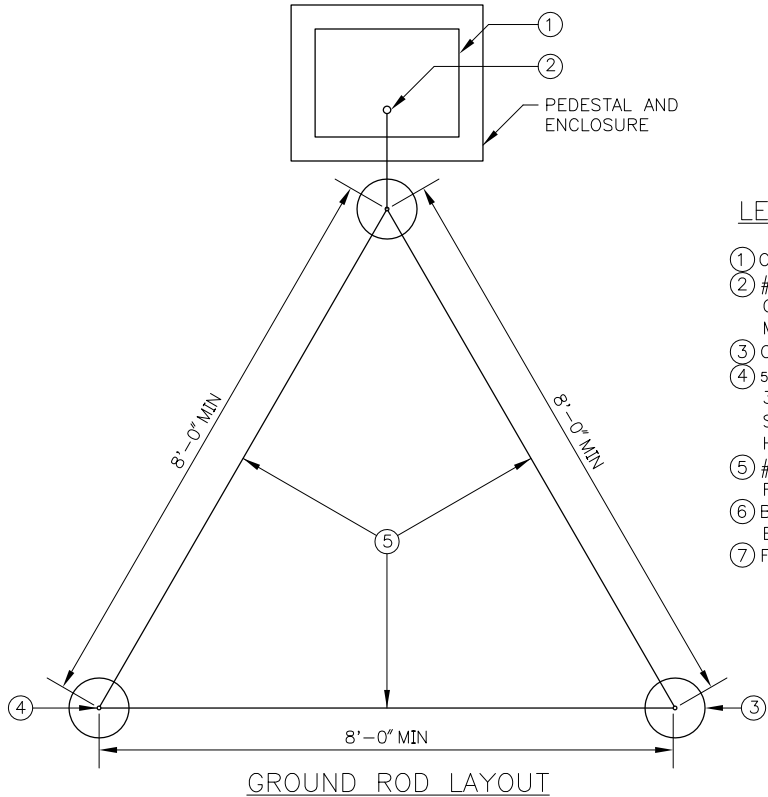

REF STD SPEC SEC 8-03




NOT TO SCALE


IRRIGATION CONTROLLER
 PEDESTAL AND ENCLOSURE
 GROUNDING

STANDARD PLAN NO 128


REV DATE: 2003

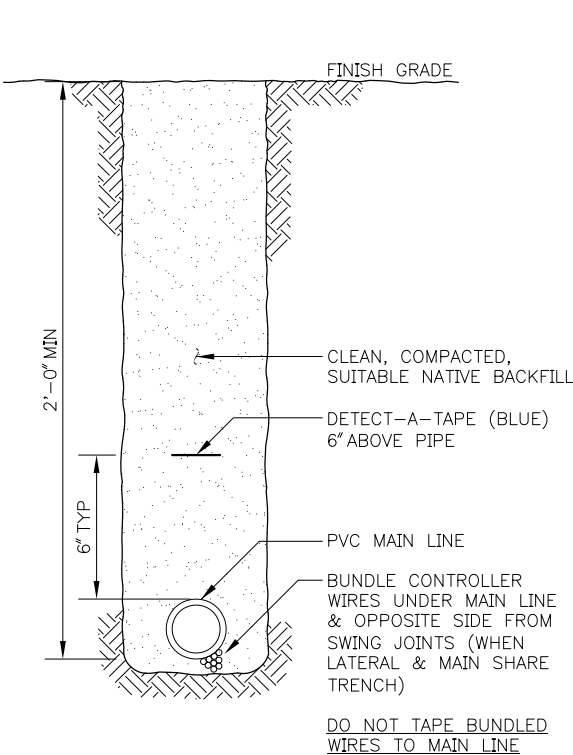


MAIN LINE

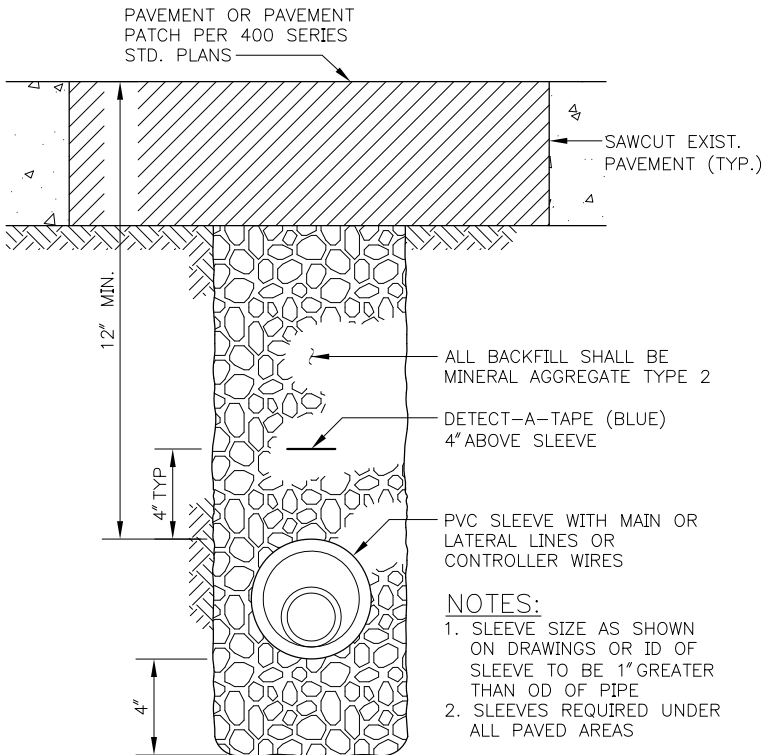

SLEEVE TRENCHING

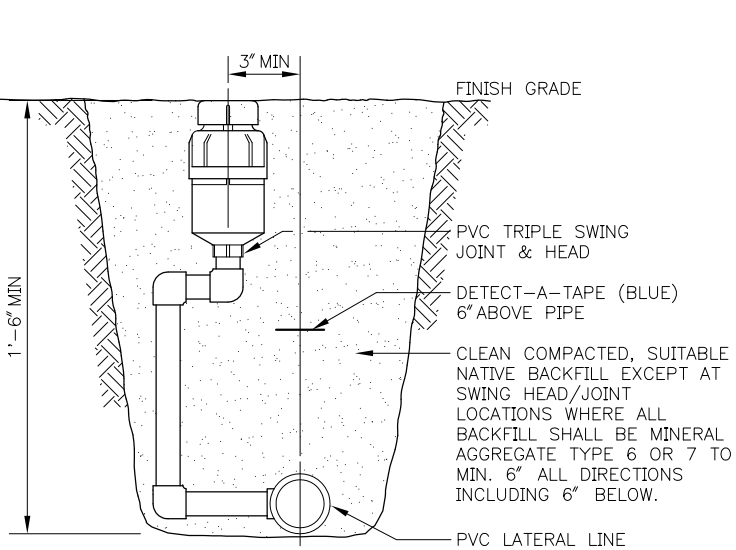

LATERAL LINE

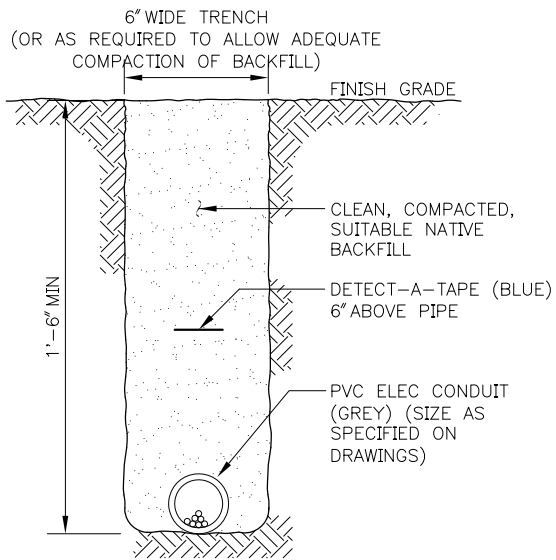

POWER SUPPLY TRENCH

REF STD SPEC SEC 8-03



City of Seattle

NOT TO SCALE




IRRIGATION TRENCHES

STANDARD PLAN NO 129

REV DATE: 2003

NOTES:

1. NEMA 3R RAINPROOF CABINET
2. NO 12 GA PREGALVANIZED STEEL WELDED SEAM CONSTRUCTION
3. TWO SCREENED, GASKETED LOUVERED VENTS
4. REMOVABLE EQUIPMENT MOUNTING PAN
5. VANDALPROOF LOCKABLE SLIDE BAR ACROSS FRONT DOOR
6. PADMOUNT DESIGN WITH 2" INSIDE FLANGE ON BOTTOM
7. DOOR:
 - 3 POINT LATCH
 - CONCEALED HINGE
 - LIFT-OFF TYPE (UPON OPENING)
 - CLOSED CELL NEOPRENE GASKET
8. PAINT:
 - OVEN BAKED ENAMEL
 - DARK GREEN OUTSIDE
 - WHITE INSIDE
 - PREGALVANIZED METAL TREATED WITH COPPER SULFATE PRIOR TO PAINTING
9. ACTUAL CABINET DIMENSIONS ARE PROJECT SPECIFIC AND WILL BE SPECIFIED ON THE DRAWINGS.

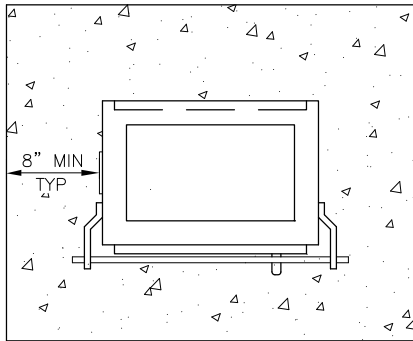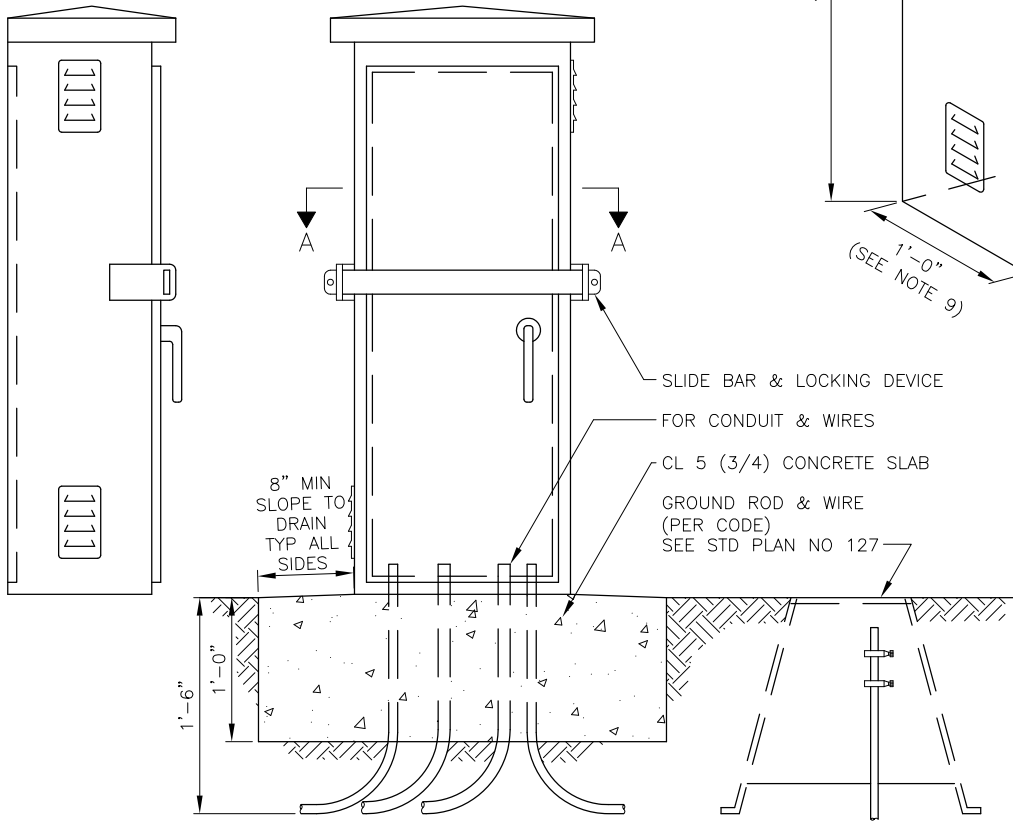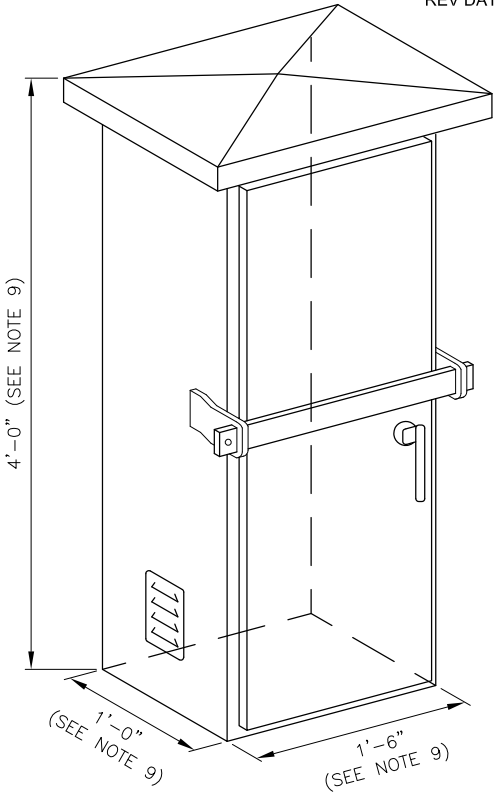

SECTION A-A

REF STD SPEC SEC 8-03






City of Seattle

NOT TO SCALE

IRRIGATION
CONTROLLER CABINET

STANDARD PLAN NO 132

REV DATE: 2003

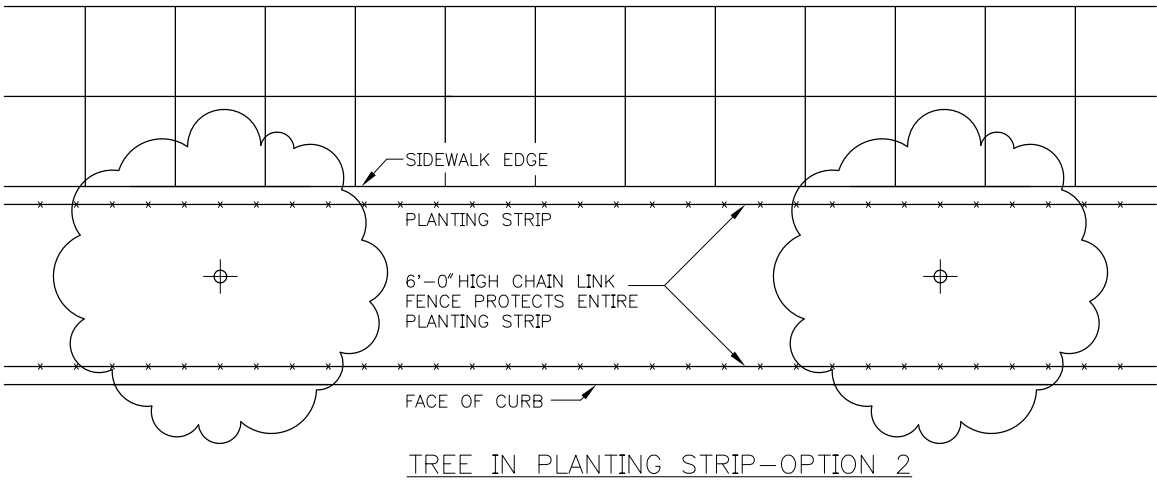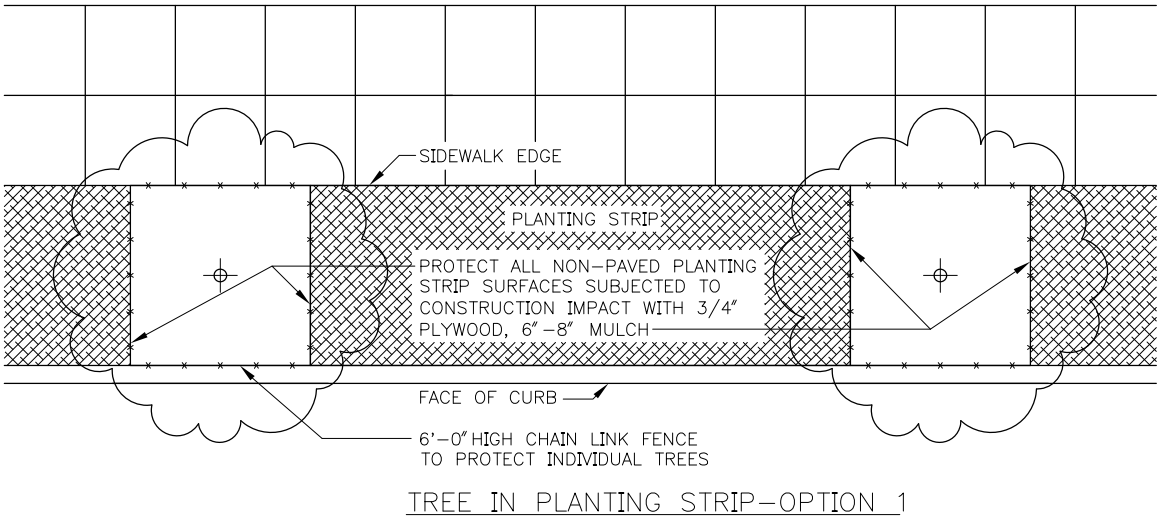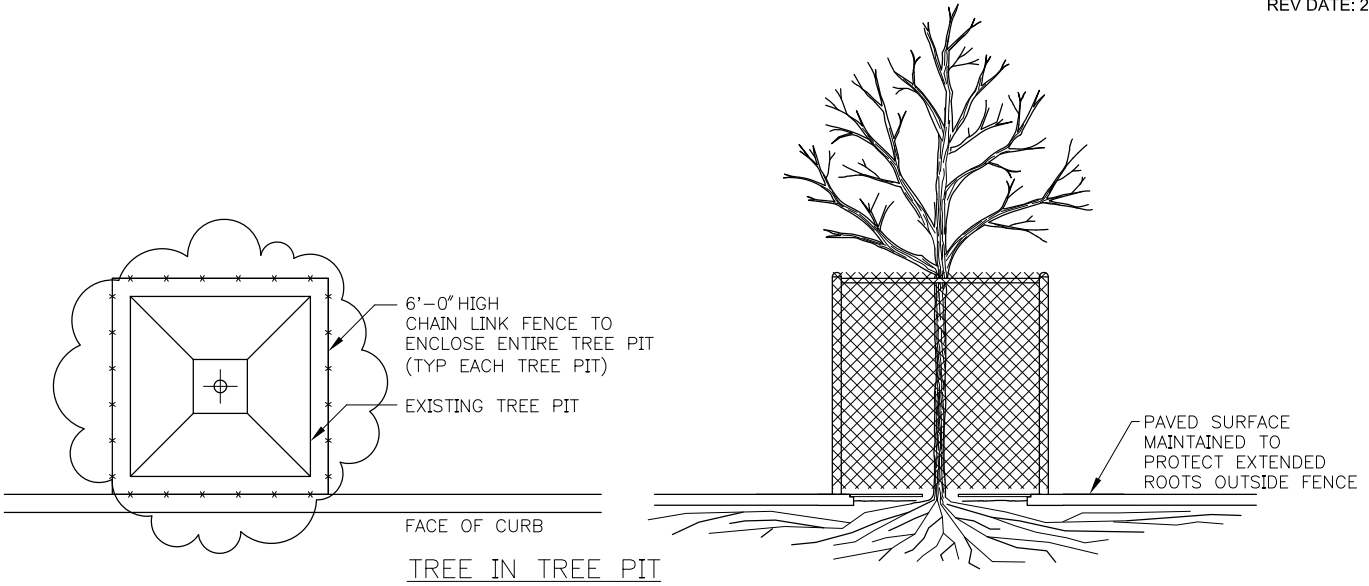


REF STD SPEC SEC 1-07.16(2)



City of Seattle

NOT TO SCALE

TREE PROTECTION DURING CONSTRUCTION

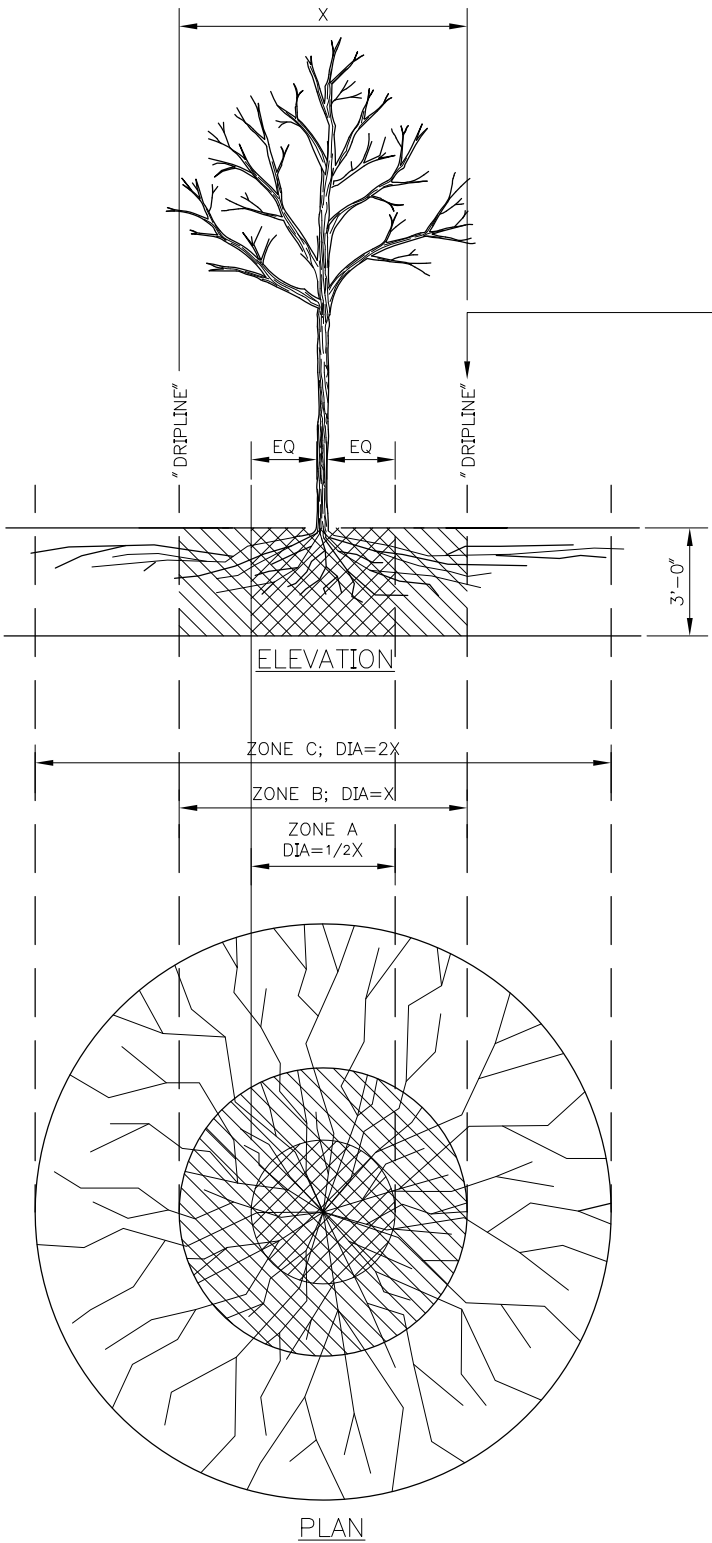

FENCING/ROOT PROTECTION

CHAIN LINK FENCING TO BE PROVIDED AND MAINTAINED AT DRIPLINE

ENGINEER'S APPROVAL REQUIRED FOR USE/ACCESS WITHIN ZONE B. PERMISSION FOR USE/ACCESS REQUIRES SURFACE PROTECTION FOR ALL UNFENCED, UNPAVED SURFACES WITHIN ZONE B

* SURFACE PROTECTION MEASURES

1. MULCH LAYER, 6" - 8" DEPTH
2. 3/4" PLYWOOD
3. STEEL PLATES

TRENCHING/EXCAVATION

ZONE A (CRITICAL ROOT ZONE)

1. NO DISTURBANCE ALLOWED WITHOUT SITE-SPECIFIC INSPECTION AND APPROVAL OF METHODS TO MINIMIZE ROOT DAMAGE
2. SEVERANCE OF ROOTS LARGER THAN 2" DIA REQUIRES ENGINEER'S APPROVAL
3. TUNNELING REQUIRED TO INSTALL LINES 3'-0" BELOW GRADE OR DEEPER

ZONE B (DRIPLINE)

1. OPERATION OF HEAVY EQUIPMENT AND/OR STOCKPILING OF MATERIALS SUBJECT TO ENGINEERS APPROVAL. SURFACE PROTECTION* MEASURES REQUIRED
2. TRENCHING ALLOWED AS FOLLOWS:
 - EXCAVATION BY HAND OR WITH HAND-DRIVEN TRENCHER MAY BE REQUIRED
 - LIMIT TRENCH WIDTH. DO NOT DISTURB ZONE A MAINTAIN 2/3 OR MORE OF ZONE B IN UNDISTURBED CONDITION
3. TUNNELING MAY BE REQUIRED FOR TRENCHES DEEPER THAN 3'-0"

ZONE C (FEEDER ROOT ZONE)

1. OPERATION OF HEAVY EQUIPMENT AND/OR STOCKPILING OF MATERIALS SUBJECT TO ENGINEERS APPROVAL. SURFACE PROTECTION* MEASURES MAY BE REQUIRED
2. TRENCHING WITH HEAVY EQUIPMENT ALLOWED AS FOLLOWS:
 - MINIMIZE TRENCH WIDTH
 - MAINTAIN 2/3 OR MORE OF ZONE C IN UNDISTURBED CONDITION

REF STD SPEC SEC 1-07.16 (2)



City of Seattle

NOT TO SCALE

TREE PROTECTION DURING
TRENCHING, TUNNELING OR
EXCAVATION

STANDARD PLAN NO 134

REV DATE: 2003

		TREES IN PLANTING STRIPS	TREES IN TREE PITS
HEAVY EQUIPMENT OPERATION	ROOT PROTECTION	<p>ALL NON-PAVED PLANTING STRIP SURFACES SUBJECT TO IMPACT (COMPACTION) BY CONSTRUCTION ACTIVITY SHALL BE PROTECTED WITH 6"-8" MULCH LAYER OR 3/4" PLYWOOD PANELS</p> <p>PROVIDE WOOD PLANKING OR STEEL PANELS UNDER BACKHOE STABILIZERS PLACED ANYWHERE IN THE PLANTING STRIP [1-07.16(2)]</p> <p>NO STORAGE OF MATERIALS OR EQUIPMENT IN THE PLANTING STRIP SHALL BE ALLOWED WITHOUT PROPER SURFACE PROTECTION AND WRITTEN AUTHORIZATION FROM THE ENGINEER</p>	<p>RETAIN EXISTING PAVING DURING CONSTRUCTION</p> <p>SCHEDULE PAVEMENT REPLACEMENT TO MINIMIZE EXPOSURE OF SURFACE ROOTS TO DRYING, EQUIPMENT DAMAGE, COMPACTION, ETC. EXPOSURE FOR LONGER THAN 48 HOURS REQUIRES MULCH APPLICATION</p>
	CANOPY PROTECTION	<p>OVERHEAD BRANCHING LIKELY TO BE DAMAGED BY EQUIPMENT OPERATION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER WITH PREVENTIVE MEASURES (PRUNING OR TIE-BACK OF BRANCHES) APPROVED BY THE ENGINEER AND PROPERLY EXECUTED BEFORE COMMENCEMENT OF THE WORK</p>	
	TRUNK PROTECTION	<p>PROVIDE CHAIN LINK CONSTRUCTION FENCE IN INDIVIDUAL FENCE INSTALLATIONS FOR EACH TREE OR THE LENGTH OF THE PLANTING STRIP.</p>	<p>PROVIDE 5'-0" MIN HEIGHT FENCE INSTALLATIONS FOR EACH TREE TO ENCLOSE ENTIRE TREE PIT OPENING.</p>
SIDEWALK RECONSTRUCTION	<p>ROOT PRUNE <u>ONLY</u> AS APPROVED BY THE ENGINEER</p> <p>MAINTAIN 2'-0" MIN CLEARANCE FROM FLARE OF TRUNK WHEN SETTING FORMS.</p>	<p>PROVIDE 5'-0"X5'-0" OR 4'-0"X6'-0" (24 SQ FT MIN) TREE PITS IN NEW SIDEWALK FOR <u>NEW</u> TREES. TREE PIT SIZE FOR EXISTING TREES SHALL BE ELONGATED (8'-0" TO 12'-0"+). PITS MAY BE REQUIRED TO MINIMIZE ROOT IMPACTS WHILE MAINTAINING REQUIRED SIDEWALK WIDTH</p>	
TRENCH OR TUNNELING	SEE STD PLAN NO 133		


REF STD SPEC SEC 1-07.16(2)



City of Seattle

NOT TO SCALE

CONSTRUCTION AROUND EXISTING TREES

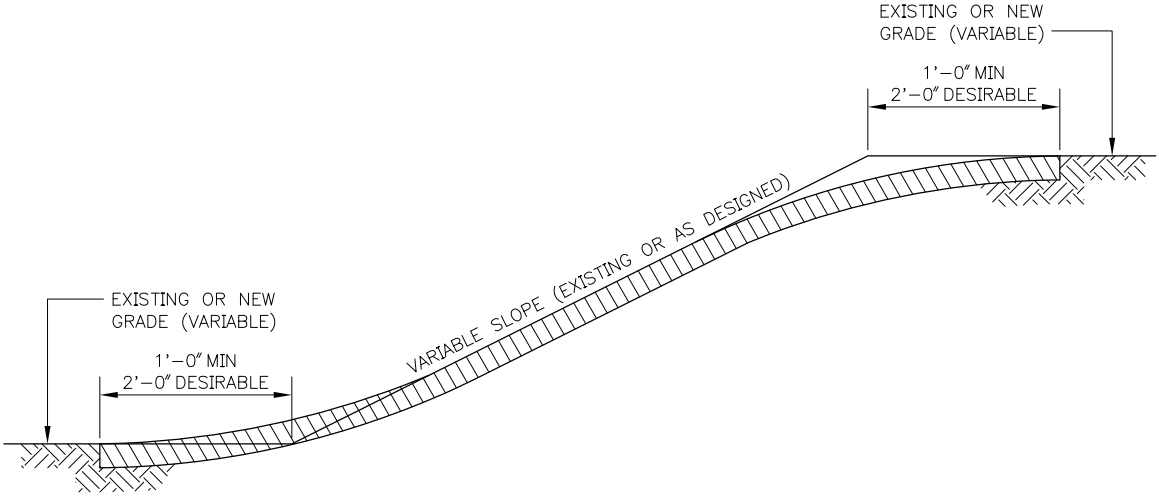

REF STD SPEC SEC 2-03




City of Seattle

NOT TO SCALE


SLOPE ROUNDING

STANDARD PLAN NO 141

REV DATE: 2003

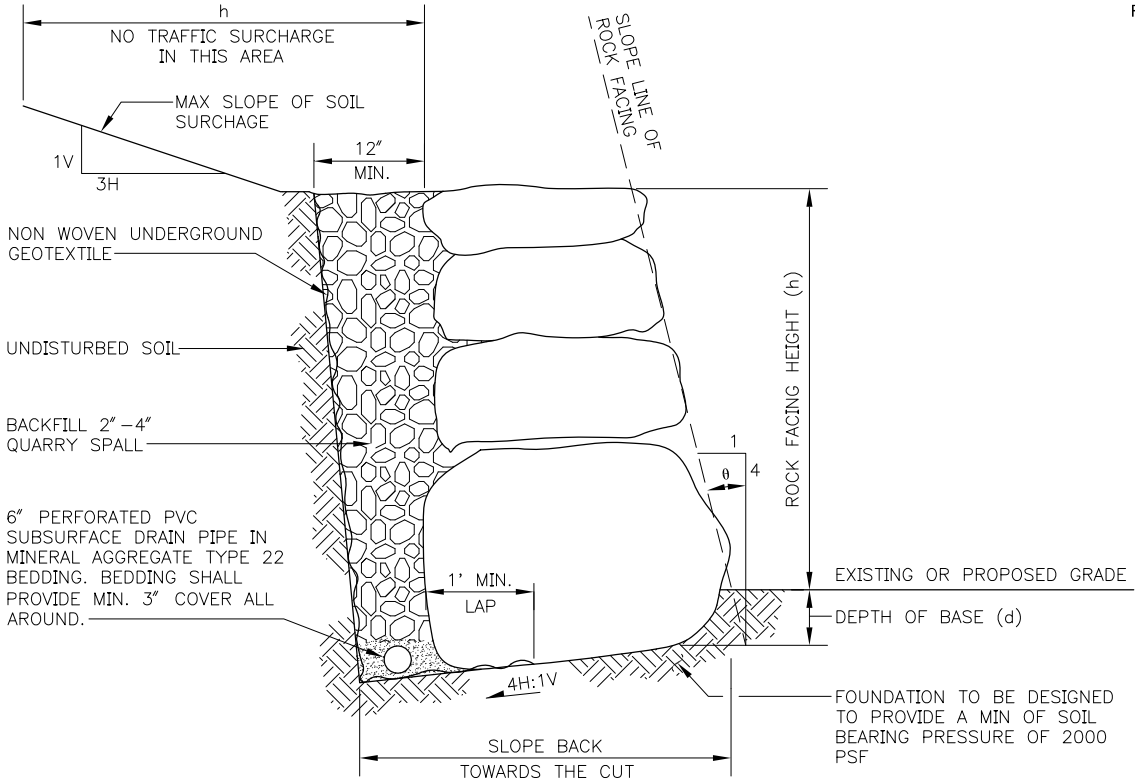

SECTION

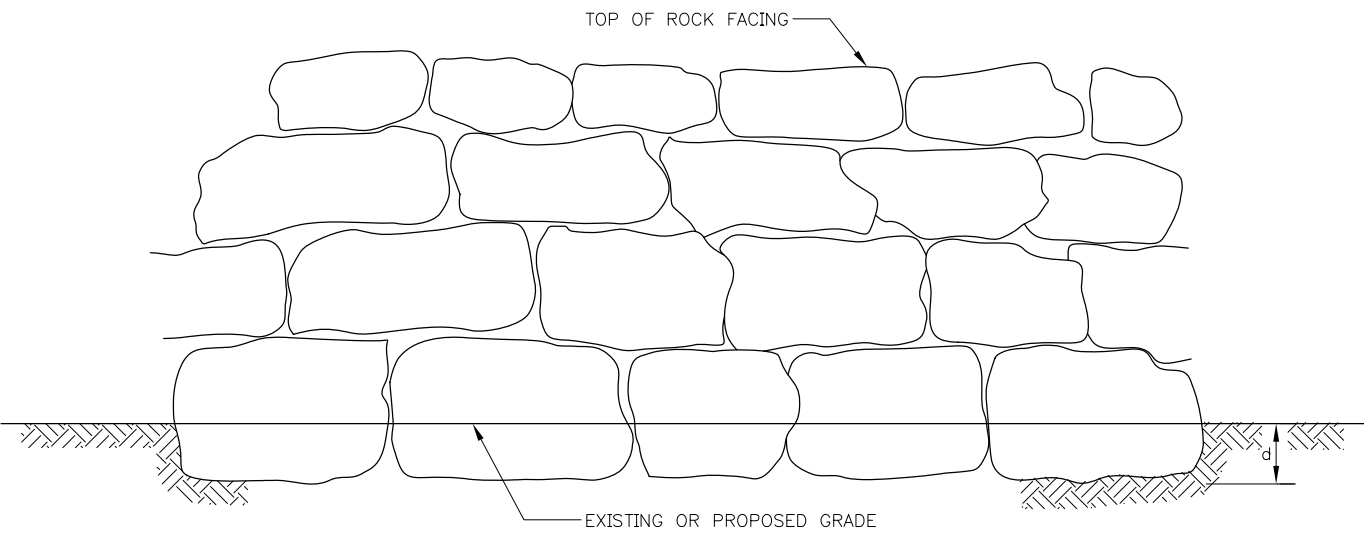

ELEVATION

(h)	(d)	MINIMUM ROCK	
		SIZE(BASE)	SIZE(TOP)
2 FEET	3 INCHES	2-MAN	1-MAN
4 FEET	6 INCHES	3-MAN	2-MAN
6 FEET	9 INCHES	4-MAN	2-MAN
8 FEET	12 INCHES	5-MAN	2-MAN

$\theta = 14^\circ \pm 1^\circ$

REF STD SPEC SEC 2-08



City of Seattle

NOT TO SCALE


ROCK FACING

STANDARD PLAN NO 200a


REV DATE: 2003

NOTES:

1. TYPE A MANHOLE DESIGNATES MANHOLES WITH PRECAST CONCENTRIC CONE SECTIONS.
2. TYPE B MANHOLE DESIGNATES MANHOLES WITH TOP SLABS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STANDARD PLAN NO 200b.
4. MAXIMUM DIMENSION FROM OUTSIDE MANHOLE WALL TO THE FIRST PIPE JOINT, THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
5. FOR TYPE A MANHOLE, LOCATE MANHOLE STEPS ON THE SIDE PERPENDICULAR TO THE DIRECTION OF THE FLOW IN THE CHANNEL.
6. FOR TYPE B MANHOLE, LOCATE MANHOLE STEPS OPPOSITE TO THE DOWNSTREAM OPENING.
7. TOTAL HEIGHT OF AN EXTENSION, MANHOLE FRAME AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
8. MANHOLE BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MANHOLES.
9. THE MAXIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MANHOLE WALL THICKNESS. THE MINIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS 4 INCHES. MINIMUM DISTANCE BETWEEN HOLES IS 8 INCHES.
10. PRECAST MANHOLE COMPONENTS SHALL CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS SHALL BE RUBBER GASKETED CONFORMING TO ASTM C 443.

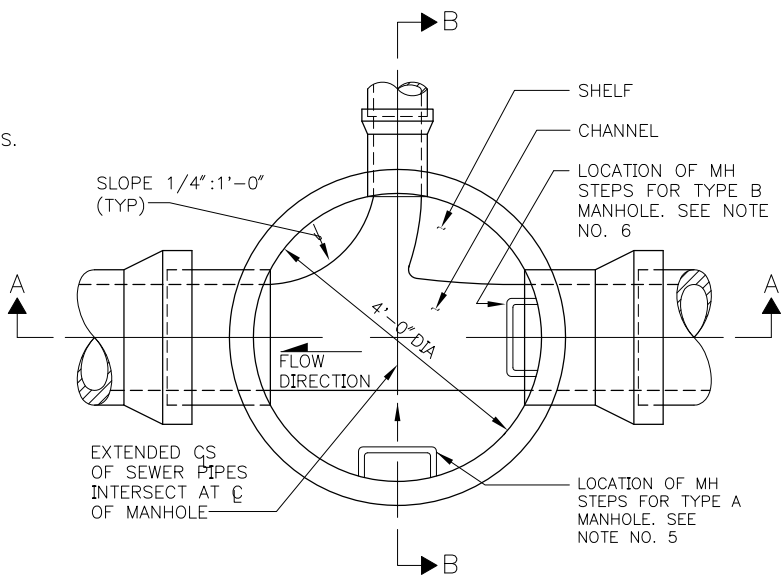


PLAN VIEW
(TOP REMOVED)

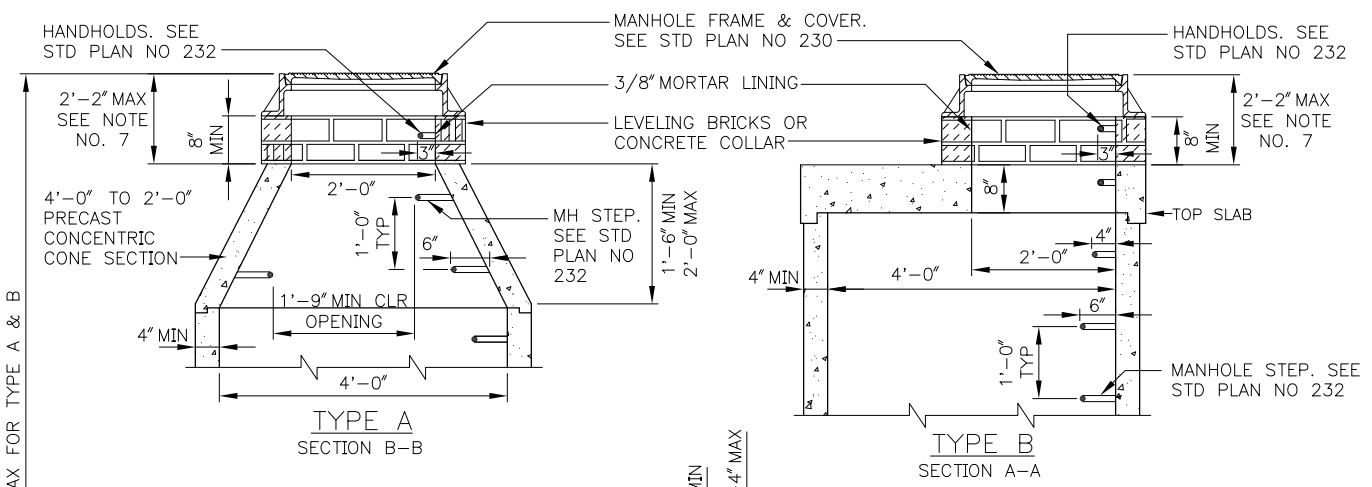

TYPE A
SECTION B-B

TYPE B
SECTION A-A

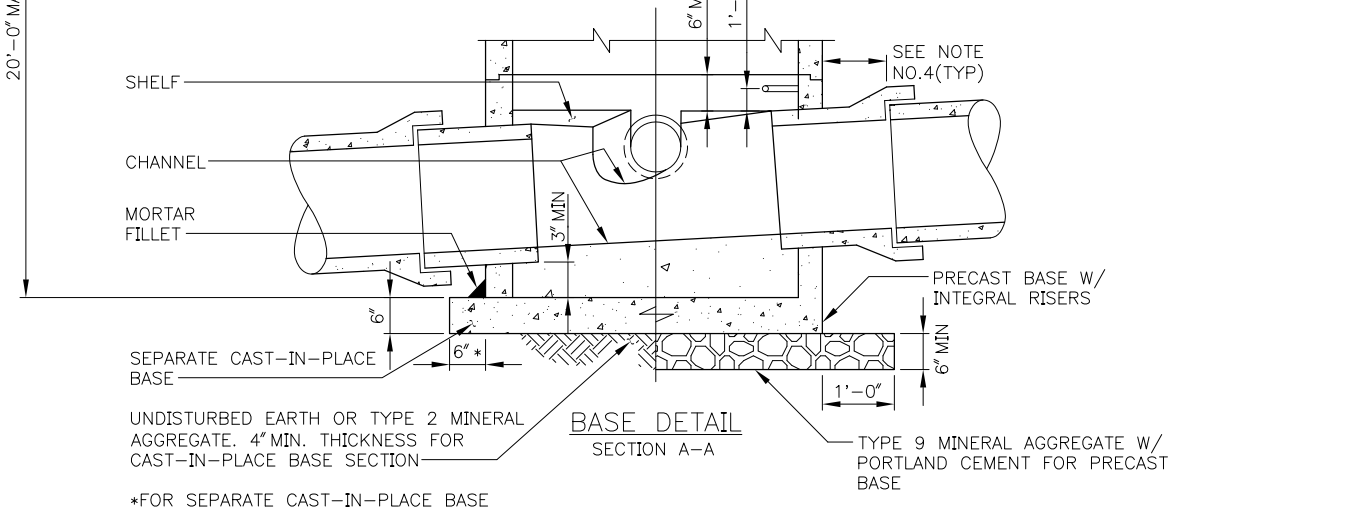

BASE DETAIL
SECTION A-A

*FOR SEPARATE CAST-IN-PLACE BASE


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

TYPE 200 MANHOLE

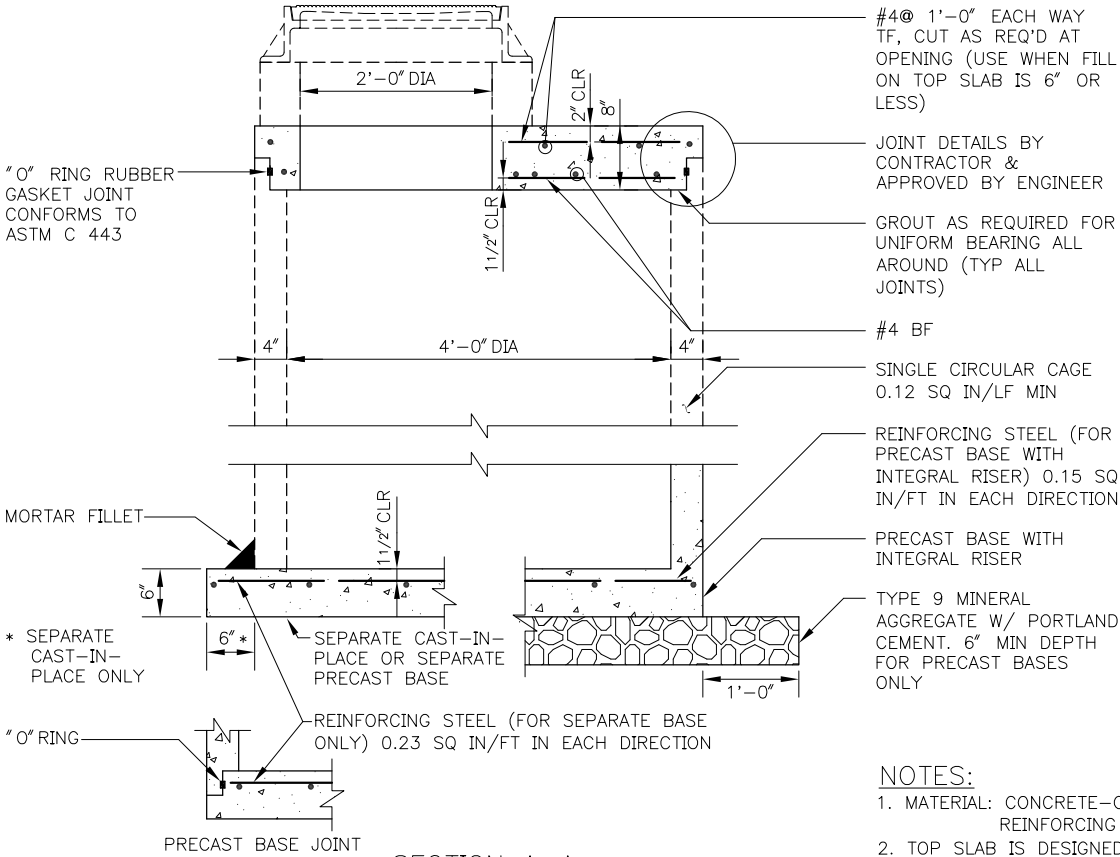

SECTION A-A

#4@ 1'-0" EACH WAY
TF, CUT AS REQ'D AT
OPENING (USE WHEN FILL
ON TOP SLAB IS 6" OR
LESS)

JOINT DETAILS BY
CONTRACTOR &
APPROVED BY ENGINEER

GRAUT AS REQUIRED FOR
UNIFORM BEARING ALL
AROUND (TYP ALL
JOINTS)

#4 BF


SINGLE CIRCULAR CAGE
0.12 SQ IN/LF MIN

REINFORCING STEEL (FOR
PRECAST BASE WITH
INTEGRAL RISER) 0.15 SQ
IN/FT IN EACH DIRECTION

PRECAST BASE WITH
INTEGRAL RISER

TYPE 9 MINERAL
AGGREGATE W/ PORTLAND
CEMENT. 6" MIN DEPTH
FOR PRECAST BASES
ONLY

- NOTES:**
1. MATERIAL: CONCRETE-CLASS AX
REINFORCING STEEL-ASTM A 615 GR 60
 2. TOP SLAB IS DESIGNED FOR 3'-0" MAX COVER
BASE IS DESIGNED FOR 20'-0" MAX COVER
 3. HEIGHT 8'-0" TO 12'-0":
MIN. REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 4. HEIGHT 12'-0" TO 20'-0":
MIN. REQUIRED SOIL BEARING = 3800 LBS/SQ FT

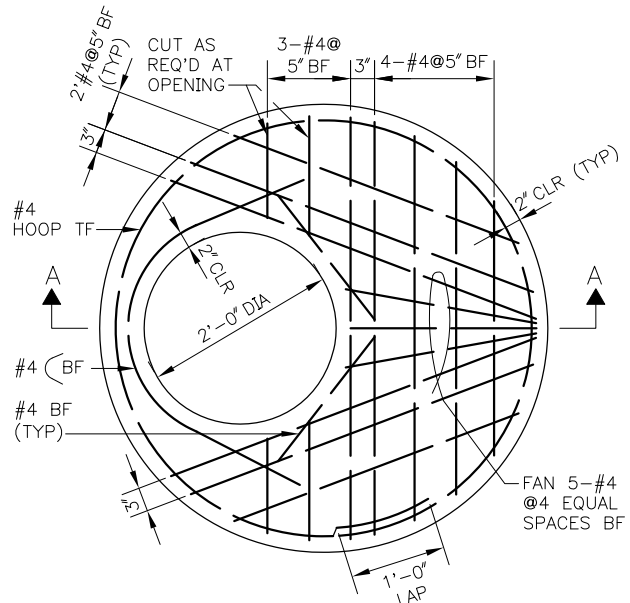

TYPE 200 MH-TOP SLAB

REF STD SPEC SEC 7-05



NOT TO SCALE




TYPE 200 MANHOLE
TOP & BOTTOM SLABS

STANDARD PLAN NO 201a

REV DATE: 2003

NOTES:

1. TYPE A MANHOLE DESIGNATES MANHOLES WITH PRECAST CONCENTRIC CONE SECTIONS.
2. TYPE B MANHOLE DESIGNATES MANHOLES WITH TOP SLABS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STANDARD PLAN NO 201b.
4. MAXIMUM DIMENSION FROM OUTSIDE MANHOLE WALL TO THE FIRST PIPE JOINT, THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
5. FOR TYPE A MANHOLE, LOCATE MANHOLE STEPS ON THE SIDE PERPENDICULAR TO THE DIRECTION OF THE FLOW IN THE CHANNEL.
6. FOR TYPE B MANHOLE, LOCATE MANHOLE STEPS OPPOSITE TO THE DOWNSTREAM OPENING.
7. TOTAL HEIGHT OF AN EXTENSION, MANHOLE FRAME AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
8. MANHOLE BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MANHOLES.
9. THE MAXIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MANHOLE WALL THICKNESS. THE MINIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS 4 INCHES. MINIMUM DISTANCE BETWEEN HOLES IS 8 INCHES.
10. PRECAST MANHOLE COMPONENTS SHALL CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS SHALL BE RUBBER GASKETED CONFORMING TO ASTM C 443.

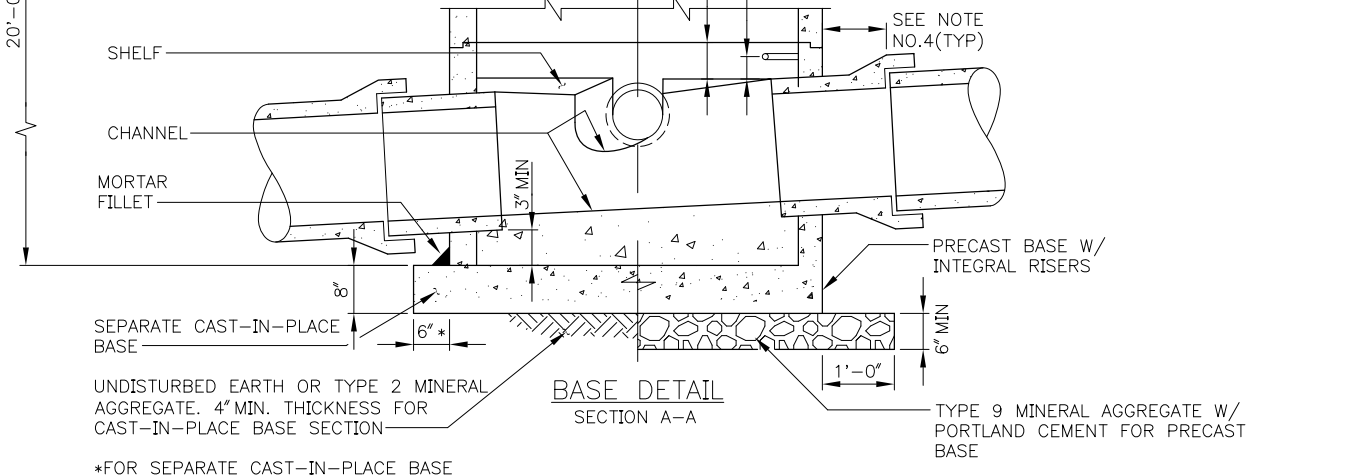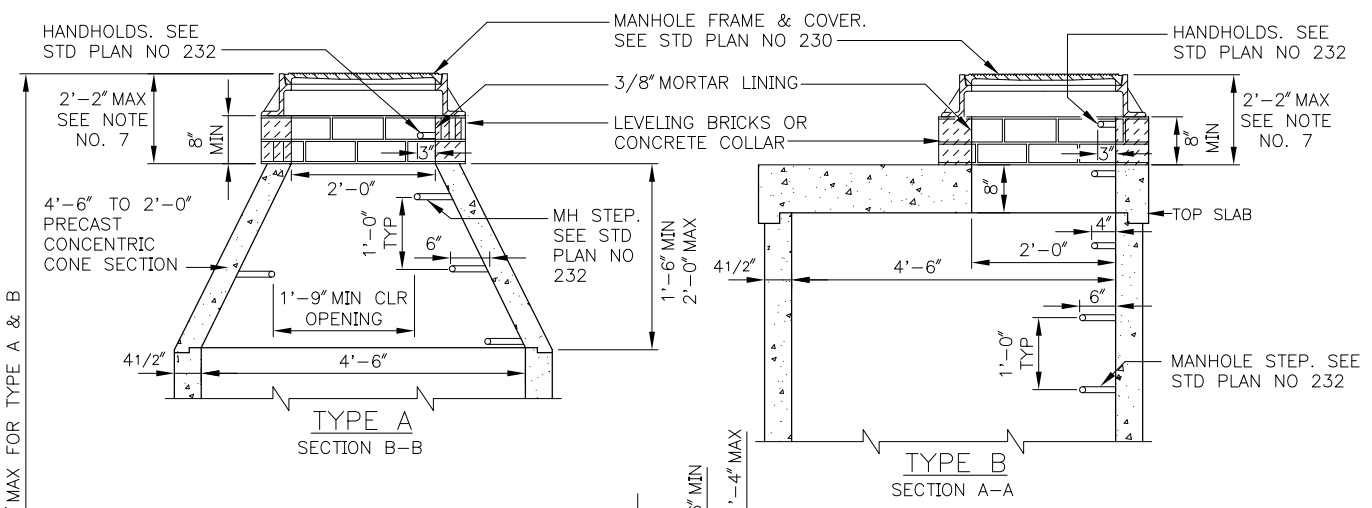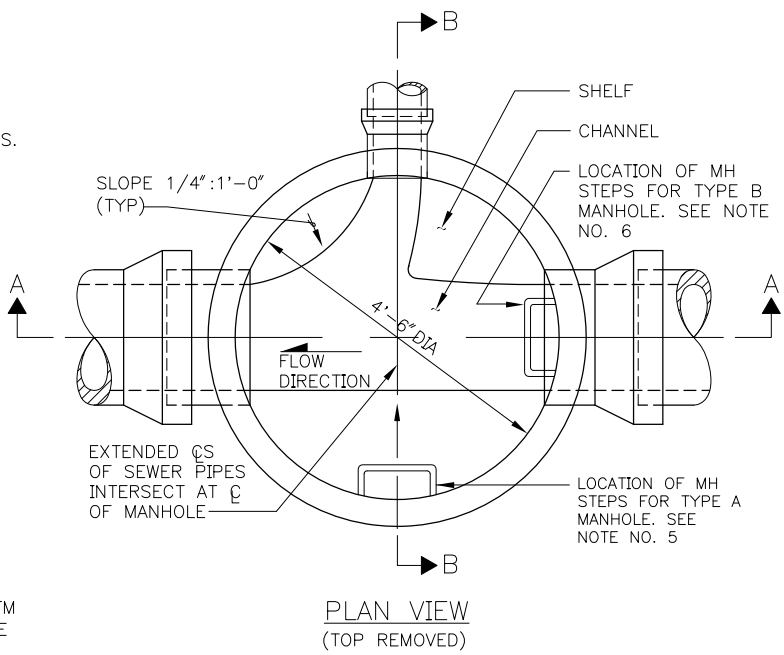

*FOR SEPARATE CAST-IN-PLACE BASE


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

TYPE 201 MANHOLE

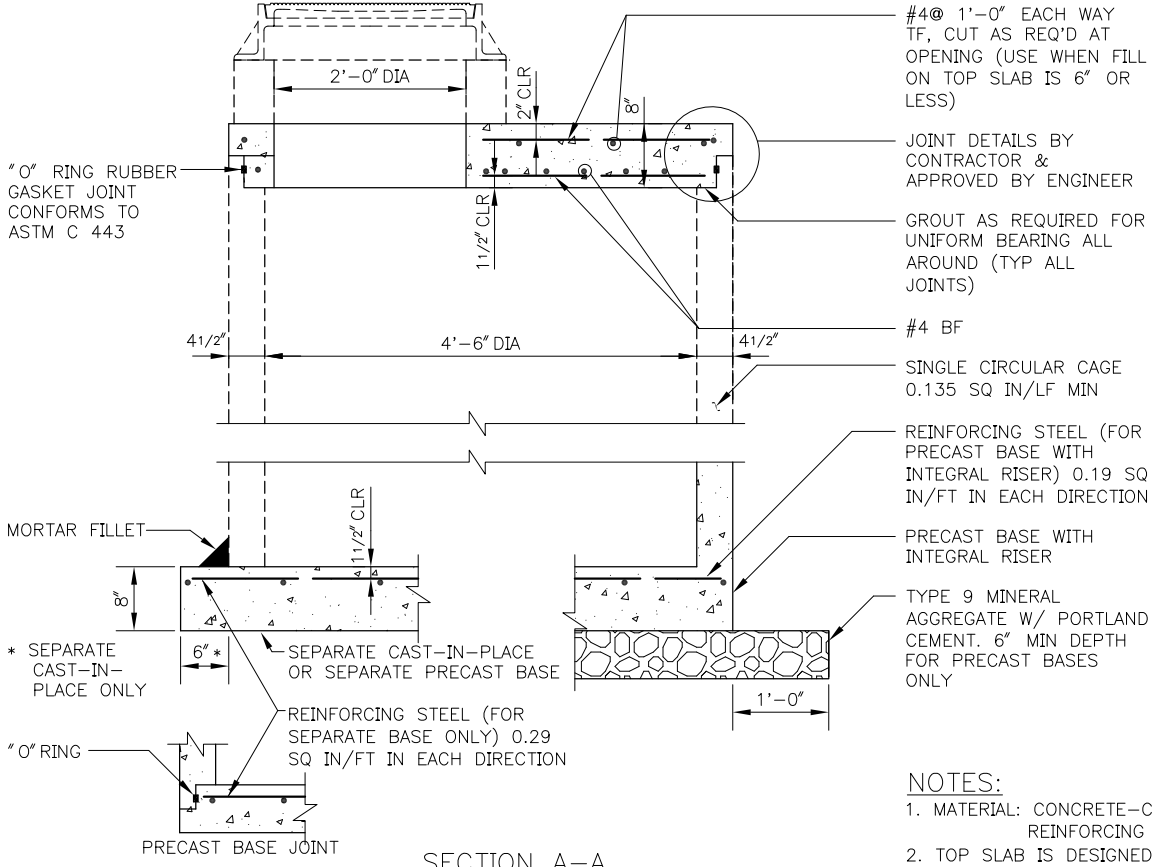

SECTION A-A

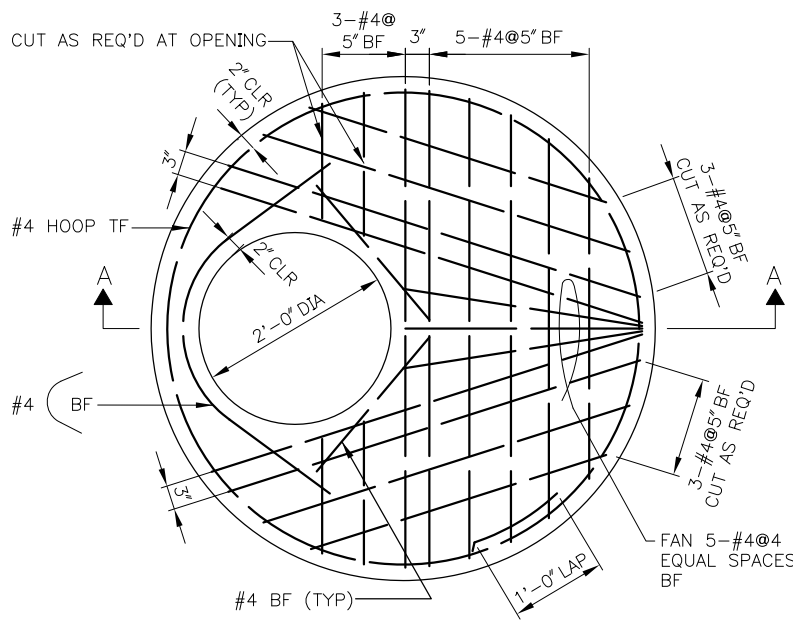

TYPE 201 MH-TOP SLAB

- NOTES:**
1. MATERIAL: CONCRETE-CLASS AX
REINFORCING STEEL-ASTM A 615 GR 60
 2. TOP SLAB IS DESIGNED FOR 3'-0" MAX COVER
BASE IS DESIGNED FOR 20'-0" MAX COVER
 3. HEIGHT 8'-0" TO 12'-0":
MIN. REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 4. HEIGHT 12'-0" TO 20'-0":
MIN. REQUIRED SOIL BEARING = 3800 LBS/SQ FT

REF STD SPEC SEC 7-05




NOT TO SCALE

TYPE 201 MANHOLE
TOP & BOTTOM SLABS


STANDARD PLAN NO 202a

REV DATE: 2003

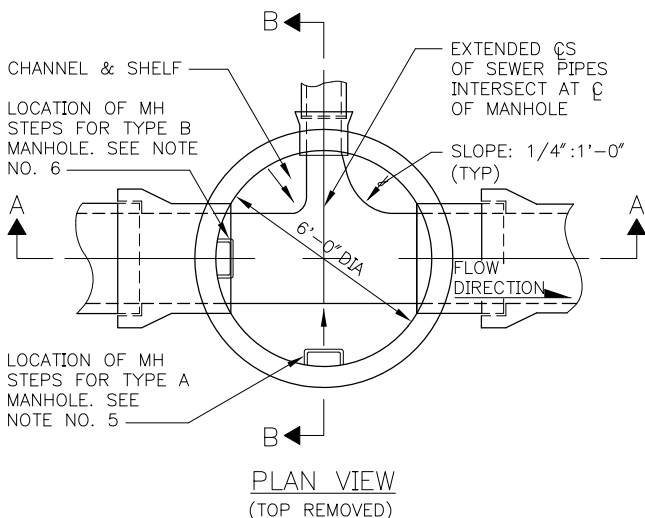

NOTES:

- MH 202 TYPE A DESIGNATES A MANHOLE TOP SLAB WITH A 4'-0" DIA ACCESS.
- MH 202 TYPE B DESIGNATES A MANHOLE TOP SLAB WITH A 2'-0" DIA ACCESS.
- TOP SLAB AND BASE SECTION DETAILS, SEE STANDARD PLAN NO 202b.
- MAXIMUM DIMENSION FROM OUTSIDE MANHOLE WALL TO THE FIRST PIPE JOINT. THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
- FOR TYPE A MANHOLE, LOCATE MANHOLE STEPS ON THE SIDE PERPENDICULAR TO THE DIRECTION OF THE FLOW IN THE CHANNEL.
- FOR TYPE B MANHOLE, LOCATE MANHOLE STEPS OPPOSITE TO THE DOWNSTREAM OPENING.
- TOTAL HEIGHT OF AN EXTENSION, MANHOLE FRAME & COVER AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
- MANHOLE BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MANHOLES.
- THE MAXIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MANHOLE WALL THICKNESS. THE MINIMUM HOLE SIZE SHALL BE THE OUTSIDE DIAMETER OF THE PIPE PLUS 4 INCHES. MINIMUM DISTANCE BETWEEN HOLES IS 1'-0" INCHES.
- PRECAST MANHOLE COMPONENTS SHALL CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS SHALL BE RUBBER GASKETED CONFORMING TO ASTM C 443.

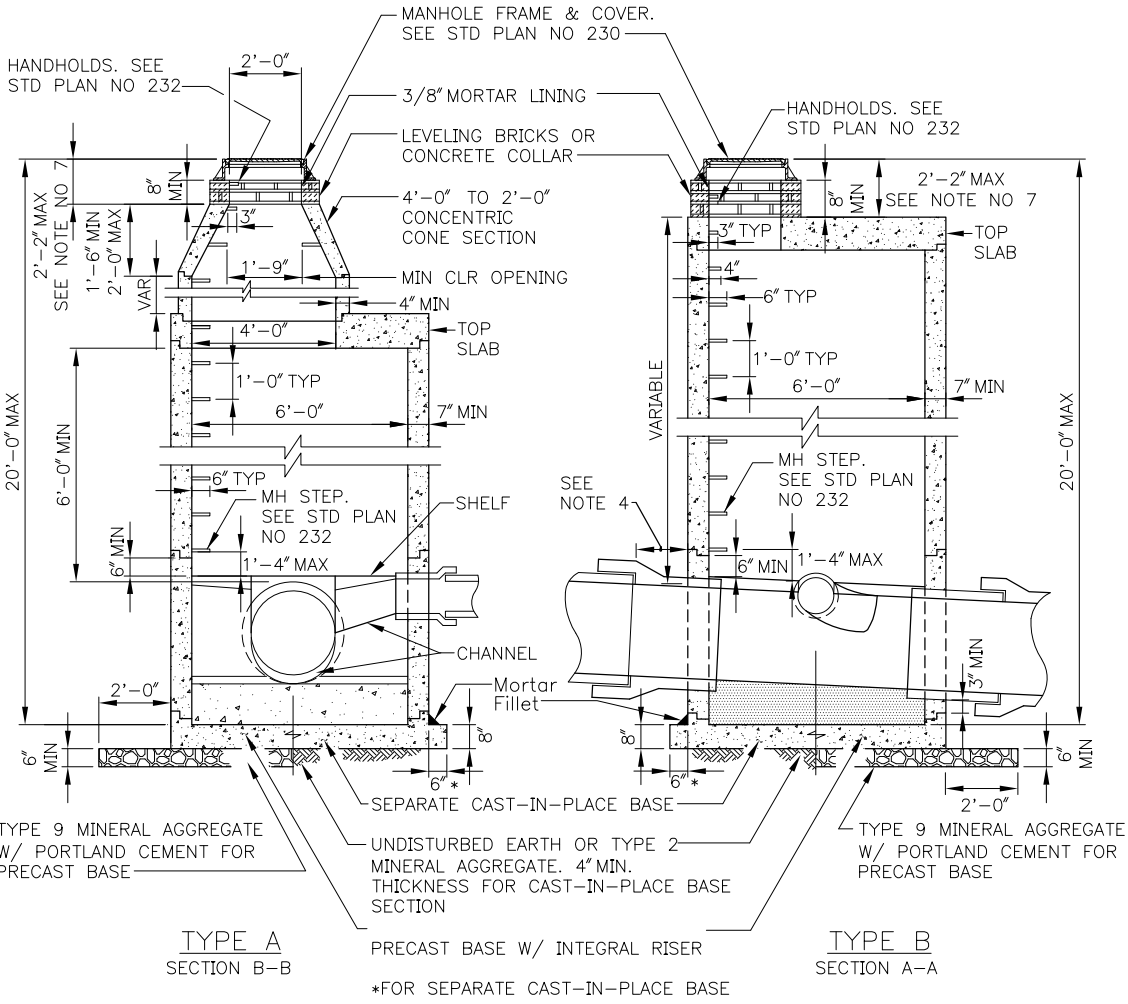

REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 202 MANHOLE

STANDARD PLAN NO 202b

REV DATE: 2003

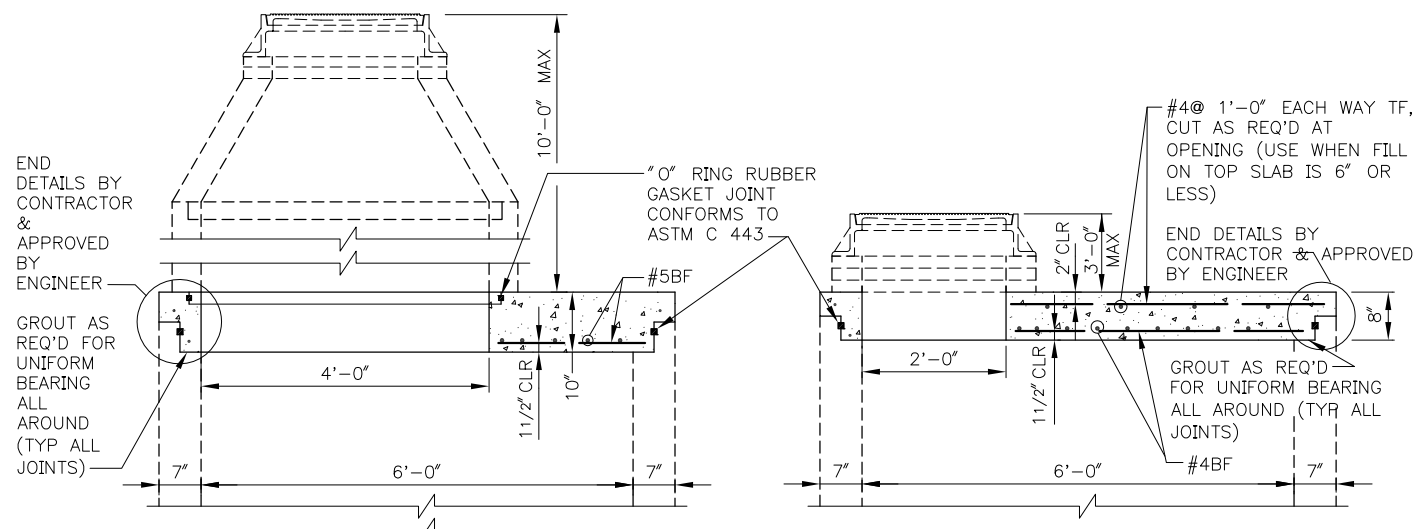


SECTION B-B
TOP SLAB ONLY

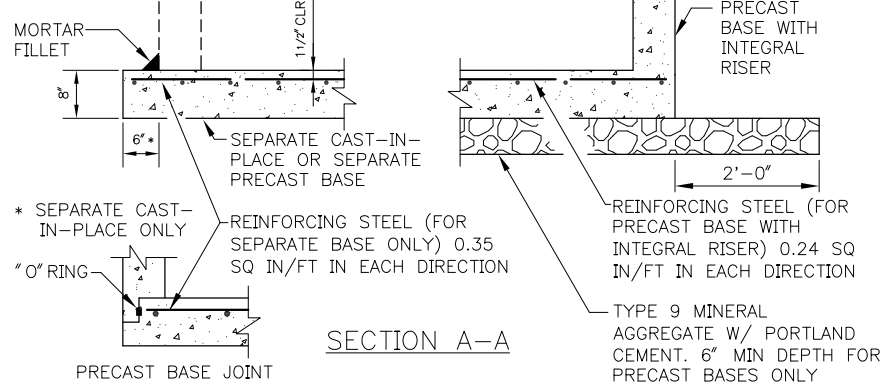


SECTION A-A
PRECAST BASE JOINT

- NOTES:
1. MATERIAL: CONCRETE—CLASS AX
REINFORCING STEEL—ASTM A 615 GR 60
 2. TOP SLAB IS DESIGNED FOR 10'-0" MAX COVER FOR TYPE A AND 3'-0" MAX COVER FOR TYPE B
 3. BASE IS DESIGNED FOR 20'-0" MAX COVER
 4. HEIGHT 8'-0" TO 12'-0":
MIN REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 5. HEIGHT 12'-0" TO 20'-0":
MIN REQUIRED SOIL BEARING = 3800 LBS/SQ FT

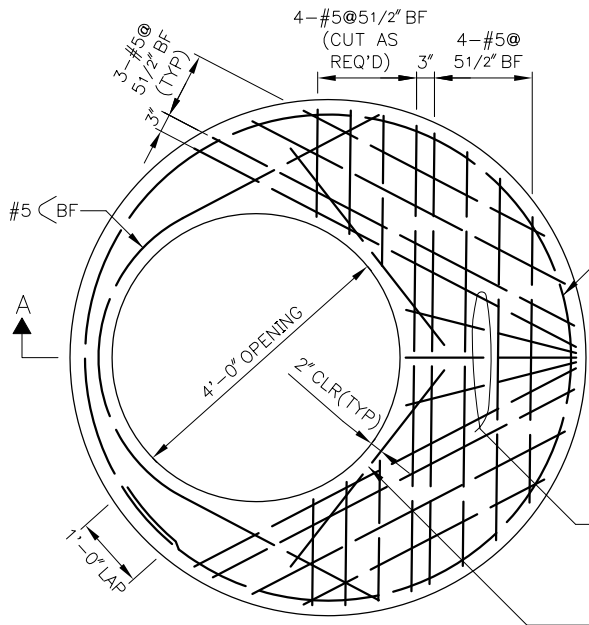

TYPE A MH-TOP SLAB

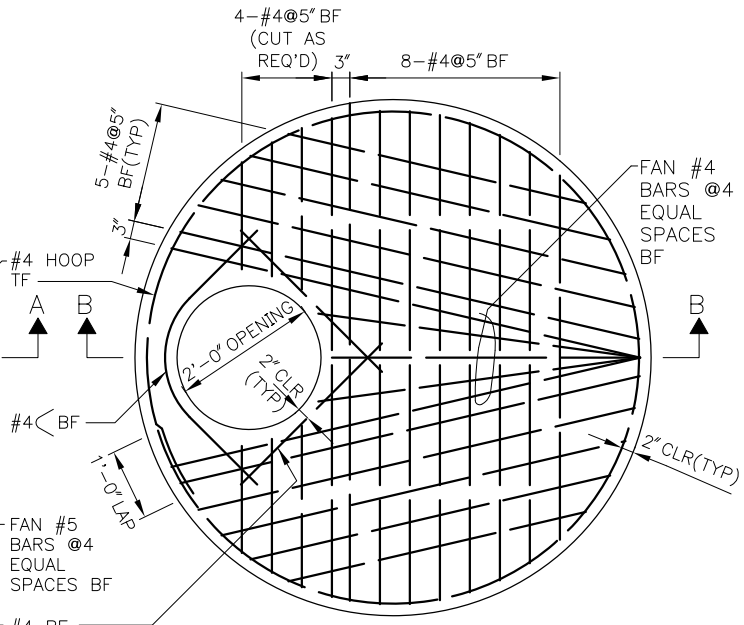

TYPE B MH-TOP SLAB

REF STD SPEC SEC 7-05




NOT TO SCALE

TYPE 202 MANHOLE
TOP & BOTTOM SLABS

STANDARD PLAN NO 203a

REV DATE: 2003

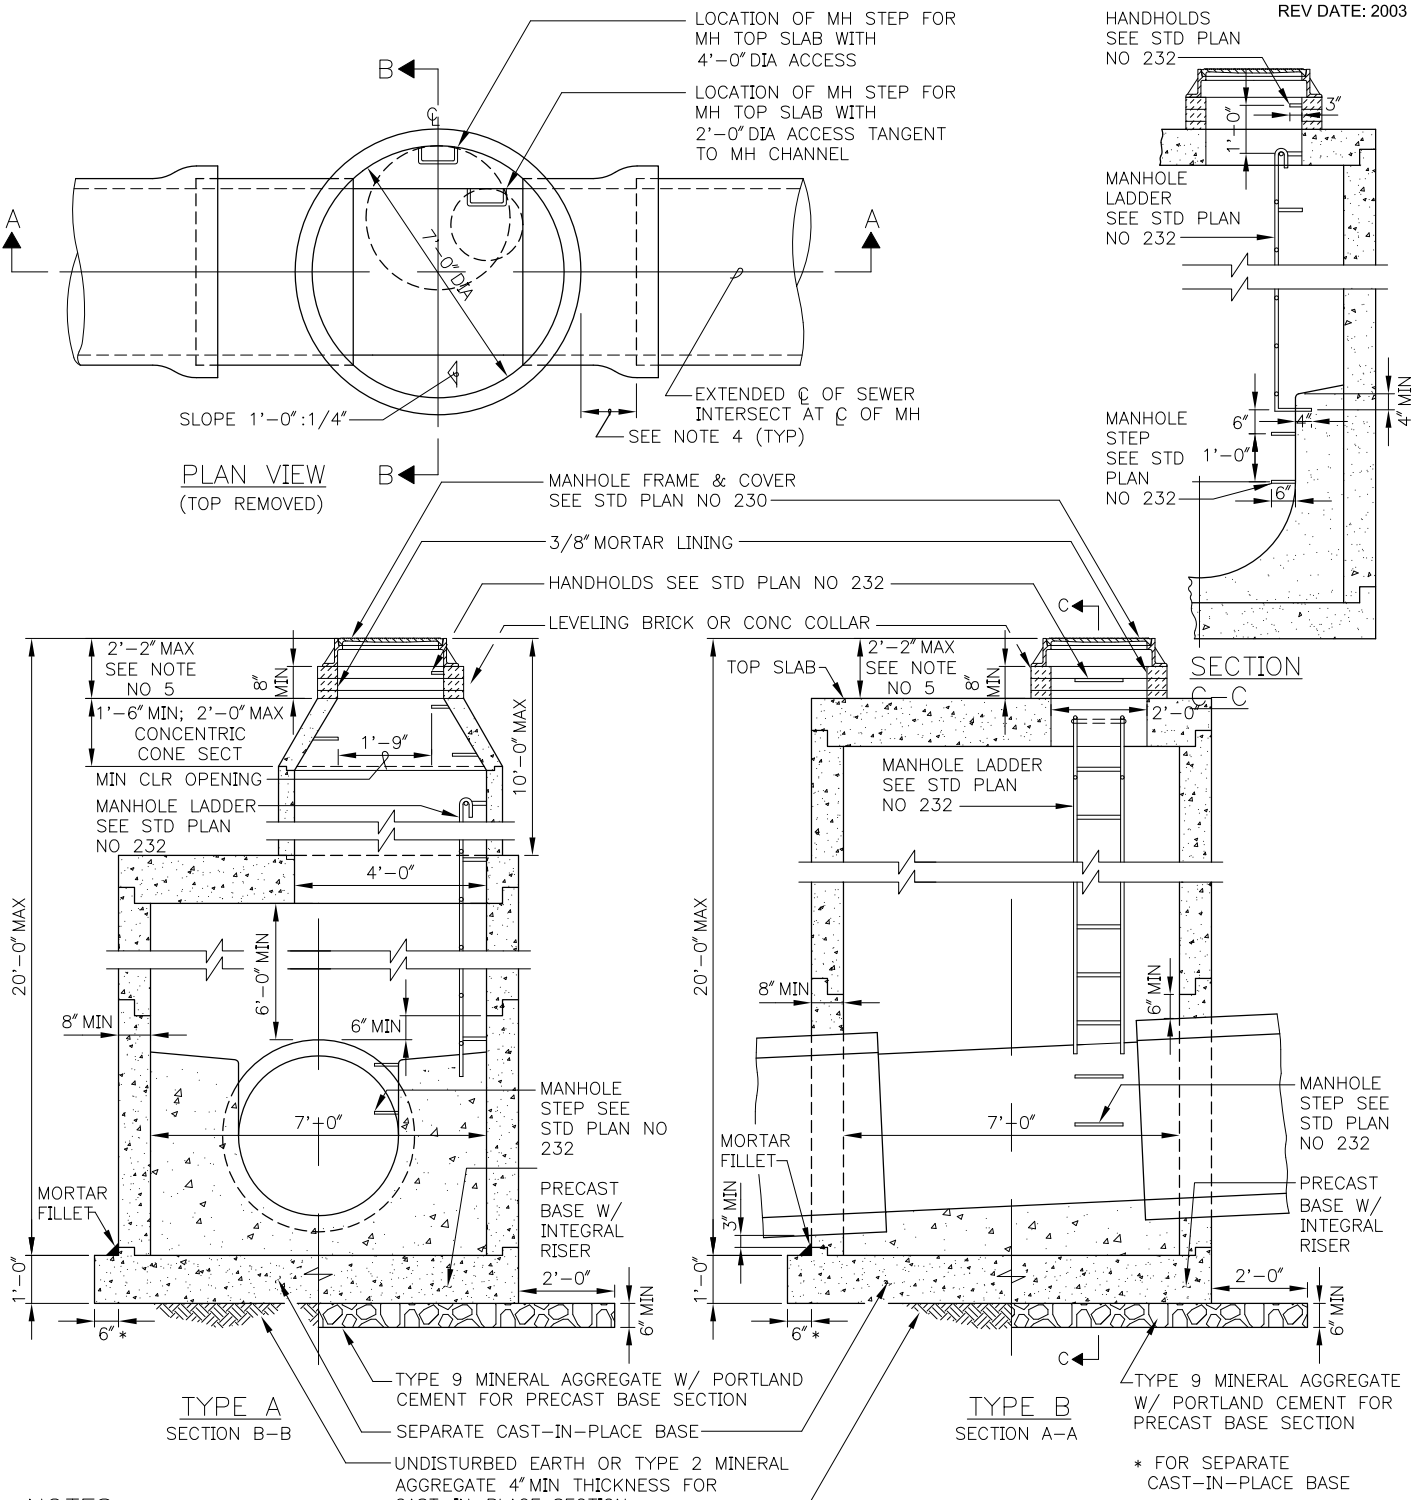



NOTES:

1. TYPE A MH DESIGNATES A MH TOP SLAB WITH A 4'-0" DIA ACCESS.
2. TYPE B MH DESIGNATES A MH TOP SLAB WITH A 2'-0" DIA ACCESS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STD PLAN NO 203b.
4. MAX DIMENSION FROM OUTSIDE MH WALL TO THE FIRST PIPE FLEX JOINT. THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
5. TOTAL HEIGHT OF FRAME EXTENSIONS, MH FRAME AND COVER, AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
6. MH BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MHS.
7. MAX HOLE SIZE IS EQUAL TO THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MH WALL THICKNESS. MIN DISTANCE BETWEEN HOLES IS 1'-0".
8. PRECAST MH COMPONENTS SHALL CONFORM TO ASTM C 478. JOINTS BETWEEN PRECAST COMPONENTS SHALL BE RUBBER GASKETED CONFORMING TO ASTM C 443.

REF STD SPEC SEC 7-05



STANDARD PLAN NO 203b

REV DATE: 2003

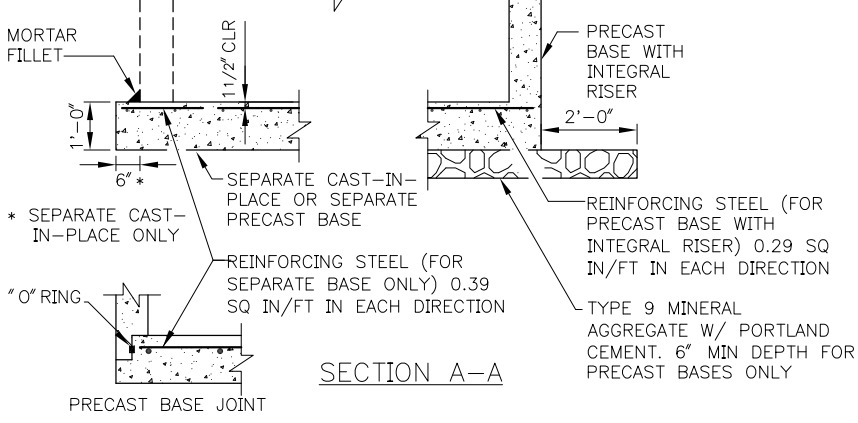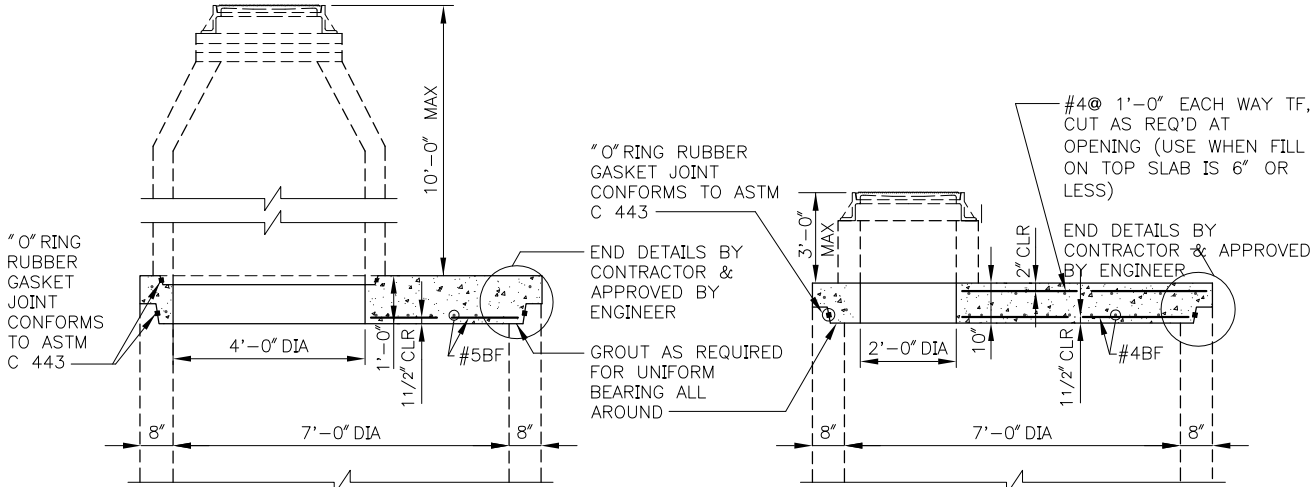

SECTION B-B
TOP SLAB ONLY

- NOTES:
1. MATERIAL: CONCRETE—CLASS AX
REINFORCING STEEL—ASTM A 615 GR 60
 2. TOP SLAB IS DESIGNED FOR 10'-0" MAX COVER FOR TYPE A AND 3'-0" MAX COVER FOR TYPE B
 3. BASE IS DESIGNED FOR 20'-0" MAX COVER
 4. HEIGHT 8'-0" TO 12'-0":
MIN REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 5. HEIGHT 12'-0" TO 20'-0":
MIN REQUIRED SOIL BEARING = 3800 LBS/SQ FT

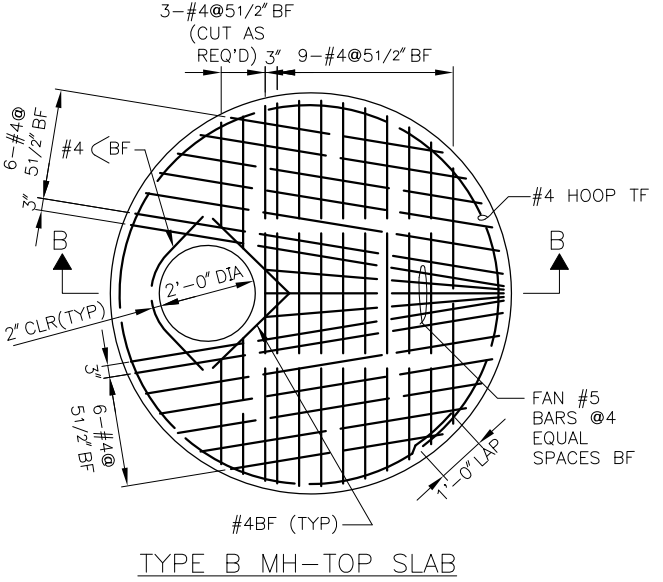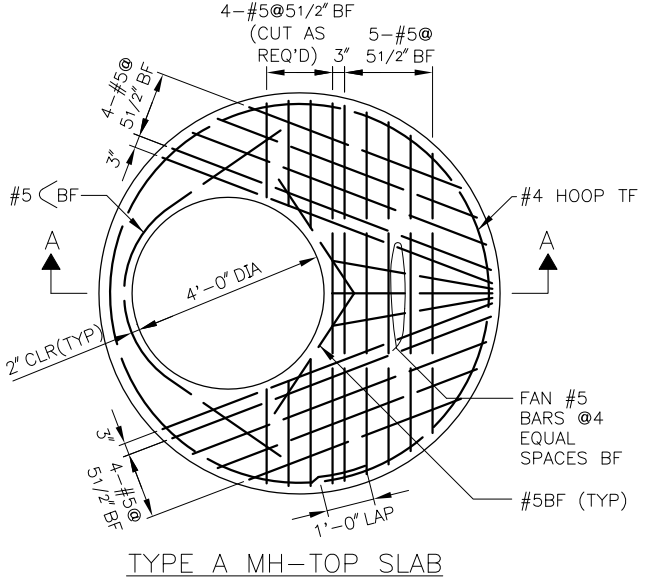

TYPE A MH-TOP SLAB

TYPE B MH-TOP SLAB

REF STD SPEC SEC 7-05







NOT TO SCALE

TYPE 203 MANHOLE
TOP & BOTTOM SLABS

STANDARD PLAN NO 204a

REV DATE: 2003

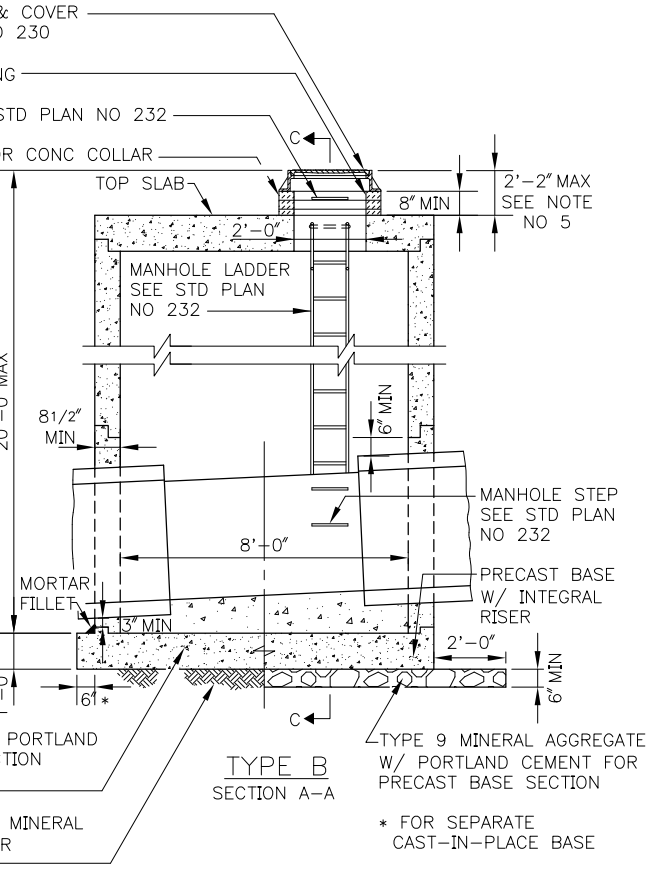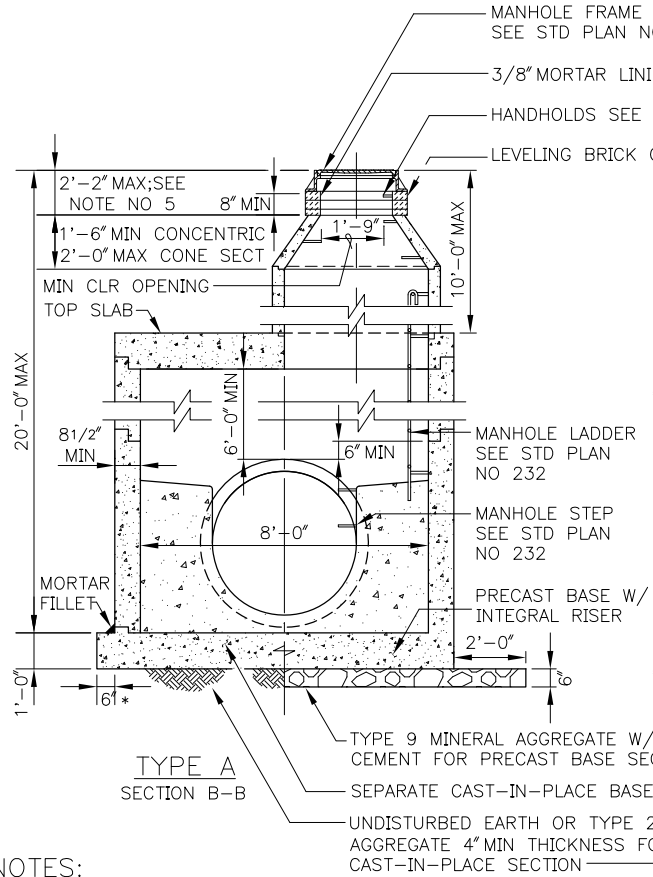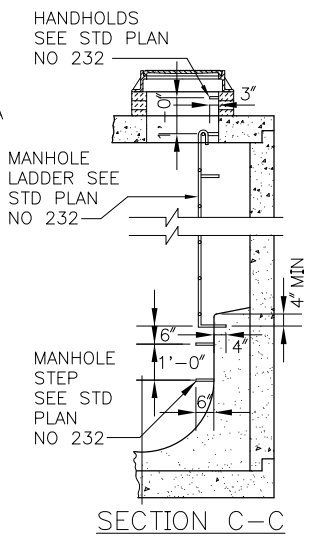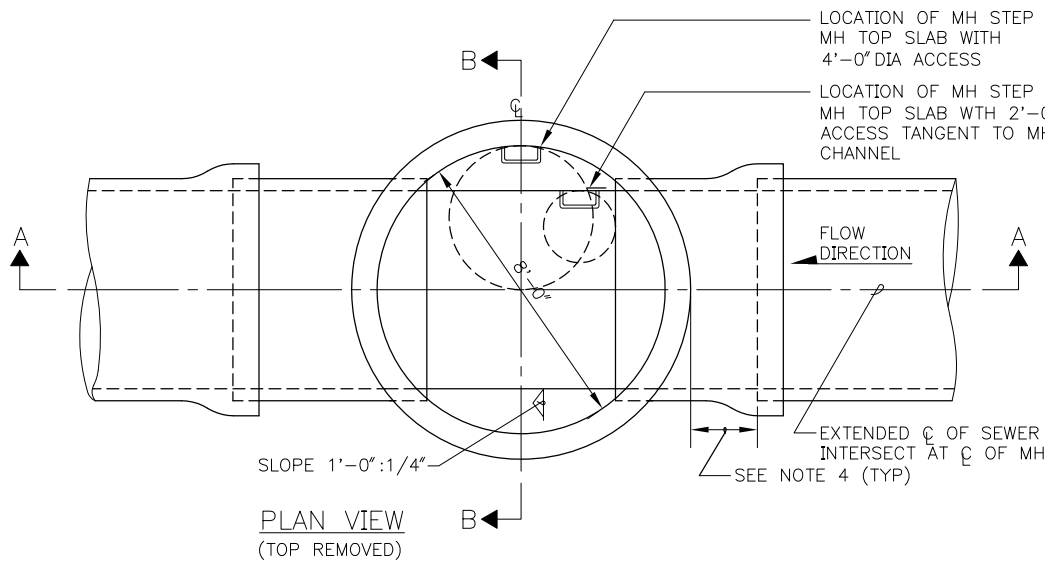

NOTES:

1. TYPE A MH DESIGNATES A MH TOP SLAB WITH A 4'-0" DIA ACCESS.
2. TYPE B MH DESIGNATES A MH TOP SLAB WITH A 2'-0" DIA ACCESS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STD PLAN NO 204.B.
4. MAX DIMENSION FROM OUTSIDE MH WALL TO THE FIRST PIPE JOINT. THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
5. TOTAL HEIGHT OF FRAME EXTENSIONS, MH FRAME AND COVER, AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
6. MH BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MHS.
7. MAX HOLE SIZE IS EQUAL TO THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MH WALL THICKNESS. MIN DISTANCE BETWEEN HOLES IS 1'-0".

REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 204 MANHOLE

STANDARD PLAN NO 204b

REV DATE: 2003

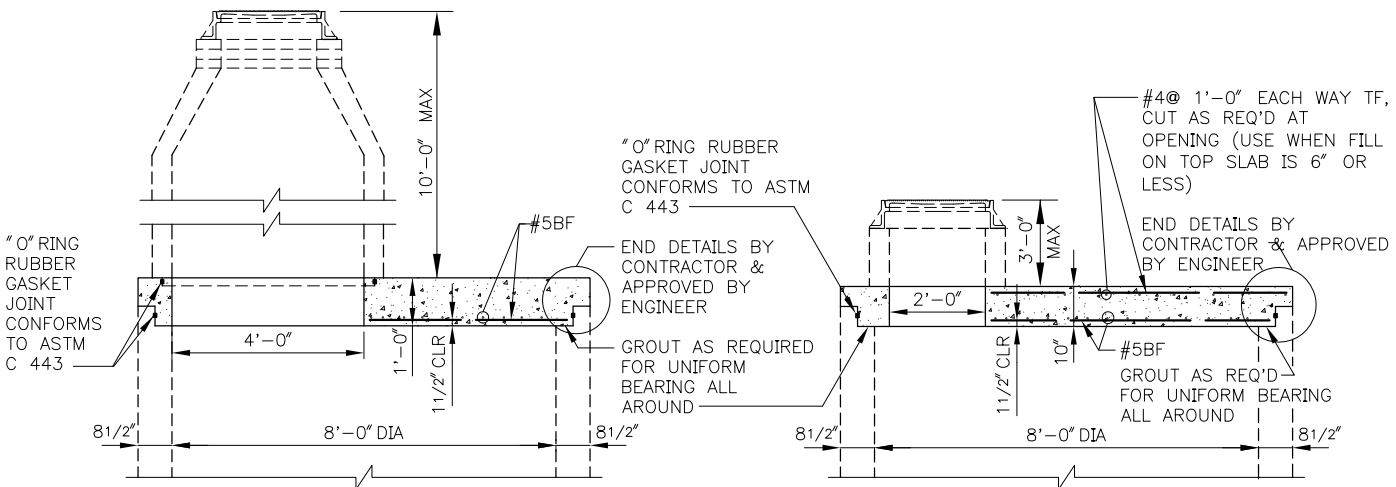


SECTION B-B
TOP SLAB ONLY

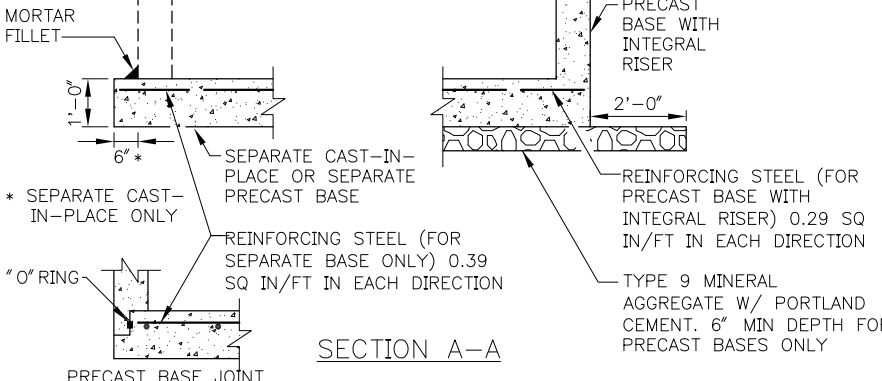


SECTION A-A
PRECAST BASE JOINT

- NOTES:
1. MATERIAL: CONCRETE-CLASS AX
REINFORCING STEEL-ASTM A 615 GR 60
 2. TOP SLAB IS DESIGNED FOR 10'-0" MAX COVER FOR TYPE A AND 3'-0" MAX COVER FOR TYPE B
 3. BASE IS DESIGNED FOR 20'-0" MAX COVER
 4. HEIGHT 8'-0" TO 12'-0":
MIN REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 5. HEIGHT 12'-0" TO 20'-0":
MIN REQUIRED SOIL BEARING = 3800 LBS/SQ FT

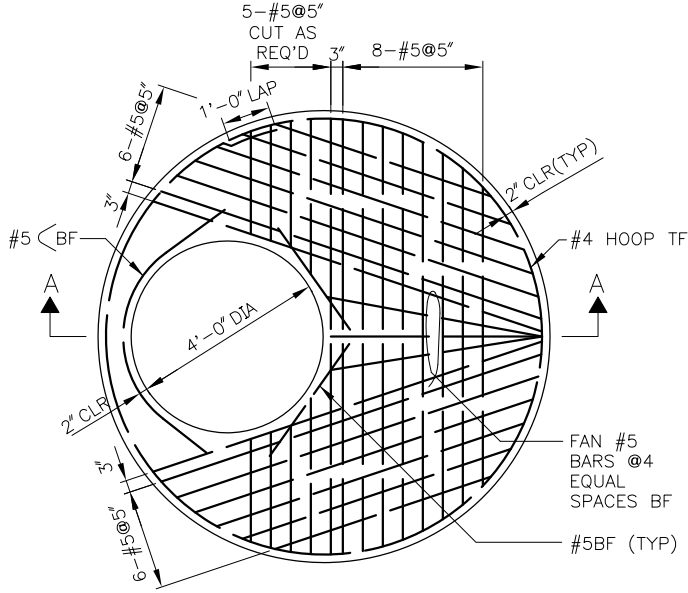

TYPE A MH-TOP SLAB

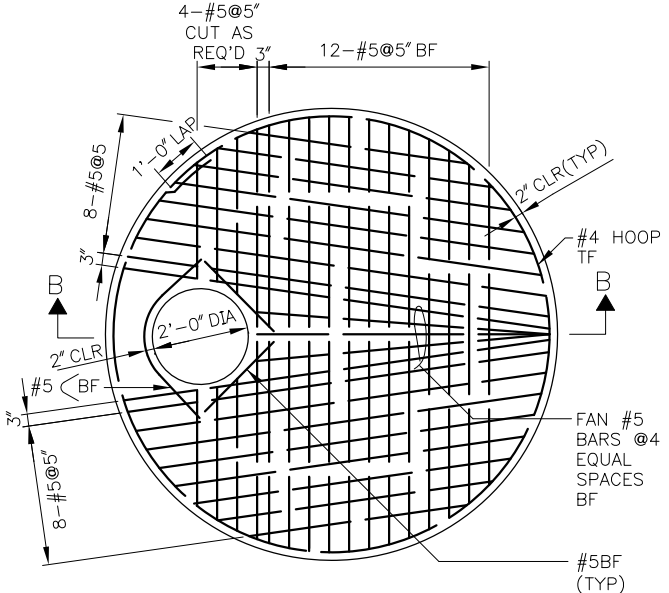

TYPE B MH-TOP SLAB

REF STD SPEC SEC 7-05






NOT TO SCALE

TYPE 204 MANHOLE
TOP & BOTTOM SLABS

STANDARD PLAN NO 205a

REV DATE: 2003

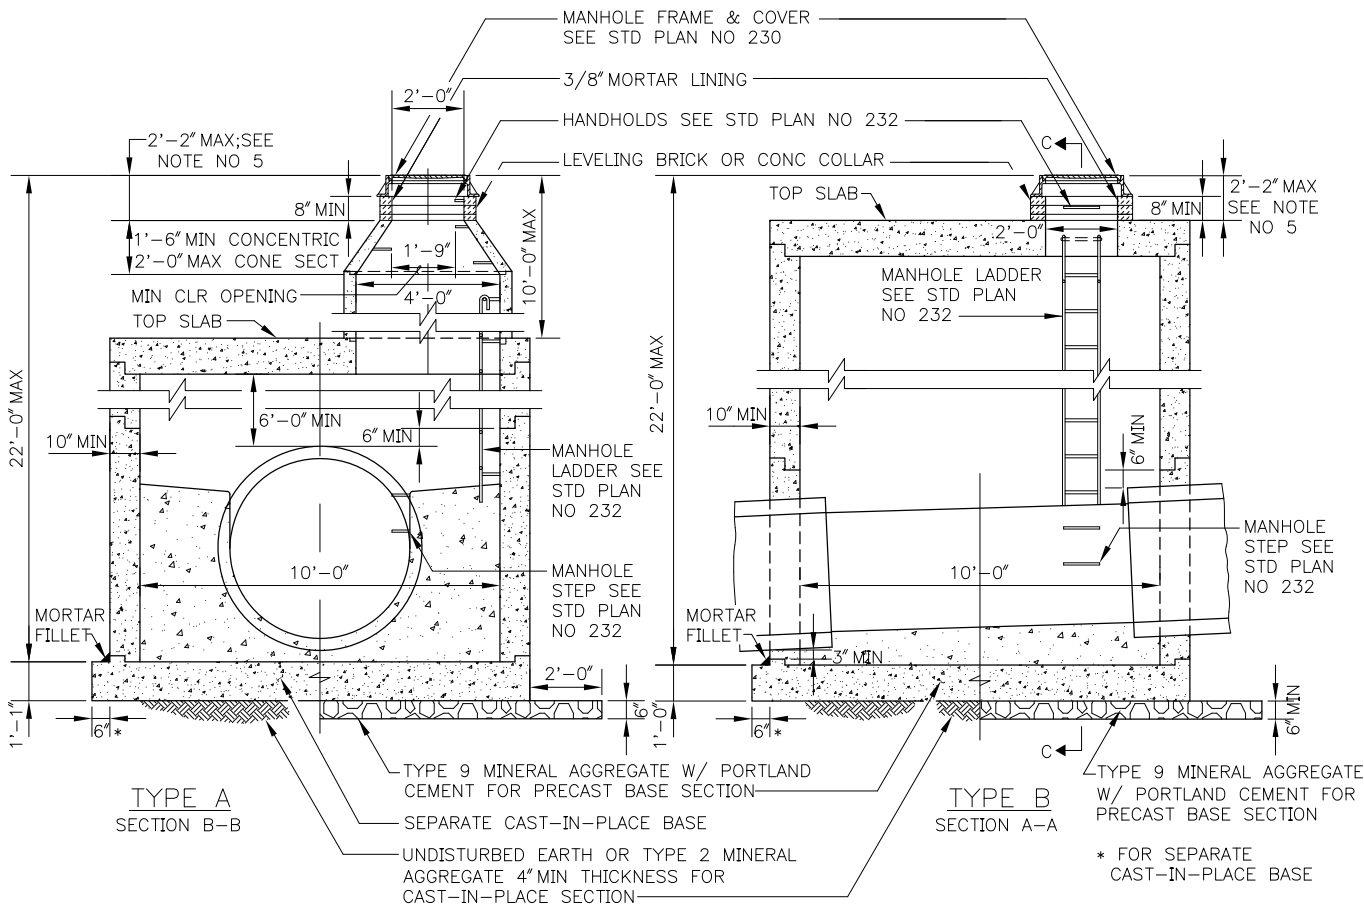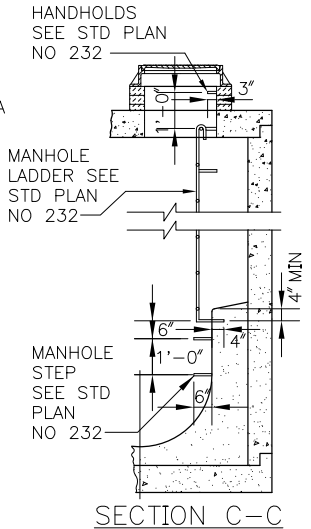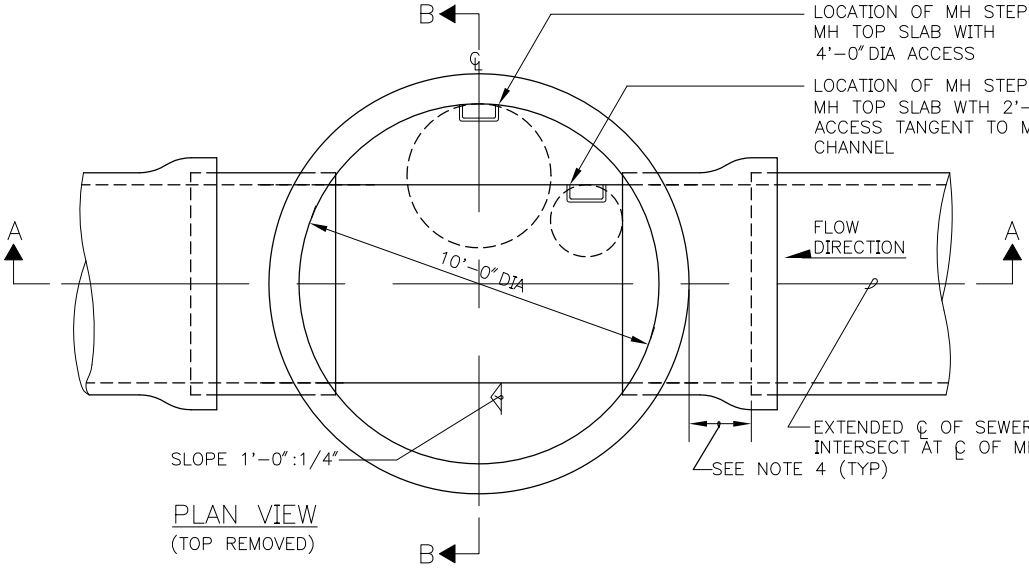

NOTES:

1. TYPE A MH DESIGNATES A MH TOP SLAB WITH A 4'-0" DIA ACCESS.
2. TYPE B MH DESIGNATES A MH TOP SLAB WITH A 2'-0" DIA ACCESS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STD PLAN NO 205b.
4. MAX DIMENSION FROM OUTSIDE MH WALL TO THE FIRST PIPE JOINT. THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0".
5. TOTAL HEIGHT OF FRAME EXTENSIONS, MH FRAME AND COVER, AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
6. MH BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MHS.
7. MAX HOLE SIZE IS EQUAL TO THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MH WALL THICKNESS. MIN DISTANCE BETWEEN HOLES IS 1'-0".




REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

TYPE 205 MANHOLE

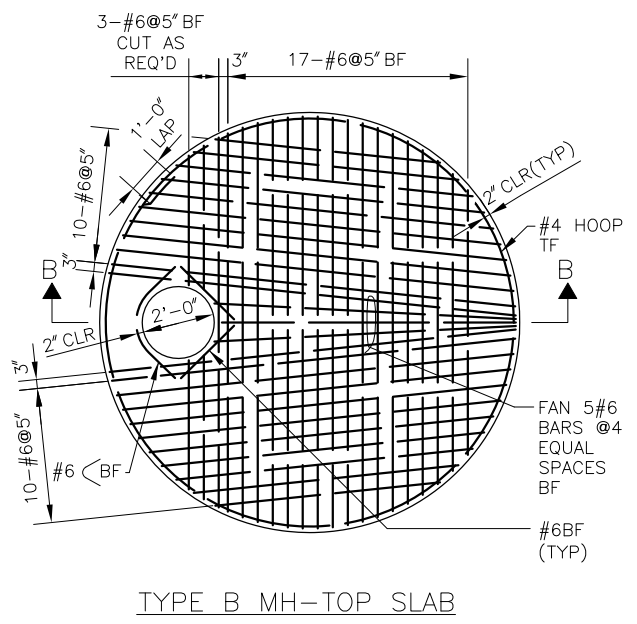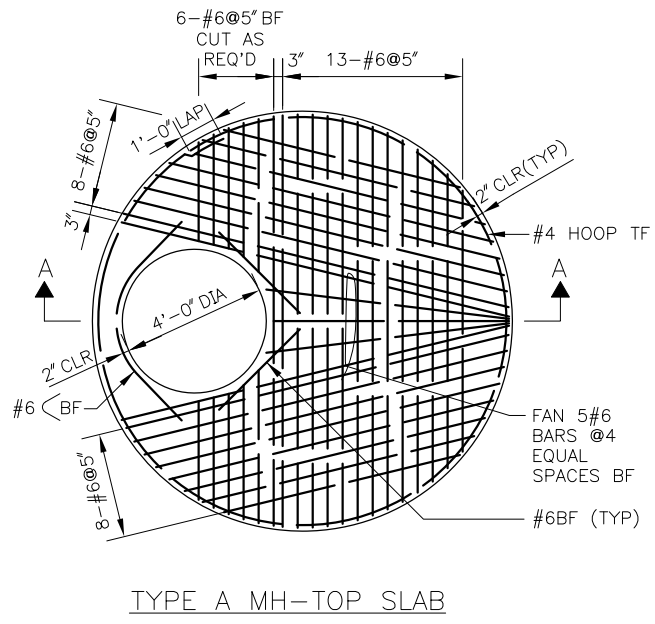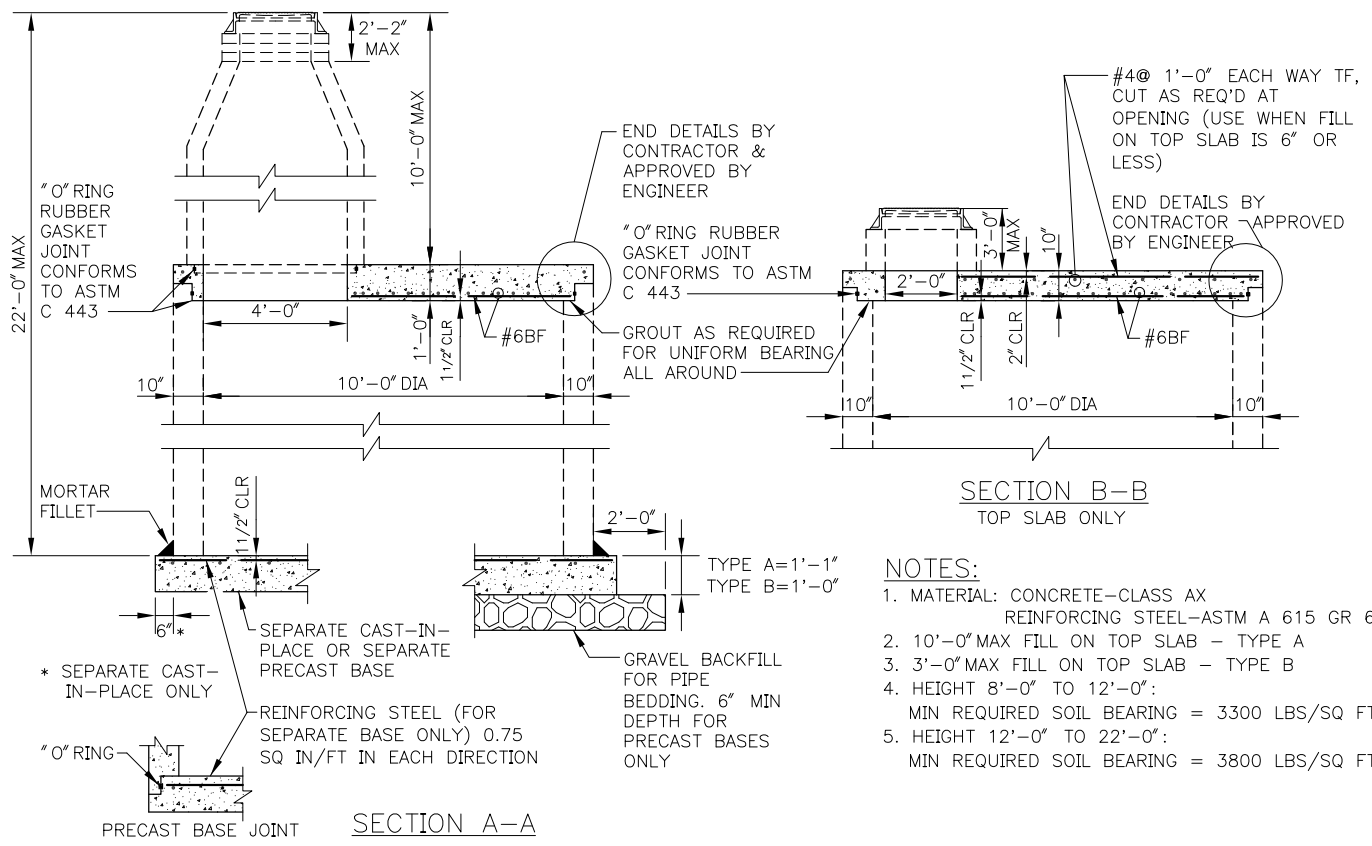

REF STD SPEC SEC 7-05





NOT TO SCALE

TYPE 205 MANHOLE
TOP & BOTTOM SLABS

STANDARD PLAN NO 206a

REV DATE: 2003

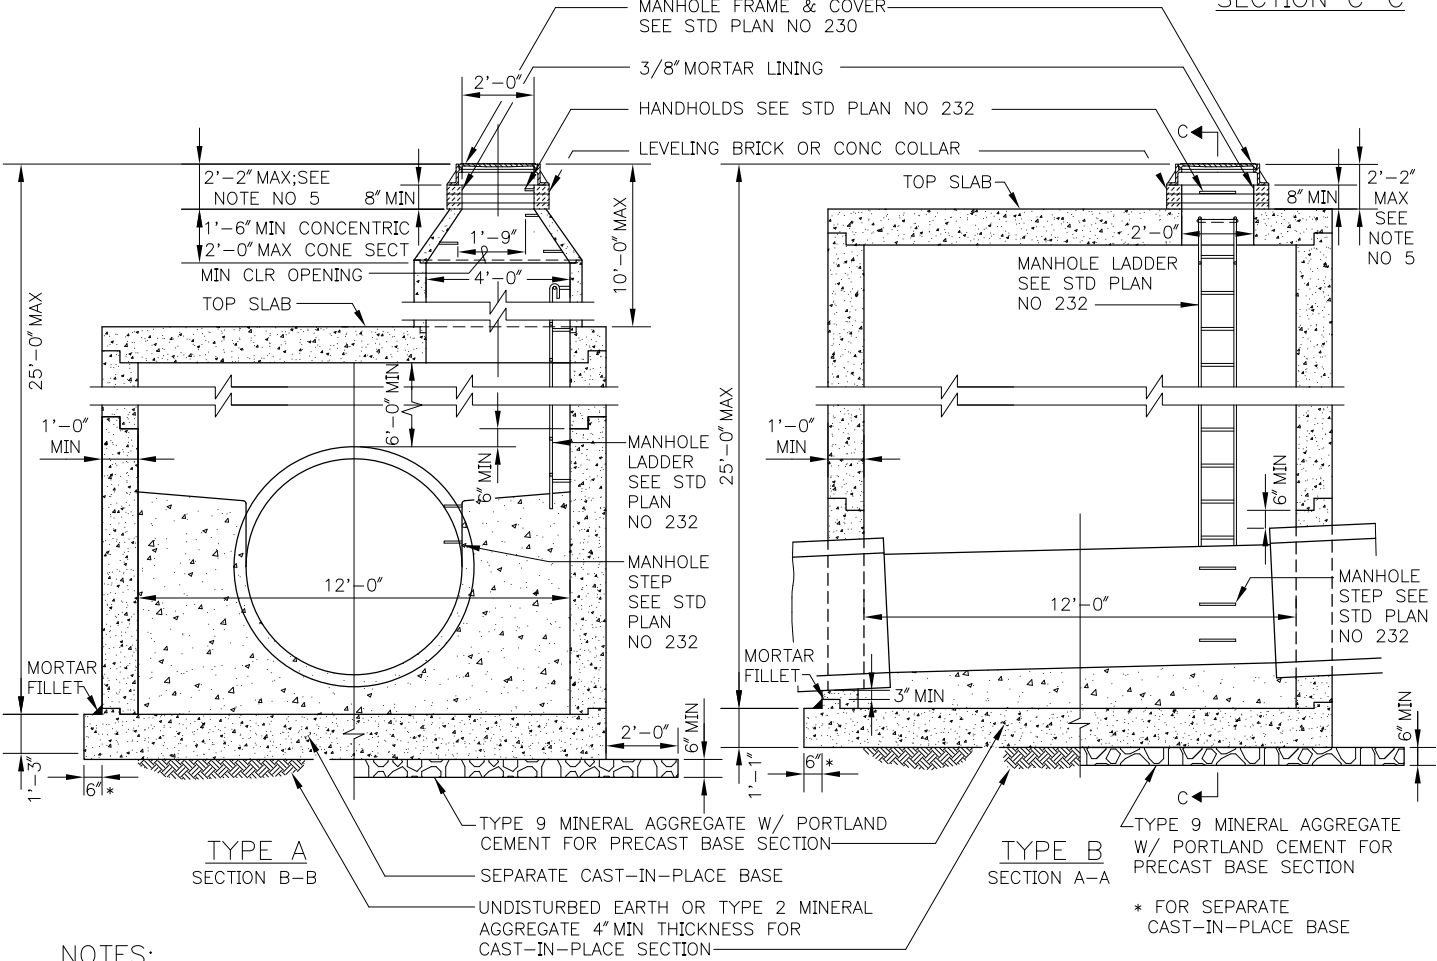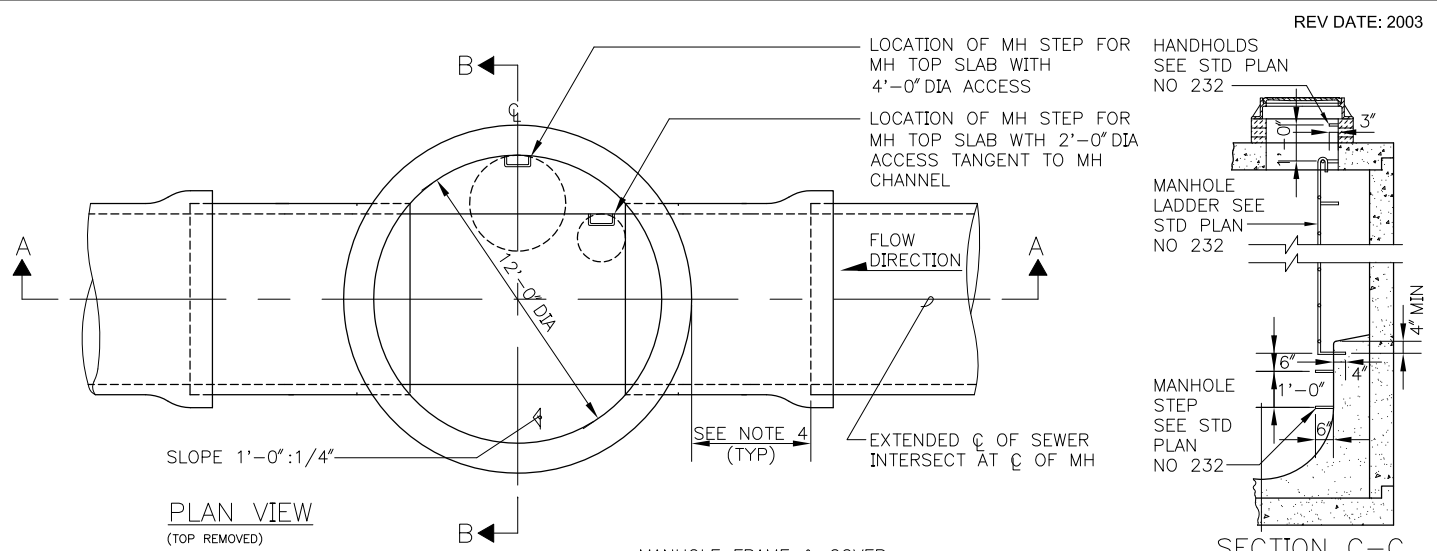


NOTES:

1. TYPE A MH DESIGNATES A MH TOP SLAB WITH A 4'-0" DIA ACCESS.
2. TYPE B MH DESIGNATES A MH TOP SLAB WITH A 2'-0" DIA ACCESS.
3. TOP SLAB AND BASE SECTION DETAILS, SEE STD PLAN NO 206b.
4. MAX DIMENSION FROM OUTSIDE MH WALL TO THE FIRST PIPE JOINT, THE GREATER OF 1/2 INSIDE PIPE DIAMETER OR 1'-0" EXCEPT PVC AND CMP.
5. TOTAL HEIGHT OF FRAME EXTENSIONS, MH FRAME AND COVER, AND LEVELING BRICKS SHALL NOT EXCEED 2'-2".
6. MH BASE SECTIONS SHOWN IN SECTION A-A AND SECTION B-B ARE TYPICAL FOR TYPE A AND TYPE B MHS.
7. MAX HOLE SIZE IS EQUAL TO THE OUTSIDE DIAMETER OF THE PIPE PLUS THE MH WALL THICKNESS. MIN DISTANCE BETWEEN HOLES IS 1'-0".


REF STD SPEC SEC 7-05

STANDARD PLAN NO 206b

REV DATE: 2003

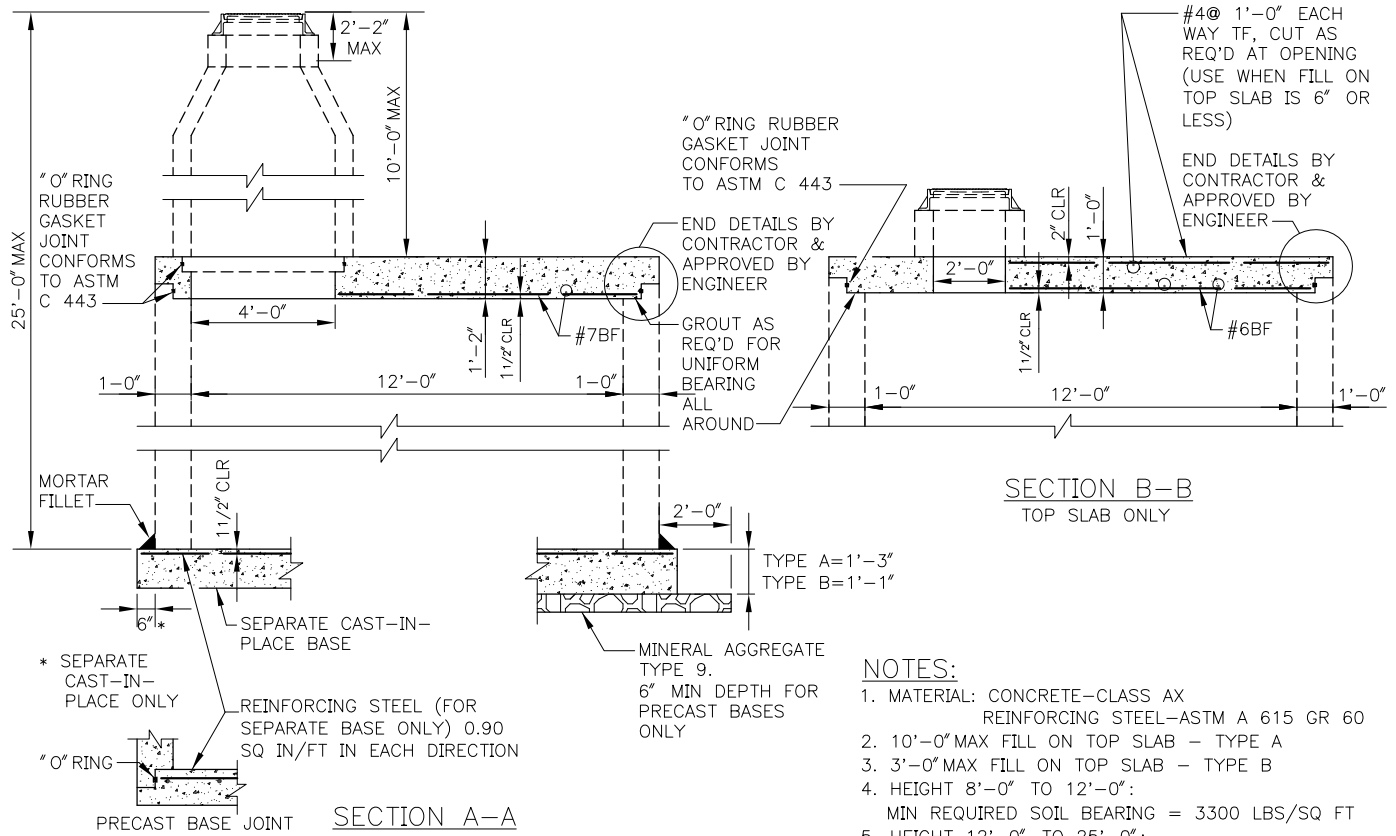

- NOTES:**
1. MATERIAL: CONCRETE—CLASS AX
REINFORCING STEEL—ASTM A 615 GR 60
 2. 10'-0" MAX FILL ON TOP SLAB — TYPE A
 3. 3'-0" MAX FILL ON TOP SLAB — TYPE B
 4. HEIGHT 8'-0" TO 12'-0":
MIN REQUIRED SOIL BEARING = 3300 LBS/SQ FT
 5. HEIGHT 12'-0" TO 25'-0":
MIN REQUIRED SOIL BEARING = 3800 LBS/SQ FT

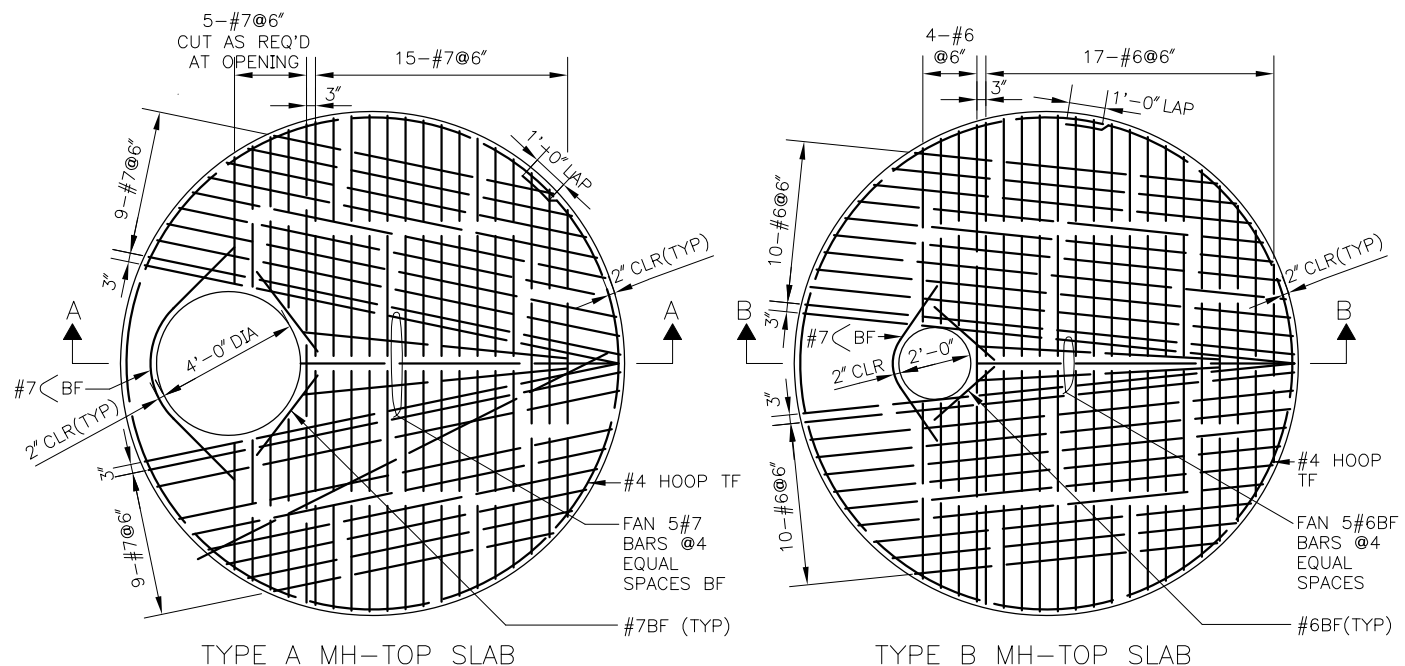


REF STD SPEC SEC 7-05




NOT TO SCALE

TYPE 206 MANHOLE
TOP & BOTTOM SLABS

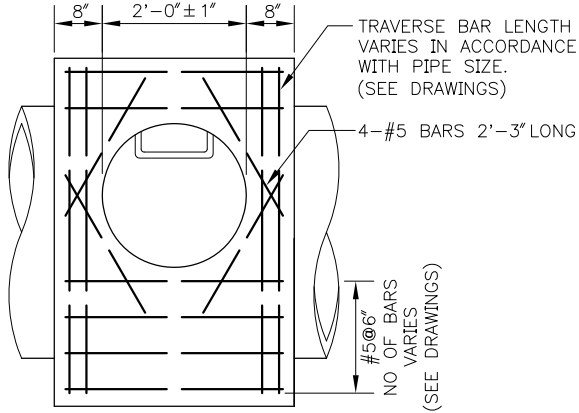


SECTION B-B

NOTE:
 REINFORCING STEEL SHALL BE DEFORMED BARS CONFORMING TO ASTM A 615 GR 60 AND SHALL HAVE A MIN COVER OF 2"

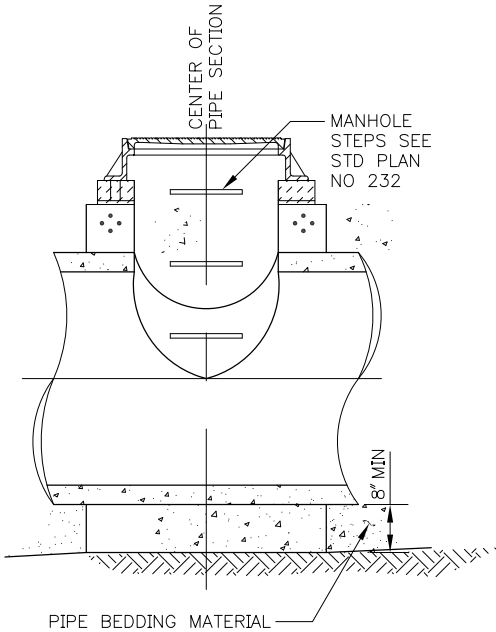

SECTION A-A

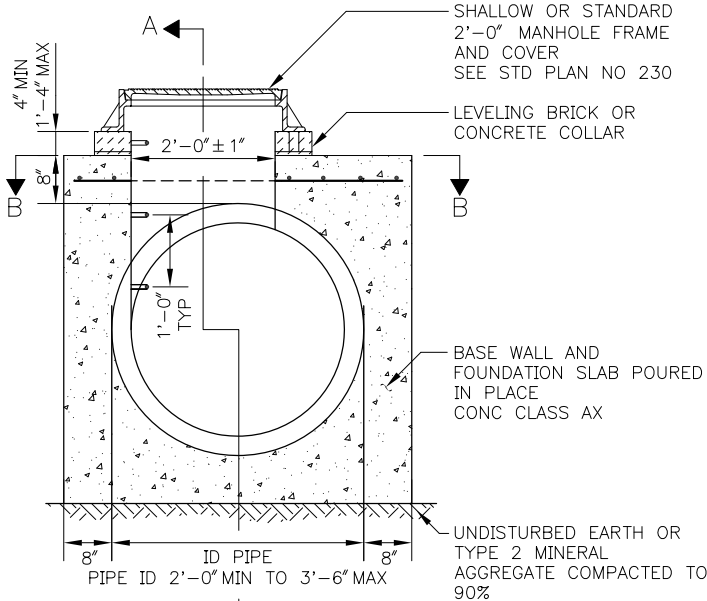

SECTION THRU Q


REF STD SPEC SEC 7-05



City of Seattle

NOT TO SCALE

TYPE 207 MANHOLE

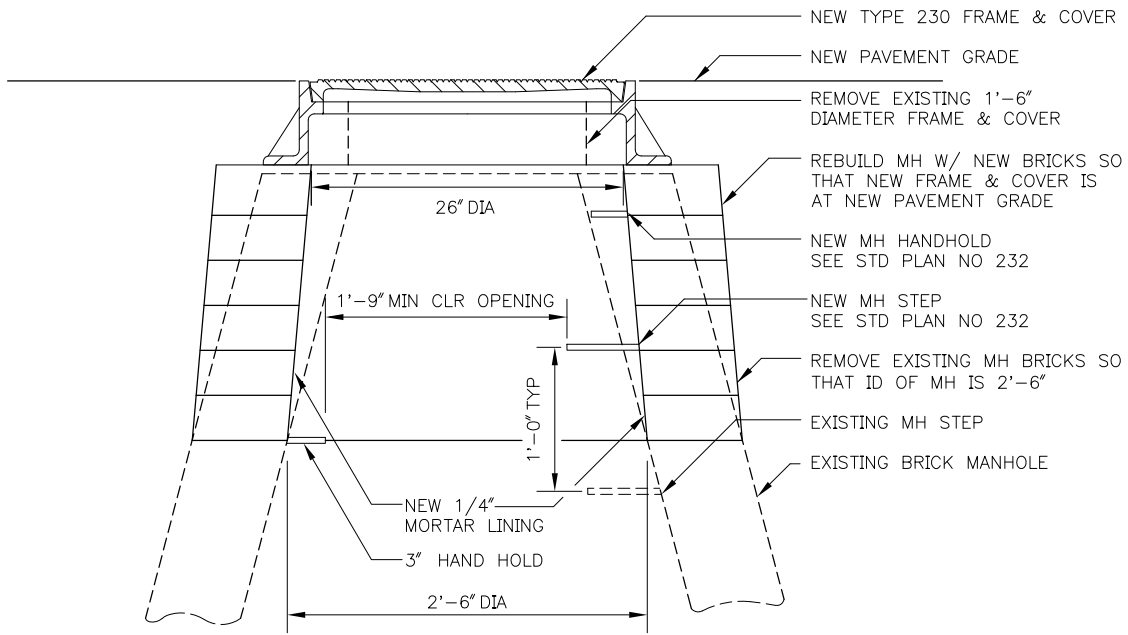

NOTES:



1. NEW MANHOLE STEPS AND HANDHOLDS SHALL BE INSTALLED AND LOCATED 1'-0" OC FROM THE FIRST EXISTING STEP IN THE MANHOLE AND SHALL MATCH THE EXISTING TYPE OF STEP. ANY SUBSTITUTIONS SHALL BE APPROVED BY THE ENGINEER. A MINIMUM 1'-9" CLEAR OPENING SHALL BE MAINTAINED.
2. FOR 7" RIGID PAVEMENT, THE RING AND COVER SHALL BE CONSTRUCTED TO THE FINISHED GRADE OF THE PAVEMENT. REINFORCEMENT SHALL BE PLACED AROUND THE CASTING AT MID-POINT BETWEEN THE FINISH GRADE OF THE RIGID PAVEMENT AND THE TOP OF THE FLANGE. #4 REINFORCING BARS SHALL BE USED IN THE CONFIGURATION OF 2 SEPARATE SQUARES OFF-ROTATED 45 DEGREES FROM EACH OTHER AND GIVING A MINIMUM CLEARANCE OF 2" AT THE SHORTEST DISTANCE WITH THE FRAME.
3. FOR PAVEMENT DEPTH GREATER THAN 7", USE FRAME EXTENSION(S) AS SHOWN IN STANDARD PLAN NO 231 TO BRING THE COVER UP TO THE LEVEL OF THE FINISHED PAVEMENT WITHOUT EMBEDDING BOTTOM FLANGE OF THE CASTING IN THE PAVEMENT.

REF STD SPEC SEC 7-05



NOT TO SCALE

REBUILD EXISTING
BRICK MANHOLE

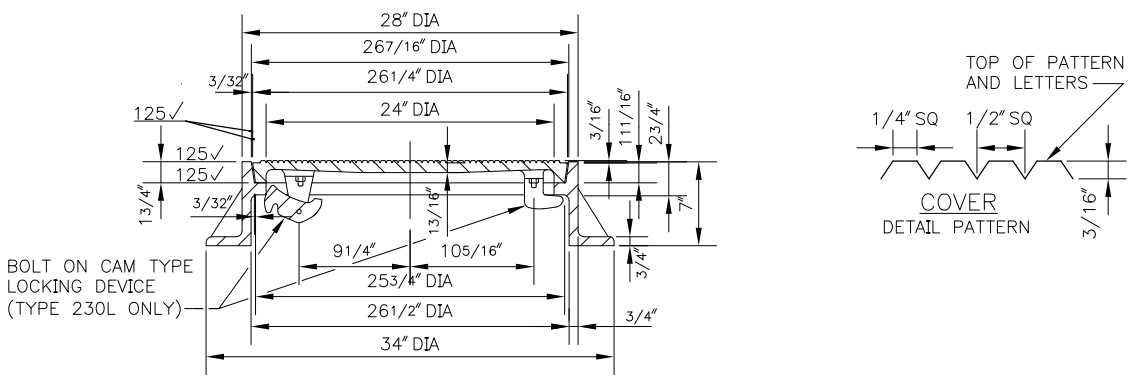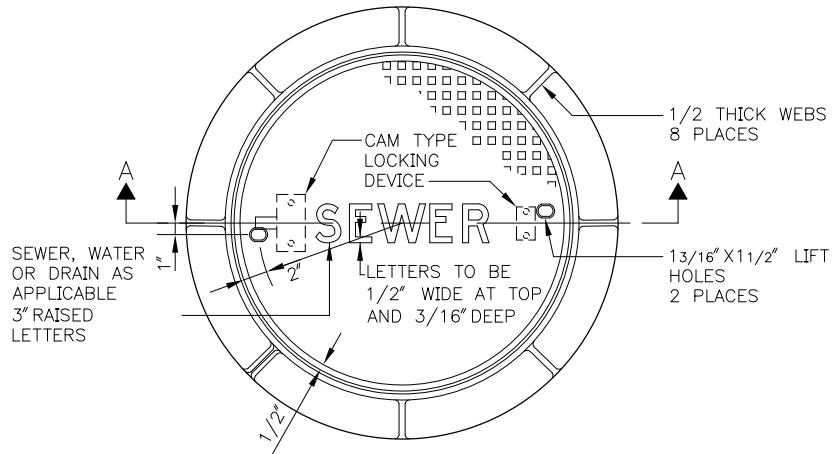


- NOTES:**
1. DESIGNATE LOCKING COVER AS TYPE 230L
 2. FOR 7" RIGID PAVEMENT, THE FRAME AND COVER SHALL BE CONSTRUCTED TO THE FINISHED GRADE OF THE PAVEMENT. REINFORCEMENT SHALL BE PLACED AROUND THE CASTING AT MID-POINT BETWEEN THE FINISHED GRADE OF THE PAVEMENT AND THE TOP OF THE FLANGE. #4 REINFORCING BARS SHALL BE USED IN THE CONFIGURATION OF 2 SEPARATE SQUARES OFF-ROTATED 45 DEGREES FROM EACH OTHER AND GIVING A CLEARANCE OF 2 INCHES AT THE SHORTEST DISTANCE WITH THE FRAME
 3. FOR RIGID PAVEMENT DEPTH GREATER THAN 7", USE FRAME EXTENSION(S) (STANDARD PLAN NO 231) TO BRING THE COVER UP TO THE LEVEL OF THE FINISHED PAVEMENT WITHOUT EMBEDDING THE BOTTOM FLANGE OF THE CASTING IN THE PAVEMENT
 4. COVER THICKNESS IS MEASURED FROM THE BOTTOM OF THE PATTERN
 5. REFER TO SECTION 5-05 FOR OTHER REQUIREMENTS FOR REINFORCING BARS
 6. FRAMES SHALL BE MANUFACTURED FROM CAST IRON OR DUCTILE IRON
 7. COVERS SHALL BE MANUFACTURED FROM DUCTILE IRON

REF STD SPEC SEC 7-05



NOT TO SCALE

2'-0" DIAMETER
FRAME & COVER

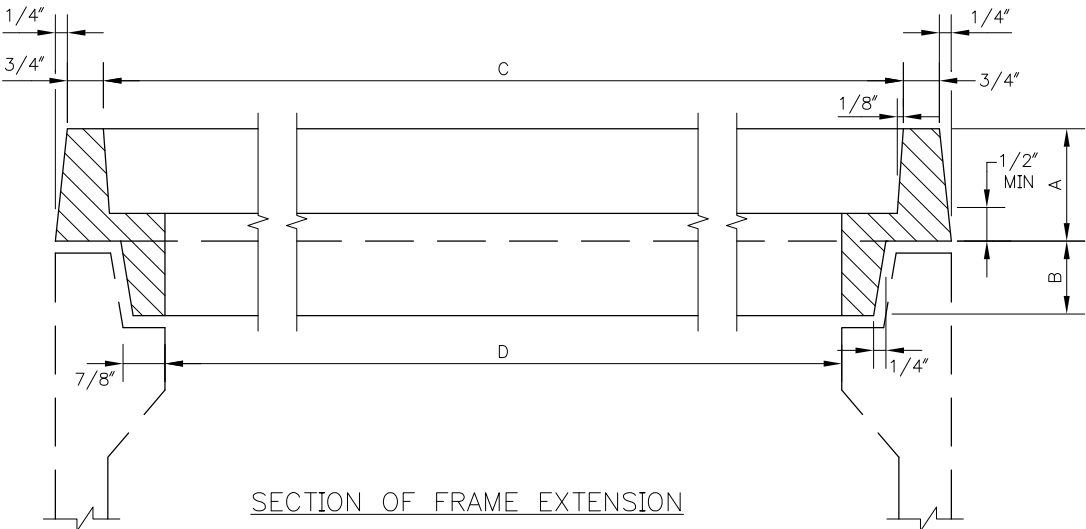

SECTION OF FRAME EXTENSION

- NOTES:
1. DIMENSION "A" REFERS TO HEIGHT OF FRAME EXTENSION ABOVE MANHOLE FRAME
 2. DIMENSIONS "B", "C" AND "D" SHALL MATCH THE MANHOLE FRAME AND COVER THAT THE FRAME EXTENSION TO BE USED ON
 3. WHEN FRAME EXTENSIONS ARE USED ON A NEW MANHOLE FRAME AND COVER, THE FRAME EXTENSION SHALL BE PERMANENTLY ATTACHED TO THE MANHOLE FRAME AT THE FACTORY, NOT IN THE FIELD. APPROVAL OF ATTACHMENT METHOD IS REQUIRED
 4. FRAME EXTENSIONS SHALL BE DUCTILE OR CAST IRON





REF STD SPEC SEC 7-20




City of Seattle

NOT TO SCALE

FRAME EXTENSIONS

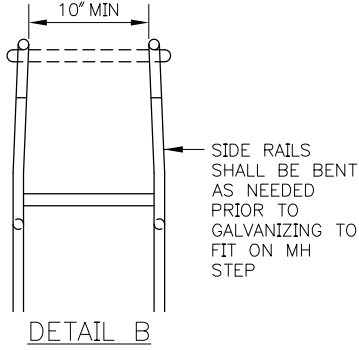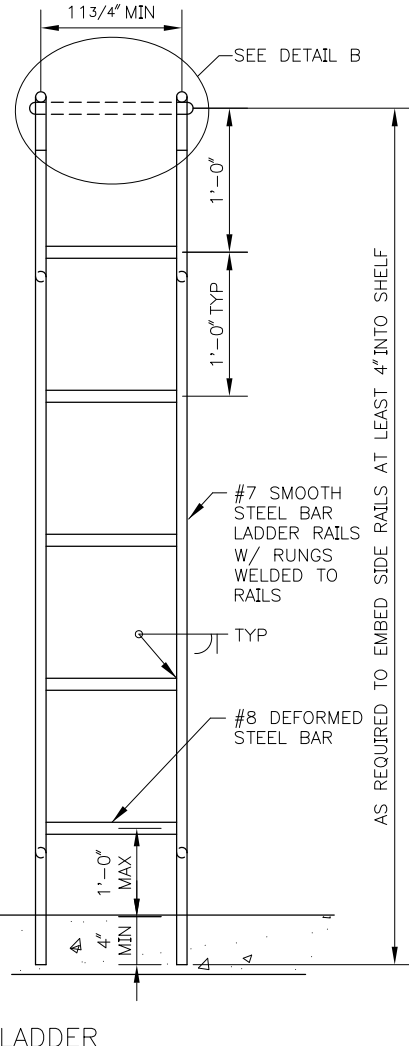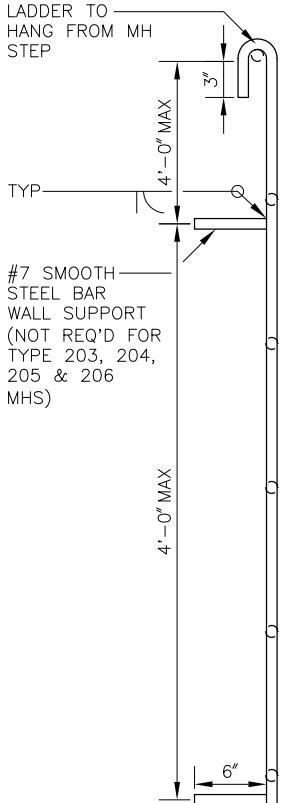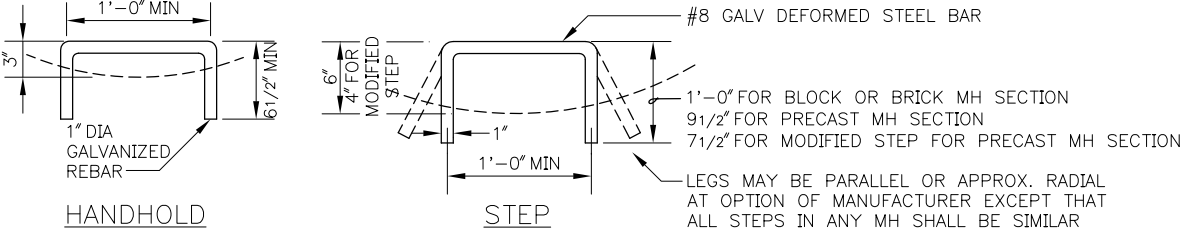

- NOTE:**
1. DIMENSIONS FOR THE MH LADDER AND STEP ARE MINIMUM REQUIREMENTS ONLY. THE LADDER SHOWN WILL NOT MEET THE 10" MIN CLEARANCE IN DETAIL B WHEN INSTALLED ON THE STEP SHOWN ABOVE.
 2. NON-COATED STEPS AND PREFABRICATED LADDER SHALL BE GALVANIZED AFTER FABRICATION
 3. STEPS AND HANDHOLDS SHALL BE INSTALLED AT 1'-0" SPACING. WHEN THE DISTANCE FROM THE LAST (HIGHEST) STEP OR HANDHOLD TO THE TOP OF THE MH FRAME EXCEEDS 1'-0" AND ANOTHER STEP OR HANDHOLD CANNOT BE INSTALLED BECAUSE OF THE LOCATION OF THE MH FRAME, A HANDHOLD SHALL BE INSTALLED BETWEEN THE TOP 2 LAYERS OF BRICK.

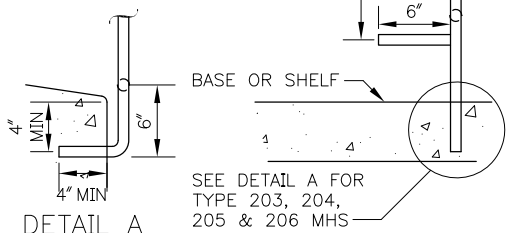


REF STD SPEC SEC 7-05



NOT TO SCALE

MANHOLE LADDER
STEP AND HANDHOLD

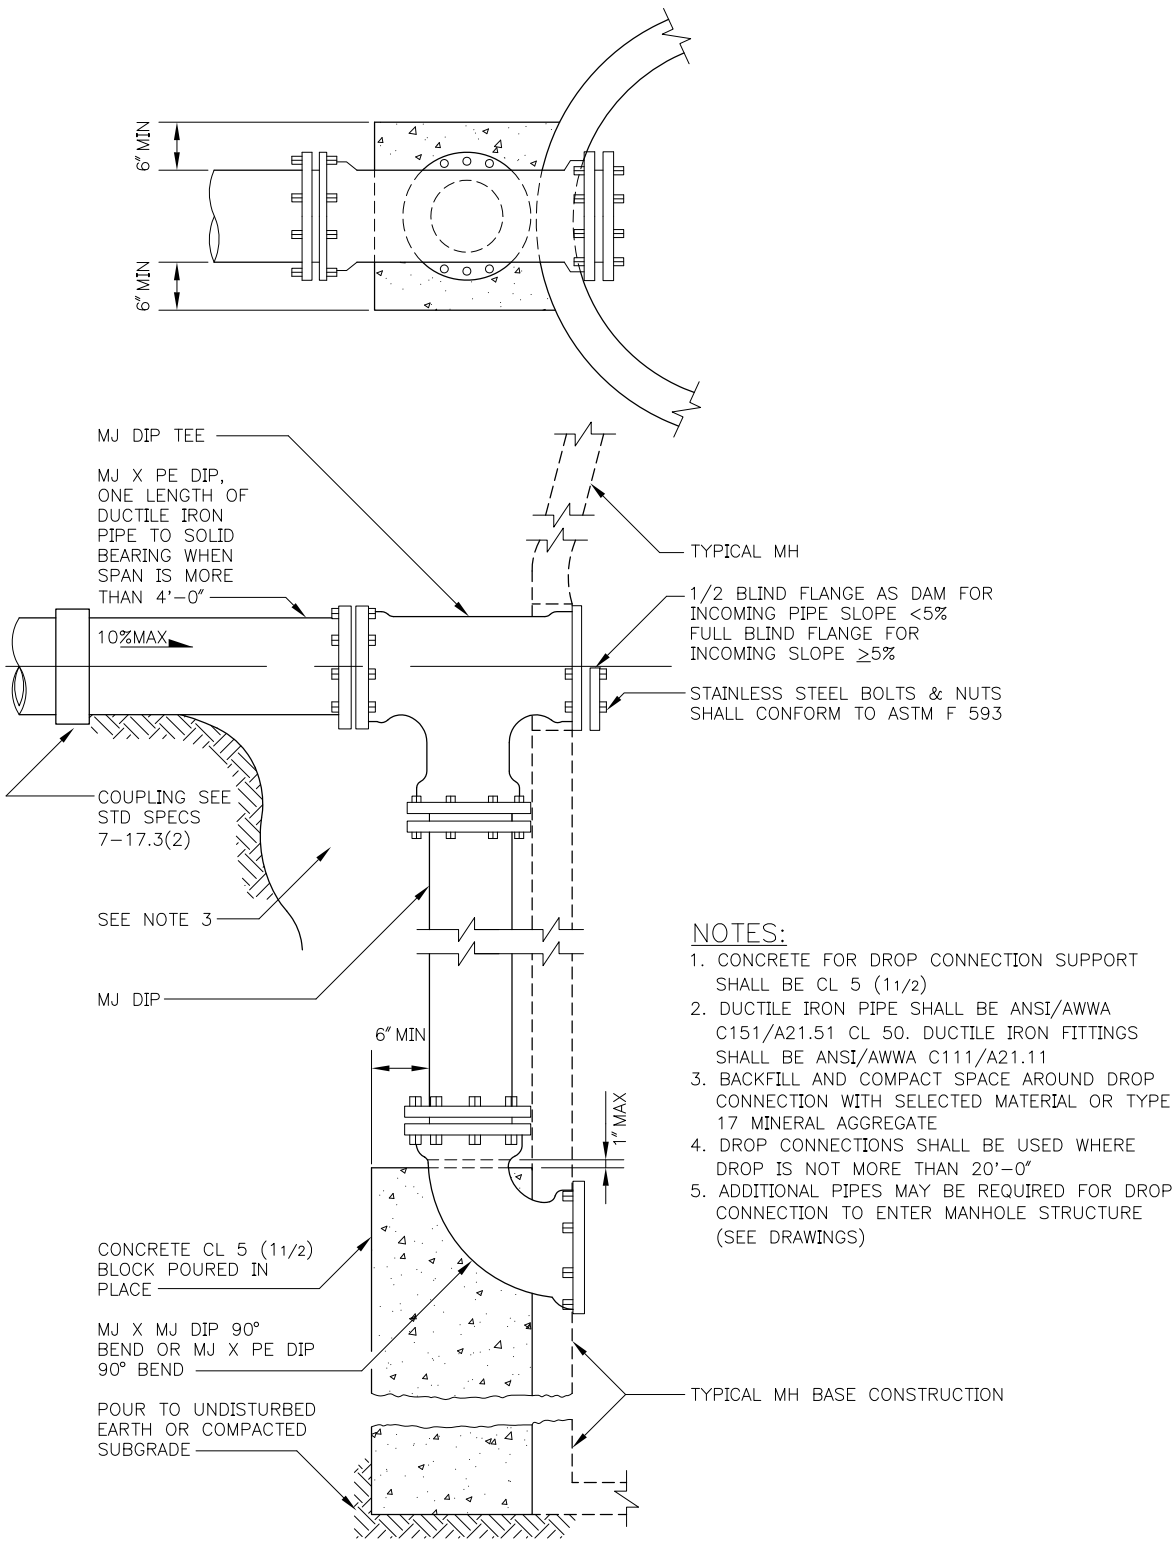

- NOTES:**
1. CONCRETE FOR DROP CONNECTION SUPPORT SHALL BE CL 5 (1 1/2)
 2. DUCTILE IRON PIPE SHALL BE ANSI/AWWA C151/A21.51 CL 50. DUCTILE IRON FITTINGS SHALL BE ANSI/AWWA C111/A21.11
 3. BACKFILL AND COMPACT SPACE AROUND DROP CONNECTION WITH SELECTED MATERIAL OR TYPE 17 MINERAL AGGREGATE
 4. DROP CONNECTIONS SHALL BE USED WHERE DROP IS NOT MORE THAN 20'-0"
 5. ADDITIONAL PIPES MAY BE REQUIRED FOR DROP CONNECTION TO ENTER MANHOLE STRUCTURE (SEE DRAWINGS)

DUCTILE IRON OUTSIDE DROP CONNECTION

REF STD SPEC SEC 7-08




City of Seattle

NOT TO SCALE

OUTSIDE DROP CONNECTION

STANDARD PLAN NO 234

REV DATE: 2003

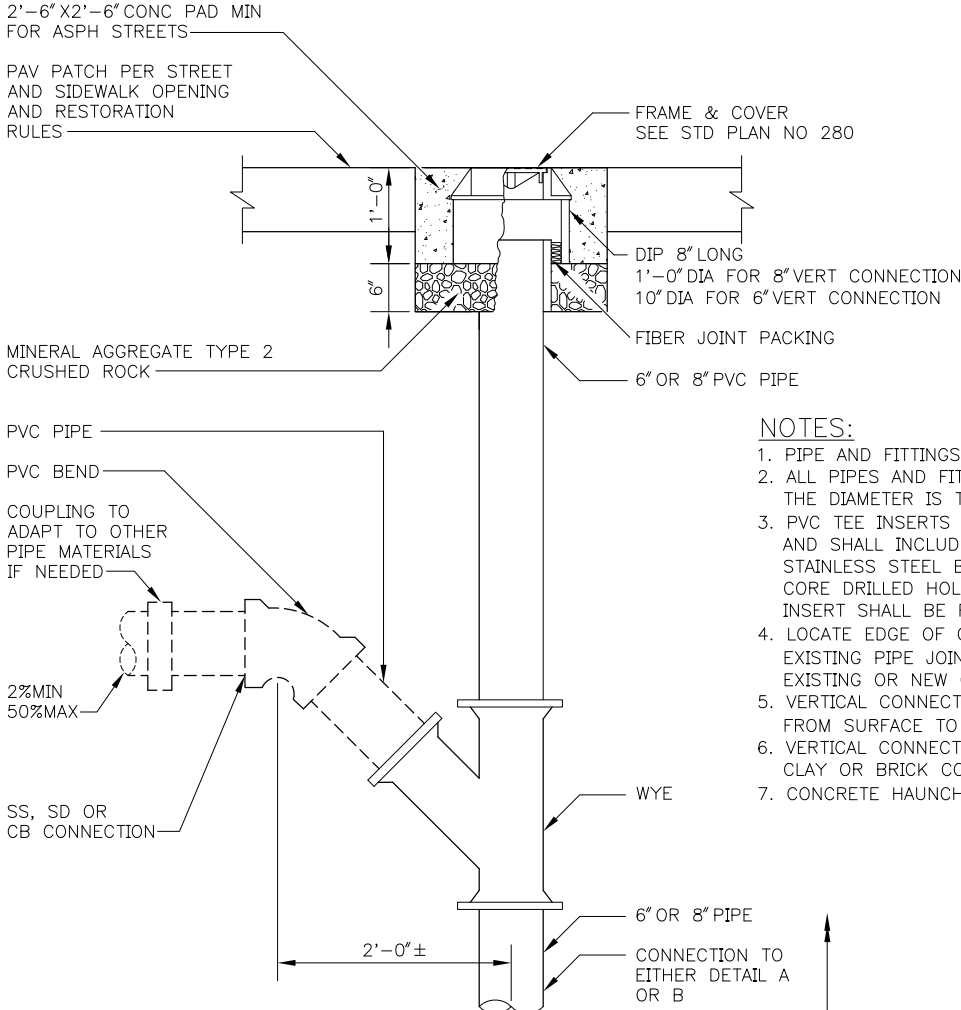

NOTES:

1. PIPE AND FITTINGS SHALL BE PVC PER ASTM D 3034 SDR 35
2. ALL PIPES AND FITTINGS ARE TO BE THE SAME DIAMETER. THE DIAMETER IS TO BE SPECIFIED ON THE PLANS
3. PVC TEE INSERTS SHALL BE BY "INSERT A TEE" OR EQUAL AND SHALL INCLUDE RUBBER SLEEVE, PVC ADAPTER HUB AND STAINLESS STEEL BAND. INSERT SHALL BE INSTALLED IN A CORE DRILLED HOLE PER MANUFACTURER'S INSTRUCTIONS. INSERT SHALL BE FLUSH WITH THE INSIDE WALL OF THE MAIN.
4. LOCATE EDGE OF CORE DRILLED HOLE 1'-0" MINIMUM FROM EXISTING PIPE JOINT AND 2'-0" FROM THE EDGE OF ANY EXISTING OR NEW CONNECTIONS
5. VERTICAL CONNECTION SHALL NOT BE USED UNLESS DEPTH FROM SURFACE TO TOP OF PIPE IS 20'-0" OR GREATER
6. VERTICAL CONNECTIONS ON MAINS OTHER THAN CONCRETE, CLAY OR BRICK CONSTRUCTION SHALL BE PER DRAWINGS
7. CONCRETE HAUNCHING IS TO BE CLASS 5 (1 1/2) CONCRETE

2'-6" X 2'-6" CONC PAD MIN FOR ASPH STREETS

PAV PATCH PER STREET AND SIDEWALK OPENING AND RESTORATION RULES

MINERAL AGGREGATE TYPE 2 CRUSHED ROCK


PVC PIPE

PVC BEND


COUPLING TO ADAPT TO OTHER PIPE MATERIALS IF NEEDED

2%MIN 50%MAX

SS, SD OR CB CONNECTION

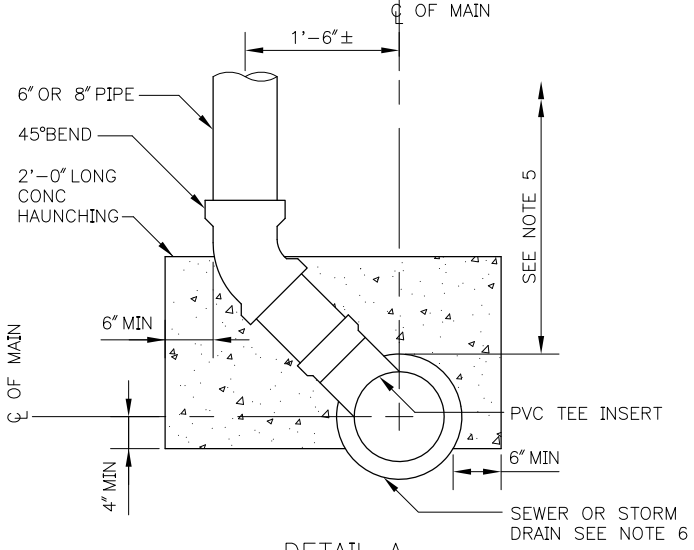

DETAIL A
FOR MAIN 3'-0" DIA OR SMALLER

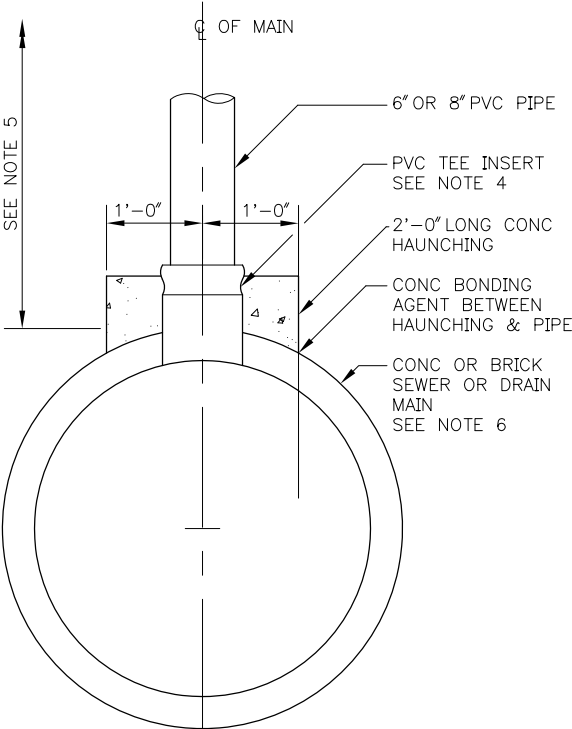

DETAIL B
FOR MAIN 3'-6" DIA OR LARGER

REF STD SPEC SEC 7-08 & 7-17




City of Seattle

NOT TO SCALE

6" OR 8" VERTICAL CONNECTION


STANDARD PLAN NO 240

REV DATE: 2003

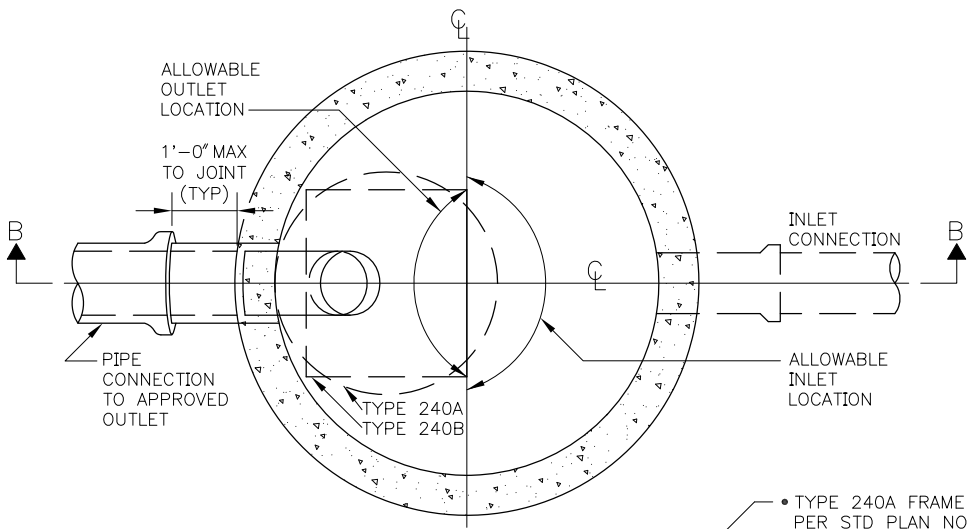

SECTION A-A

- TYPE 240A FRAME & COVER PER STD PLAN NO 230
- TYPE 240B FRAME & GRATE PER STD PLAN NO 264
- TYPE 240C FRAME PER STD PLAN NO 262 AND GRATE PER STD PLAN NO 265
- TYPE 240D FRAME PER STD PLAN NO 263 AND GRATE PER STD PLAN NO 265

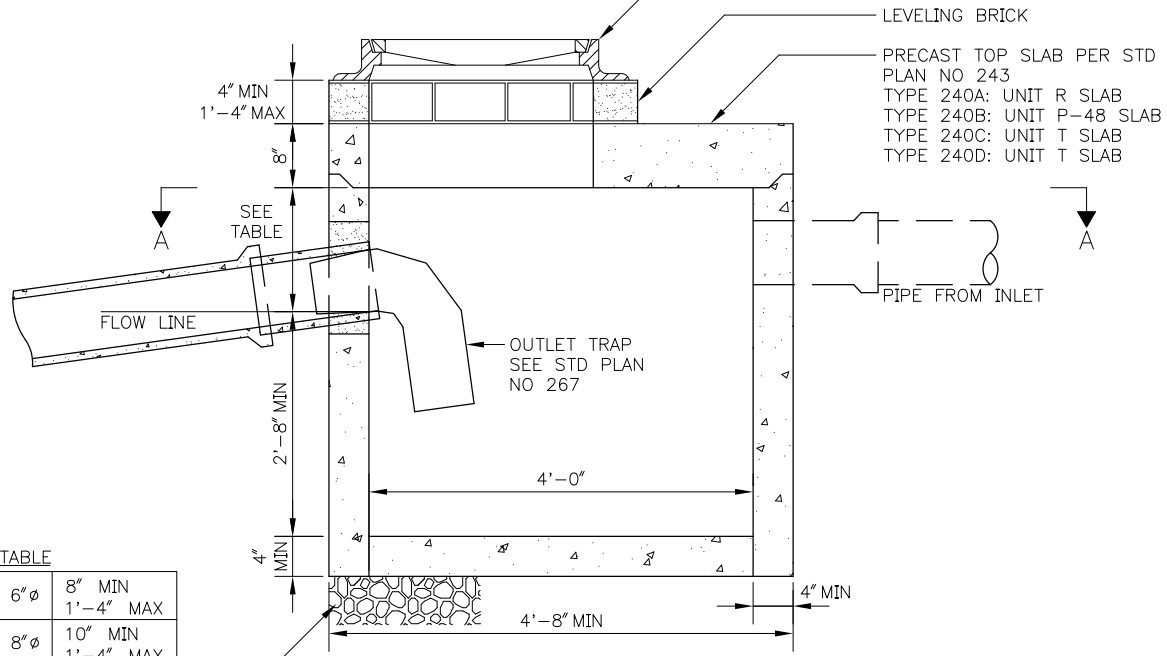

- LEVELING BRICK
- PRECAST TOP SLAB PER STD PLAN NO 243
- TYPE 240A: UNIT R SLAB
- TYPE 240B: UNIT P-48 SLAB
- TYPE 240C: UNIT T SLAB
- TYPE 240D: UNIT T SLAB

TABLE

6" ϕ	8" MIN 1'-4" MAX
8" ϕ	10" MIN 1'-4" MAX
12" ϕ	1'-3" MIN 2'-0" MAX

SECTION B-B

- NOTES:**
1. FRAME & GRATE OR FRAME & COVER SHALL BE LOCATED OVER TRAP
 2. INVERT OF INLET PIPE SHALL BE 2" MIN ABOVE INVERT OF OUTLET PIPE
 3. FRAME AND GRATE SHALL BE LOCATED OVER OUTLET TRAP

REF STD SPEC SEC 7-05




NOT TO SCALE


TYPE 240 CATCH BASIN

STANDARD PLAN NO 241a


REV DATE: 2003

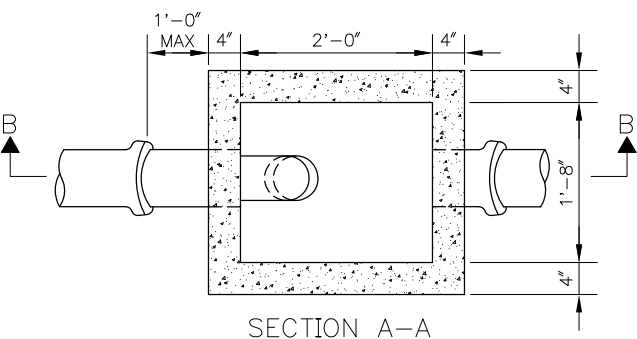


SECTION A-A

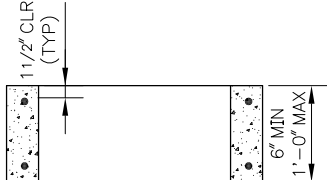

SECTION D-D

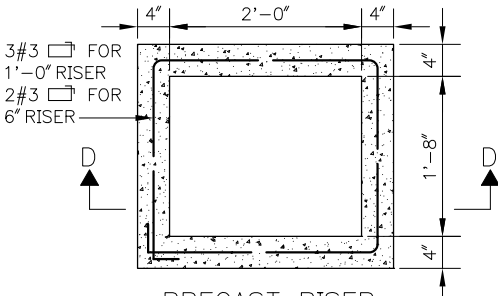


PRECAST RISER REINFORCING

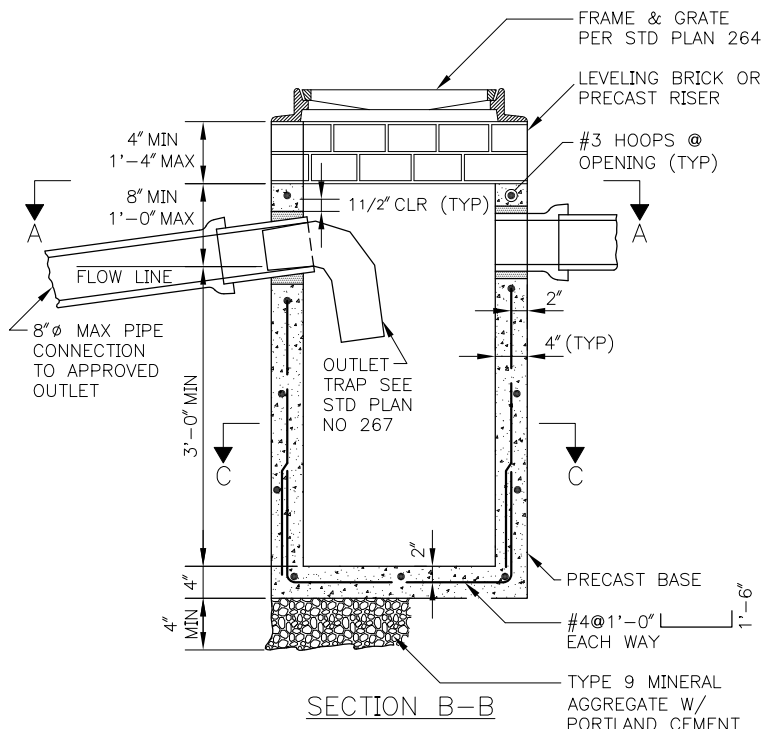

SECTION B-B

NOTES:

1. THIS CATCH BASIN IS FOR INSTALLATIONS IN ALLEYS AND UNPAVED AREAS IN THE RIGHT-OF-WAY. ANY OTHER USE IN THE R/W WILL REQUIRE APPROVAL OF SPU
2. FOR CURB DISCHARGE INSTALLATION SEE STD PLAN NO 241b
3. INSTALL PER STD PLAN NO 261
4. MATERIAL: CONCRETE CLASS AX REINFORCING STEEL ASTM A615 GR60
5. INLET INVERT EL. TO BE HIGHER THAN OUTLET INVERT EL.

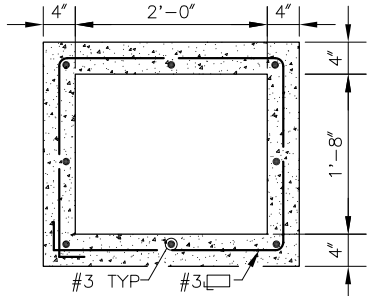

SECTION C-C


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 241 CATCH BASIN

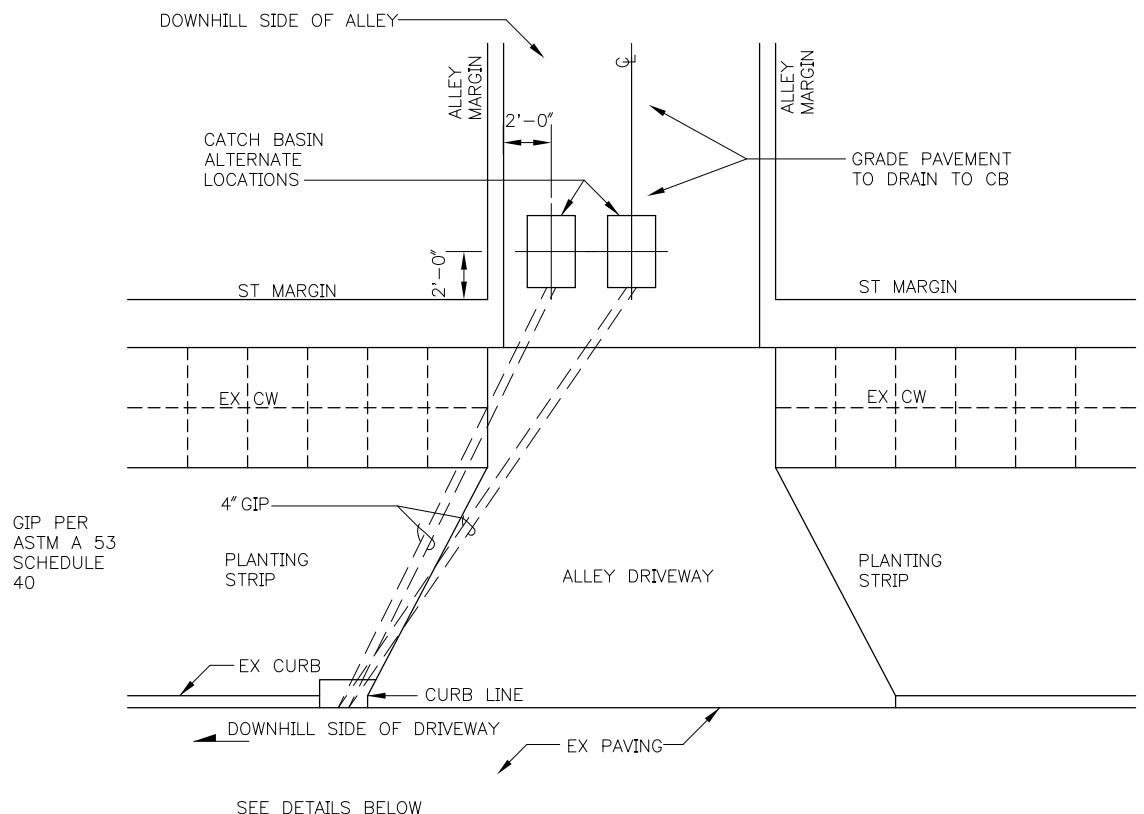


PLAN

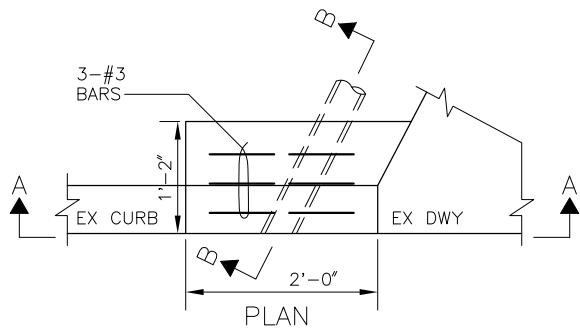

PLAN

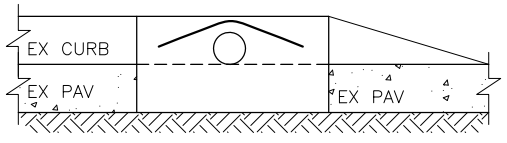

SECTION A-A

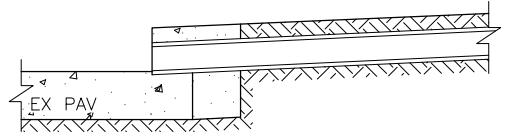

SECTION B-B

REF STD SPEC SEC 7-05 & 7-08




NOT TO SCALE


TYPE 241 CATCH BASIN INSTALLATIONS

STANDARD PLAN NO 242


REV DATE: 2003

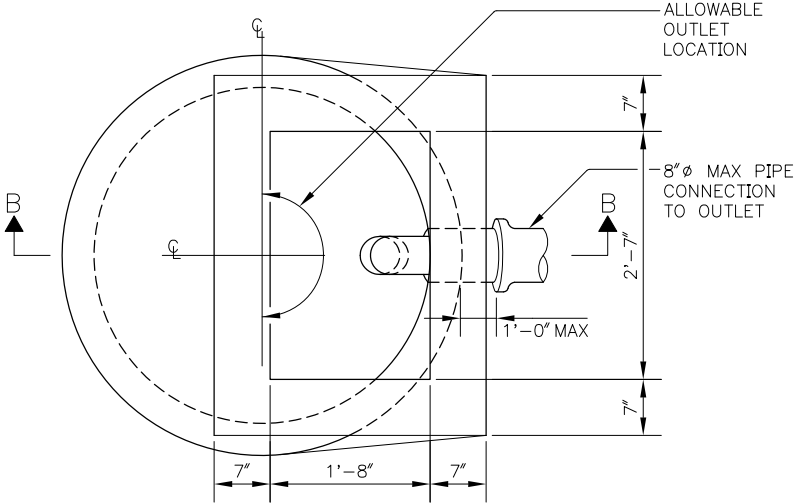

SECTION A-A

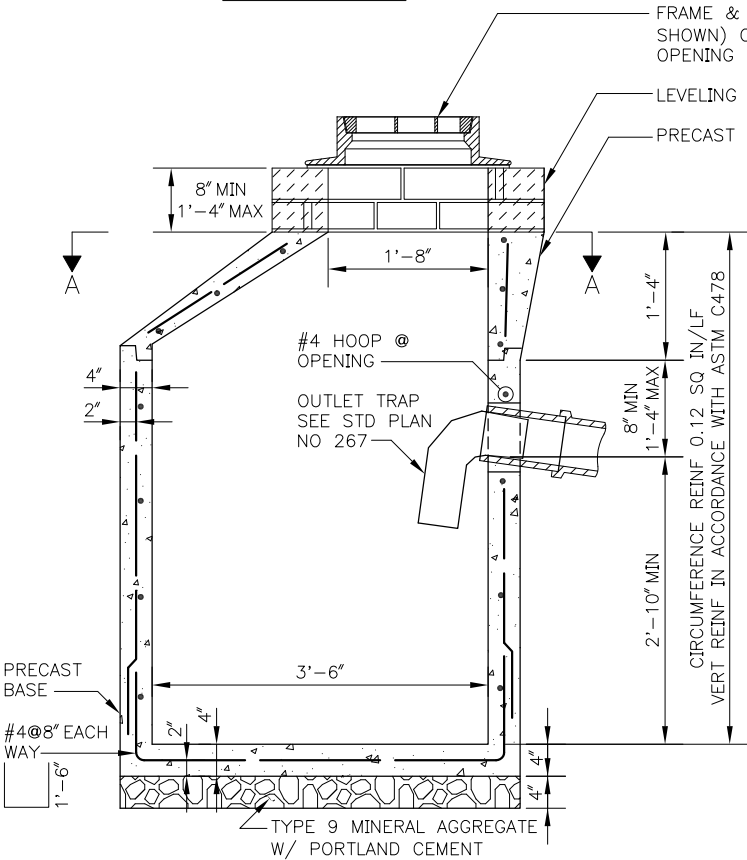

TYPE A SECTION B-B

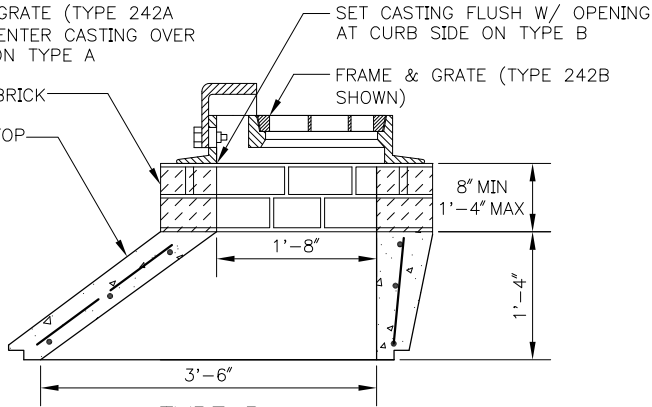

TYPE B

CB TYPE	CASTING	
	FRAME	GRATE
A OR A.1	NO 262	NO 265
B OR B.1	NO 263	NO 265

- NOTES:**
- MATERIAL: CONCRETE: CLASS AX
REINFORCING STEEL: ASTM A 615 GR 60
 - INSTALL & LOCATE PER STD PLANS NOS 260 & 261
 - A.1 OR B.1 CAN ONLY BE USED WHEN SPECIFIED ON CONTRACT PLANS
 - FOR TYPE 242A.1 OR B.1 ROTATE CATCH BASIN 180° FROM STANDARD. SEE STD PLAN NO 260
 - OUTLET TRAP TO BE LOCATED DIRECTLY BELOW FRAME AND GRATE

REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

TYPE 242 CATCH BASIN

STANDARD PLAN NO 243a

REV DATE: 2003

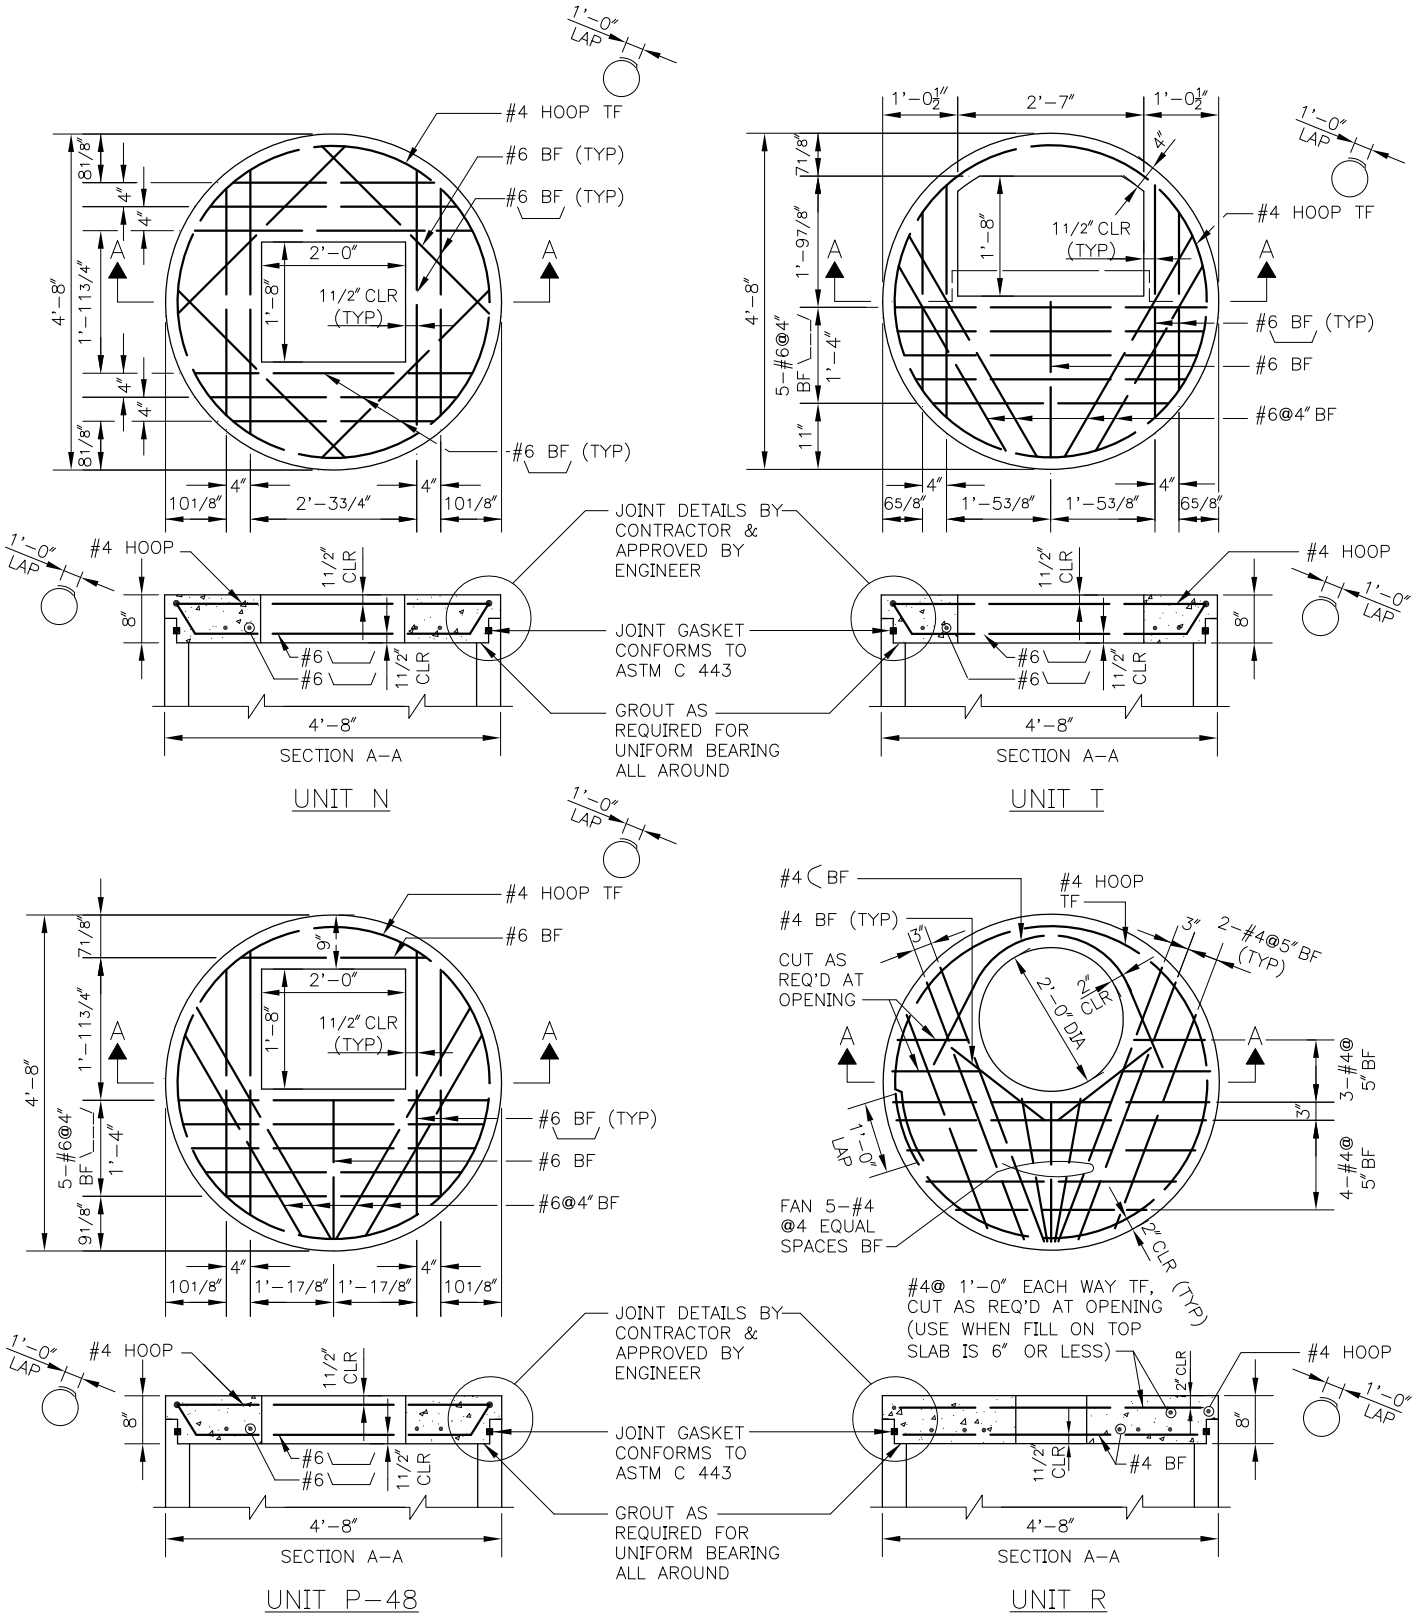


REF STD SPEC SEC 7-05




NOT TO SCALE

PRECAST CATCH BASIN TOP SLAB

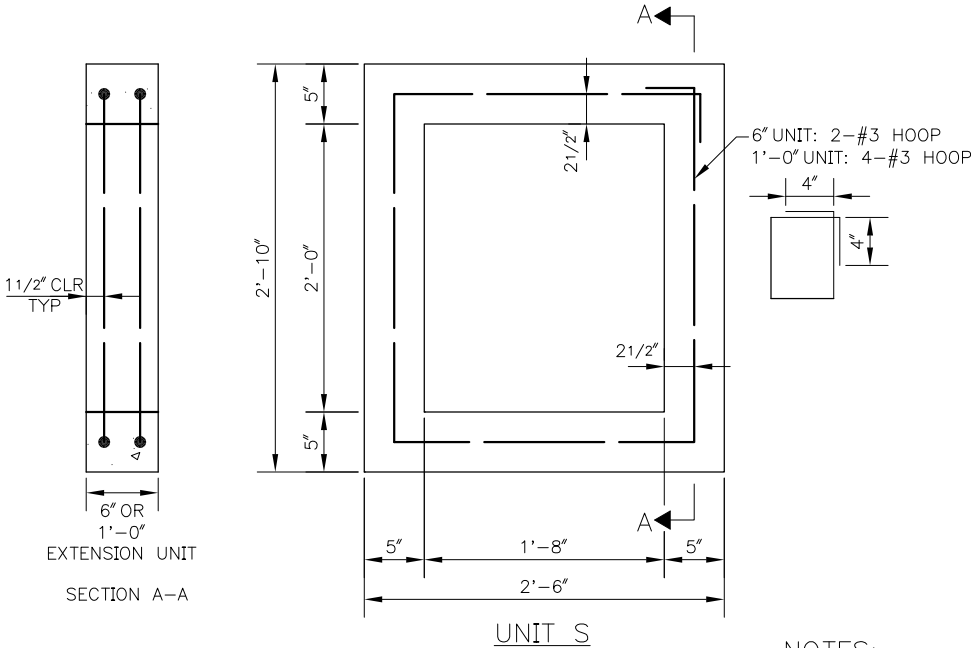

- NOTES:
 1. CONCRETE: CLASS AX
 2. REINFORCING STEEL: ASTM A615 GR 60

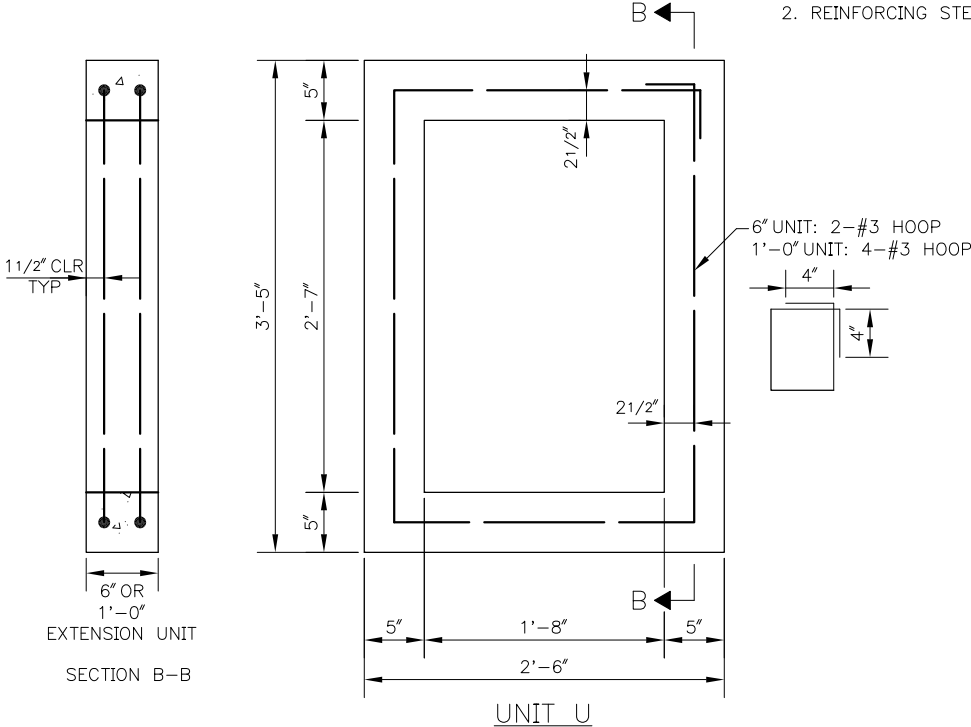

REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE

PRECAST CATCH BASIN
EXTENSION RISERS


STANDARD PLAN NO 250

REV DATE: 2003

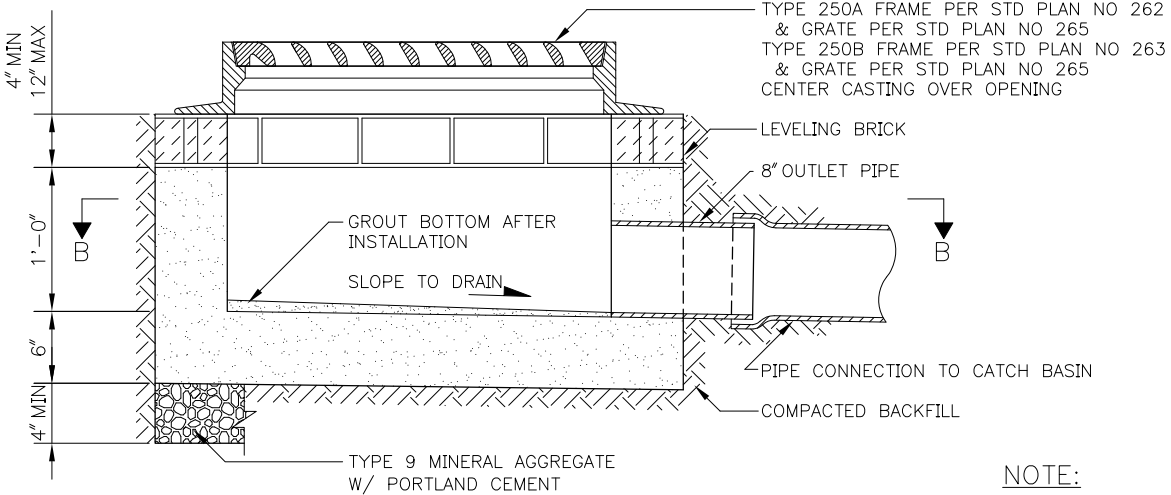


SECTION A-A

NOTE:
INSTALL AND LOCATE
PER STD PLAN NO 260

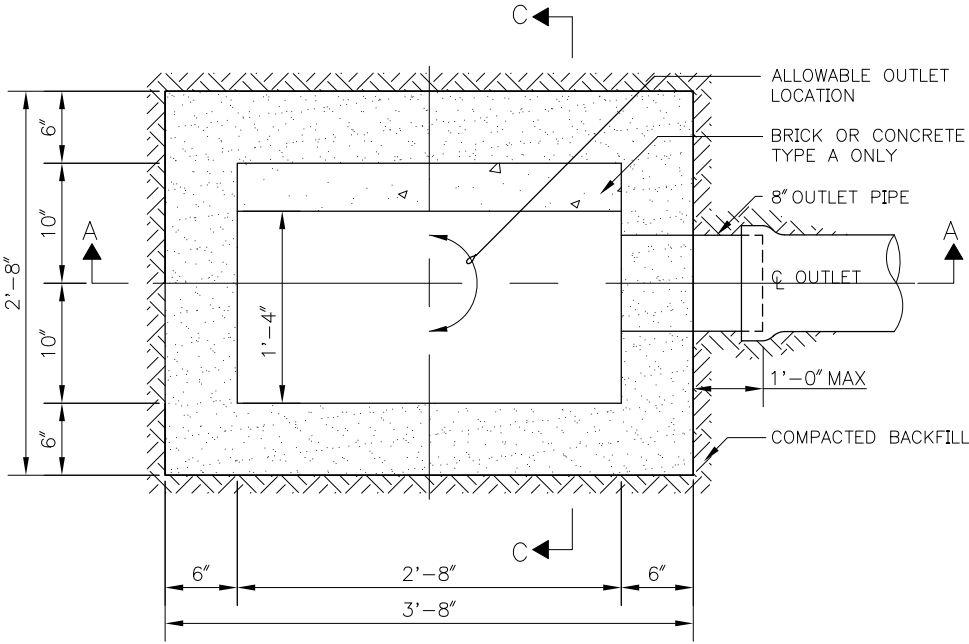

SECTION B-B

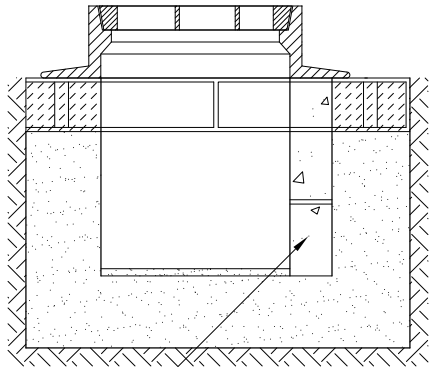

BRICK OR
CONCRETE ON TYPE A
ONLY SO THAT INLET FRAME
IS FULLY SUPPORTED

SECTION C-C
TYPE A ONLY

REF STD SPEC SEC 7-05





City of Seattle

NOT TO SCALE

TYPE 250 INLET

STANDARD PLAN NO 252

REV DATE: 2003

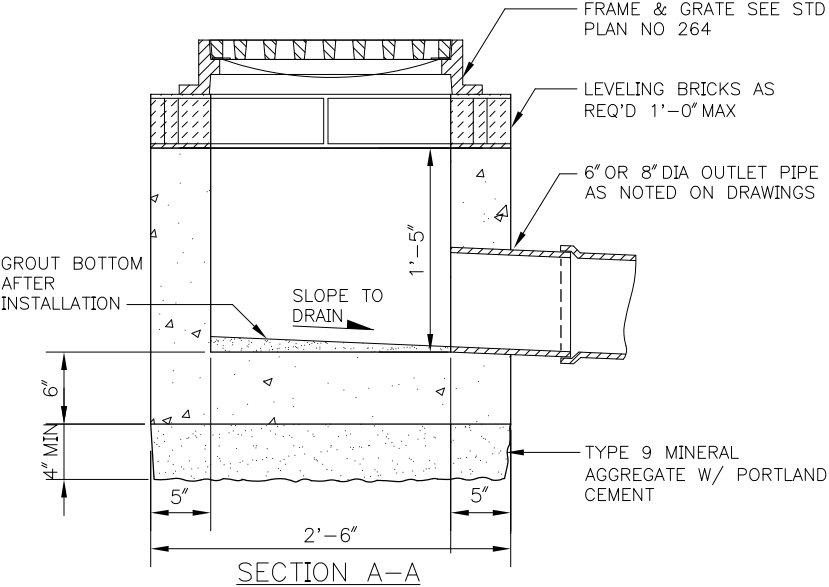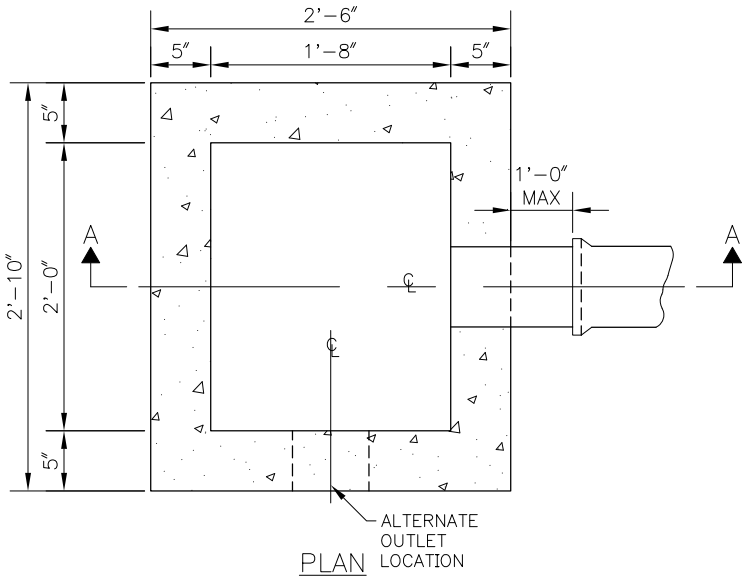


REF STD SPEC SEC 7-05




City of Seattle

NOT TO SCALE


TYPE 252 INLET

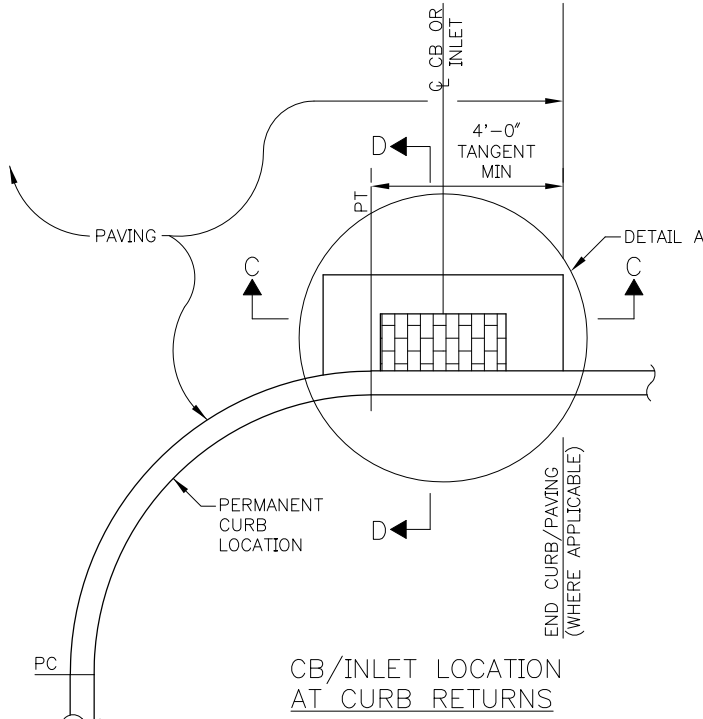


CB/INLET LOCATION AT CURB RETURNS

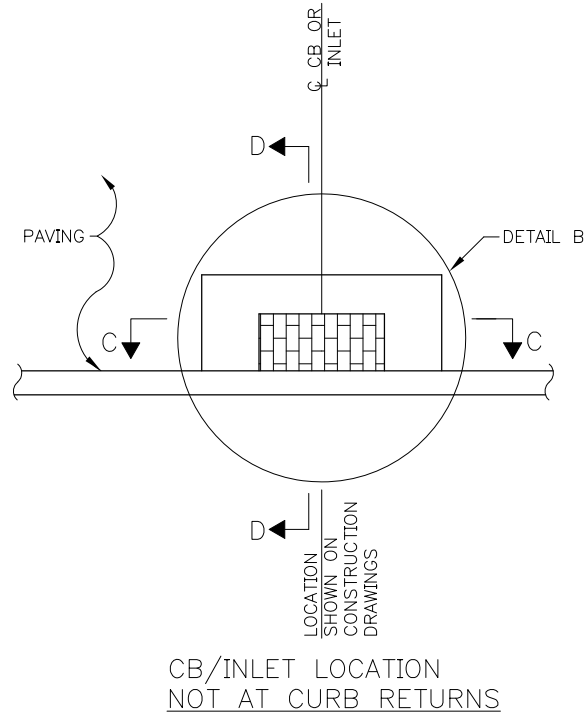


CB/INLET LOCATION NOT AT CURB RETURNS




SECTION D-D INLET (TYP)

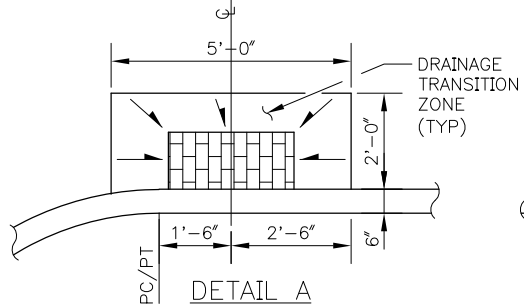

DETAIL A

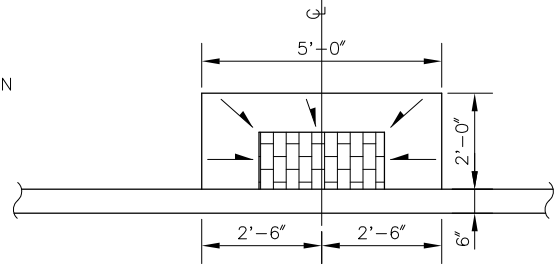

DETAIL B

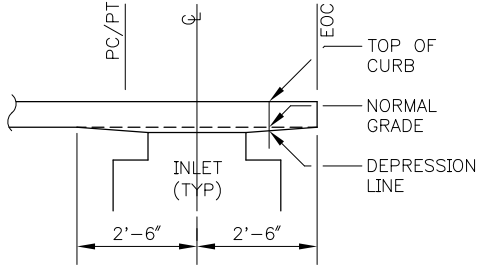

SECTION C-C


NOTE
 INLET/CB SHALL NOT BE PLACED IN CROSSWALKS OR IN FRONT OF WHEELCHAIR RAMPS

REF STD SPEC SEC 7-05




NOT TO SCALE


INLET/CB LOCATION & INSTALLATION

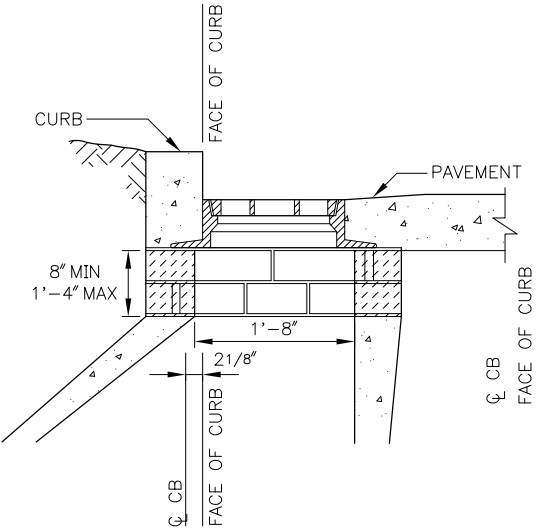

TYPE 242A CB
 (TYPE 250A INLET SIMILAR)
 NOTE - TYPE 240C GRATE

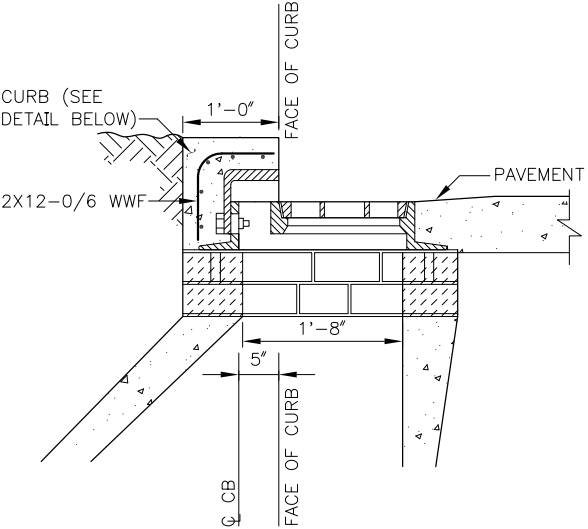


TYPE 242B CB
 (TYPE 250B INLET SIMILAR)

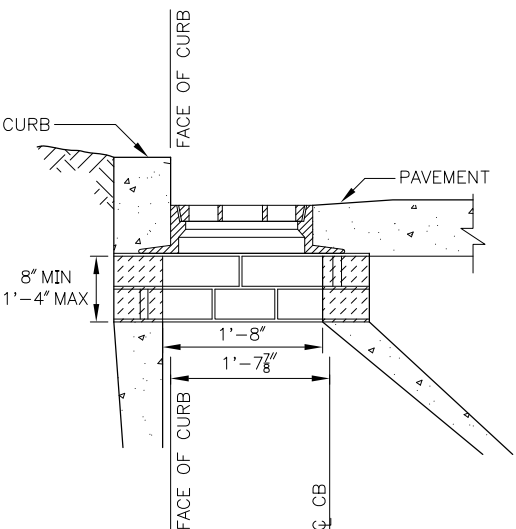

TYPE 242A.1 CB

- NOTES:**
1. TYPE 242A.1 OR B.1 INSTALLATION IS ROTATED 180° FROM TYPE 242A OR 242B
 2. A.1 IS SHOWN, B.1 IS SIMILAR
 3. A.1 OR B.1 CAN ONLY BE USED WHEN SPECIFIED ON DRAWINGS

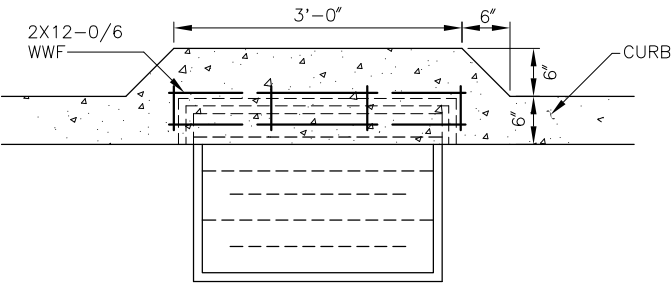


CURB DETAIL (PLAN VIEW) FOR TYPE 242B CB & TYPE 250B INLET

REF STD SPEC SEC 7-05




NOT TO SCALE


CATCH BASIN & INLET INSTALLATION

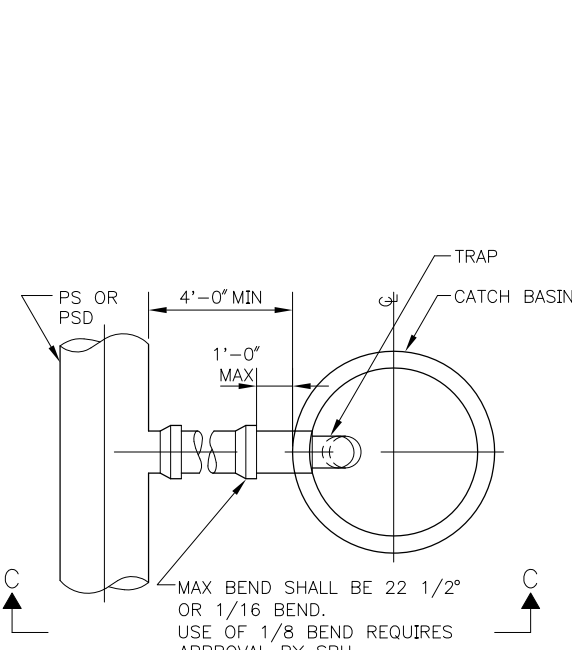


TYPE A

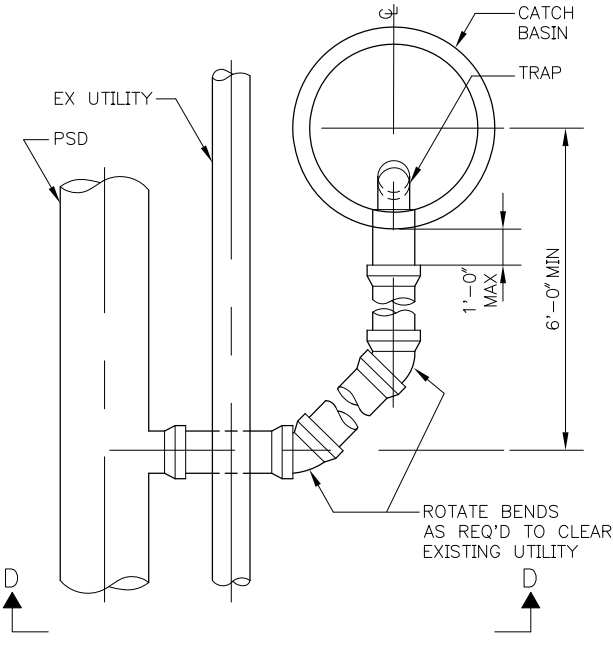

TYPE B

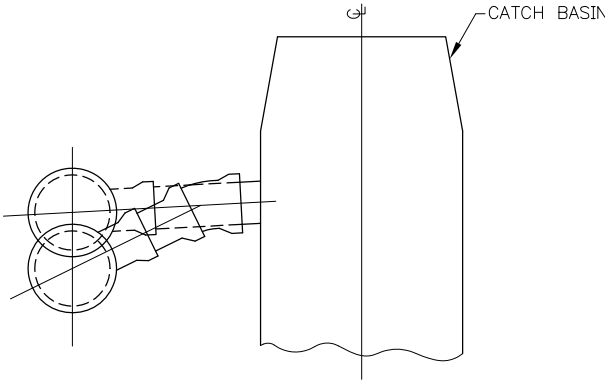

SECTION C-C

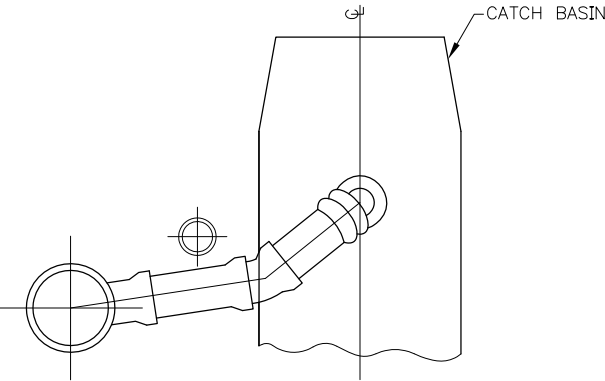

SECTION D-D





- NOTES:**
1. CONNECTIONS SHALL MAINTAIN A MINIMUM OF 2% AND A MAXIMUM OF 50% GRADE
 2. TYPE A CONNECTION MAY BE USED UNDER THE FOLLOWING CIRCUMSTANCES:
 - A. THE MAXIMUM OF 50% GRADE IS NOT EXCEEDED
 - B. THERE IS NO INTERFERENCE WITH EXISTING OR PROPOSED UTILITIES

REF STD SPEC SEC 7-08



NOT TO SCALE

TYPICAL CATCH BASIN CONNECTION

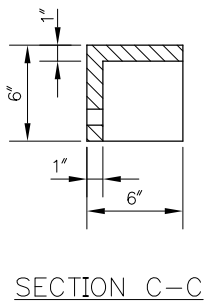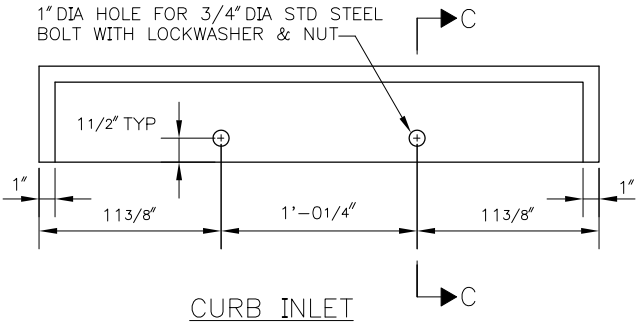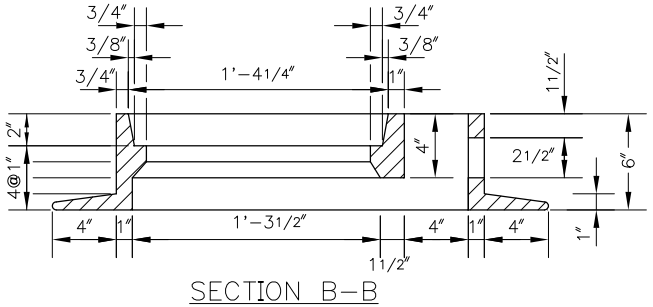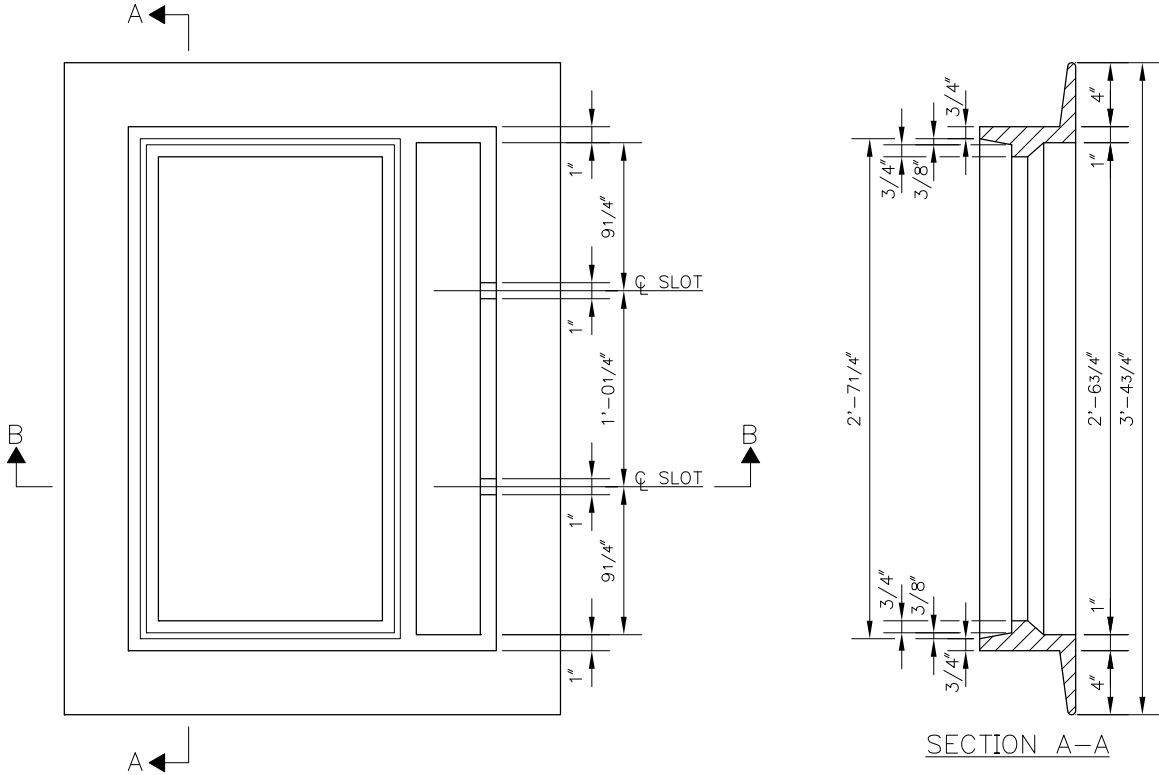


REF STD SPEC SEC 9-12



City of Seattle


NOT TO SCALE

TYPE 263 INLET FRAME

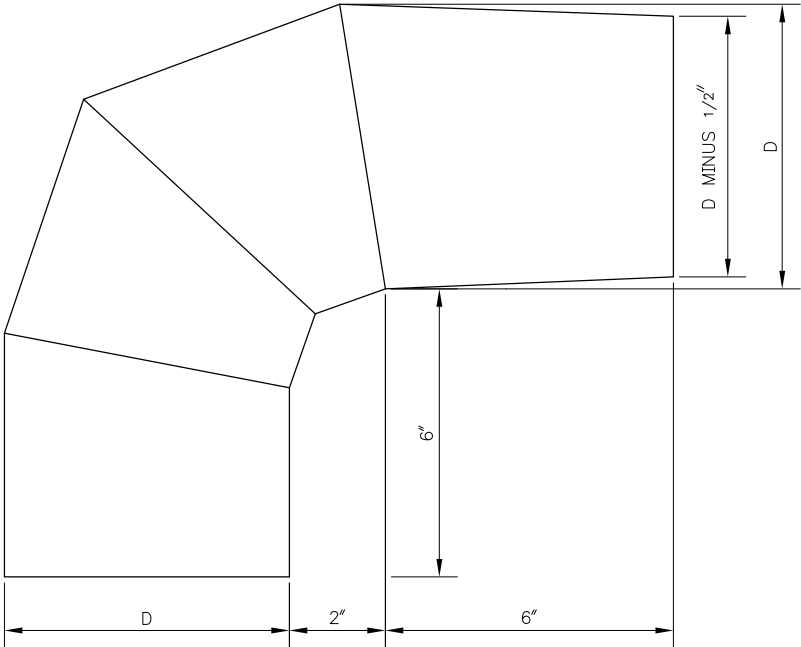

TYPE A
 FOR USE WITH OUTLET PIPE WHICH SLOPES 10% OR LESS

- NOTES:
1. TRAP TO BE MADE OF 22 GA (0.0336") GALVANIZED SHEET METAL OR 18 GA (0.05") ALUMINUM
 2. ALL JOINTS TO BE SEAMED AND SOLDERED, OR WELDED
 3. ALL LONGITUDINAL JOINTS TO BE RIVETED OR WELDED
 4. DIAMETER "D" IS NOMINAL DIAMETER OF OUTLET PIPE

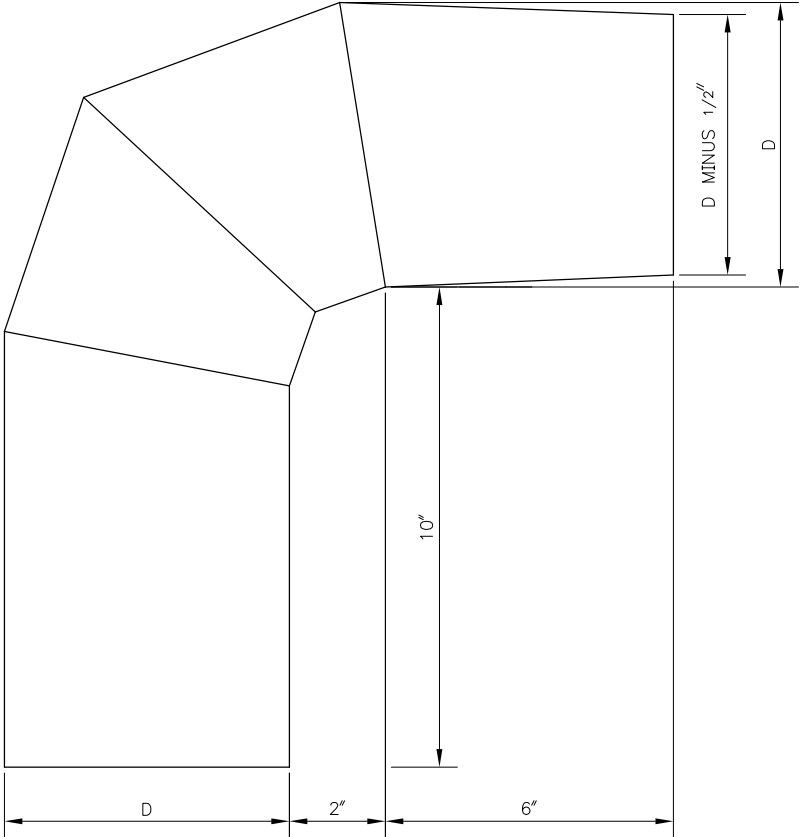

TYPE B
 FOR USE WITH OUTLET PIPE WHICH SLOPES MORE THAN 10%





REF STD SPEC SEC 9-12




City of Seattle

NOT TO SCALE


OUTLET TRAP

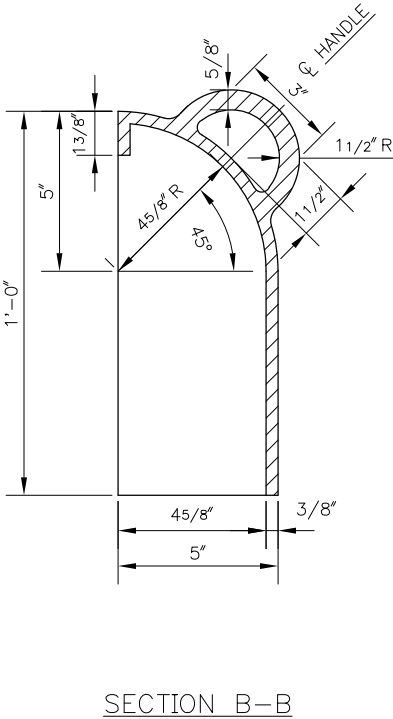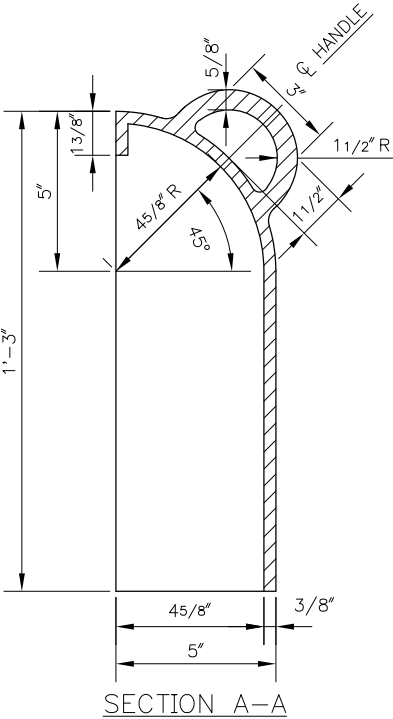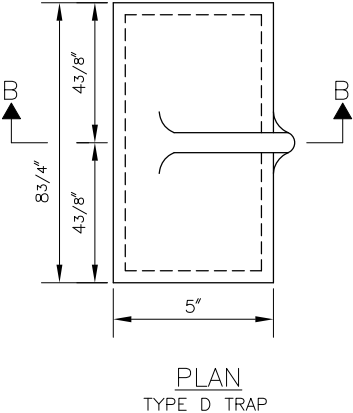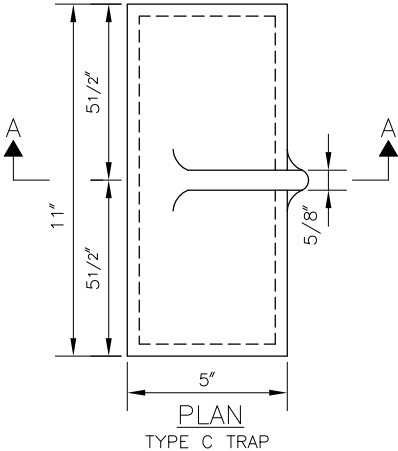

- NOTES:
1. TYPE 267C TRAP TO BE USED WITH 8" ID OUTLET PIPE. TYPE 267D TRAP TO BE USED WITH 4" OR 6" ID OUTLET PIPE
 2. TRAP MAY BE CAST IRON ASTM A 48 CLASS 25 OR CAST STEEL ASTM A 27 GRADE 70-36
 3. TRAP AND TRAP HOOK TO HAVE A BITUMINOUS COATING INSIDE AND OUT

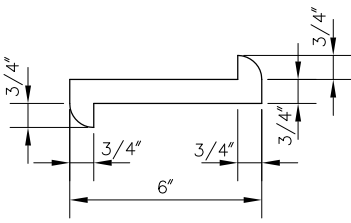

TRAP HOOKS MAY BE ROUND OR SQUARE IN CROSS-SECTION

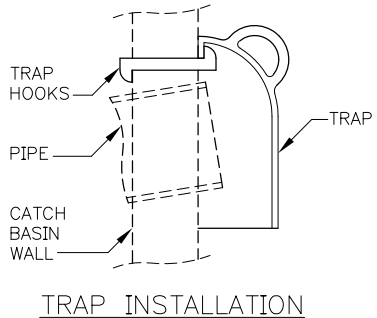

REF STD SPEC SEC 7-05





NOT TO SCALE


OUTLET TRAP
(FOR DOPAR USE ONLY)

STANDARD PLAN NO 268

REV DATE: 2003

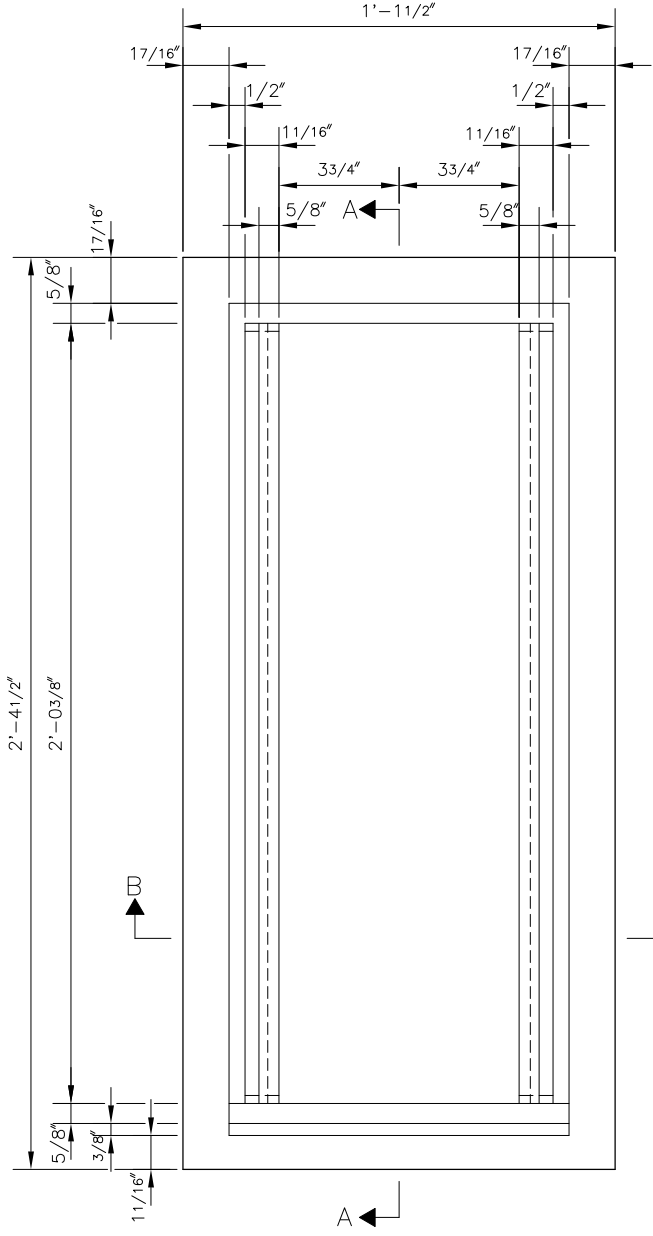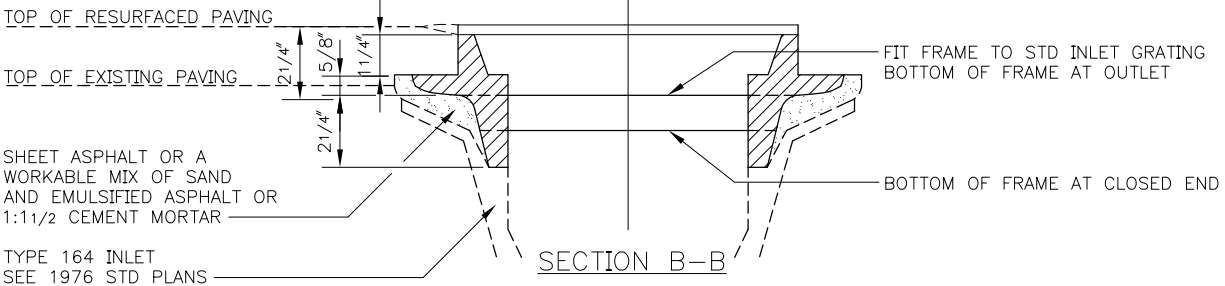

PLAN

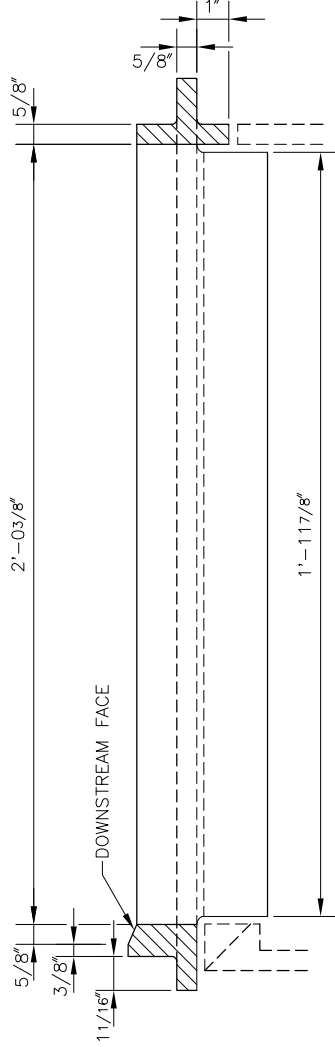

SECTION A-A

THESE DIMENSIONS MAY BE CHANGED IF NECESSARY TO FIT EXISTING CASTINGS

REF STD SPEC SEC 9-05




City of Seattle

NOT TO SCALE


EXTENSION FOR INLET

STANDARD PLAN NO 270


REV DATE: 2003

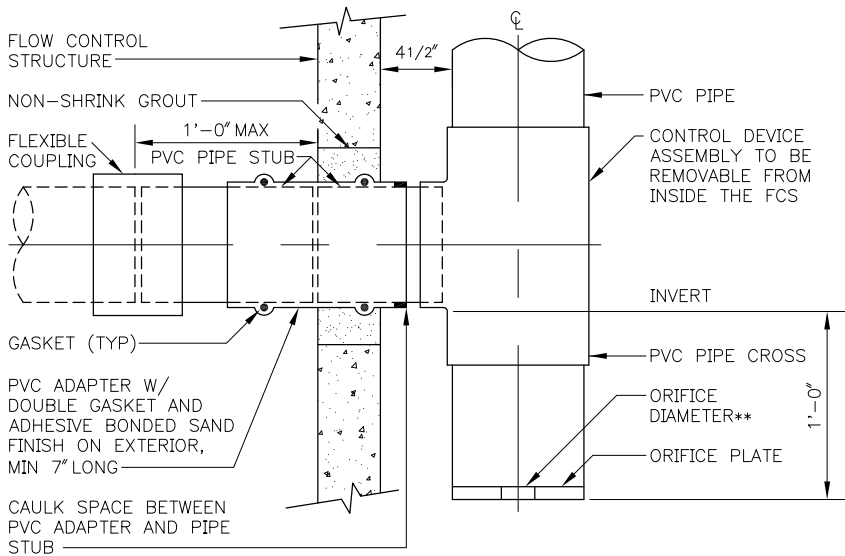




**CONNECTION & CONTROL DEVICE
DETAIL A**

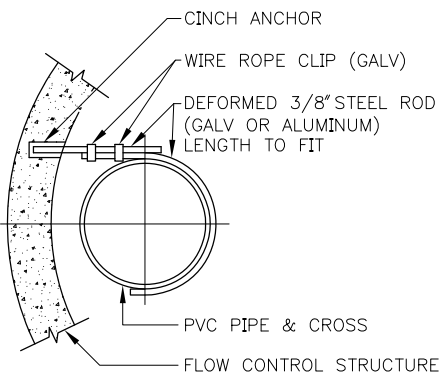

**PIPE SUPPORT
DETAIL B**

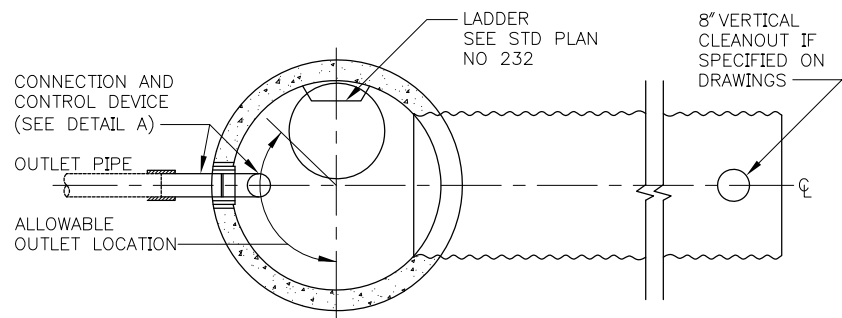

**END CAP DETAIL
(WHEN REQUIRED)**

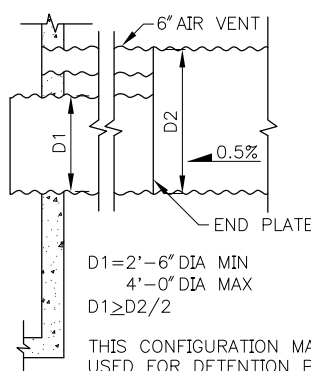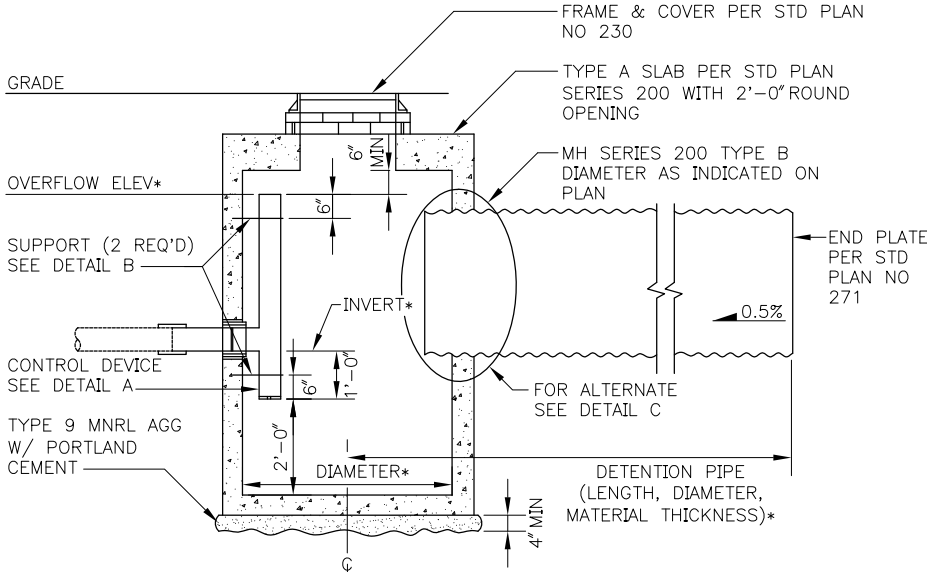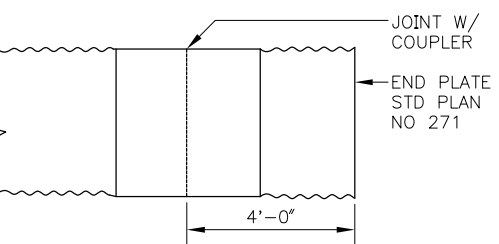

D1 = 2'-6\"/>

DETAIL C

FLOW CONTROL STRUCTURE & DETENTION PIPE

*SPECIFIC DESIGN INFORMATION AS INDICATED ON CONSTRUCTION DRAWINGS
NOTE - INVERT OF DETENTION PIPE HIGHER THAN INVERT OF OUTLET PIPE

REF STD SPEC SEC 7-16





City of Seattle

NOT TO SCALE



FLOW CONTROL STRUCTURE

STANDARD PLAN NO 271a

REV DATE: 2003

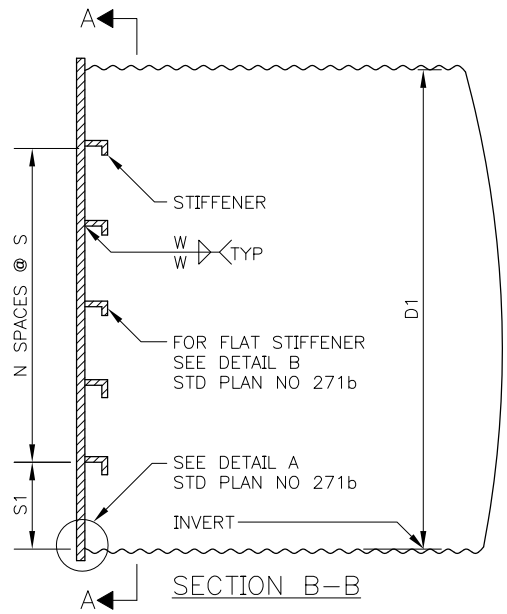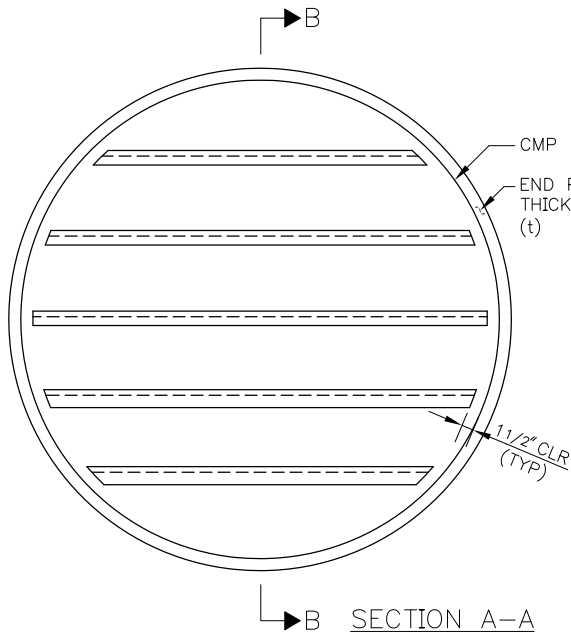

TYPE A

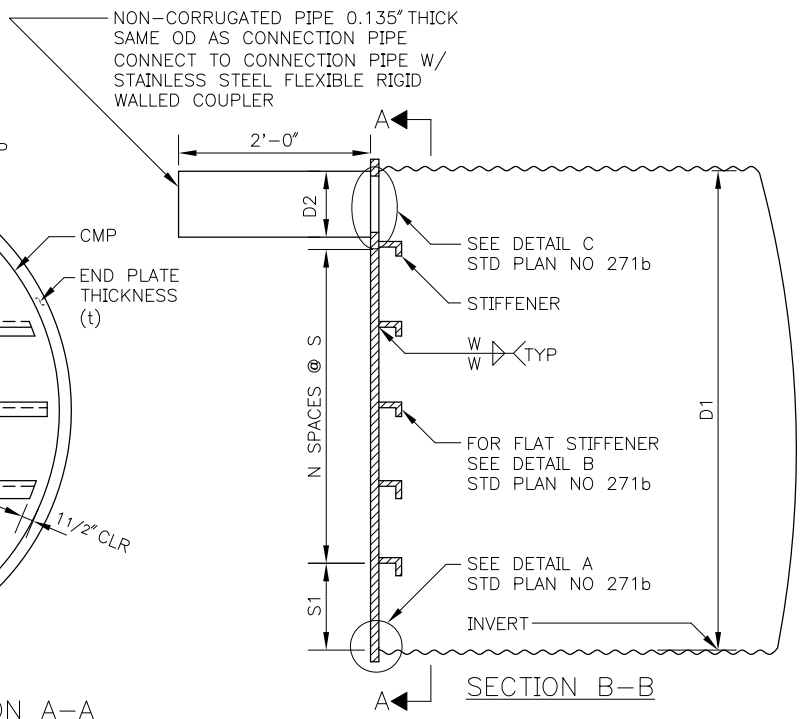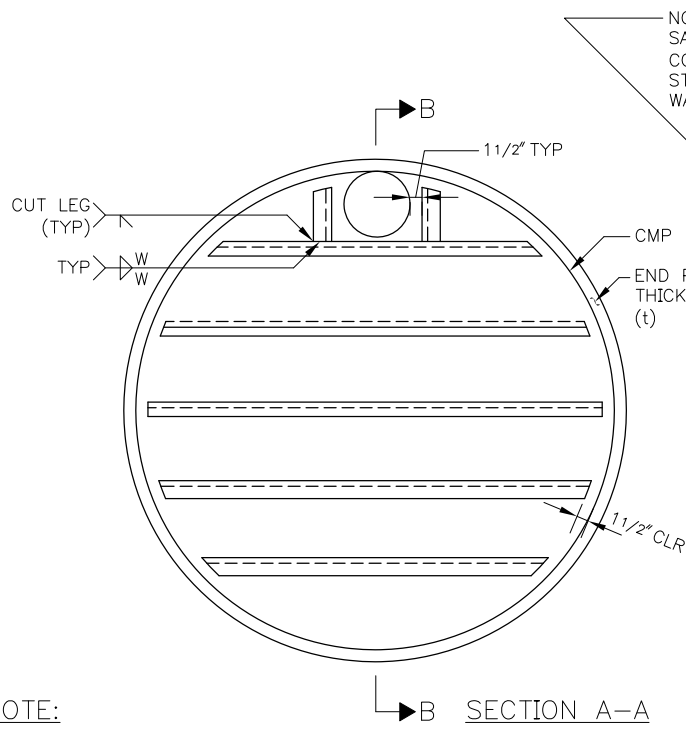

TYPE B

NOTE:
FOR D1, D2, t, S, S1, N & W
VALUES AND GENERAL NOTES SEE
STD PLAN NO 271c

REF STD SPEC SEC 7-16




City of Seattle

NOT TO SCALE

DETENTION STRUCTURE END
PLATE DETAILS


STANDARD PLAN NO 271b

REV DATE: 2003

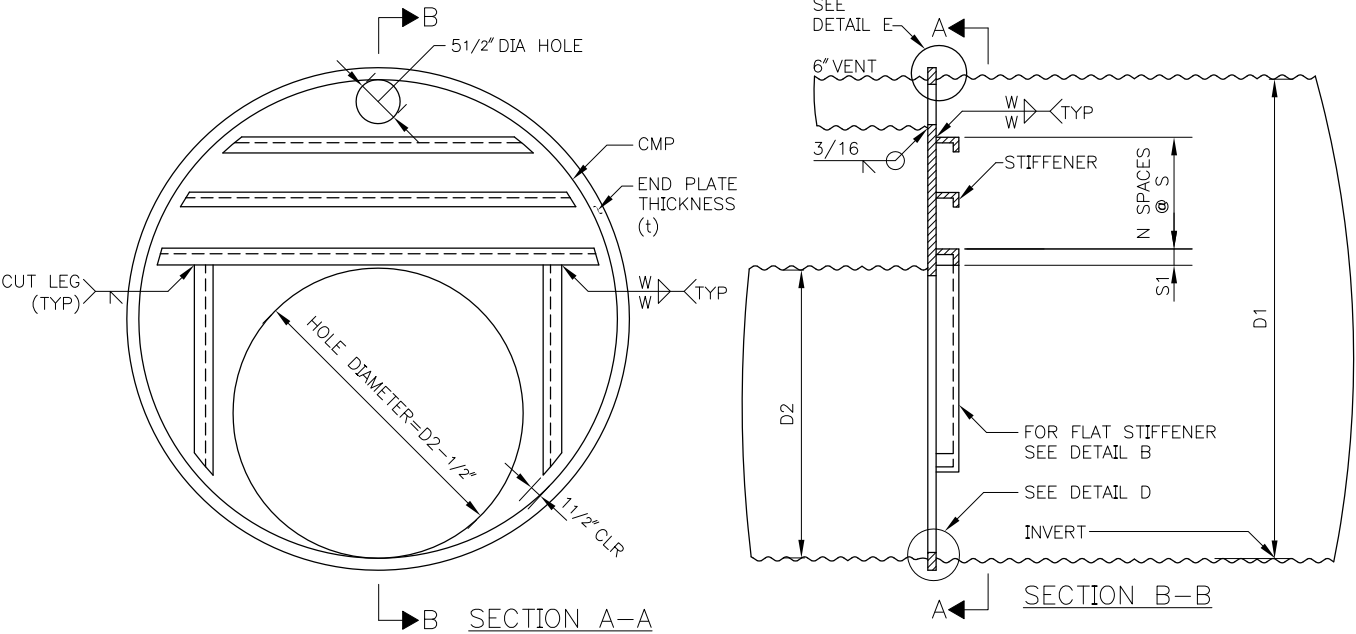

NOTE:
 FOR D1, D2, t, S, S1, N & W
 VALUES AND GENERAL NOTES SEE
 STD PLAN NO 271c

TYPE C

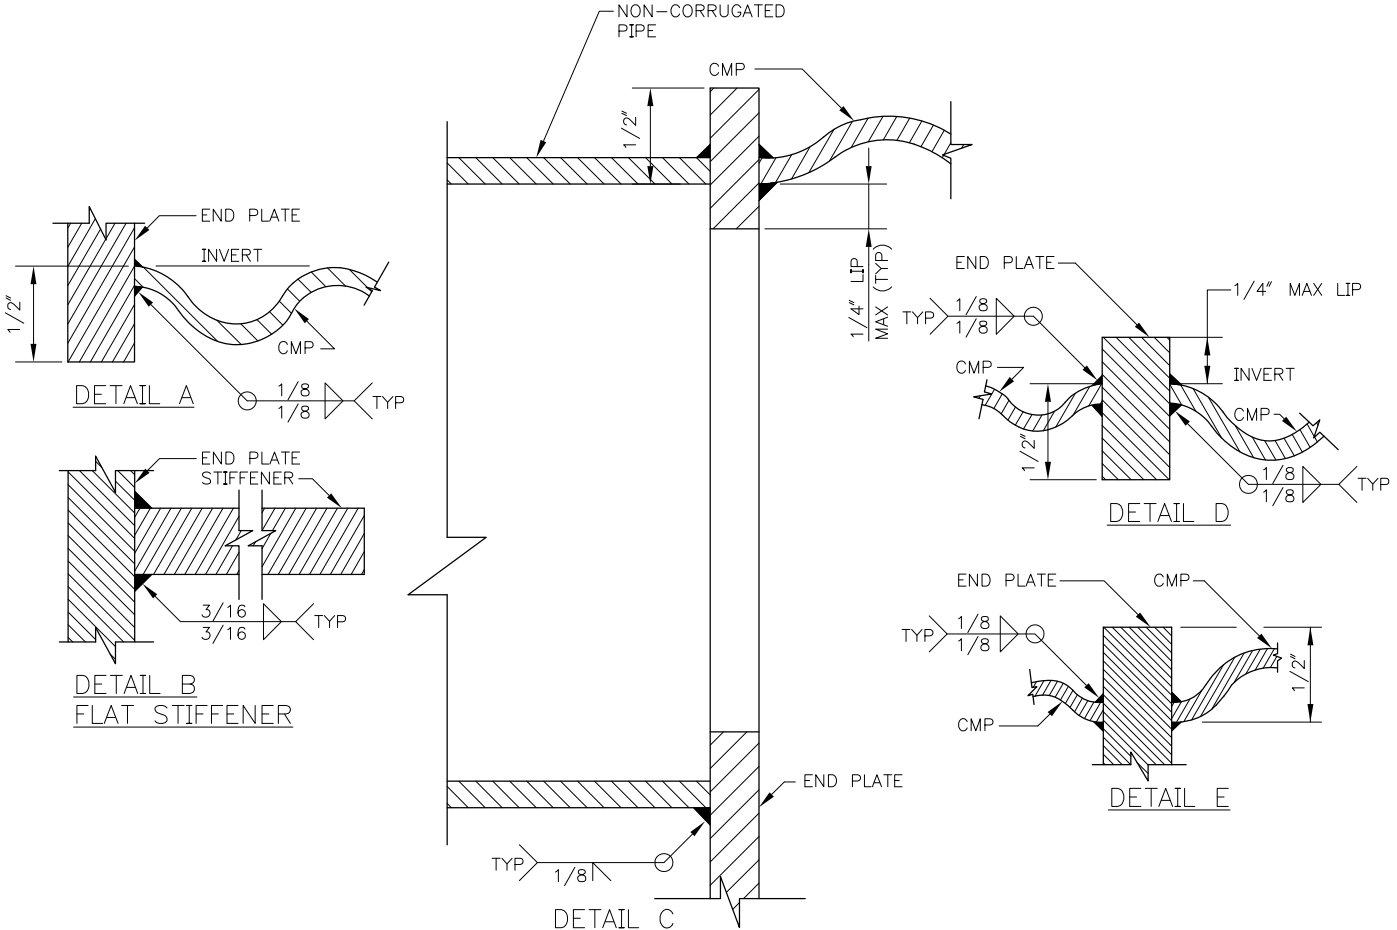

REF STD SPEC SEC 7-16



NOT TO SCALE

DETENTION STRUCTURE END
 PLATE DETAILS

PIPE DIAMETER		END PLATE THICKNESS t	STIFFENER TYPE & SIZE	STIFFENER SPACING			SIZE W
D1	D2			S1	S	N	
TYPE A							
30"	-	1/4"	FLAT 2 1/2" X 1/4"	6"	6"	3	3/16"
36"	-	1/4"	FLAT 3" X 1/4"	6"	6"	4	3/16"
48"	-	1/4"	FLAT 4 1/4" X 1/4"	8"	8"	4	3/16"
60"	-	3/8"	L 2 1/2" X 2" X 3/8"	10"	10"	4	1/4"
72"	-	3/8"	L 3" X 3" X 3/8"	6"	10"	6	1/4"
TYPE B							
30"	6"	1/4"	FLAT 2 1/2" X 1/4"	5 1/2"	5 1/2"	3	3/16"
	8"			5"	5"	3	
	12"			4"	6"	2	
36"	6"	1/4"	FLAT 3" X 1/4"	6"	5 1/2"	4	3/16"
	8"			6"	5"	4	
	12"			5 1/2"	5 1/2"	3	
48"	6"	1/4"	FLAT 4 1/4" X 1/4"	8"	8"	4	3/16"
	8"			6"	8"	4	
	12"			4"	7 1/2"	4	
60"	6"	3/8"	L 2 1/2" X 2" X 3/8"	7"	9"	5	1/4"
	8"			10"	10"	4	
	12"			6"	10"	4	
72"	6"	3/8"	L 3" X 3" X 3/8"	8"	8"	7	1/4"
	8"			8"	9"	6	
	12"			8"	10"	5	
TYPE C							
48"	30"	1/4"	FLAT 4 1/4" X 1/4"	2"	8"	1	3/16"
60"	36"	3/8"	L 2 1/2" X 2" X 3/8"	2"	7"	2	1/2"
72"	36"	3/8"	L 2" X 3" X 3/8"	3"	8 1/2"	3	1/4"

NOTES:

- DESIGNS VALID FOR PIPE INSTALLED WITH 6'-0" OR LESS OF COVER FROM CROWN OF PIPE TO GRADE. MAXIMUM WATER SURCHARGE 3'-0" ABOVE CROWN OF PIPE
- END PLATE MATERIAL: ALUMINUM 6061-T6
- DESIGNS SHALL BE USED ONLY FOR ALUMINUM CMP

REF STD SPEC SEC 7-16





City of Seattle

NOT TO SCALE

DETENTION STRUCTURE END PLATE DETAILS


STANDARD PLAN NO 272a

REV DATE: 2003

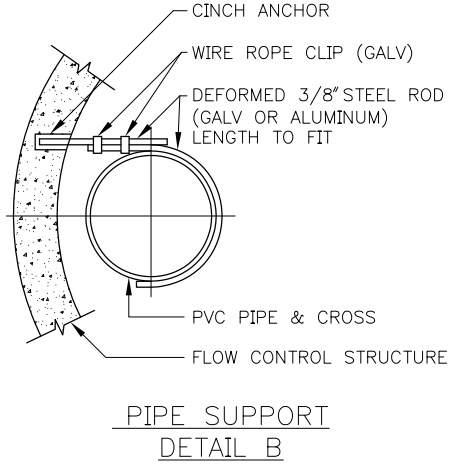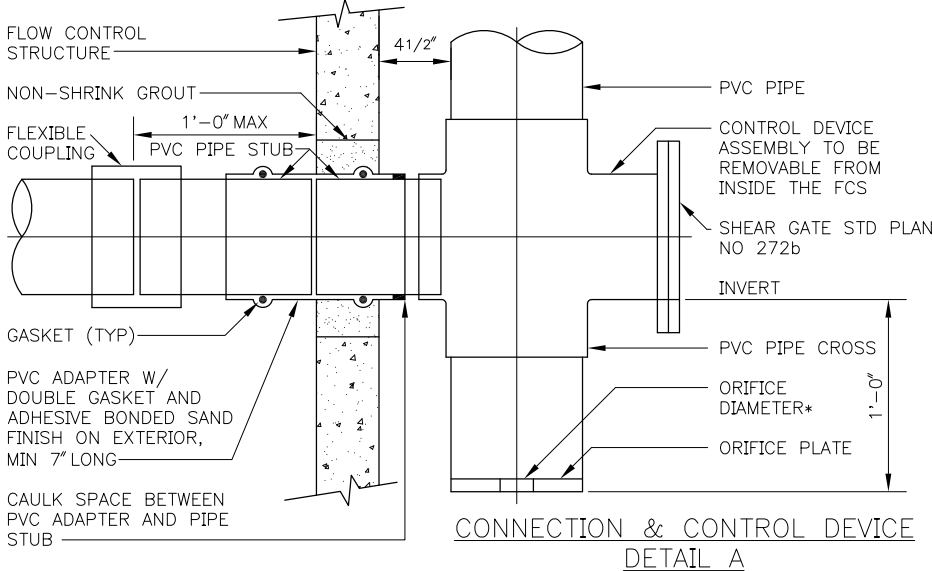


CONNECTION & CONTROL DEVICE
DETAIL A

PIPE SUPPORT
DETAIL B

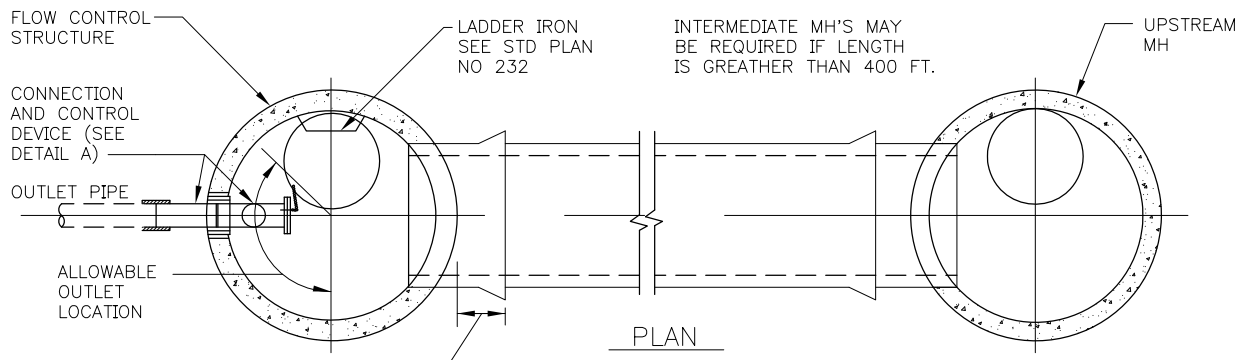

PLAN

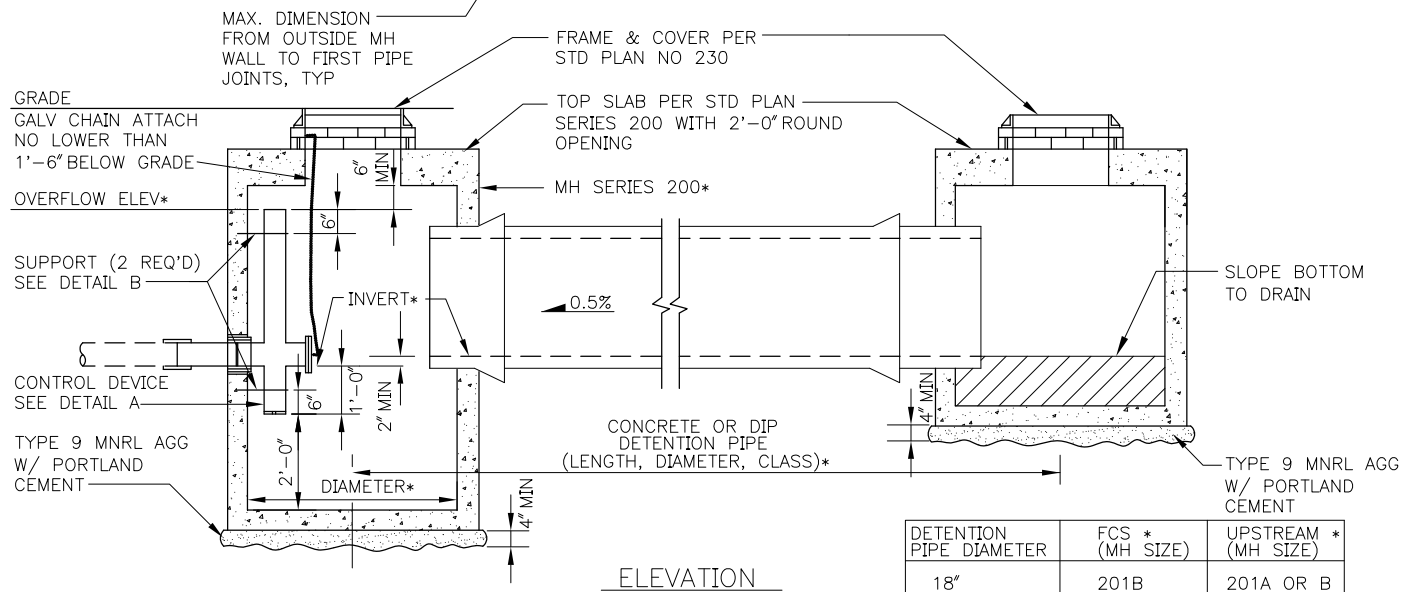

ELEVATION

FLOW CONTROL STRUCTURE & DETENTION PIPE

DETENTION PIPE DIAMETER	FCS * (MH SIZE)	UPSTREAM * (MH SIZE)
18"	201B	201A OR B
24"	201B	201A OR B
30"	202B	202B
36"	202B	202B
48"	203B	203B
60"	204B	204B
72"	205B	205B

*SPECIFIC DESIGN INFORMATION AS INDICATED ON CONSTRUCTION DRAWINGS

REF STD SPEC SEC 7-16




City of Seattle

NOT TO SCALE

FLOW CONTROL STRUCTURE
(CONC OR DIP DETENTION PIPE)

STANDARD PLAN NO 272b


REV DATE: 2003

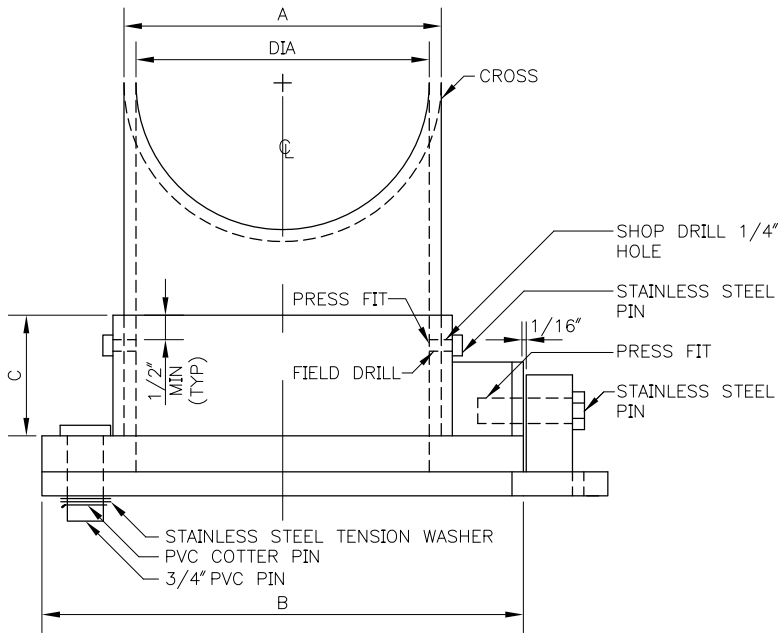


DIA	A	B*	C*
4"	4 1/2"	8"	2"
6"	6 5/8"	10"	2 1/2"
8"	8 5/8"	12"	3"
10"	10 3/4"	14"	3"
12"	12 3/4"	16"	3"

*MINIMUM
DIA=OUTLET PIPE DIAMETER

TOP VIEW

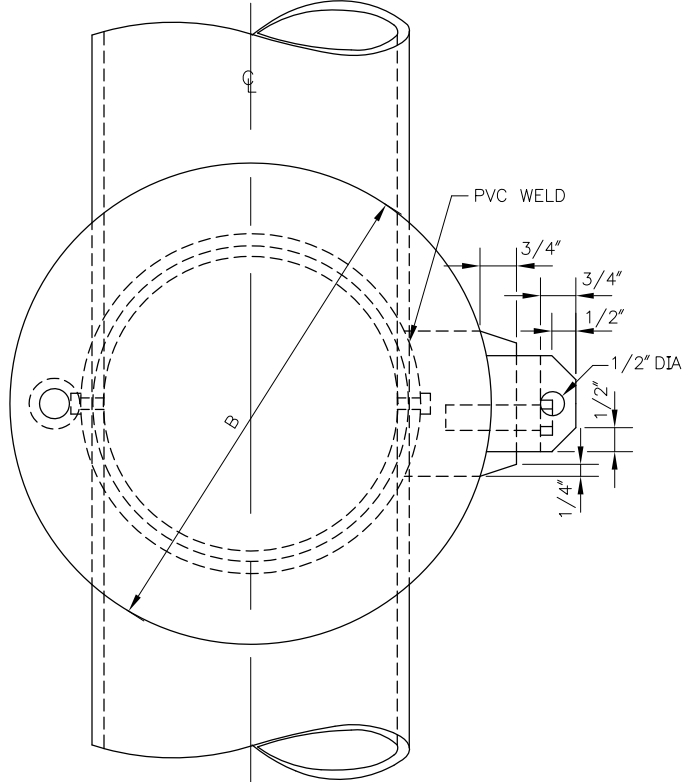

FRONT VIEW

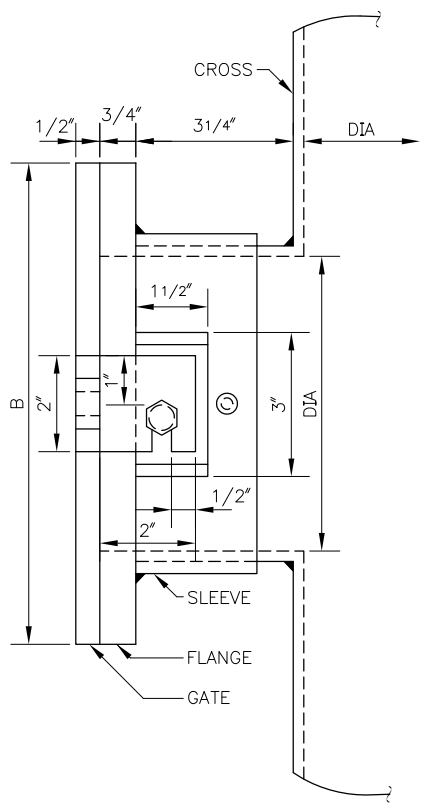

SIDE VIEW

REF STD SPEC SEC 7-16





City of Seattle

NOT TO SCALE

PVC SHEAR GATE

STANDARD PLAN NO 277

REV DATE: 2003

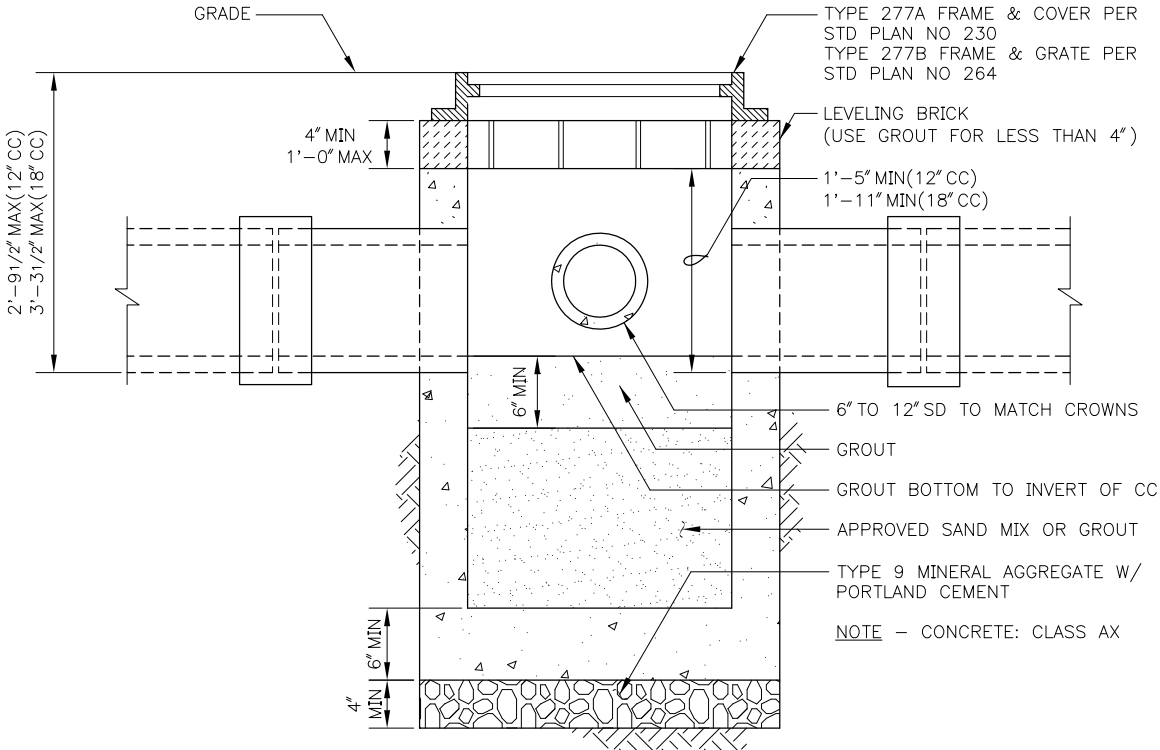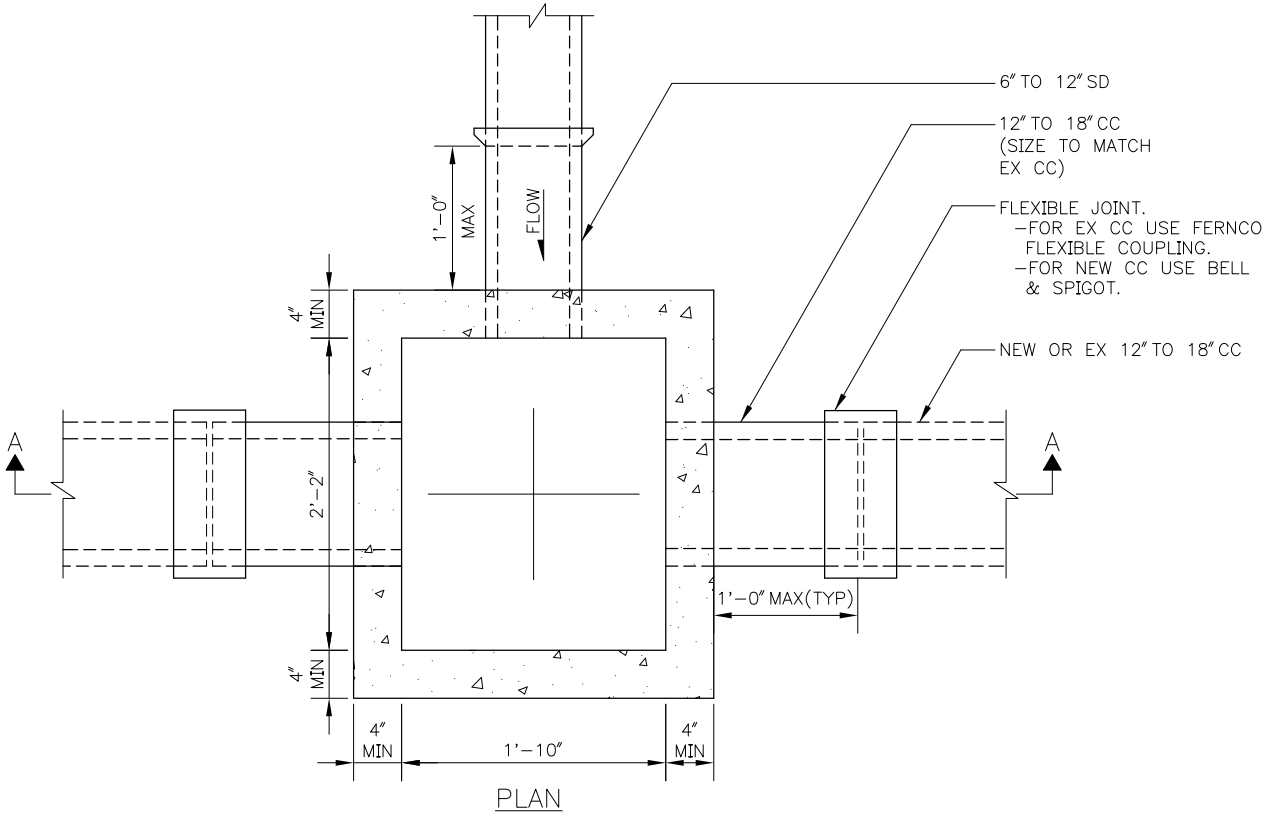

REF STD SPEC SEC 7-02 & 9-12.9




City of Seattle

NOT TO SCALE

TYPE 277 JUNCTION BOX & INSTALLATION

STANDARD PLAN NO 278

REV DATE: 2003

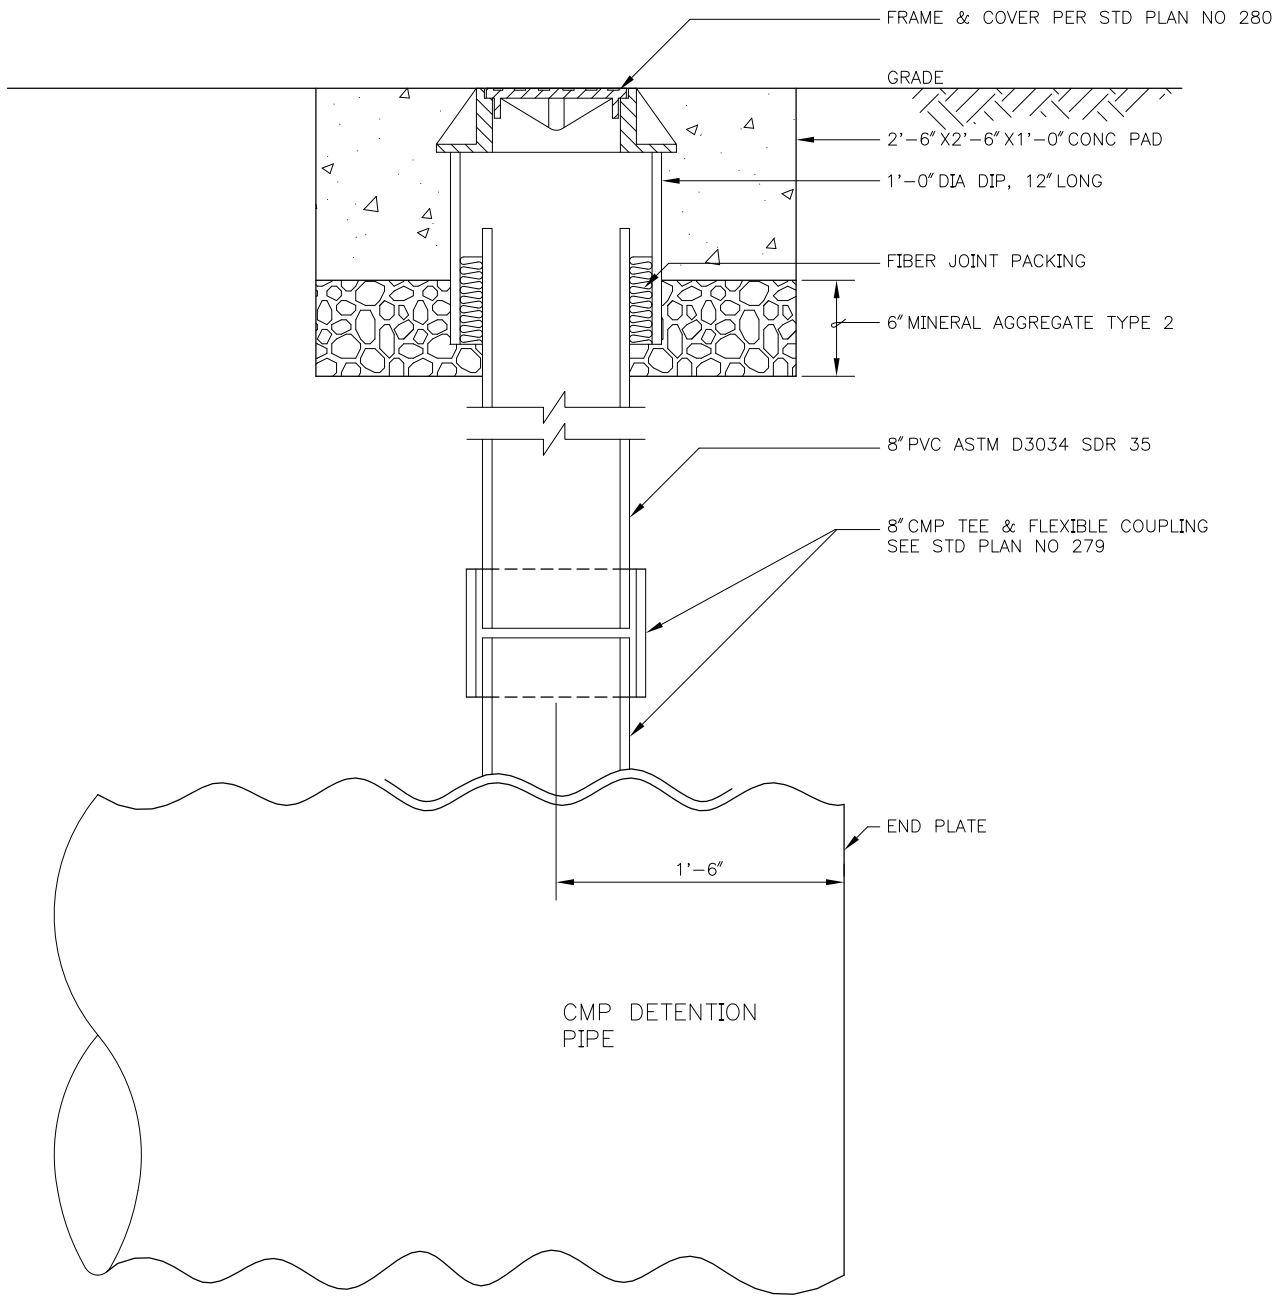

REF STD SPEC SEC 7-19 & 7-16.2





City of Seattle

NOT TO SCALE

VERTICAL CLEAN OUT/
CORRUGATED METAL PIPE

STANDARD PLAN NO 279

REV DATE: 2003

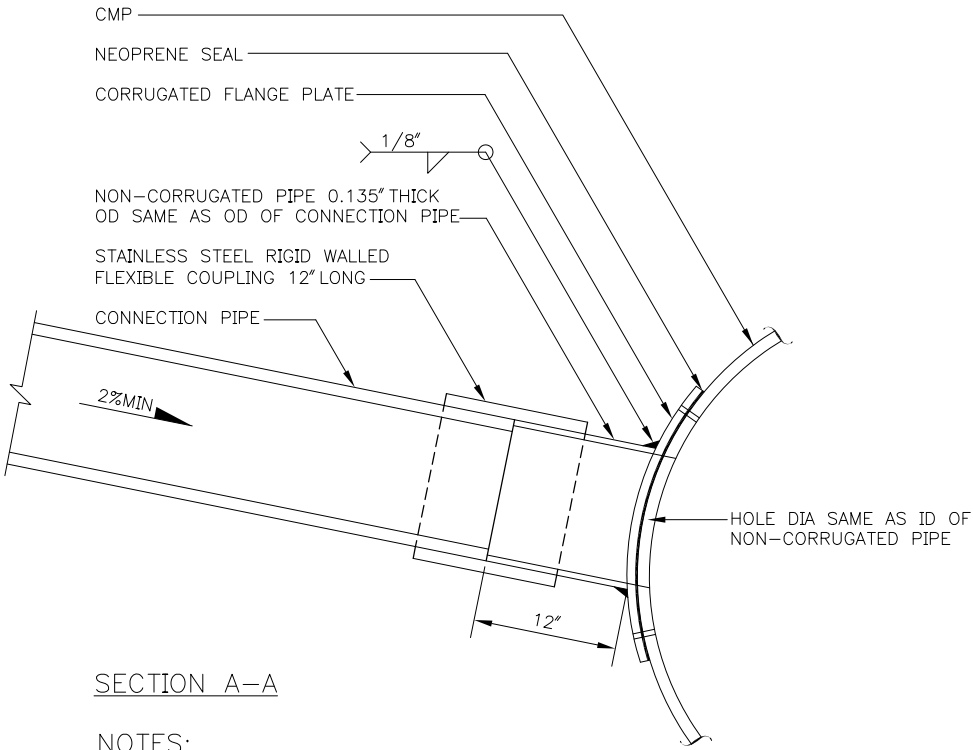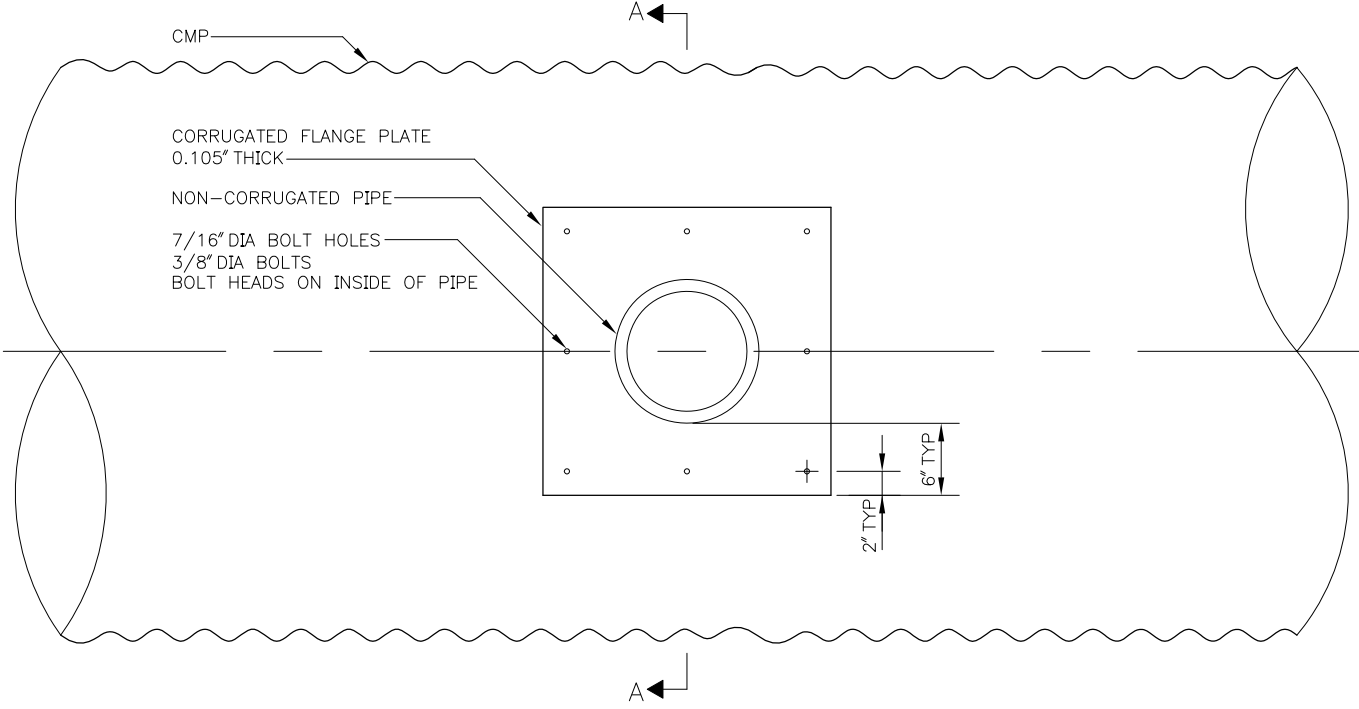

- NOTES:
1. CORRUGATED FLANGE PLATE AND NON-CORRUGATED PIPE TO BE SAME MATERIAL AND HAVE SAME COATING AS CMP
 2. BOLTS TO BE GALV STEEL MEETING ASTM A 307 OR STAINLESS STEEL MEETING ASTM A 193

REF STD SPEC SEC 7-17 & 7-16.2




NOT TO SCALE

TEE INSTALLATION
CORRUGATED METAL PIPE

STANDARD PLAN NO 280

REV DATE: 2003

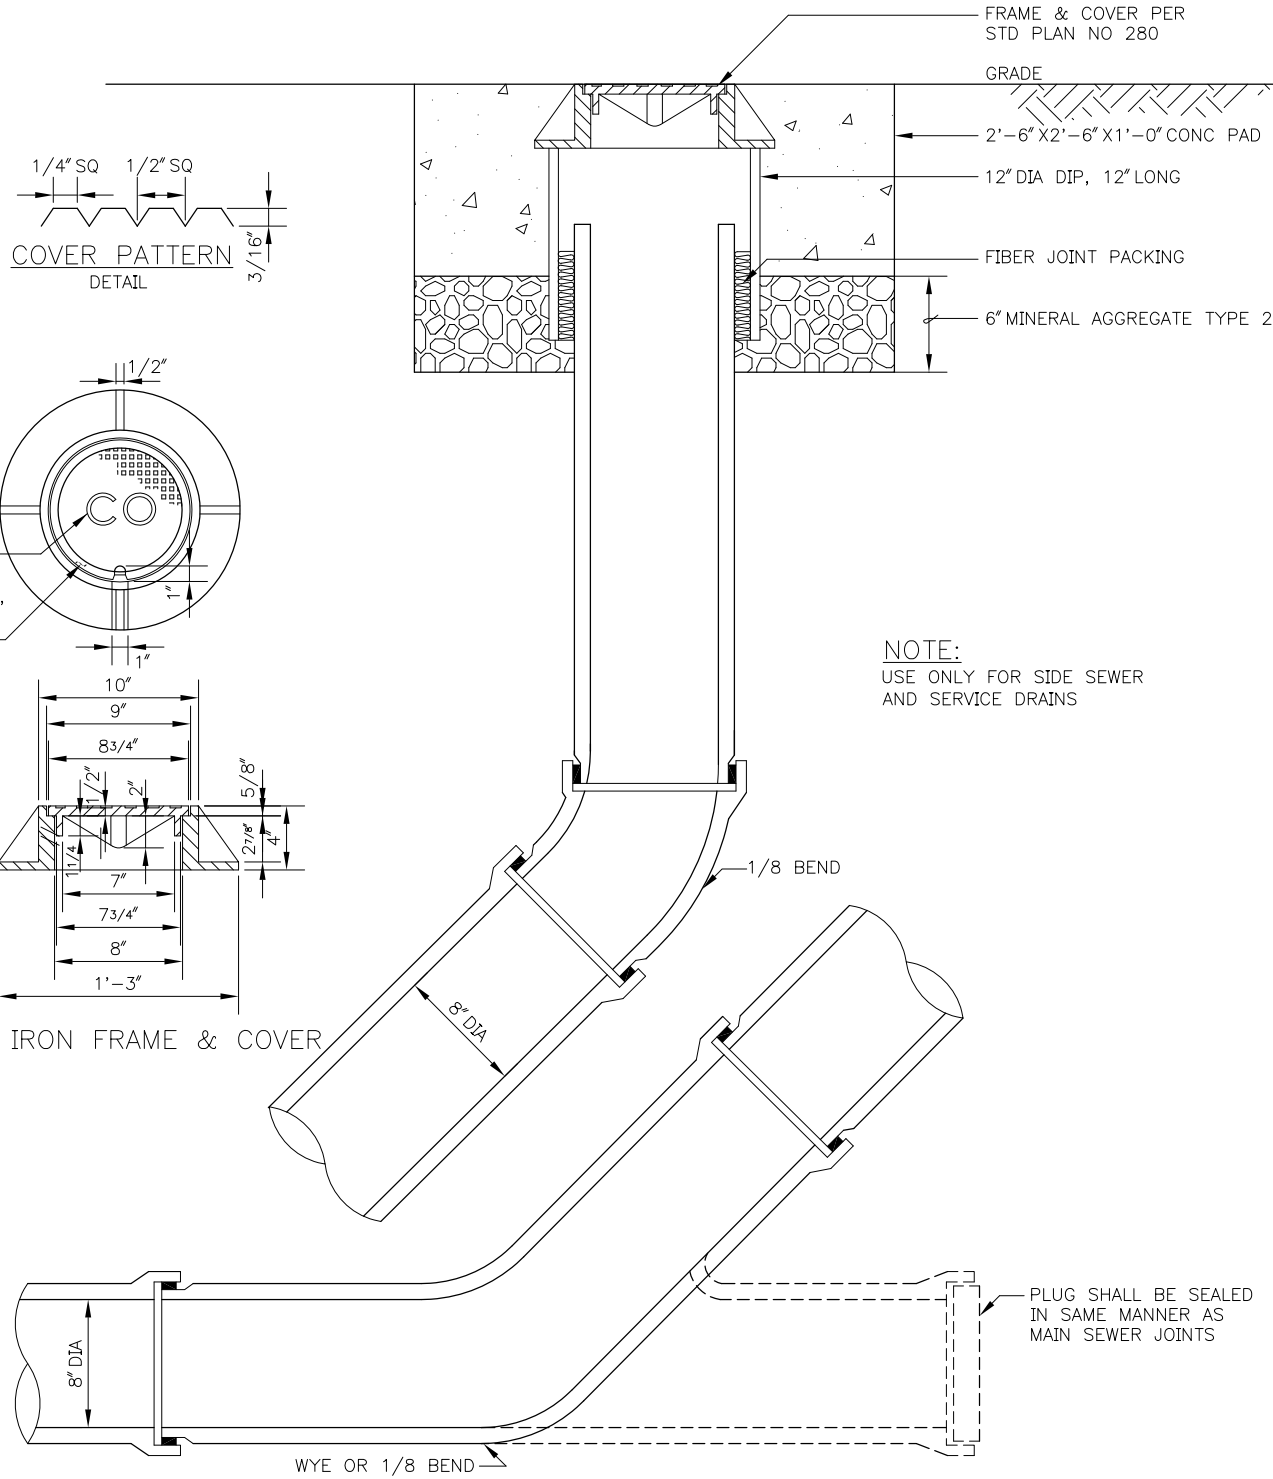

NOTE:
USE ONLY FOR SIDE SEWER
AND SERVICE DRAINS

REF STD SPEC SEC 7-19





NOT TO SCALE

8" CLEAN-OUT

STANDARD PLAN NO 282a

REV DATE: 2003

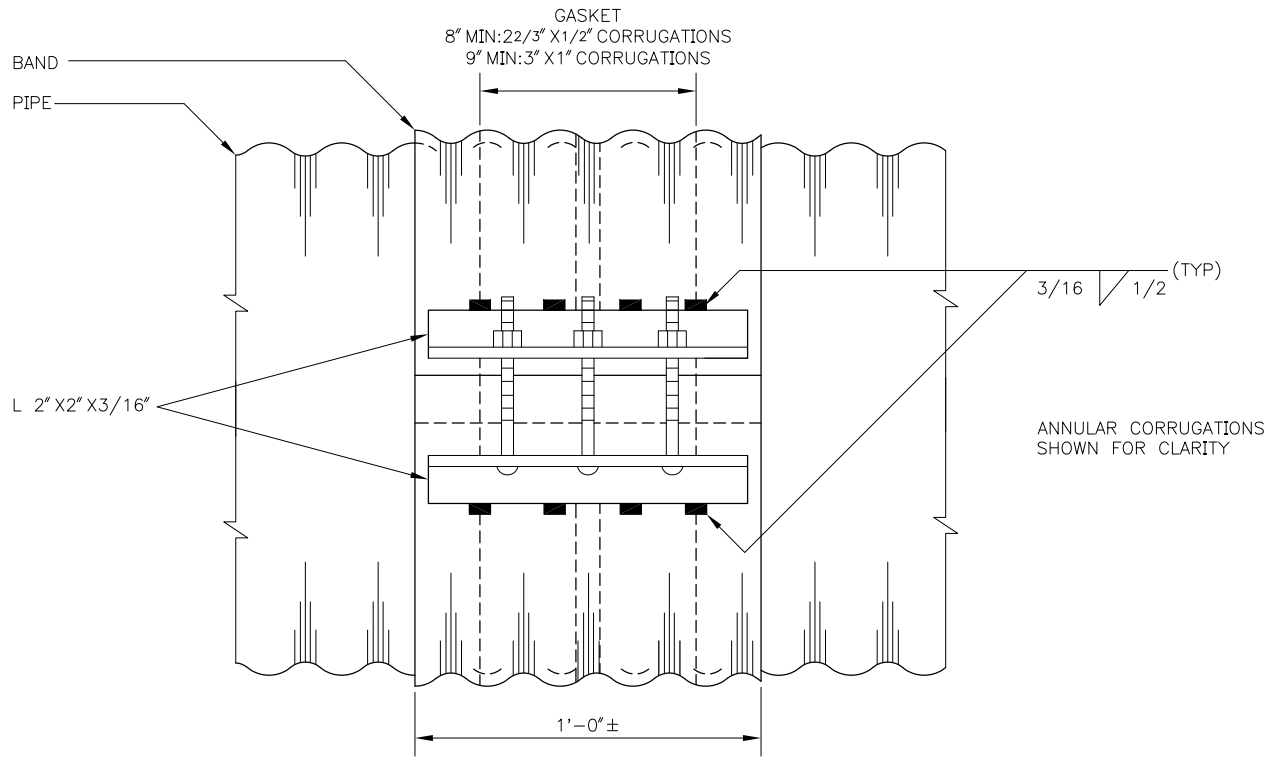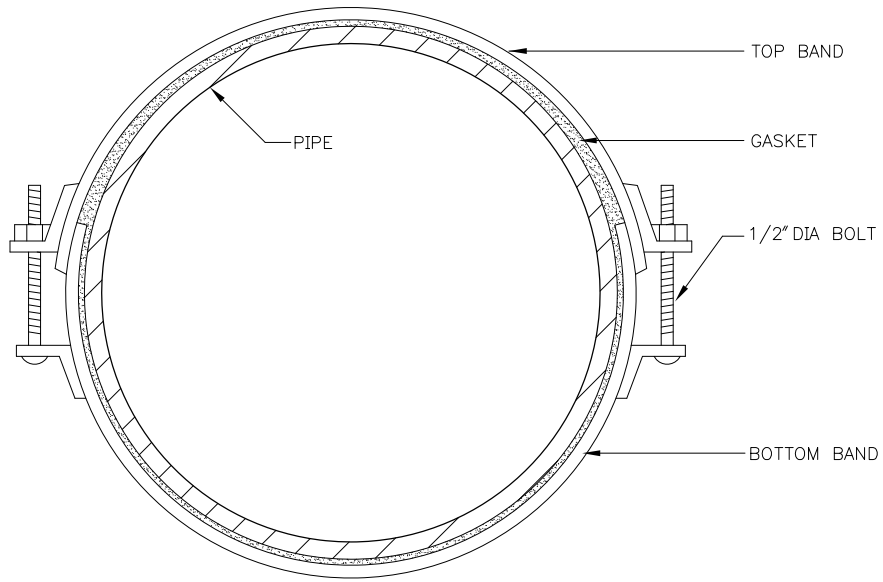

FOR PIPES LESS THAN 48" DIAMETER
(HELICAL OR ANNULAR)

REF STD SPEC SEC 7-16.2 & 9-05





NOT TO SCALE

CORRUGATED METAL
PIPE COUPLING BANDS

STANDARD PLAN NO 282b

REV DATE: 2003

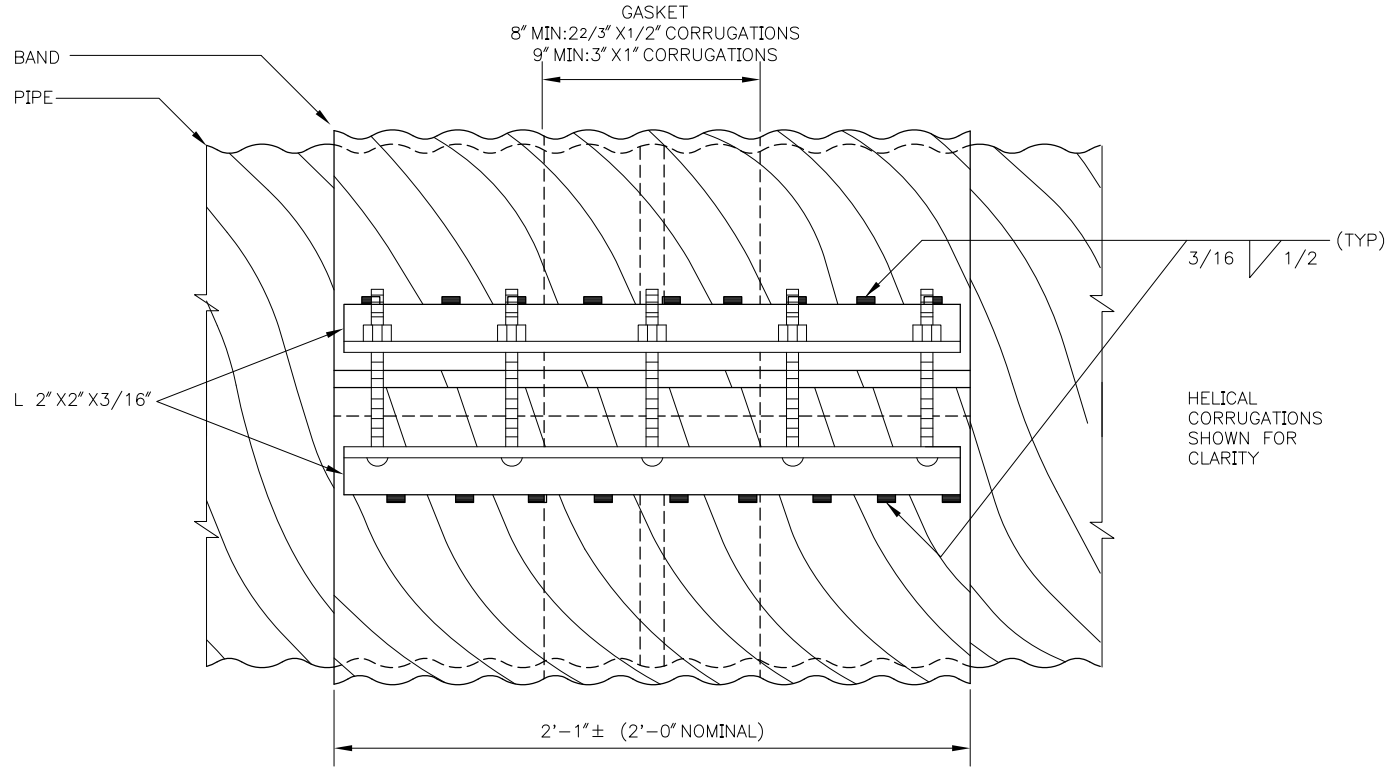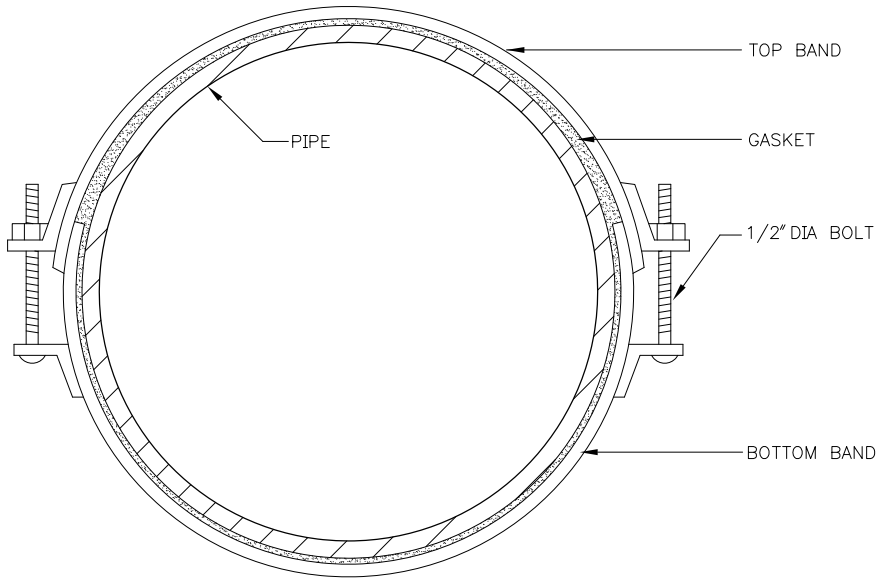

FOR PIPES 48" DIAMETER & LARGER
(HELICAL OR ANNULAR)


REF STD SPEC SEC 7-16.2 & 9-05



City of Seattle

NOT TO SCALE

CORRUGATED METAL
PIPE COUPLING BANDS

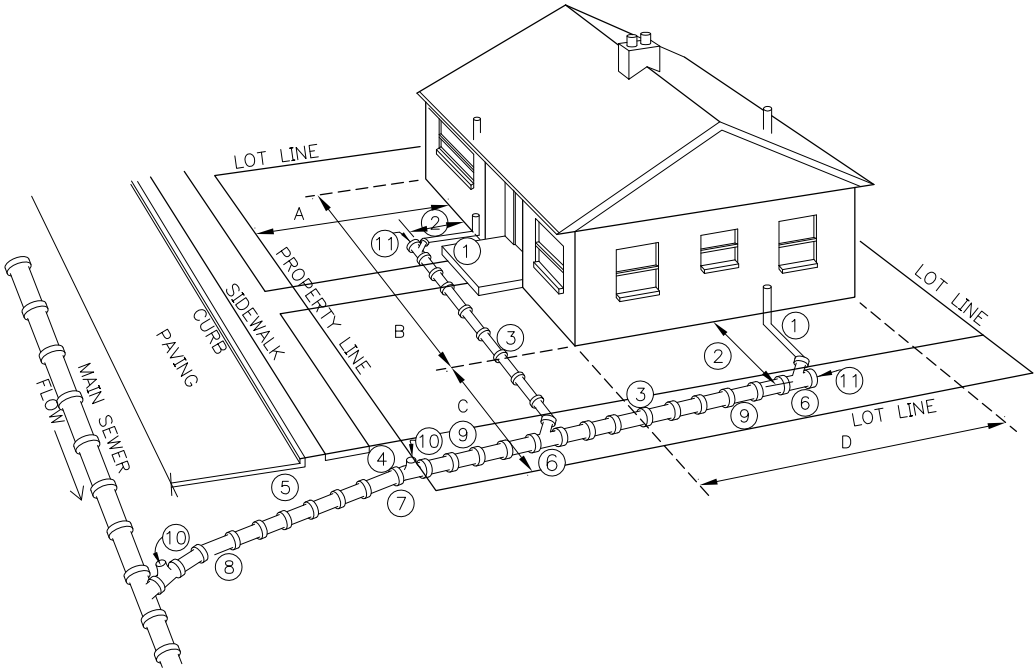

NOTES:

1. ALL HOUSE PLUMBING OUTLETS MUST BE CONNECTED TO THE SEWER. NO DOWNSPOUTS OR STORM DRAINAGE MAY BE CONNECTED, EXCEPT TO A SEPARATE STORM DRAINAGE SYSTEM.
 2. 2'-6" MIN DISTANCE FROM HOUSE, EXCEPT FOR SOIL PIPE CONNECTION.
 3. 1'-6" MIN COVER OF PIPE.
 4. 2'-6" MIN COVER AT PROPERTY LINE.
 5. 5'-0" MIN COVER AT CURB LINE.
 6. LAY PIPE IN STRAIGHT LINE BETWEEN BENDS. MAKE ALL CHANGES IN GRADE OR LINE WITH BENDS OR WYES.
 7. STANDARD 4" TO 6" INCREASER.
 8. 6" SEWER PIPE: MIN SIZE IN STREET, AND ELSEWHERE AS DIRECTED. 2% MIN GRADE, 100% MAX.
 9. 4" SEWER PIPE: MIN SIZE ON PROPERTY. 2% MIN GRADE, 100% (45°) MAX.
 10. TEST "T" WITH PLUG
 11. REMOVABLE PLUG.
- A. CONSTRUCTION IN STREET MUST BE DONE BY A LICENSED SIDE SEWER CONTRACTOR.
 B. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH CURRENT SIDE SEWER ORDINANCES.
 C. ALL CONSTRUCTION REQUIRES A PERMIT AND PAYMENT OF FEE. COMPLETE LEGAL DESCRIPTIONS OF PROPERTY AND DIMENSIONS A, B, C AND D THAT SHOW THE SIZE AND LOCATION OF THE HOUSE ARE REQUIRED FOR ISSUANCE OF THE PERMIT.
 D. ORDINANCE 97016 APPLIES TO INSTALLATION OF SIDE SEWER.


REF STD SPEC SEC 7-18



City of Seattle

NOT TO SCALE

SIDE SEWER INSTALLATION

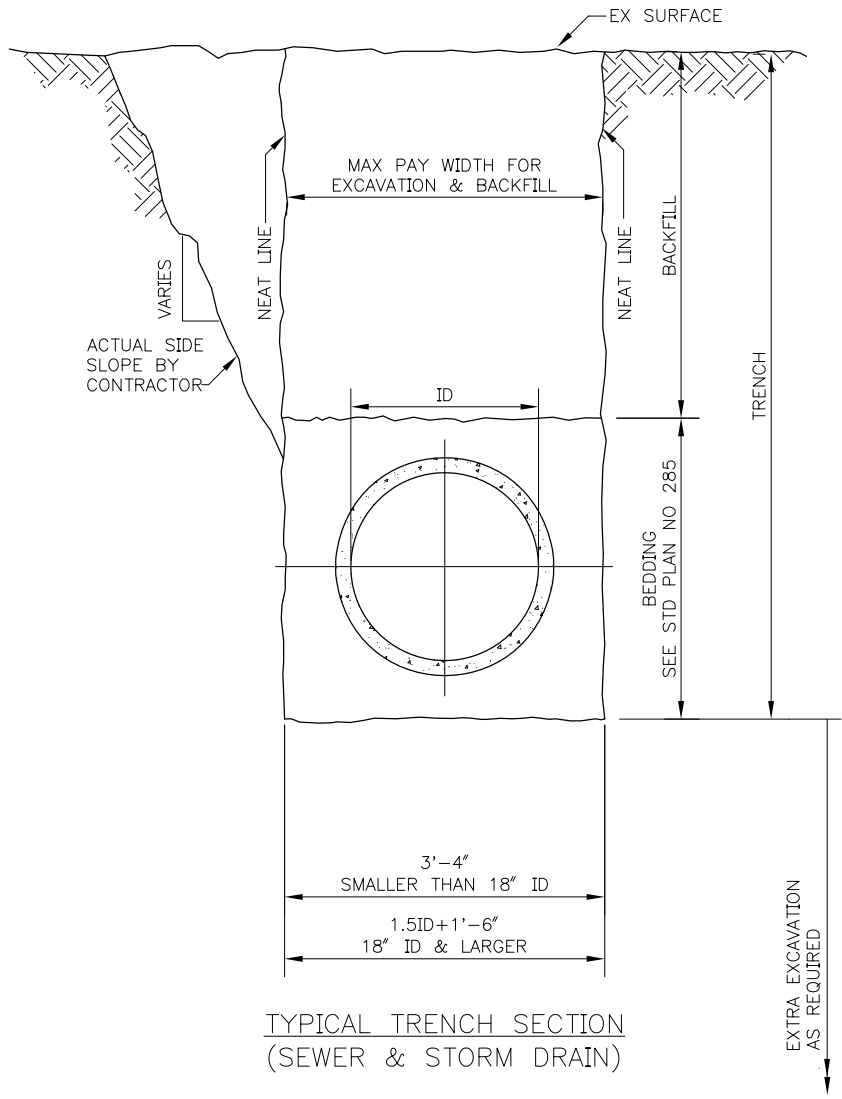

TYPICAL TRENCH SECTION
(SEWER & STORM DRAIN)

NOTE:
FOR PAVEMENT REMOVAL
AND RESTORATION SEE
STD PLAN NO 404

REF STD SPEC SEC 7-17




NOT TO SCALE


TYPICAL SEWER TRENCH SECTION

STANDARD PLAN NO 285


REV DATE: 2003

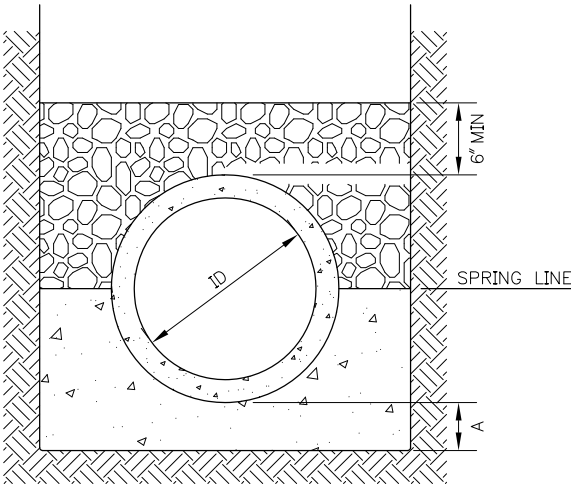


CLASS A BEDDING
(CONCRETE BEDDING)

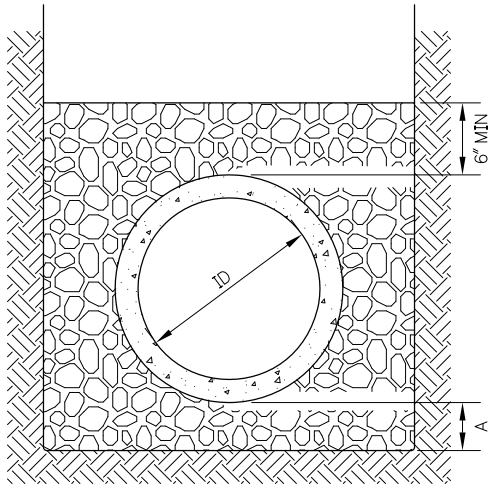




CLASS B BEDDING

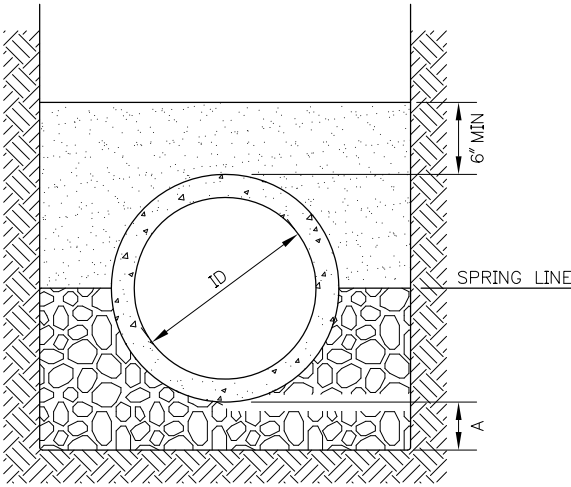

CLASS C BEDDING

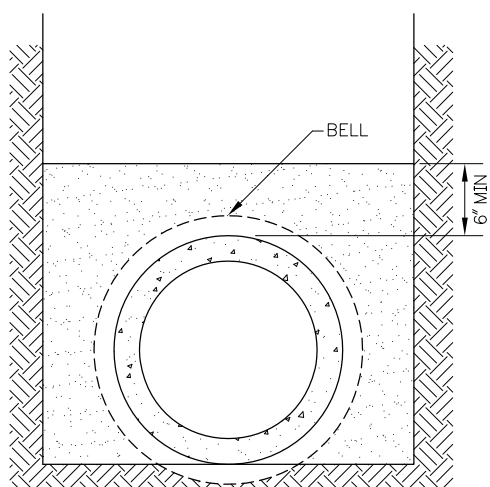

CLASS D BEDDING

-  MINERAL AGGREGATE PER STD SPEC 4-01
TYPE 9 FOR RIGID PIPE
TYPE 22 FOR FLEXIBLE PIPE
-  CONCRETE
(4 SACK MIN 1 1/2" MAX AGGREGATE)
-  SELECTED NATIVE MATERIAL

- NOTES:**
1. FOR TRENCH WIDTH SEE STD PLAN NO 284
 2. A=4" WHEN ID IS LESS THAN 2'-6"
 - A=6" WHEN ID IS 2'-6" OR MORE
 3. FOR CLASS D BEDDING EXCAVATE FOR BELL

REF STD SPEC SEC 7-17




NOT TO SCALE


PIPE BEDDING
SEWER / STORM DRAIN

NOTES


1. EXCEPTIONS TO STD PLAN NO. 286 SHALL BE APPROVED BY SEATTLE PUBLIC UTILITIES, WATER QUALITY DIVISION.
2. "SEWER" INCLUDES SANITARY SEWER, COMBINED SEWER AND SIDE SEWER.
3. WHERE MINIMUM CLEARANCES CANNOT BE MET, SEWER SHALL BE CONSTRUCTED OF MATERIALS AND WITH JOINTS THAT ARE EQUIVALENT TO WATER MAIN STANDARDS INCLUDING WATER MAIN PRESSURE TESTING REQUIREMENTS.
4. NO VERTICAL CLEARANCE REQUIRED.
5. IF MINIMUM VERTICAL SEPARATION CANNOT BE MET, WATER MAIN SHALL BE A STANDARD SINGLE 18'-0" NOMINAL LENGTH DUCTILE IRON WATER MAIN SECTION CENTERED AT THE POINT OF CROSSING.
6. SEWER SHALL HAVE ADEQUATE FOUNDATION SUPPORT TO PREVENT SETTLEMENT ON THE WATER MAIN AND TO PREVENT DEFLECTION OF WATER MAIN JOINTS.
7. CROSSINGS AT AN ANGLE BETWEEN 90° AND 45° MAY OCCUR BETWEEN 9'-0" AND 6'-0" OF WATER MAIN JOINT. FOR CROSSINGS LESS THAN 45°, SEE NOTE 1.
8. ORDINANCE 97016 APPLIES TO SIDE SEWERS.

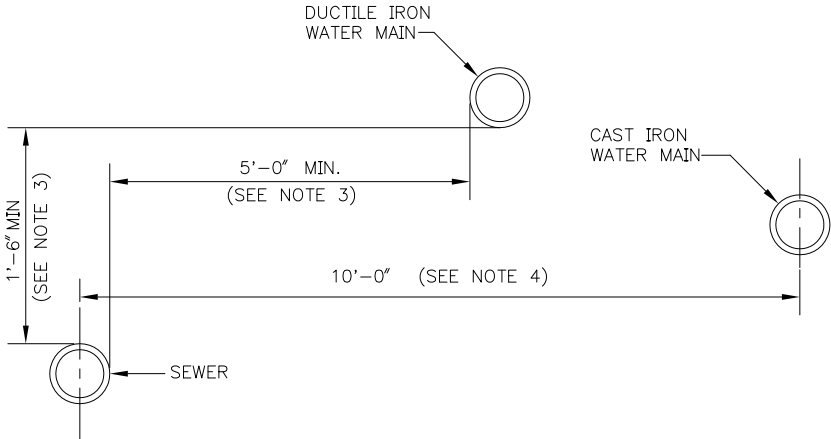

PARALLEL INSTALLATION

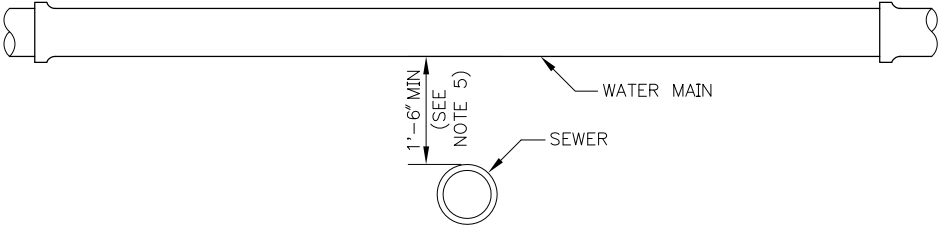

CROSSING WATER OVER SEWER

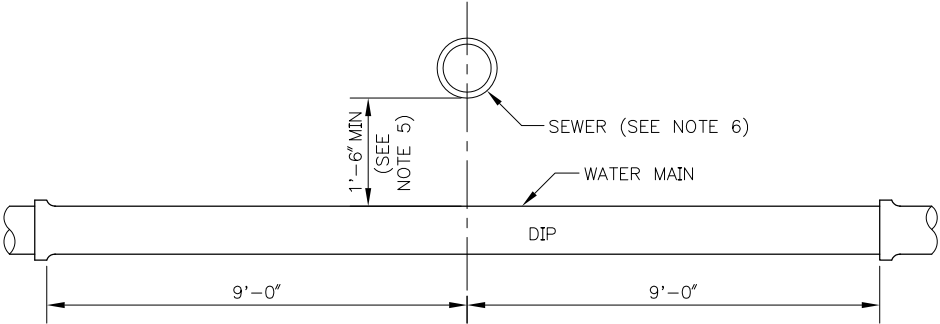

STANDARD SINGLE 18'-0" NOMINAL LENGTH DUCTILE IRON WATER MAIN SECTION CENTERED AT THE POINT OF CROSSING

CROSSING WATER UNDER SEWER

REF STD SPEC SEC 1-07.17 & 7-11




City of Seattle

NOT TO SCALE

SEWER & WATER
SPACING & CLEARANCES

STANDARD PLAN NO 286b

REV DATE: 2003

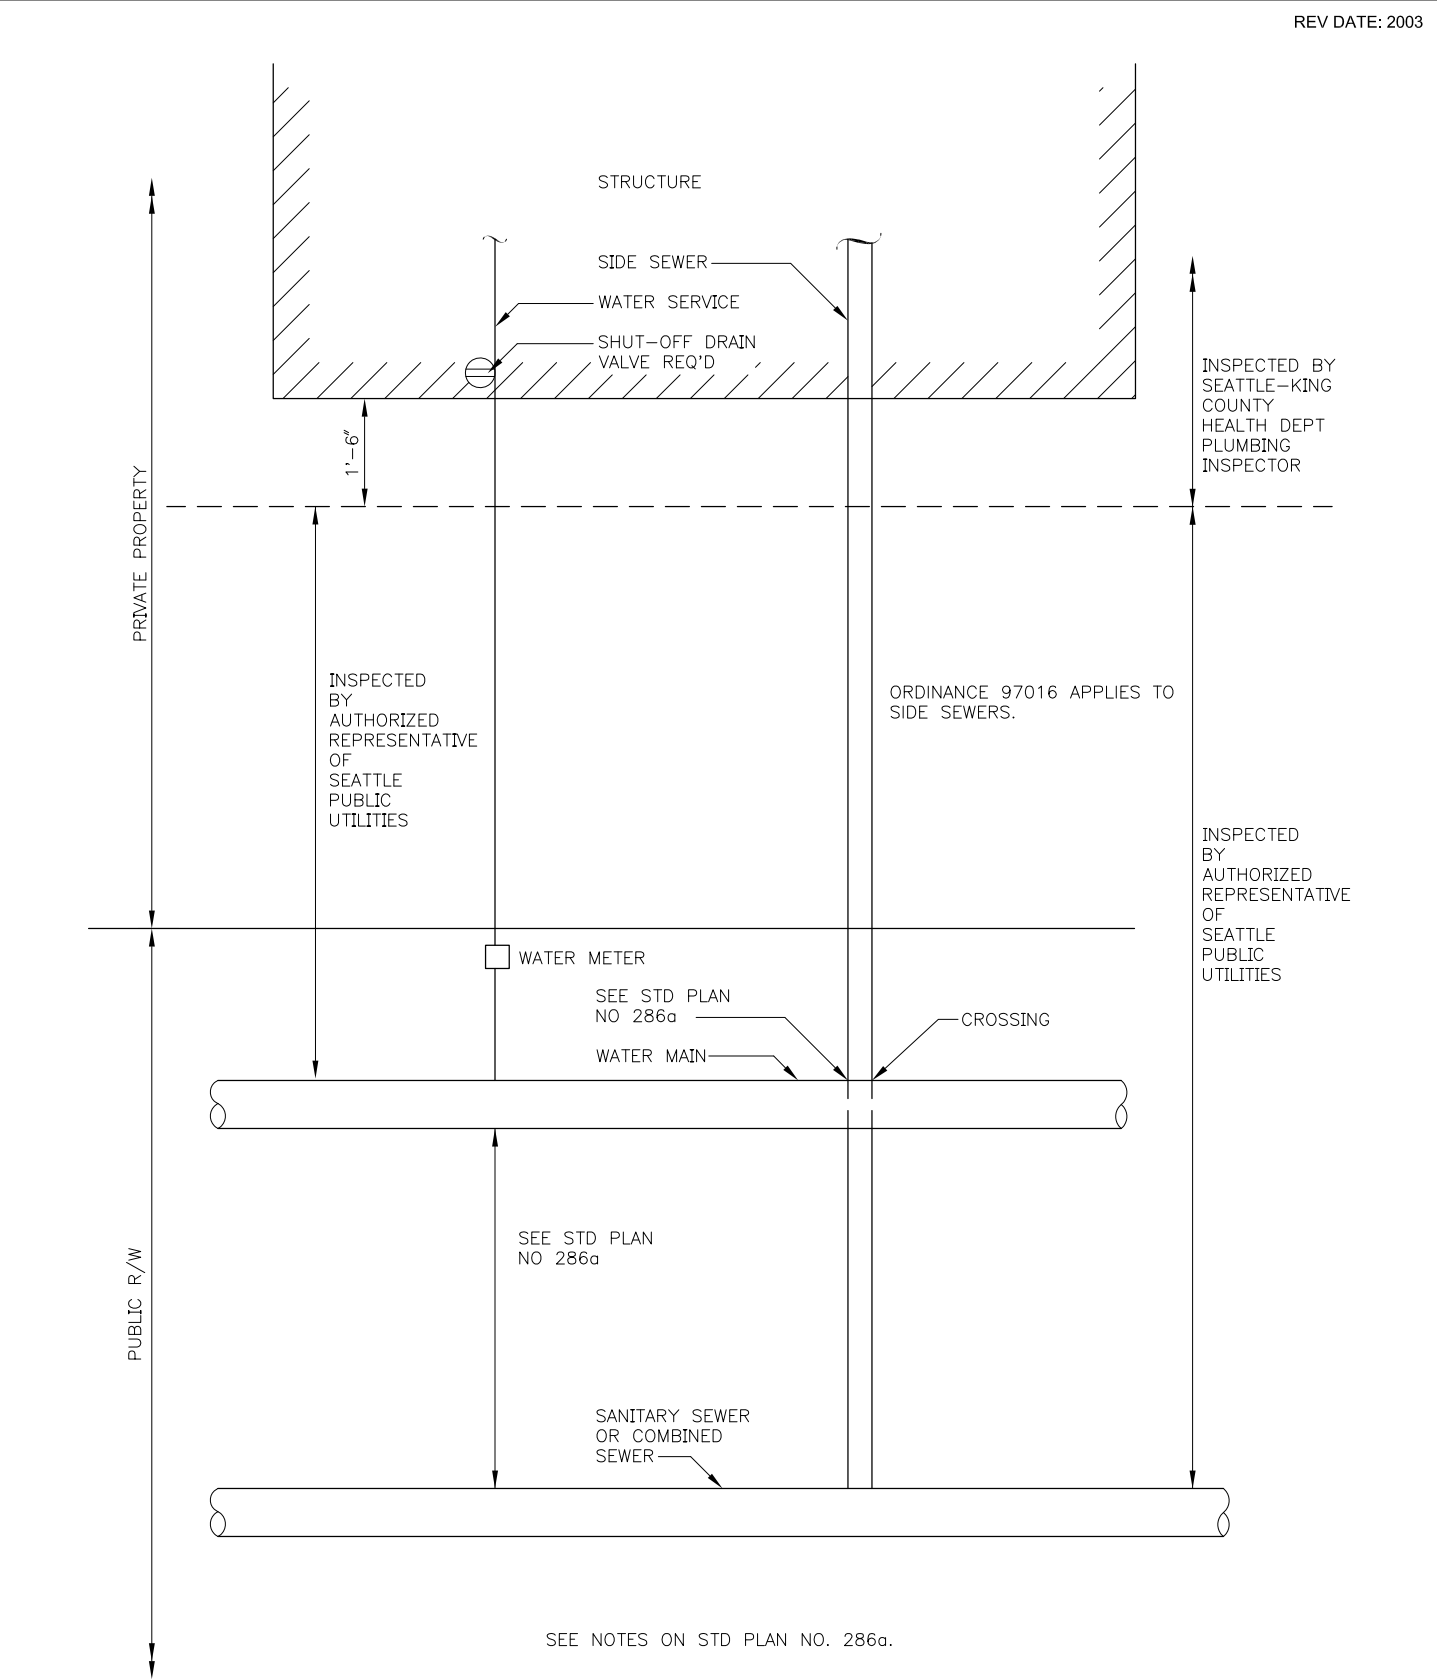


REF STD SPEC SEC 1-07.17 & DIV 7




NOT TO SCALE


SEWER & WATER SPACING & CLEARANCES

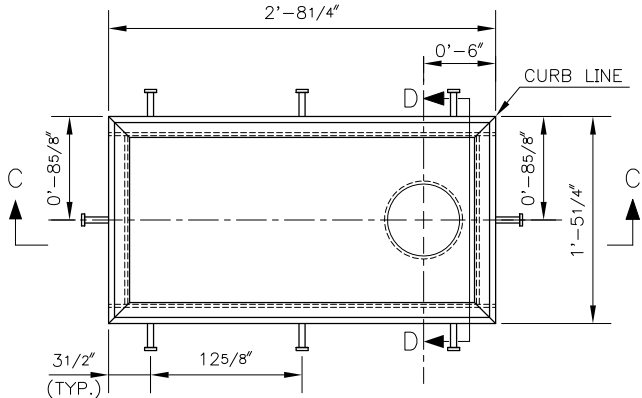

PLAN VIEW - BRIDGE DRAIN

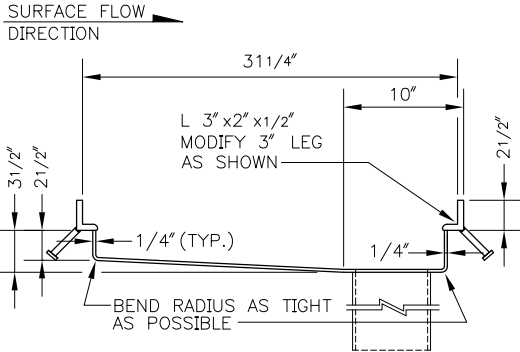

SECTION C-C

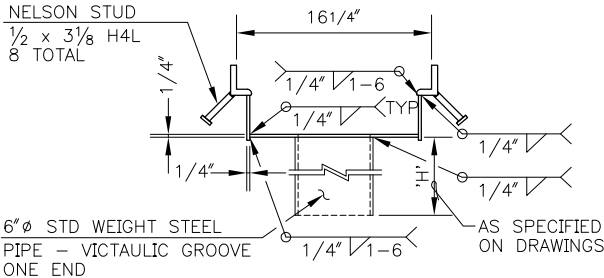

SECTION D-D

- NOTES:
1. ALL 1/4" STEEL & L3" x 2" x 1/2" TO BE A-36.
 2. 6" Ø PIPE TO BE STANDARD WEIGHT STEEL.
 3. AFTER FABRICATION, DRAIN ASSEMBLY TO BE HOT DIP GALVANIZED.
 4. VANED GRATE TO BE PER STD PLAN NO 265.

REF STD SPEC SEC 6-01 & 6-02





City of Seattle

NOT TO SCALE


BRIDGE DRAIN

STANDARD PLAN NO 300a

REV DATE: 2003

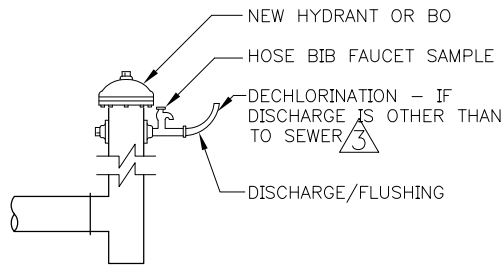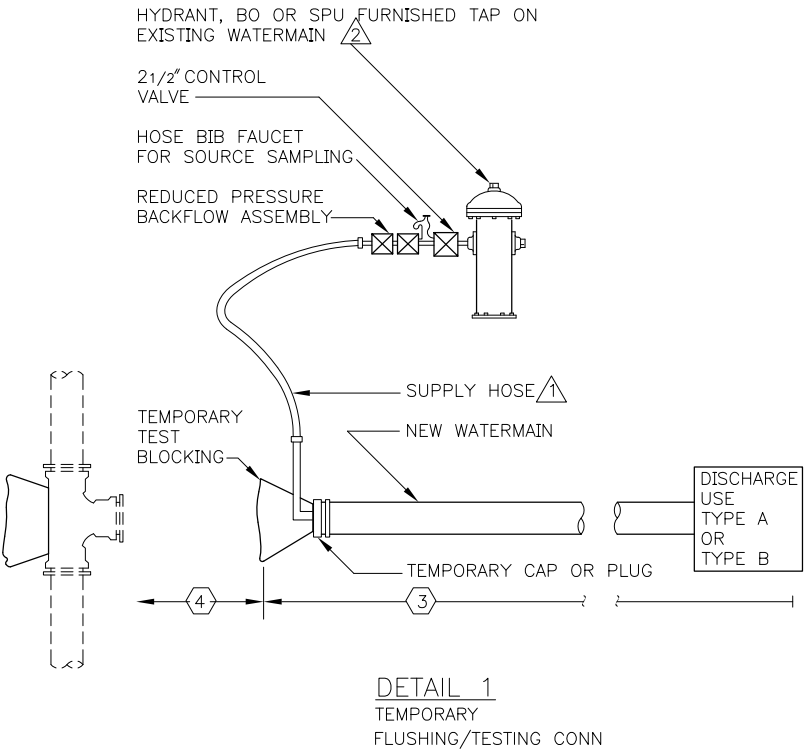

TYPE A

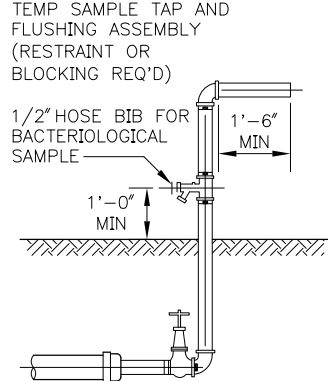

TYPE B

DETAIL 1
TEMPORARY
FLUSHING/TESTING CONN

NOTES

1. ALL FITTINGS SHALL BE DUCTILE IRON
2. ALL EXCAVATION SHALL PROVIDE A MINIMUM OF 1'-0" CLEAR AROUND PIPE AND FITTINGS.
3. THESE PLANS ARE FOR DIP AND CIP WATERMAINS 12" OR SMALLER DIA OTHER SIZES AND TYPES SEE PROJECT DRAWINGS
4. REDUCED PRESSURE BACKFLOW ASSEMBLY (RPBA) SHALL BE INSTALLED AS A UNIT (TWO SHUT-OFF VALVES, RELIEF PORT, TWO CHECK VALVES AND FOUR TEST COCKS). WHEN RPBA IS CONNECTED TO HYDRANT AND THE HOSE BIB FAUCET SAMPLE THEY SHALL BE CAPPED WHEN NOT IN USE. ASSEMBLY SHALL BE TESTED WHEN INSTALLED BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER (BAT) AND A CURRENT TEST REPORT SHALL BE ON SITE. FOR INSTALLATION PROCEDURES CALL 684-3536.

LEGEND

- ▲ CLEAN & DISINFECTED POTABLE WATER HOSE ONLY. SIZE FLUSHING RISER PER TABLE IN STD SPEC SEC 7-11.3(12)
- ▲ HYDRANT PERMIT REQUIRED
- ▲ CHECK WITH SEWER UTILITY BEFORE DISCHARGE TO SEWERS
- ⬆ CONTRACTOR TO DETERMINE ALIGNMENT & GRADE OF EXISTING PIPE PRIOR TO INSTALLING NEW WATERMAIN. ENGINEER TO DETERMINE OUTSIDE DIAMETER OF EXISTING PIPE WHEN CONTRACTOR EXCAVATES TO DETERMINE ALIGNMENT & GRADE.
- ② ALL EXCAVATION, PIPE, FITTINGS (EXCEPT AS NOTED BELOW), OTHER MATERIAL, BEDDING, BACKFILL, COMPACTION & STREET RESTORATION BY CONTRACTOR. ALL MATERIALS SHALL BE ON JOB SITE PRIOR TO SHUTDOWN OF EXISTING MAIN.
- ③ INSTALLED BY CONTRACTOR
- ④ CONNECTION PIPE: CONTRACTOR FURNISHED, INSTALLED BY SPU
- ⑤ WATERMAIN WITH PLAIN ENDS
- ⑥ MECHANICAL JOINT SLEEVE WITH SPACER CUT TO FIT GAP, FURNISHED AND INSERTED AT TIME OF CONNECTION BY SPU
- ⑦ TAPPING SLEEVE & TAPPING VALVE FURNISHED AND INSTALLED BY SPU
- ⑧ APPLIES TO PIPES 4" THROUGH 12". ALL LARGER SIZES TO BE ADDRESSED ON DRAWINGS
- ⑨ MECHANICAL JOINT SLEEVE, FURNISHED BY CONTRACTOR AND INSTALLED BY SPU, SPACERS BY SPU WHERE REQUIRED

REF STD SPEC SEC 7-11




NOT TO SCALE

CONNECTIONS TO EXISTING WATERMAINS

ELEVATION


PLAN

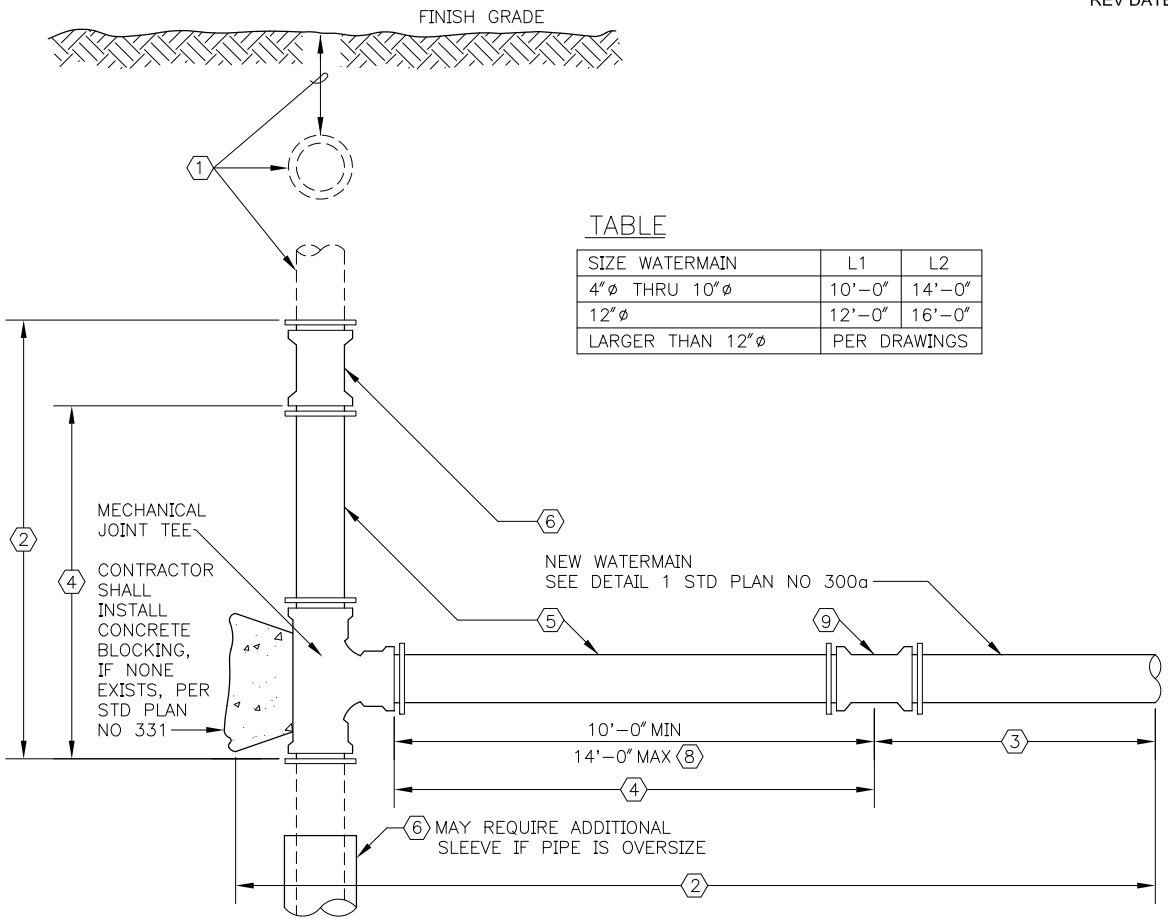

CONNECTIONS TO EXISTING MAIN, WITH A NEW TEE OR CROSS (CUT IN NEW TEE)

ELEVATION

PLAN

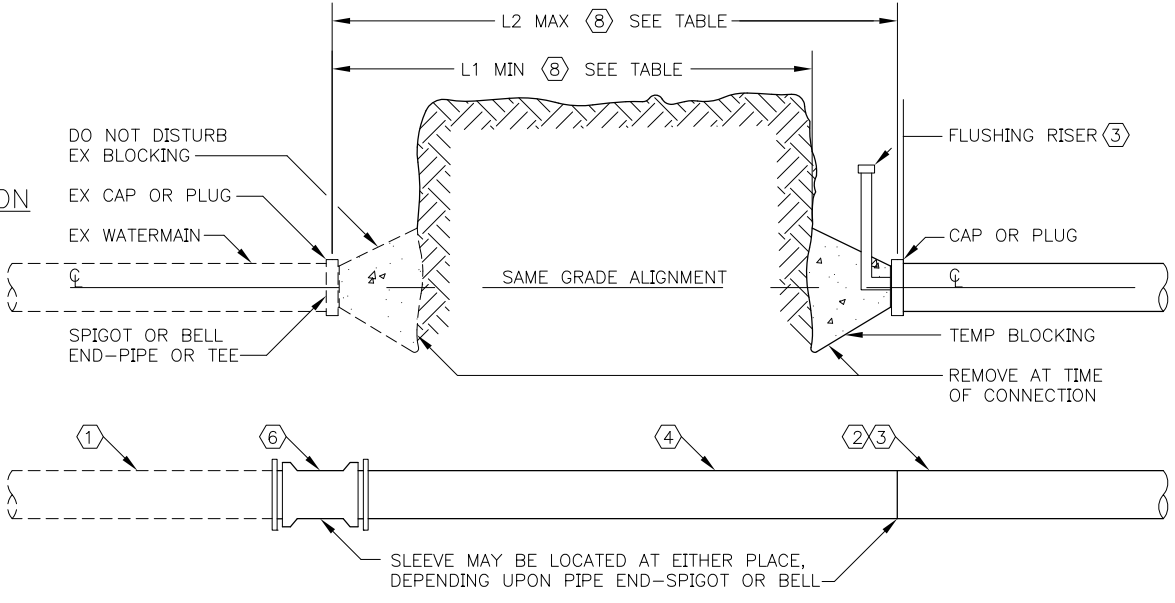

CONNECTIONS TO EXISTING MAIN, STUB OR END OUTLET OF TEE OR CROSS

REF STD SPEC SEC 7-11

FOR LEGEND AND NOTES SEE STD PLAN NO 300a





City of Seattle

NOT TO SCALE

CONNECTIONS TO EXISTING WATERMAINS

STANDARD PLAN NO 300c


REV DATE: 2003

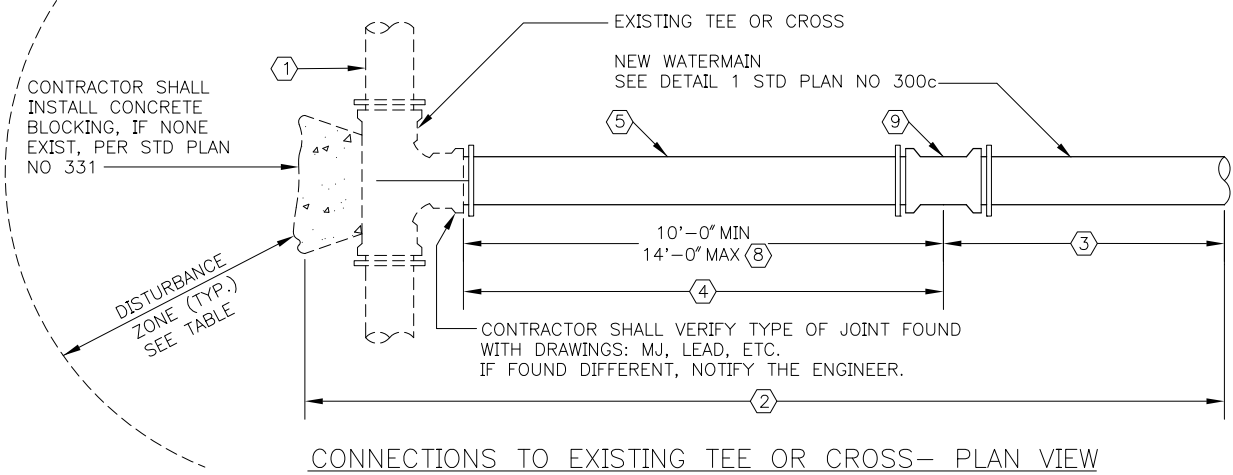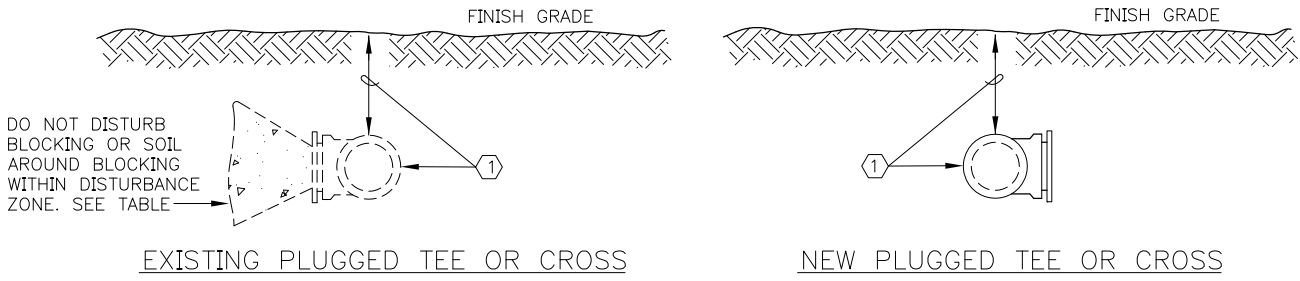

TABLE

SIZE WATERMAIN	DISTURBANCE ZONE
UP TO & INCLUDING 10" ϕ	10'-0"
OVER 10" ϕ	12'-0"

* SPU MAY INCREASE DISTURBANCE ZONE. SEE CONTRACT DOCUMENTS

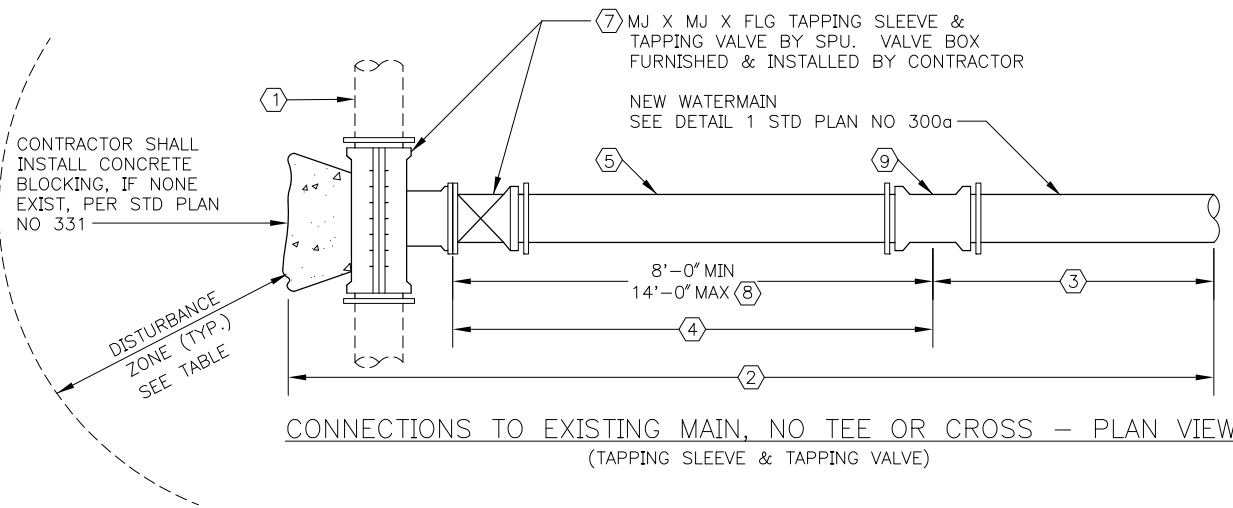

REF STD SPEC SEC 7-11

FOR LEGEND AND NOTES SEE STD PLAN NO 300a




City of Seattle

NOT TO SCALE

CONNECTIONS TO EXISTING WATERMAINS

STANDARD PLAN NO 310a

REV DATE: 2003

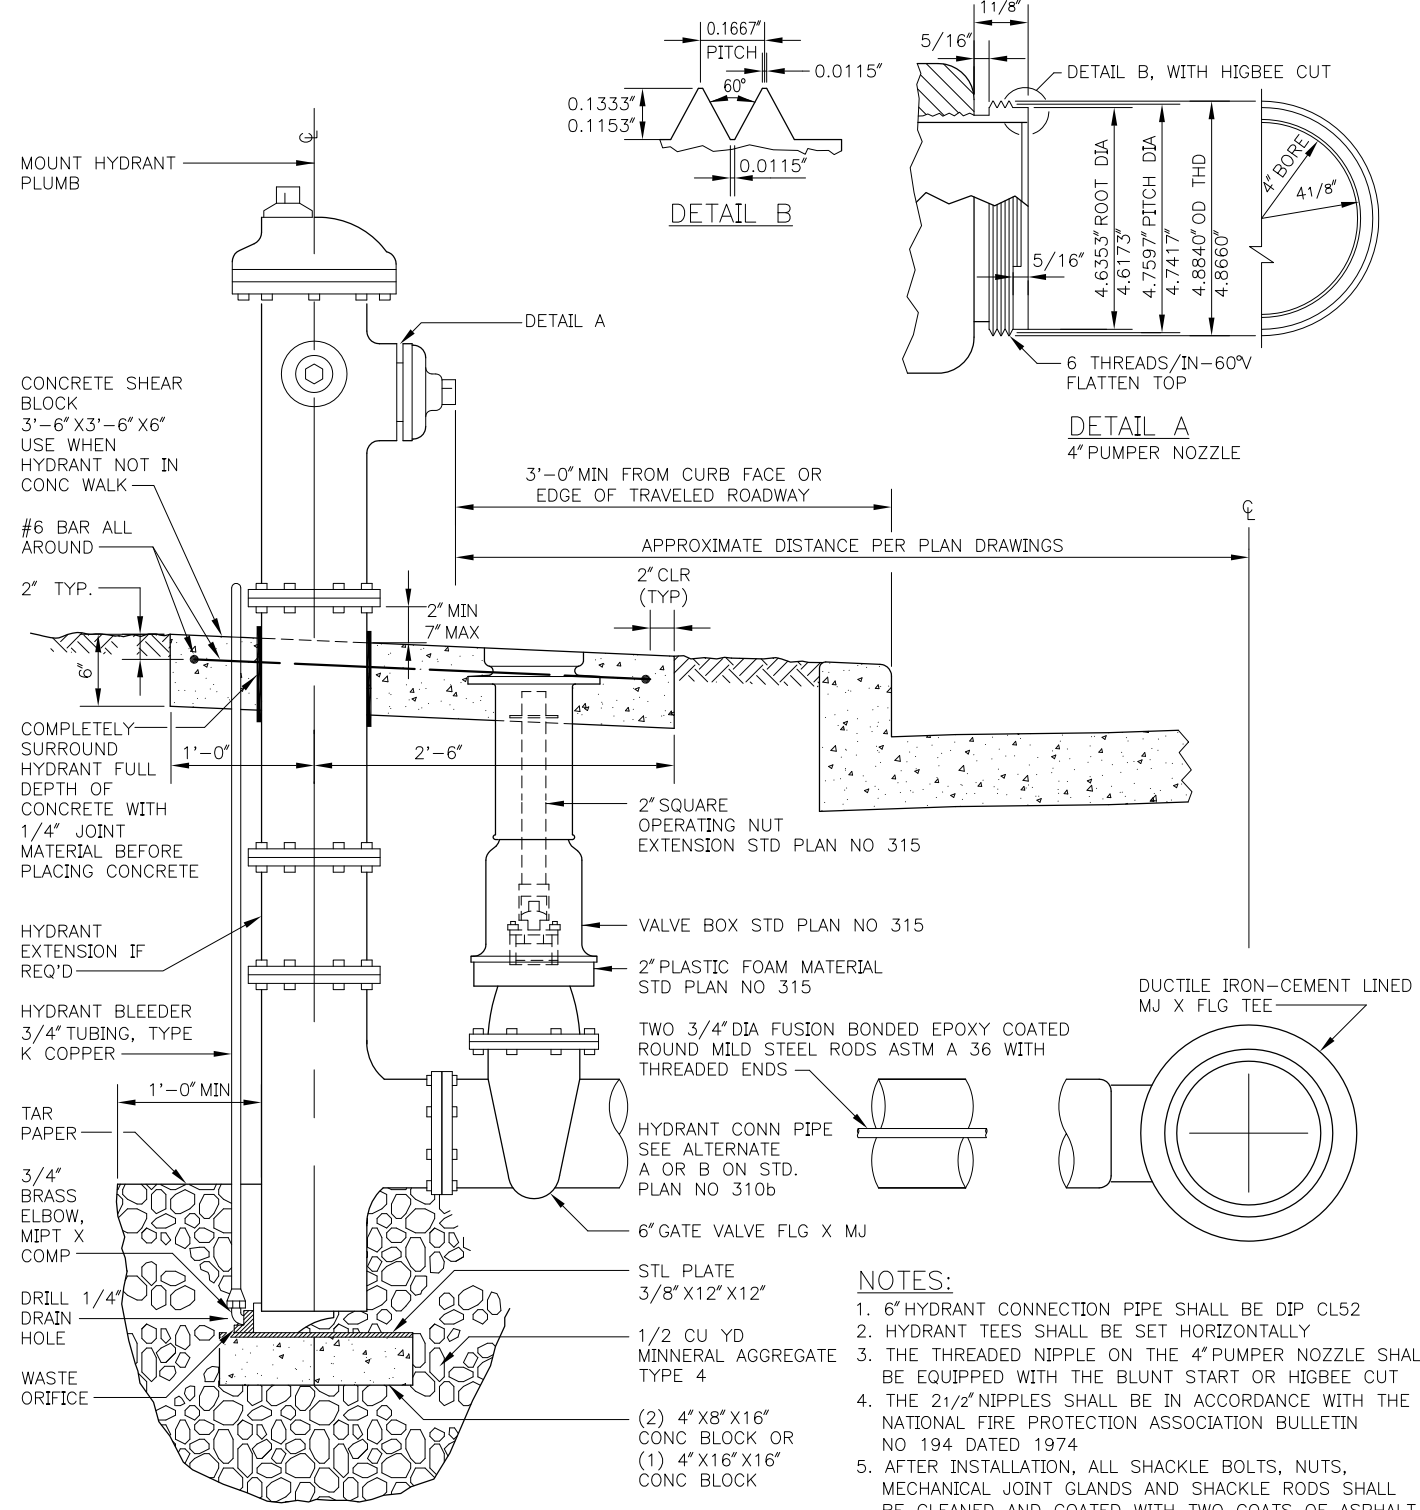

HYDRANT DETAIL

- NOTES:**
1. 6" HYDRANT CONNECTION PIPE SHALL BE DIP CL52
 2. HYDRANT TEES SHALL BE SET HORIZONTALLY
 3. THE THREADED NIPPLE ON THE 4" PUMPER NOZZLE SHALL BE EQUIPPED WITH THE BLUNT START OR HIGBEE CUT
 4. THE 2 1/2" NIPPLES SHALL BE IN ACCORDANCE WITH THE NATIONAL FIRE PROTECTION ASSOCIATION BULLETIN NO 194 DATED 1974
 5. AFTER INSTALLATION, ALL SHACKLE BOLTS, NUTS, MECHANICAL JOINT GLANDS AND SHACKLE RODS SHALL BE CLEANED AND COATED WITH TWO COATS OF ASPHALT, ROYSTON ROSKOTE #612XM
 6. AFTER BACKFILLING, THE OUTSIDE OF THE HYDRANT (ABOVE THE GROUND LINE) SHALL BE THOROUGHLY CLEANED AND PAINTED WITH ONE COAT OF KELLY-MOORE LUXLITE 43-616 CAT YELLOW
 7. PUMPER PORT TO FACE CURB



REF STD SPEC SEC 7-14




City of Seattle

NOT TO SCALE

TYPE 310 HYDRANT SETTING DETAIL

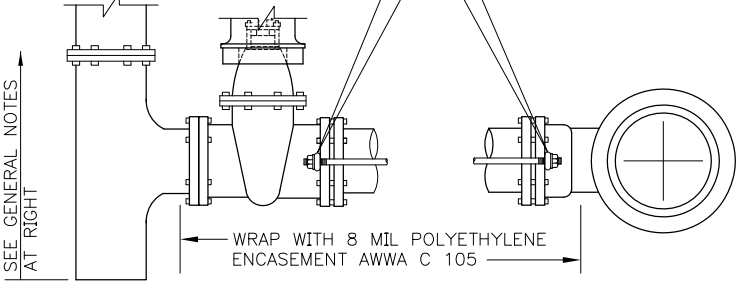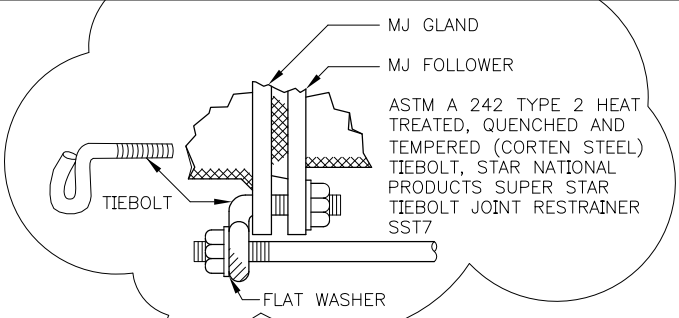



ALTERNATE A
TIEBOLT RESTRAINT

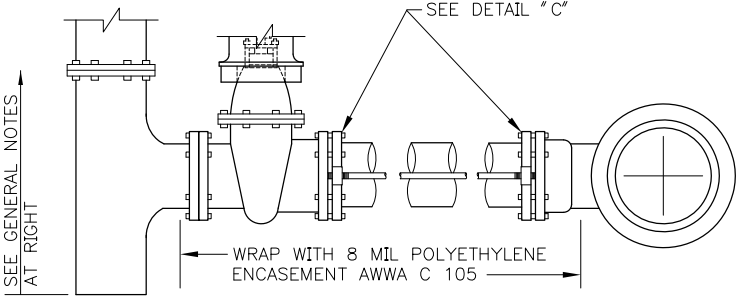


ALTERNATE B
MECHANICAL JOINT GLAND W/LUGS

GENERAL NOTES:


1. WHERE WATERMANS ARE INSTALLED WITH POLYETHYLENE ENCASEMENT OR TAPE COATINGS, THE HYDRANT BARREL AND VALVE SHALL BE SIMILARLY ENCASED, COATED AND/OR JOINTS BONDED. WHERE WATERMAIN IS THERMOPLASTIC COATED, THE HYDRANT BARRIER SHALL BE TAPE COATED
2. WHERE 6" GATE VALVE IS TO BE LOCATED WITHIN A PARKING-PERMITTED AREA, A SECOND 6" GATE VALVE SHALL BE INSTALLED AT THE HYDRANT ASSEMBLY PER STD PLAN NO 310a

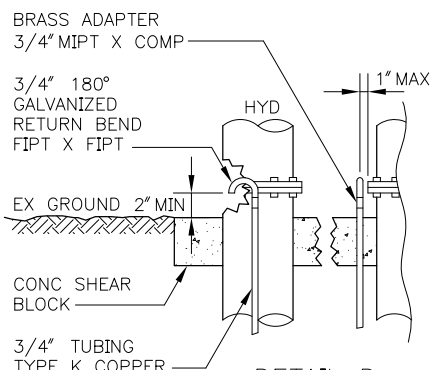

DETAIL D
HYDRANT BLEEDER

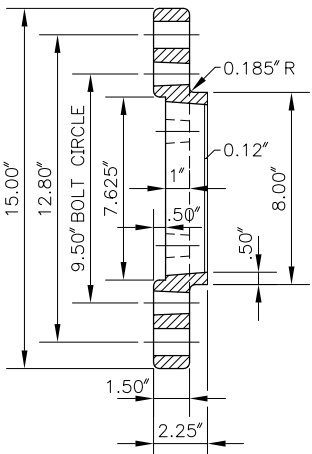

SECTION A-A

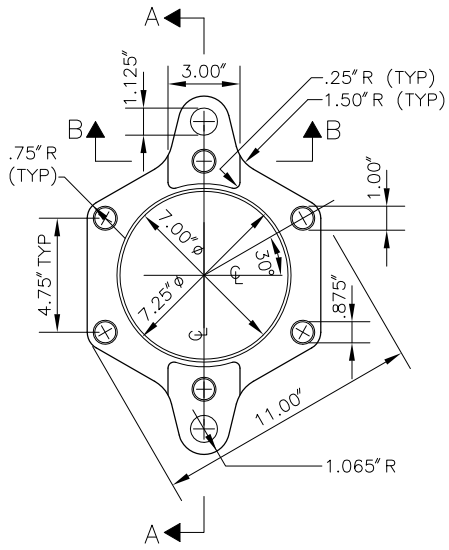

DETAIL C
6" MECHANICAL JOINT GLAND W/ LUGS

DETAIL C NOTES:

1. TO BE CAST OF DUCTILE IRON IN CONFORMANCE WITH ASTM A 536 CLASS 80-55-06
2. AFTER CLEANING, THE CASTING SHALL BE HOT DIPPED IN ASPHALTIC VARNISH, ROYSTON ROSKOTE #612XM
3. TOLERANCES PER DIPRA HANDBOOK

REF STD SPEC SEC 7-14




City of Seattle

NOT TO SCALE

TYPE 310 HYDRANT SETTING DETAIL

STANDARD PLAN NO 311a

REV DATE: 2003

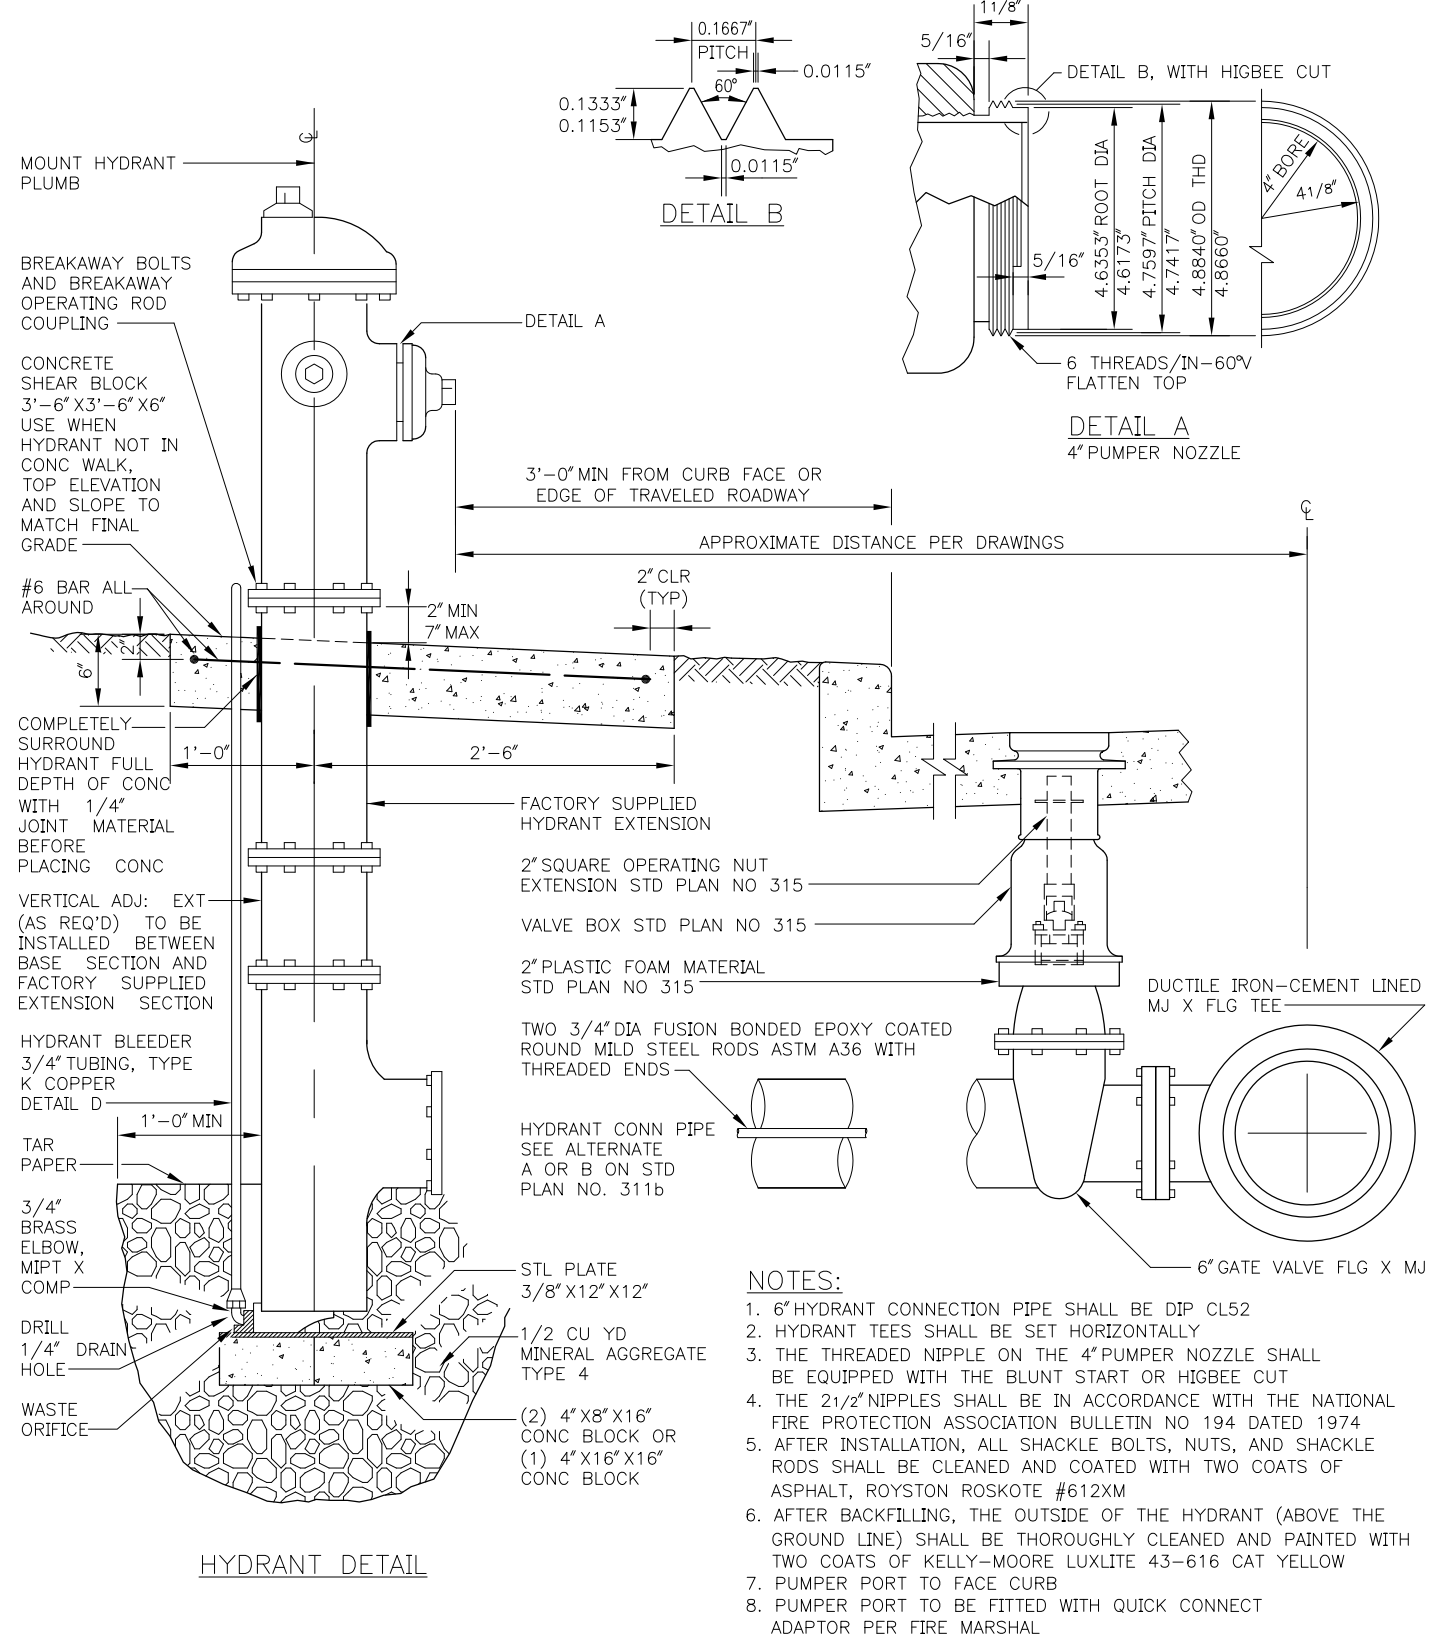

HYDRANT DETAIL


- NOTES:**
- 6" HYDRANT CONNECTION PIPE SHALL BE DIP CL52
 - HYDRANT TEES SHALL BE SET HORIZONTALLY
 - THE THREADED NIPPLE ON THE 4" PUMPER NOZZLE SHALL BE EQUIPPED WITH THE BLUNT START OR HIGBEE CUT
 - THE 2 1/2" NIPPLES SHALL BE IN ACCORDANCE WITH THE NATIONAL FIRE PROTECTION ASSOCIATION BULLETIN NO 194 DATED 1974
 - AFTER INSTALLATION, ALL SHACKLE BOLTS, NUTS, AND SHACKLE RODS SHALL BE CLEANED AND COATED WITH TWO COATS OF ASPHALT, ROYSTON ROSKOTE #612XM
 - AFTER BACKFILLING, THE OUTSIDE OF THE HYDRANT (ABOVE THE GROUND LINE) SHALL BE THOROUGHLY CLEANED AND PAINTED WITH TWO COATS OF KELLY-MOORE LUXLITE 43-616 CAT YELLOW
 - PUMPER PORT TO FACE CURB
 - PUMPER PORT TO BE FITTED WITH QUICK CONNECT ADAPTOR PER FIRE MARSHAL

REF STD SPEC SEC 7-14




NOT TO SCALE

TYPE 311 HYDRANT SETTING DETAIL

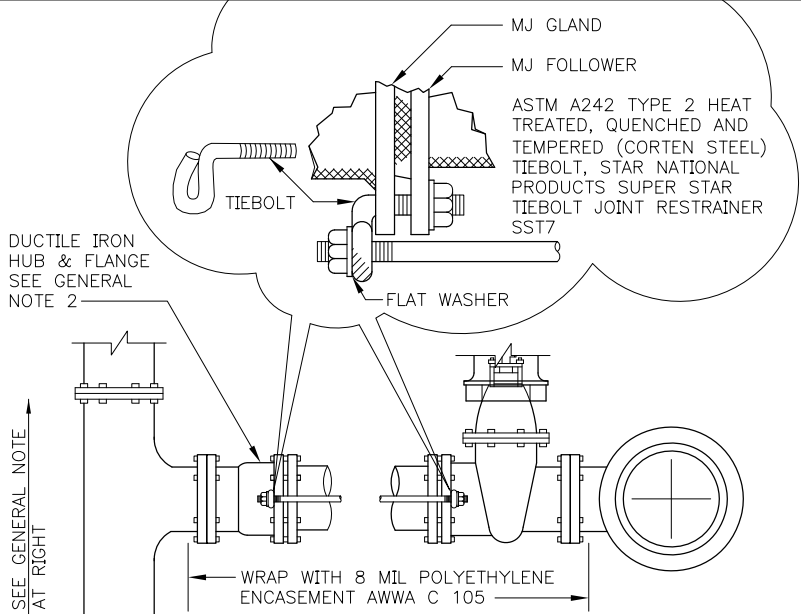





ALTERNATE A
TIEBOLT RESTRAINT

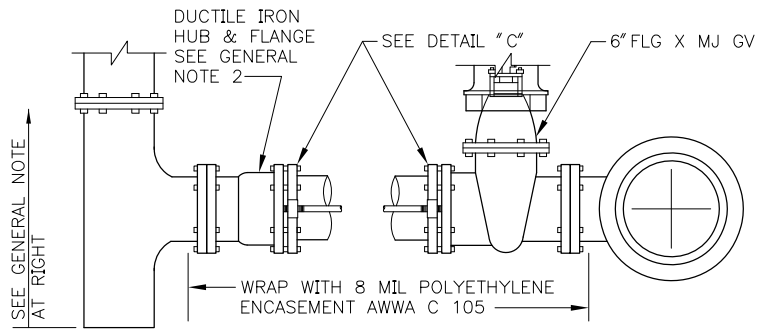

ALTERNATE B
MECHANICAL JOINT GLAND W/LUGS

GENERAL NOTES:

1. WHERE WATERMANS ARE INSTALLED WITH POLYETHYLENE ENCASEMENT OR TAPE COATINGS, THE HYDRANT BARREL AND VALVE SHALL BE SIMILARLY ENCASED, COATED AND/OR JOINTS BONDED. WHERE WATERMAIN IS THERMOPLASTIC COATED, THE HYDRANT BARREL SHALL BE TAPE COATED
2. WHERE 6" GATE VALVE IS TO BE LOCATED WITHIN A PARKING-PERMITTED AREA, A SECOND 6" GATE VALVE SHALL BE INSTALLED AT THE HYDRANT ASSEMBLY PER STD PLAN NO 310a

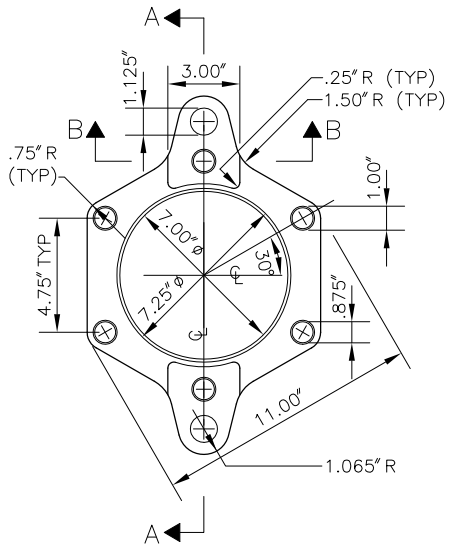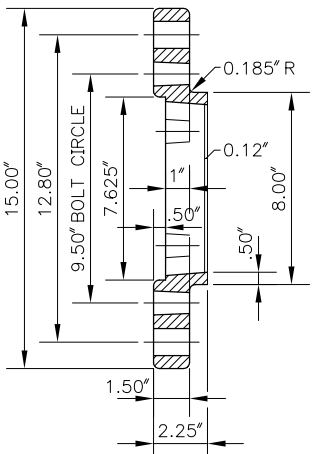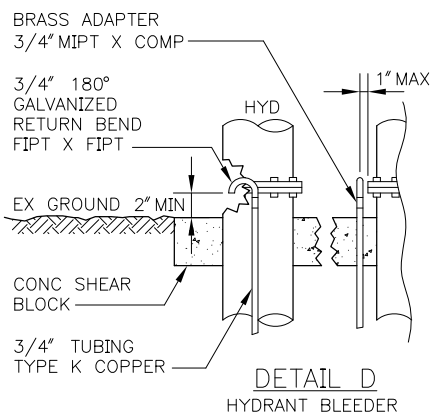

DETAIL C NOTES:

1. TO BE CAST OF DUCTILE IRON IN CONFORMANCE WITH ASTM A 536 CLASS 80-55-06
2. AFTER CLEANING, THE CASTING SHALL BE HOT DIPPED IN ASPHALTIC VARNISH, ROYSTON ROSKOTE #612XM
3. TOLERANCES PER DIPRA HANDBOOK



REF STD SPEC SEC 7-14



City of Seattle

NOT TO SCALE


TYPE 311 HYDRANT SETTING DETAIL

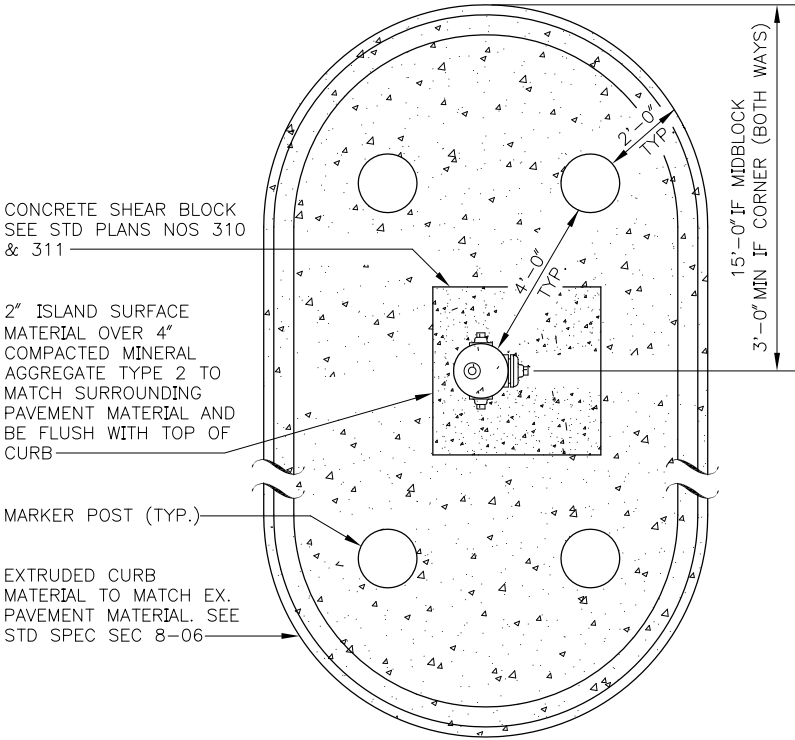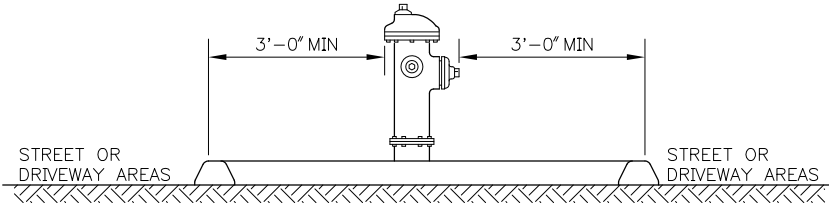

TRAFFIC ISLAND MARKER POST LAYOUT FOR FIRE HYDRANTS IN PARKING AREAS

NOTES

1. LAYOUT OF MARKER POST SHALL BE VERIFIED FIRST WITH SPU AND SEATRAN
2. MARKER POST WITH HIGH INTENSITY REFLECTORIZED BANDS PROVIDED BY SPU

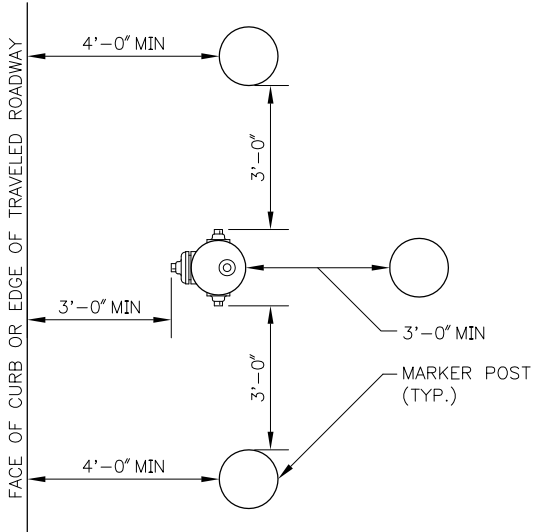

MARKER POST LAYOUT FOR FIRE HYDRANTS IN PARKING AREAS

REF STD SPEC SEC 7-14




City of Seattle

NOT TO SCALE


FIRE HYDRANT MARKER LAYOUT

STANDARD PLAN NO 313

REV DATE: 2003

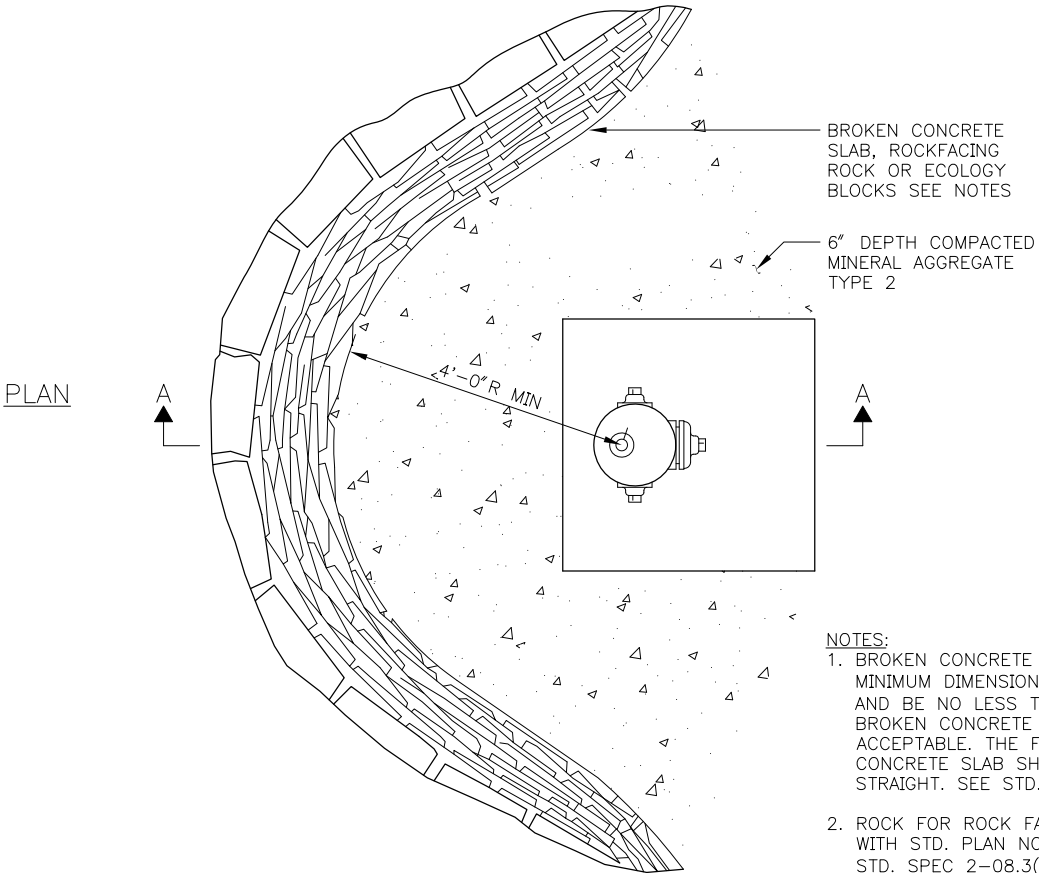

- NOTES:
1. BROKEN CONCRETE SLABS SHALL HAVE MINIMUM DIMENSIONS OF 3'-0" x 1'-6" AND BE NO LESS THAN 3 1/2" THICK. BROKEN CONCRETE SIDEWALK IS ACCEPTABLE. THE FACE SIDE OF CONCRETE SLAB SHALL BE STRAIGHT. SEE STD. SPEC SEC 8-15.3(5)A
 2. ROCK FOR ROCK FACING SHALL COMPLY WITH STD. PLAN NO. 141 SEE STD. SPEC 2-08.3(5)

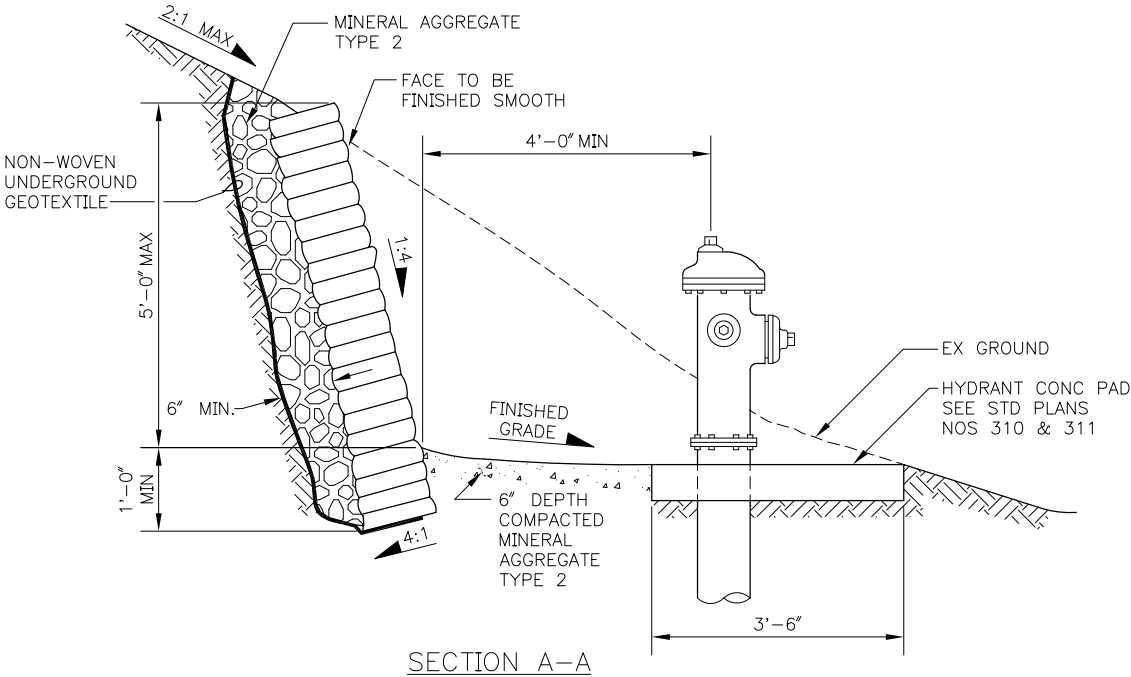

REF STD SPEC SEC 2-08, 7-14 & 8-15



NOT TO SCALE

WALL REQUIREMENTS FOR HYDRANTS

STANDARD PLAN NO 314

REV DATE: 2003

3'-0" MIN, 15'-0" MAX ON CORNERS
7'-0" MAX MIDBLOCK

CURB OR EDGE OF TRAVELED PORTION OF ROADWAY

CORNER

R/W MARGIN

5'-0" STD
5'-0" MIN

DRIVEWAY

NOTES:

- 1. NO PARKING ZONE WITHIN 15'-0" RADIUS OF FIRE HYDRANT
- 2. MIN DISTANCE FROM BACK FACE OF HYDRANT TO FRONT EDGE OF CONCRETE WALK SHALL BE 2'-0"

R/W MARGIN

TREE

MID-BLOCK

5'-0" MIN

LOT LINE

3'-0" MIN (TYP) OTHERWISE EASEMENT IS REQUIRED

10'-0" MIN

SIDE SEWER

10'-0" STD N OR E


UTILITY POLE, GUARD POST, BUILDING WALL OR ANY OTHER FIXED STRUCTURE

3'-0" CLR MIN

5'-0" STD

R/W MARGIN

SEE DETAIL A

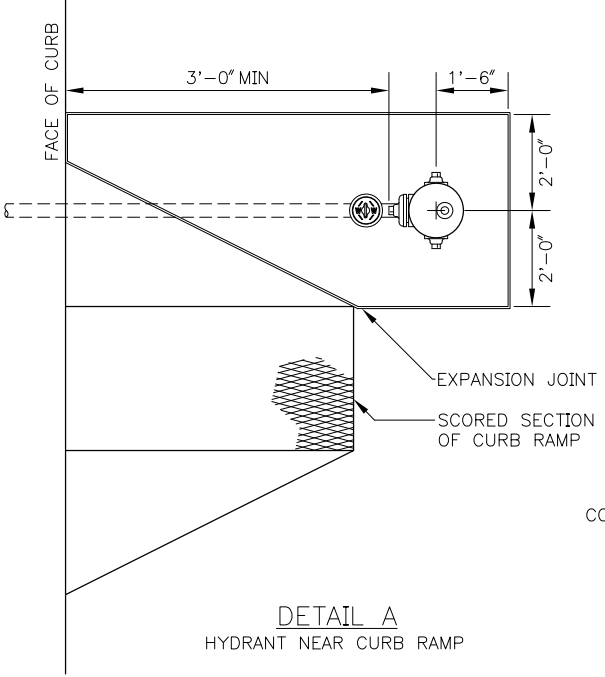

DETAIL A
HYDRANT NEAR CURB RAMP

CORNER

STREET

REF STD SPEC SEC 7-14





City of Seattle

NOT TO SCALE


FIRE HYDRANT LOCATIONS & CLEARANCES

STANDARD PLAN NO 315a

REV DATE: 2003

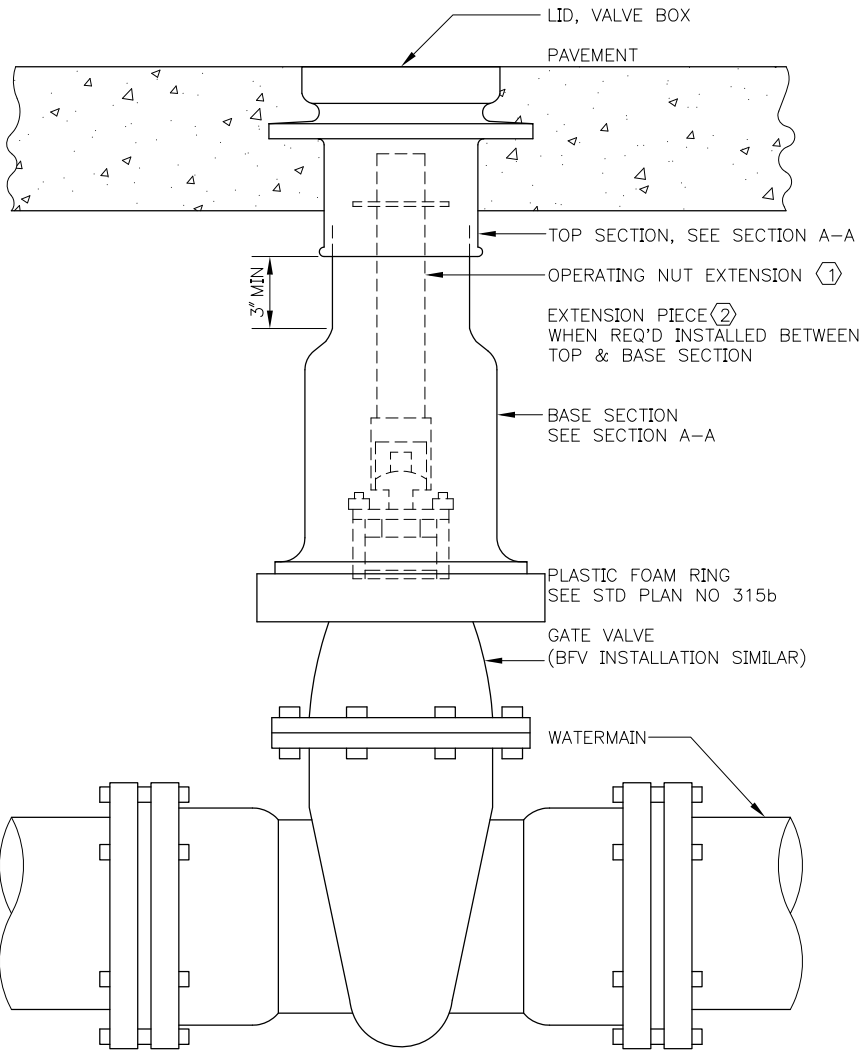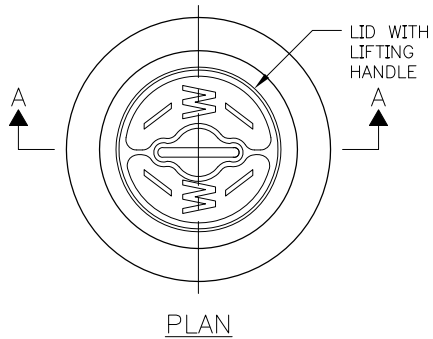

VALVE BOX ASSEMBLY
TYPICAL SETTING DETAIL

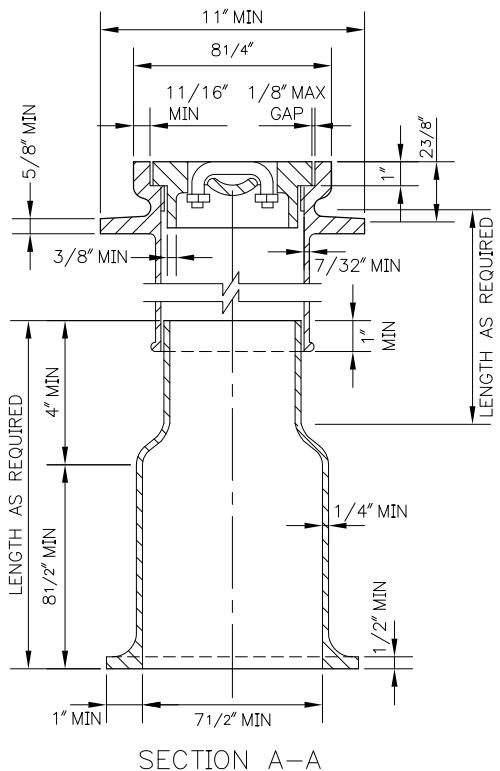

NOTE:
VALVE BOX FOR USE ON 12" OR
SMALLER VALVE INSTALLATIONS

REF STD SPEC SEC 7-12


FOR LEGEND (1) AND NOTES SEE STD PLAN NO 315b




City of Seattle

NOT TO SCALE


CAST IRON VALVE BOX &
OPERATING NUT EXTENSION

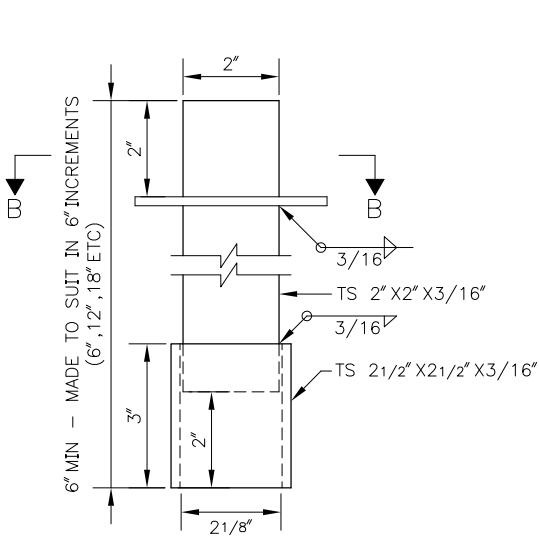


OPERATING NUT EXTENSION DETAIL 1

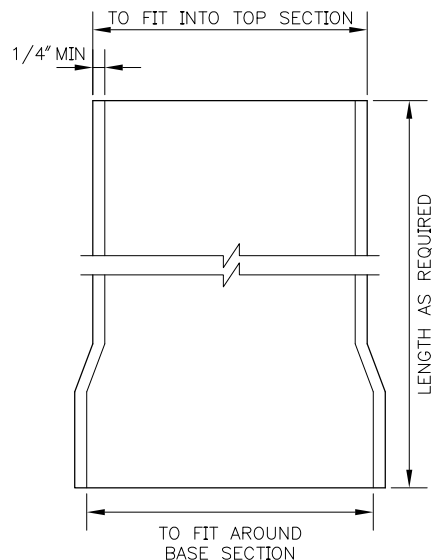

EXTENSION PIECE 2 WHEN REQUIRED

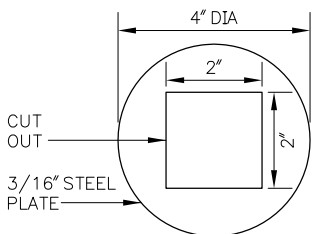

SECTION B-B

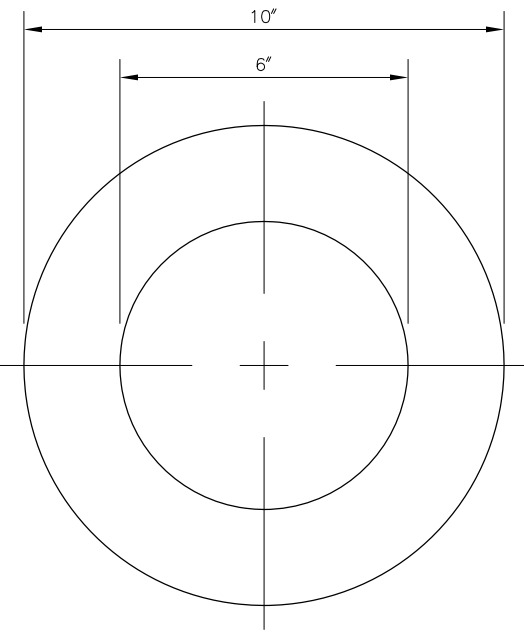

PLASTIC FOAM RING DETAIL

NOTES:

1. FRAME AND COVER SHALL BE TESTED FOR ACCURACY OF FIT AND SHALL BE MARKED IN SETS FOR DELIVERY
2. CASTINGS AND EXTENSIONS SHALL BE HOT-DIPPED IN ASPHALTIC VARNISH ROYSTON ROSKOTE #612XM OR 2 COATS OF MASTIC ROYSTON INSIDE AND OUT.
3. VALVE BOXES SHALL BE RICH #045: TOP SECTION, LID AND BASE; OR OLYMPIC FOUNDRY: LID #1908-33, TOP SECTION #1106-33, BASE SECTION #1301-33
4. ALL CASTINGS SHALL BE DUCTILE OR GREY CAST IRON

LEGEND:

- 1 AN OPERATING NUT EXTENSION SHALL BE INSTALLED WHEN THE GROUND SURFACE IS MORE THAN 2'-6" ABOVE THE VALVE OPERATING NUT. THE OPERATING NUT EXTENSION SHALL EXTEND INTO THE TOP SECTION OF THE STANDARD VALVE BOX AND SHALL CLEAR THE BOTTOM OF THE LID BY 6" MIN
- 2 EXTENSION PIECES (WHEN USED) SHALL CONFORM TO MINIMUM THICKNESS REQUIREMENTS AND SHALL FIT INTO THE TOP SECTION AND OVER THE BOTTOM SECTION

REF STD SPEC SEC 7-12 & 9-30



City of Seattle

NOT TO SCALE



CAST IRON VALVE BOX & OPERATING NUT EXTENSIONS

STANDARD PLAN NO 330a

REV DATE: 2003

TYPE A BLOCKING
FOR 11 1/4° & 22 1/2° VERTICAL BENDS

PIPE SIZE NOM DIA INCHES	TEST PRESSURE PSI	VB VERTICAL BEND DEGREES	S NO OF CU FT OF CONC BLOCKING	d SIDE OF CUBE FEET	L DIA OF SHACKLE RODS (2) INCHES	DEPTH OF RODS IN CONCRETE INCHES
4"	300	11 1/4	8	2	3/4	18
		22 1/2	12	2 1/4		24
6"	300	11 1/4	12	2 1/4	3/4	24
		22 1/2	27	3		24
8"	300	11 1/4	16	2 1/2	3/4	24
		22 1/2	43	3 1/2		24
12"	300	11 1/4	64	4	-	24
		22 1/2	125	5		36

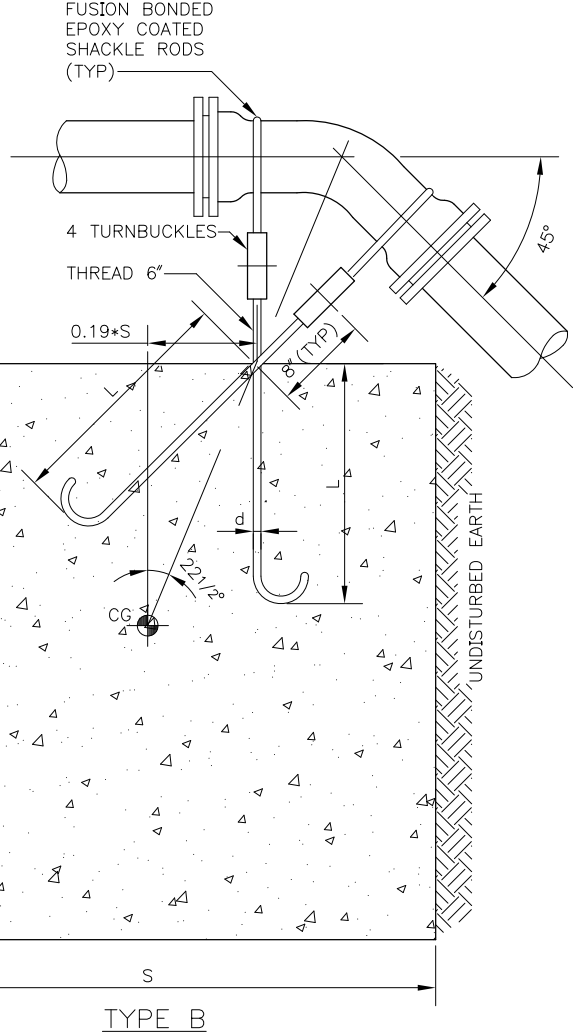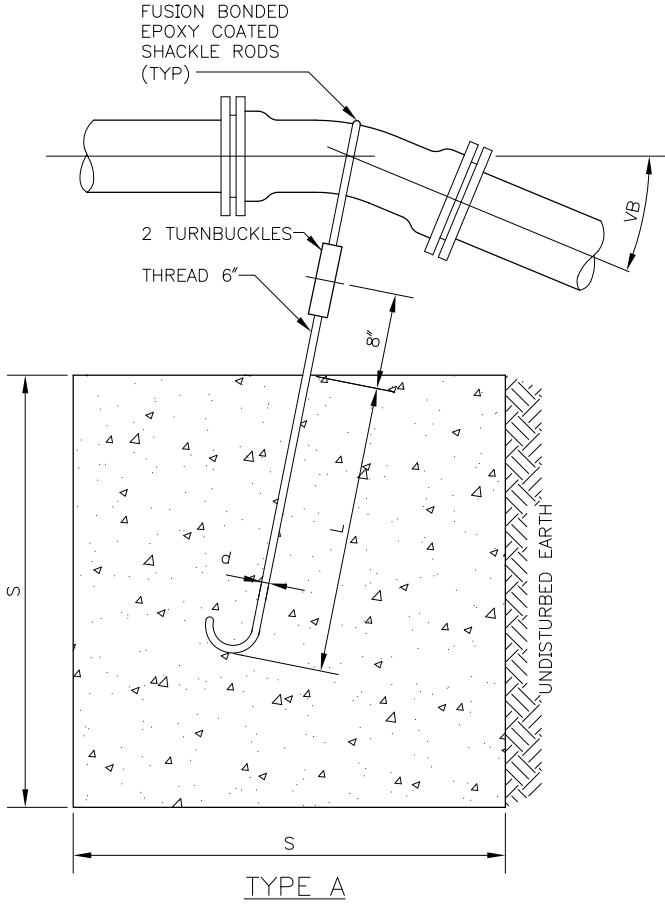

TYPE B BLOCKING
FOR 45° VERTICAL BENDS


PIPE SIZE NOM DIA INCHES	TEST PRESSURE PSI	VB VERTICAL BEND DEGREES	S NO OF CU FT OF CONC BLOCKING	d SIDE OF CUBE FEET	L DIA OF SHACKLE RODS (4) INCHES	DEPTH OF RODS IN CONCRETE INCHES
4"	300	45	27	3	3/4	20
6"			64	4		
8"			125	5		
12"			216	6		

FOR NOTES SEE STD PLAN NO 330b
REF STD SPEC SEC 7-11



NOT TO SCALE

WATERMAIN THRUST BLOCKING
VERTICAL FITTINGS

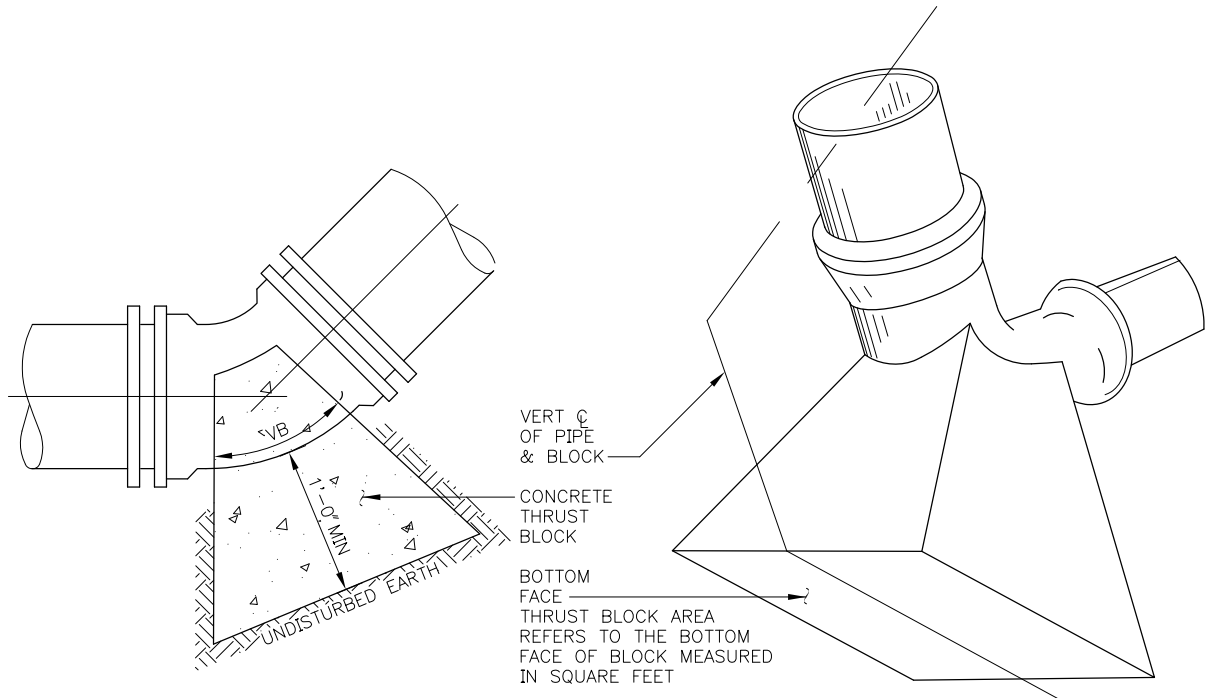

TYPE C

TYPE "C" BLOCKING FOR 11 1/4°, 22 1/2°, 45° AND 90° VERTICAL BENDS										
THRUST BLOCK AREA IN SQUARE FEET										
PIPE SIZE	FITTING	FIRM SILT OR FIRM SILTY SAND			COMPACT SAND			COMPACT SAND & GRAVEL		
		90° BEND	TEE 45° BEND & DEAD END	11 1/4° & 22 1/2° BEND	90° BEND	TEE 45° BEND & DEAD END	11 1/4° & 22 1/2° BEND	90° BEND	TEE 45° BEND & DEAD END	11 1/4° & 22 1/2° BEND
4"		5.8	4.2	1.7	2.9	2.1	1.0	2.2	1.6	1.0
6"		13.3	9.4	3.8	6.7	4.7	1.9	5.0	3.5	1.4
8"		23.3	16.7	6.7	11.7	8.4	3.4	8.8	6.3	2.5
12"		53.0	37.5	15.0	26.5	18.8	7.5	20.0	14.0	5.6

AREAS CALCULATED ON 300 PSI TEST PRESSURE AND 3'-0" MIN COVER OVER WATERMAIN

NOTES:

1. LOCATION AND SIZE OF BLOCKING FOR PIPE LARGER THAN 12" DIAMETER AND FOR SOIL TYPES DIFFERENT THAN SHOWN SHALL BE DETERMINED BY THE ENGINEER
2. ALL BLOCKING FOR VERTICAL FITTINGS (POURED IN PLACE) SHALL BEAR AGAINST UNDISTURBED NATIVE GROUND
3. ALL POURED THRUST BLOCKS SHALL BE BACKFILLED AFTER MIN. 1 DAY. PRESSURE TESTING SHALL OCCUR AFTER CONCRETE HAS REACHED f'c
4. ALL BLOCKING SHALL BE CONCRETE CL 5 (11/2)
5. AFTER INSTALLATION, SHACKLE RODS & TURNBUCKLES SHALL BE CLEANED AND COATED WITH 2 COATS OF ASPHALTIC VARNISH, ROYSTON ROYKOTE #612M OR APPROVED EQUAL
6. SHACKLE RODS SHALL BE FUSION BONDED EPOXY COATED ROUND MILD STEEL, ASTM A 36, WITH THREADS ON ENDS ONLY
7. BLOCKING AGAINST FITTINGS SHALL BEAR AGAINST THE GREATEST FITTING SURFACE AREA POSSIBLE, BUT SHALL NOT COVER OR ENCLOSE BELL ENDS, JOINT BOLTS OR GLANDS. REASONABLE ACCESS TO BOLTS AND GLANDS SHALL BE PROVIDED

REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE


WATERMAIN THRUST BLOCKING VERTICAL FITTINGS

STANDARD PLAN NO 331a

REV DATE: 2003

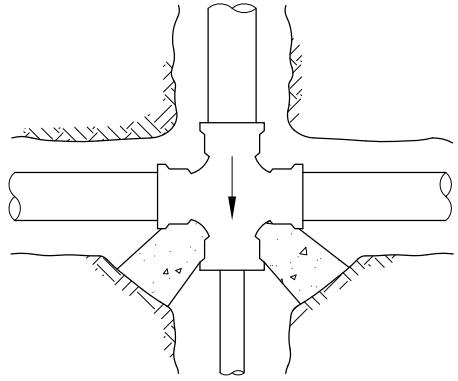


UNBALANCED CROSS

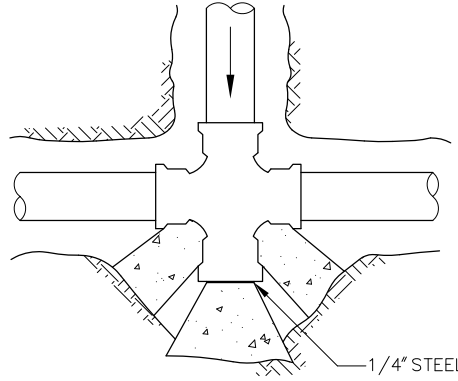


CROSS WITH PLUG

1/4" STEEL PLATE

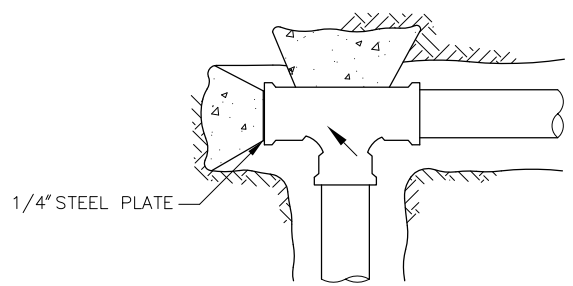


1/4" STEEL PLATE

PLUGGED TEE

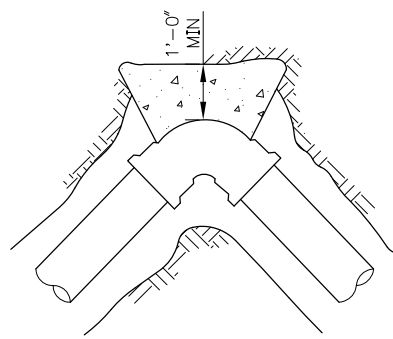


HORIZONTAL BEND

1'-0" MIN

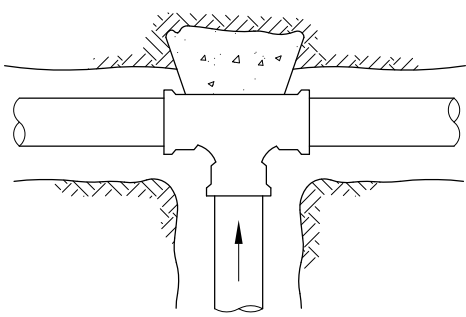

TEE

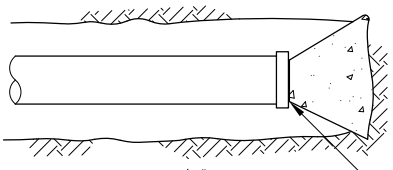

1/4" STEEL PLATE

PIPE & CAP

THRUST BLOCK AREA IN SQUARE FEET (SEE STD PLAN NO 331b)

PIPE SIZE	SOIL		FIRM SILT OR FIRM SILTY SAND				COMPACT SAND				COMPACT SAND & GRAVEL			
	90° BEND	TEE	45° BEND CAP OR PLUG	11 1/4° & 22 1/2° BEND	90° BEND	TEE	45° BEND CAP OR PLUG	11 1/4° & 22 1/2° BEND	90° BEND	TEE	45° BEND CAP OR PLUG	11 1/4° & 22 1/2° BEND		
4"	7.0	4.2	4.2	1.7	2.9	2.1	2.1	1.0	2.2	1.6	1.6	1.0		
6"	13.3	9.4	9.4	3.8	6.7	4.7	4.7	1.9	5.0	3.5	3.5	1.4		
8"	23.3	16.7	16.7	6.7	11.7	8.4	8.4	3.4	8.8	6.3	6.3	2.5		
12"	53.0	37.5	37.5	15.0	26.5	18.8	18.8	7.5	20.0	14.0	14.0	5.6		

AREAS CALCULATED ON 300 PSI TEST PRESSURE AND 3'-0" MIN COVER OVER WATERMAIN

ECOLOGY BLOCKS, PER STD PLAN NO 460, MAY BE USED IN LIEU OF POURED-IN-PLACE BLOCKING FOR FITTINGS IN SHADED PORTION OF TABLE

REF STD SPEC SEC 7-11


FOR NOTES SEE STD PLAN NO 331b



City of Seattle

NOT TO SCALE

WATERMAIN THRUST BLOCKING HORIZONTAL FITTINGS

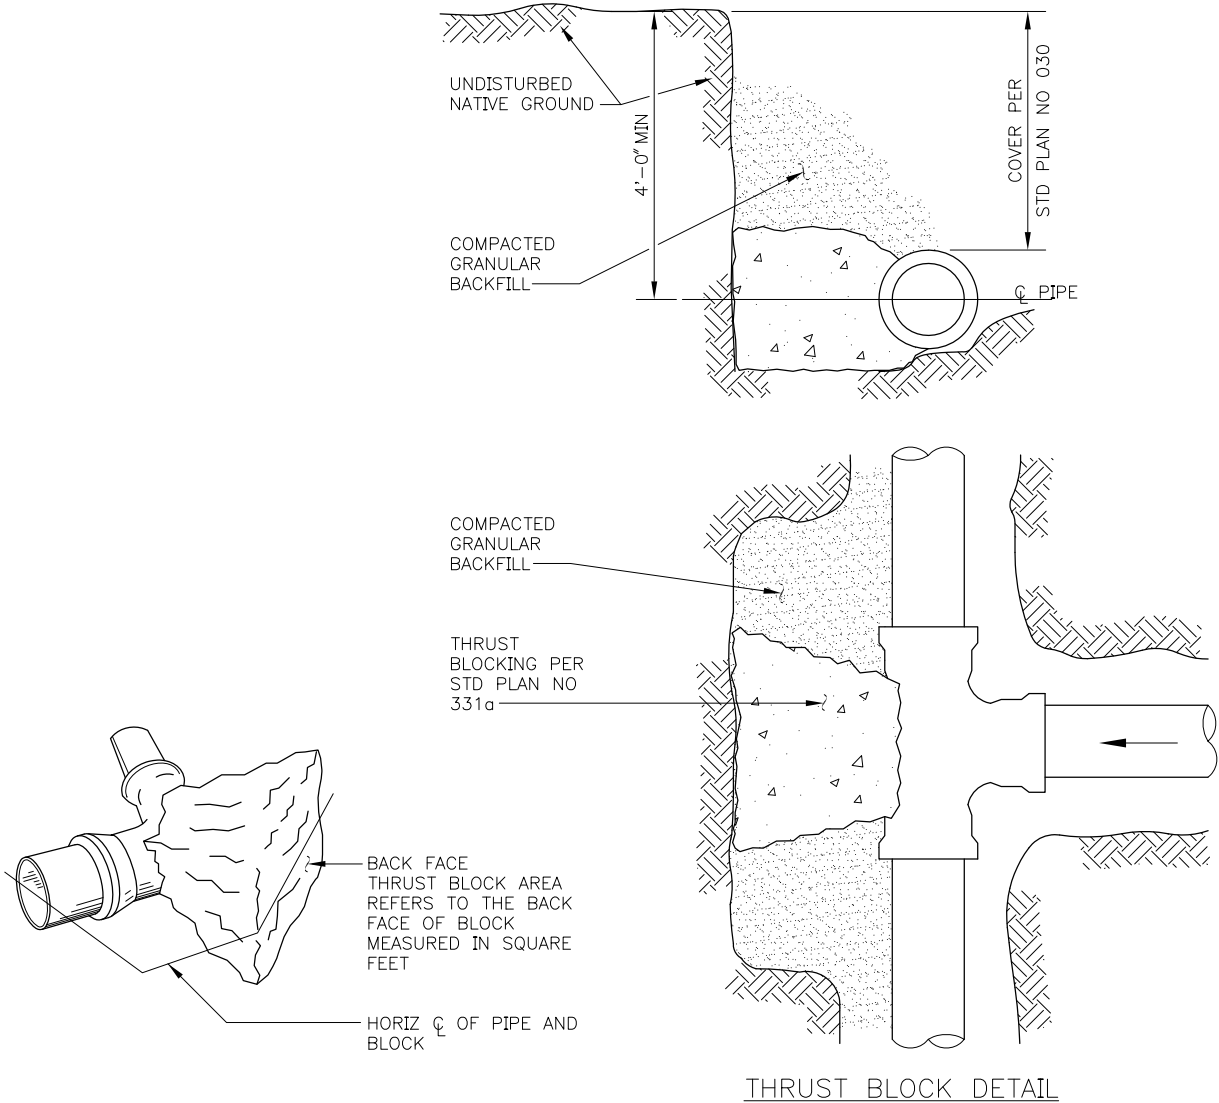

NOTES:

1. LOCATION AND SIZE OF BLOCKING FOR PIPE LARGER THAN 12" DIAMETER AND FOR SOIL TYPES DIFFERENT THAN SHOWN SHALL BE DETERMINED BY THE ENGINEER.
2. ALL BLOCKING FOR HORIZONTAL FITTINGS (POURED IN PLACE) SHALL BEAR AGAINST UNDISTURBED NATIVE GROUND.
3. ALL POURED THRUST BLOCKS SHALL BE BACKFILLED AFTER MIN. 1 DAY. PRESSURE TESTING SHALL OCCUR AFTER CONCRETE HAS REACHED f'c.
4. ALL BLOCKING TO BE CONCRETE CL 5 (1 1/2).
5. BLOCKING AGAINST FITTINGS SHALL BEAR AGAINST THE GREATEST FITTING SURFACE AREA POSSIBLE, BUT SHALL NOT COVER OR ENCLOSE BELL ENDS, JOINT BOLTS OR GLANDS. ACCESS TO BOLTS AND GLANDS SHALL BE PROVIDED.
6. ALL HORIZONTAL BLOCKING THRUST AREAS SHALL BE CENTERED ON PIPE.
7. WHERE POURED-IN-PLACE BLOCKING IS REQUIRED AT A POINT OF CONNECTION TO AN EXISTING WATERMAIN, THE BLOCKING SHALL BE INSTALLED PRIOR TO CONNECTION.
8. TEMPORARY BLOCKING, IF USED, SHALL BE APPROVED BY ENGINEER.

REF STD SPEC SEC 7-11




City of Seattle

NOT TO SCALE

WATERMAIN THRUST BLOCKING
HORIZONTAL FITTINGS

STANDARD PLAN NO 340a

REV DATE: 2003

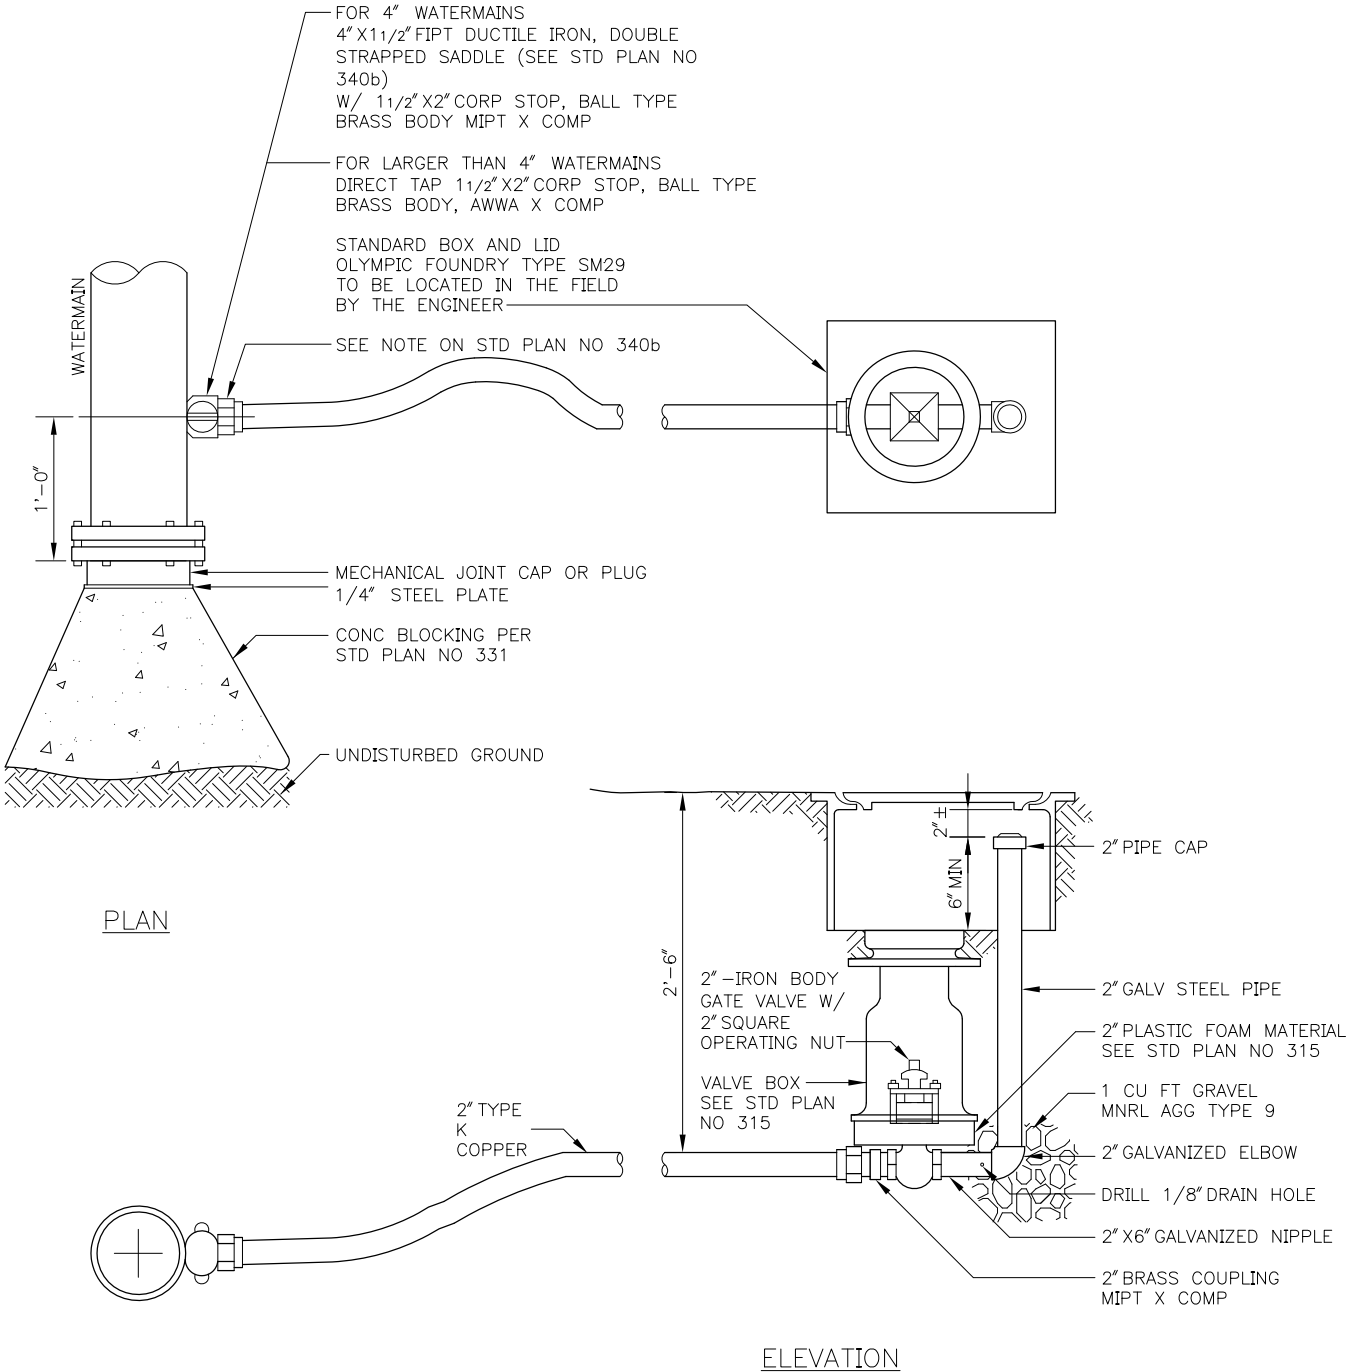


REF STD SPEC SEC 7-11



City of Seattle


NOT TO SCALE

2" BLOW OFF TYPE A
NON TRAFFIC INSTALLATION

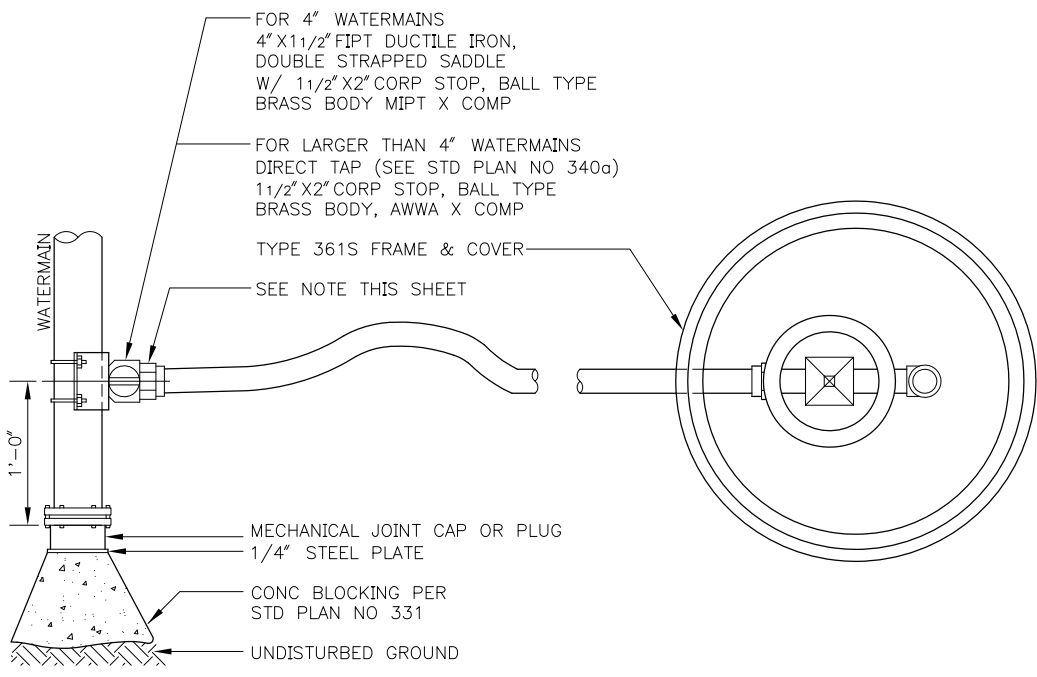

PLAN

NOTE:
 WHERE TAPE-WRAPPED DUCTILE IRON PIPE IS USED, THE MECHANICAL JOINT CAP, CORP AND SADDLE (IF REQUIRED) SHALL BE WRAPPED PER AWWA C214

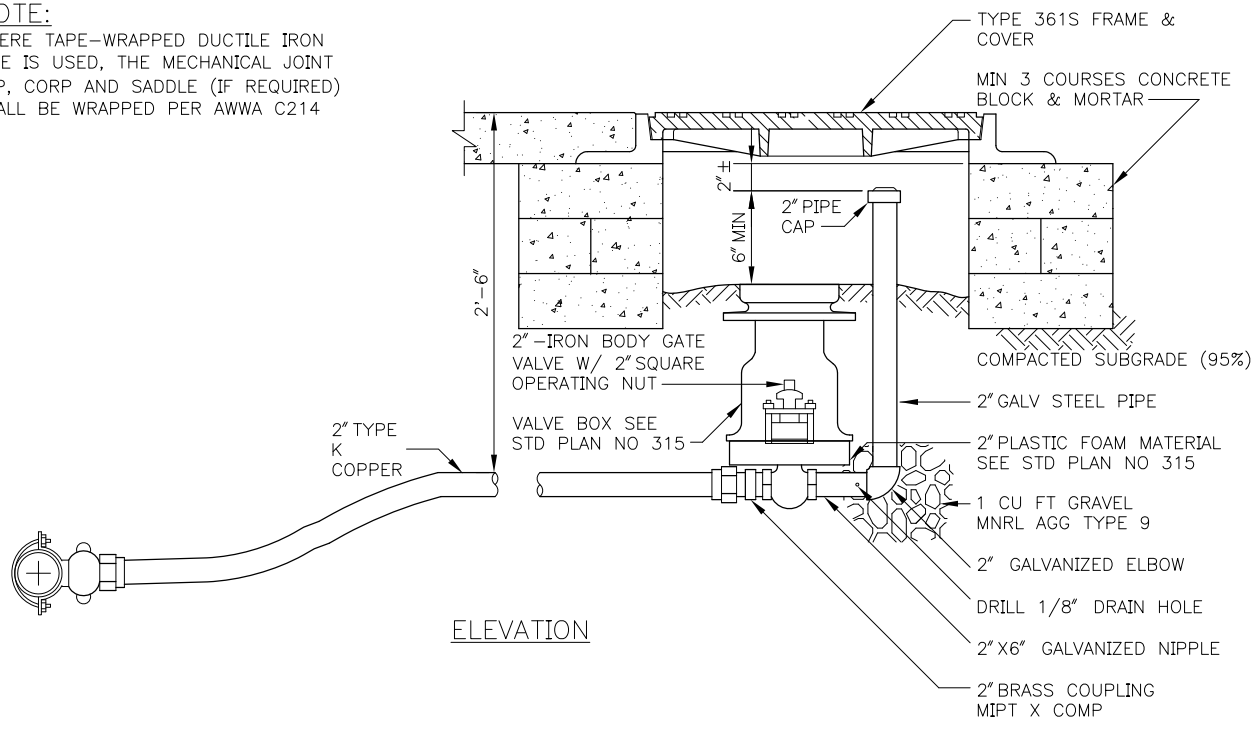

ELEVATION

REF STD SPEC SEC 7-11




NOT TO SCALE

2" BLOW OFF DETAIL TYPE B
 TRAFFIC INSTALLATION

STANDARD PLAN NO 350

REV DATE: 2003

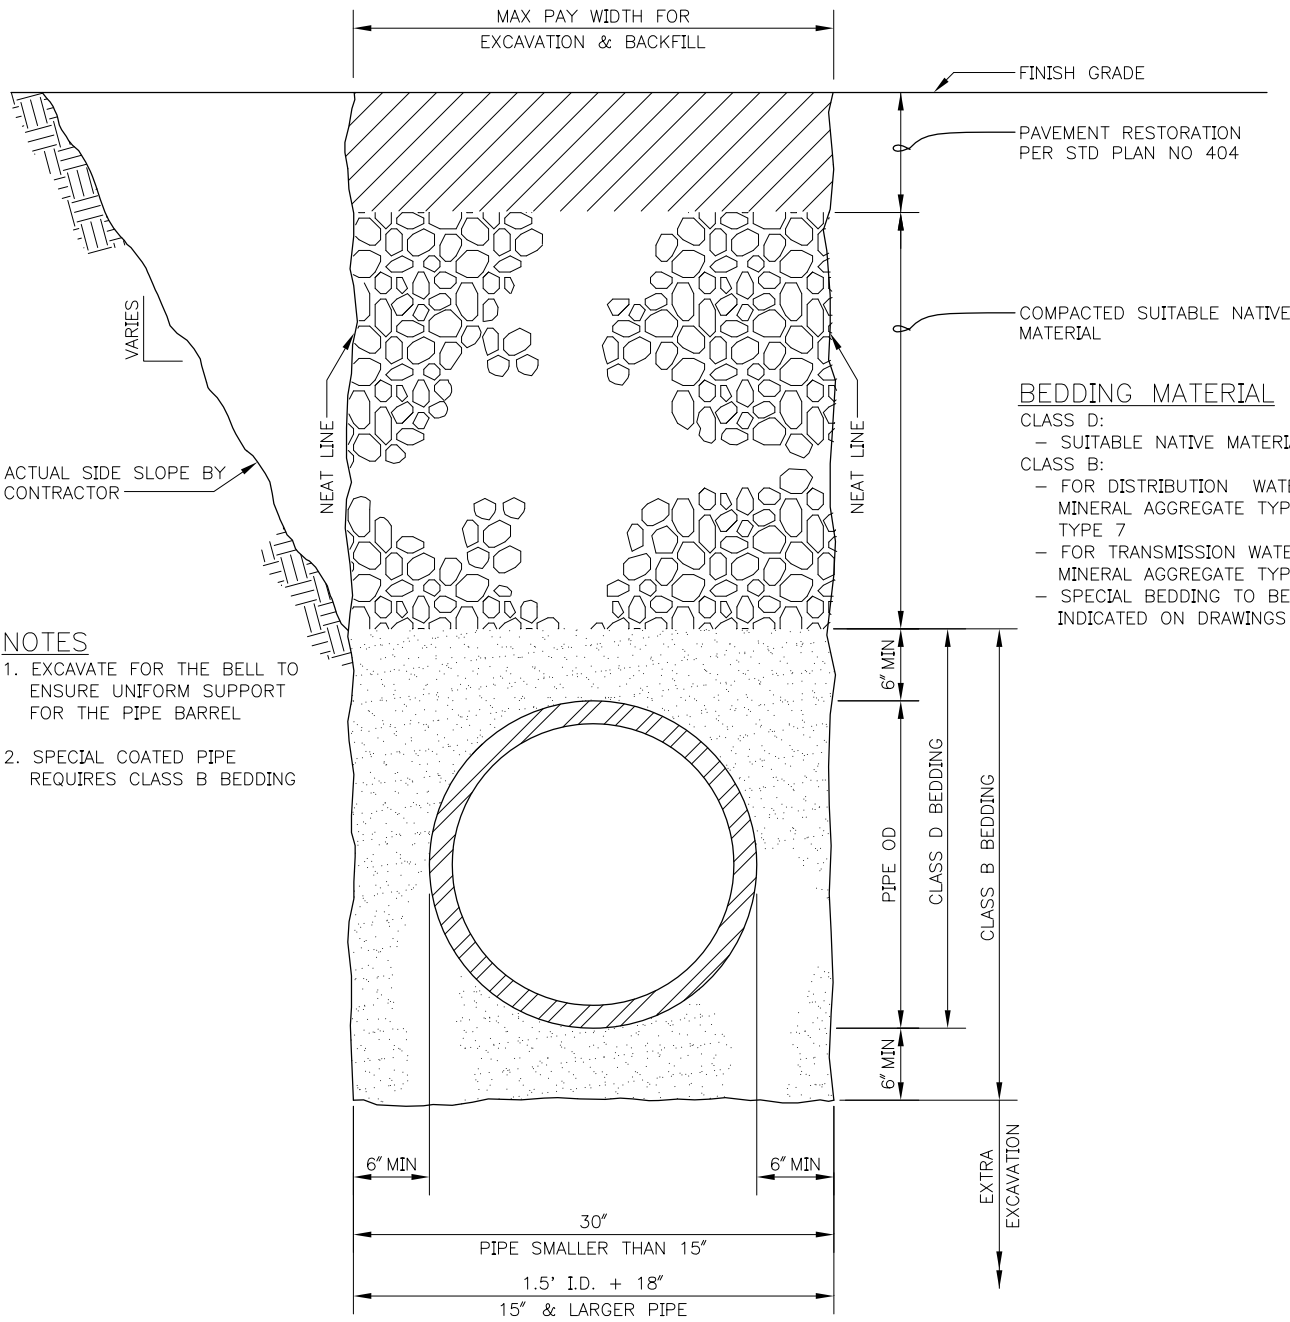

BEDDING MATERIAL

- CLASS D:
 - SUITABLE NATIVE MATERIAL
- CLASS B:
 - FOR DISTRIBUTION WATERMAIN, MINERAL AGGREGATE TYPE 6 OR TYPE 7
 - FOR TRANSMISSION WATERMAIN, MINERAL AGGREGATE TYPE 9
 - SPECIAL BEDDING TO BE INDICATED ON DRAWINGS

NOTES

1. EXCAVATE FOR THE BELL TO ENSURE UNIFORM SUPPORT FOR THE PIPE BARREL
2. SPECIAL COATED PIPE REQUIRES CLASS B BEDDING

REF STD SPEC SEC 7-10




City of Seattle

NOT TO SCALE


WATERMAIN TRENCH AND BEDDING

STANDARD PLAN NO 360



REV DATE: 2003

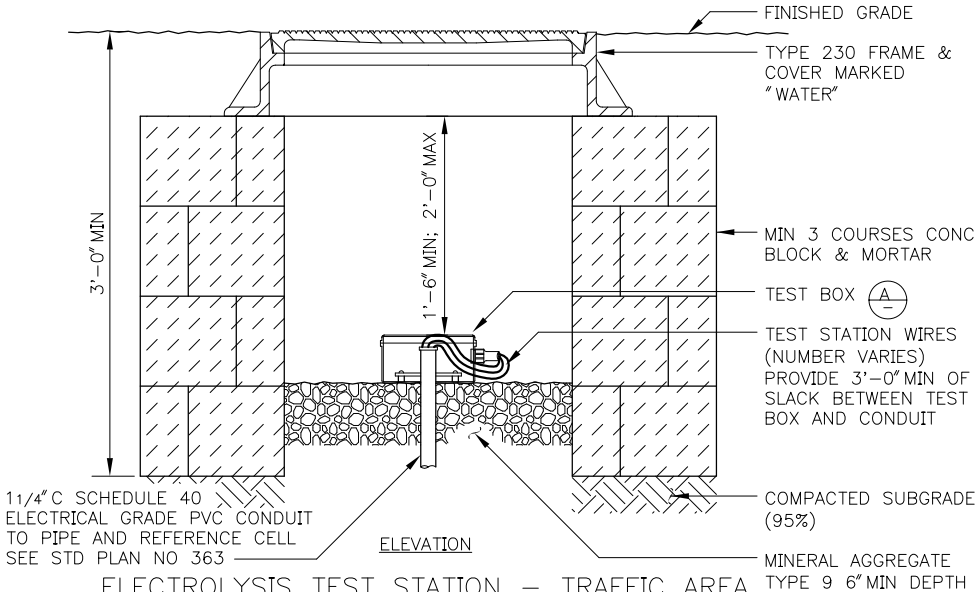

ELECTROLYSIS TEST STATION - TRAFFIC AREA

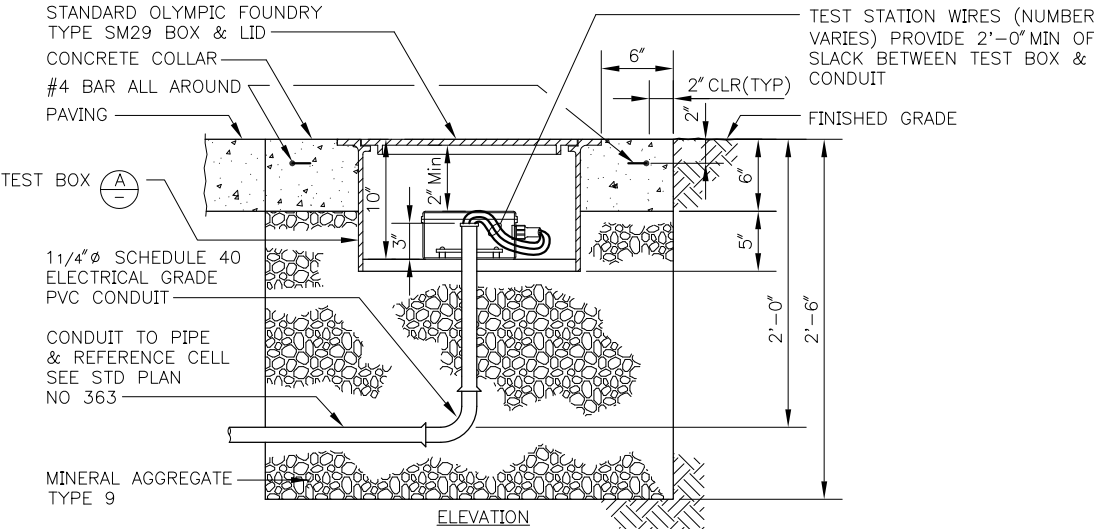

ELECTROLYSIS TEST STATION - NON-TRAFFIC AREA

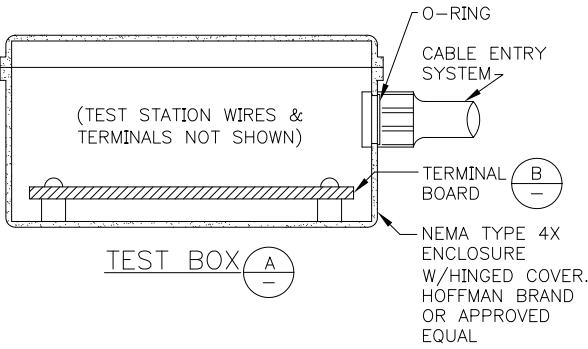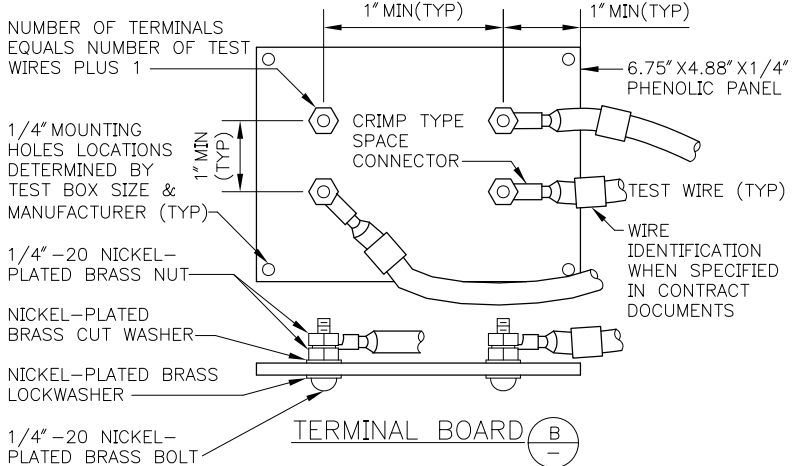

TEST BOX (A)

REF STD SPEC SEC 7-11




NOT TO SCALE


WATERMAIN ELECTROLYSIS TEST STATION

STANDARD PLAN NO 361


REV DATE: 2003

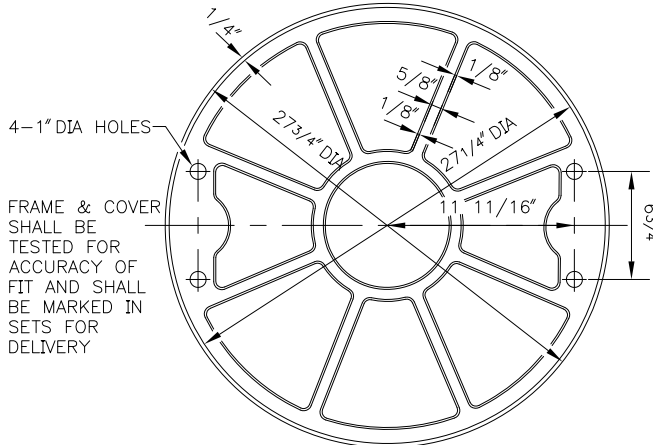

BOTTOM VIEW

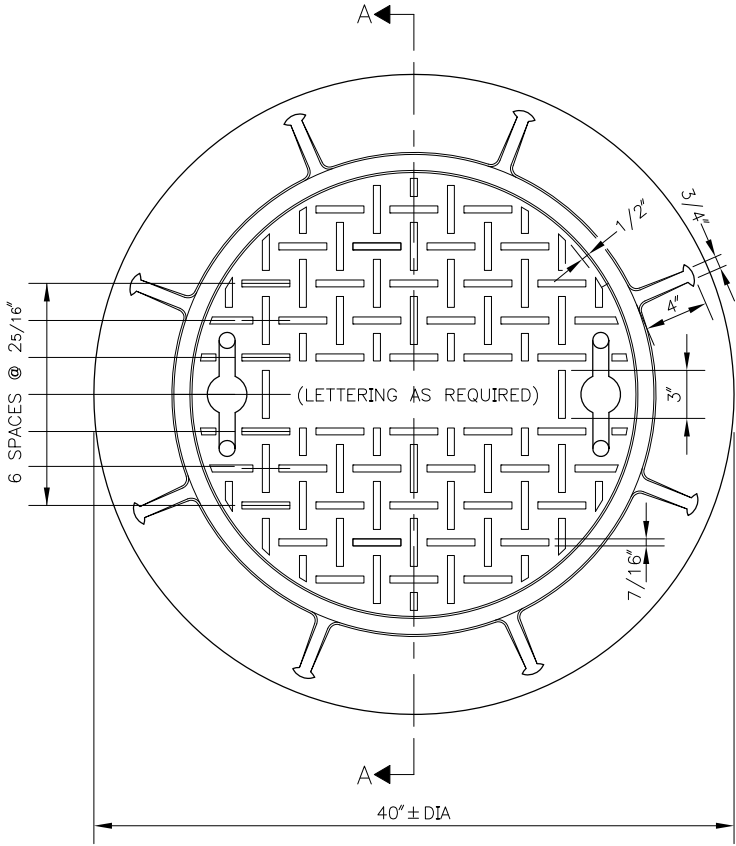

TOP VIEW

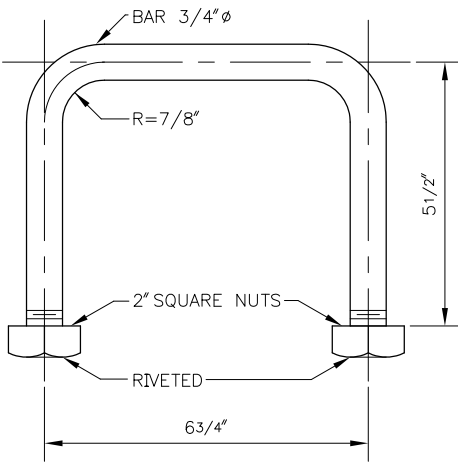


LIFTING HANDLE
(2 REQUIRED)

TYPE 361
H=9 1/4"

DESIGNATE SHALLOW FRAME AS TYPE 361S
H=4 1/4"

f=MACHINED FINISH

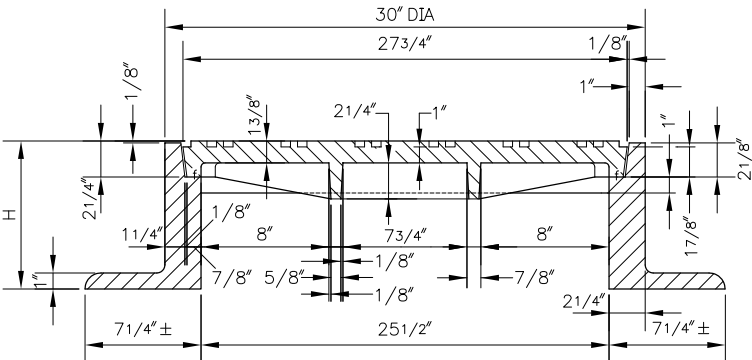


SECTION A-A

REF STD SPEC SEC 7-12




NOT TO SCALE


TYPE 361 VALVE CHAMBER
FRAME & COVER

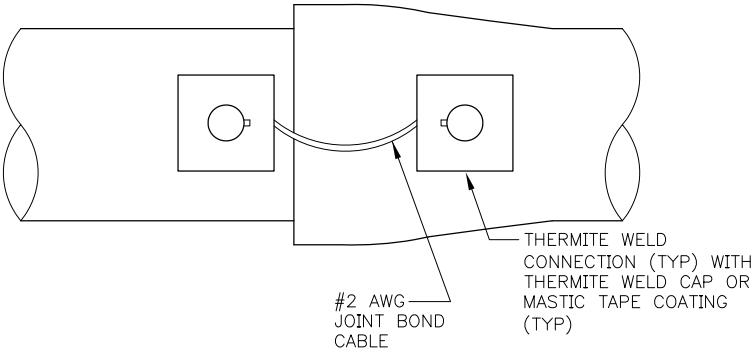

SLIP JOINT BOND CONNECTION

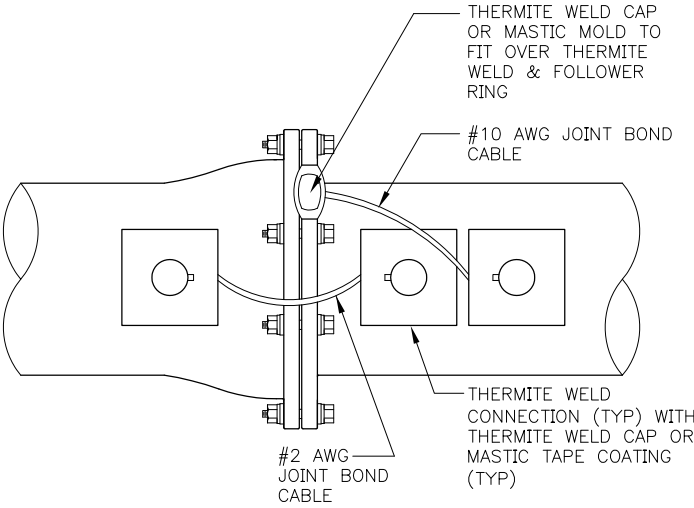

MECHANICAL JOINT BOND CONNECTION

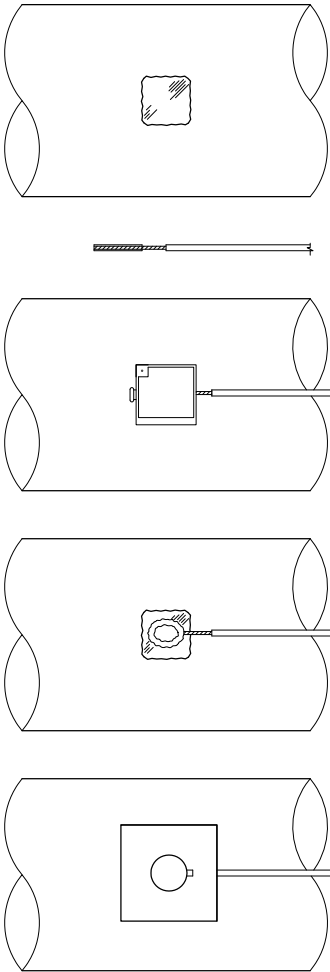

CONNECTION SEQUENCE:

1. REMOVE PIPE COATING TO BRIGHT & CLEAN METAL
2. STRIP INSULATION FROM TEST STATION WIRE, INSTALL ADAPTER SLEEVE
3. HOLD MOLD FIRMLY WITH OPENING AWAY FROM OPERATOR AND IGNITE
4. REMOVE SLAG AND ALLOW TO COOL
5. 16 OUNCE HAMMER TEST PER STD. SPEC SEC 7- 11.3(15)01
6. FINAL CONNECTION TO BE MADE WATERTIGHT WITH MASTIC COATING OR PREFORMED THERMITE WELD CAP

THERMITE WELD CONNECTION

REF STD SPEC SEC 7-11




City of Seattle


NOT TO SCALE

JOINT BONDING FOR DIP WATERMAINS & JOINTS BONDING DETAIL


NOTE:
WIRE INSTALLATION PER
STD SPEC SEC 9-30.12(3)

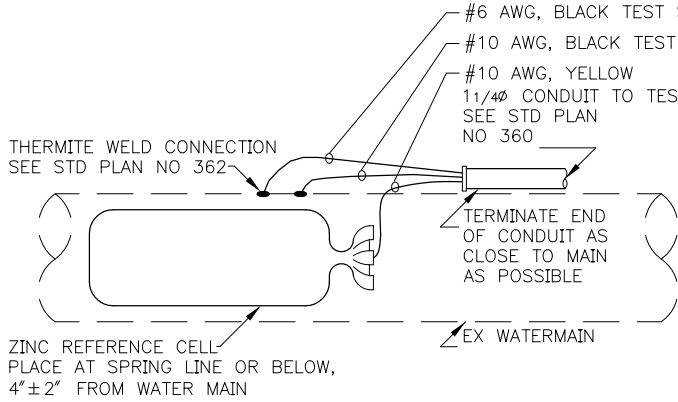

STANDARD 3-WIRE TEST STATION

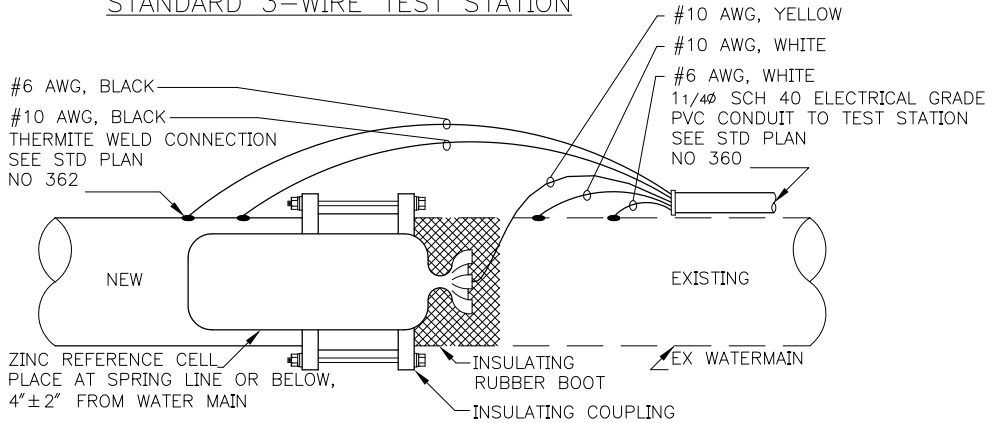

INSULATING COUPLING 5-WIRE TEST STATION

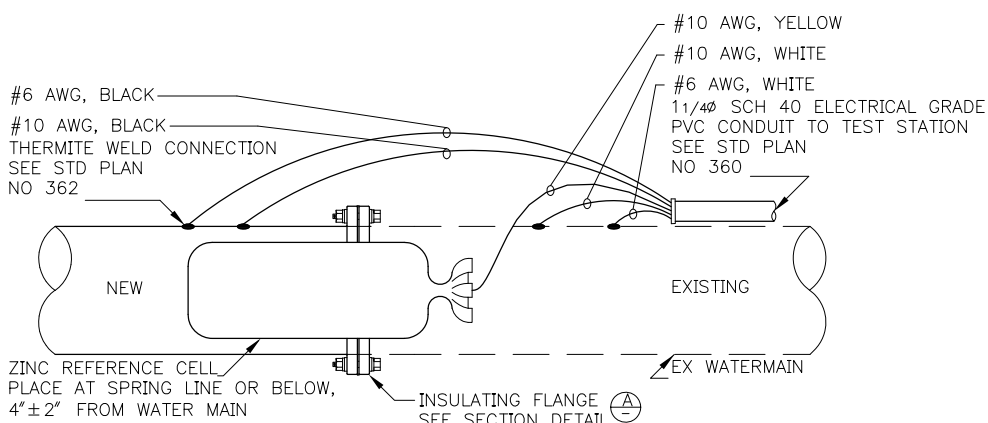

INSULATING FLANGE 5-WIRE TEST STATION


TYPE E NEOPRENE FACED PHENOLIC INSULATING GASKET

PHENOLIC OR SPIRAL WOUND MYLAR INSULATING SLEEVE (LENGTH OF SLEEVE TO BE 1/16" LESS THAN SPACING BETWEEN STEEL WASHERS)

PHENOLIC INSULATING WASHER

STEEL WASHER

PETROLATUM TAPE ENCLOSE ENTIRE FLANGE ASSEMBLY

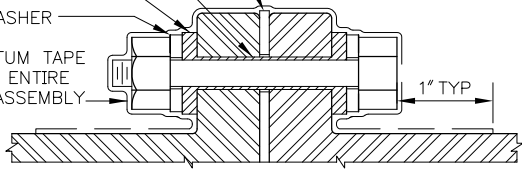

(A) INSULATING FLANGE SECTION DETAIL

REF STD SPEC SEC 7-11.3(15) & 9-30.12




City of Seattle

NOT TO SCALE

ELECTROLYSIS TEST STATION
WIRE INSTALLATION DETAILS

STANDARD PLAN NO 400

REV DATE: 2003

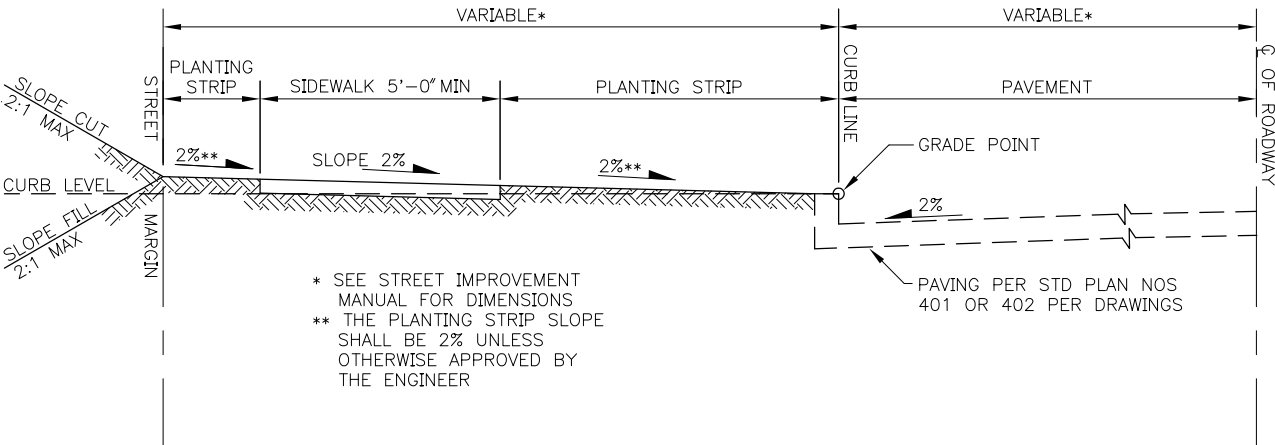

* SEE STREET IMPROVEMENT
MANUAL FOR DIMENSIONS
** THE PLANTING STRIP SLOPE
SHALL BE 2% UNLESS
OTHERWISE APPROVED BY
THE ENGINEER

PAVING PER STD PLAN NOS
401 OR 402 PER DRAWINGS

REF STD SPEC SEC 2-03




City of Seattle

NOT TO SCALE


HALF SECTION, GRADING

STANDARD PLAN NO 401


REV DATE: 2003

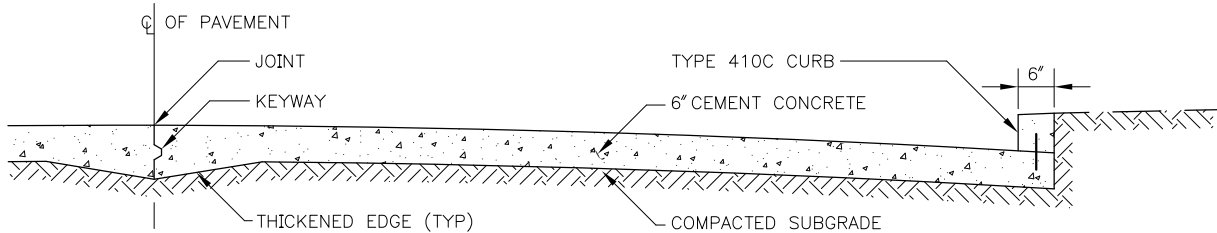


401A-CEMENT CONCRETE PAVEMENT WITH INTEGRAL CURB

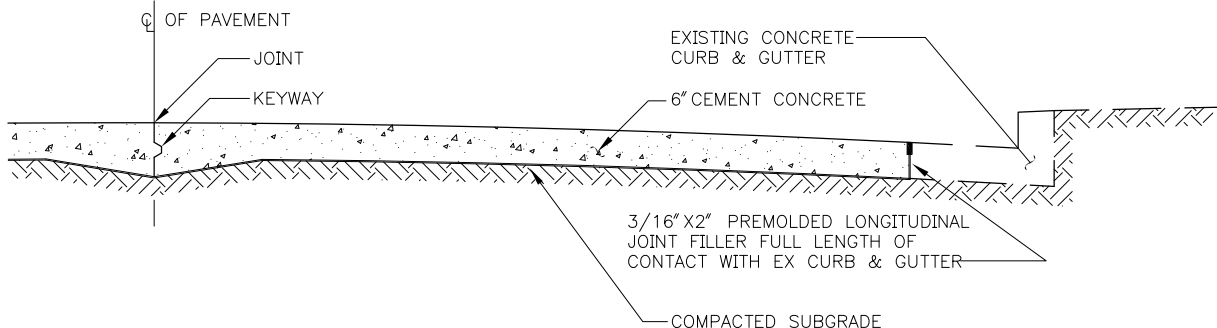

401B-CEMENT CONCRETE PAVEMENT WITH EXISTING CURB & GUTTER

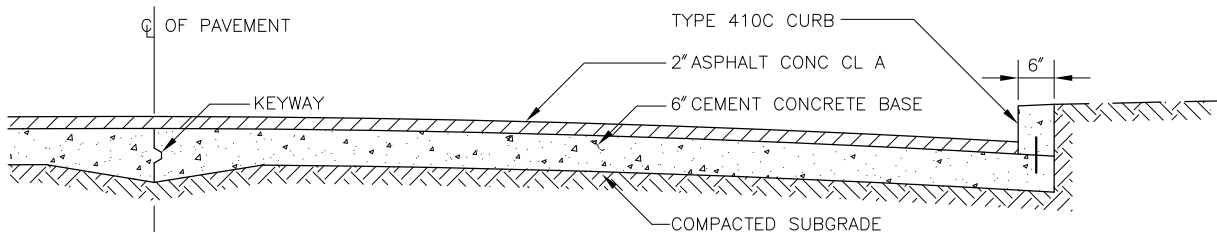

401C-ASPHALT CONCRETE ON CEMENT CONCRETE BASE

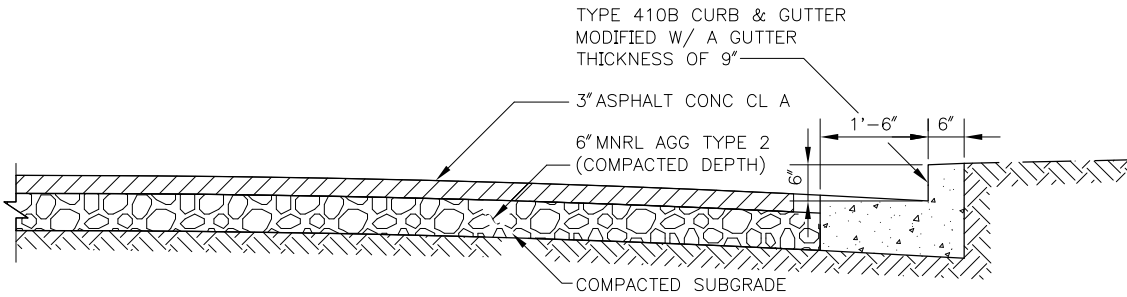

401D-ASPHALT CONCRETE OVER CRUSHED ROCK BASE

NOTES:

- 1. CONC CL 6 (1 1/2) UNLESS OTHERWISE SPECIFIED ON DRAWINGS
- 2. FOR JOINT DETAILS, SEE STD PLAN NO 405


REF STD SPEC SEC 4-04, 5-04, 5-05 & 8-04




City of Seattle

NOT TO SCALE


RESIDENTIAL PAVEMENT SECTIONS

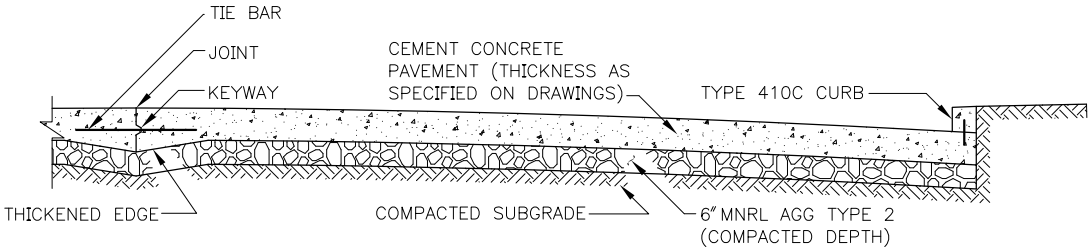

402A-CEMENT CONCRETE PAVEMENT ON CRUSHED ROCK

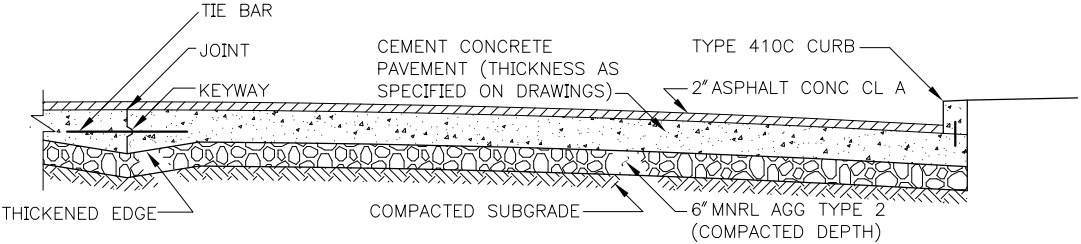

402B-ASPHALT CONCRETE ON CEMENT CONCRETE ON CRUSHED ROCK

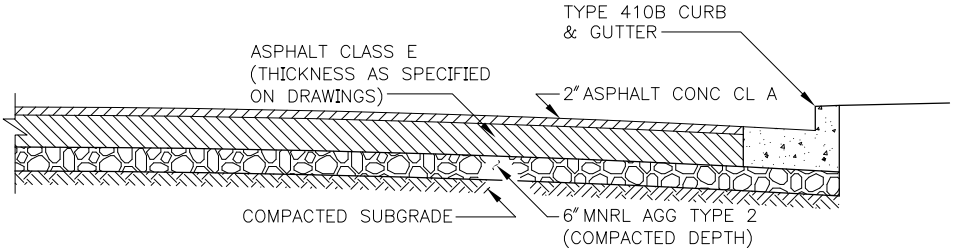

402D-ASPHALT CONCRETE ON CRUSHED ROCK BASE

NOTES:

1. PAVEMENT WIDTH AND THICKNESS AS SPECIFIED ON DRAWINGS
2. CONC CL 6.5 (1 1/2) UNLESS OTHERWISE SPECIFIED ON DRAWINGS
3. TIE BARS AND DOWELL BARS ARE REQUIRED FOR CEMENT CONCRETE PAVEMENT AND BASE (SEE STD PLAN NO 405)
4. FOR THICKENED EDGE AND JOINT DETAILS, SEE STD PLAN NO 405


REF STD SPEC SEC 4-04, 5-04, 5-05 & 8-04




City of Seattle

NOT TO SCALE

ARTERIAL PAVEMENT SECTIONS

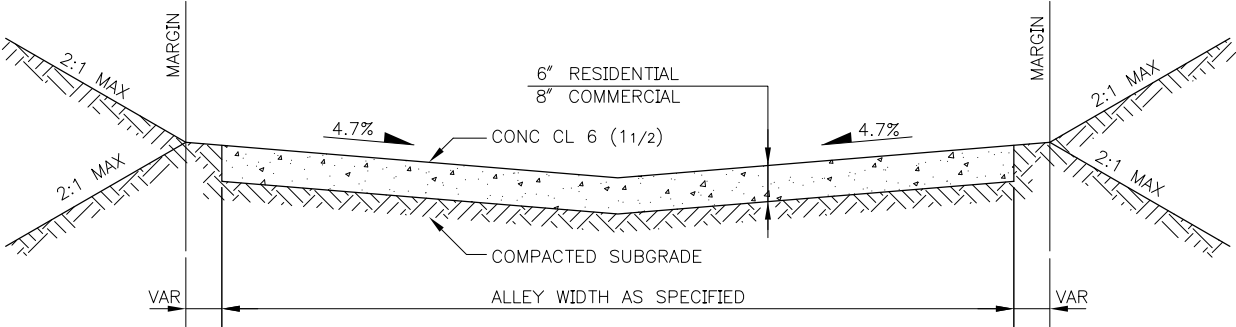

403A—CEMENT CONCRETE ALLEY PAVEMENT

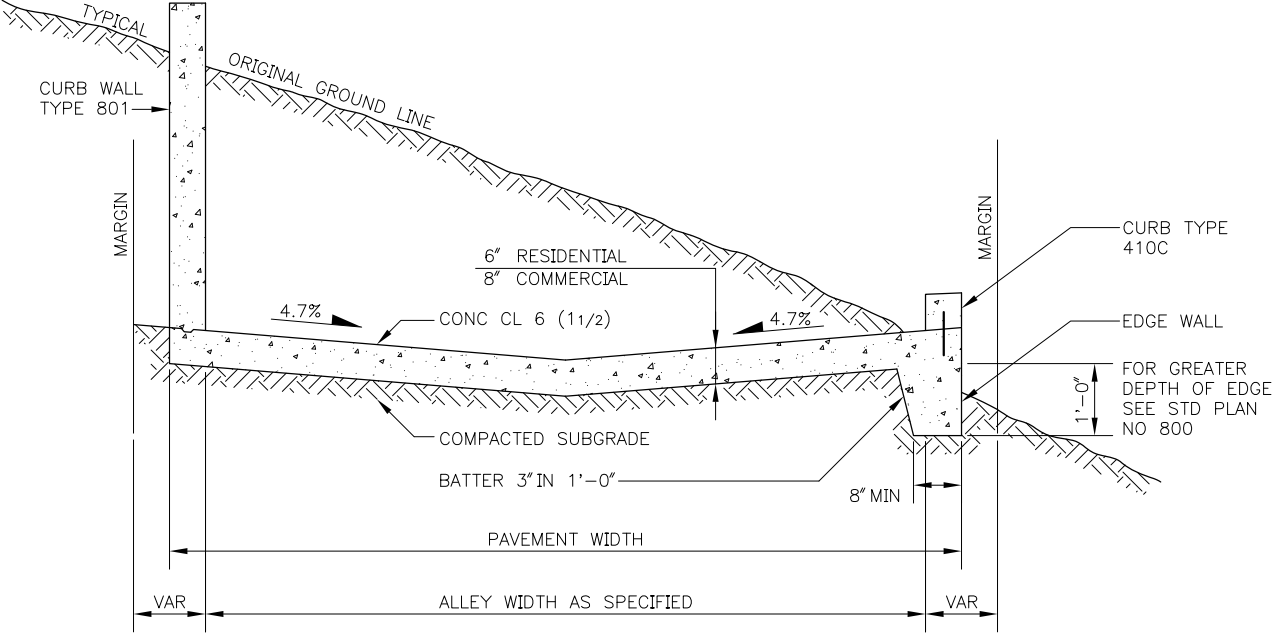

CEMENT CONCRETE ALLEY PAVEMENT
403B—FOR SHALLOW EMBANKMENT AREA

NOTES:

1. WHEN ALLEY PAVEMENT IS 16'-0" OR WIDER
PLACE CONSTRUCTION JOINT TYPE II PER
STD PLAN NO 405 ALONG CENTERLINE OF ALLEY
2. CONC CL 6(1 1/2)
3. SPECIFIC APPLICATION OF THIS STANDARD PLAN
SHALL CONSIDER ADA ACCESSIBLE ROUTE
FOR ENTIRE ALLEY

REF STD SPEC SEC 5-05



City of Seattle

NOT TO SCALE

CEMENT CONCRETE ALLEY
PAVEMENTS

HALF SECTION

RIGID PAVEMENT WITH ASPHALT CONCRETE SURFACE

SAW ASPHALT (REMOVE LOOSENED AREAS)

EXISTING ASPHALT PAVEMENT

EXISTING RIGID BASE

TRIM VERTICALLY

COMPACTED SUBGRADE

MIN WIDTH FOR RESTORATION**

ASPHALT** CONCRETE CL A

CONC CLASS 6.5 (1 1/2) HES**

12"

HALF SECTION

CEMENT CONCRETE PAVEMENT

SAW CONCRETE (1/3 D)

EXISTING CONCRETE PAVEMENT

6" MIN

COMPACTED MINERAL AGGREGATE TYPE 2 FOR ARTERIAL AND COMMERCIAL ACCESS STREETS.

D

TRENCH WIDTH*

TYPICAL PATCH FOR RIGID PAVEMENT

HALF SECTION

FLEXIBLE PAVEMENT RESTORATION FOR RESIDENTIAL STREETS

EXISTING OIL MAT

EXISTING EARTH OR GRANULAR BASE

COMPACTED MINERAL AGGREGATE TYPE 2

COMPACTED SUBGRADE

MIN WIDTH FOR RESTORATION**

ASPHALT** CONCRETE CL A

12"

3"

6" MIN

HALF SECTION

FLEXIBLE PAVEMENT RESTORATION FOR ARTERIAL AND COMMERCIAL ACCESS STREET

SAW ASPHALT

EXISTING ASPHALT CONCRETE SURFACE

EXISTING FLEXIBLE BASE

ASPHALT CL E**

COMPACTED MINERAL AGGREGATE TYPE 2

4"

2"

6" MIN

TRENCH WIDTH*

TYPICAL PATCH FOR FLEXIBLE PAVEMENT

* TRENCH WIDTH REFERS TO MAX TRENCH WIDTH AS CALLED OUT ON STD PLAN NOS 284 & 350

** ACTUAL WIDTH AND DEPTH OF RESTORATION MAY BE INCREASED TO MEET REQUIREMENTS OF "STREET AND SIDEWALK PAVEMENT OPENING AND RESTORATION RULES"


REF STD SPEC SEC 2-02, 5-04, & 5-05



City of Seattle

NOT TO SCALE

PAVEMENT PATCHING

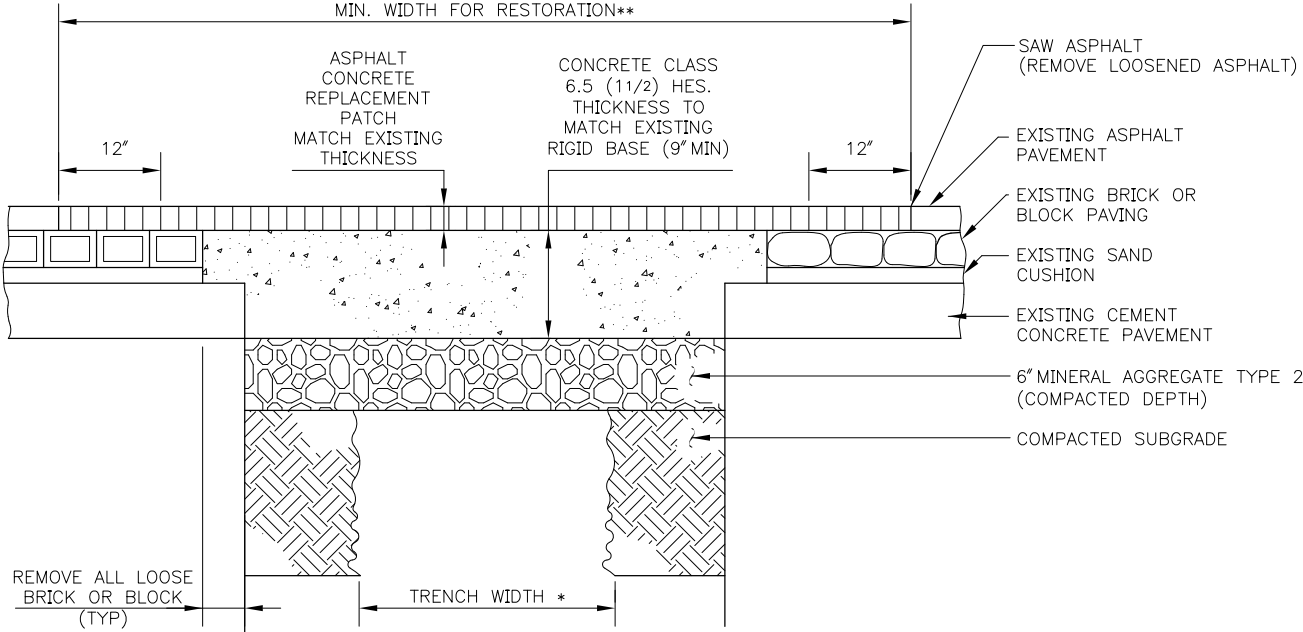

ASPHALT OVER RIGID BASE OF BRICK OR STONE BLOCK PAVEMENT

NOTES:

- 1. WHEN A STONE OR BRICK PAVEMENT IS OVERLAYED WITH ASPHALT, THE STREET SURFACE PAVEMENT BECOMES AN ASPHALT STREET OVER RIGID BASE
- 2. IF A STONE OR BRICK PAVEMENT IS NOT OVERLAYED, THE METHOD OF RESTORATION IS IN KIND

* TRENCH WIDTH REFERS TO MAX TRENCH WIDTH AS CALLED OUT ON STD PLAN NOS. 284 & 350
 ** ACTUAL WIDTH AND DEPTH OF RESTORATION MAY BE INCREASED TO MEET REQUIREMENTS OF "STREET AND SIDEWALK PAVEMENT OPENING AND RESTORATION RULES"

REF STD SPEC SEC 2-02, 5-04 & 5-05




City of Seattle

NOT TO SCALE


PAVEMENT PATCHING

STANDARD PLAN NO 405


REV DATE: 2003

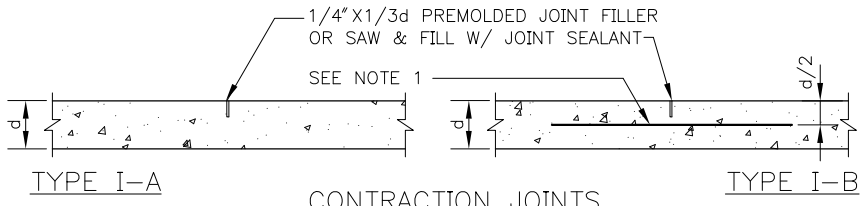

CONTRACTION JOINTS

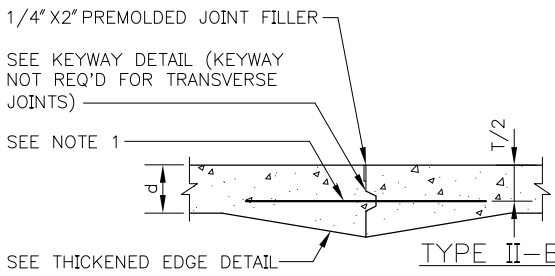


CONSTRUCTION JOINTS

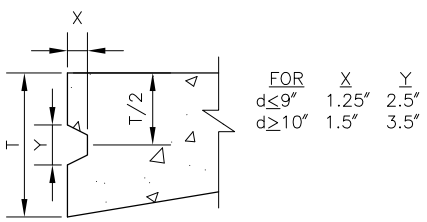


KEYWAY DETAIL

FOR JOINTS WITH THICKENED EDGE $T=d+3'$
OTHERWISE $T=d$

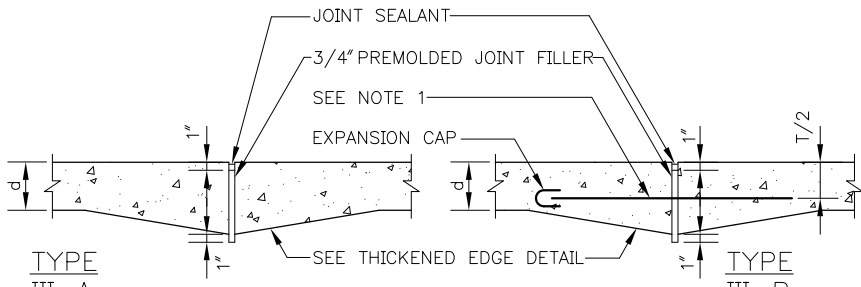


THROUGH JOINTS

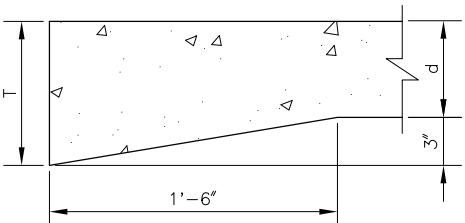

THICKENED EDGE DETAIL

(NOT NEEDED FOR TYPE A JOINTS WIDTH $d \geq 10'$)
(NOT NEEDED FOR TYPE B JOINTS WIDTH $d \geq 9'$)

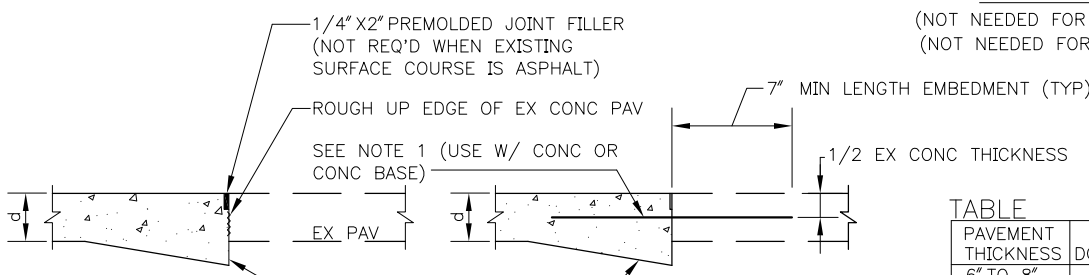

NEW TO OLD JOINTS

PAVEMENT THICKNESS	DOWEL BAR SIZE
6" TO 8"	1" X 18" @ 12"
9" TO 11"	1 1/4" X 18" @ 12"
12" & OVER	1 1/2" X 18" @ 12"

NOTES:

1. WHERE REQUIRED AT LONGITUDINAL JOINTS, TIE BARS SHALL BE 5/8" X 2'-6" @ 3'-0", DEFORMED GRADE 40 OR BETTER, EPOXY COATED. WHERE REQUIRED AT TRANSVERSE JOINTS, DOWEL BARS SHALL BE SIZED AS SHOWN IN THE TABLE, SMOOTH ROUND GRADE 60 OR BETTER, EPOXY COATED AND GREASED
2. LONGITUDINAL JOINT SPACING SHOULD NOT EXCEED 15'-6" (TO BACK OF CURB). TRANSVERSE JOINT SPACE SHALL NOT EXCEED 15'-0". THE AREA OF THE PANEL SHALL NOT EXCEED 225 SQUARE FEET
3. JOINT OFFSETS AT RADIUS POINTS SHOULD BE AT LEAST 1'-6" LONG
4. JOINT INTERSECTION ANGLES OF LESS THAN 60 DEGREES SHALL BE USED
5. WHEN A JOINT IS CLOSER THAN 1'-0" TO A CASTING, THEN A MINOR ADJUSTMENT IN THE JOINT LOCATION SHOULD BE MADE BY SKEWING OR SHIFTING THE JOINT ALIGNMENT TO MEET THE CASTING AT 90° OR NORMAL TO THE CASTING.
6. WHERE POSSIBLE, LONGITUDINAL JOINTS SHOULD MATCH LANE MARKINGS
7. LONGITUDINAL JOINTS ARE TO BE CONSTRUCTION JOINTS UNLESS PAVED BY MACHINE CAPABLE OF PLACING AND FINISHING CONCRETE FOR TWO OR MORE PANEL WIDTHS (IN WHICH CASE A CONTRACTION JOINT IS ALLOWED)
8. DOWEL BARS SHALL NOT BE PLACED WITHIN 1'-0" OF THE EDGE OF PAVEMENT OR A PARALLEL JOINT

REF STD SPEC SEC 5-05 & 6-02




City of Seattle

NOT TO SCALE



TYPES OF JOINTS FOR CONCRETE PAVEMENT

STANDARD PLAN NO 410

REV DATE: 2003

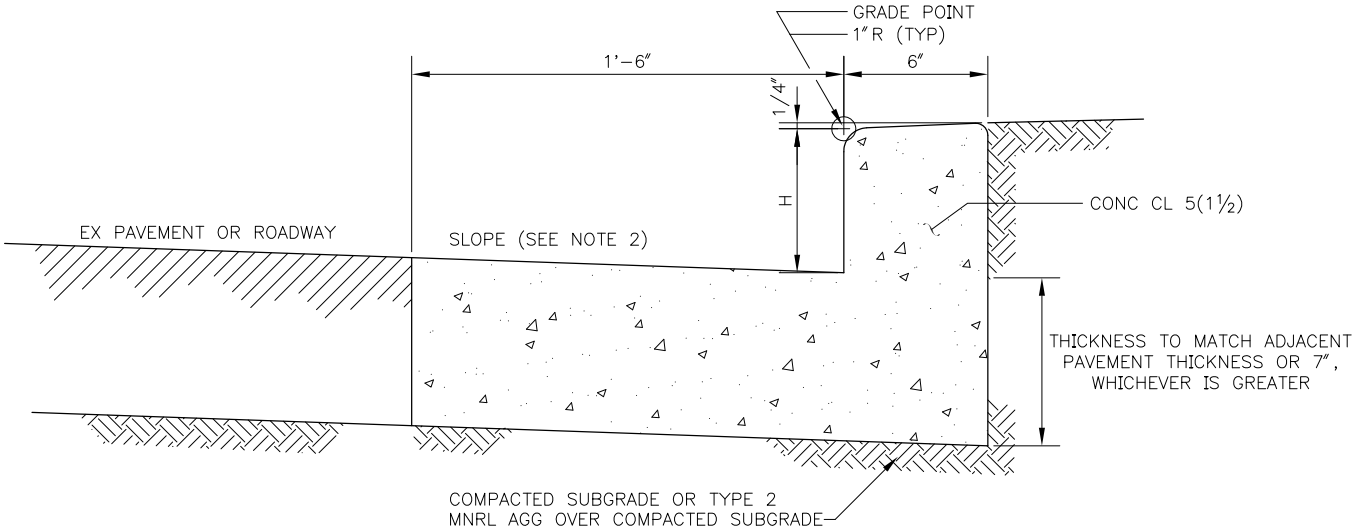

410B CURB & GUTTER

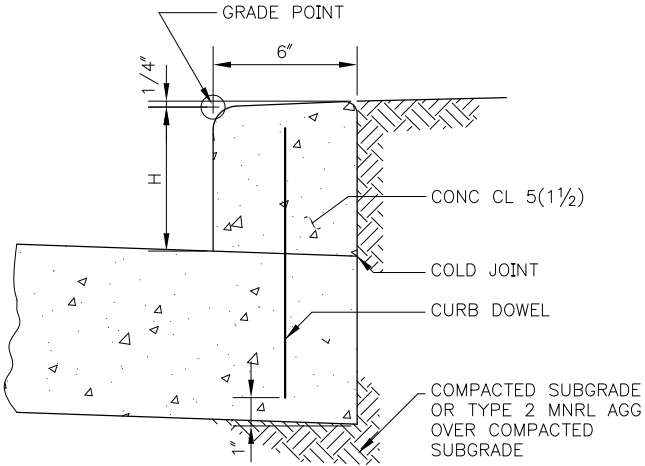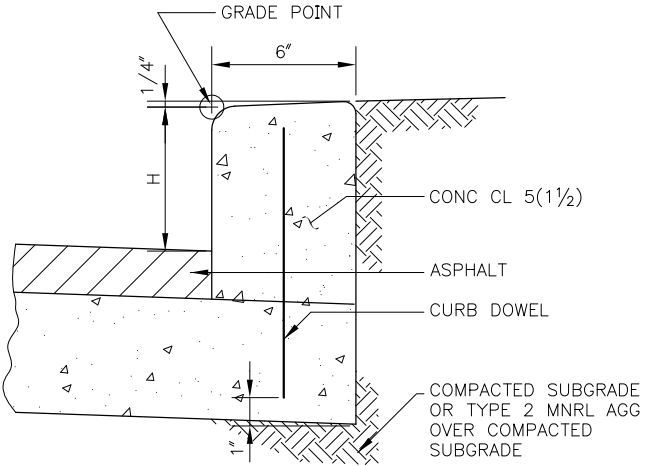

410C CURB

- NOTES:
1. "H" SHALL BE 6" FROM FINISHED ROADWAY GRADE UNLESS OTHERWISE SHOWN ON DRAWINGS
 2. GUTTER SHALL BE SLOPED THE SAME AS ADJACENT PAVEMENT OR 2% MIN, WHICHEVER IS GREATER.
 3. SEE STD PLAN NO 411 FOR CURB DOWELS


REF STD SPEC SEC 8-04



City of Seattle


NOT TO SCALE

TYPE 410 CURB

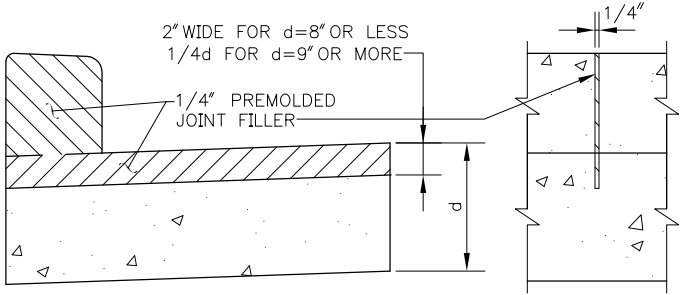


NOTE:
JOINT AND JOINT FILLER FOR CURB
OR FOR CURB & GUTTER, NOT
MATCHING PAVEMENT JOINT

CONTRACTION JOINT FOR
CURB OR CURB & GUTTER

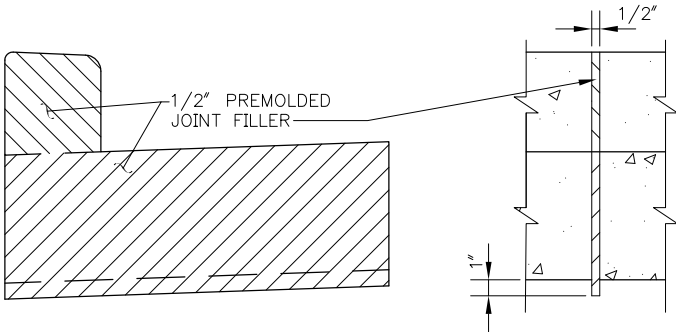

NOTE:
JOINT AND JOINT FILLER FOR CURB
OR FOR CURB & GUTTER, MATCHING
PAVEMENT JOINT

THROUGH JOINT FOR
CURB OR CURB & GUTTER

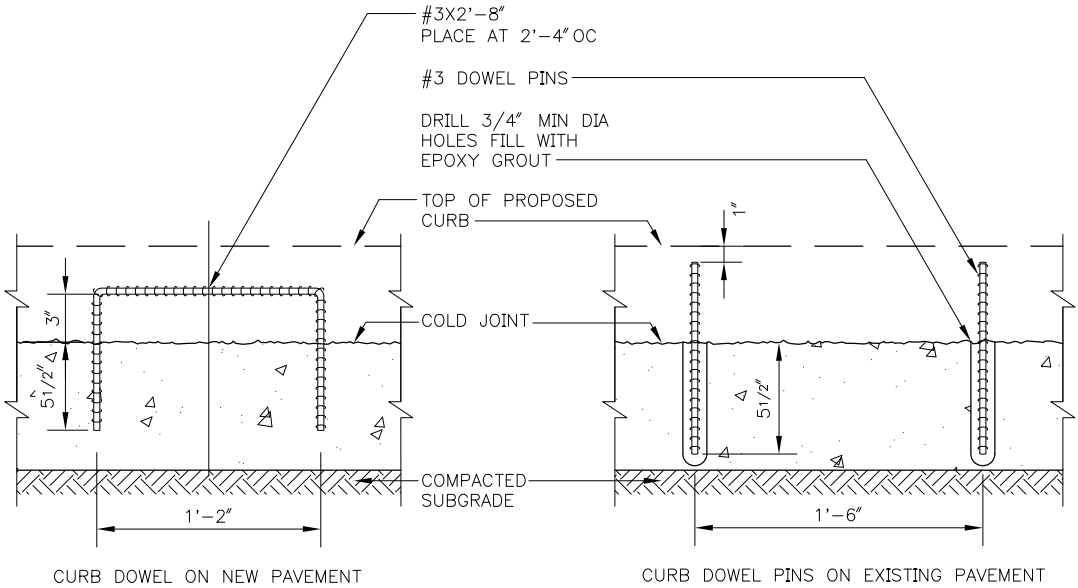

DOWELS FOR DOWELLED CURB CONSTRUCTION


REF STD SPEC SEC 6-02 & 8-04




City of Seattle

NOT TO SCALE

CURB JOINTS & DOWELS

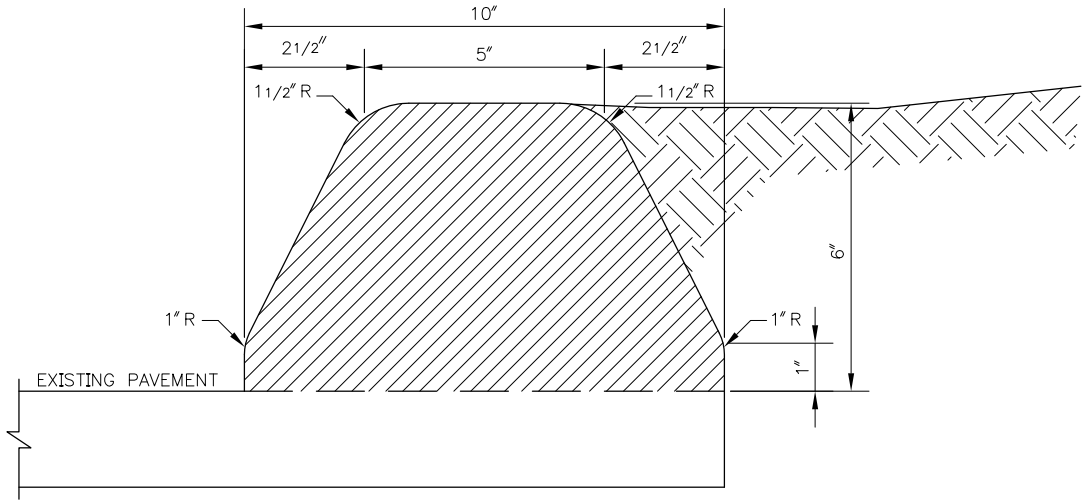

EXTRUDED ASPHALT CONCRETE CURB

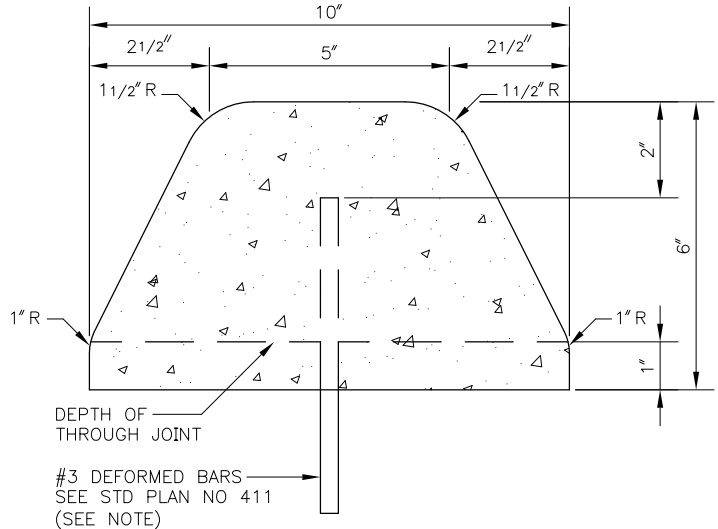

EXTRUDED CEMENT CONCRETE CURB


NOTE:
 ALTERNATELY, THE USE OF EPOXY BONDING AGENT,
 IN PLACE OF #3 DEFORMED BARS, WILL BE ALLOWED.

REF STD SPEC SEC 8-06




NOT TO SCALE


EXTRUDED CURB

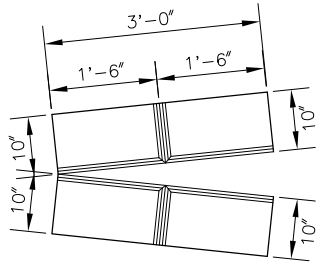


413A STRAIGHT SECTION




LONGITUDINAL SECTION THRU TRANSVERSE RIBS 3'-0" SECTION

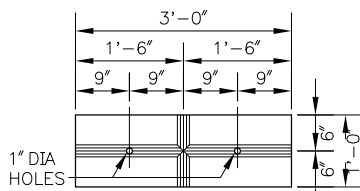


413C CURB 3'-0" SECTION

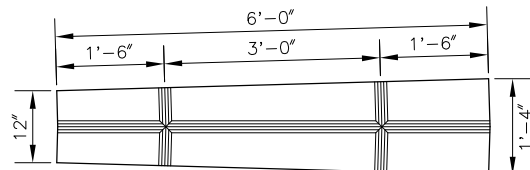


413A-1 CONNECTING DIVIDER

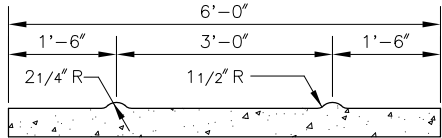


LONGITUDINAL SECTION THRU TRANSVERSE RIBS 6'-0" SECTION

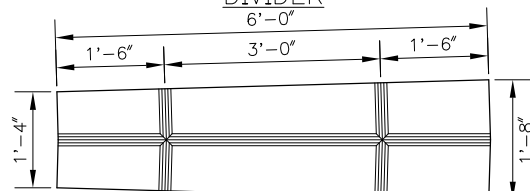


413A-2 CONNECTING DIVIDER




SECTION A CONNECTING DIVIDERS
THE MAIN BODY OF THE CURB AND THE LONGITUDINAL RIB SHALL FORM A UNIFORM TRANSITION FROM A TYPE C SECTION TO A TYPE A (BACK TO BACK) SECTION

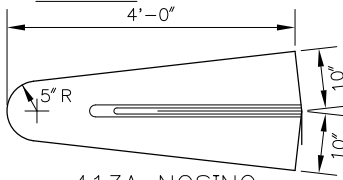


413A NOSING

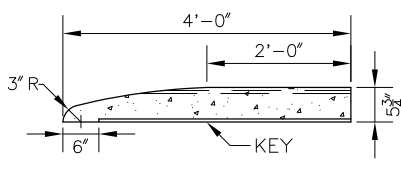


SECTION A & C NOSING

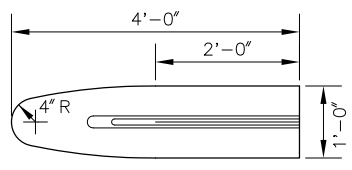


413C NOSING




413A RADIAL CURB
SEE TABLE BELOW

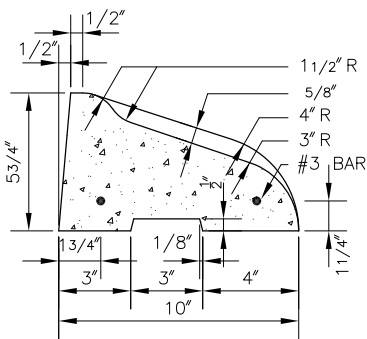

SECTION A STRAIGHT CURB

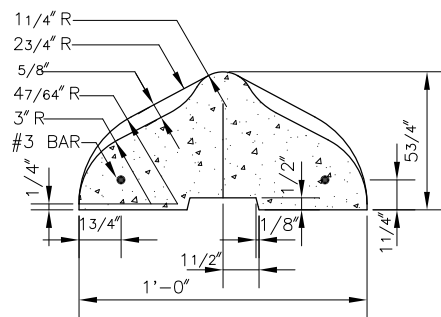

SECTION C CURB

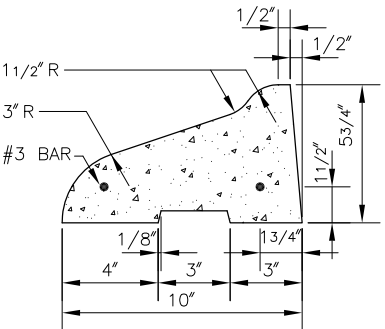

SECTION A RADIAL CURB

413 A RADIAL CURB		
UNIT	RADIUS	CURB RETURN ANGLE(θ)MULTIPLE
R1	1'- 3"	45°00'
R2	1'-10"	30°00'
R3	2'- 6"	22°30'
R4	5'- 0"	11°27.54'
R5	10'- 0"	5°43.77'

FOR RADII GREATER THAN 10'-0" USE SEGMENTS OF STRAIGHT CURB

REF STD SPEC SEC 8-07




NOT TO SCALE


TRAFFIC CURB PRECAST CEMENT CONCRETE

STANDARD PLAN NO 414

REV DATE: 2003

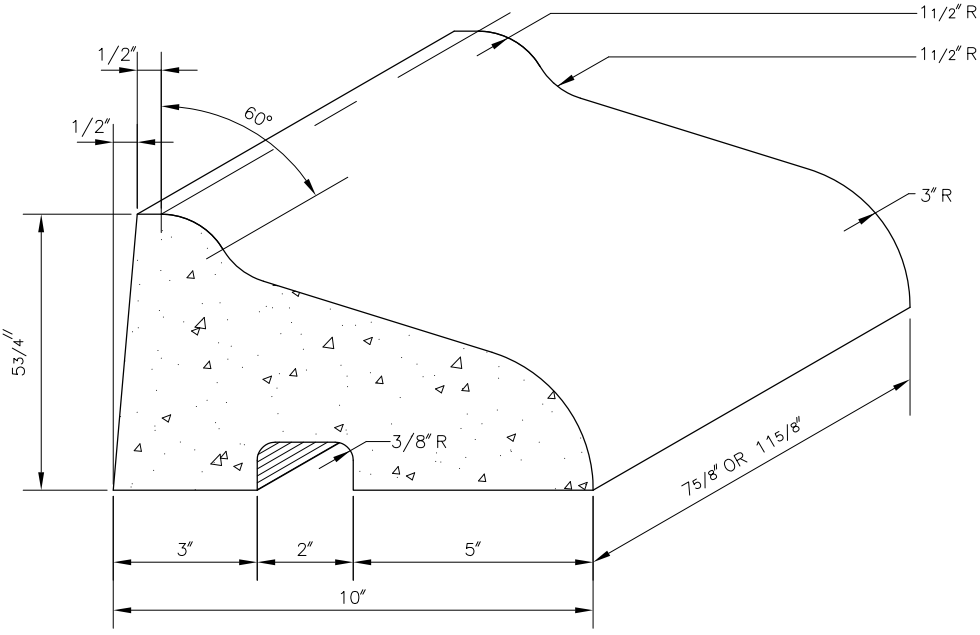

414 A BLOCK

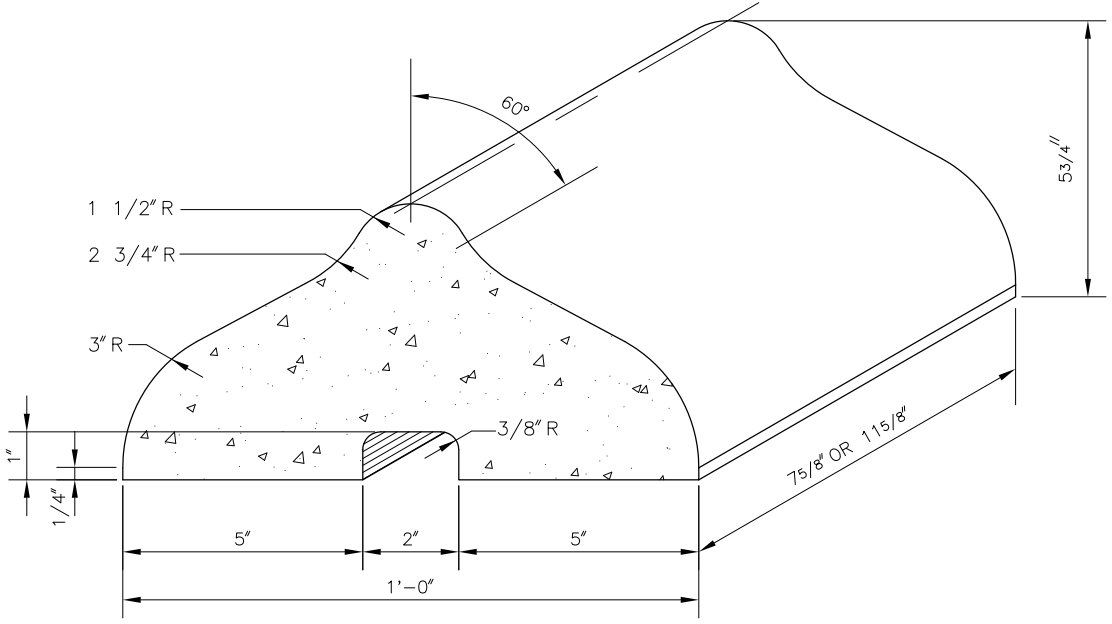

414 C BLOCK

REF STD SPEC SEC 8-07




City of Seattle

NOT TO SCALE


BLOCK TRAFFIC CURBS
PRECAST CEMENT CONCRETE

STANDARD PLAN NO 415

REV DATE: 2003

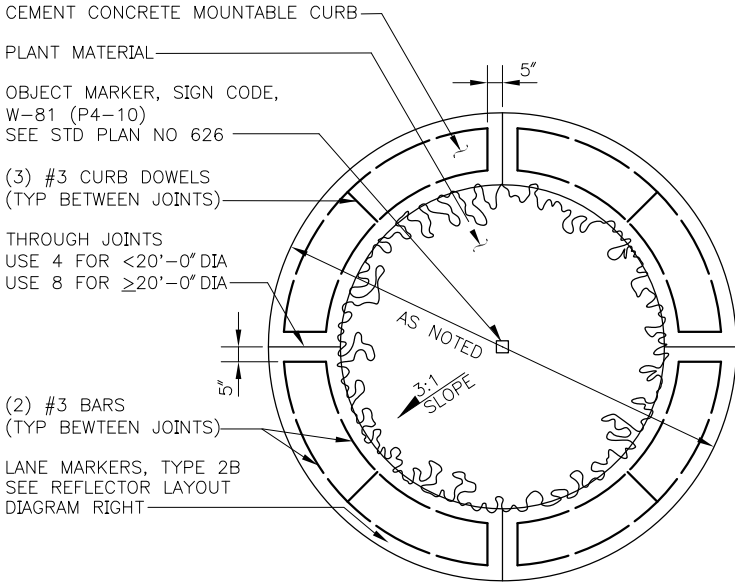

TYPICAL TRAFFIC CIRCLE

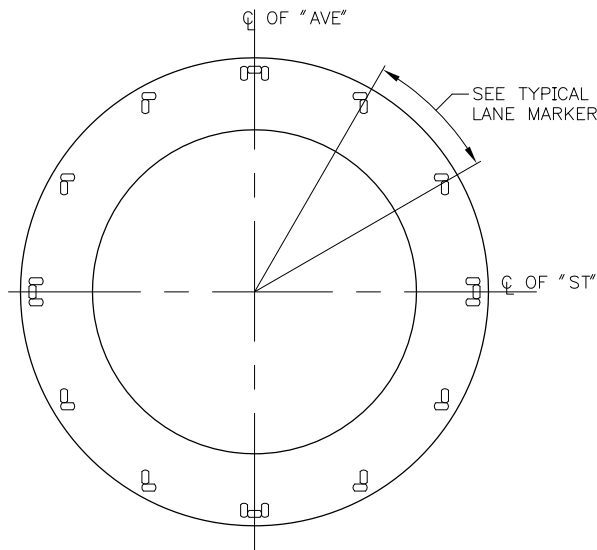


TRAFFIC CIRCLE REFLECTOR LAYOUT

SPACING CHART

DIAMETER OF CIRCLE	DEGREE OF SPACING
<12'-0"	EVERY 45°
<20'-0"	EVERY 30°
>20'-0"	EVERY 22 1/2°

(FACING VEHICLE APPROACHES)

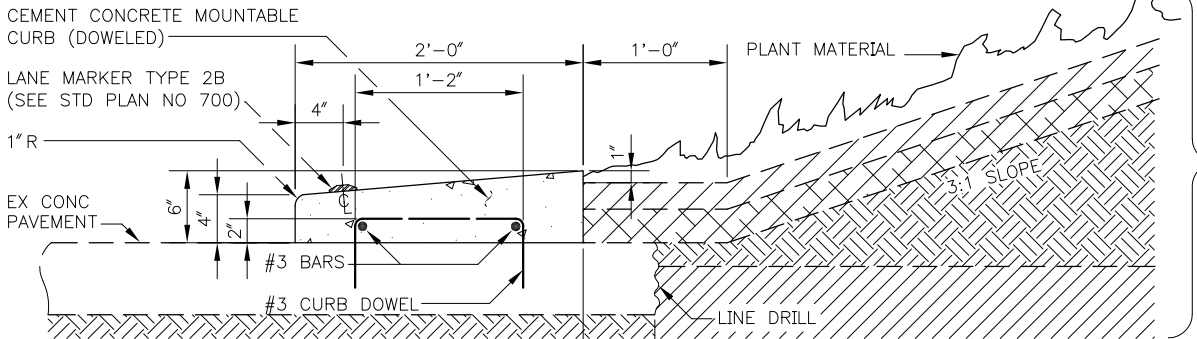


TYPICAL SECTION

FOR LANDSCAPING REQUIREMENTS SEE SDOT TRAFFIC CIRCLE GUIDELINE PUBLICATION


REMOVE PAVEMENT AND BASE COURSE THOROUGHLY LOOSEN SUBSOIL TO 6" DEPTH (AFTER COMPLETE REMOVAL OF ALL PAVEMENT AND BASE MATERIAL)

NOTES:

1. DIMENSIONS ABOVE PAVEMENT EXTENSION TO MATCH SECTION DETAILED ELSEWHERE ON THIS STD PLAN
2. EXTEND CURB DEPTH TO MATCH ADJACENT ASPHALT THICKNESS OR 7" WHICHEVER IS GREATER

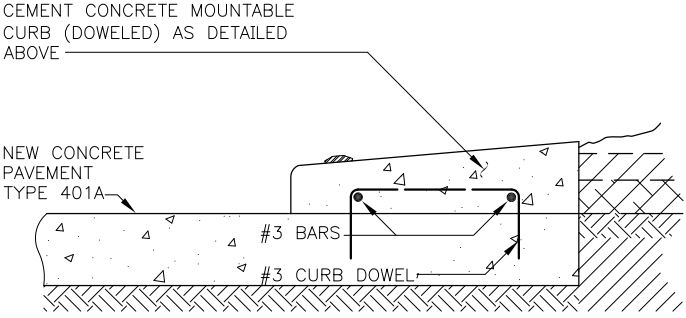

SEE TYP SECTION ABOVE FOR DIMENSIONS

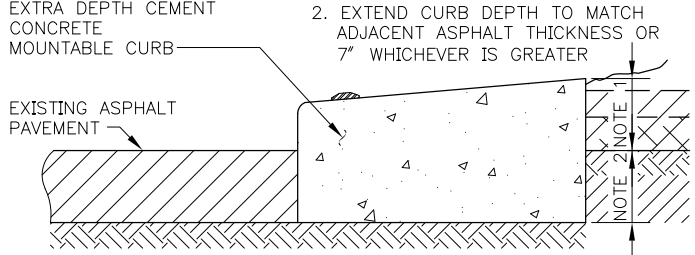

TYPICAL SECTIONS

REF STD SPEC SEC 8-02, 8-04 & 8-08




City of Seattle

NOT TO SCALE


TRAFFIC CIRCLE DETAILS

STANDARD PLAN NO 420


REV DATE: 2003

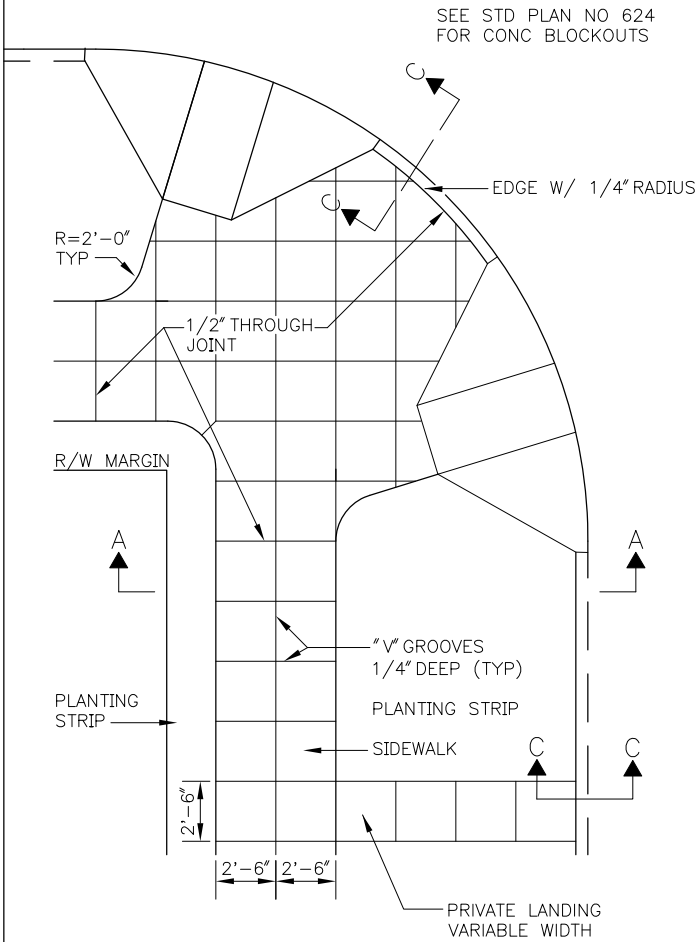


SIDEWALK
5'-0" WIDE

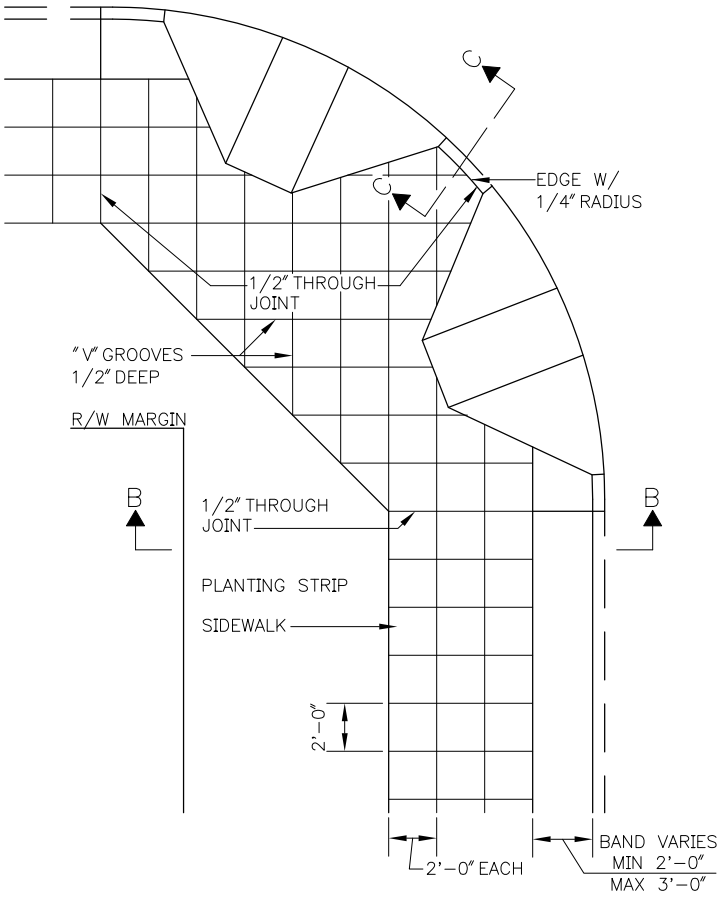

SIDEWALK
GREATER THAN
5'-0" WIDE

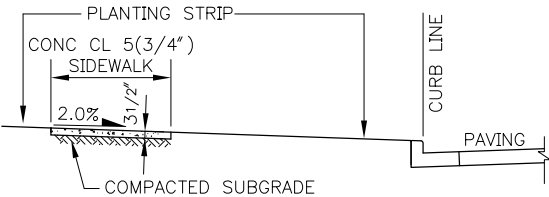


SECTION A-A

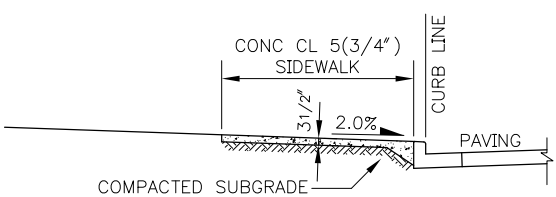

SECTION B-B

NOTES:

1. WHEN PLANTING STRIP PAVEMENT IS APPROVED, JOINT MATERIAL WILL BE REQUIRED AT THE PERIMETER OF THE PLANTING STRIP PAVEMENT
2. WHEN EXISTING PARKING METERS ARE TO BE REMOVED FOR NEW SIDEWALK CONSTRUCTION, CONTACT SEATTLE DEPARTMENT OF TRANSPORTATION A MINIMUM OF 2 WORKING DAYS PRIOR TO SCHEDULED WORK TO COORDINATE REMOVAL OF METER HEADS

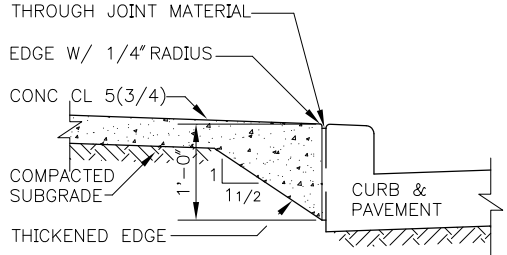

SECTION C-C

REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE

CONCRETE SIDEWALK DETAILS

STANDARD PLAN NO 421

REV DATE: 2003

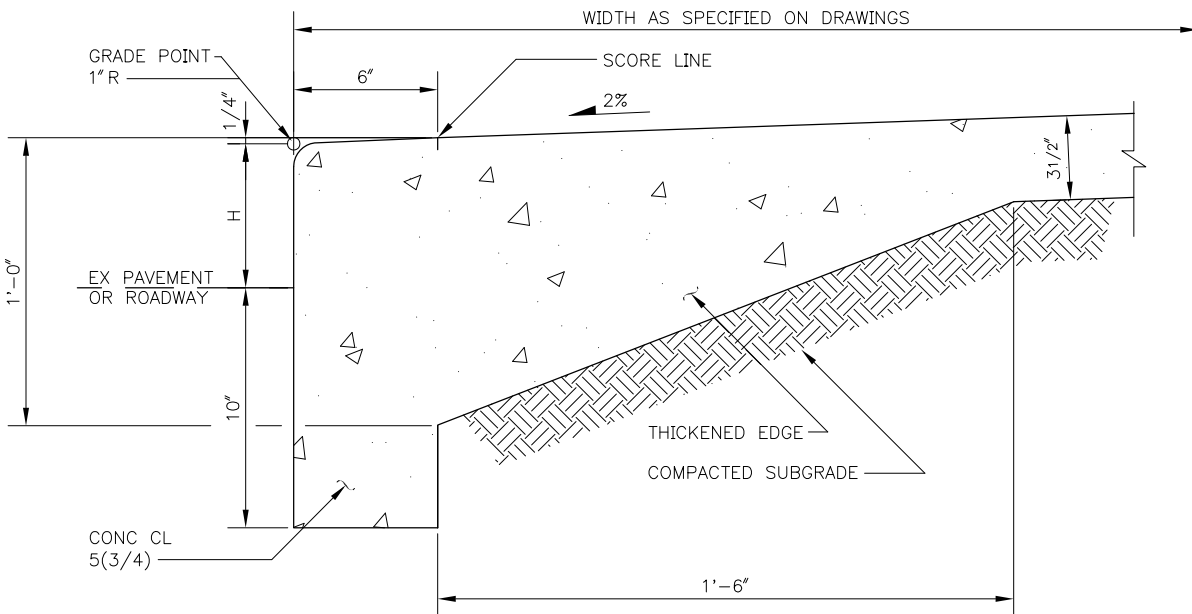

NOTES:




- 1. "H" SHALL BE 6" FROM FINISHED GRADE UNLESS OTHERWISE SPECIFIED
- 2. VERTICAL BACKFACE OF CURB SHALL BE FORMED AGAINST NATIVE EARTH WHERE PRACTICAL, OTHERWISE BY BACKFORM LEFT IN PLACE

REF STD SPEC SEC 8-14




NOT TO SCALE

SIDEWALK WITH MONOLITHIC CURB

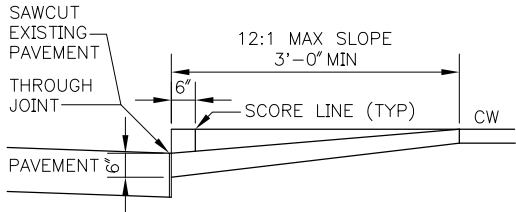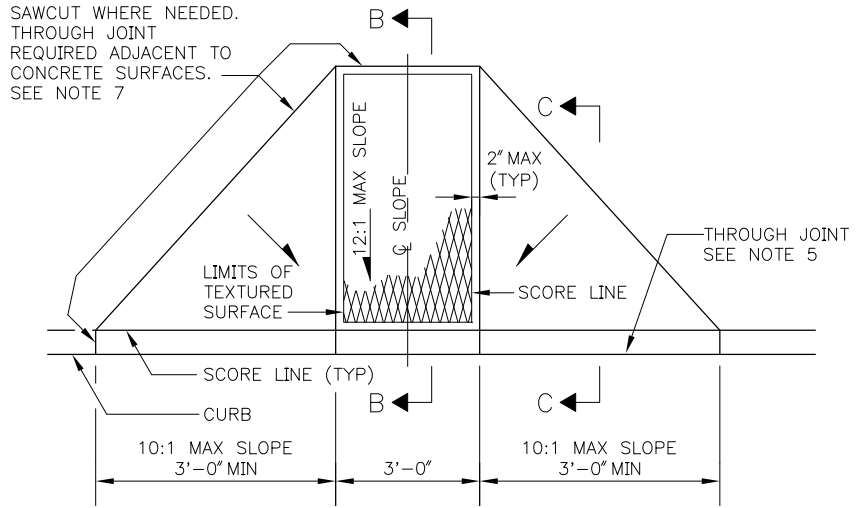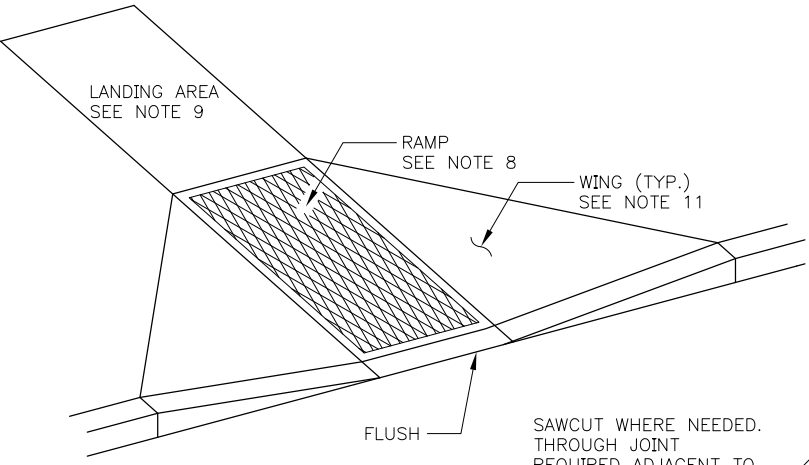

SECTION B-B
CURB MONOLITHIC WITH RAMP.
NEW PAVEMENT BLOCKED OUT FULL DEPTH.
EXISTING PAVEMENT REMOVED AT FACE OF CURB

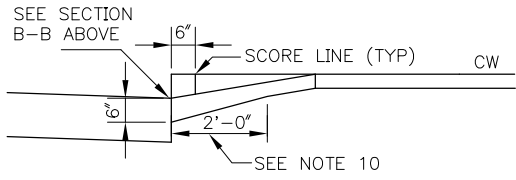

SECTION C-C

- NOTES:**
1. TWO CURB RAMPS SHALL BE INSTALLED AT EACH CORNER UNLESS DIRECTED OTHERWISE BY SDOT.
 2. CURB RAMPS SHALL BE CONSTRUCTED WITH COMPANION RAMPS ON OPPOSITE SIDES OF THE STREET UNLESS DIRECTED OTHERWISE BY SDOT
 3. WHERE CURB IS INSTALLED AT A LOCATION WITH NO SIDEWALK, CURB SHALL BE DEPRESSED FOR FUTURE CURB RAMP INSTALLATION.
 4. TYPE 422a CURB RAMP SHALL BE USED. HOWEVER IF NOT FEASIBLE, THEN TYPE 422b CURB RAMP MAY BE INSTALLED WITH THE APPROVAL OF SDOT
 5. NEW PAVEMENT SHALL BE BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT SHALL BE REMOVED AT THE FACE OF THE CURB.
 6. MIN DISTANCE BETWEEN ADJACENT CURB RAMPS SHALL BE 3'-0".
 7. CURB RAMPS SHALL BE ISOLATED FROM ALL OTHER CONCRETE BY THROUGH JOINTS.
 8. RAMPS SHALL HAVE A COARSE TEXTURED SURFACE OBTAINED WITH A 3/4" 9-11 FLATTENED EXPANDED METAL MESH BEING PRESSED INTO THE STILL FRESH CONCRETE. THE LONG AXIS OF THE DIAMOND PATTERN SHALL BE ALIGNED WITH THE SLOPE OF THE RAMP.
 9. ADDITIONAL SIDEWALK PAVING MAY BE NECESSARY IN THE PLANTING STRIP OR AT THE BACK OF SIDEWALK TO ACCOMODATE ACCESS TO THE RAMP. A MINIMUM 3'-0" x 5'-0" 2% MAX. GRADE LANDING SHALL BE PROVIDED AT THE TOP OF RAMP ON TYPE 422a.
 10. THE SIDEWALK THICKENED EDGE SHALL BE CONTINUED THROUGH BOTH WINGS ON TYPE 422a AND BOTH RAMPS ON TYPE 422b. SEE STD. PLAN NO 420.
 11. THE WINGS ON TYPE 422a SHALL HAVE A SLIGHTLY BRUSHED FINISH PARALLEL TO THE CURB.
 12. MIN LATERAL CLEARANCE FROM INLETS, POLES, HYDRANTS AND OTHER ABOVE GROUND OBSTACLES SHALL BE 1'-0" FROM THE SCORED PORTION OF THE CURB RAMP.
 13. INLETS SHALL BE SO LOCATED THAT GUTTER FLOW DOES NOT FLOW PAST THE CURB RAMP.



REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE

CURB RAMP DETAILS

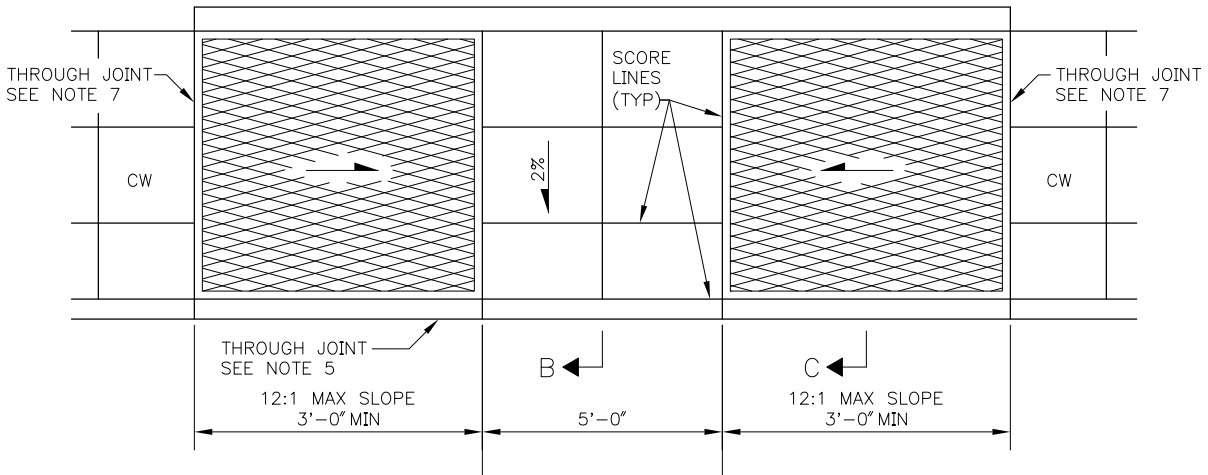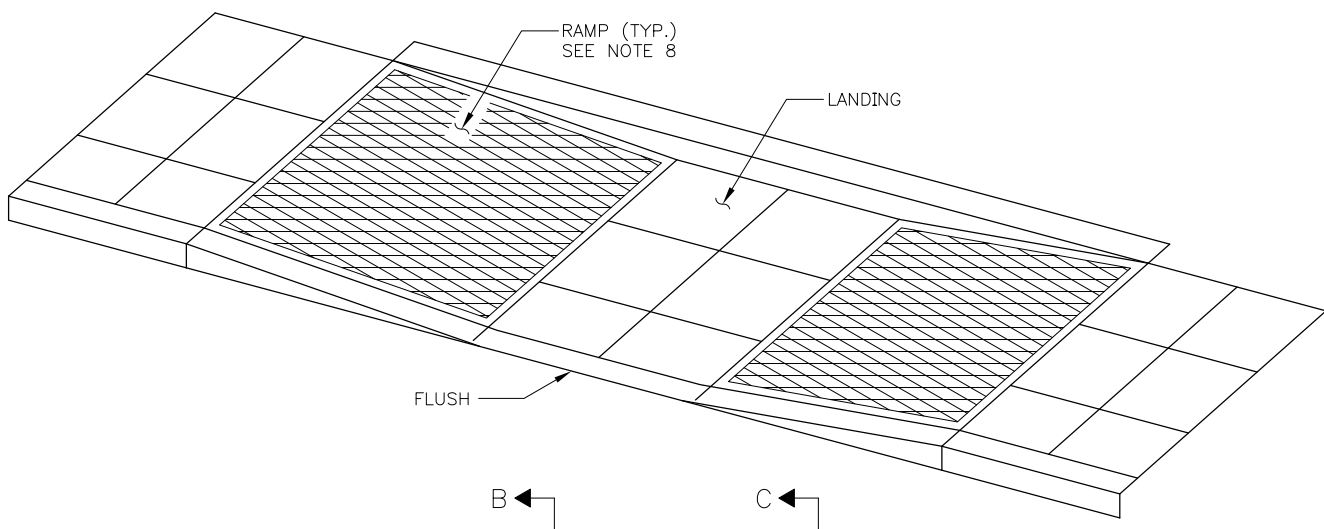


SECTION A-A

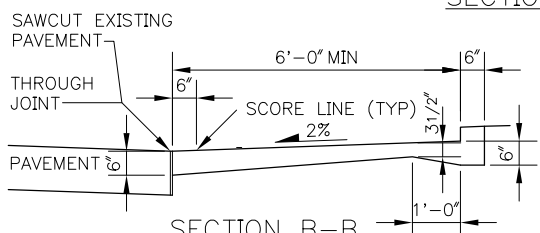


SECTION B-B

CURB MONOLITHIC WITH RAMP. NEW PAVEMENT BLOCKED OUT FULL DEPTH. EXISTING PAVEMENT REMOVED AT FACE OF CURB

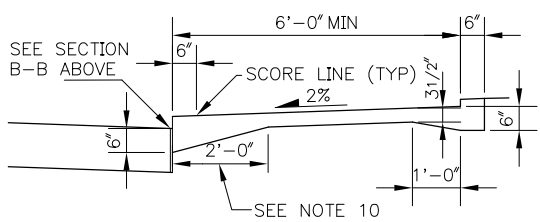

SECTION C-C

SEE STD PLAN NO 422a FOR NOTES

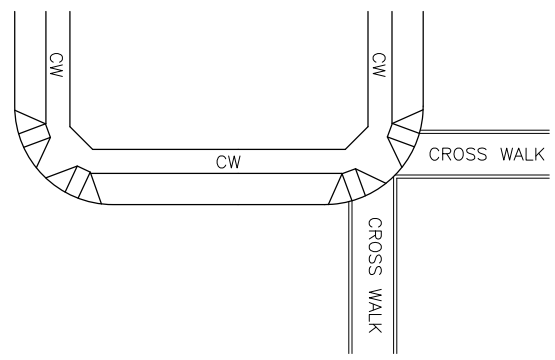

TYPICAL CURB RAMP LOCATIONS

REF STD SPEC SEC 8-14




City of Seattle

NOT TO SCALE




CURB RAMP DETAILS

STANDARD PLAN NO 423

REV DATE: 2003

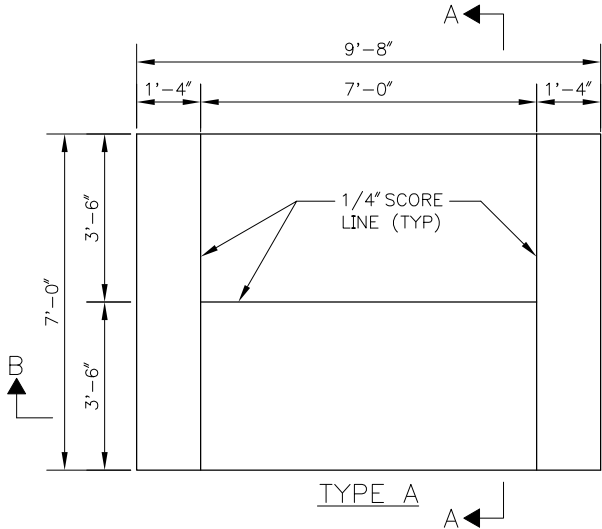

NOTE:
 CONCRETE SHALL
 BE 3000 PSI MIN
 @28 DAYS. STEEL
 TROWEL SURFACE
 W/ BROOM FINISH

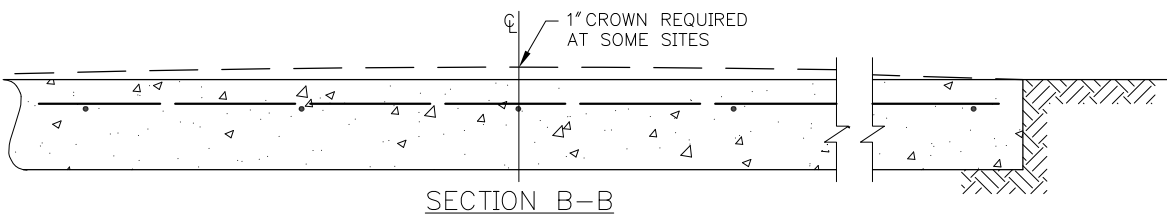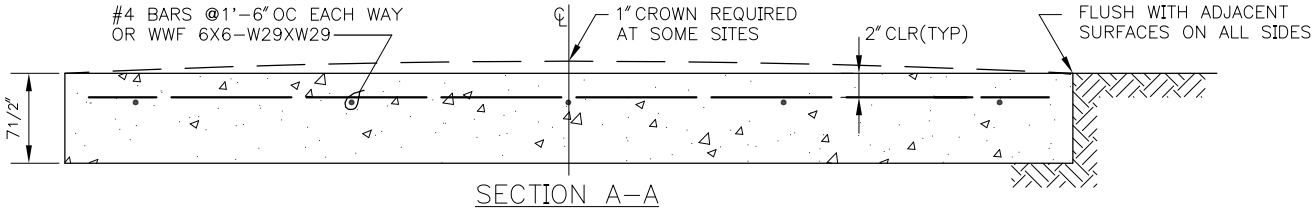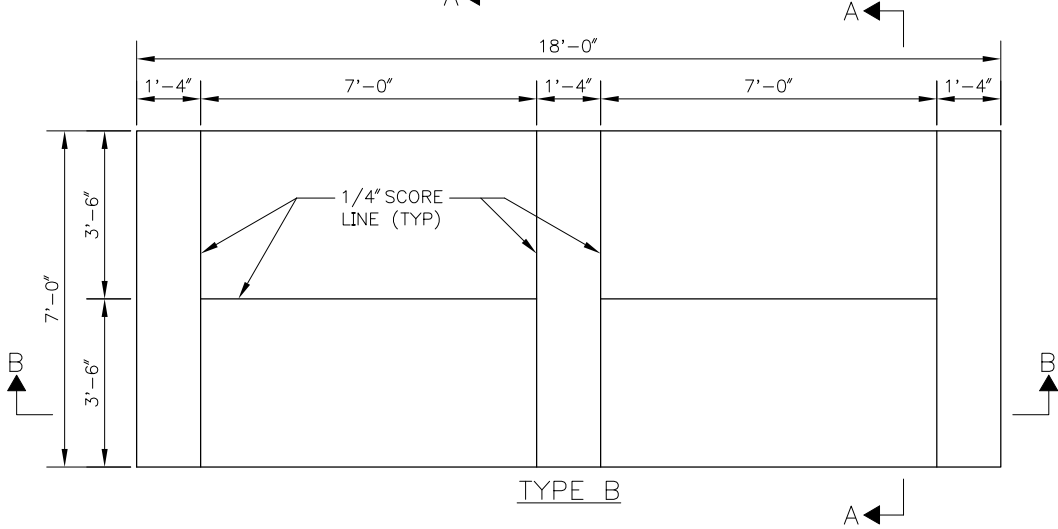


REF STD SPEC SEC 8-14



City of Seattle

NOT TO SCALE

BUS SHELTER FOOTING

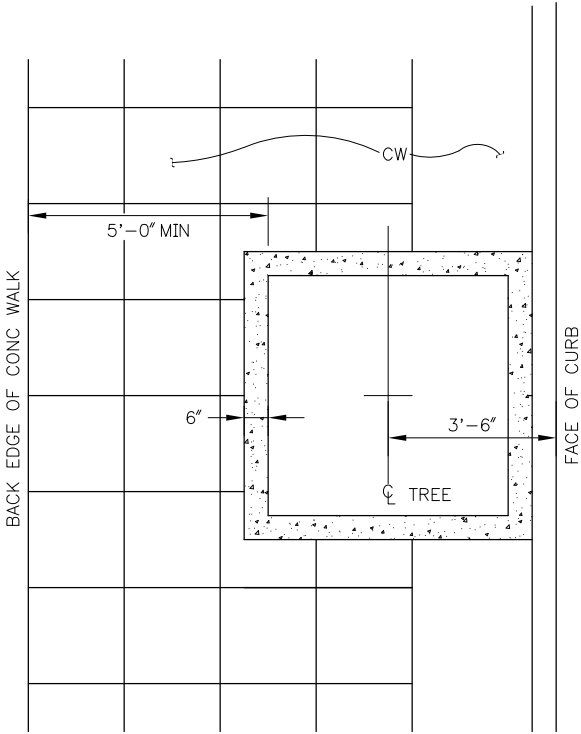

- TREE PIT DIMENSIONAL REQUIREMENTS:
- 24 SQ FT MIN TREE PIT SIZE
 - 3'-6" MIN REQ'D BETWEEN TREE ϕ & FACE OF CURB
 - 2'-0" MIN REQ'D BETWEEN TREE ϕ & CONC SIDEWALK
 - 5'-0" MIN CONC WALKING SURFACE

NOTE:
 INSTALLATIONS REQUIRING LESS THAN STANDARD MIN CLEARANCES SHALL BE ALLOWED ONLY WITH SPECIFIC APPROVAL BY SEATTLE TRANSPORTATION

FOR ADDITIONAL SIDEWALK SCORING REQUIREMENTS SEE STD PLAN NO 420



REF STD SPEC SEC 8-02 & 8-14



City of Seattle

NOT TO SCALE

TREE PIT DETAIL

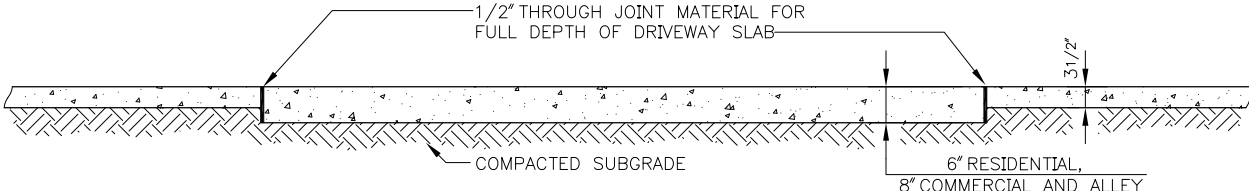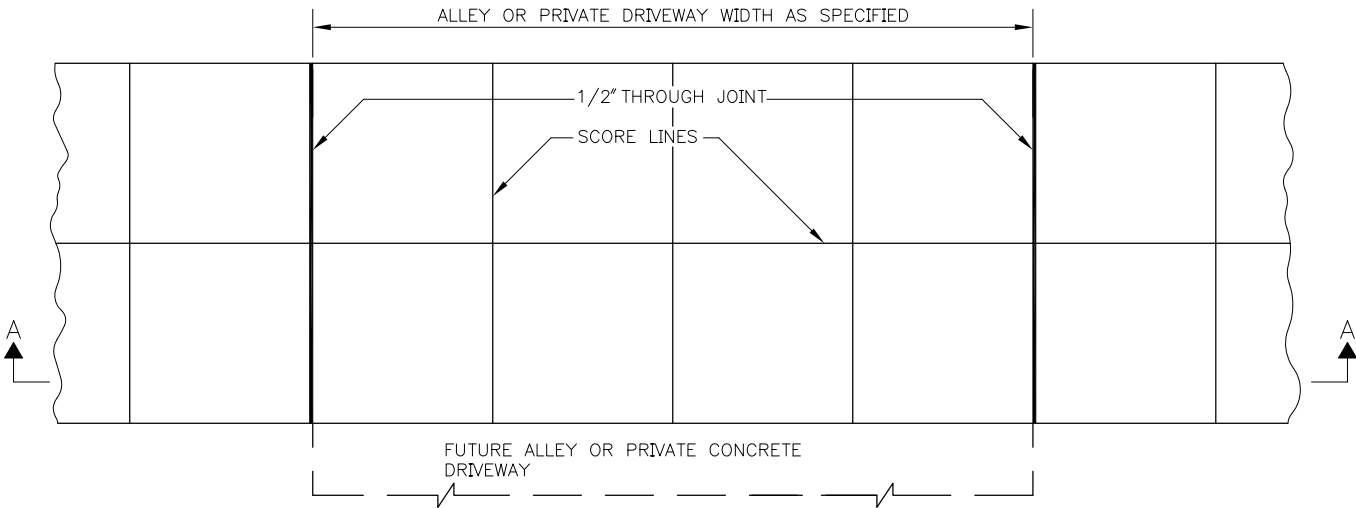

SECTION A-A

- NOTES:
1. DRIVEWAY WIDTH GREATER THAN 15'-0" SHALL HAVE TRANSVERSE CONTRACTION JOINT AT ITS CENTER
 2. DRIVEWAY CONCRETE SHALL BE CLASS 6(3/4) OR 6(1 1/2) AT CONTRACTOR'S OPTION
 3. SIDEWALK CONCRETE SHALL BE CLASS 5(3/4)

REF STD SPEC SEC 8-14 & 8-19




NOT TO SCALE


CONCRETE DRIVEWAY PLACED WITH SIDEWALK CONSTRUCTION

STANDARD PLAN NO 440b


REV DATE: 2003

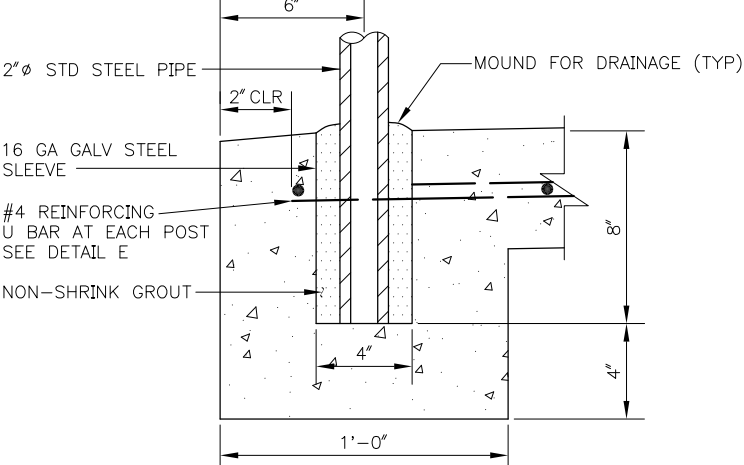

DETAIL A

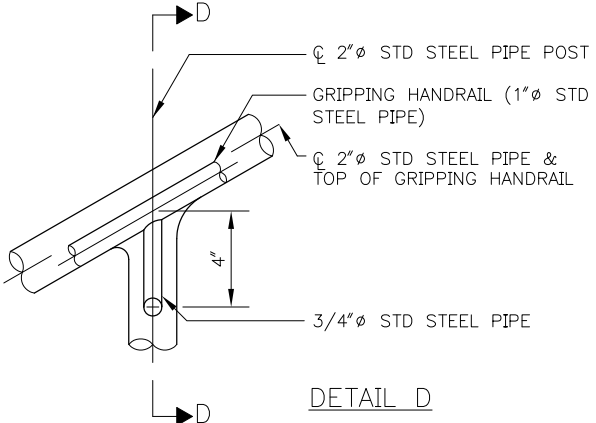


DETAIL D

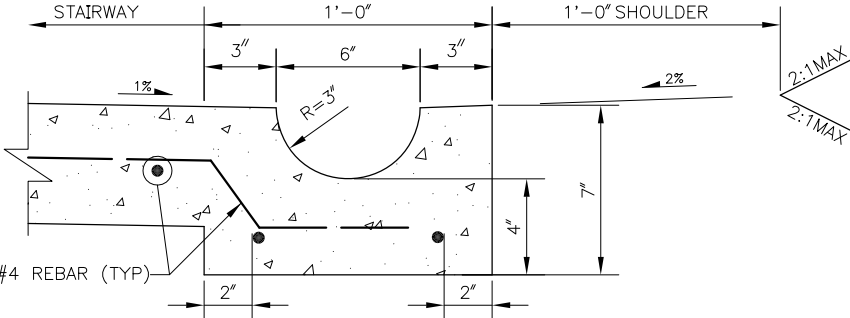


DETAIL B


SEE NOTE 11 ON STD PLAN NO 440a

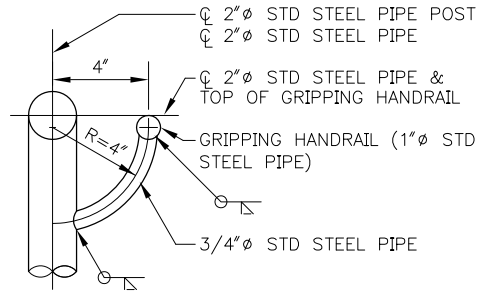


SECTION D-D

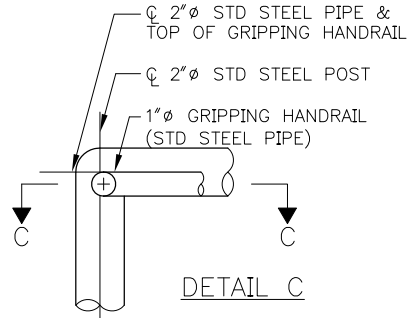


DETAIL C

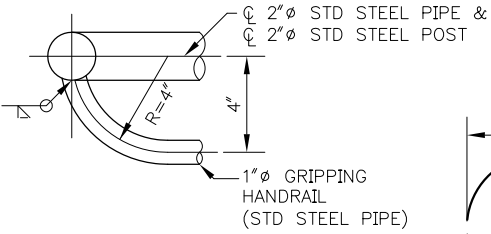

SECTION C-C

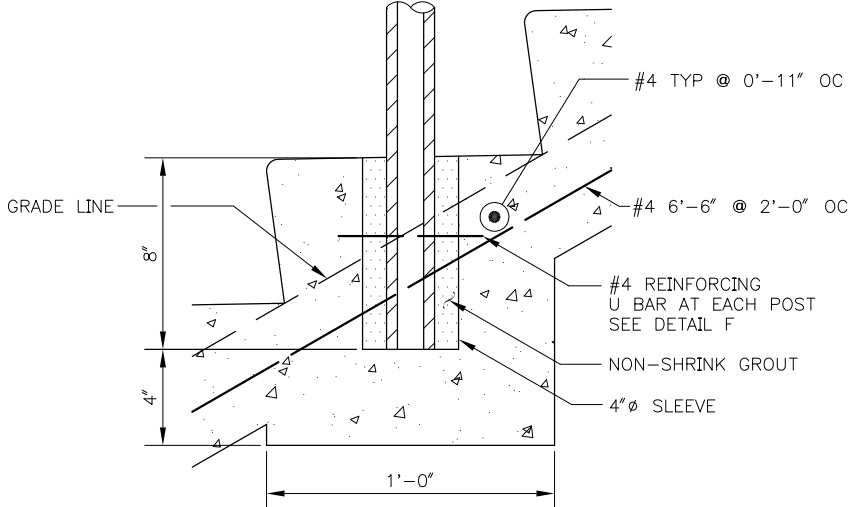

DETAIL E

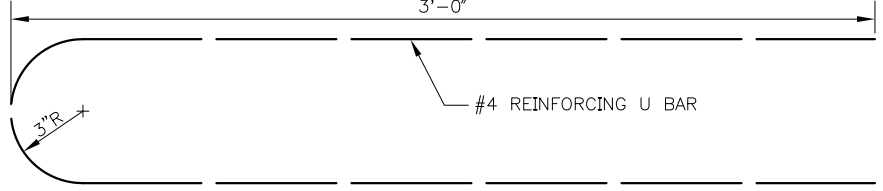

DETAIL F

REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE


CEMENT CONCRETE STAIRWAY & HANDRAIL

STANDARD PLAN NO 441

REV DATE: 2003

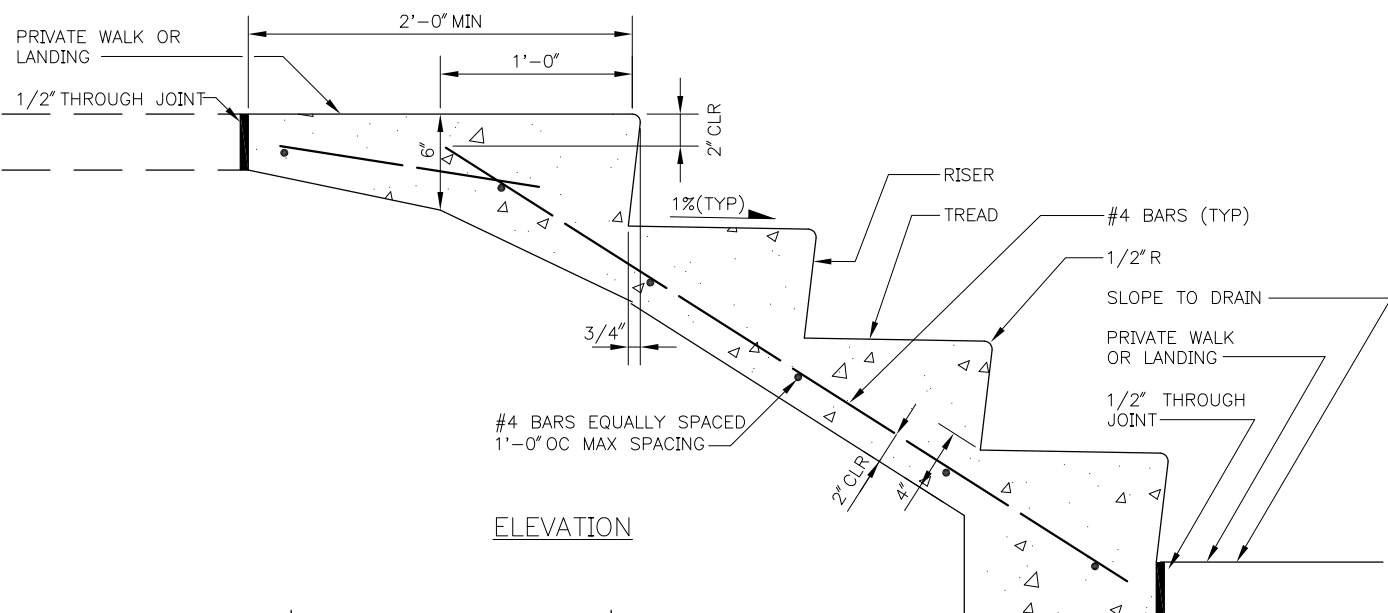

ELEVATION

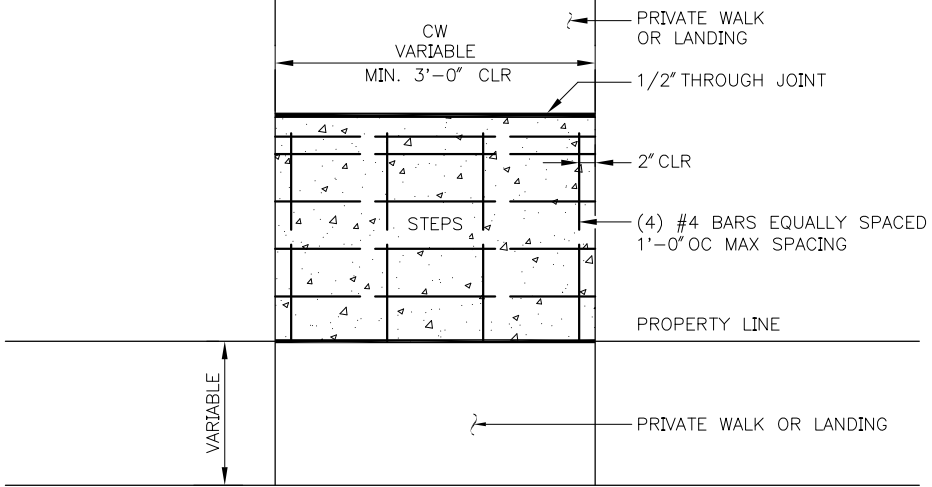

PLAN

- NOTES:
1. CEMENT CONCRETE SHALL BE CL 6 (3/4) TROWEL FINISH
 2. NUMBER OF STEPS SHALL SUIT INDIVIDUAL CONDITIONS WITH UNIFORM TREAD AND RISER DIMENSIONS AS FOLLOWS:
TREADS SHALL BE 11" MIN - 1'-0" MAX
RISERS SHALL BE 5" MIN - 7" MAX
 3. STEP WIDTH SHALL MATCH WIDTH OF EXISTING WALK, BUT SHALL BE NO LESS THAN 2'-6" WIDE
 4. STEPS WITH 4 OR MORE RISERS MUST INCLUDE HANDRAIL.
SEE STD PLAN NO 440
 5. REINFORCING STEEL ASTM A615 GR 60
 6. TREAD SLOPES OUTWARD @1%

REF STD SPEC SEC 8-18





City of Seattle

NOT TO SCALE







CEMENT CONCRETE STEPS

STANDARD PLAN NO 442

REV DATE: 2003

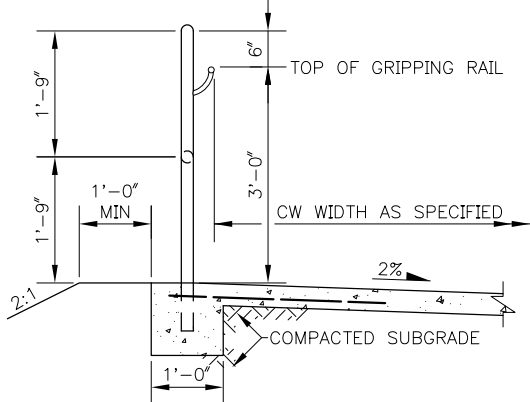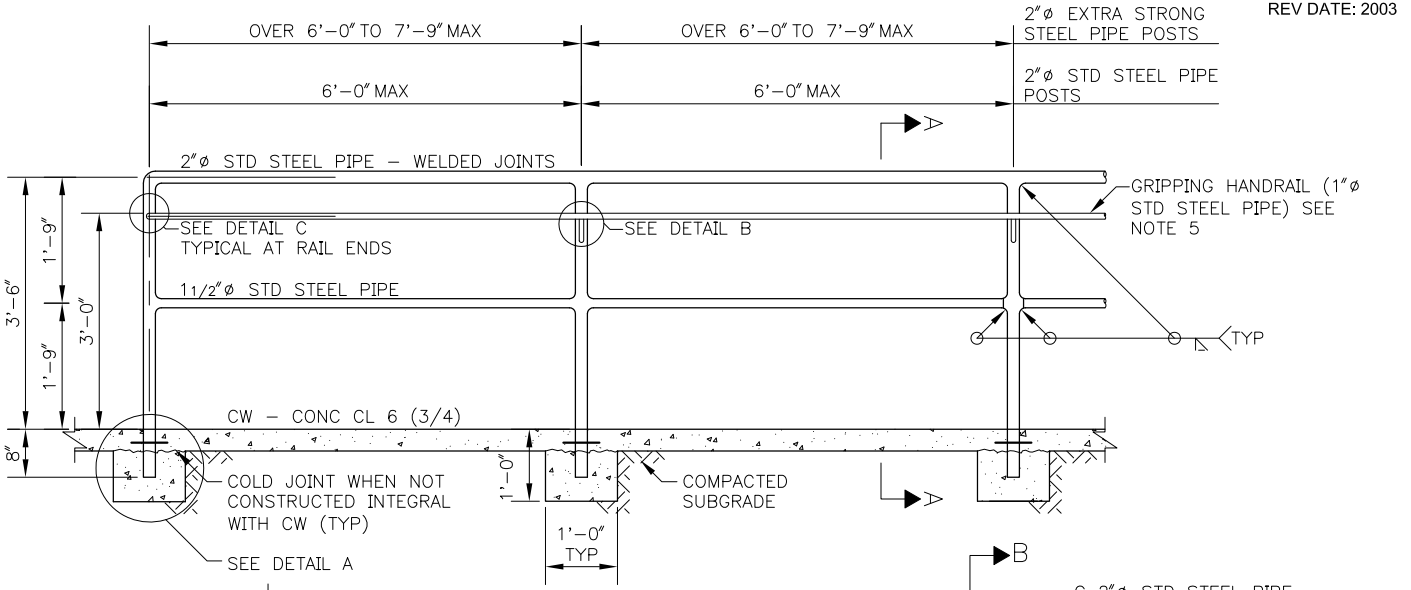

- NOTES:**
1. RAILING SHALL BE HOT DIP GALVANIZED AFTER FABRICATION
 2. ALL POSTS SHALL BE PLUMB AND RAILS PARALLEL TO THE GROUND
 3. PIPE MATERIAL SHALL CONFORM TO ASTM A 53
 4. REINFORCING STEEL ASTM A 615 GR 60
 5. IF THE CONCRETE WALK SLOPE IS 5% OR GREATER A GRIPPING HANDRAIL IS REQUIRED
 6. PIPE DIAMETERS SHOWN ARE "NOMINAL" DIAMETERS AS GIVEN IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL

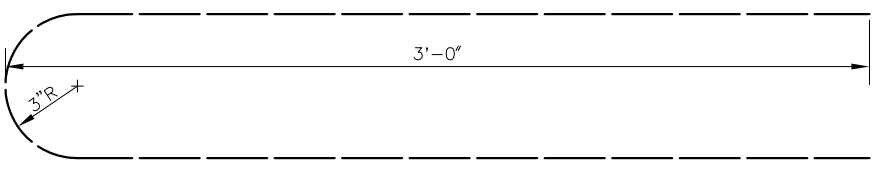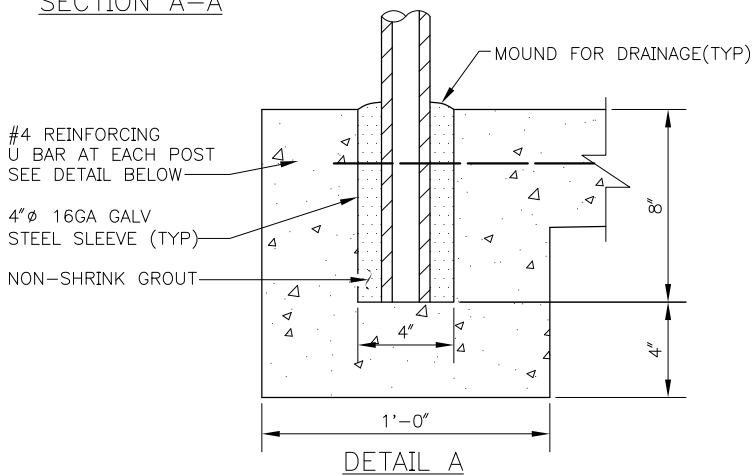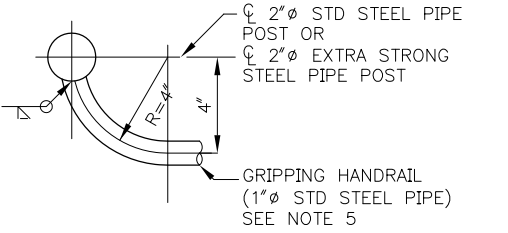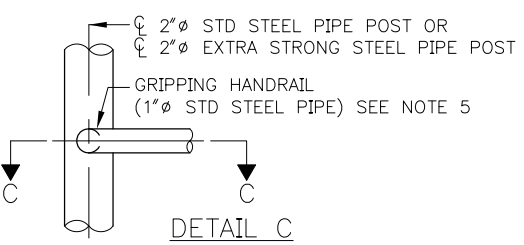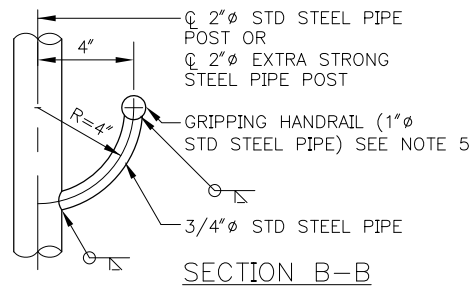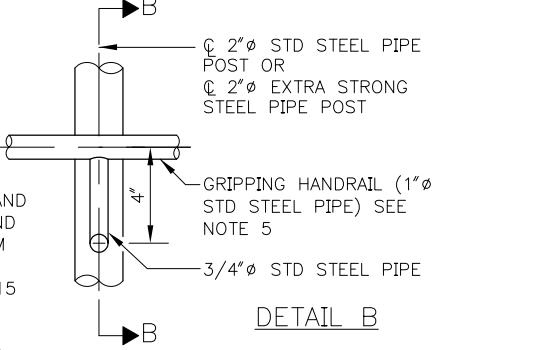

REF STD SPEC SEC 8-14 & 8-18





City of Seattle

NOT TO SCALE

STEEL PIPE HANDRAIL

STANDARD PLAN NO 443a

REV DATE: 2003

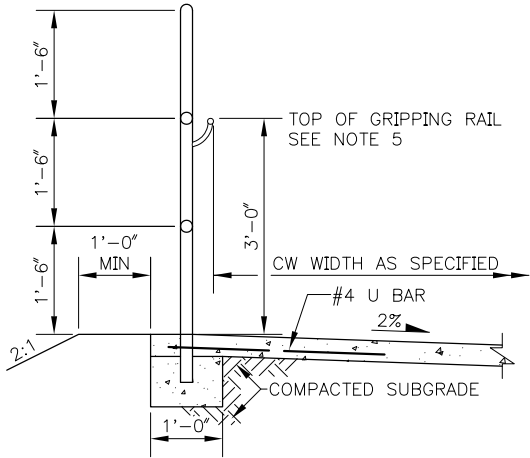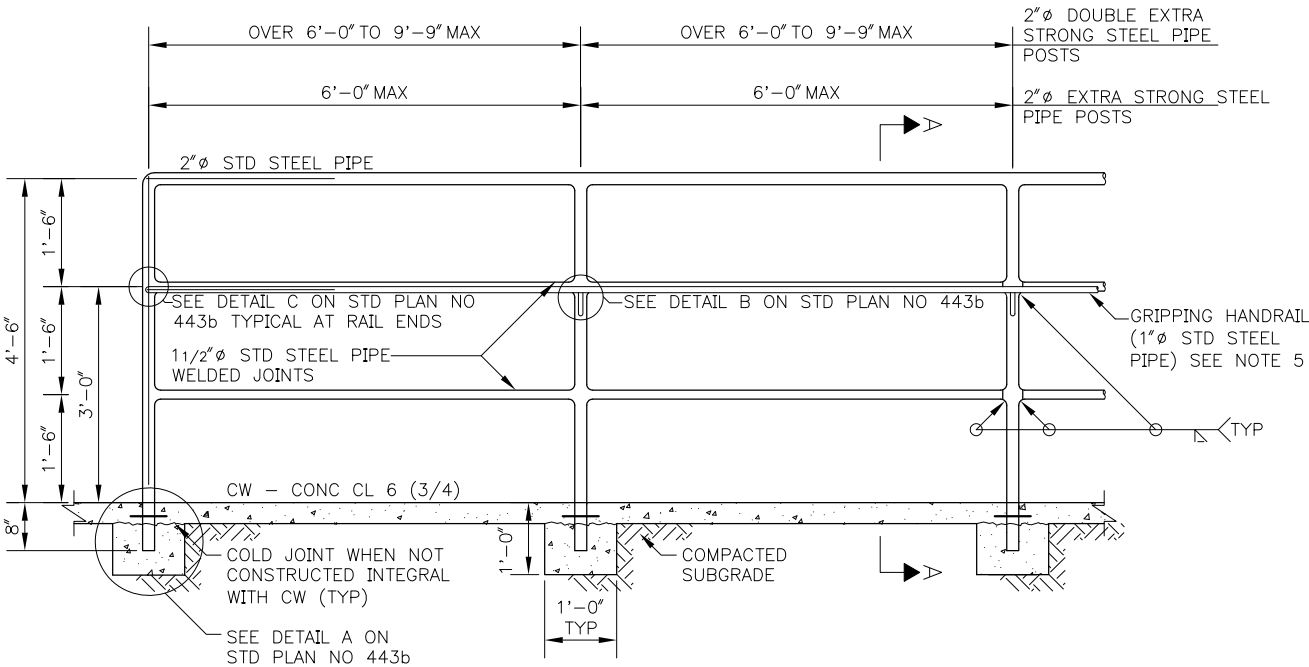

SECTION A-A

NOTES:

1. RAILING SHALL BE HOT DIP GALVANIZED AFTER FABRICATION
2. ALL POSTS SHALL BE PLUMB AND RAILS PARALLEL TO GRADE
3. PIPE MATERIAL SHALL CONFORM TO ASTM A53
4. REINFORCING STEEL ASTM A615 GR 60
5. IF THE CONCRETE WALK SLOPE IS 5% OR GREATER A GRIPPING HANDRAIL IS REQUIRED
6. PIPE DIAMETERS SHOWN ARE "NOMINAL" DIAMETERS AS GIVEN IN AMERICAN INSTITUTE OF STEEL CONSTRUCTION MANUAL







REF STD SPEC SEC 8-18



City of Seattle

NOT TO SCALE

STEEL PIPE RAILING FOR BIKE PATH

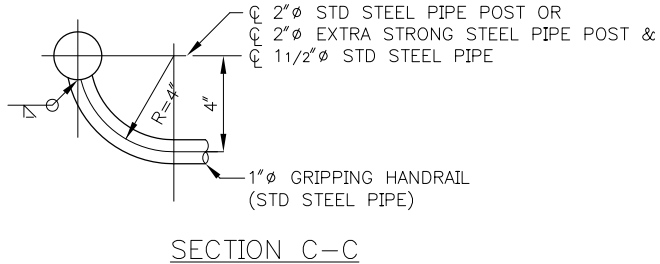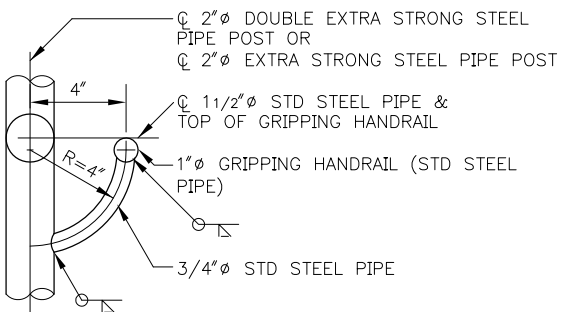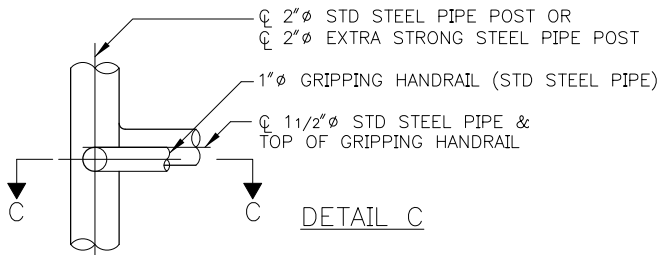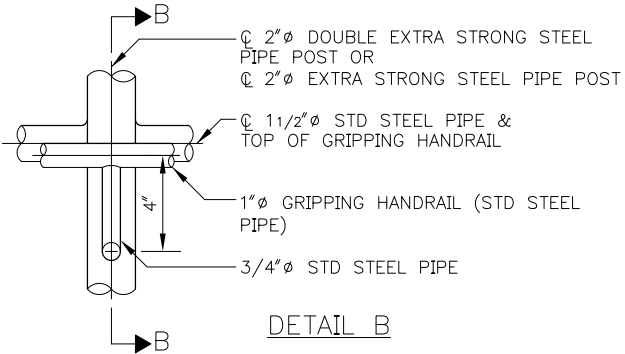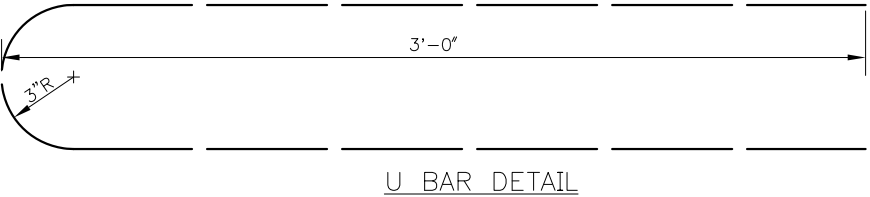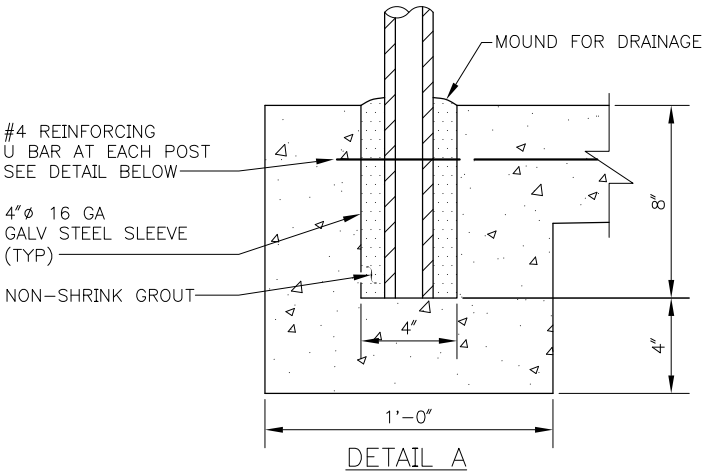


REF STD SPEC SEC 8-18




City of Seattle

NOT TO SCALE


STEEL PIPE RAILING FOR BIKE PATH

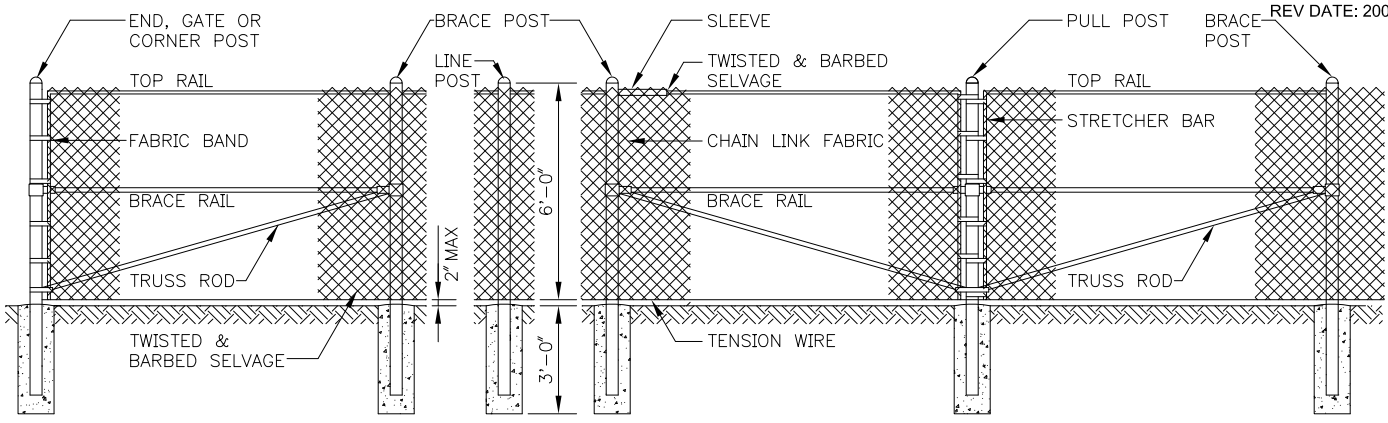


CHAIN LINK FENCE TYPE 1

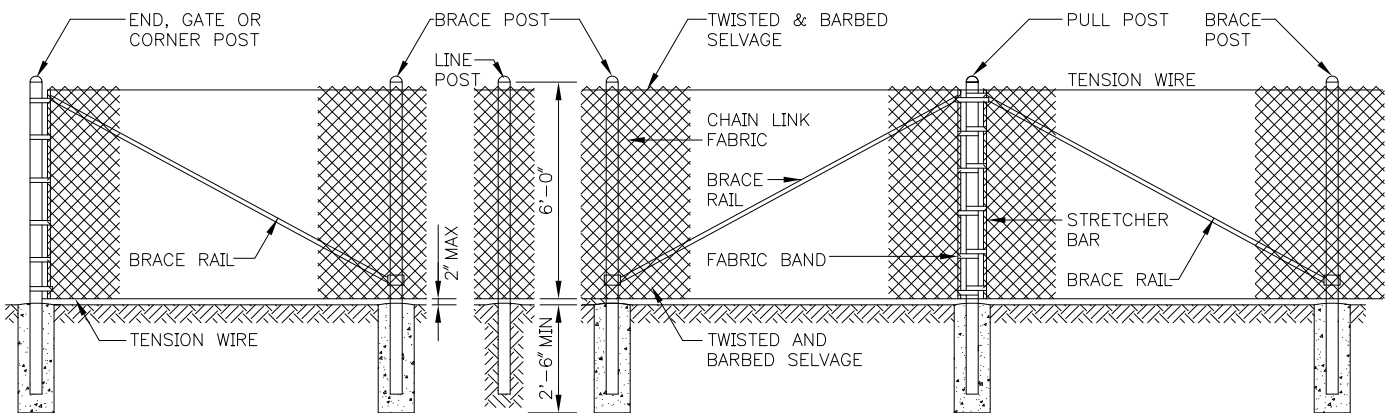

CHAIN LINK FENCE TYPE 3

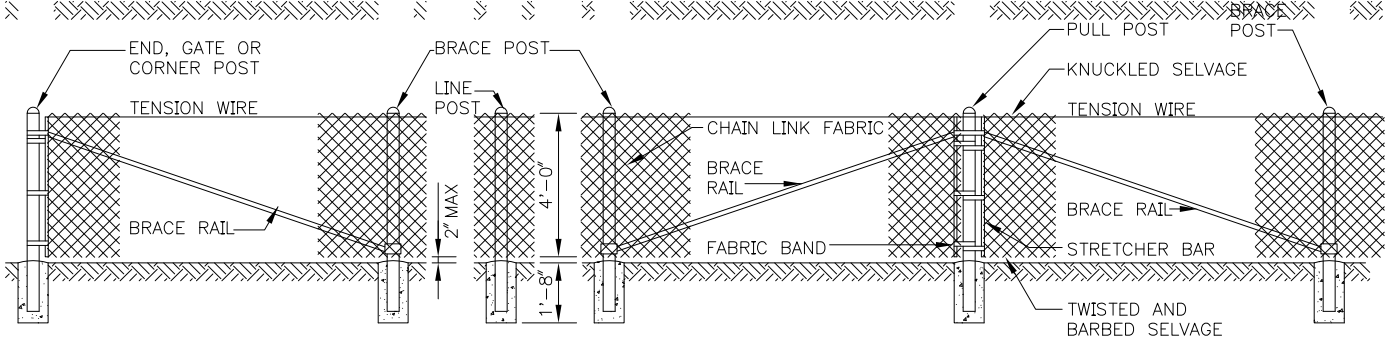

CHAIN LINK FENCE TYPE 4

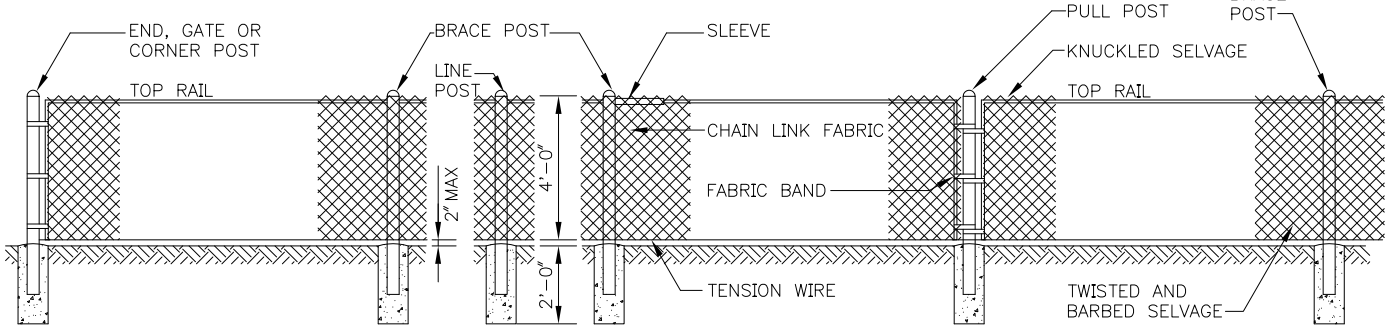

CHAIN LINK FENCE TYPE 6


REF STD SPEC SEC 8-12



City of Seattle

NOT TO SCALE

CHAIN LINK FENCE

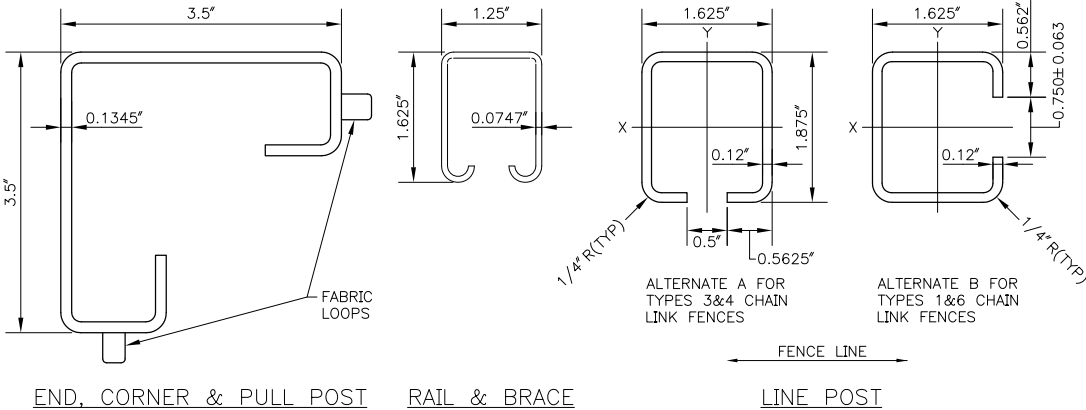

END, CORNER & PULL POST RAIL & BRACE LINE POST

ROLL FORMED SECTIONS

TYPE	MEMBER											
	BRACE RAIL & TOP RAIL						LINE & BRACE POST					
	ROUND		H-COLUMN		ROLL FORMED		ROUND		H-COLUMN		ROLL FORMED	
ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	
1			1.25X1.62	1.35			2	3.65	2 1/4	4.0		
3	1.25	2.27			1 5/8X1 1/4	1.35	1 1/2	2.72	1 7/8	2.72	1 5/8X1 7/8	2.34
4							1 1/2	2.72	1 7/8	2.72	1 5/8X1 7/8	2.34
6			1.25X1.62	1.35			2	3.65	2 1/4	4.0		

TYPE	MEMBER							
	END, CORNER & PULL POSTS				GATE POST		ALL POSTS	
	ROUND		ROLL FORMED		ROUND		LENGTH	
ID PIPE INCHES	WEIGHT PER FT POUNDS	SIZE INCHES	WEIGHT PER FT POUNDS	ID PIPE INCHES	WEIGHT PER FT POUNDS	LENGTH		
1	2 1/2	5.79				8'-8"		
3	2	3.65	3 1/2X	5.14	3 1/2	9.1	8'-8"	
4	2	3.65	3 1/2				5'-6"	
6	2 1/2	5.79					5'-6"	

- NOTES:**
- ALL CONCRETE POST BASES SHALL BE 10" MINIMUM DIAMETER, CL 5 (1 1/2)
 - POSTS SHALL BE SPACED AT 10'-0" MAXIMUM INTERVALS UNLESS OTHERWISE DIRECTED BY THE ENGINEER
 - TOP OR BOTTOM TENSION WIRES SHALL BE PLACED WITHIN THE LIMITS OF THE FIRST FULL FABRIC WEAVE
 - THE ILLUSTRATIVE DETAIL SHOWN HEREON SHALL NOT BE CONSTRUED AS LIMITING TO HARDWARE DESIGN OR POST SELECTION FOR ANY PARTICULAR FENCE TYPE
 - CONCRETE OR GROUT AROUND POST AT GROUND LINE SHALL BE MOUNDED FOR DRAINAGE

REF STD SPEC SEC 8-12





City of Seattle

NOT TO SCALE

CHAIN LINK FENCE

STANDARD PLAN NO 450c

REV DATE: 2003

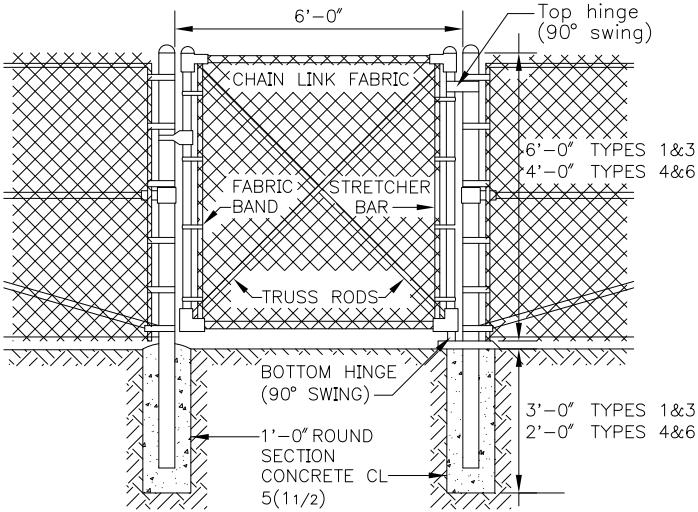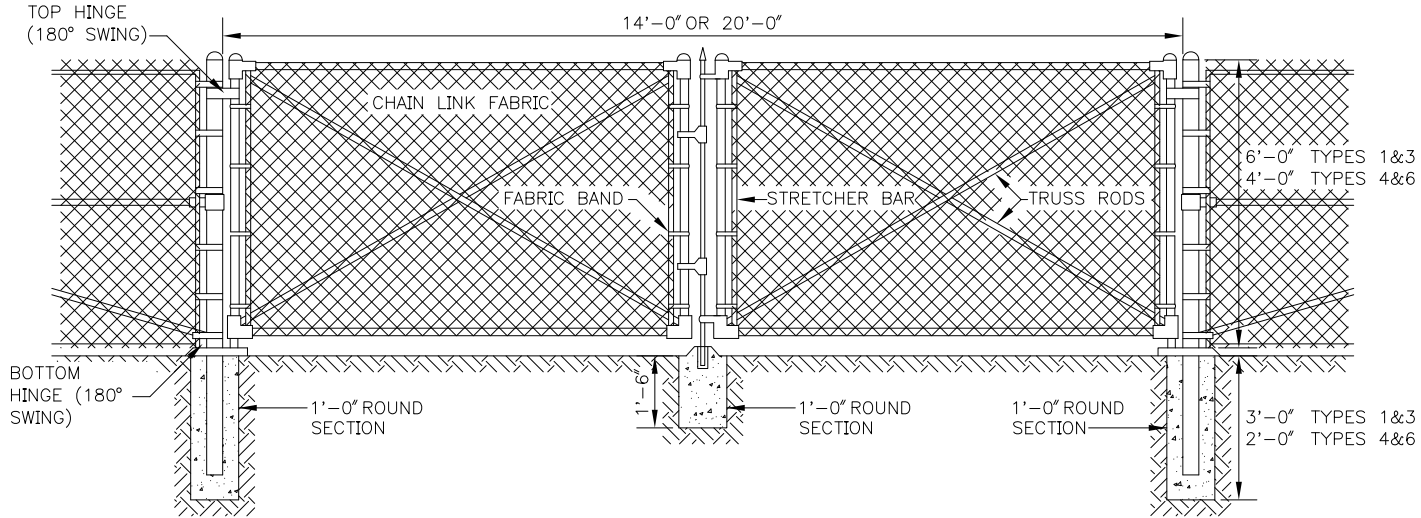

- NOTES:**
1. FENCE FABRIC SHALL BE SECURED TO GATE FRAMES WITH KNUCKLED SELVAGE ALONG TOP EDGE FOR TYPES 4&6 CHAIN LINK FENCE INSTALLATIONS
 2. MINIMUM POST LENGTH:
 TYPES 1&3: 8'-8"
 TYPES 4&6: 5'-6"
 3. CONCRETE OR GROUT AROUND POST AT GROUND LINE SHALL BE MOUNDED FOR DRAINAGE

REF STD SPEC SEC 8-12




City of Seattle

NOT TO SCALE

CHAIN LINK GATES


STANDARD PLAN NO 456

REV DATE: 2003

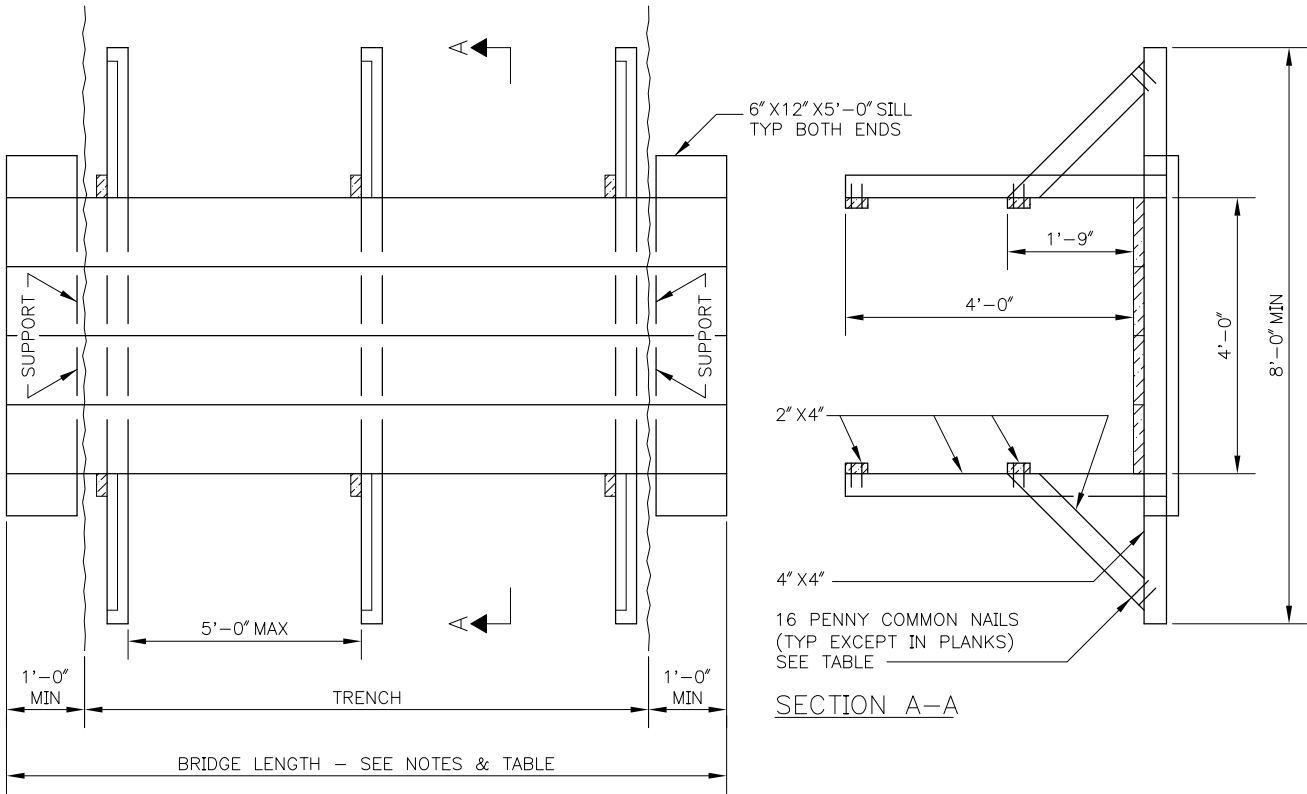

NOTE:

- 1. IF THE SLOPE OF THE TEMPORARY CROSSING IS 5% OR GREATER, A GRIPPING HANDRAIL SHALL BE ADDED THAT COMPLIES WITH ADA STANDARDS
- 2. ENDS OF THE TEMPORARY CROSSING SHALL BE SLOPED TO ALLOW ADA ACCESS
- 3. SURFACE OF WALKWAY SHALL BE SKID RESISTANT

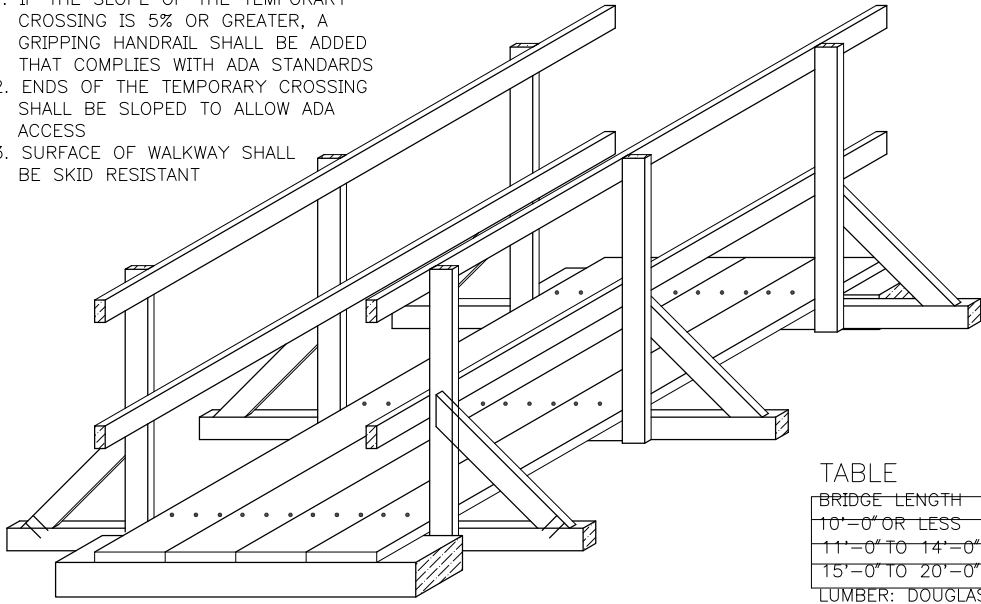

TABLE

BRIDGE LENGTH	PLANK SIZE	NAIL SIZE
10'-0" OR LESS	2" X 12"	20 PENNY
11'-0" TO 14'-0"	3" X 12"	40 PENNY
15'-0" TO 20'-0"	4" X 12"	60 PENNY


LUMBER: DOUGLAS FIR #2 OR BETTER
 POSTS & RAILS S4S
 PLANKS - ROUGH

REF STD SPEC SEC 1-07.23






NOT TO SCALE

TEMPORARY PEDESTRIAN WALKWAY

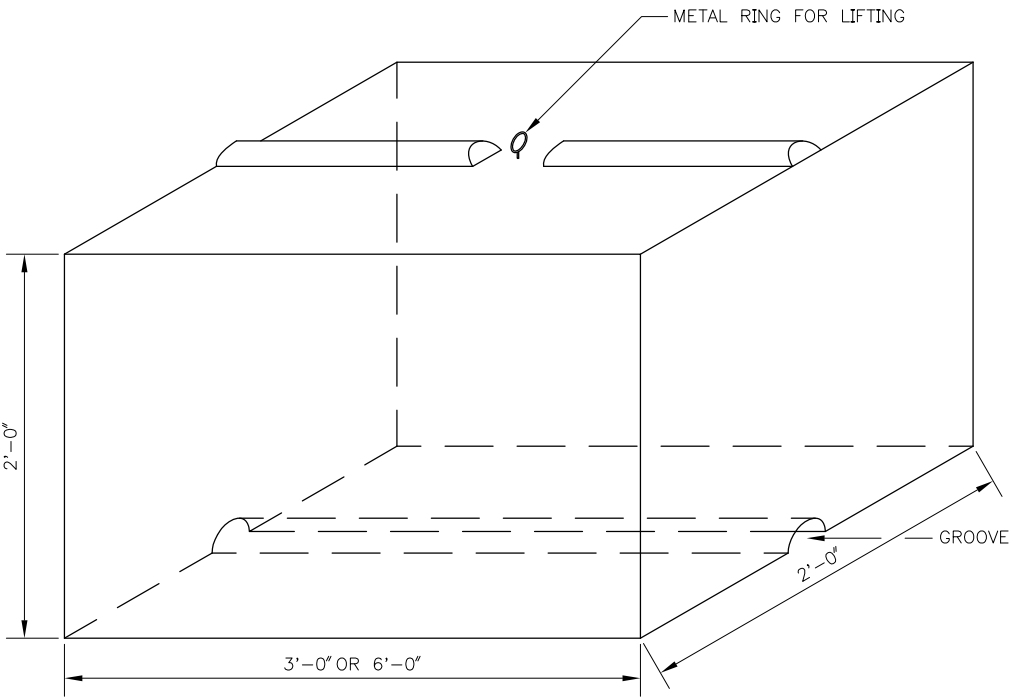

CONCRETE TONGUE & GROOVE BLOCK



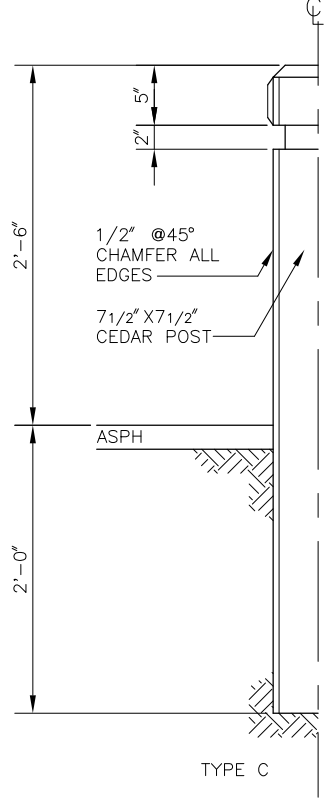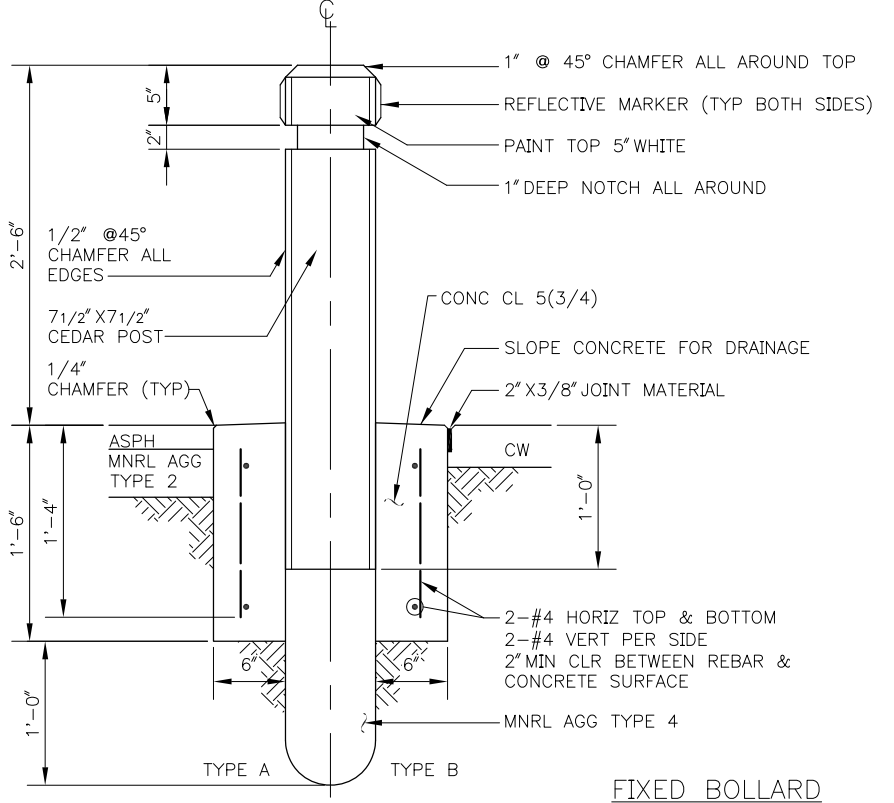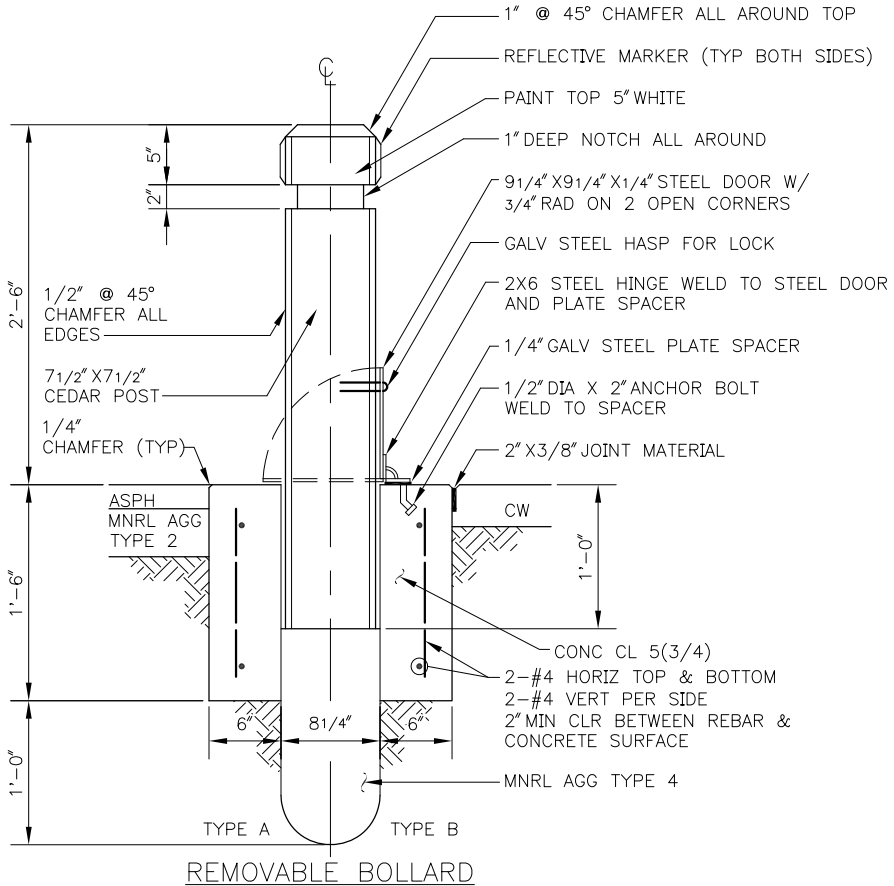


REF STD SPEC SEC 8-02



City of Seattle

NOT TO SCALE

FIXED & REMOVABLE WOOD BOLLARD

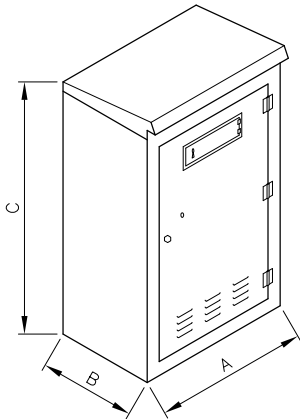


DIMENSION	TYPE II	TYPE III
A	28" TO 34"	36" TO 48"
B	16" TO 20"	20" TO 28"
C	38" TO 52"	50" TO 58"

SIGNAL CONTROLLER CABINET—TYPES II & III

NOTES:

1. TRAFFIC SIGNAL CONTROLLER CABINET SHALL BE FURNISHED BY THE CITY
2. EXACT CABINET DIMENSIONS & ANCHOR BOLT LOCATIONS SHALL BE PROVIDED BY THE TRAFFIC SIGNAL SHOPS
3. PLACE CABINET DOOR ON SIDEWALK SIDE OF FOUNDATION
4. SEAL CABINET TO FOUNDATION WITH GREY OR CLEAR SILICON TO PREVENT MOISTURE FROM ENTERING THE CABINET

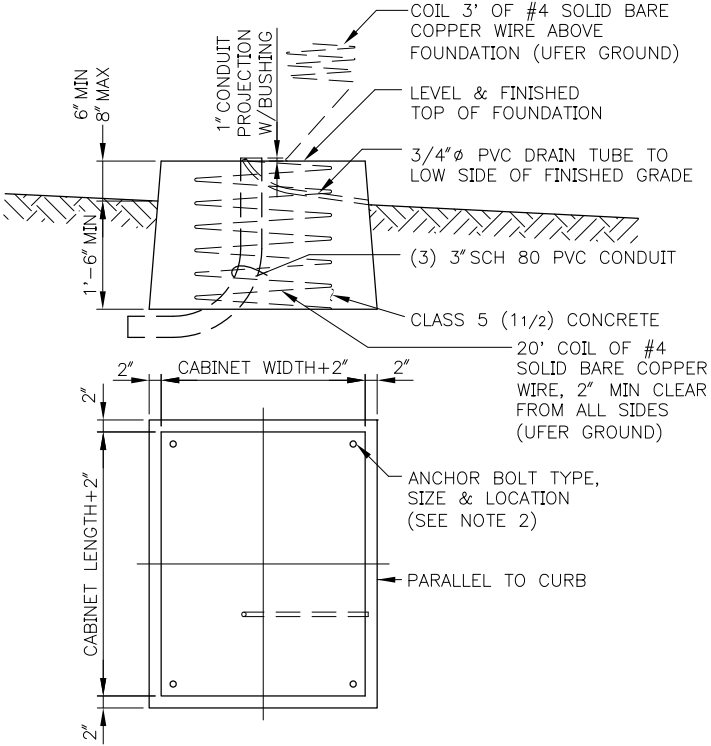

SIGNAL CONTROLLER FOUNDATION—TYPES II & III
SEE STD PLAN NO 500b FOR CONDUIT LAYOUT



REF STD SPEC SEC 8-31 & 8-32



City of Seattle


NOT TO SCALE

SIGNAL CONTROLLER CABINET & FOUNDATION

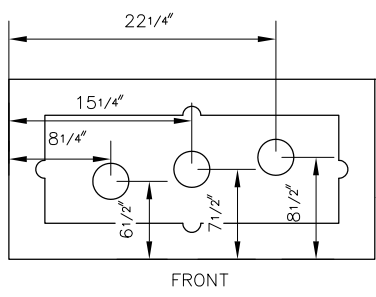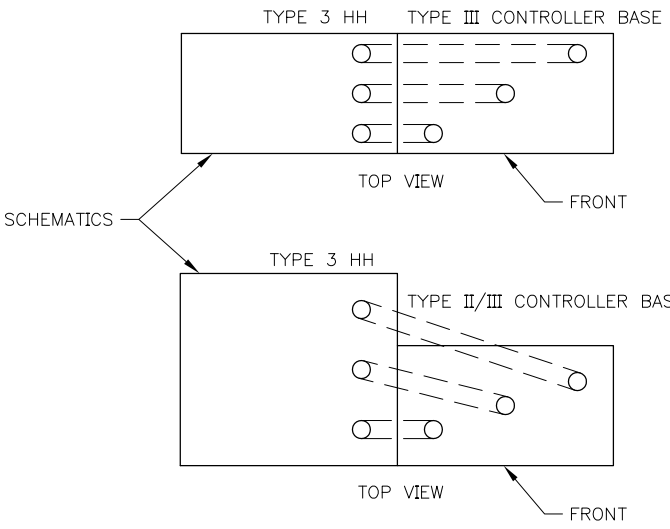

CONDUIT LAYOUT—TYPE II SIGNAL CONTROLLER FOUNDATION

ALL MEASUREMENTS TO CENTER OF CONDUIT

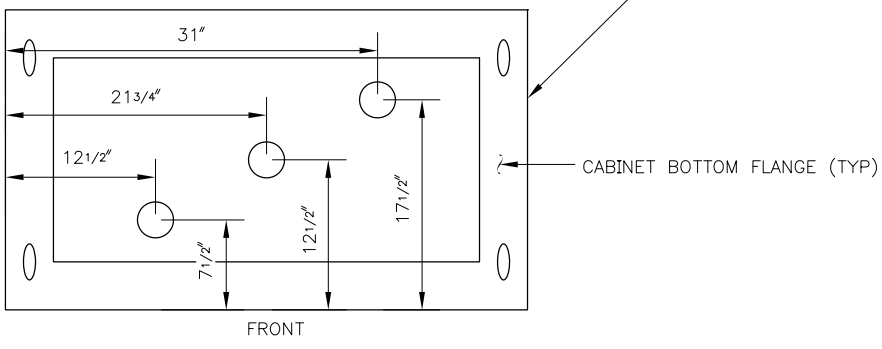

CONDUIT LAYOUT—TYPE III SIGNAL CONTROLLER FOUNDATION

REF STD SPEC SEC 8-31 & 8-32




NOT TO SCALE

SIGNAL CONTROLLER FOUNDATION CONDUIT LAYOUT

STANDARD PLAN NO 502

REV DATE: 2003

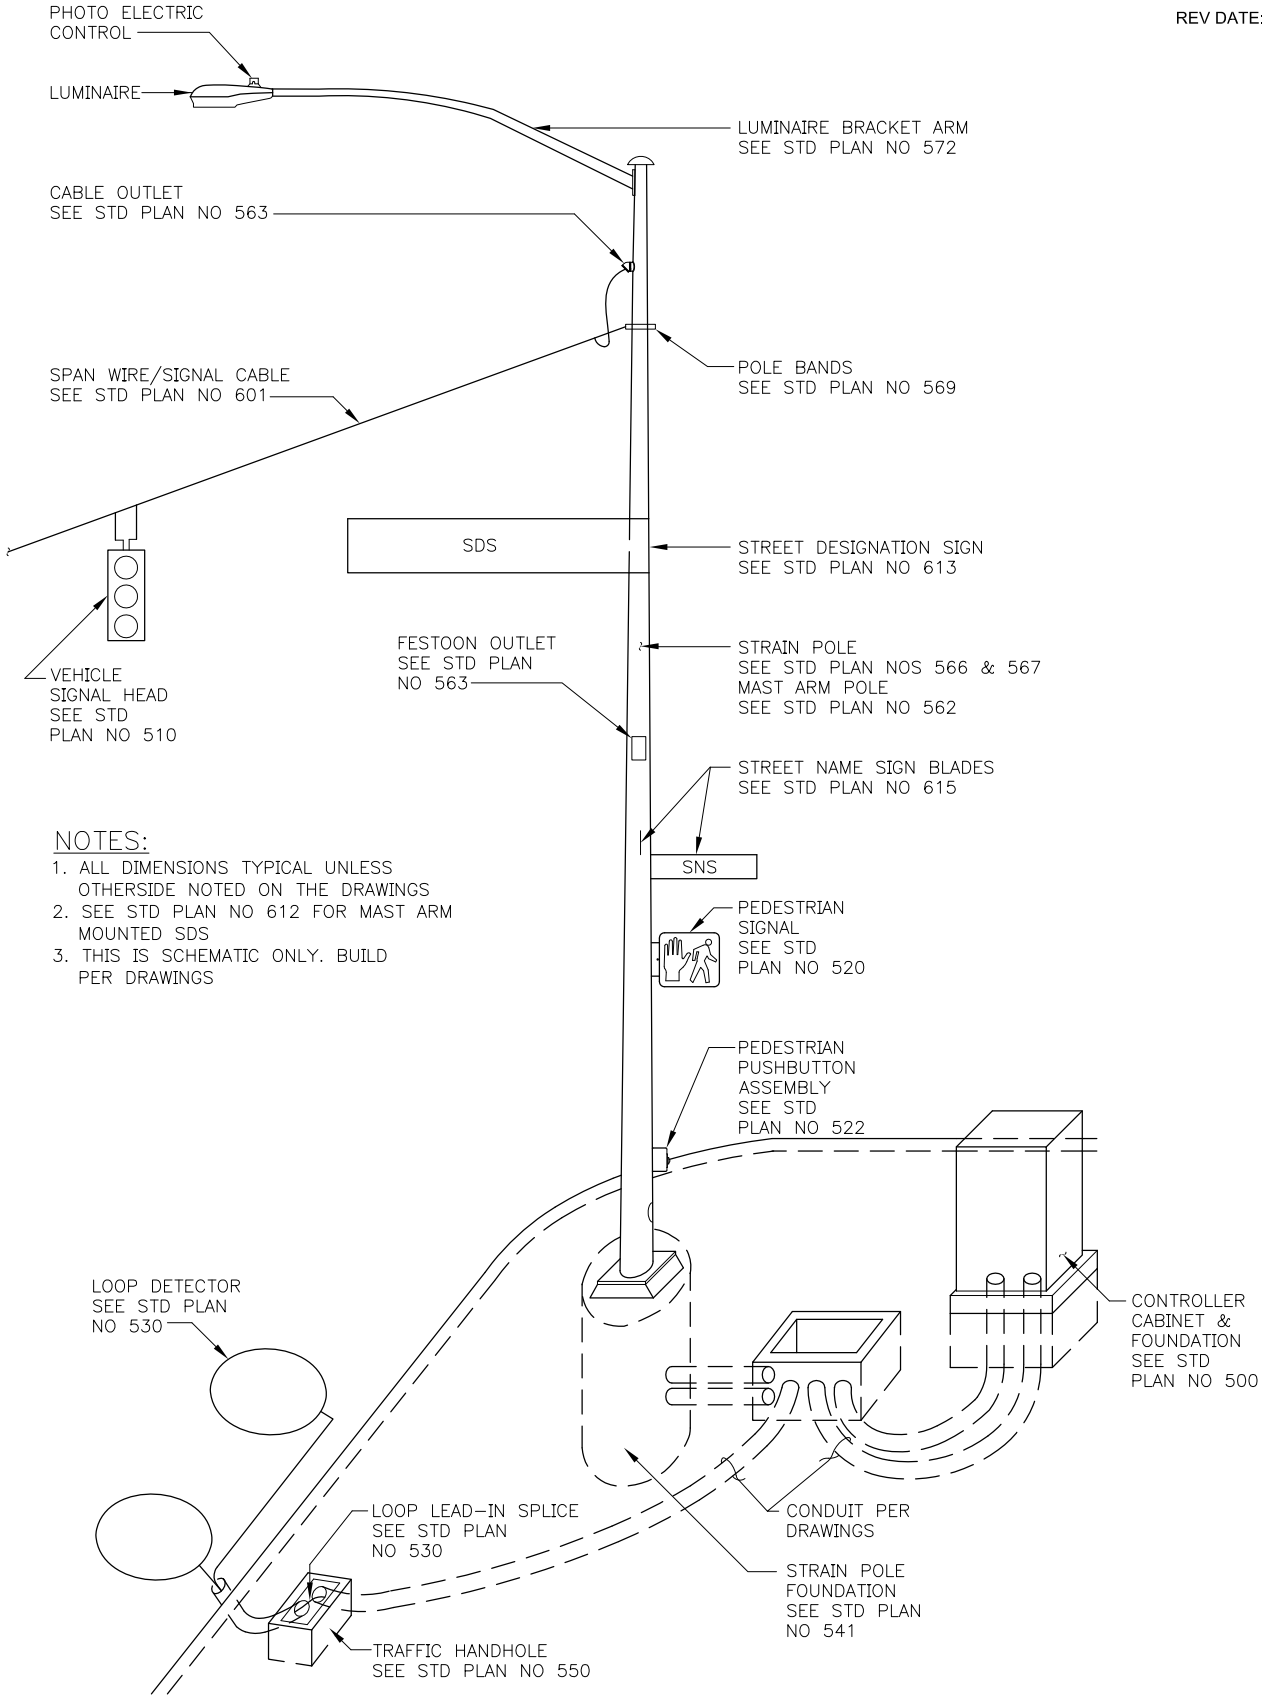

NOTES:

- 1. ALL DIMENSIONS TYPICAL UNLESS OTHERSIDE NOTED ON THE DRAWINGS
- 2. SEE STD PLAN NO 612 FOR MAST ARM MOUNTED SDS
- 3. THIS IS SCHEMATIC ONLY. BUILD PER DRAWINGS


REF STD SPEC SEC 9-31, 9-32, 9-33 & 9-34




City of Seattle

NOT TO SCALE

SIGNALIZED INTERSECTION
SPAN WIRE TYPE
CONFIGURATION

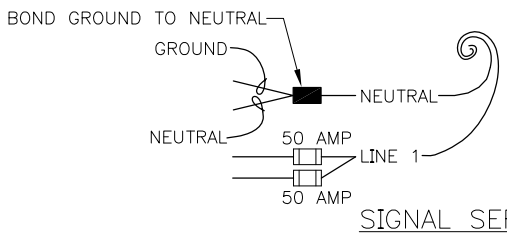


SIGNAL SERVICE

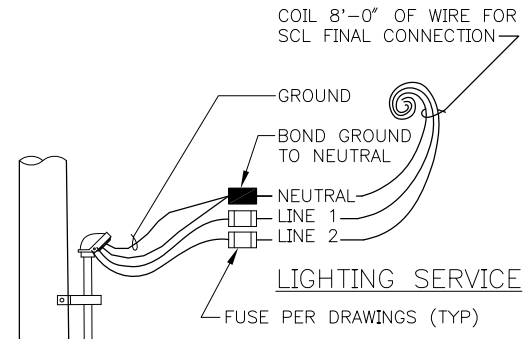

LIGHTING SERVICE

NOTES:

- 1. FOR METAL POLES WITH ONLY OVERHEAD ACCESS, CONDUCTORS SHALL ENTER POLE THROUGH CABLE OUTLETS
- 2. CONDUCTORS SHALL BE CONTINUOUSLY COLOR CODED
 LINE 1 = BLACK
 LINE 2 = RED
 LINE 3 = BLUE
 NEUTRAL = WHITE
 GROUND = GREEN

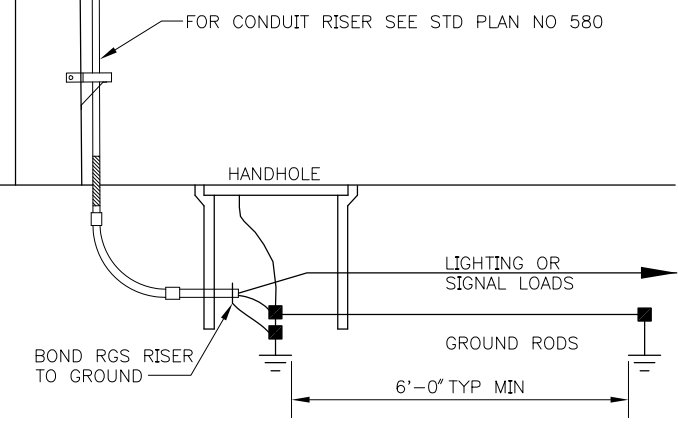

OVERHEAD SERVICE CONNECTION


REF STD SPEC SEC 8-30 & 8-31




City of Seattle

NOT TO SCALE

SIGNAL & LIGHTING SERVICE CONNECTION & LIGHT POLE WIRING DETAIL

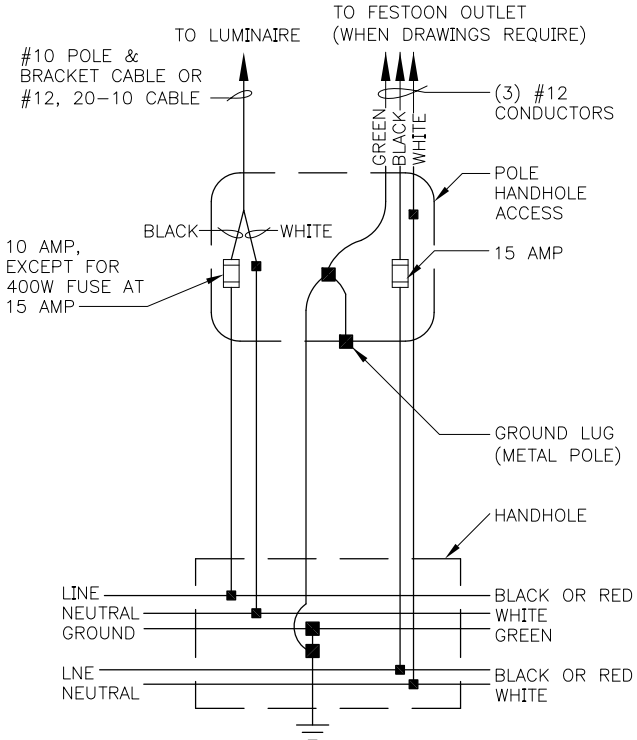

POLE WIRING DETAIL

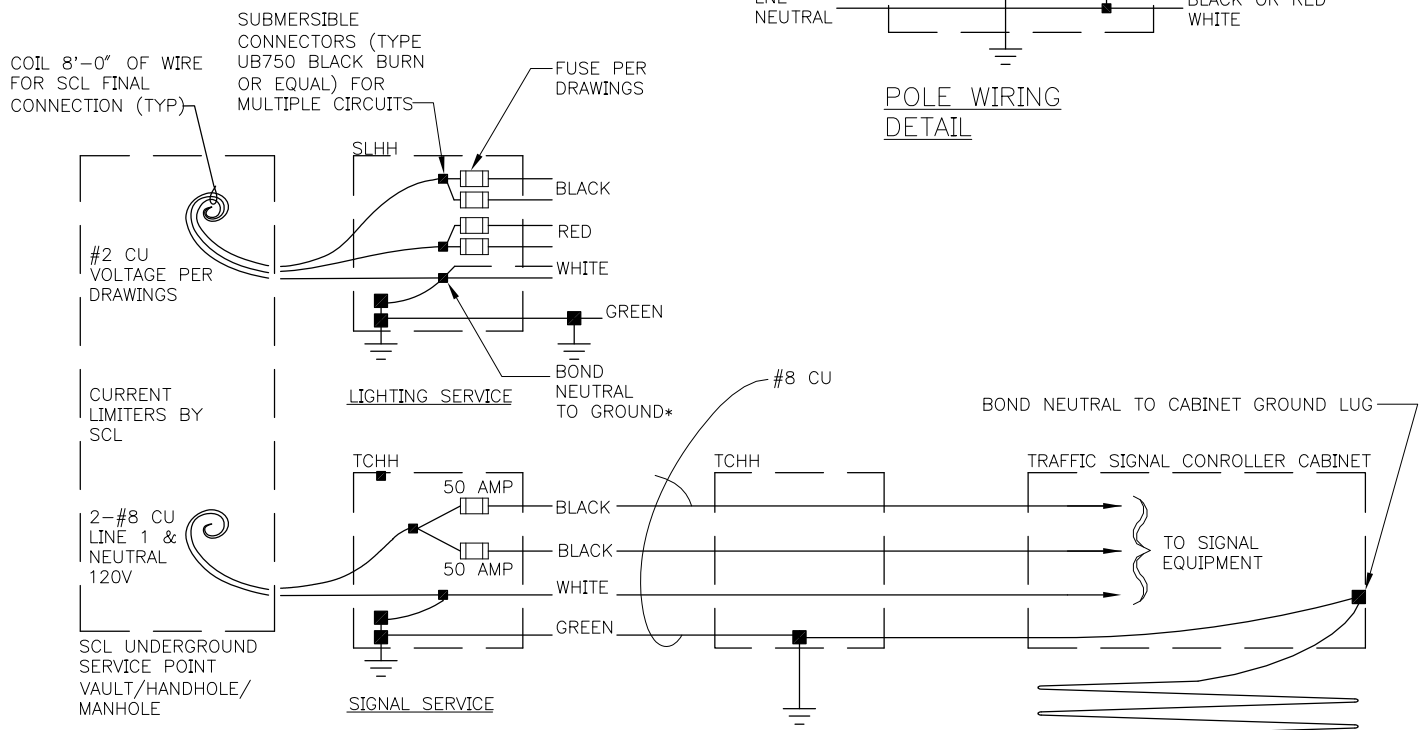

UNDERGROUND SERVICE CONNECTION

*SCL MAY REQUIRE NEUTRAL TO BE BONDED TO GROUND IN SCL SERVICE POINT.

COIL 20' OF #4 SOLID BARE COPPER WIRE IN CONTROLLER CABINET FOUNDATION W/2" MINIMUM CLEARANCE FROM ALL SIDES (UFER GROUND)

REF STD SPEC SEC 8-30 & 8-31




NOT TO SCALE

SIGNAL & LIGHTING SERVICE CONNECTION & LIGHT POLE WIRING DETAIL


STANDARD PLAN NO 510a

REV DATE: 2003

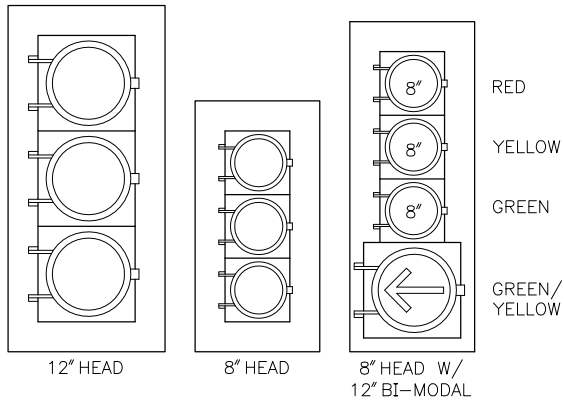


TYPICAL SIGNAL FACES
W/ TUNNEL VISORS &
5" BACKPLATE (LOUVERED)

RED
YELLOW
GREEN
GREEN/
YELLOW



MAST ARM MOUNTING


MAST ARM SIGNAL
COUPLING SEE
STD PLAN NO
562
BRONZE ELEVATOR
PLUMBIZER W/
STAINLESS STEEL
THROUGH BOLT

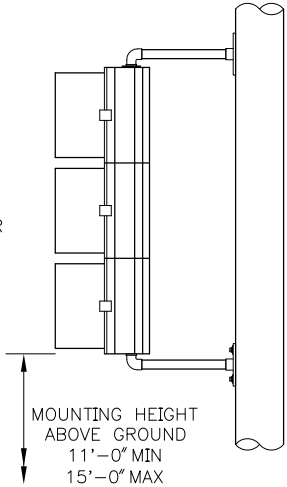

BRACKET MOUNTING
FOR BRACKET ASSEMBLY
SEE STD PLAN NO 511


MOUNTING HEIGHT
ABOVE GROUND
11'-0" MIN
15'-0" MAX

NOTE:
BACKPLATES HAVE
BEEN OMITTED
FROM VARIOUS
VIEWS FOR CLARITY

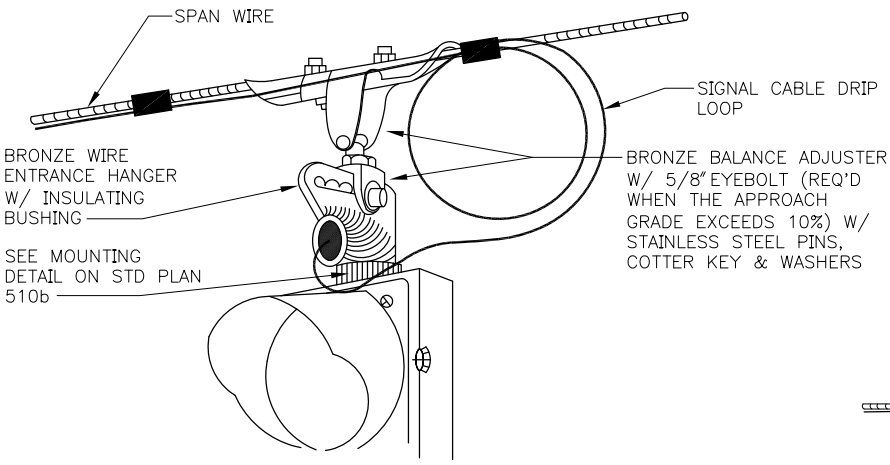

SIGNAL HANGER DETAIL

SEE MOUNTING
DETAIL ON STD PLAN
510b

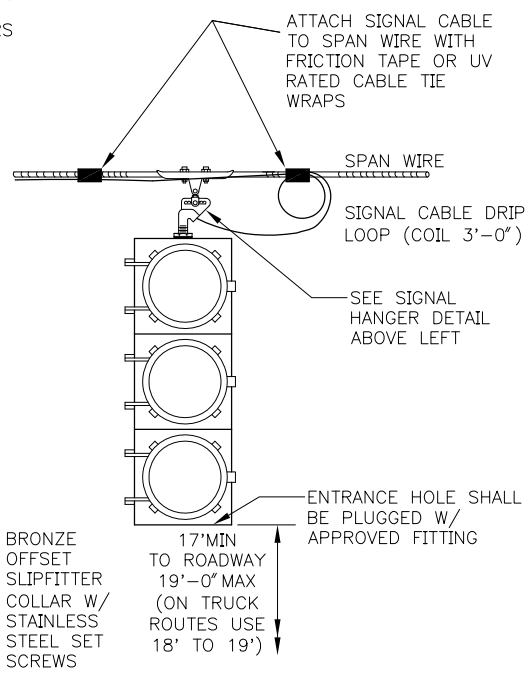

MOUNTING
HEIGHT
ABOVE
GROUND
11'-0" MIN
15'-0" MAX

PEDESTAL TOP MOUNTING
FOR PEDESTAL SEE STD PLAN NO 524

17" MIN
TO ROADWAY
19'-0" MAX
(ON TRUCK
ROUTES USE
18' TO 19')


BRONZE
OFFSET
SLIPFITTER
COLLAR W/
STAINLESS
STEEL SET
SCREWS

REF STD SPEC SEC 8-31



NOT TO SCALE

VEHICULAR SIGNAL MOUNTING

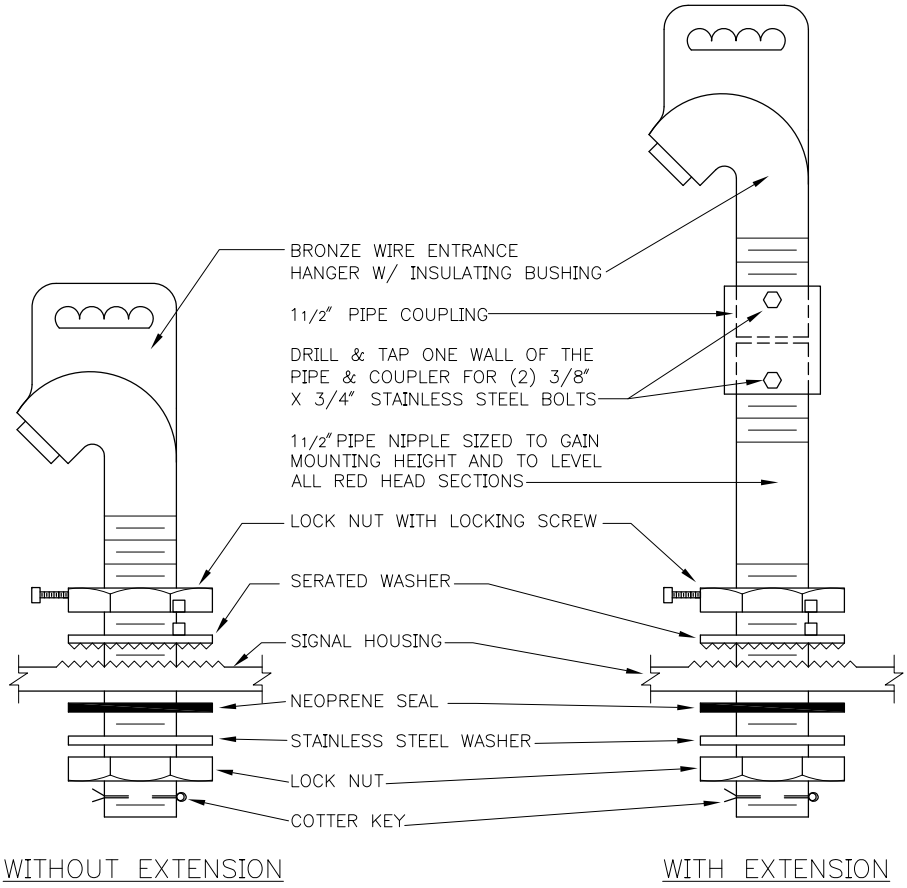

SUSPENDED SIGNAL MOUNTING DETAIL

REF STD SPEC SEC 8-31




City of Seattle

NOT TO SCALE

VEHICULAR SIGNAL MOUNTING

STANDARD PLAN NO 511

REV DATE: 2003

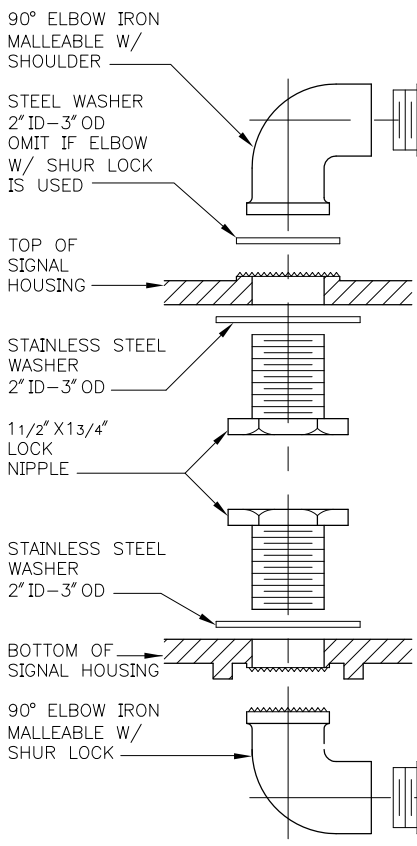

90° ELBOW IRON MALLEABLE W/ SHOULDER

STEEL WASHER 2" ID-3" OD OMIT IF ELBOW W/ SHUR LOCK IS USED

TOP OF SIGNAL HOUSING


STAINLESS STEEL WASHER 2" ID-3" OD

1 1/2" X 1 3/4" LOCK NIPPLE


STAINLESS STEEL WASHER 2" ID-3" OD

BOTTOM OF SIGNAL HOUSING

90° ELBOW IRON MALLEABLE W/ SHUR LOCK

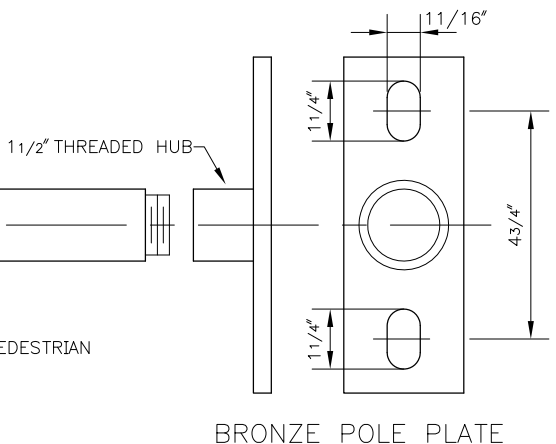

BRONZE POLE PLATE

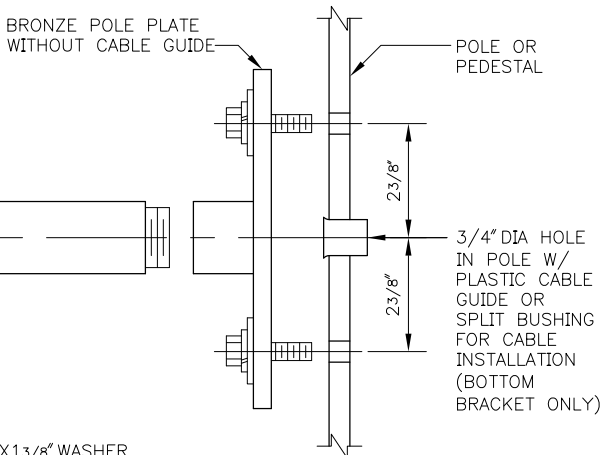

BRONZE POLE PLATE WITHOUT CABLE GUIDE

POLE OR PEDESTAL

2 3/8"

2 3/8"

3/4" DIA HOLE IN POLE W/ PLASTIC CABLE GUIDE OR SPLIT BUSHING FOR CABLE INSTALLATION (BOTTOM BRACKET ONLY)

NOTES:

1. 3/8" X 1 1/2" BOLT, 3/8" LOCK WASHER, 7/16" X 1 3/8" WASHER 4 OF EACH REQUIRED PER ASSEMBLY; ALL STAINLESS STEEL.
2. MOUNTING SHALL BE AS FOLLOWS:
 - ON METAL POLES THINNER THAN 7 GAUGE, USE 3/8" STAINLESS STEEL RIVNUTS.
 - ON METAL POLES 7 GAUGE OR THICKER, DRILL AND TAP FOR 3/8" BOLT (STAINLESS STEEL RIVNUTS OPTIONAL).
 - ON POLES FILLED OR MADE WITH CONCRETE USE 3/8" X 2 1/2" MIN STUD BOLT ANCHORS, SLEEVE TYPE.
 - ON WOOD POLES USE 1 1/2" X 2 1/2" LAG BOLTS.

REF STD SPEC SEC 8-31




NOT TO SCALE


SIGNAL HEAD BRACKET ASSEMBLY

STANDARD PLAN NO 520


REV DATE: 2003

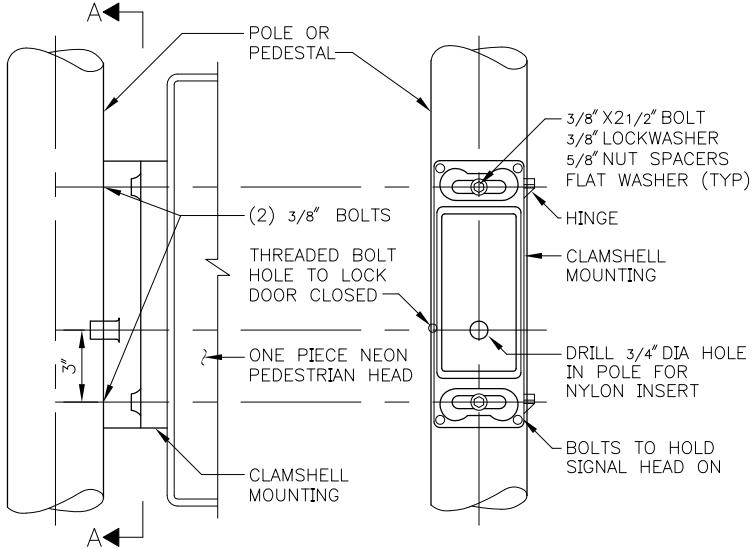

ELEVATION SECTION A-A
METAL POLE MOUNT

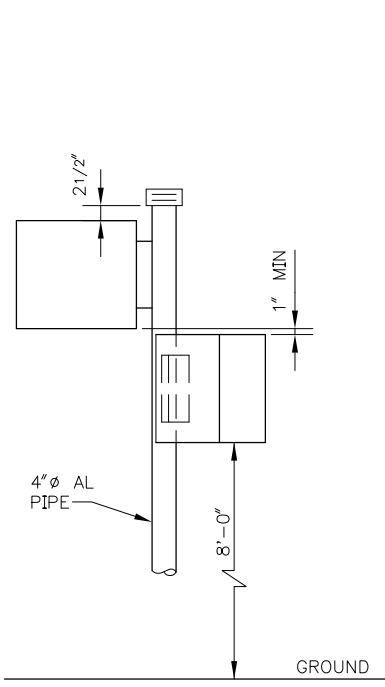

PEDESTAL MOUNT

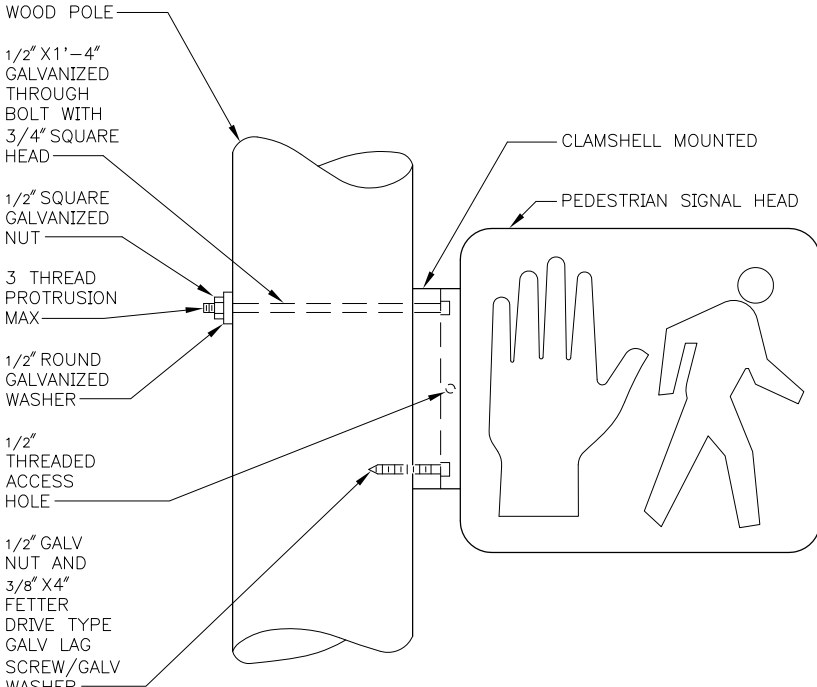

WOOD POLE MOUNT

NOTES:

1. BOLT AND WASHERS SHALL BE STAINLESS STEEL
2. MOUNTING SHALL BE AS FOLLOWS:
 - ON METAL POLES THINNER THAN 7 GAUGE, USE 3/8" STAINLESS STEEL RIVNUTS
 - ON METAL POLES 7 GAUGE OR THICKER, DRILL AND TAP FOR 3/8" BOLT (STAINLESS STEEL RIVNUTS OPTIONAL)
 - ON POLES FILLED WITH OR MADE FROM CONCRETE USE 3/8" X 2 1/2" STUD BOLT ANCHORS WITH HEX NUT
3. FOR STREET NAME SIGNS MOUNTED ON TOP OF PEDESTAL SEE STD PLAN NO 623

REF STD SPEC SEC 8-31




NOT TO SCALE

PEDESTRIAN SIGNAL CLAMSHELL MOUNTING

STANDARD PLAN NO 521

REV DATE: 2003


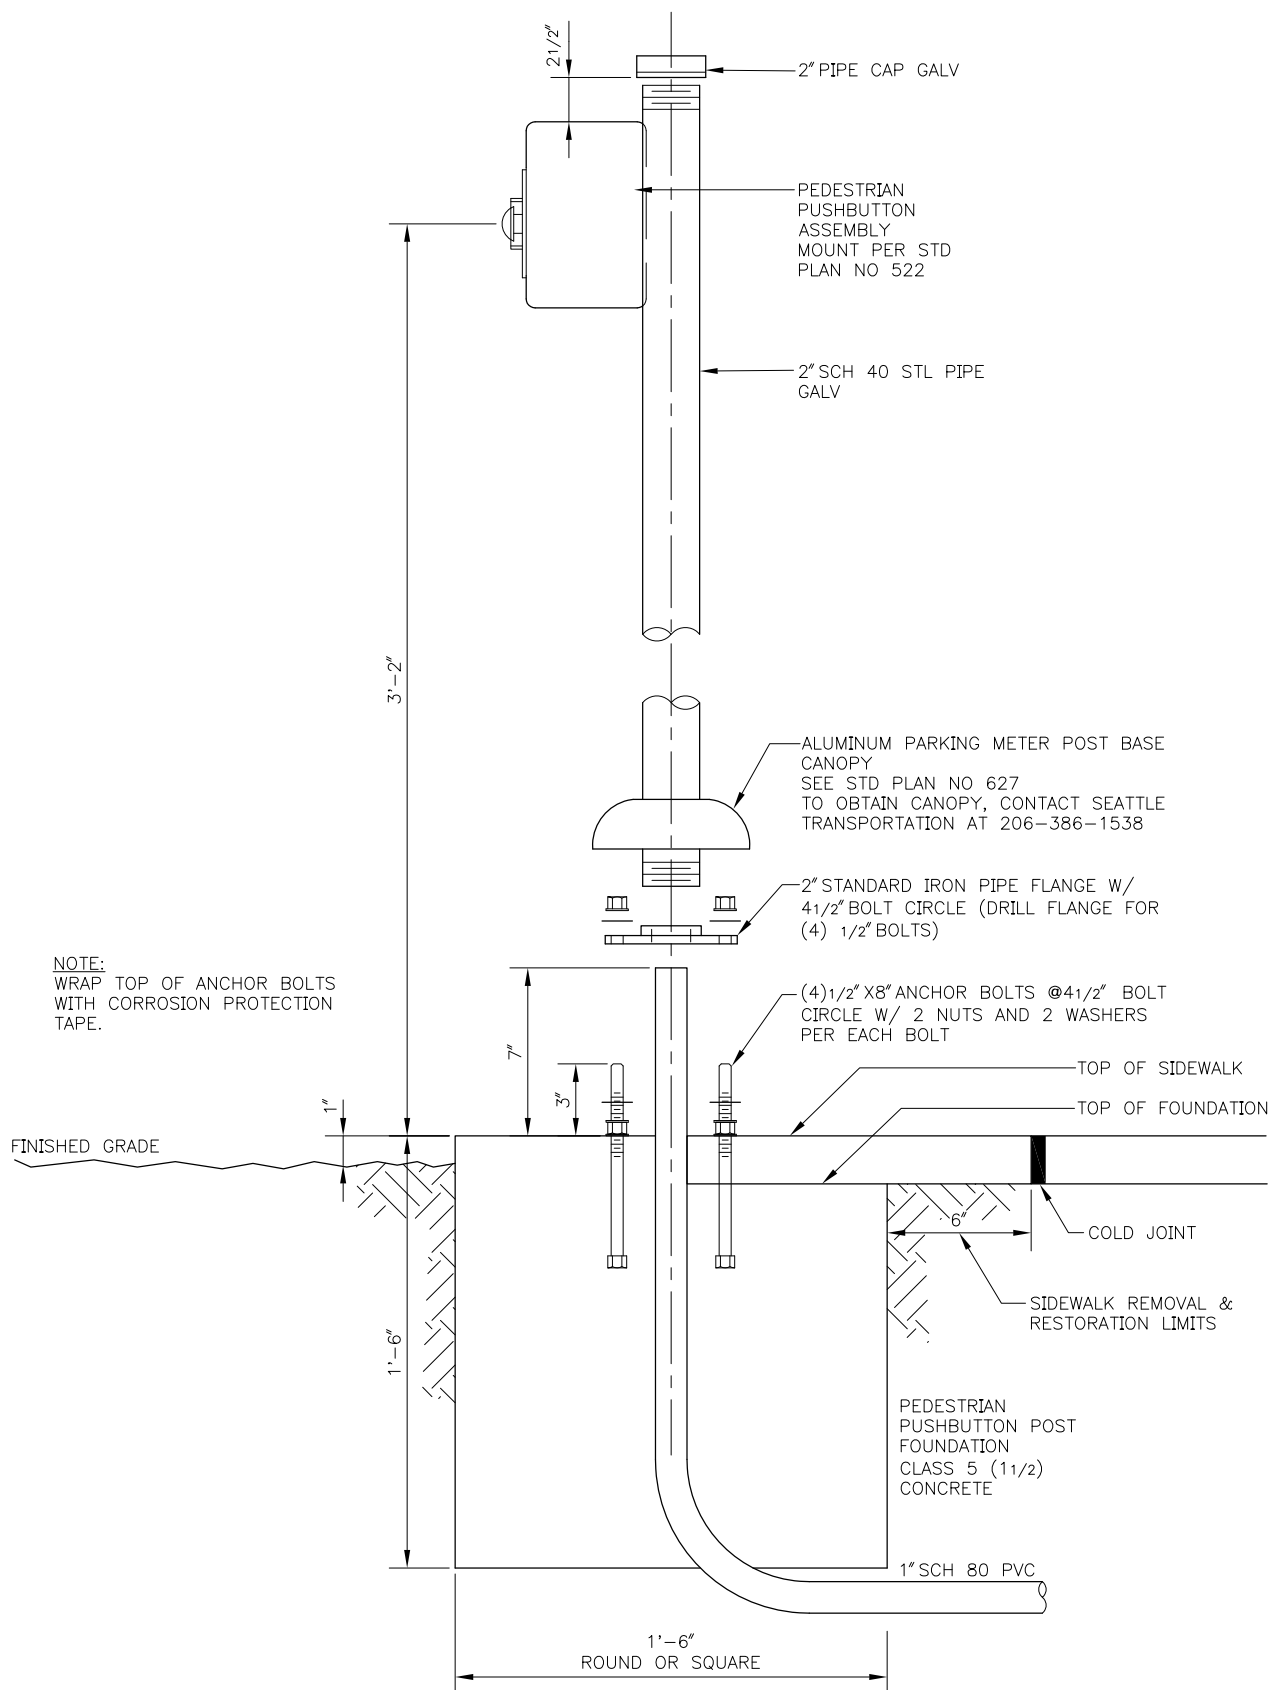


REF STD SPEC SEC 8-31 & 8-32



NOT TO SCALE

PEDESTRIAN PUSHBUTTON POST & FOUNDATION

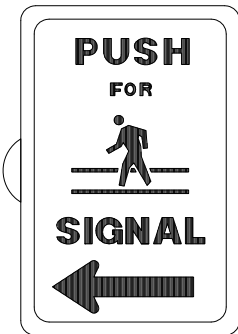
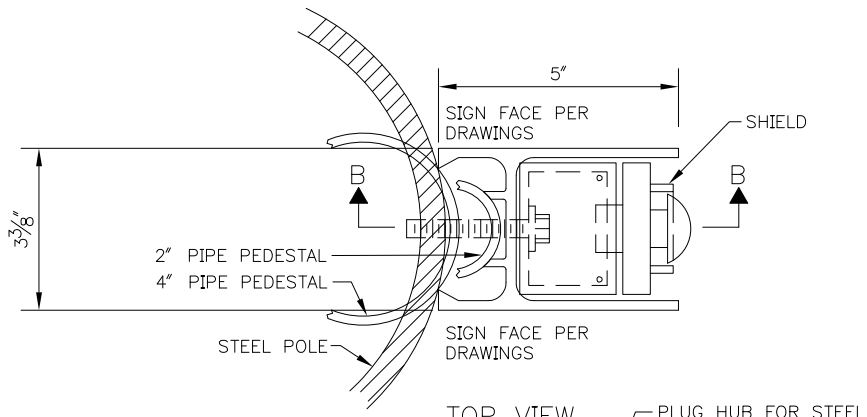


R-37L
MODIFIED
(PART NO H3)

FOR WOOD POLE
USE 3/8" GALV THRU BOLT FOR
TOP HOLE & 3/8"x4" GALV LAG
BOLT & WASHER FOR BOTTOM HOLE


FOR METAL POLE
DRILL & TAP POLE FOR 3/8" X 31/2"
STAINLESS STEEL BOLTS & WASHERS
-USE 3/8" X 1 1/4" BOLT FOR 2" PIPE
POST
-USE 3/8" X 2 3/4" BOLT FOR 4" PIPE
PEDESTAL

DRILL HOLE FOR 3/4" NYLON
INSERT (TYP)

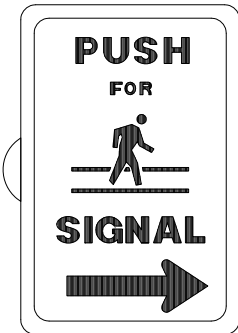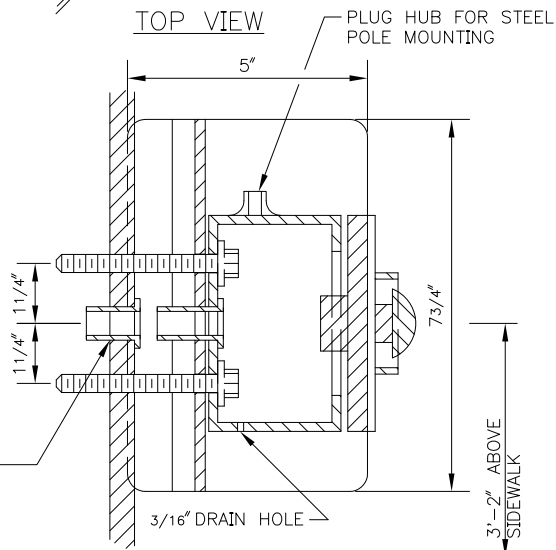

R-37R
MODIFIED
(PART NO H3R)

SECTION B-B

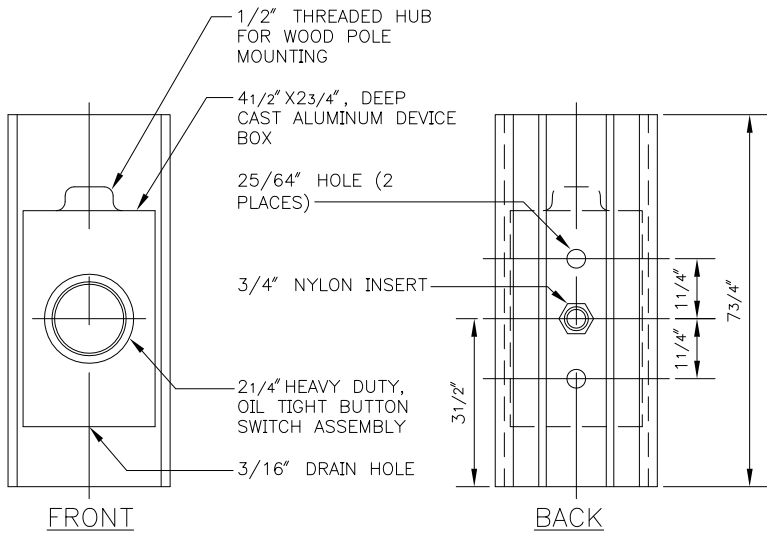

PPB ASSEMBLY

NOTES:

1. MOLDED ONE-PIECE ALUMINUM CONSTRUCTION
2. SIGNS SHALL BE FABRICATED FROM BAKED-ON ENAMEL DIRECTLY ON BOTH SIDES OF THE EXTRUSION

REF STD SPEC SEC 8-31




City of Seattle

NOT TO SCALE

PEDESTRIAN PUSHBUTTON & MOUNTING

STANDARD PLAN NO 523

REV DATE: 2003

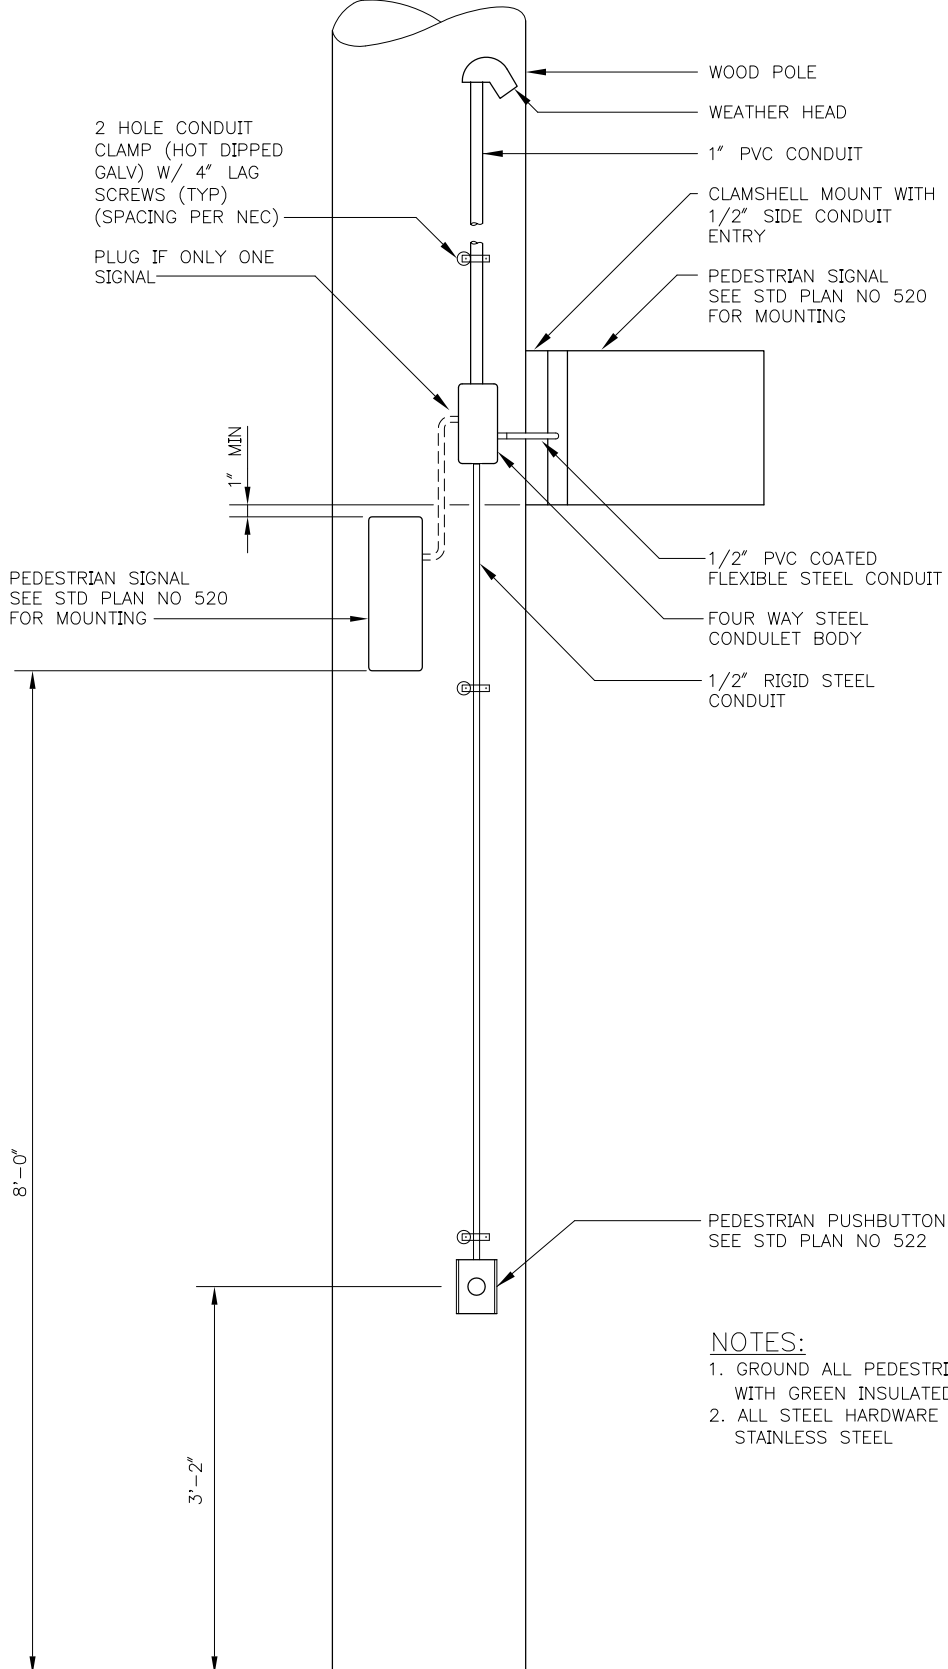

2 HOLE CONDUIT CLAMP (HOT DIPPED GALV) W/ 4" LAG SCREWS (TYP) (SPACING PER NEC)
 PLUG IF ONLY ONE SIGNAL

WOOD POLE
 WEATHER HEAD
 1" PVC CONDUIT
 CLAMSHELL MOUNT WITH 1/2" SIDE CONDUIT ENTRY
 PEDESTRIAN SIGNAL SEE STD PLAN NO 520 FOR MOUNTING

PEDESTRIAN SIGNAL SEE STD PLAN NO 520 FOR MOUNTING

1/2" PVC COATED FLEXIBLE STEEL CONDUIT
 FOUR WAY STEEL CONDULET BODY
 1/2" RIGID STEEL CONDUIT

PEDESTRIAN PUSHBUTTON SEE STD PLAN NO 522

- NOTES:**
1. GROUND ALL PEDESTRIAN SIGNALS AND PUSHBUTTONS WITH GREEN INSULATED #8 COPPER WIRE
 2. ALL STEEL HARDWARE SHALL BE HOT DIP GALV OR STAINLESS STEEL

8'-0"

3'-2"

1" MIN

REF STD SPEC SEC 8-31

FINISHED GRADE




NOT TO SCALE

PEDESTRIAN SIGNAL & PUSHBUTTON MOUNTED ON WOOD POLE


STANDARD PLAN NO 524

REV DATE: 2003


NOTE: INSTALL UFER GROUND TO FOUNDATION (SEE STD PLAN NO 500a)

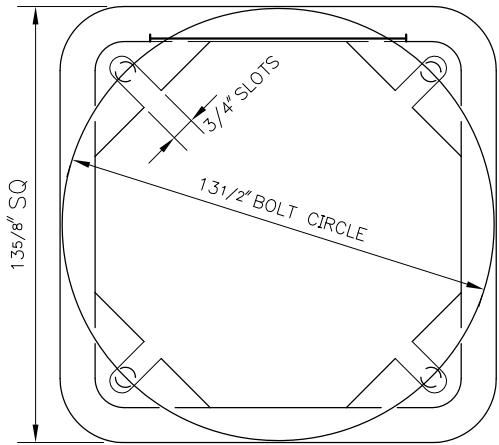


BOTTOM VIEW

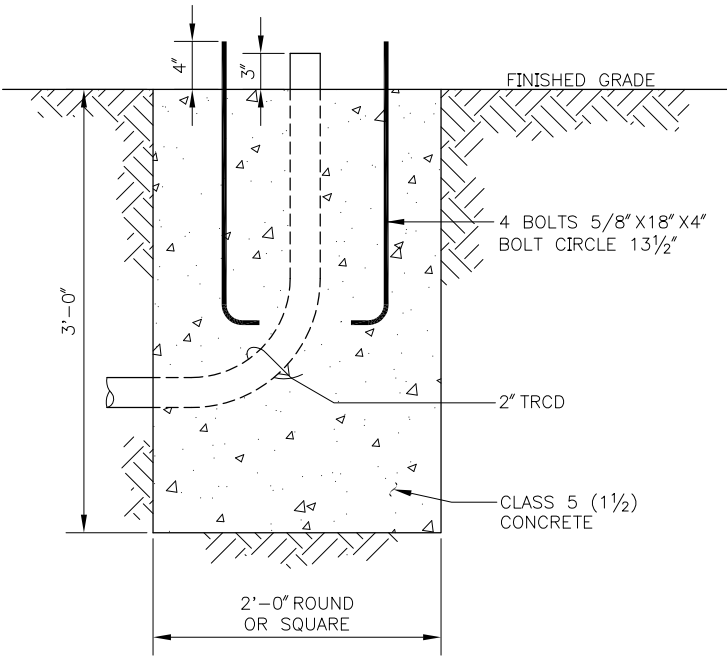

PEDESTAL FOUNDATION

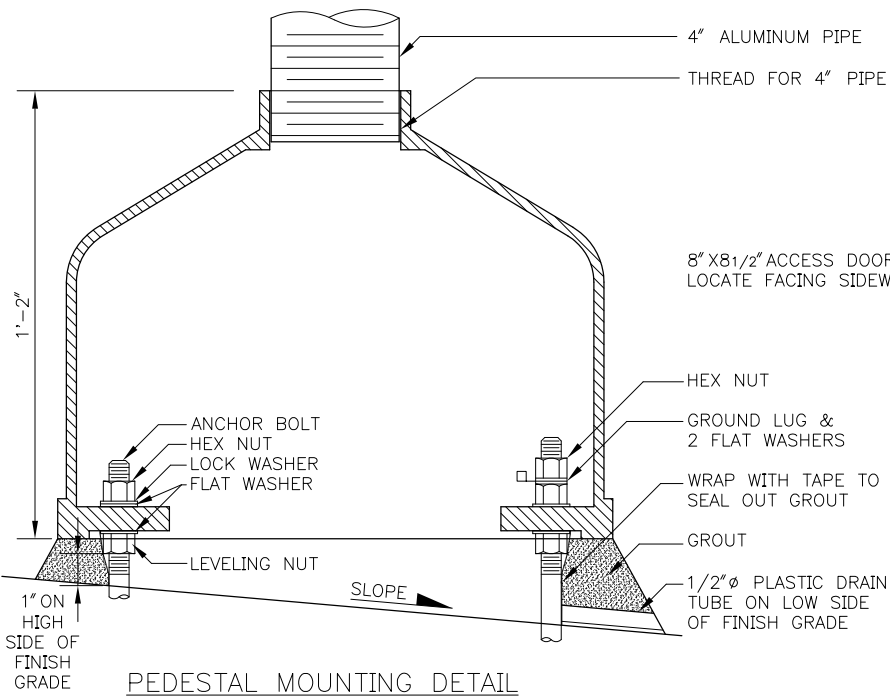

PEDESTAL MOUNTING DETAIL

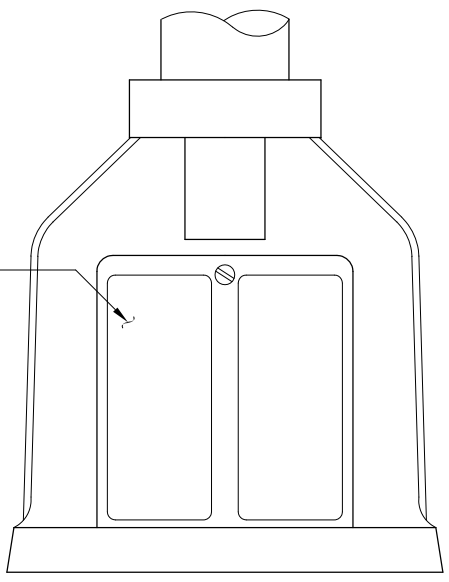


SQUARE ALUMINUM BASE PEDESTAL

REF STD SPEC SEC 8-32




NOT TO SCALE


PEDESTAL & FOUNDATION

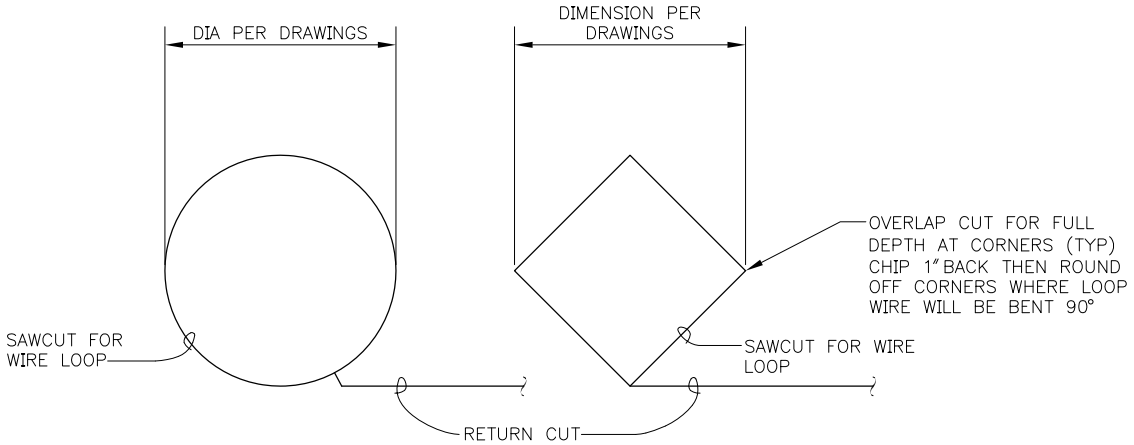


DIPOLE LOOP DETECTORS

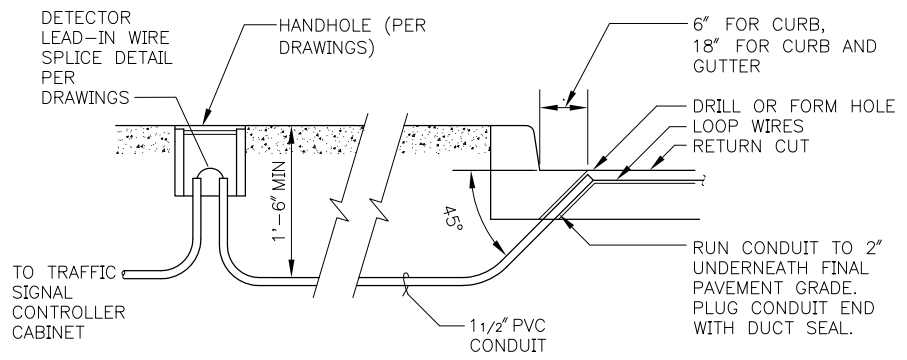

CURB/PAVEMENT ENTRANCE FOR DETECTOR LOOP WIRES

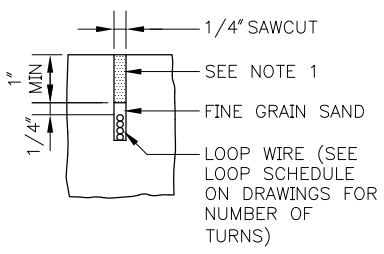

SECTION A-A

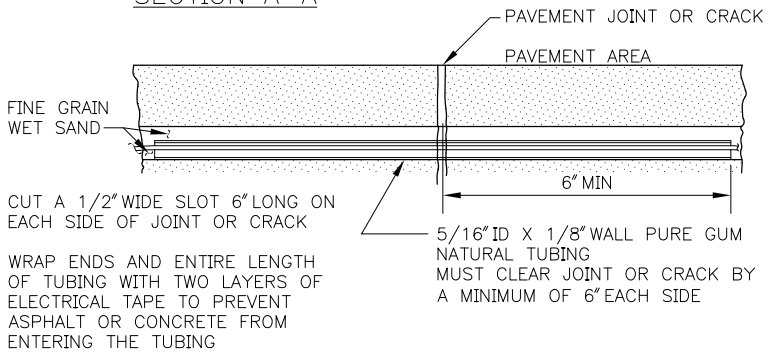

PAVEMENT JOINT OR CRACK DETAIL

NOTES:

1. FILL CUT AFTER VERTICAL PLACEMENT AND TESTING WITH HOT PAVING GRADE LIQUID ASPHALT ASTM D 312 TYPE III OR QUICK SETTING HIGH STRENGTH GROUT
2. SHARP EDGE TOOLS SHALL NOT BE USED IN PLACING CONDUCTORS IN SAW CUTS
3. EACH PAIR OF LOOP WIRES IN THE RETURN CUT SHALL BE TWISTED A MINIMUM OF 3 TURNS PER FOOT AND MAY SHARE COMMON RETURN CUTS WITH OTHER TWISTED PAIRS
4. TAPE LOOP WIRE A MINIMUM OF 2 TURNS AT EACH CORNER
5. REMOVE SHARP CORNER EDGES IN SAW CUTS WHERE LOOP WIRE WILL BE BENT AROUND
6. PERFORM RESISTANCE AND CONTINUITY TESTS PRIOR TO SEALING LOOP WIRES
7. COIL 5'-0" OF LOOP WIRE IN HANDHOLE


REF STD SPEC SEC 8-31



City of Seattle


NOT TO SCALE

LOOP DETECTORS

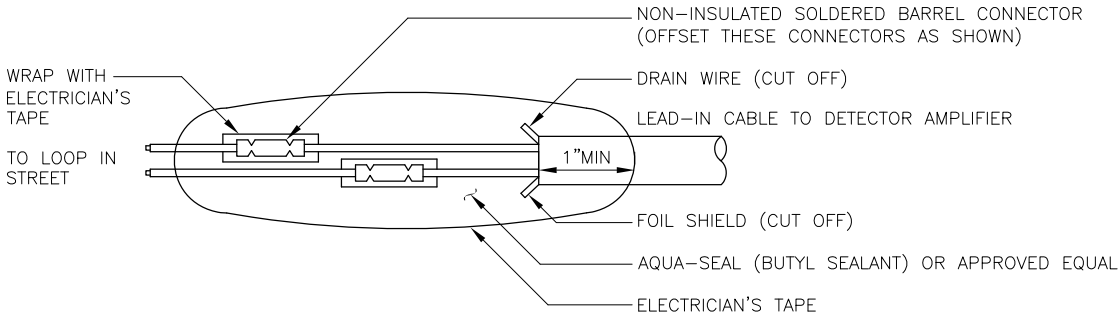

DETECTOR LEAD-IN WIRE SPLICE DETAIL

NOTE:
SOLDER CONNECTION AFTER CRIMPING

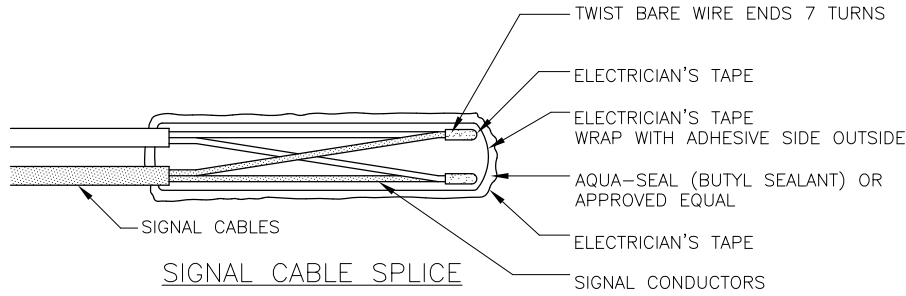


SIGNAL CABLE SPLICE

REF STD SPEC SEC 8-31




NOT TO SCALE

DETECTOR LOOP WIRE AND SIGNAL CABLE SPLICE

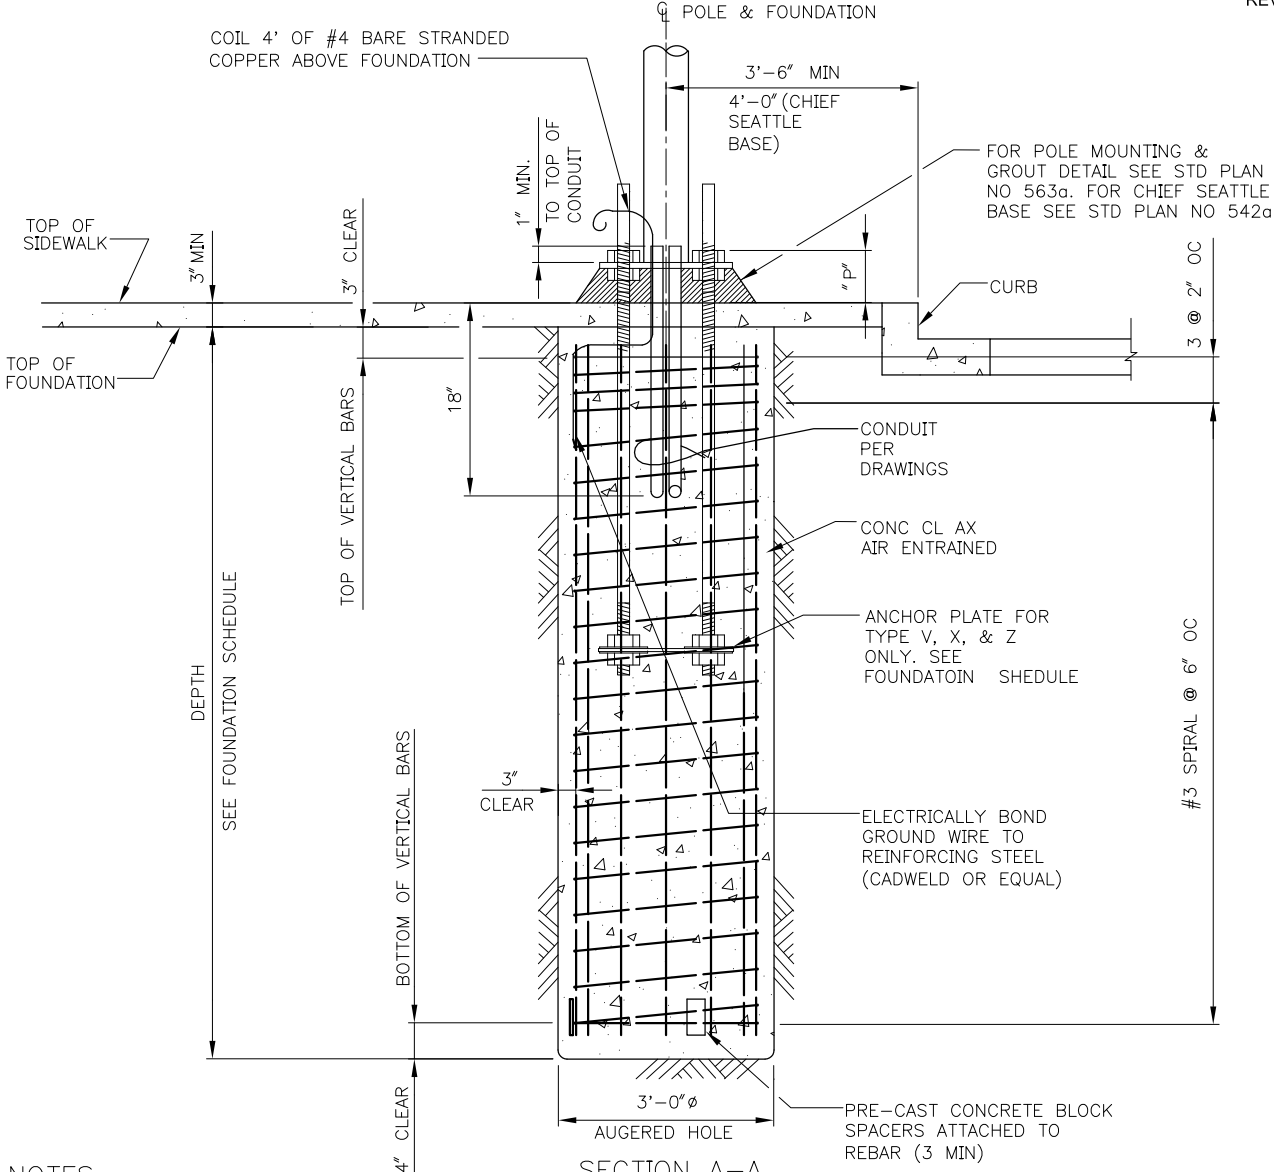

NOTES:

1. FOR STEEL MAST ARM POLE FOUNDATION SCHEDULE, SEE STD PLAN NO 562b
2. INSTALL UFER GROUND IN FOUNDATION (SEE STD PLAN NO 500a)

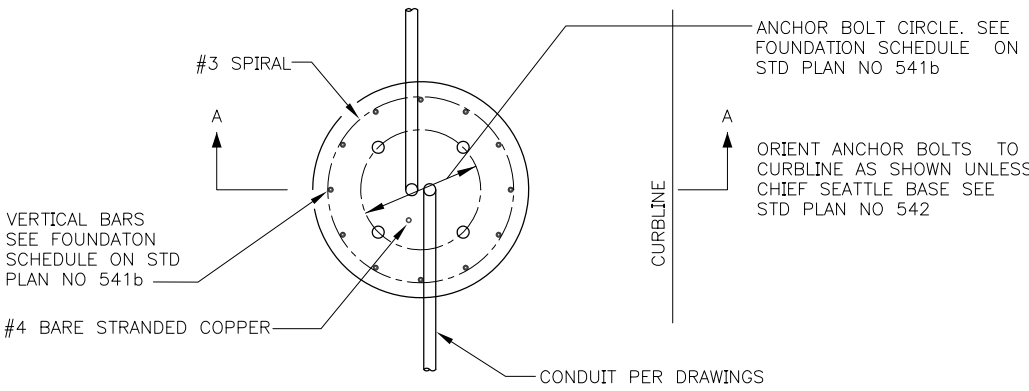

PLAN VIEW
STRAIN POLE FOUNDATION IN SIDEWALK

REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


STRAIN POLE FOUNDATION DETAIL (TYPE T, V, X & Z)

FOUNDATION SCHEDULE											
POLE TYPE	PROJECTION		VERTICAL REINFORCING	DEPTH (LATERAL BEARING)		ANCHOR BOLTS (TOTAL 4 PER POLE)	ANCHOR PLATE DIMENSIONS				
	P	P* (CHIEF SEATTLE BASE)		100#/SF/FT	150/SF/FT		SIZE	BOLT CIRCLE DIA	BOLT HOLE	CENTER HOLE	CORNER RADIUS
T	7 1/2"	8"	8 #7	8'-0"	7'-6"	1 1/2" DIA X 54" X 6"	—————	14 1/2"	—	—	—
V	9"	9"	8 #8	9'-6"	8'-6"	1 3/4" DIA X 72"	3/8" X 16" X 16"	18"	1 7/8"	12 1/2"	1 5/8"
X	10"	10"	12 #8	12'-6"	10'-6"	2" DIA X 72"	3/8" X 18" X 18"	20"	2 1/8"	14"	2"
Z	11 1/2"	11 1/2"	12 #8	15'-0"	13'-0"	2 1/2" DIA X 72"	1/2" X 20" X 20"	22"	2 5/8"	15"	2 1/4"

* SEE STD PLAN NO 542

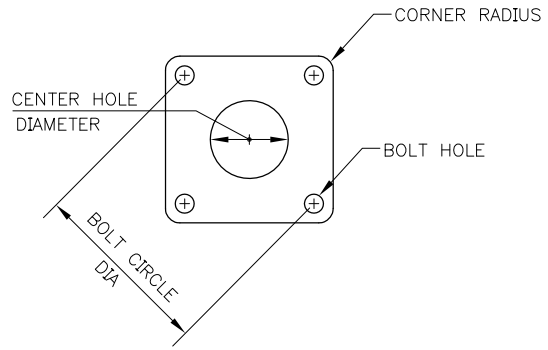

ANCHOR PLATE FOR TYPE V,X & Z

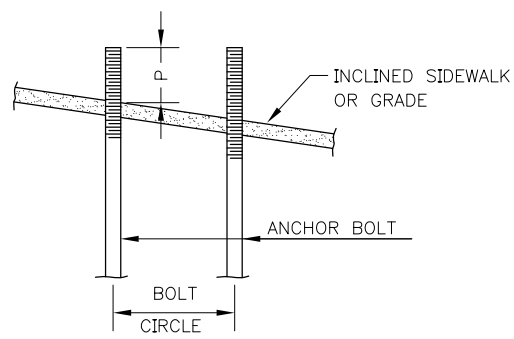

INCLINED CONDITION

POLE FOUNDATION NOTES

1. CONCRETE STRENGTH SHALL BE CLASS AX AIR ENTRAINED.
2. ANCHOR BOLTS FOR TYPE V,X,Z: ASTM A354 GRADE BC OR A687.
ANCHOR BOLTS FOR TYPE T: ASTM A576 (TYPE 1040 OR 1045)
FY=55 KSI MIN., ASTM A675 GRADE 90 OR ASTM A36 MOD FY=55 KSI.
NUTS: ASTM A563 HEAVY HEX GRADE DH. HARDENED STEEL WASHERS: ASTM F436.
3. ANCHOR PLATE: ASTM A36. HOT DIP GALVANIZED.
4. ALL REINFORCING BARS SHALL BE DEFORMED BILLET STEEL CONFORMING TO ASTM CLASS A615, GRADE 60.
5. ANCHOR BOLTS SHALL BE HOT DIP GALVANIZED ASTM A153 INCLUDING NUTS & WASHERS (FULL LENGTH) WITH A MINIMUM OF 18" OF THREADS ON TOP & 12" ON BOTTOM (TYPE V,X,Z ONLY).
6. LATERAL BEARING IS BASED ON THE SOIL CLASSIFICATION USED IN THE 1997 UNIFORM BUILDING CODE UNDER TABLE 18-I-A.
7. TAPE THE TOP OF ANCHOR BOLTS WITH CORROSION PROTECTION TAPE PER STD SPEC SEC 8-32.3(2)A PRIOR TO POURING CONCRETE.

REF STD SPEC SEC 8-32




NOT TO SCALE

STRAIN POLE FOUNDATION SCHEDULE & NOTES (TYPE T,V,X & Z)

STANDARD PLAN NO 542a

REV DATE: 2003

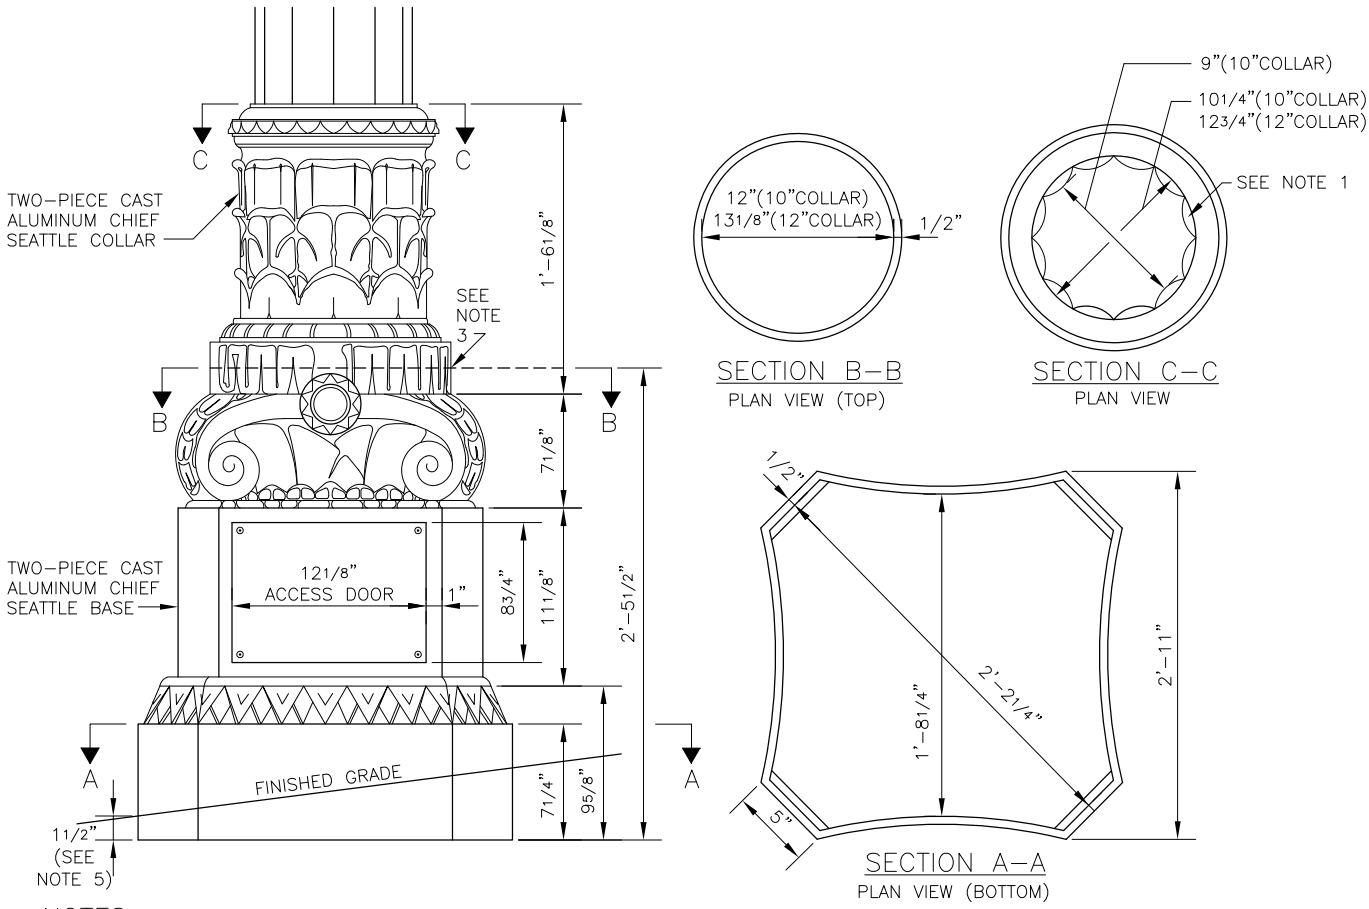


NOTES:

- FOR POLE DIAMETER GREATER THAN 9 1/2" BUT NOT MORE THAN 10" OD, A 10" COLLAR SHALL BE USED & THE FLUTES ON THE TOP OF THE COLLAR MAY HAVE TO BE GROUND OFF TO ALLOW A SNUG FIT AGAINST THE POLE
- FOR POLE DIAMETER GREATER THAN 10" BUT NOT MORE THAN 12 1/2" OD, A 12" COLLAR SHALL BE USED
- FOR POLE DIAMETER IN EXCESS OF 12 1/2" BUT NOT MORE THAN 13" OD, THE COLLAR SHALL NOT BE USED. SOME GRINDING MAY BE REQUIRED TO ALLOW THE TWO PIECE CAST BASE TO FIT SNUGLY AROUND THE POLE
- SEE STD PLAN NO 542b FOR TYPE T, V, X & Z STRAIN POLE FOUNDATION DETAILS
- BASE SHALL BE EMBEDDED 1 1/2" AT LOW POINT OF SIDEWALK GRADE

POLE TYPE	G	P
T	6 1/2"	8"
V	6 1/2"	9"
X	7"	10"
*Z	11 1/2"	11 1/2"

*CSB WILL NOT FIT OVER ANCHOR BOLT NUTS THEREFORE BOLTS MUST BE SET BELOW SIDEWALK

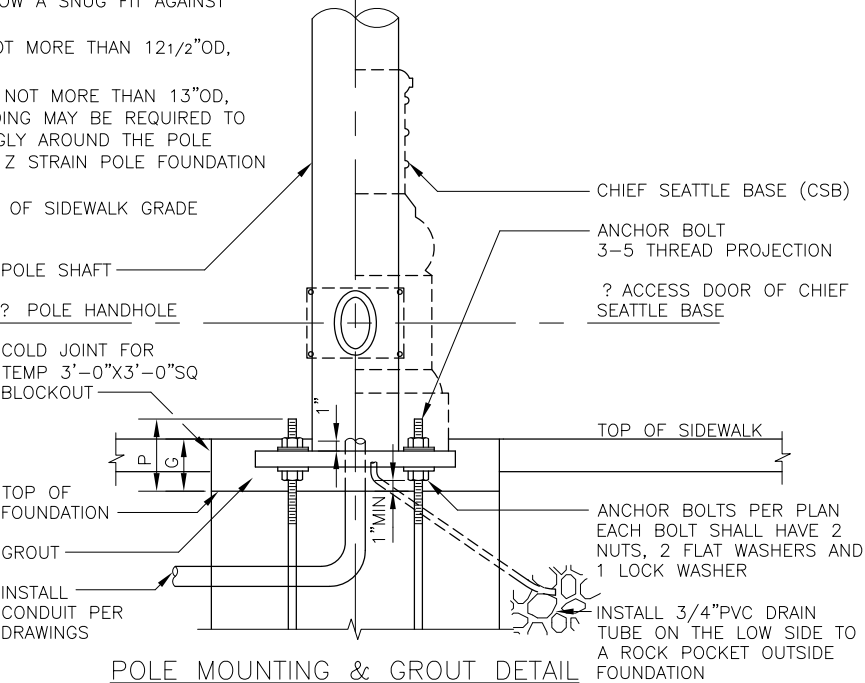


POLE MOUNTING & GROUT DETAIL

REF STD SPEC SEC 8-32




NOT TO SCALE

CHIEF SEATTLE BASE (CSB)

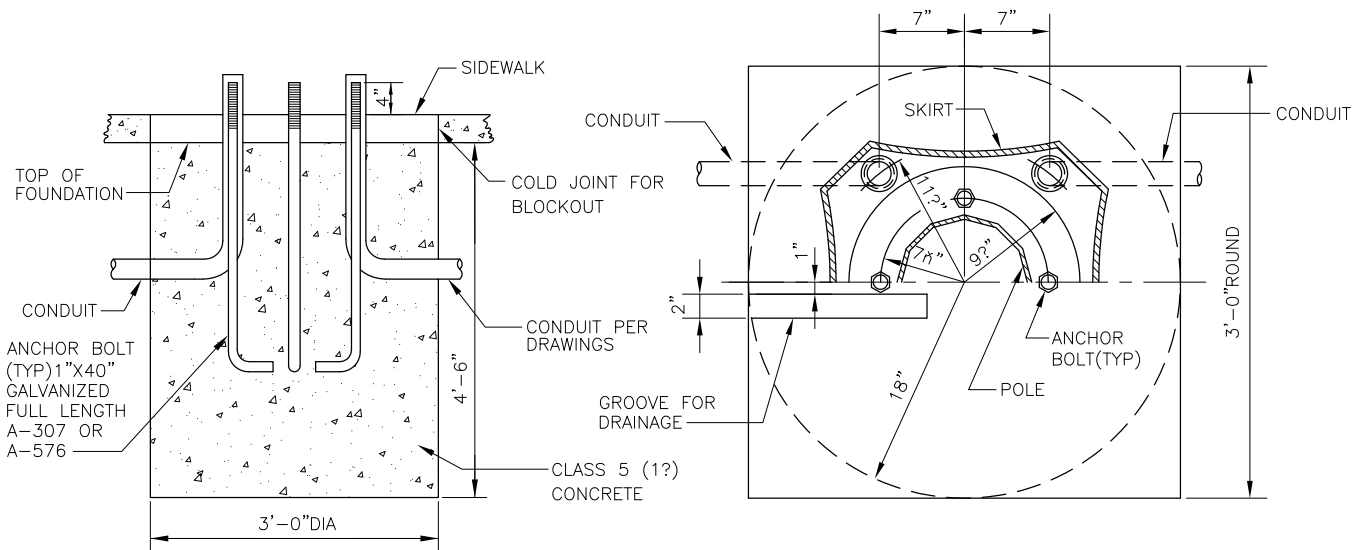

TYPE A

BOLT PATTERN MUST BE DIAMOND SHAPE TO CURB. CONDUIT IS OUTSIDE BOLT CIRCLE.

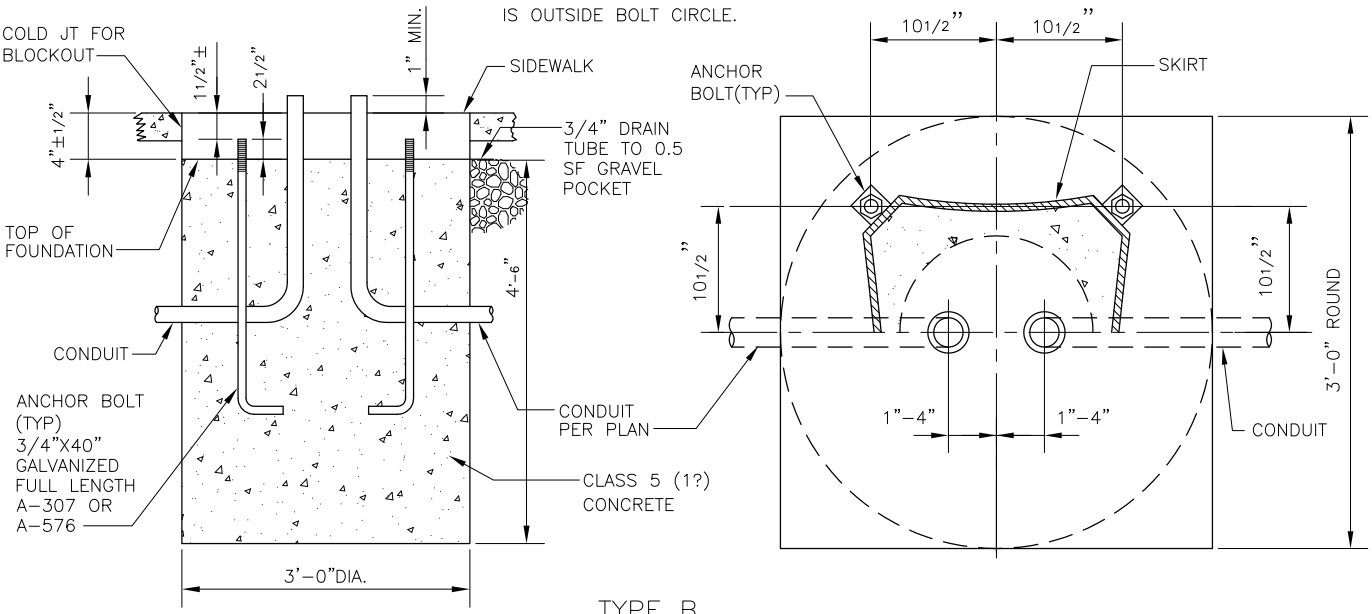

TYPE B

TO BE USED FOR CONCRETE FILLED POLE. BOLTS ARE PARALLEL TO CURB. CONDUIT IS INSIDE BOLT CIRCLE.

NOTES:

1. FOR TYPE "A" FOUNDATION ALIGN THE CHIEF SEATTLE BASE ACCESS COVER ON THE SAME SIDE WITH THE POLE HANDHOLE, AND CONDUITS.
2. TAPE TOP OF ANCHOR BOLTS WITH CORROSION PROTECTION TAPE PER SPECS.
3. FOR TYPE "A" FOUNDATION, THE TOP 3%316" SHALL BE FORMED INTO A SQUARE AND Poured PRIOR TO SETTING POLES.
4. FOR TYPE "B" FOUNDATION, THE TOP 5%316" SHALL BE FORMED INTO A SQUARE AND Poured AFTER SETTING THE POLE.
5. INSTALL UFER GROUND IN FOUNDATION (SEE STD PLAN NO 500a)

REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


CHIEF SEATTLE STREET LIGHT POLE FOUNDATION

STANDARD PLAN NO 543


REV DATE: 2003

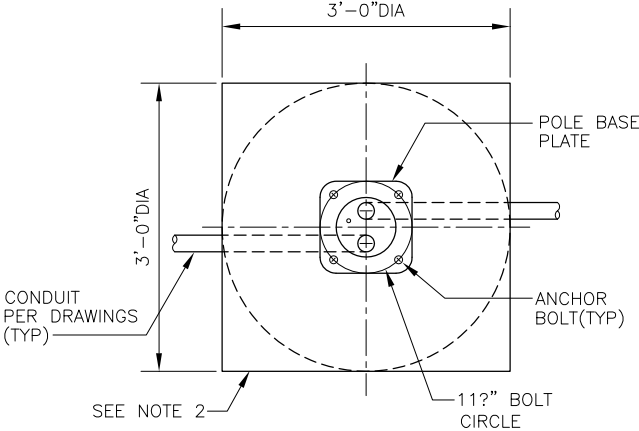


PLAN

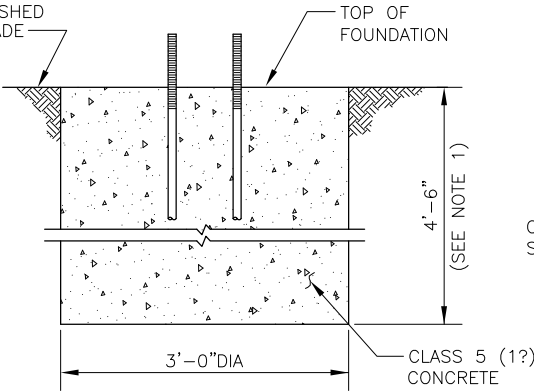

IN EARTH
(TYPE B)

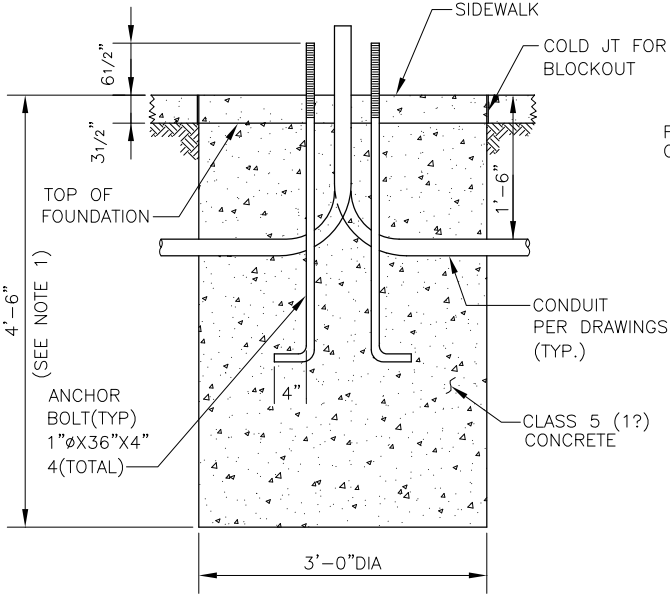

IN SIDEWALK
(TYPE A)

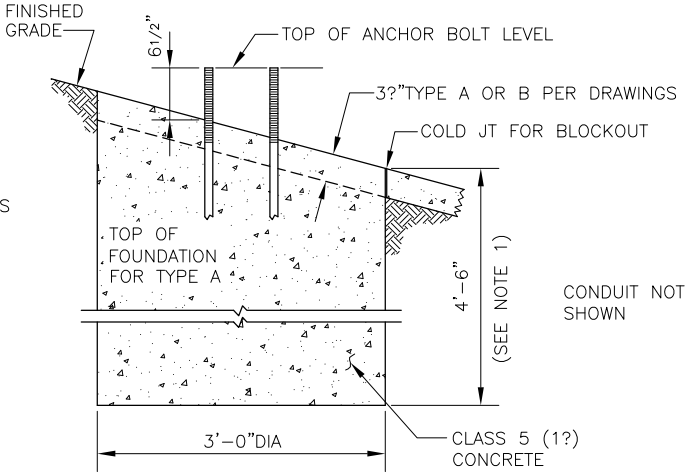

ON AN INCLINE

NOTES:

1. 5 FT WHERE LOCATED ON FILL OR WHERE SLOPE IS 3:1 OR STEEPER.
2. TOP 3?" TO BE FORMED INTO A 36" SQUARE BLOCKOUT AND POURED SEPARATELY IN TYPE A AND IN ONE PIECE IN TYPE B.
3. BOLT CIRCLE-11?" TYP. (TRANSFORMER BASE-15" TYP.)
4. SEE STD PLAN NO 563 FOR POLE MOUNTING AND GROUT DETAIL.
5. TAPE TOP OF ANCHOR BOLTS W/CORROSION PROTECTION TAPE PER SPECS 8-32.3(2)A
6. SEE STD PLAN NO 572 FOR STEEL STREET LIGHT POLE DETAIL AND CITY LIGHT MATERIAL STD NO 5739.8 FOR ALUMINUM STREET LIGHT POLE.
7. ANCHOR BOLTS SHALL BE HOT DIP GALVANIZED (ASTM A 153) FULL LENGTH AND FABRICATED FROM ASTM A 307 OR A 576.
8. INSTALL UFER GROUND IN FOUNDATION (SEE STD PLAN NO 500a)

REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE

STREET LIGHT POLE FOUNDATIONS

STANDARD PLAN NO 550


REV DATE: 2003

HANDHOLE SCHEDULE


HANDHOLE TYPE	TOP UNIT INSIDE DIMENSIONS			EXTENSION UNIT(E)	LID DIMENSIONS	
	L	W	H	H	L	W
1	19"	14"	12"	12"	17 3/4"	13"
2	28"	17"	12"	12"	26 5/8"	17 1/8"
3	36"	24"	12"	12"	44"	32"
4	24" DIA	VAR	NA	NA	NA	NA
5	36"	24"	32"	NA	44"	32"
GRHH	8" DIA			NA		

NOTES:


1. THE COVER SHALL HAVE 1/16" TO 1/8" CLEARANCE ON EACH EDGE WITHIN THE FRAME AFTER GALVANIZING
2. THE GROUND ROD SHALL EXTEND A 3" MIN AND 6" MAX ABOVE THE BOTTOM OF THE HANDHOLE
3. TYPE 1, 2, 3 & 5 HANDHOLE COVERS SHALL HAVE "TC" OR "SL" ON THEM, AS APPROPRIATE
4. TYPE 4 HANDHOLE SHALL BE INSTALLED IN ROADWAYS, PARKING LOTS, ETC
5. FOR PAVEMENT DEPTH GREATER THAN 7" USE FRAME EXTENSIONS (SEE STD PLAN NO 231) TO BRING THE COVER UP TO THE LEVEL OF THE FINISHED PAVEMENT WITHOUT EMBEDDING THE BOTTOM FLANGE OF THE CASTING IN THE PAVEMENT
6. A 4' LENGTH OF #8 BRAIDED COPPER WIRE SHALL BE SECURED FROM THE HANDHOLE LID TO THE FRAME. WITH A 4'-0" LENGTH FROM FRAME THAT CAN BE HOOKED UP TO A GROUND ROD
7. BUNDLE CABLE IN HANDHOLES TO PROVIDE ORDERLY GROUPING OF CABLES
8. ALL HAND HOLE LIDS AND FRAMES SHALL HAVE A NON-SKID SURFACE (SEE STD SPEC SEC 9-34.6)

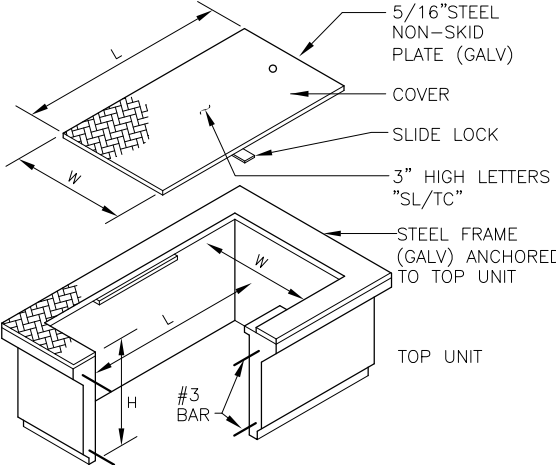


TYPE 1 & 2 HANDHOLE

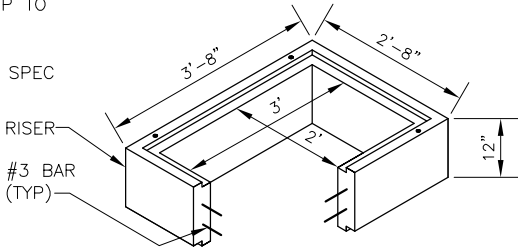


TYPE 3 HANDHOLE
(COVER SAME AS TYPE 5)

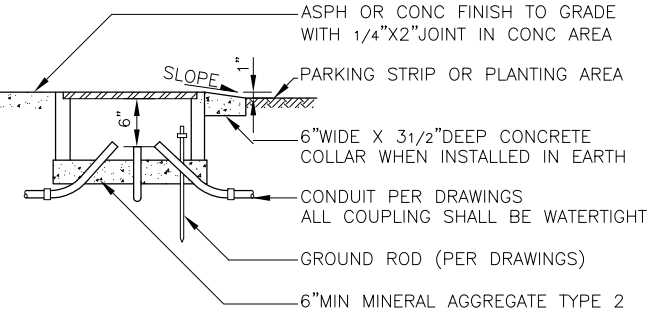


HANDHOLE INSTALLATION DETAIL

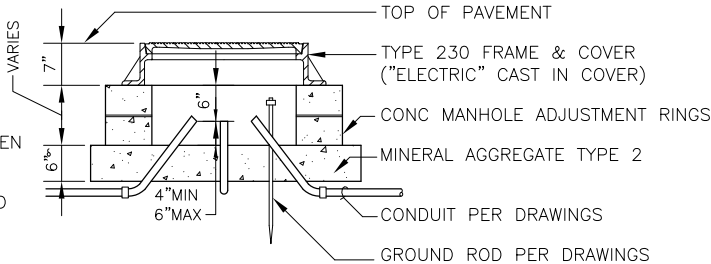

TYPE 4 HANDHOLE
TRAFFIC BEARING

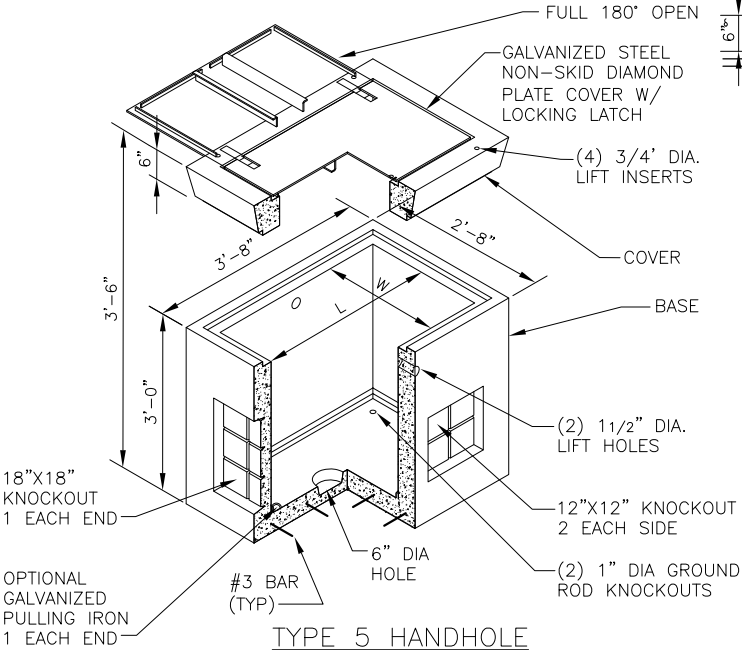

TYPE 5 HANDHOLE

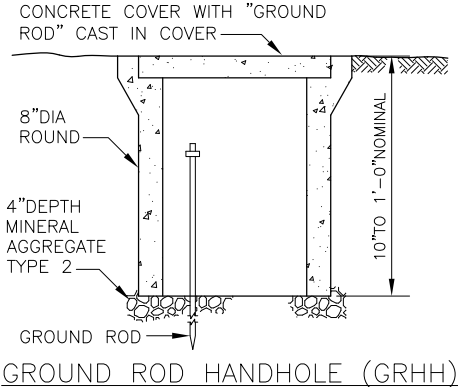

GROUND ROD HANDHOLE (GRHH)

REF STD SPEC SEC 8-33




City of Seattle

NOT TO SCALE

HANDHOLES

STANDARD PLAN NO 560


REV DATE: 2003

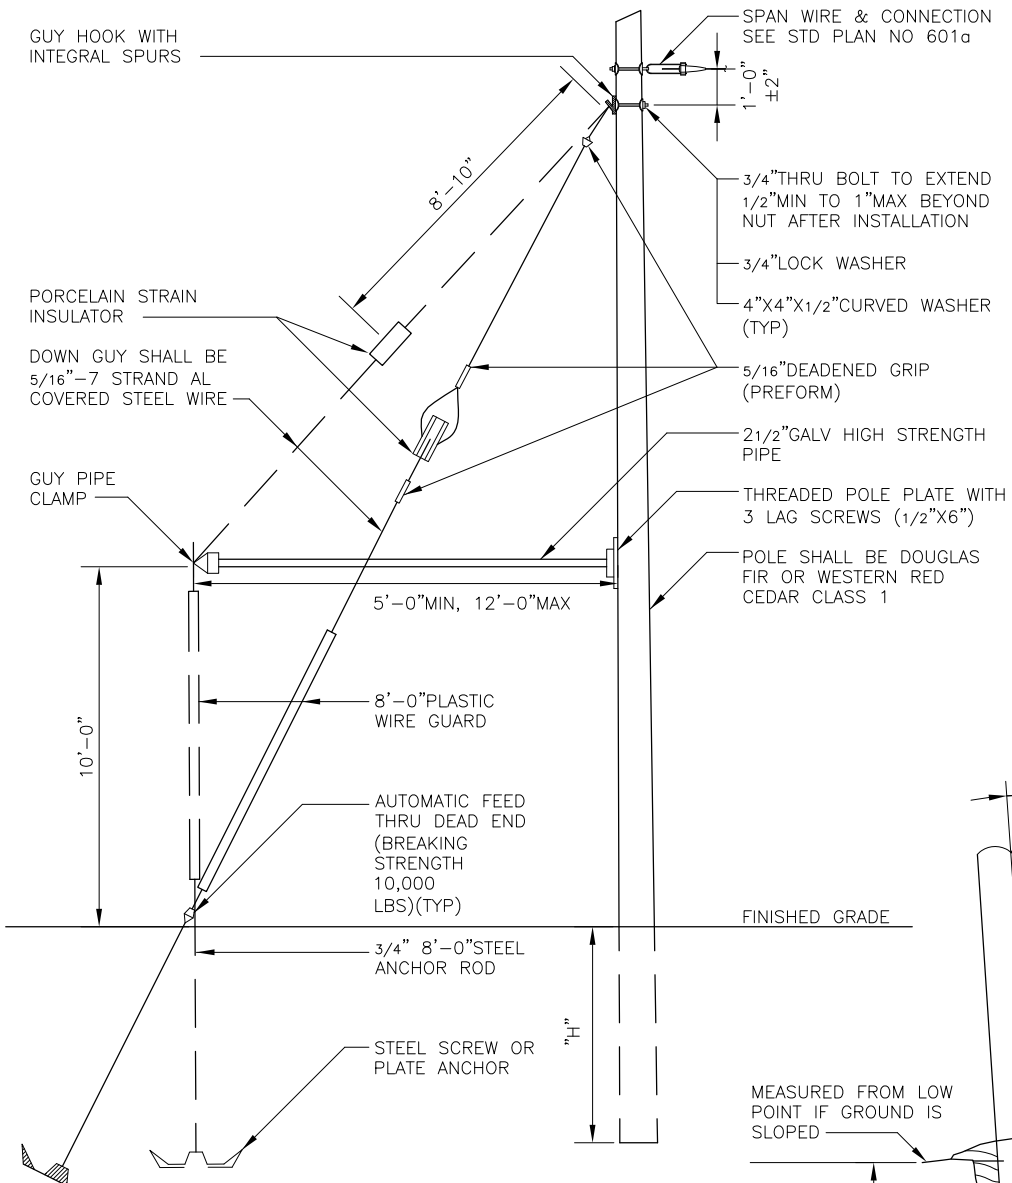


POLES SHALL BE MARKED (BRANDED) BY MANUFACTURER WITH THE FOLLOWING INFORMATION:
 1. CLASS
 2. LENGTH
 3. MANUFACTURER
 4. TYPE OF PRESERVATIVE

LENGTH OF POLE	"H"
20'-0" & 25'-0"	5'-0"
30'-0"	5'-6"
35'-0" & 40'-0"	6'-0"

RAKE SCHEDULE	
LENGTH FT	RAKE IN INCHES
30	18
35	20
40	22

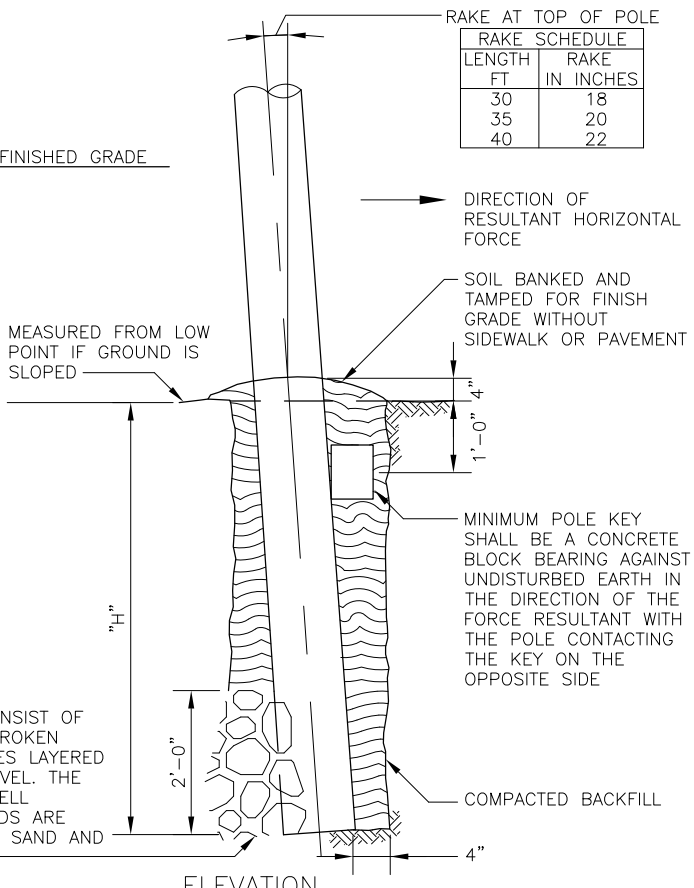

WOOD POLE DOWN & SIDEWALK GUY

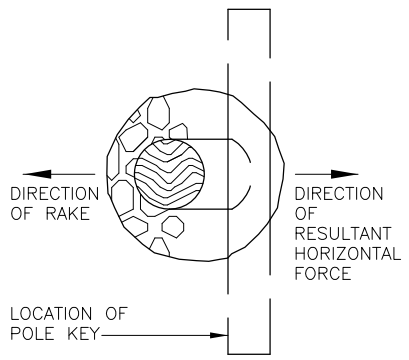

POLE TOE SHALL CONSIST OF BUILDING BLOCKS, BROKEN CONCRETE OR STONES LAYERED WITH SAND AND GRAVEL. THE LAYERS SHALL BE WELL TAMPED SO THE VOIDS ARE FILLED SOLIDLY WITH SAND AND GRAVEL.

PLAN

ELEVATION

WOOD POLE KEYING STANDARD

REF STD SPEC SEC 8-32 AND SCL CONSTRUCTION GUIDELINES D6-4




City of Seattle

NOT TO SCALE

WOOD STRAIN POLES

STANDARD PLAN NO 562a

REV DATE: 2003

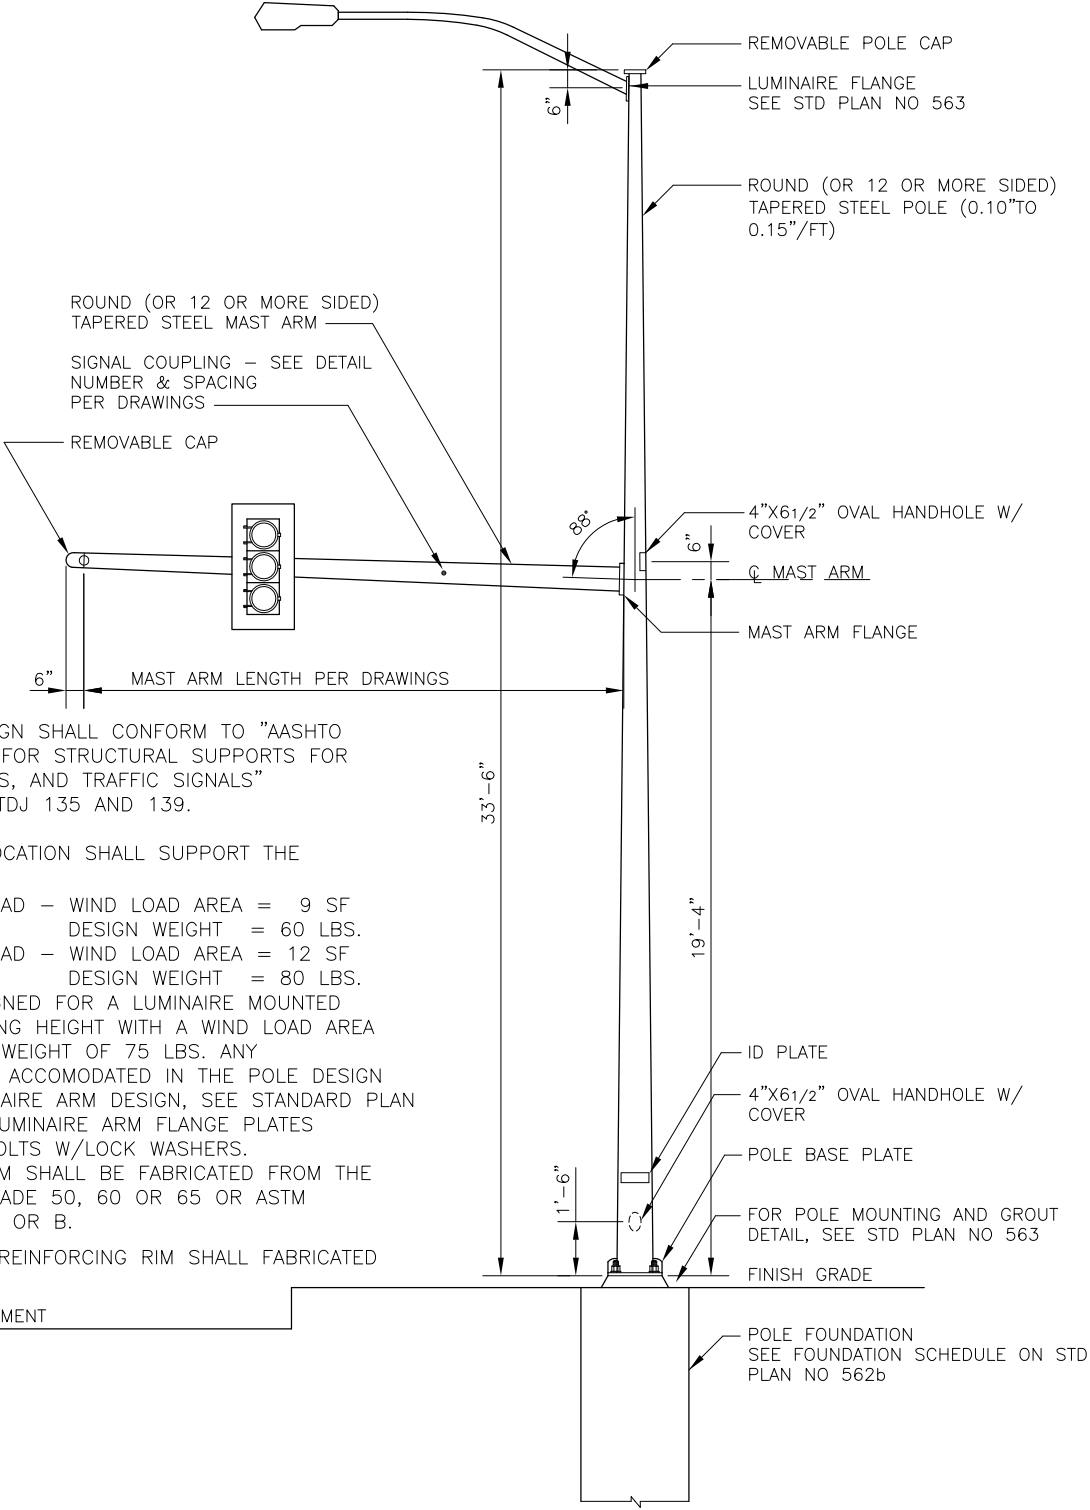

NOTES:

1. POLE AND MAST ARM DESIGN SHALL CONFORM TO "AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS" (1994 EDITION) AND EE1-TDJ 135 AND 139.
2. EACH SIGNAL COUPLING LOCATION SHALL SUPPORT THE FOLLOWING:
 FOR 3 SECTION SIGNAL HEAD - WIND LOAD AREA = 9 SF
 DESIGN WEIGHT = 60 LBS.
 FOR 4 SECTION SIGNAL HEAD - WIND LOAD AREA = 12 SF
 DESIGN WEIGHT = 80 LBS.
3. THE POLE SHALL BE DESIGNED FOR A LUMINAIRE MOUNTED AT A NOMINAL 35' MOUNTING HEIGHT WITH A WIND LOAD AREA OF 3.2 SF AND A DESIGN WEIGHT OF 75 LBS. ANY PROPOSED SIGN SHALL BE ACCOMODATED IN THE POLE DESIGN PER DRAWINGS. FOR LUMINAIRE ARM DESIGN, SEE STANDARD PLAN NO 572. MAST ARM AND LUMINAIRE ARM FLANGE PLATES SHALL HAVE ASTM A325 BOLTS W/LOCK WASHERS.
4. POLE SHAFT AND MAST ARM SHALL BE FABRICATED FROM THE FOLLOWING: ASTM A572 GRADE 50, 60 OR 65 OR ASTM A595 GRADE A OR B.
5. ALL PLATES & HANDHOLE REINFORCING RIM SHALL FABRICATED FROM ASTM A36


REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE

STEEL MAST ARM POLE

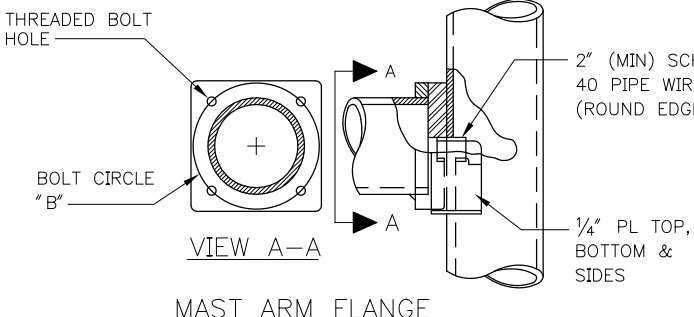


MAST ARM FLANGE

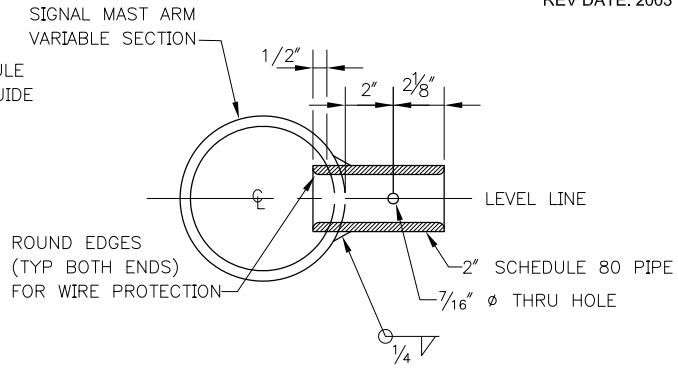


SIGNAL COUPLING

COUPLING TO BE FABRICATED & INSTALLED BEFORE GALVANIZING

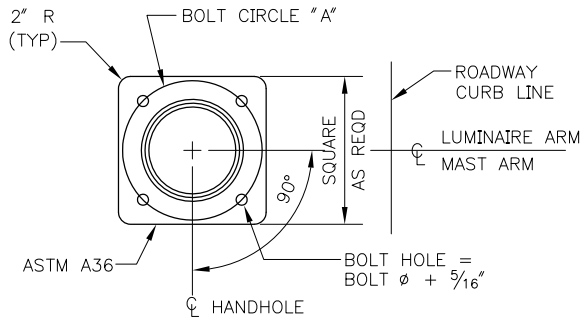

POLE BASE PLATE

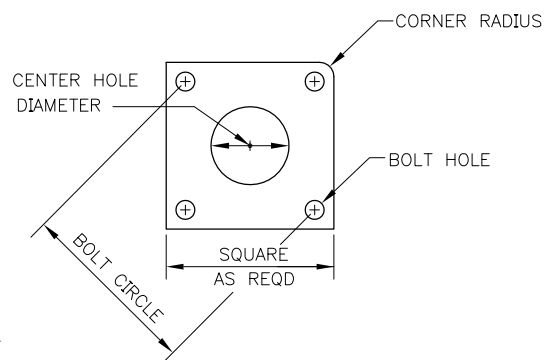


ANCHOR PLATE

PER FOUNDATION SCHEDULE

POLE FOUNDATION NOTES

1. CONCRETE STRENGTH SHALL BE CLASS AX AIR ENTRAINED.
2. ANCHOR BOLTS SHALL HAVE $F_y = 55$ KSI MIN, NUTS: ASTM A563 HEAVY HEX GRADE DH. HARDENED STEEL WASHERS: ASTM F436.
3. BOTTOM ANCHOR PLATE: ASTM A36. HOT DIP GALVANIZED.
4. ALL REINFORCING BARS SHALL BE DEFORMED BILLET STEEL CONFORMING TO ASTM CLASS A615, GRADE 60.
5. ANCHOR BOLTS SHALL BE HOT DIP GALVANIZED ASTM A153 INCLUDING NUTS & WASHERS (FULL LENGTH) WITH A MINIMUM OF 18" OF THREADS ON TOP & 12" ON BOTTOM.
6. LATERAL BEARING IS BASED ON THE SOIL CLASSIFICATION USED IN THE 1997 UNIFORM BUILDING CODE UNDER TABLE 18-I-A.
7. TAPE THE TOP OF ANCHOR BOLTS WITH CORROSION PROTECTION TAPE PER STD SPEC SEC 8-32.3(2)A PRIOR TO POURING CONCRETE.
8. SEE STD PLAN NO 541A FOR FOUNDATION DETAILS.

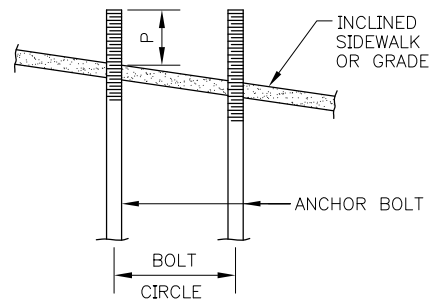

INCLINED CONDITION

MAST ARM SCHEDULE			POLE SCHEDULE		
MAST ARM LENGTH	FLANGE PLATE		POLE BASE PLATE		
	BOLT CIRCLE "B"	THREADED BOLT DIA	SIZE	BOLT CIRCLE "A"	BOLT HOLE
15'-0" TO 30'-0"	11"	1"-8NC	1 1/2" X 16" X 16"	14 1/2"	1 1 3/16"
31'-0" TO 40'-0"	12"	1 1/4"-7NC	1 3/4" X 18" X 18"	16 1/2"	2 1/16"
41'-0" TO 45'-0"	13 1/8"	1 1/4"-7NC	1 3/4" X 18" X 18"	18"	2 1/16"
46'-0" TO 60'-0"	14"	1 1/2"-6NC	2" X 20" X 20"	20"	2 5/16"

FOUNDATION SCHEDULE											
MAST ARM LENGTH	FOUNDATION DEPTH (LATERAL BEARING)		PROJECTION	ANCHOR BOLTS (FY=55 KSI MIN.)		VERTICAL REINFORCING	ANCHOR PLATE DIMENSIONS				
	150#/SF/FT	100#/SF/FT		BOLT CIRCLE DIA	SIZE (J HOOK)		SIZE	BOLT CIRCLE DIA	BOLT HOLE	CENTER HOLE	CORNER RADIUS
15'-30'	7'-6"	8'-0"	7 1/2"	14 1/2"	1 1/2" X 54" X 6"	8 #7	-	-	-	-	
31'-40'	8'-6"	9'-6"	9"	16 1/2"	1 3/4" X 60" X 6"	8 #8	3/8" X 16" X 16"	16 1/2"	1 7/8"	12"	1 5/8"
41'-45'	8'-6"	9'-6"	9"	18"	1 3/4" X 60" X 6"	8 #8	3/8" X 16" X 16"	18"	1 7/8"	12"	1 5/8"
46'-60'	10'-6"	12'-6"	10"	20"	2" X 60" X 6"	12 #8	3/8" X 18" X 18"	20"	2 1/8"	14"	2"



REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


STEEL MAST ARM POLE FOUNDATION SCHEDULE & DETAIL (W/O METRO TROLLEY LOADS)

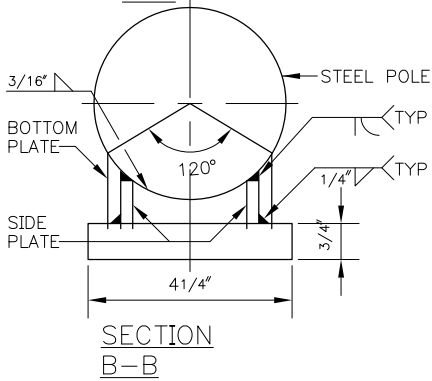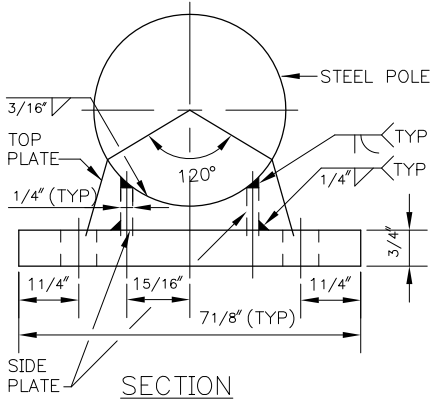


NOTE:
GROUT SHALL BE PREMIXED,
NON-SHRINK AND NON-METALLIC

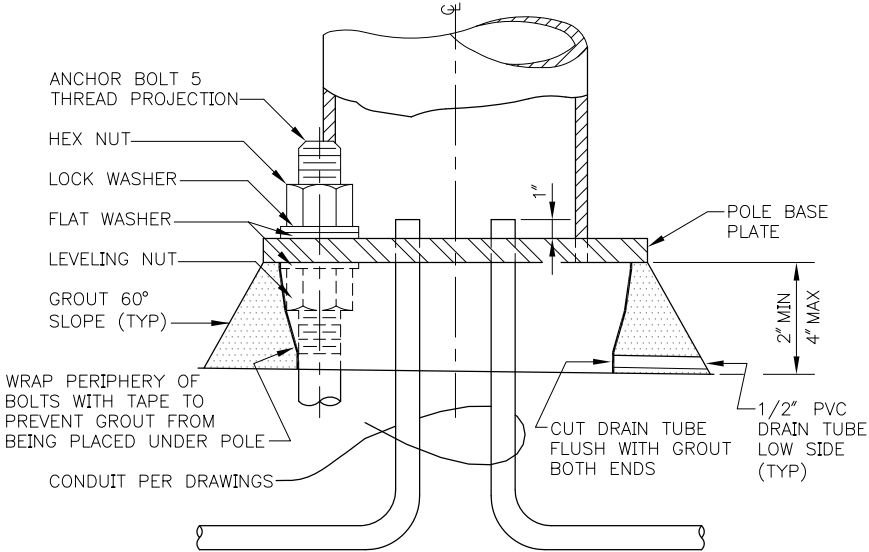

POLE MOUNTING & GROUT DETAIL
(EXCEPT FOR POLES W/ CHIEF SEATTLE BASE)

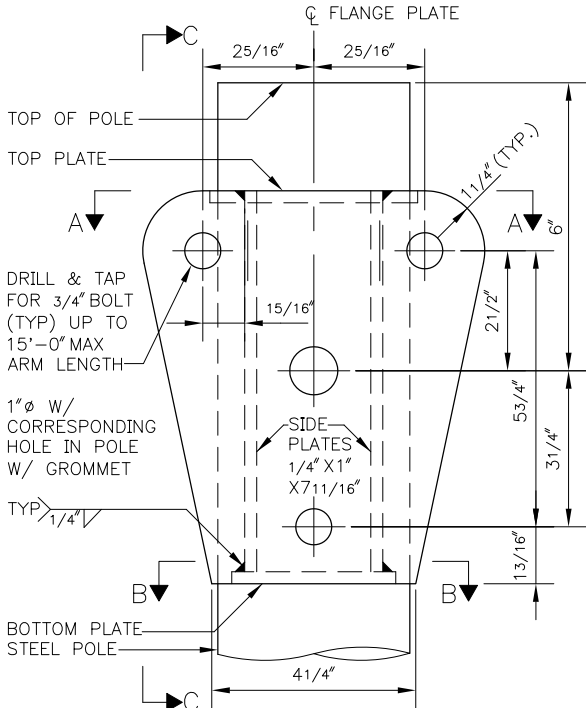

LUMINAIRE FLANGE PLATE ON POLE

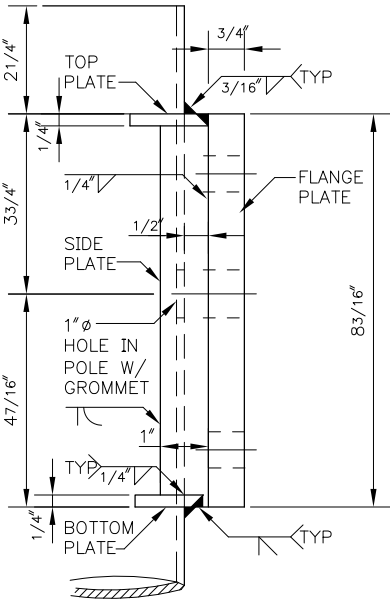

SECTION C-C
STRUCTURAL CARBON STEEL
PLATES SHALL BE ASTM A36



REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE


MISCELLANEOUS STEEL
POLE DETAILS

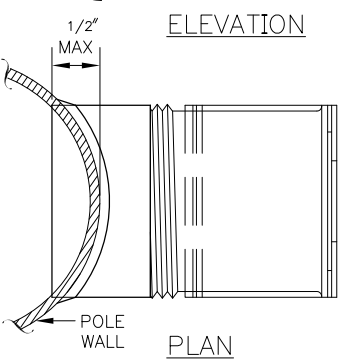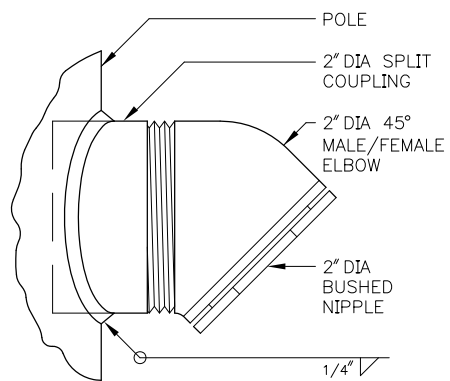

CABLE OUTLET DETAIL

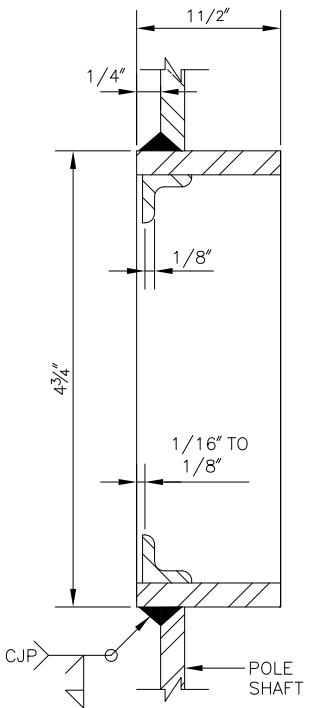


SECTION A-A

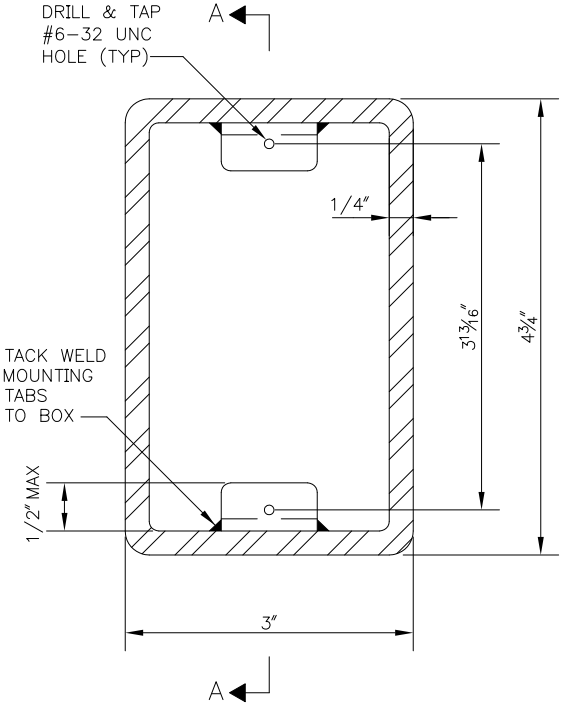

FESTOON OUTLET BOX

- NOTES:**
1. ALL OUTLETS SHALL BE PLUGGED WITH THREADED INSERT PLUGS DURING SHIPMENT TO PREVENT DAMAGE TO THREADS
 2. REMOVE BURRS AND SHARP EDGES TO PREVENT DAMAGE TO ELECTRICAL CABLE
 3. SPLIT COUPLING SHALL EXTEND INTO THE POLE 1/2" MAX AS SHOWN

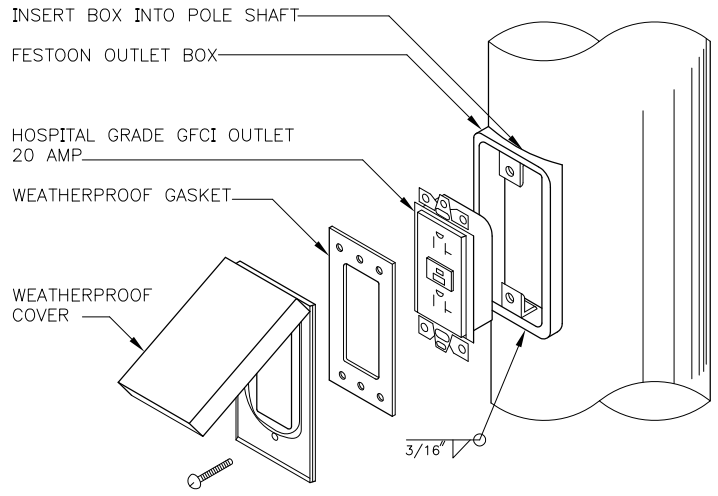

FESTOON OUTLET DETAIL (METAL POLES)

REF STD SPEC SEC 8-30 & 8-32




NOT TO SCALE


MISCELLANEOUS STEEL POLE DETAILS

STANDARD PLAN NO 566a


REV DATE: 2003

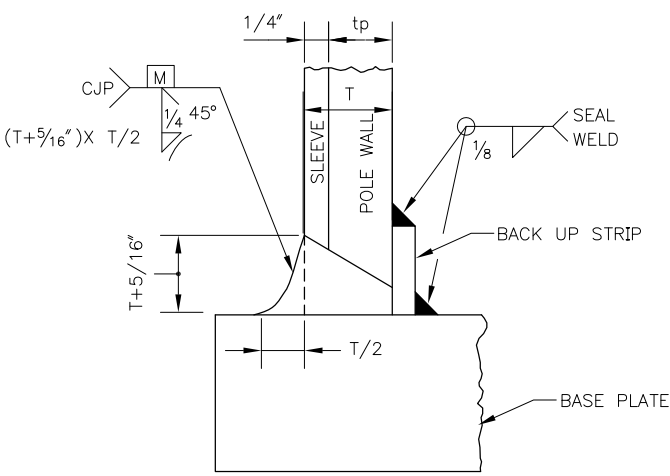


POLE BASE PLATE WELD DETAIL

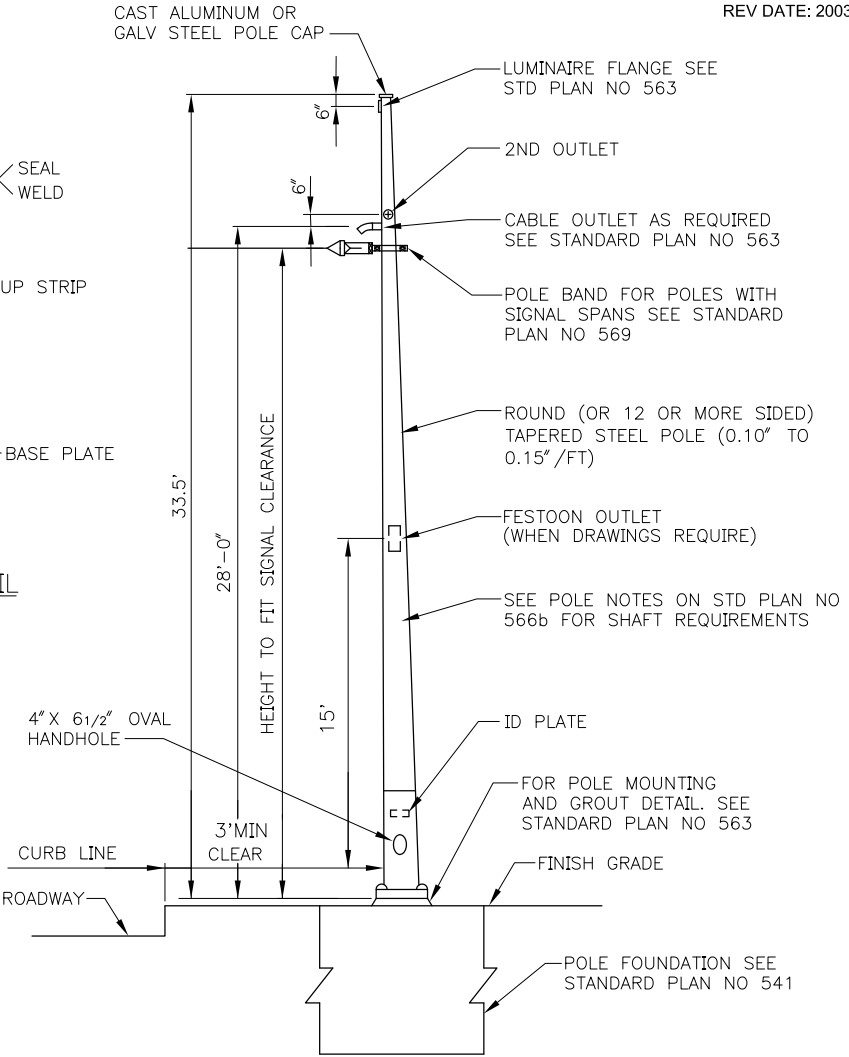

STRAIN POLE

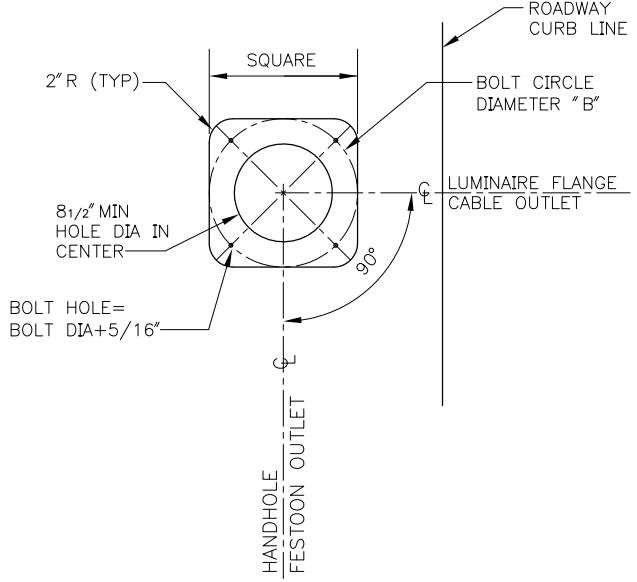

POLE BASE PLATE

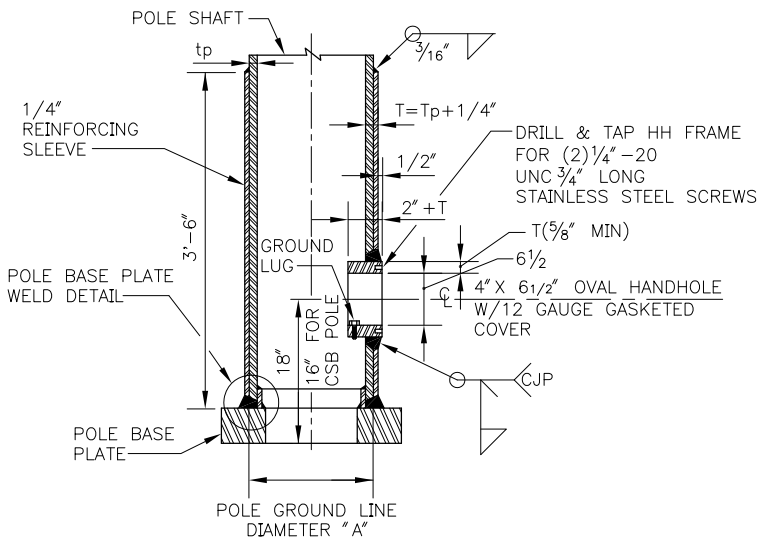

POLE BASE DETAIL

REF STD SPEC SEC 8-32



NOT TO SCALE

COMBINED USE METRO STRAIN POLE DETAILS (TYPE V,X,Z POLES)

POLE TYPE	DEAD LOAD MOMENT KIP-FT (AT GROUND LINE)	POLE SCHEDULE						
		GROUND LINE DIA. "A"		POLE BASE PLATE SIZE		BOLT CIRCLE DIA. "B"	BOLT HOLE	ANCHOR BOLTS
		STD	CSB	STD	CSB			
V	51	12"	12"	1 3/4" X 18" X 18"	1 3/4" X 23" X 23"	18'	2 1/16"	1 3/4" DIA. X 72"
X	93	14"	12" 1/2"	2" X 20" X 20"	2" X 23" X 23"	20"	2 5/16"	2" DIA. X 72"
Z	164	15"	-	2 1/2" X 23" X 23"	-	22"	2 13/16"	2 1/2" DIA. X 72"

POLE NOTES

1. THE YIELD MOMENT SHALL BE 2X THE DEAD LOAD MOMENT. THE ULTIMATE PLASTIC MOMENT SHALL BE 2.5 X THE DEAD LOAD MOMENT.
2. POLE SHAFT AND REINFORCING SLEEVE. ASTM A 572 GRADE 50, 60 OR 65 (Fy = 50, 60 OR 65 KSI RESPECTIVELY), OR ASTM A 595 GRADE A OR B (Fy = 55 OR 60 KSI RESPECTIVELY).
3. BASE PLATE AND HANDHOLE REINFORCING RIM: ASTM A 36 OR ASTM A 572 GRADE 42. BASE PLATE Fy ≥ 0.65 POLE SHAFT Fy. THE BASE PLATE THICKNESS MAY BE REDUCED BY 1/4" IF ASTM A 572 GRADE 42 STEEL IS USED.
4. REINFORCING SLEEVE SHALL BE FABRICATED FROM THE SAME MATERIAL TYPE AND YIELD STRENGTH AS THE POLE SHAFT.
5. POLE SHAFTS SHALL HAVE NO MORE THAN TWO LONGITUDINAL WELDS IN EACH PLY.
6. MINIMUM SHAFT WALL THICKNESS OF EACH PLY SHALL BE 0.239" (3 GAUGE). POLE SHALL HAVE A MAXIMUM OF TWO PLYS NOT INCLUDING THE 1/4" REINFORCING SLEEVE.
7. MAXIMUM SILICON CONTENT IN STEEL SHALL BE 0.04%. SEE STD SPEC SECTION 9-33.1(3) FOR GENERAL GALVANIZING REQUIREMENTS.
8. POLE DIAMETER FOR 12 OR MORE SIDED POLES SHALL BE MEASURED FROM THE FLAT TO FLAT DIMENSION.
9. POLES SHALL MEET DEFLECTION CRITERIA STATED IN STD SPEC SECTION 9-33.2(2) WITH THE DEAD LOAD APPLIED AT 25' ABOVE GROUNDLINE.
10. POLE STRENGTH SHALL MEET REQUIREMENTS OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS (1994 EDITION).

REF STD SPEC SEC 8-32





City of Seattle

NOT TO SCALE


COMBINED USE METRO STRAIN POLE DETAILS (TYPE V,X,Z POLES)

STANDARD PLAN NO 567a

REV DATE: 2003

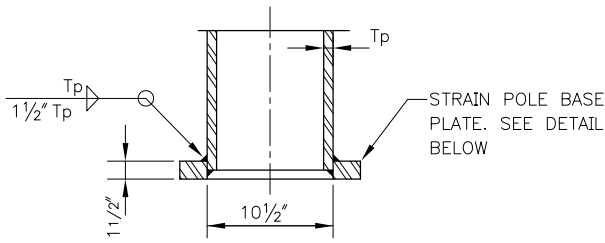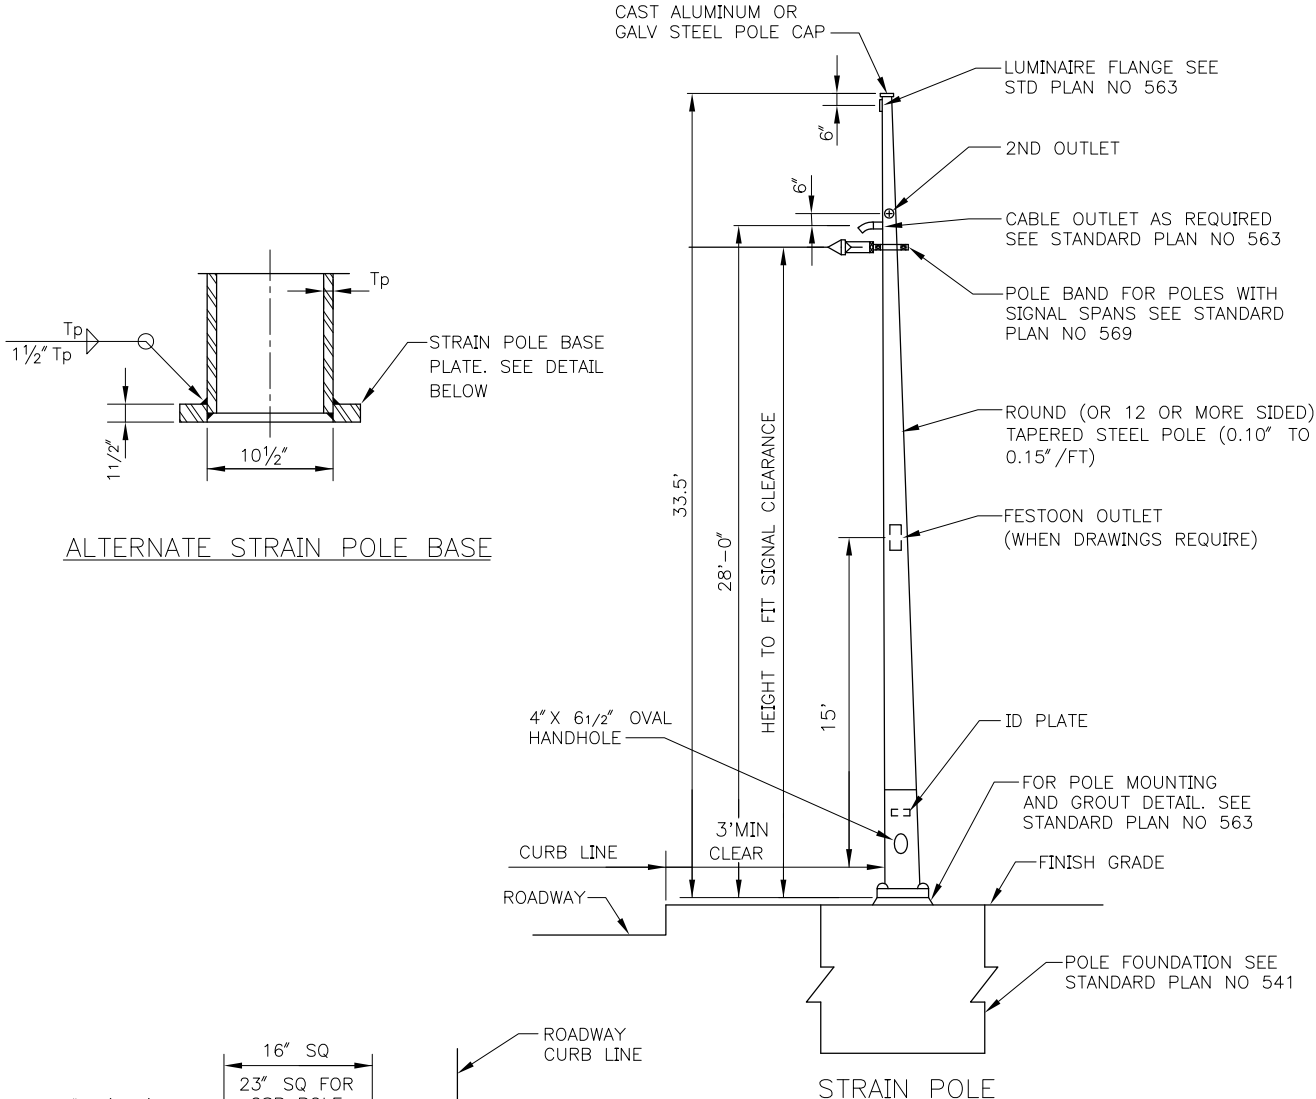

ALTERNATE STRAIN POLE BASE

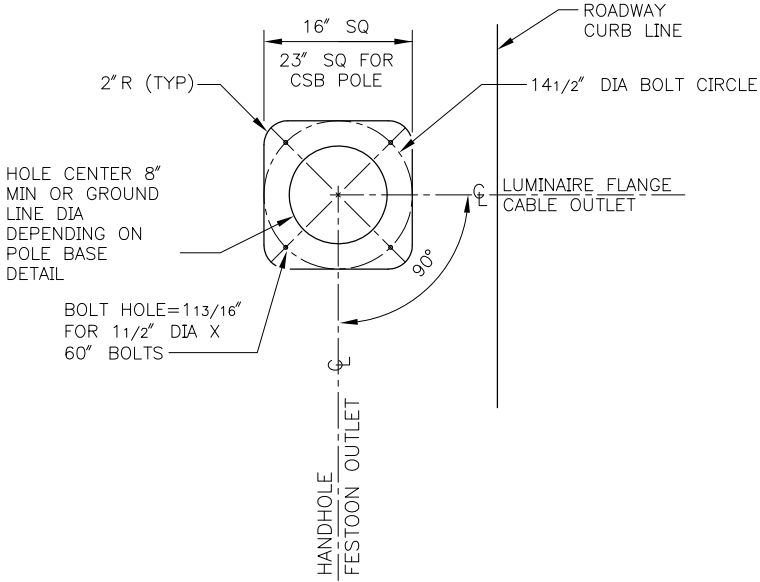

STRAIN POLE BASE PLATE

REF STD SPEC SEC 8-32




NOT TO SCALE

TYPE T STRAIN POLE DETAILS TRAFFIC SIGNAL ONLY

POLE NOTES

1. THE DEAD LOAD MOMENT AT THE GROUNDLINE SHALL BE 40 KIP-FT. THE YIELD MOMENT SHALL BE 2X DEAD LOAD MOMENT.
2. POLE STRENGTH SHALL MEET REQUIREMENTS OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS. (1994 EDITION)
3. POLE SHAFT: ASTM A 572 GRADE 50, 60, OR 65 ($F_y=50, 60, \text{ OR } 65$ KSI RESPECTIVELY), OR ASTM A 595 GRADE A OR B ($F_y=55$ OR 60 KSI RESPECTIVELY).
4. POLE BASE PLATE AND HANDHOLE REINFORCING RIM: ASTM A 36 OR ASTM A 572 GRADE 42. BASE PLATE $F_y \geq 0.65$ POLE SHAFT F_y . THE BASE PLATE THICKNESS MAY BE REDUCED BY $1/4"$ IF ASTM A 572 GRADE 42 STEEL IS USED.
5. POLE SHAFTS SHALL HAVE NO MORE THAN 2 LONGITUDINAL WELDS IN EACH PLY.
6. MINIMUM SHAFT WALL THICKNESS OF EACH PLY SHALL BE $0.239"$ (3 GAUGE). THE POLE SHALL HAVE A MAXIMUM OF 2 PLYS.
7. MAXIMUM SILICON CONTENT IN STEEL SHALL BE 0.04%. SEE STD SPEC SEC 9-33.1(3) FOR GENERAL GALVANIZING REQUIREMENTS.
8. POLE DIAMETER FOR 12 OR MORE SIDED POLES SHALL BE MEASURED FROM THE FLAT TO FLAT DIMENSION.
9. POLES SHALL MEET DEFLECTION CRITERIA STATED IN THE STD SPEC SEC 9-33.2(2) WITH THE DEAD LOAD APPLIED AT 27' ABOVE GROUNDLINE.
10. THE POLES SHALL BE COMPACT AND MUST MEET REQUIREMENTS IN AASHTO SECTION 4, TABLE 1.4 1B (1).

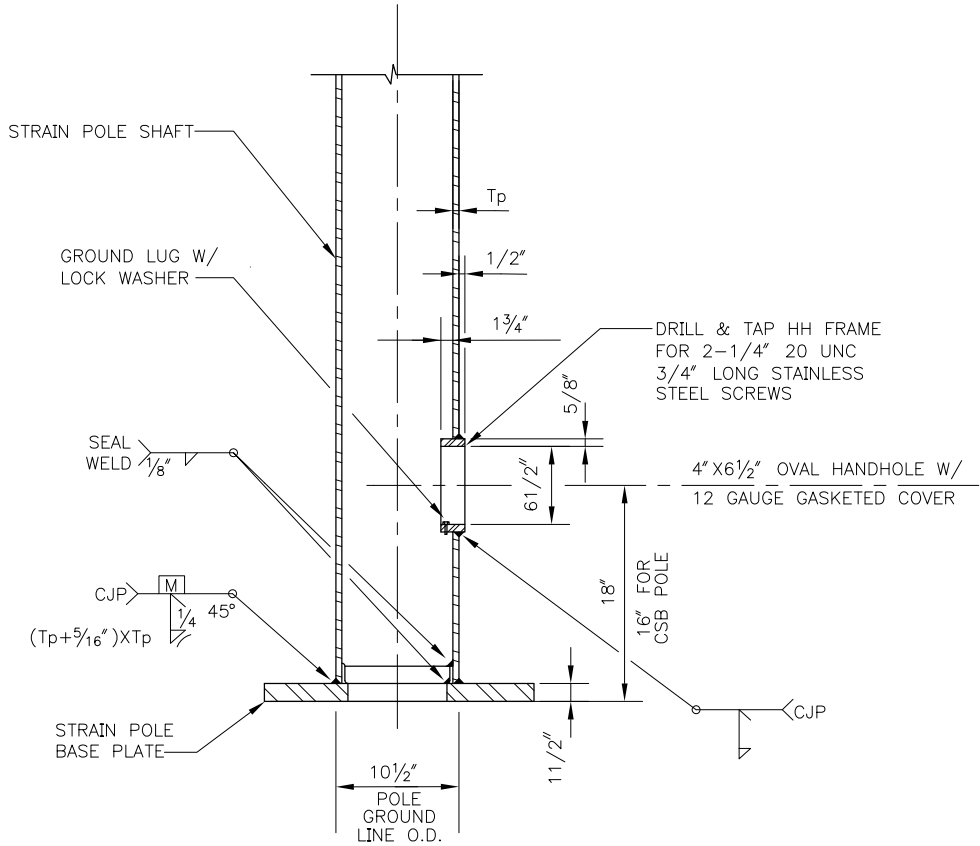

STRAIN POLE BASE


REF STD SPEC SEC 8-32



City of Seattle

NOT TO SCALE

TYPE T
STRAIN POLE DETAILS
TRAFFIC SIGNAL ONLY

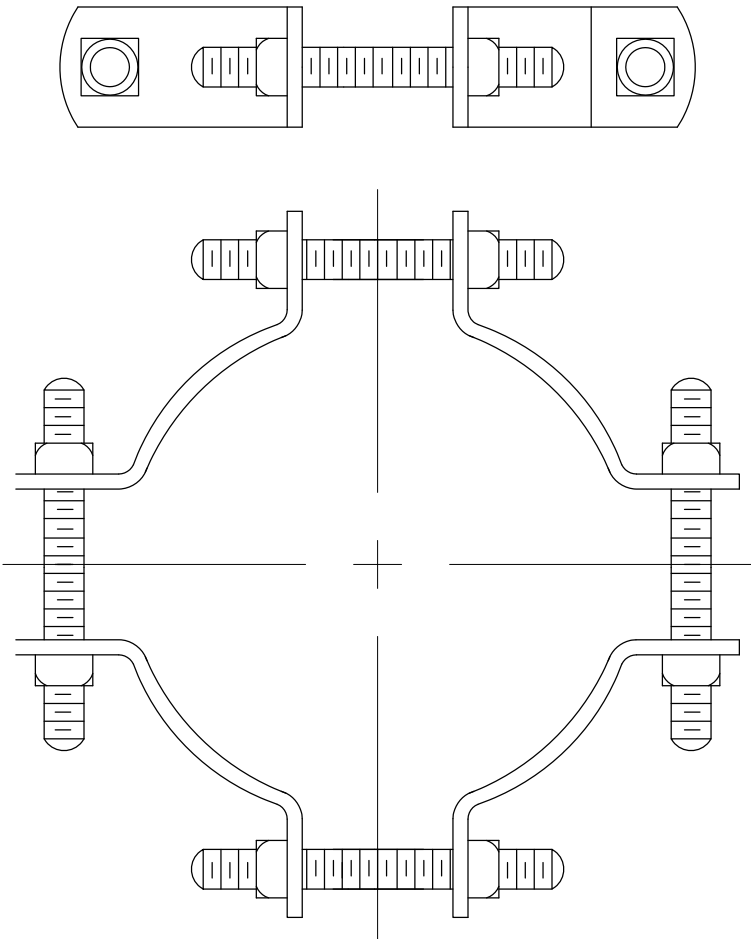

ADJUSTABLE 4-WAY BAND

REF STD SPEC SEC 8-31





City of Seattle

NOT TO SCALE

POLE BAND



STANDARD PLAN NO 572

REV DATE: 2003

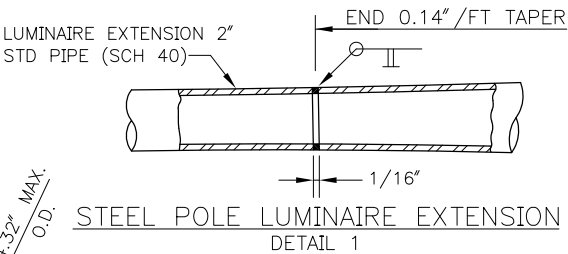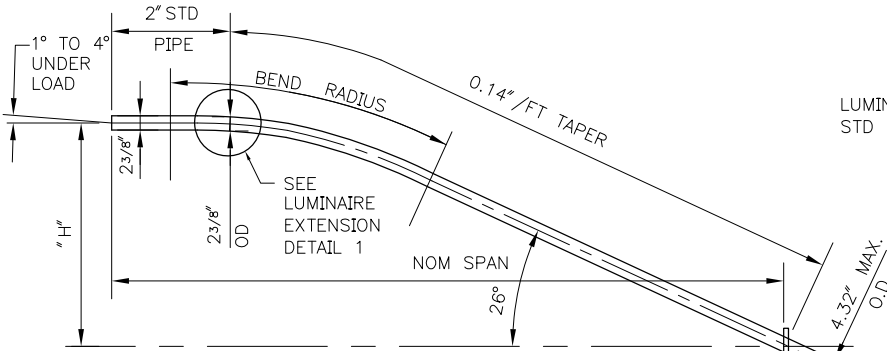


NOTE: BEVEL TUBE AS NECESSARY FOR FLUSH WELD.

15' LUMINAIRE ARMS

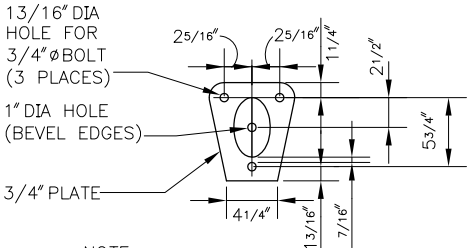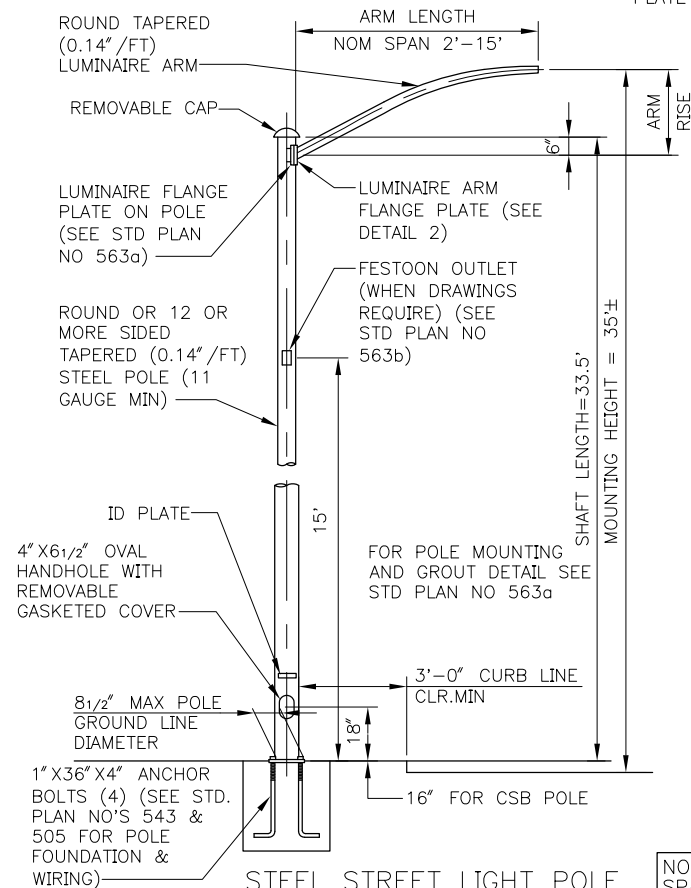

NOTE: FLANGE DIMENSIONS AND HOLE LOCATIONS MUST MATCH THOSE ON POLE FLANGE PLATE. (SEE STD PLAN NO 563a)


LUMINAIRE ARM FLANGE PLATE
DETAIL 2

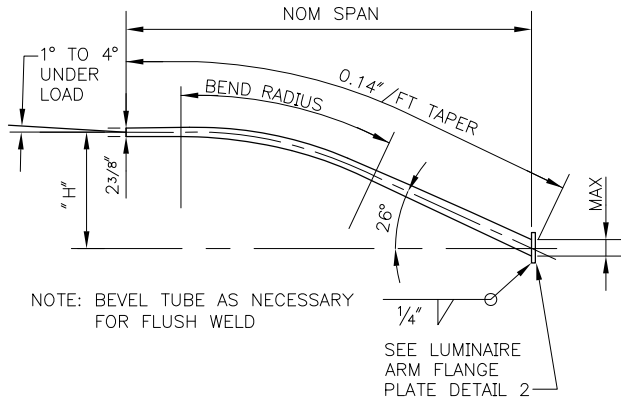

NOTE: BEVEL TUBE AS NECESSARY FOR FLUSH WELD

SEE LUMINAIRE ARM FLANGE PLATE DETAIL 2

2' THRU 12' LUMINAIRE ARMS

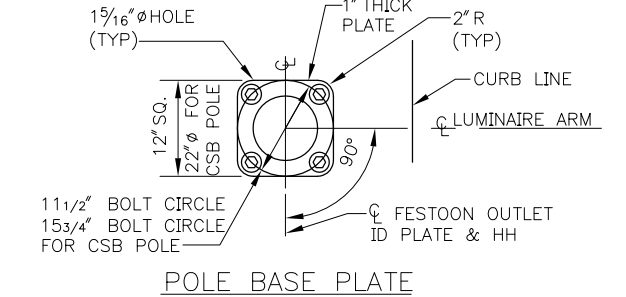

POLE BASE PLATE

NOM. SPAN	H*	BEND RADIUS	TUBE REQUIREMENT
2'	5 1/4"	—	2" STD PIPE
4'	12"	6'	11 GAUGE
6'	18"	9'	11 GAUGE
8'	24"	13'	11 GAUGE
10'	30"	15'	11 GAUGE
12'	33"	17'	11 GAUGE
15'	36"	17'	11 GAUGE

MATERIAL SPECIFICATION

- PLATE AND SHAPES ASTM A 36
- POLE SHAFTS ASTM A 570 GR 40 MIN.
- ANCHOR BOLTS ASTM A 307
- ARM FLANGE PLATE BOLT ASTM A 325

* THESE DIMENSIONS ARE ONLY ILLUSTRATIVE OF THE GENERAL OUTLINE AND MATERIALS USED IN THE CONSTRUCTION OF THESE ARMS AND ARE NOT INTENDED TO EXCLUDE MANUFACTURERS STANDARD PRODUCTS.

REF STD SPEC SEC 8-32




City of Seattle

NOT TO SCALE

STEEL STREET LIGHT POLE WITH BRACKET ARM

STANDARD PLAN NO 580

REV DATE: 2003

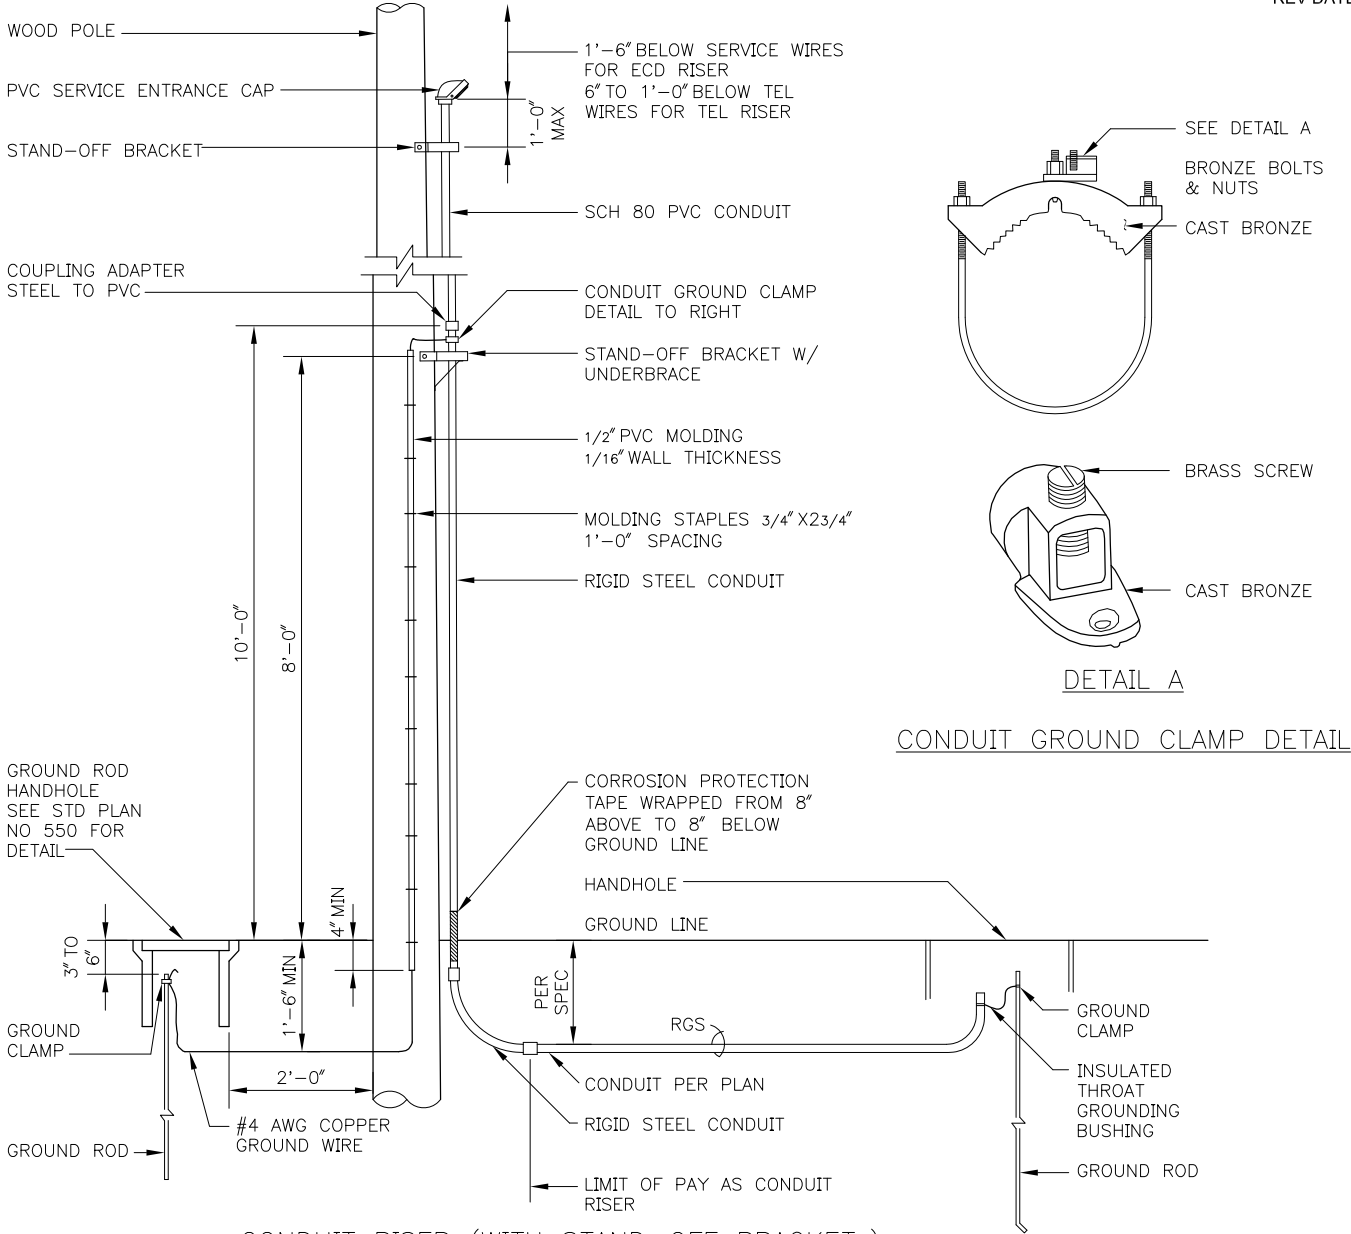

CONDUIT RISER (WITH STAND-OFF BRACKET*)

*WHEN THERE WILL BE ONLY ONE CONDUIT (1 1/2" OR SMALLER) ON THE POLE, ONE HOLE MALLEABLE IRON CLAMPS WITH 4" LAG SCREWS SHALL BE USED TO SECURE THE CONDUIT TO THE POLE IN LIEU OF THE STAND-OFF BRACKETS

NOTES:

1. ON POLES WITH EXISTING CONDUITS, NEW CONDUITS SHALL BE INSTALLED IN ACCORDANCE WITH THIS STANDARD PLAN.
2. RIGID STEEL CONDUIT SHALL BE GROUNDED JUST BELOW COUPLING, APPROXIMATELY 8'-0" TO 10'-0" ABOVE GROUND, AS SHOWN
3. WHEN 2 OR MORE RIGID STEEL CONDUITS ARE INSTALLED ON ONE POLE, ONE CONDUIT SHALL BE GROUNDED AS SHOWN. THE CONDUIT SUPPORTS & STRAPS SHALL SERVE AS A BONDING DEVICE BETWEEN THE STEEL CONDUITS
4. THE GROUND WIRE SHALL BE ONE CONTINUOUS LENGTH. INSERT THE GROUND WIRE FORM THE BOTTOM OF THE GROUND CLAMP & BEND OVER THE CLAMP BEFORE TIGHTENING
5. PLACE GROUND WIRE IN QUADRANT BETWEEN POLE FACE & SECONDARY NEUTRAL
6. ALL STEEL HARDWARE SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION PER ASTM A123
7. CONDUIT CLAMP SPACING SHALL BE PER THE NEC WITH A MINIMUM OF TWO HOLE CLAMP PER 10'-0" LENGTH OF CONDUIT


REF STD SPEC SEC 8-33, SCL CONSTRUCTION GUIDELINES U 7-10




City of Seattle

NOT TO SCALE


CONDUIT RISER

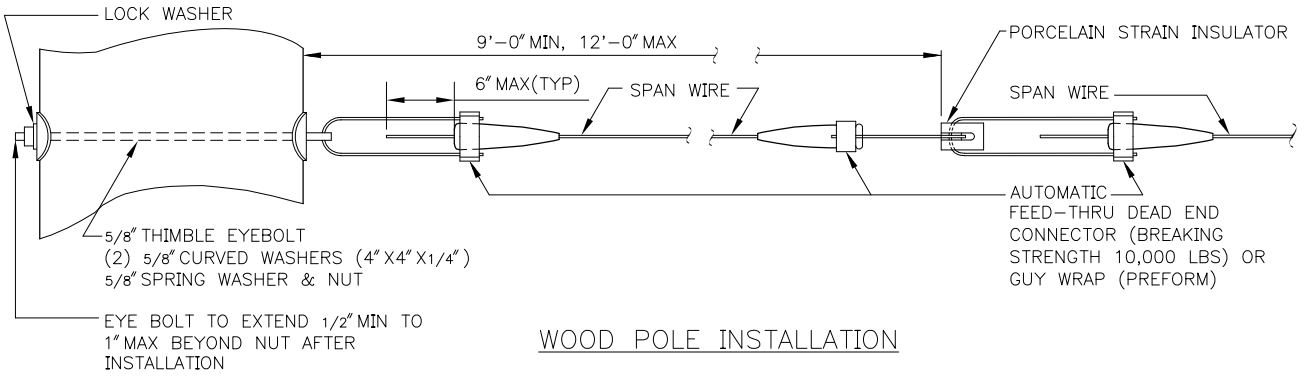

WOOD POLE INSTALLATION

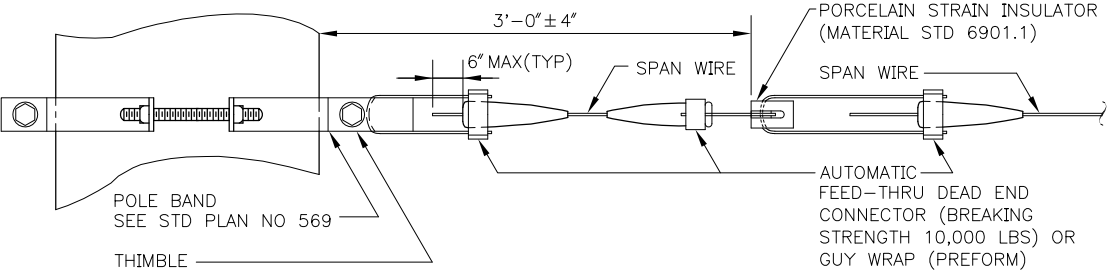

METAL POLE INSTALLATION

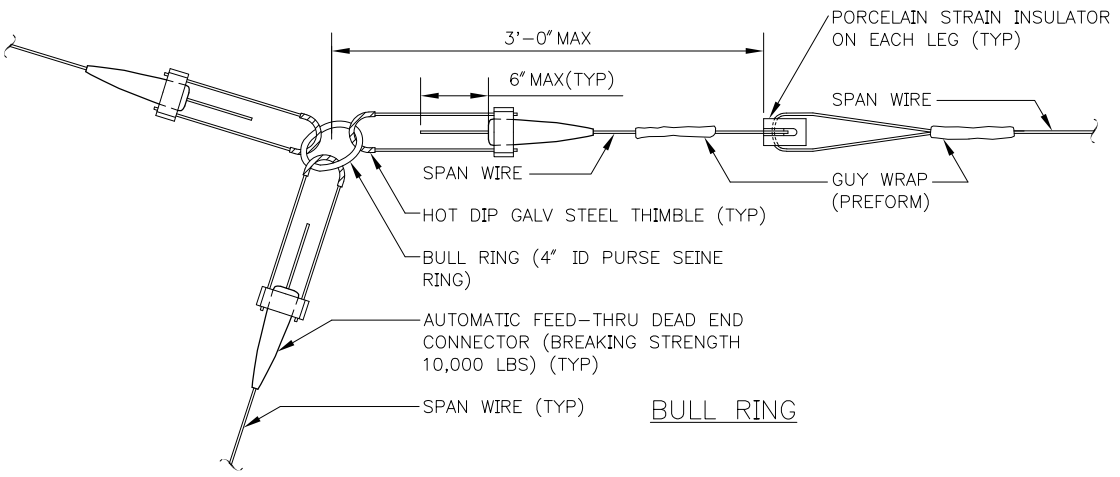

BULL RING

- NOTES:
1. ALL STEEL HARDWARE TO BE HOT DIP GALVANIZED OR STAINLESS STEEL UNLESS OTHERWISE STIPULATED IN THE DRAWINGS
 2. SPAN WIRE SHALL BE ALUMINUM COATED STEEL
 3. SPREAD THIMBLE TO FIT THE BAIL OF THE AUTOMATIC DEAD END

REF STD SPEC SEC 8-21 & SCL MATERIAL STANDARD 6901.1




City of Seattle

NOT TO SCALE


SPAN WIRE INSTALLATION

STANDARD PLAN NO 601b


REV DATE: 2003

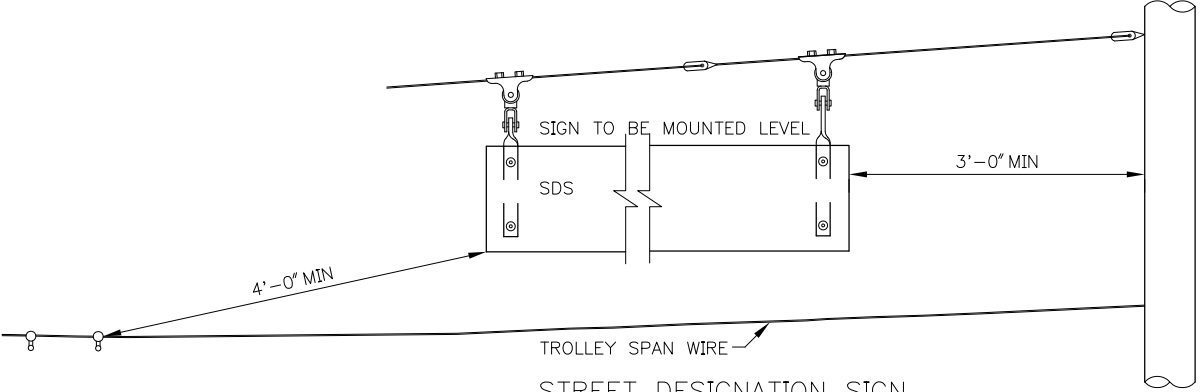


STREET DESIGNATION SIGN
WOOD SIGNS ONLY

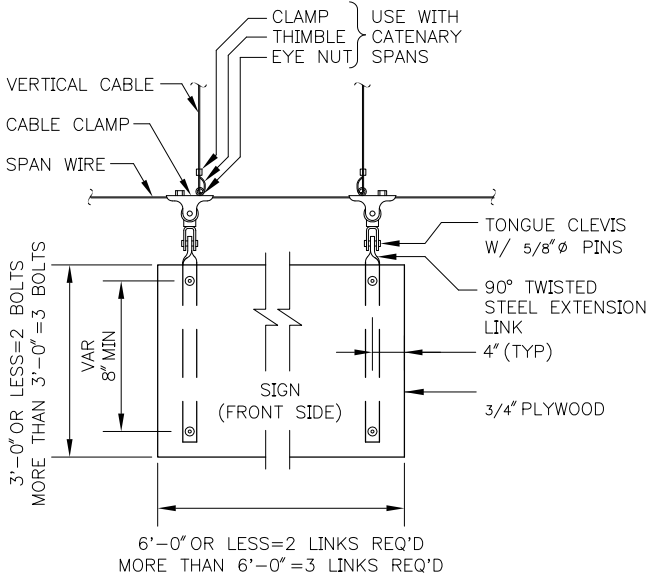

SPAN WIRE MOUNTED
WOOD SIGN

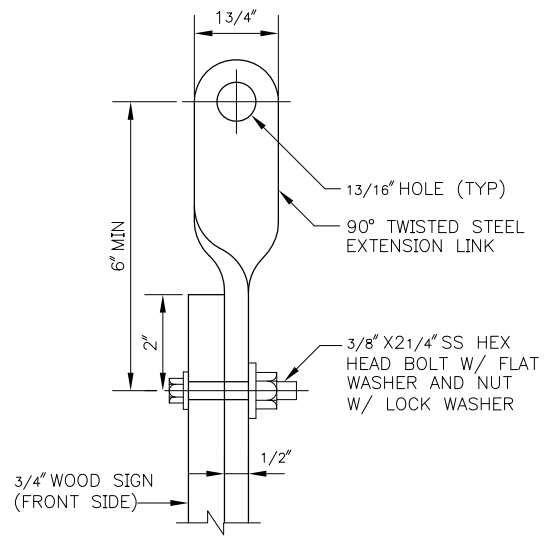

90° TWISTED STEEL EXTENSION LINK

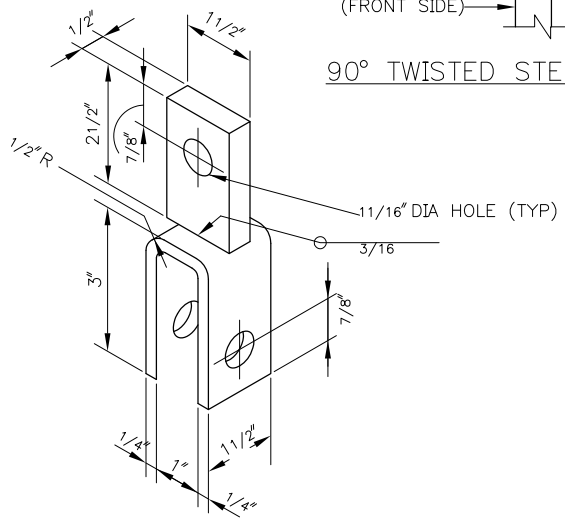

TONGUE CLEVIS

NOTES

1. ALL HARDWARE SHALL BE STAINLESS STEEL. OTHER THAN HARDWARE SHALL BE HOT DIP GALVANIZED.
2. NEOPRENE GASKETS SHALL NOT BE USED FOR SPAN WIRE OR AERIAL CONNECTIONS.



REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

OVERHEAD WOOD SIGNS
SPANWIRE MOUNTED

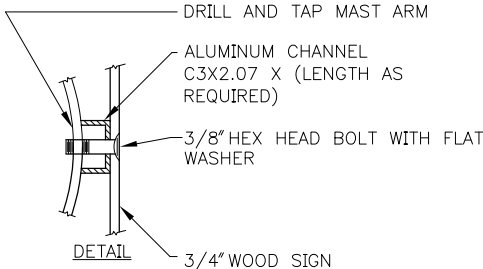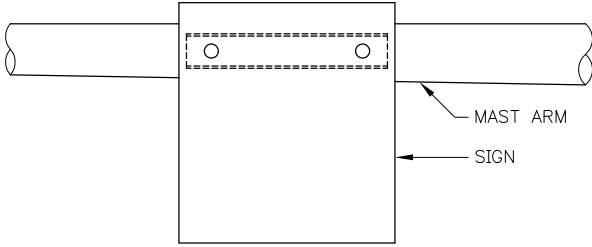

SIGN MOUNTING ON MAST ARM

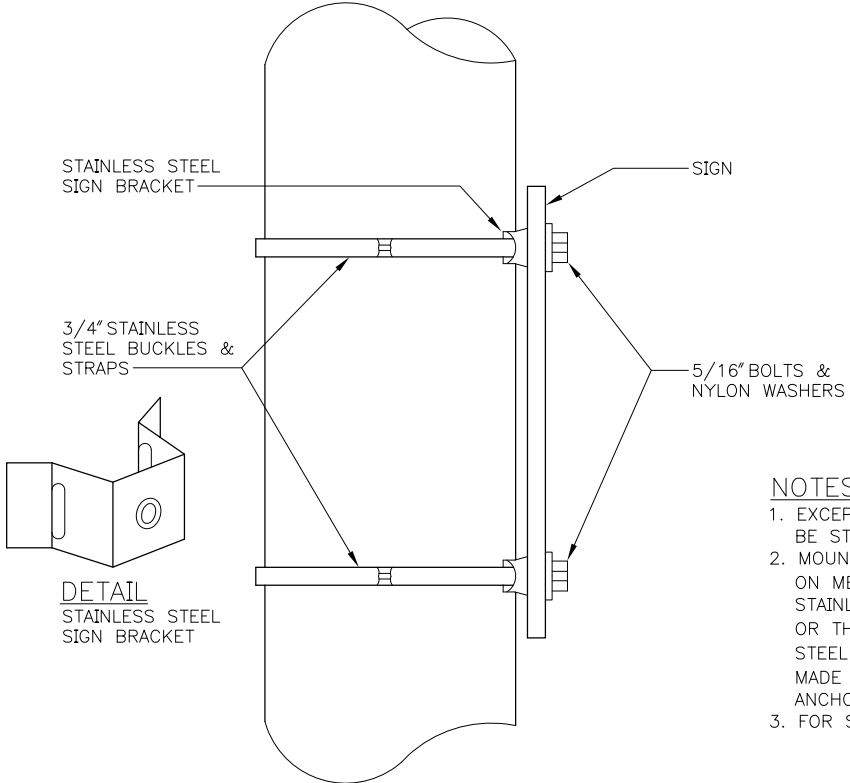

- NOTES:**
- EXCEPT AS NOTED OTHERWISE, ALL HARDWARE SHALL BE STAINLESS STEEL.
 - MOUNTING OF TRAFFIC SIGNS SHALL BE AS FOLLOWS: ON METAL POLE THINNER THAN 7 GAUGE, USE 3/8" STAINLESS STEEL RIVNUTS ON METAL POLES 7 GAUGE OR THICKER, DRILL AND TAP FOR 3/8" BOLT (STAINLESS STEEL RIVNUT OPTIONAL) ON POLES FILLED WITH OR MADE FROM CONCRETE, USE 3/8" X 2 1/2" MIN STUD BOLT ANCHORS WITH HEX NUT
 - FOR SIGN FEATURE, CONTACT TRAFFIC ENGINEER

TEMPORARY SIGN MOUNTING ON METAL POLE

REF STD SPEC SEC 8-21




NOT TO SCALE

SIGN INSTALLATION (NON-SPANWIRE MOUNTING)

STANDARD PLAN NO 610

REV DATE: 2003

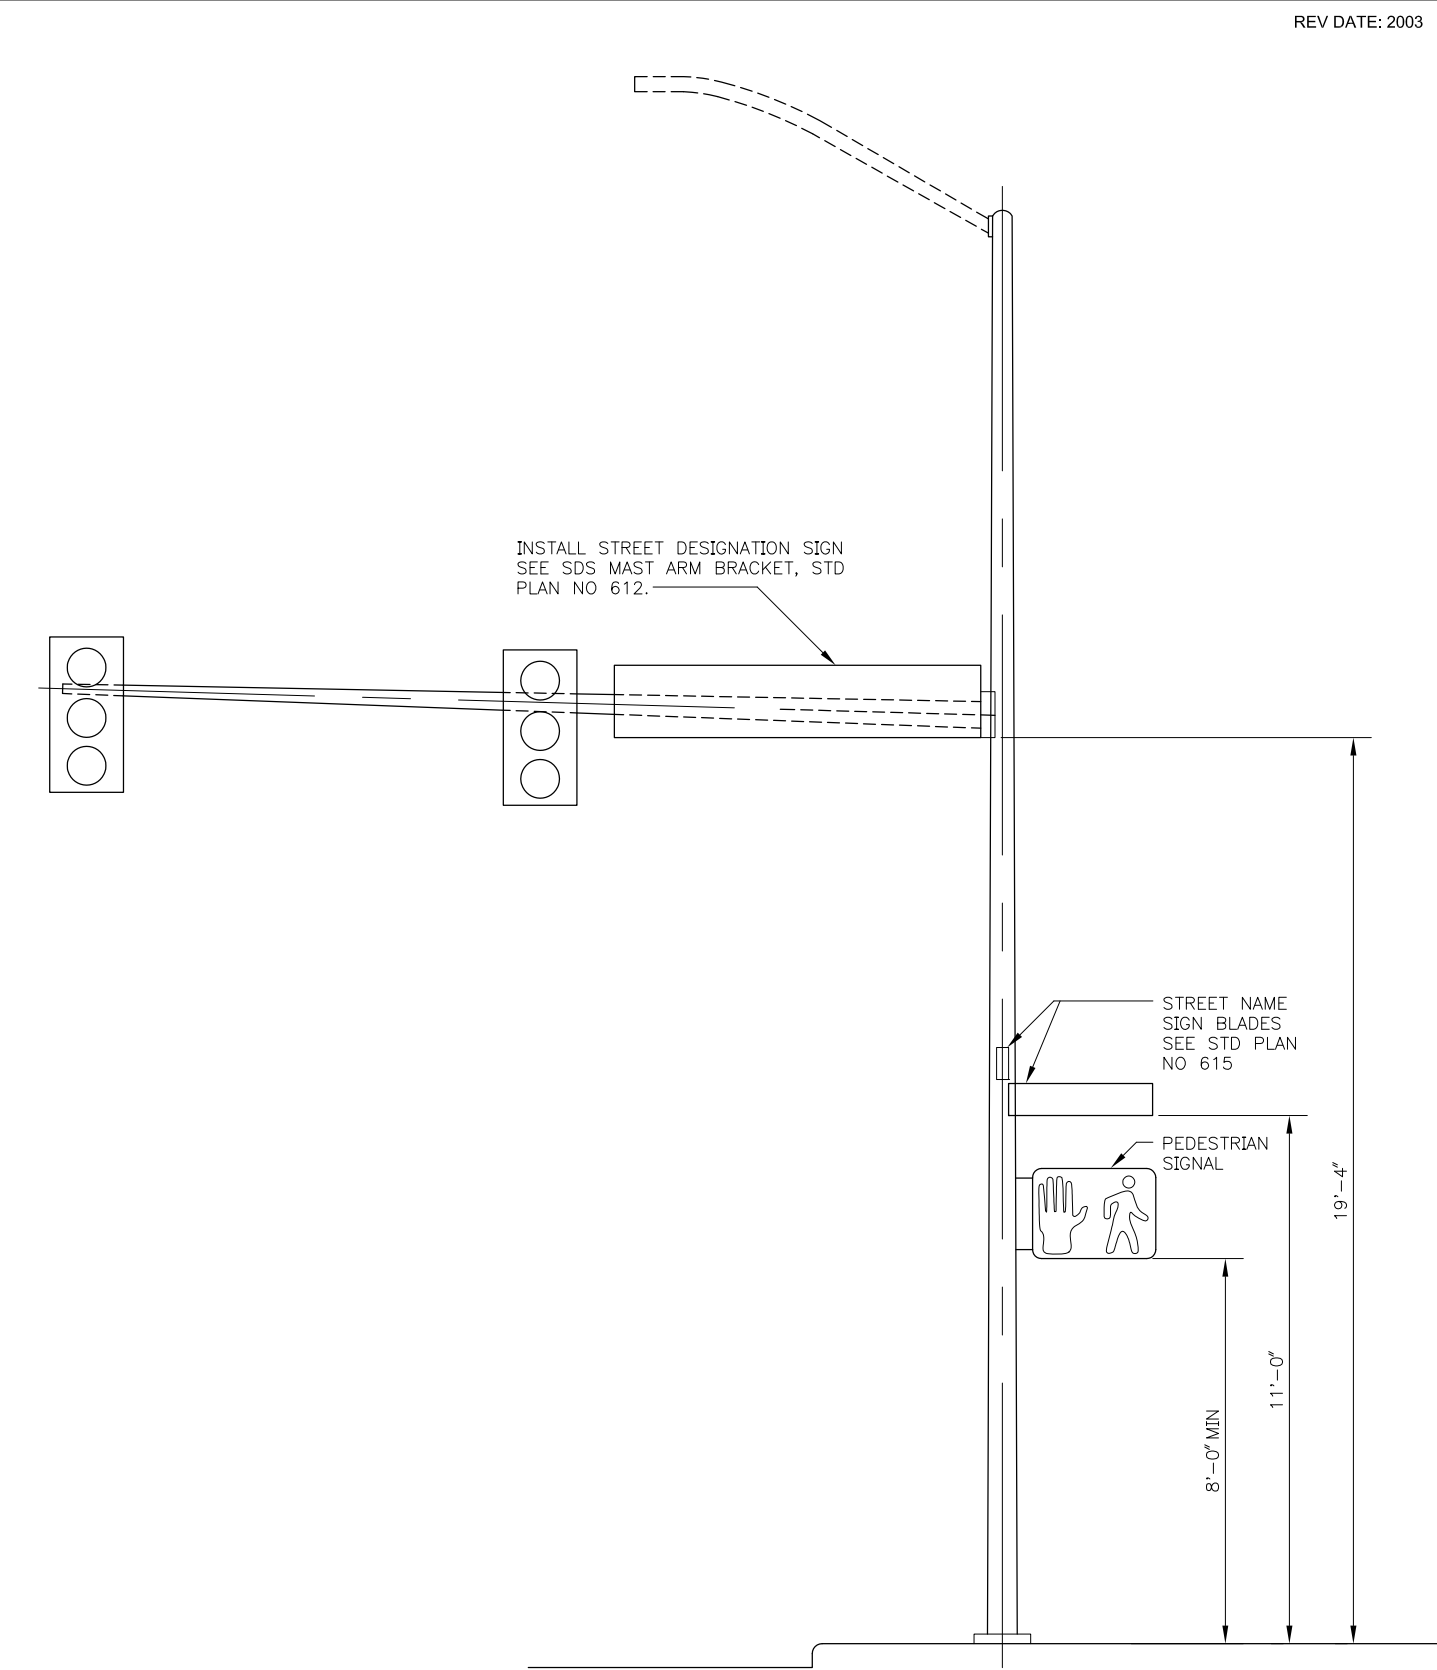


REF STD SPEC SEC 8-21





NOT TO SCALE

STANDARD SIGN INSTALLATION
STEEL POLES

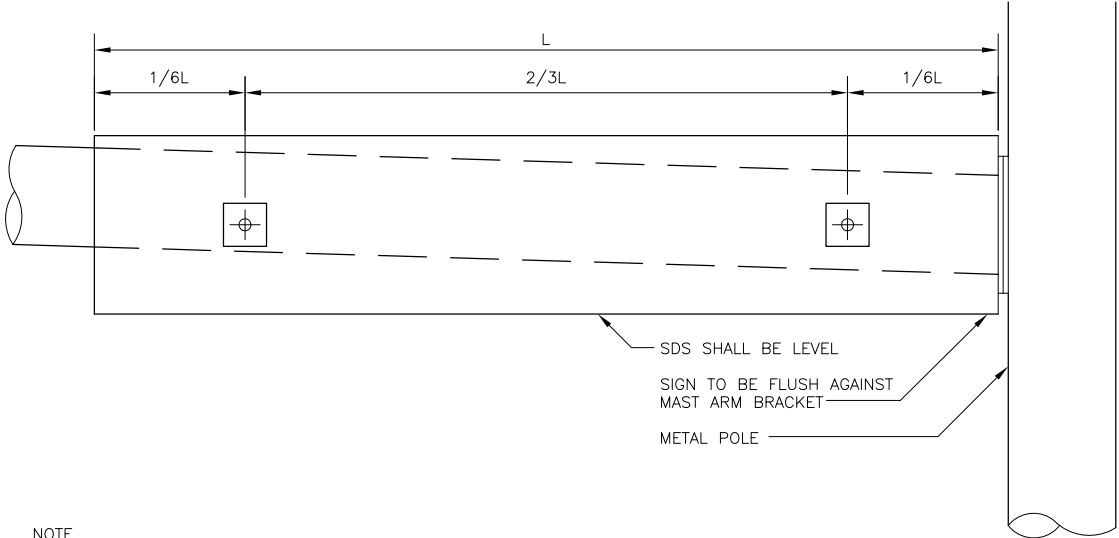

NOTE
ALL HARDWARE SHALL BE
STAINLESS STEEL.

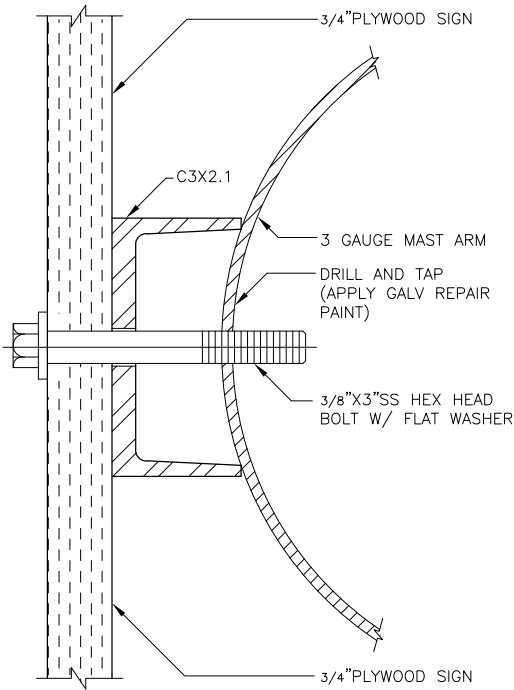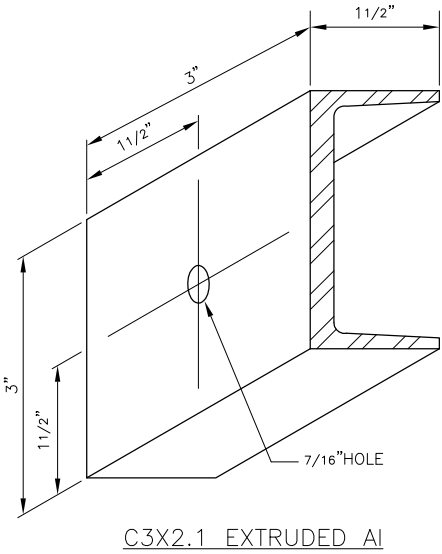

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

SDS BRACKET FOR STEEL
MAST ARM POLES

STANDARD PLAN NO 613

REV DATE: 2003

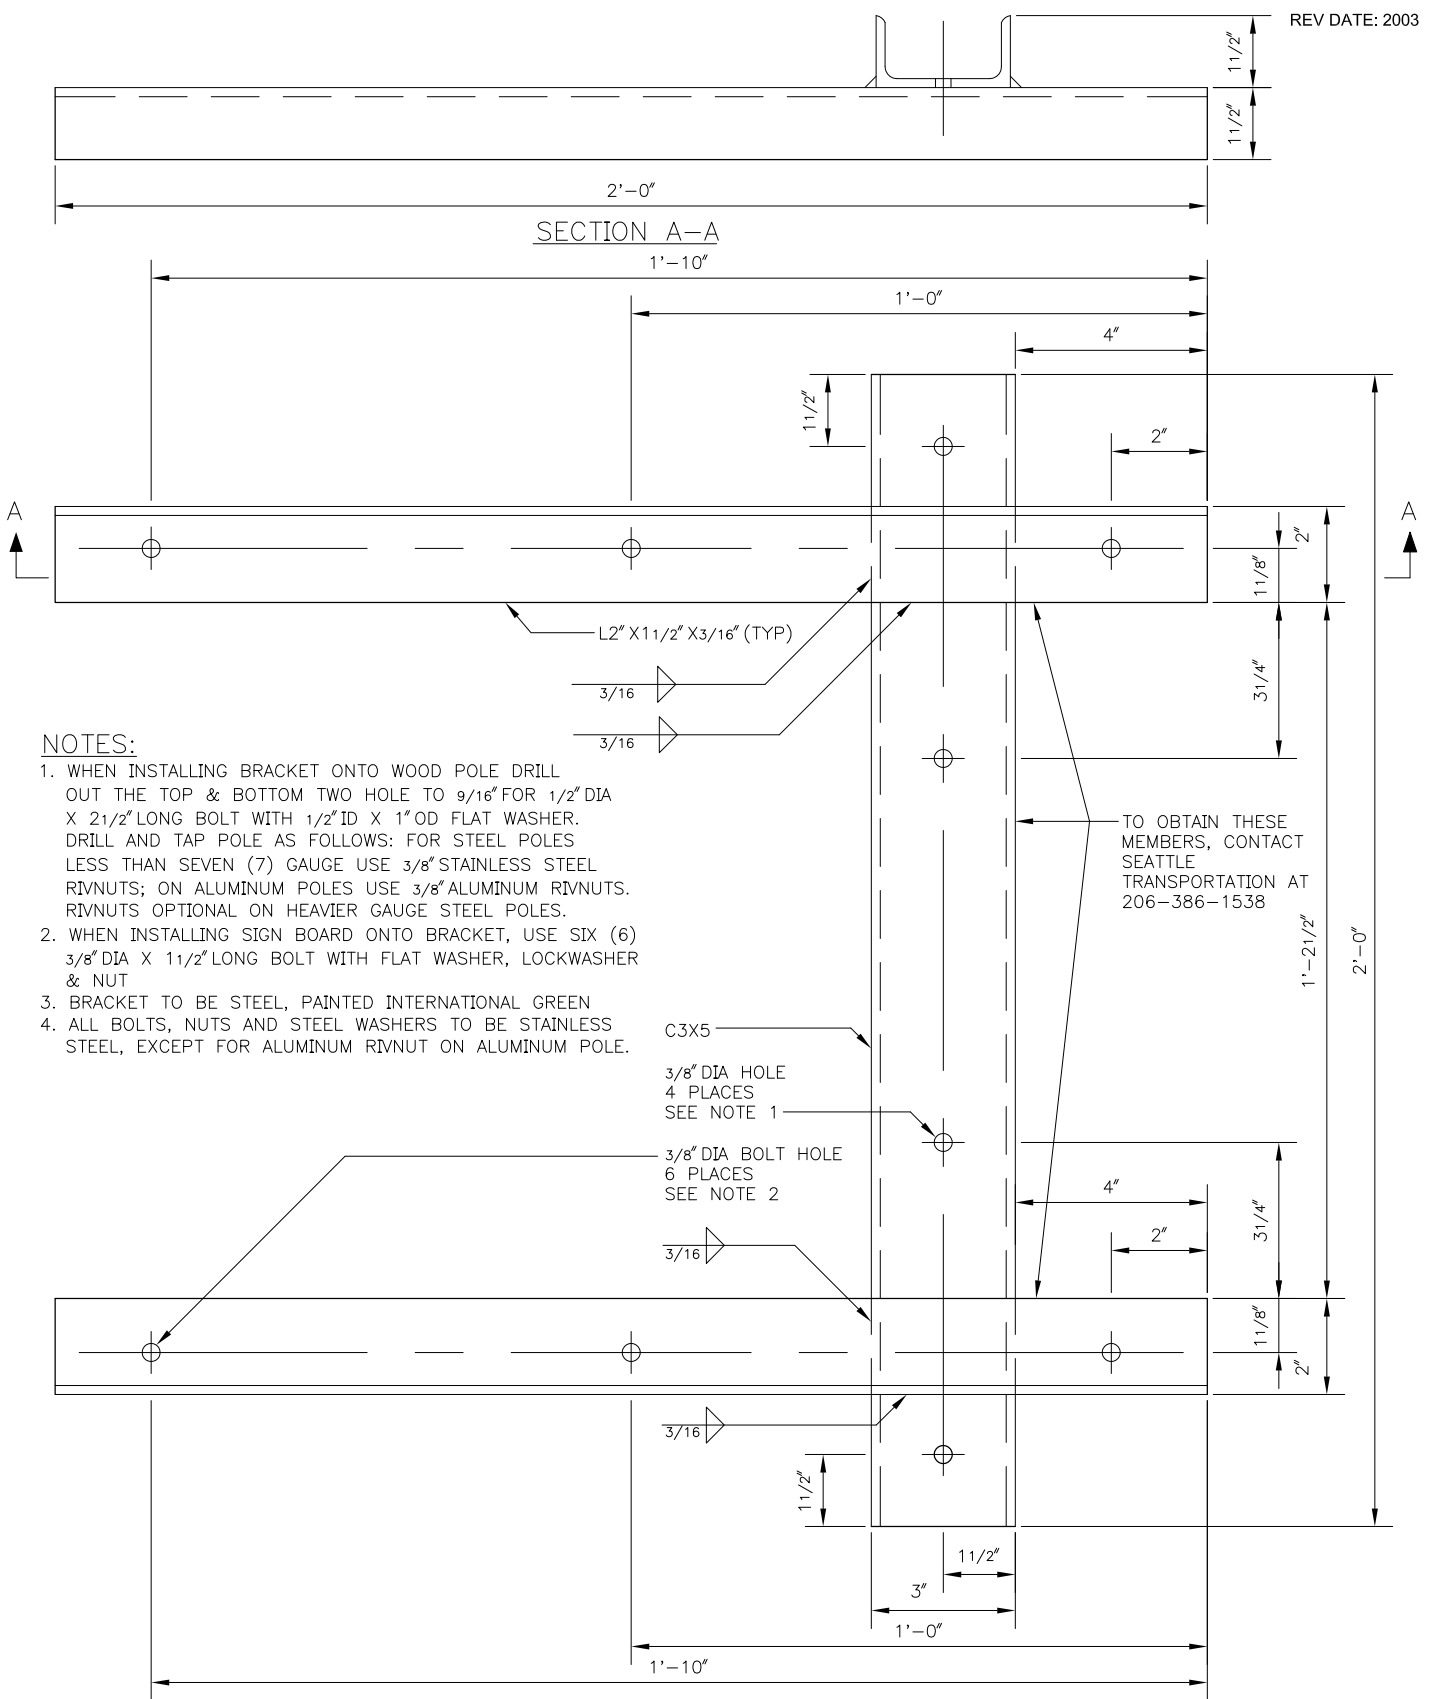

NOTES:

1. WHEN INSTALLING BRACKET ONTO WOOD POLE DRILL OUT THE TOP & BOTTOM TWO HOLE TO 9/16" FOR 1/2" DIA X 2 1/2" LONG BOLT WITH 1/2" ID X 1" OD FLAT WASHER. DRILL AND TAP POLE AS FOLLOWS: FOR STEEL POLES LESS THAN SEVEN (7) GAUGE USE 3/8" STAINLESS STEEL RIVNUTS; ON ALUMINUM POLES USE 3/8" ALUMINUM RIVNUTS. RIVNUTS OPTIONAL ON HEAVIER GAUGE STEEL POLES.
2. WHEN INSTALLING SIGN BOARD ONTO BRACKET, USE SIX (6) 3/8" DIA X 1 1/2" LONG BOLT WITH FLAT WASHER, LOCKWASHER & NUT
3. BRACKET TO BE STEEL, PAINTED INTERNATIONAL GREEN
4. ALL BOLTS, NUTS AND STEEL WASHERS TO BE STAINLESS STEEL, EXCEPT FOR ALUMINUM RIVNUT ON ALUMINUM POLE.

TO OBTAIN THESE MEMBERS, CONTACT SEATTLE TRANSPORTATION AT 206-386-1538

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE



SDS BRACKET FOR STEEL OR WOOD POLES

STANDARD PLAN NO 615


REV DATE: 2003

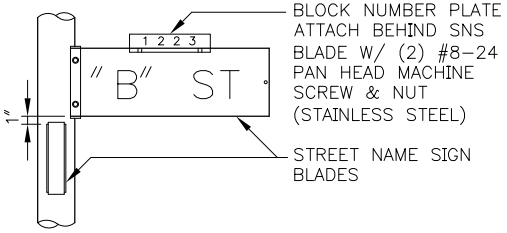

- NOTES:**
1. STAGGER SNS BLADES WITH THE "AVENUE" DESIGNATION BLADE BELOW THE "STREET" DESIGNATION BLADE
 2. SNS SHALL BE INSTALLED PARALLEL TO CORRESPONDING STREET
 3. ALL NUTS, BOLTS & WASHERS TO BE STAINLESS STEEL EXCEPT ALUMINUM RIV NUTS ON ALUMINUM POLES.

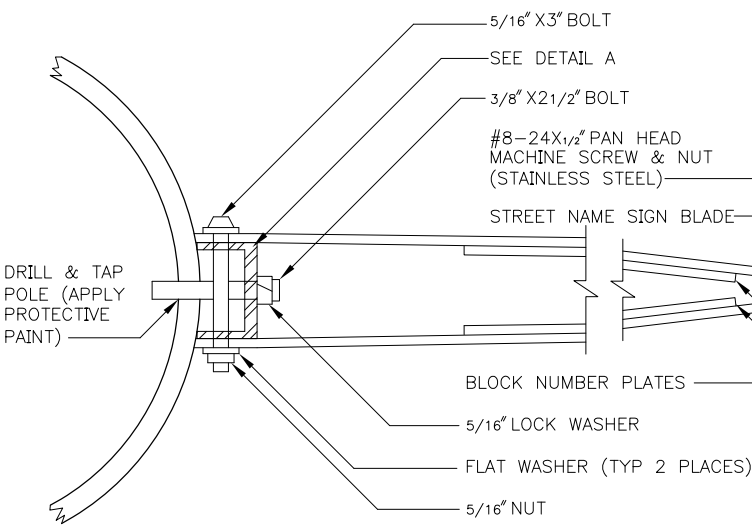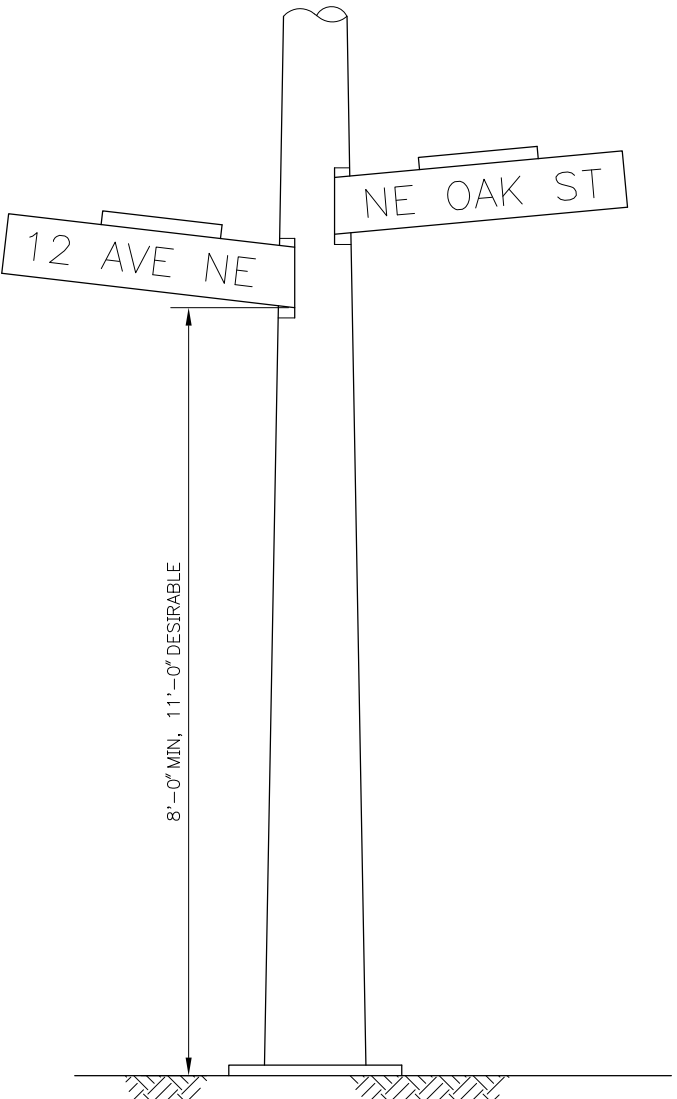

ON ALUMINUM POLES USE 5/16" ALUMINUM RIVNUTS FOR STEEL POLES LESS THAN SEVEN (7) GAUGE USE 5/16" STAINLESS STEEL RIVNUTS (RIVNUTS OPTIONAL ON HEAVIER GAUGE STEEL POLES)

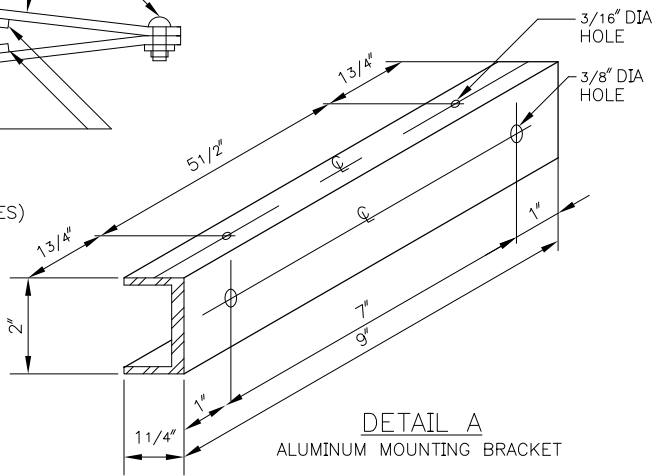

REF STD SPEC SEC 8-21






City of Seattle

NOT TO SCALE

SNS BRACKET FOR STEEL POLES


STANDARD PLAN NO 616

REV DATE: 2003

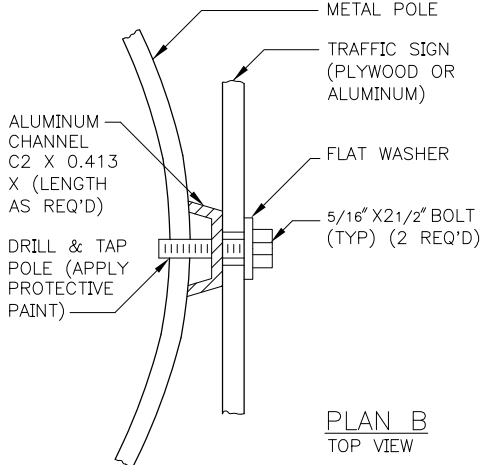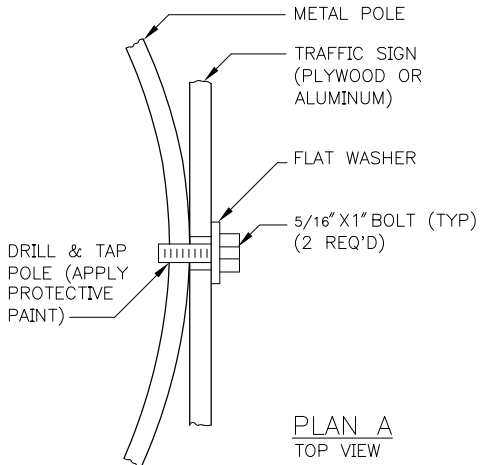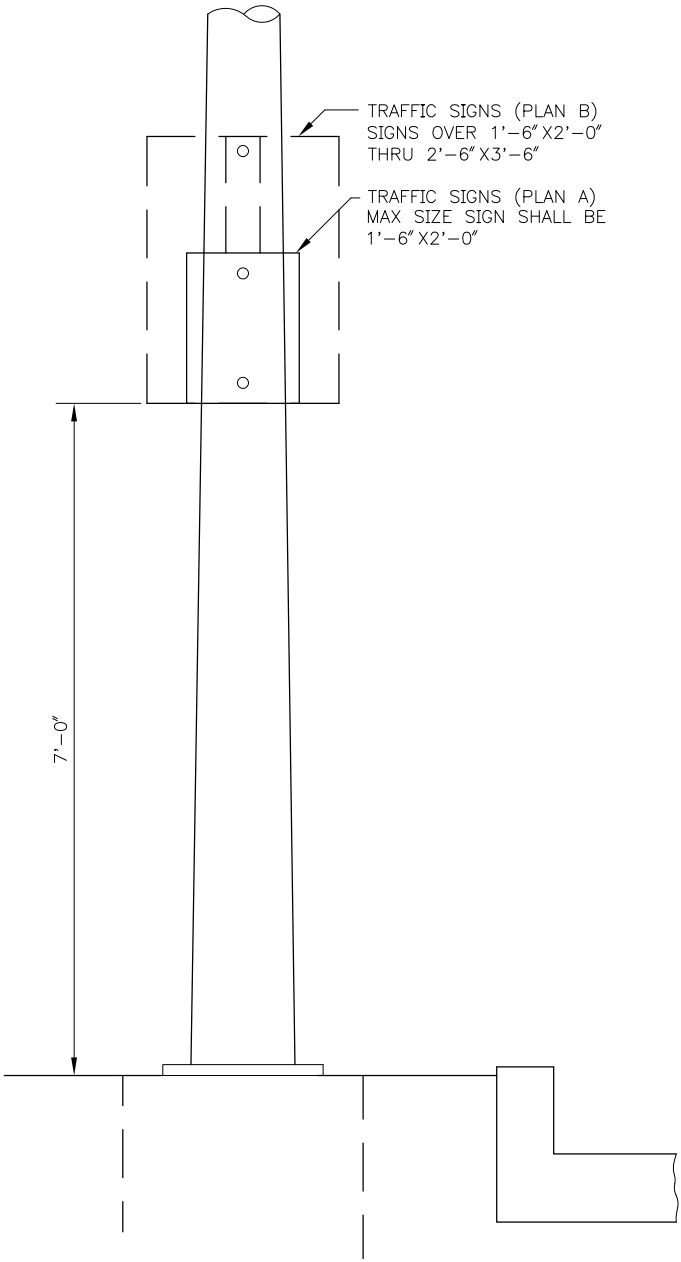


NOTES:

1. FOR STEEL POLES LESS THEN SEVEN (7) GAUGE USE 5/16" STAINLESS STEEL RIVNUTS. STAINLESS STEEL RIVNUTS OPTIONAL ON HEAVIER GAUGE STEEL POLES
2. ON ALUMINUM POLES USE 5/16" ALUMINUM RIVNUTS
3. ON POLES FILLED WITH OR MADE FROM CONCRETE USE 5/16" X 2 1/2" MIN STUD BOLT ANCHORS WITH HEX NUT
4. FOR SIGNS OVER 2'-6" X 3'-6" USE STD PLAN NO 612. MOUNT SIGNS VERTICALLY ON STRAIN POLE WITH THREE (3) FASTENERS MIN
5. FOR DARK COLORED POLES PAINT BAND TO MATCH POLE
6. ALL HARDWARE TO BE STAINLESS STEEL.

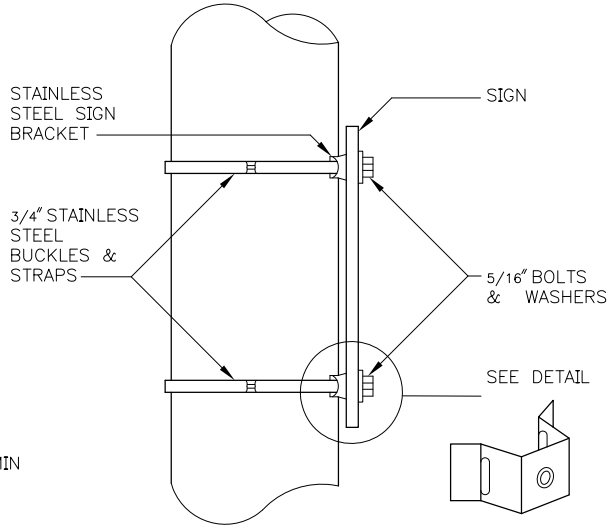

PLAN C
SIDE VIEW



DETAIL
STAINLESS
STEEL SIGN
BRACKET

REF STD SPEC SEC 8-21




NOT TO SCALE

TRAFFIC SIGN MOUNTING
ON METAL POLES

STANDARD PLAN NO 620

REV DATE: 2003

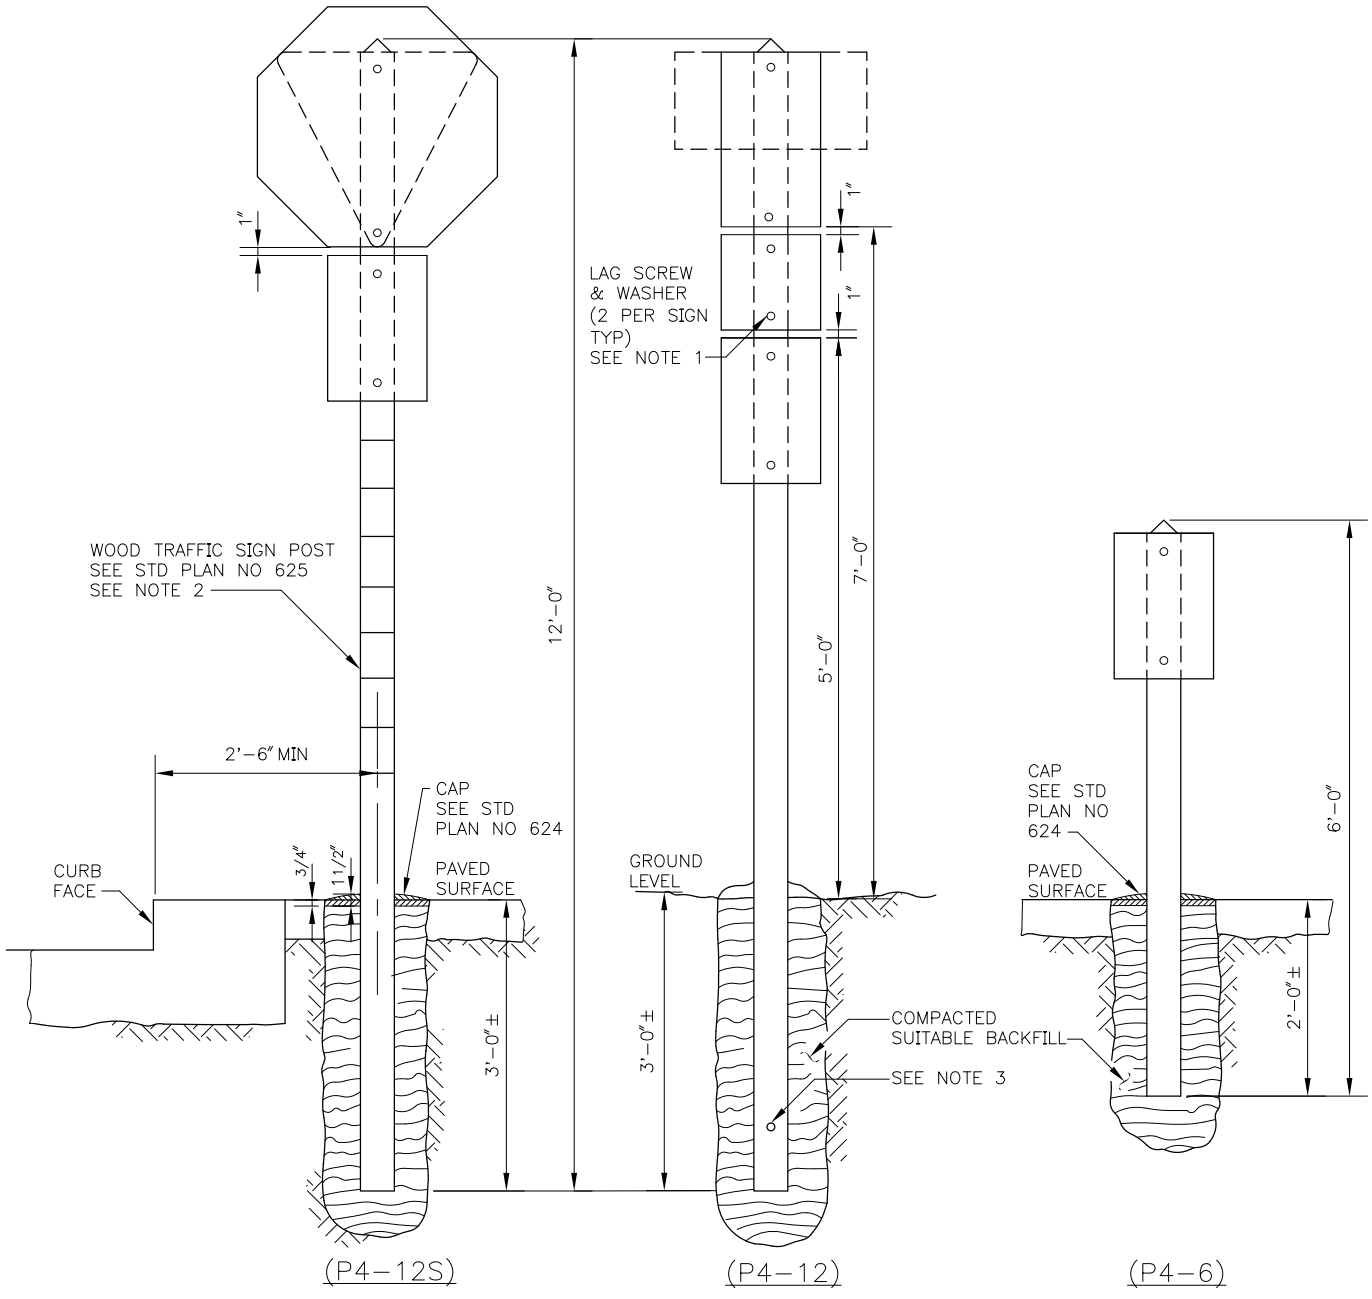

NOTES:

1. 5/16" X 3/4" GALVANIZED OR PLATED LAG SCREW & 3/8" ID X 1" OD NYLON WASHER
2. FOR "YIELD" SIGNS PAINTED STRIPES SHALL FACE TOWARD THE APPROACHING TRAFFIC (SEE STD PLAN NO 625)
3. INSTALL 30D GALV COMMON SPIKE ON THE FACE SIDE OF POST EXCEPT WHEN CONCRETE PAVING EXISTS. SPIKE SHALL BE 8" ABOVE BOTTOM OF POST AND SHALL PROTRUDE 2" FROM POST
4. CONTACT SEATTLE TRANSPORTATION (684-5087) FOR DETAILS REGARDING SIGN MESSAGE AND FOUNDATION
5. SIGN POST MATERIAL SHALL BE STANDARD GRADE WESTERN RED CEDAR

REF STD SPEC SEC 8-21




NOT TO SCALE

TRAFFIC SIGN & WOOD POST INSTALLATION

STANDARD PLAN NO 621

REV DATE: 2003

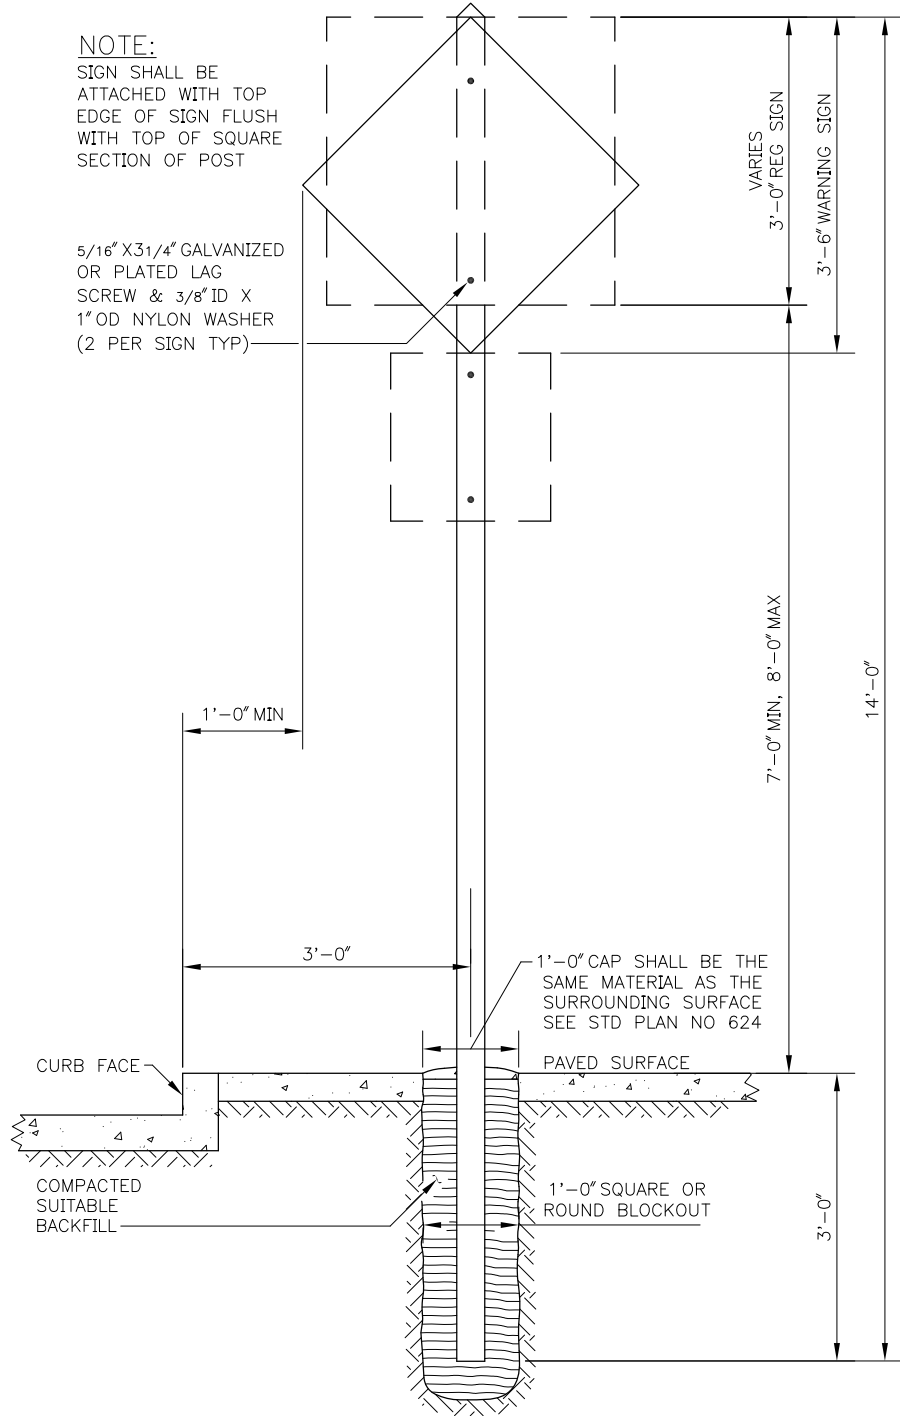

NOTE:
SIGN SHALL BE ATTACHED WITH TOP EDGE OF SIGN FLUSH WITH TOP OF SQUARE SECTION OF POST

5/16" X 3 1/4" GALVANIZED OR PLATED LAG SCREW & 3/8" ID X 1" OD NYLON WASHER (2 PER SIGN TYP)

CURB FACE
COMPACTED SUITABLE BACKFILL

1'-0" CAP SHALL BE THE SAME MATERIAL AS THE SURROUNDING SURFACE SEE STD PLAN NO 624

1'-0" SQUARE OR ROUND BLOCKOUT


P4-14

REF STD SPEC SEC 8-21



NOT TO SCALE

TRAFFIC SIGN & WOOD POST INSTALLATION

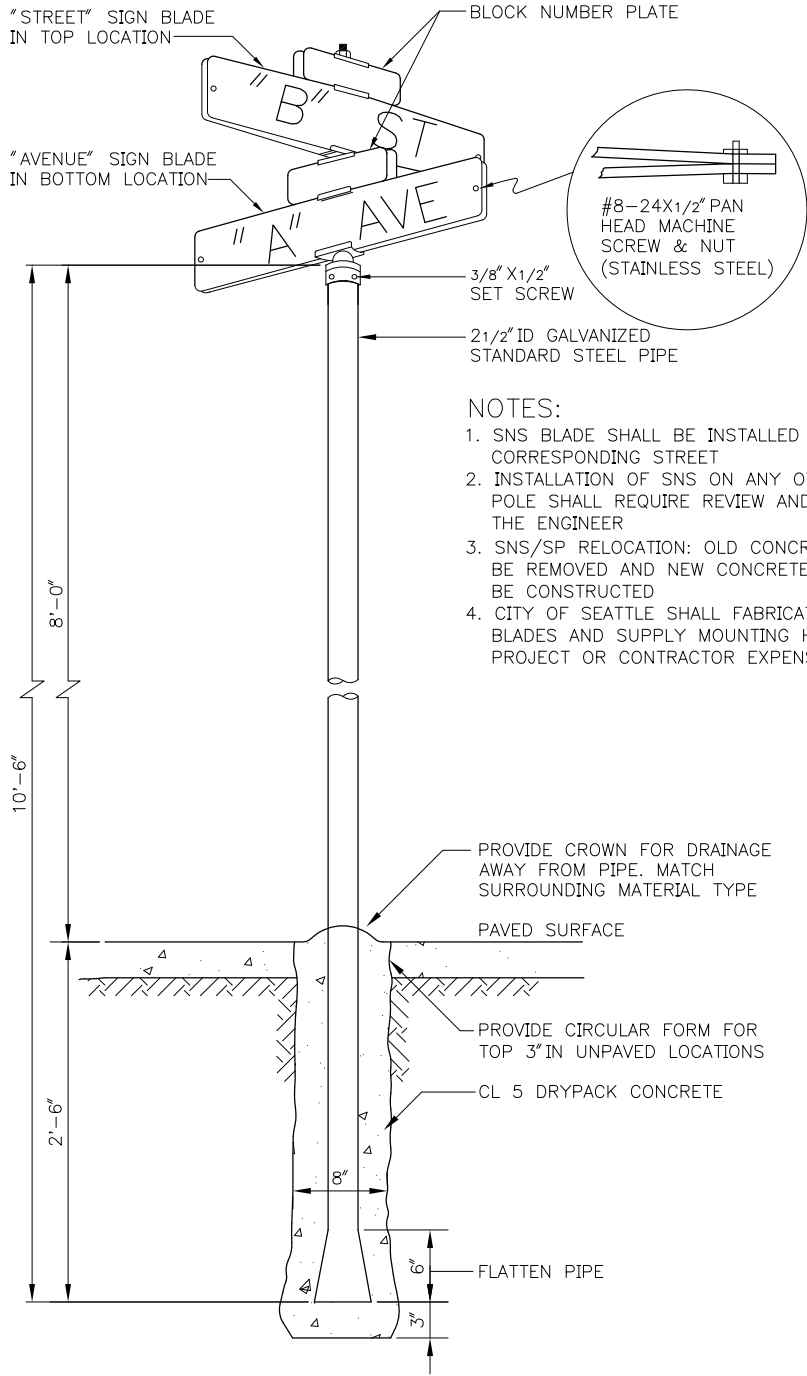

- NOTES:
1. SNS BLADE SHALL BE INSTALLED PARALLEL TO CORRESPONDING STREET
 2. INSTALLATION OF SNS ON ANY OTHER METAL POLE SHALL REQUIRE REVIEW AND APPROVAL BY THE ENGINEER
 3. SNS/SP RELOCATION: OLD CONCRETE SHALL BE REMOVED AND NEW CONCRETE BASE SHALL BE CONSTRUCTED
 4. CITY OF SEATTLE SHALL FABRICATE SNS BLADES AND SUPPLY MOUNTING HARDWARE AT PROJECT OR CONTRACTOR EXPENSE

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

STREET NAME SIGN INSTALLATION

STANDARD PLAN NO 623

REV DATE: 2003

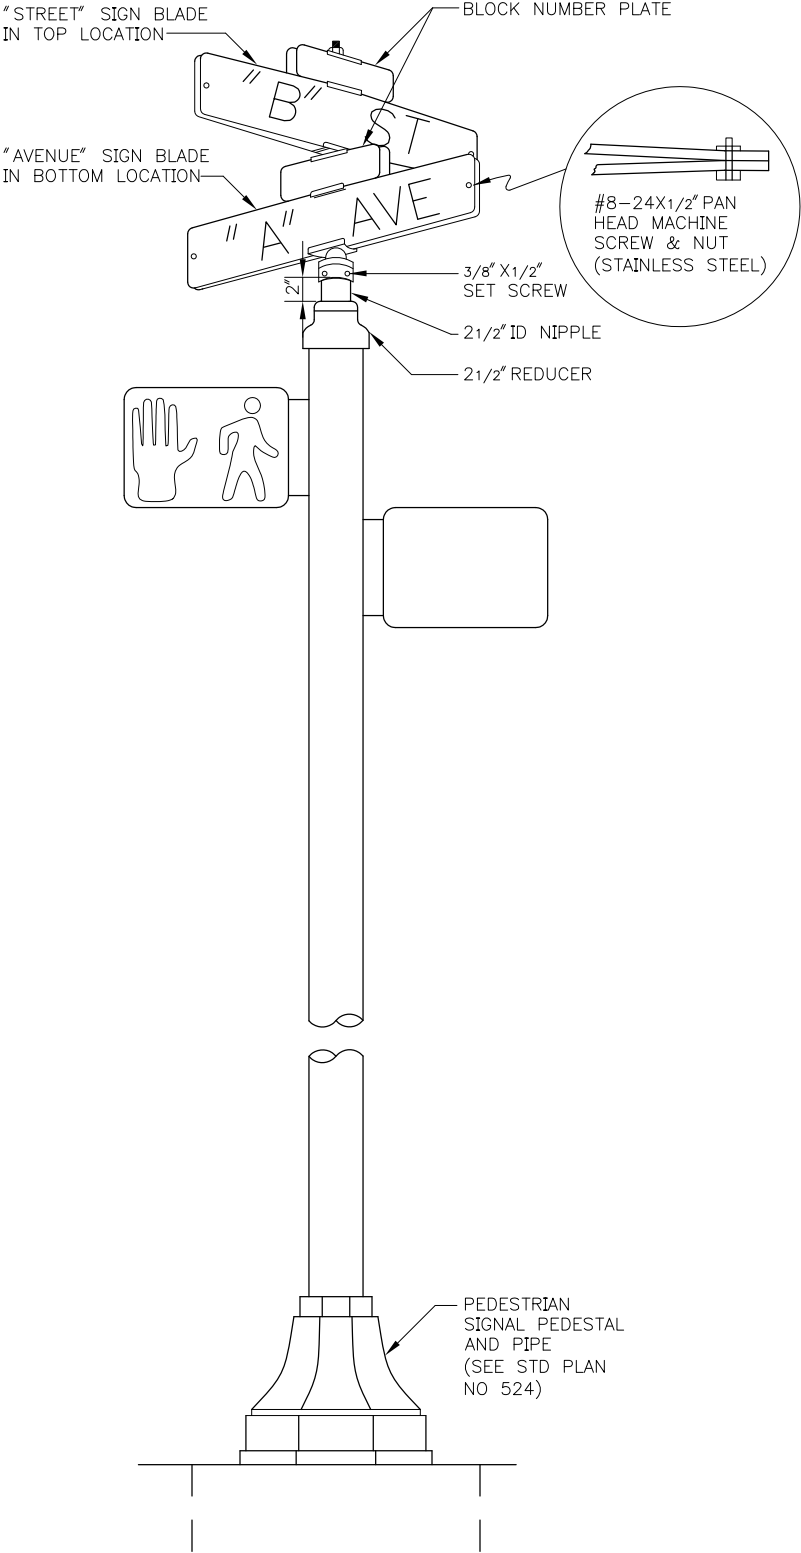


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

STREET NAME SIGN
PEDESTAL INSTALLATION

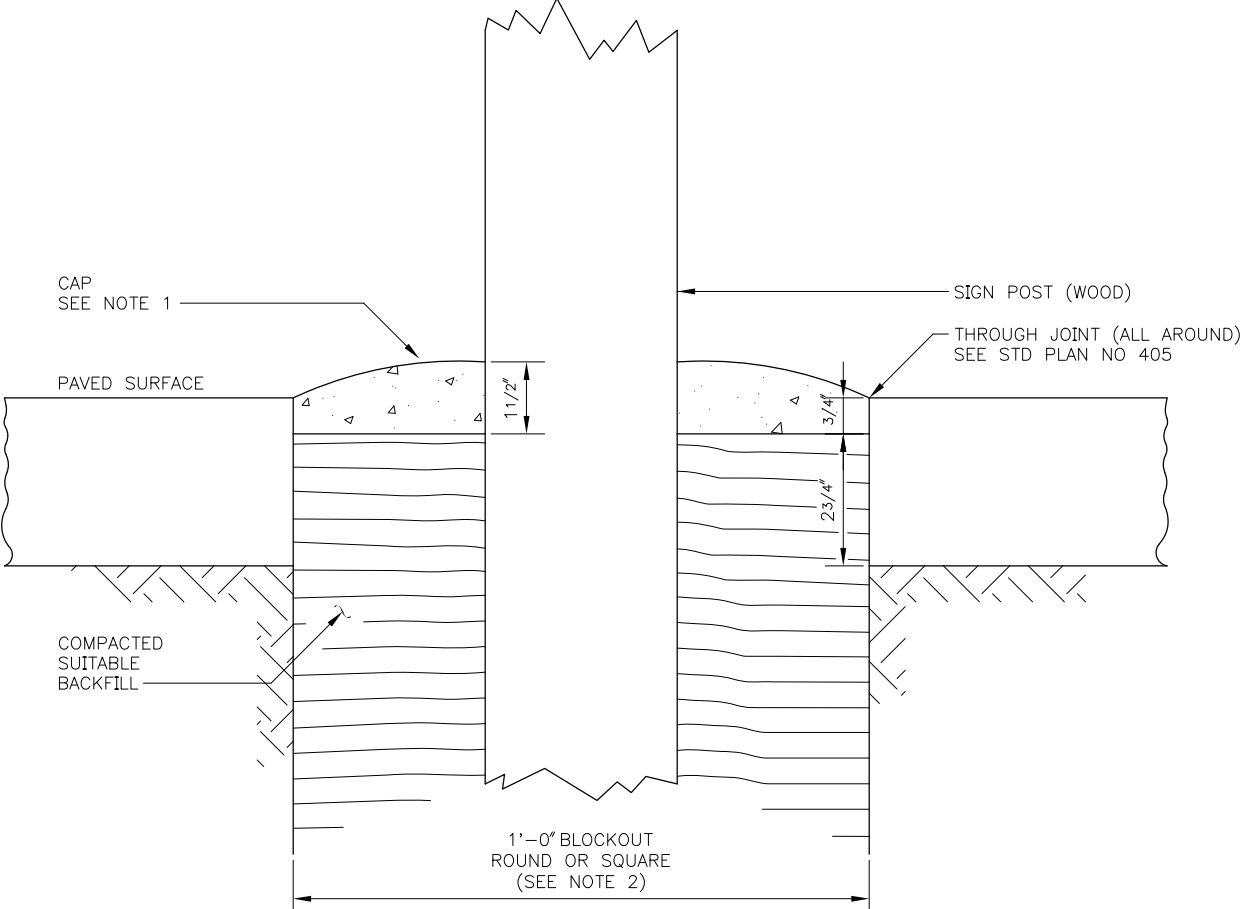

- NOTES:**
1. CAP SHALL BE MADE OF THE SAME MATERIAL AS THE SURROUNDING PAVED SURFACE AND SHALL BE MOUNDED FOR DRAINAGE AWAY FROM POST
 2. BLOCKOUTS SHALL BE PROVIDED FOR POST LOCATIONS WHERE NEW CONCRETE PAVEMENT (SIDEWALK, ROADWAY, ETC) IS BEING INSTALLED
 3. WHERE POST IS BEING INSTALLED IN EXISTING PAVED AREAS, HOLE IN PAVED SURFACE SHALL NOT EXCEED 1'-0" NOMINAL DIAMETER


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

POST CAP

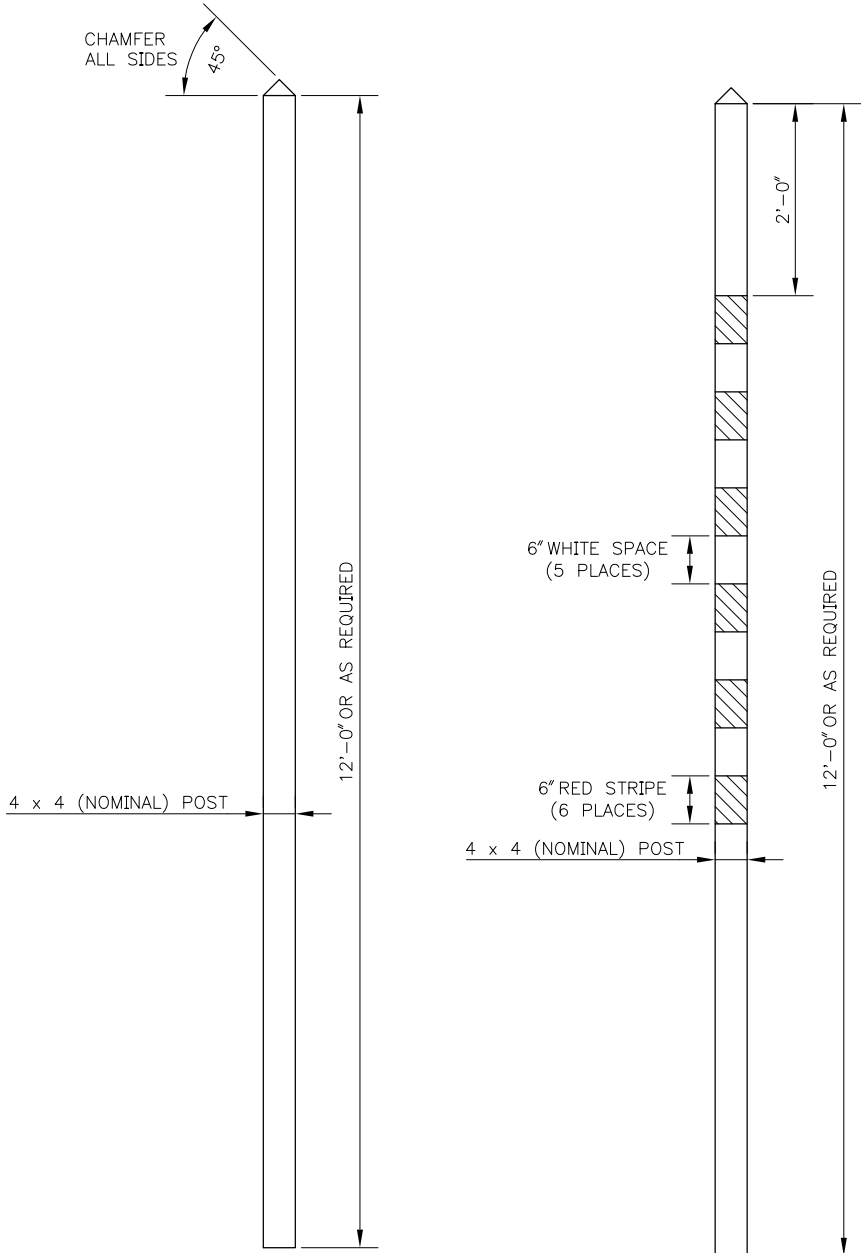

STANDARD SIGN POST

STOP & YIELD SIGN POST
(P4-12S, P4-12Y)

NOTES:

- 1. PAINT RED STRIPES ON ALL FOUR SIDES FOR "STOP" SIGN INSTALLATION, ONE SIDE ONLY FOR "YIELD" SIGN INSTALLATIONS
- 2. FOR "YIELD" SIGN INSTALLATION, STRIPED SIDE SHALL BE FACING APPROACHING TRAFFIC
- 3. SEE STD PLAN NO 620
- 4. SIGN POST MATERIAL SHALL BE STANDARD GRADE WESTERN RED CEDAR


REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE

WOOD TRAFFIC SIGN POSTS

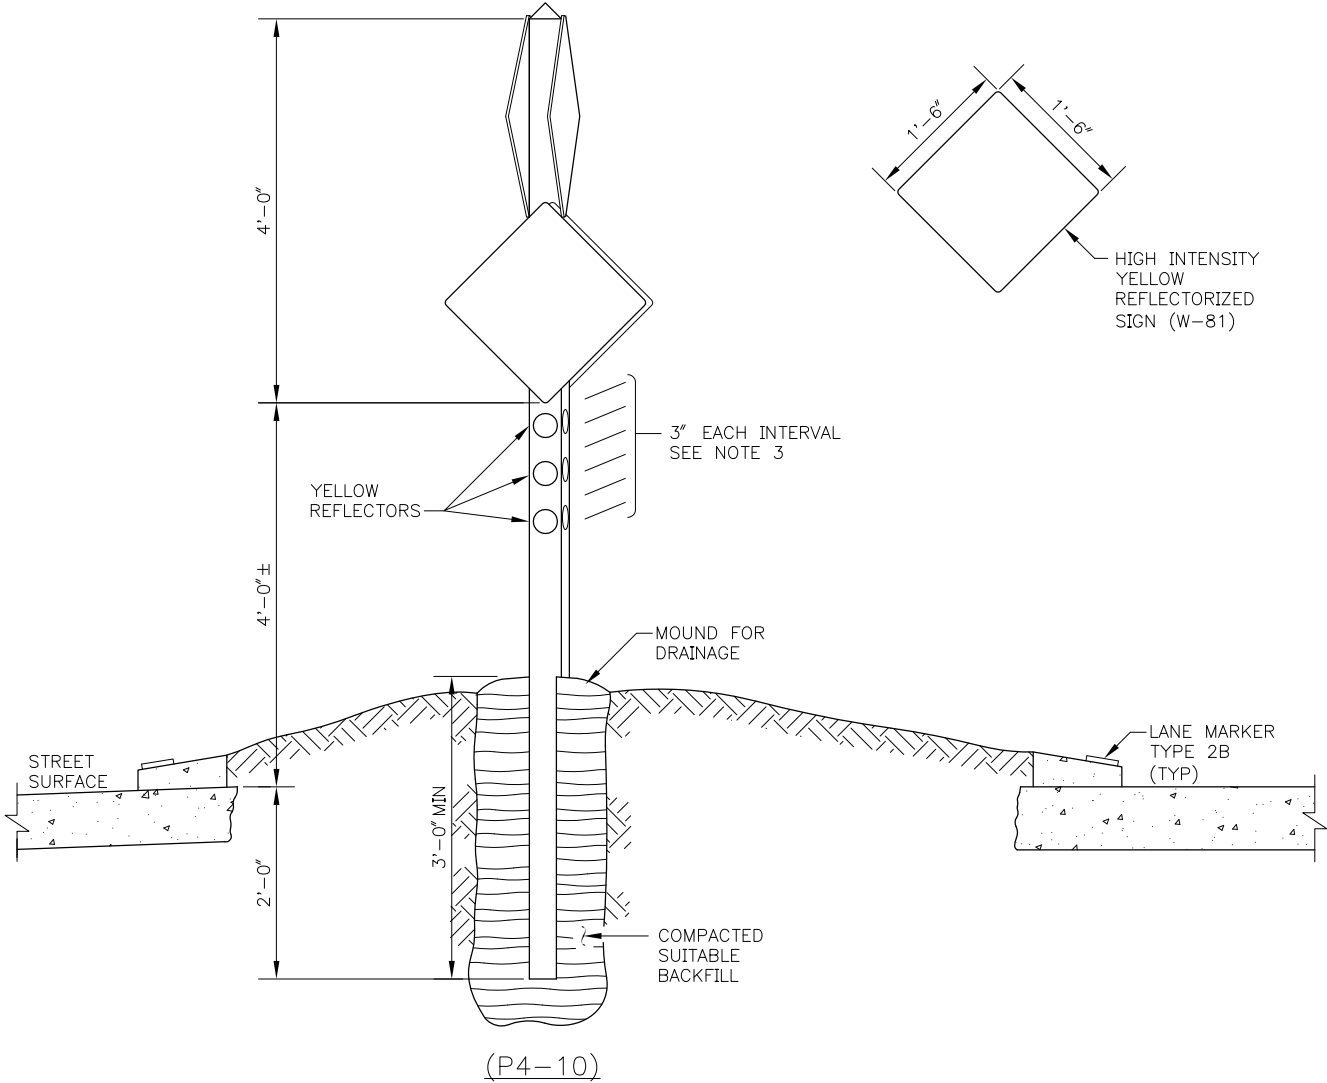

NOTES:

- 1. IN THE CASE WHERE ALL APPROACHES OF THE INTERSECTION ARE PRIMARILY AT THE SAME LEVEL WITH RESPECT TO GRADES (LESS THAN 3%) THE LOWER SET OF SIGNS WILL FACE THE HIGHER VOLUME STREET
- 2. IN THE CASE WHERE AN APPROACH HAS A GRADE LARGER THAN 3% THE HIGHER SIGNS WILL FACE THE APPROACH WITH THE HIGHEST GRADE TO ALLOW BETTER SIGHT DISTANCE
- 3. PLACE A MINIMUM OF THREE (3) REFLECTORS ON EACH AND EVERY SIDE OF POST OR PLACE THREE (3) HIGH INTENSITY REFLECTORIZED STRIPS COMPLETELY AROUND POST

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE


OBJECT MARKER INSTALLATION

STANDARD PLAN NO 627

REV DATE: 2003


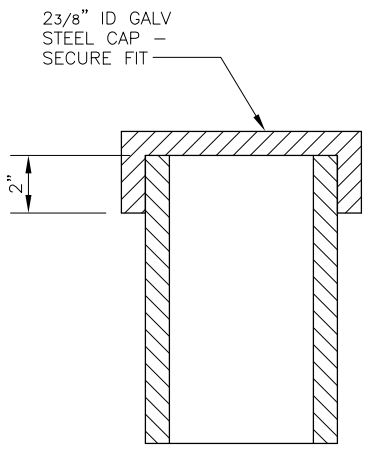


METER POST CAP
(TO BE USED W/ SIGN INSTALLATION)

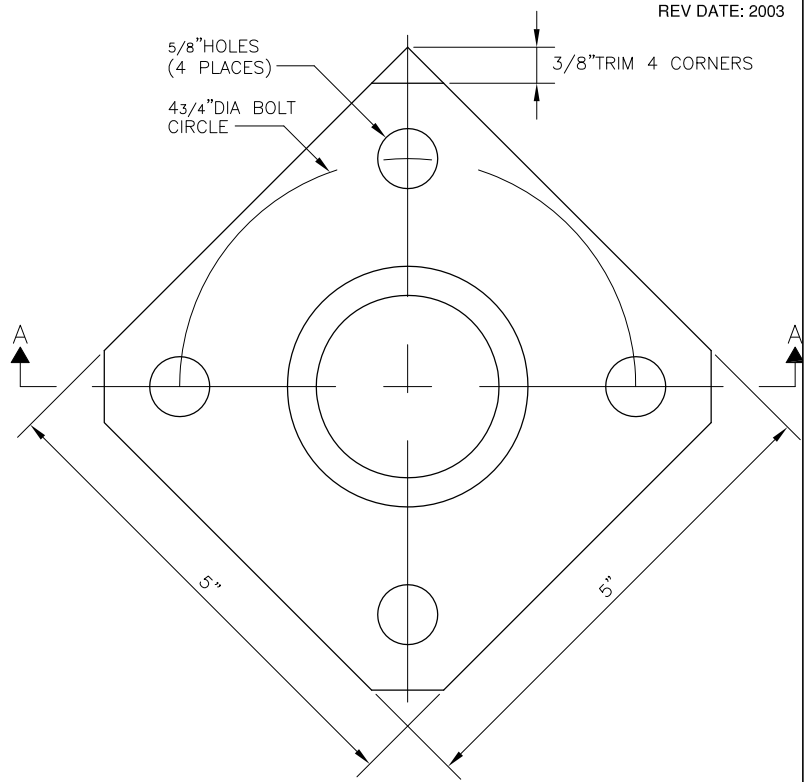

METER POST


PRIME WITH "RUSTOLEUM" OR APPROVED EQUAL AND
PAINT WITH TWO (2) COATS OF ALUMINUM

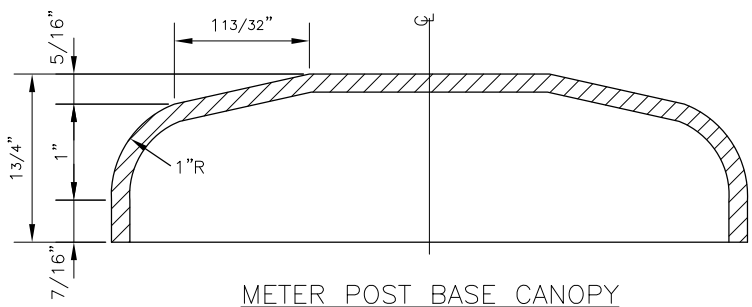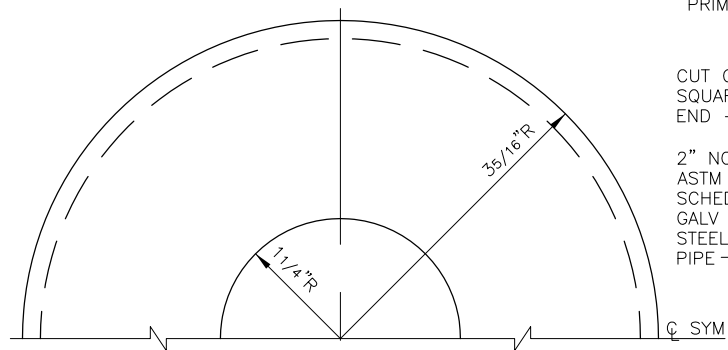

METER POST BASE CANOPY
MATERIAL: 0.062' 2-5-0 ALUM

CUT OFF
SQUARE PLAIN
END - REAM

2" NOM DIA
ASTM A 53
SCHED 40
GALV STD.
STEEL
PIPE

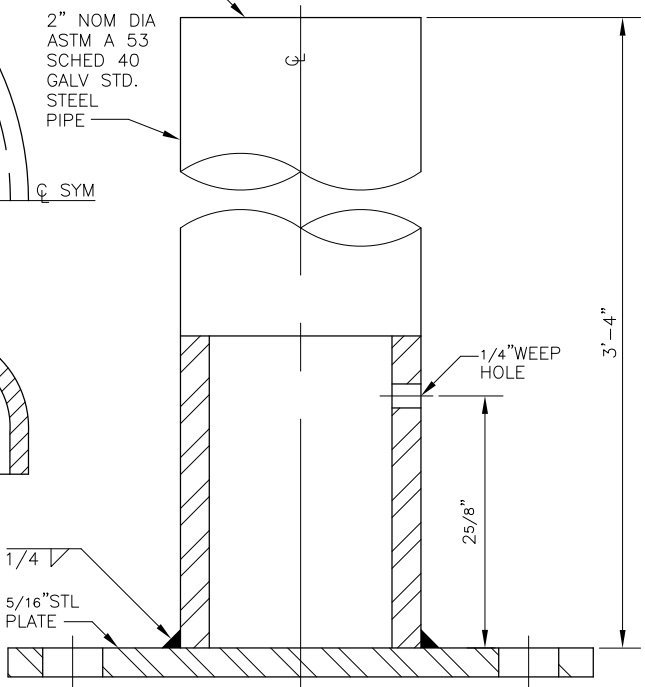

SECTION A-A

REF STD SPEC SEC 8-21




City of Seattle

NOT TO SCALE

PARKING METER POST &
ACCESSORIES

STANDARD PLAN NO 628

REV DATE: 2003

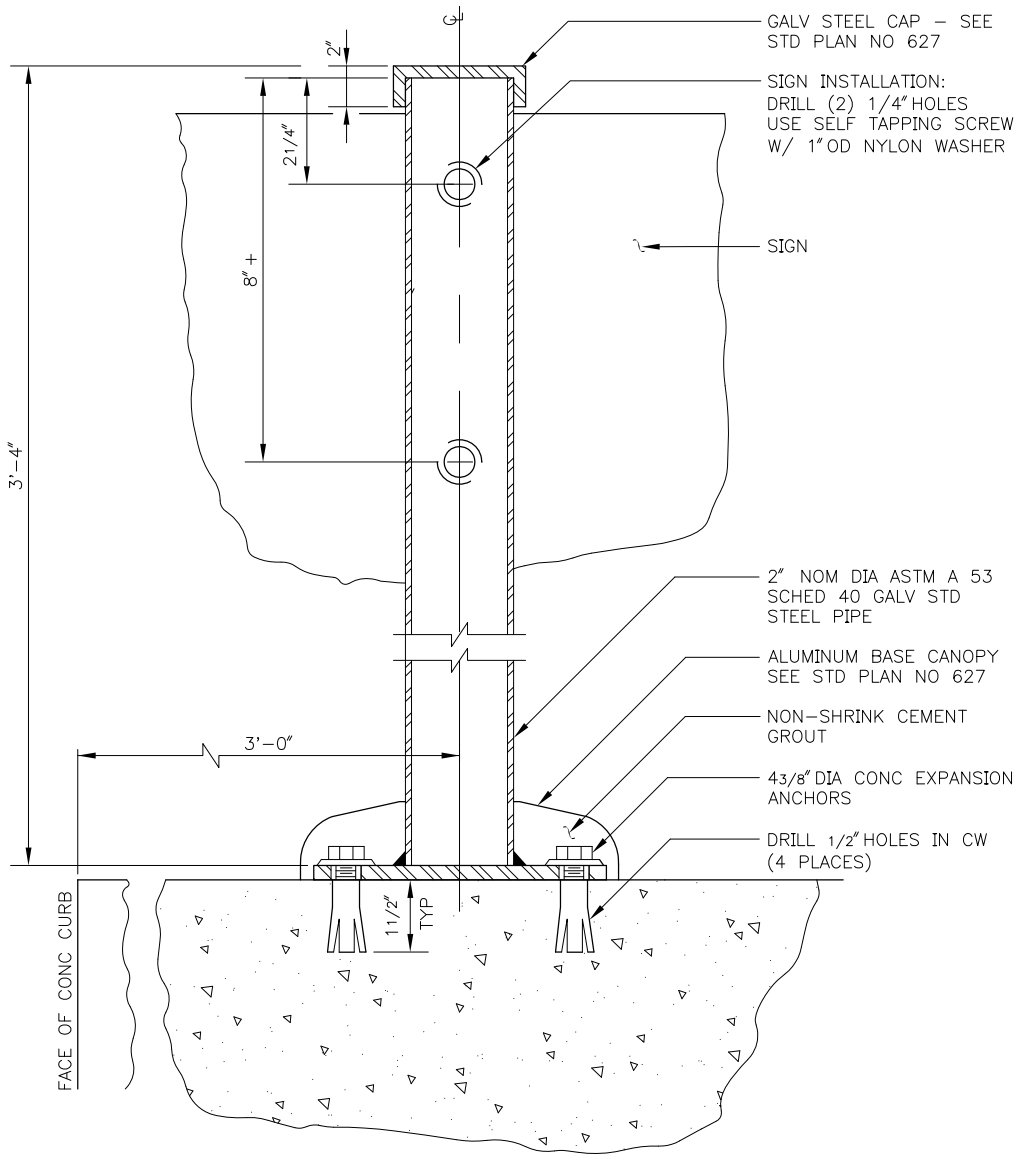

REF STD SPEC SEC 8-21



City of Seattle

NOT TO SCALE


SURFACE MOUNT METER
POST INSTALLATION DETAIL

STANDARD PLAN NO 630


REV DATE: 2003

NOTES:


1. POST ANCHOR RIVETS SHALL BE 1 1/2" ABOVE GROUND LEVEL
2. ATTACHMENT BRACKETS SHALL FACE AWAY FROM STREET AS WHEN POST IS LOCATED 3'-0" FROM EDGE OF CURB. ATTACHMENT BRACKETS SHALL FACE TOWARDS STREET (TS) WHEN POST IS LOCATED AT BACK SIDE OF SIDEWALK
3. FOR POST RELOCATIONS, OLD CONCRETE SHALL BE REMOVED FROM POST
4. ALL SIGNS, STRUCTURES AND HARDWARE PROVIDED BY METRO EXCEPT WHERE NOTED OTHERWISE ON THIS STD PLAN.
5. WHERE SURFACE MOUNTED BUS ZONE SIGNS ARE REQUIRED ON SLOPED SIDEWALK, THE CONTRACTOR SHALL PLUMB THE POST BY BUILDING A NON-SHRINK GROUT PAD UNDER PEDESTAL ASSEMBLY WITH SMOOTH 1H TO 1V TAPER ON THE GROUT EDGE. THE BOLT ANCHOR LENGTH SHALL BE ADJUSTED TO PROVIDE A MIN 3 1/2 INCH EMBEDMENT THROUGH THE GROUT INTO THE EXISTING CONCRETE.

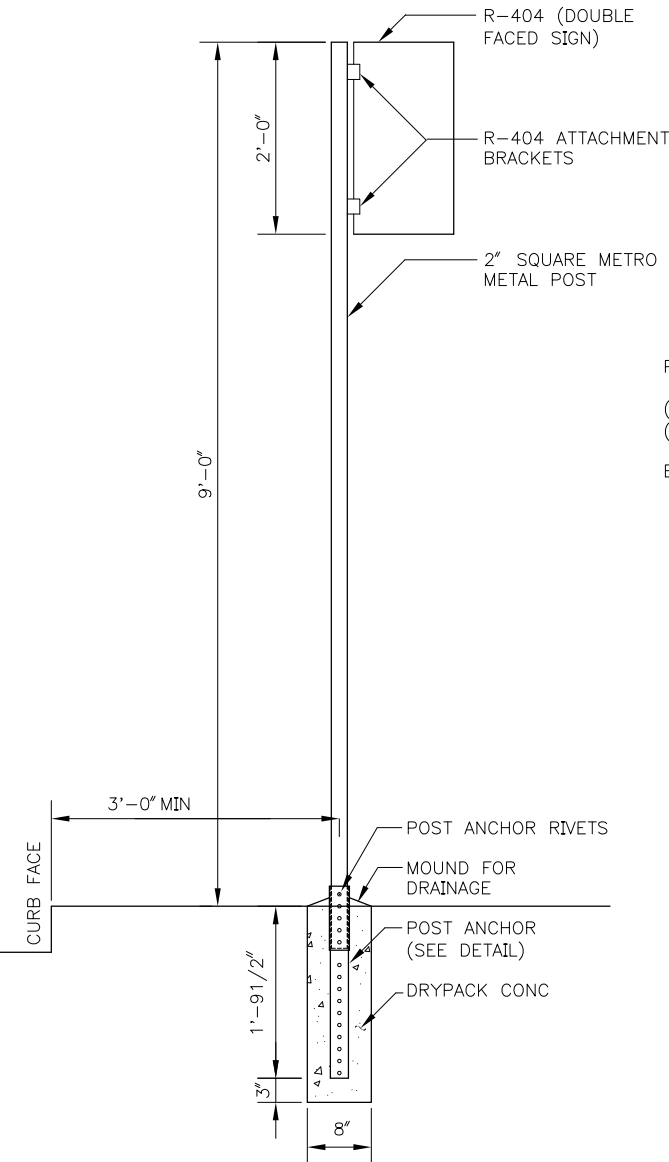


DIRECT BURIAL INSTALLATION

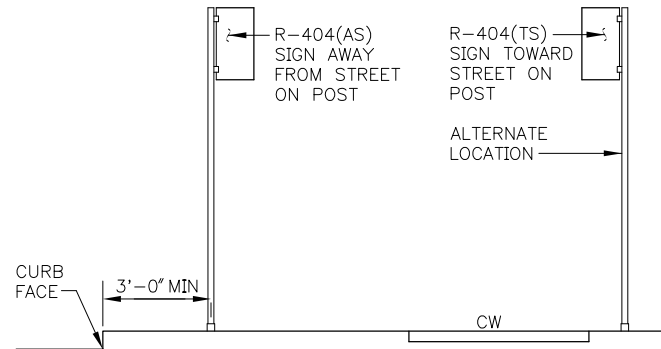

SIGN LOCATION DETAIL

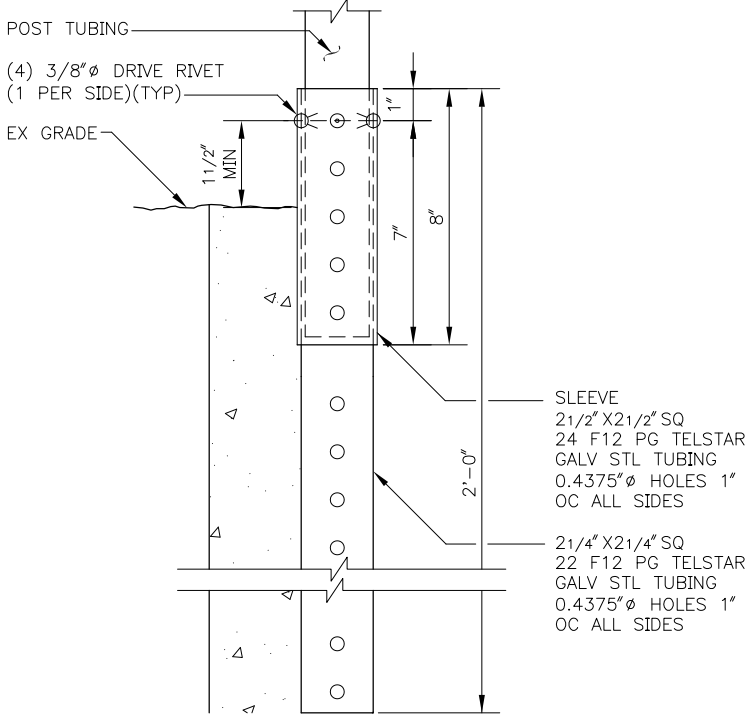

POST ANCHOR DETAIL

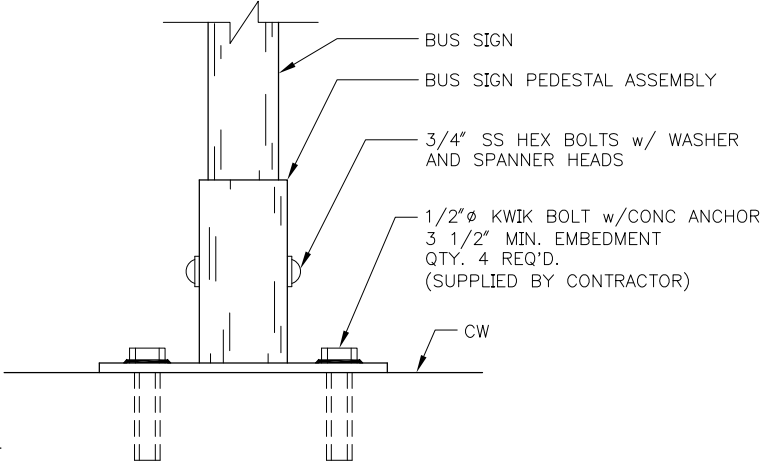

SURFACE MOUNT INSTALLATION

REF STD SPEC SEC 8-21





City of Seattle

NOT TO SCALE

METRO BUS ZONE SIGN INSTALLATION



$$a = 5/8" \pm 1/8"$$

$$b = 1/8" \pm 1/16"$$

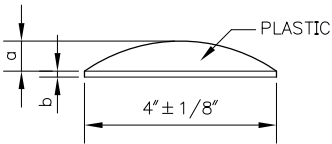



LANE MARKER-TYPE 1

▲ DIRECTION OF TRAFFIC

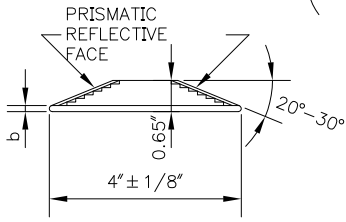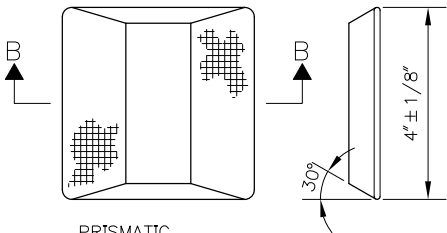

SECTION B-B

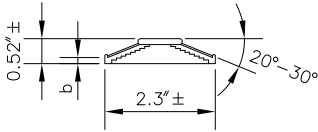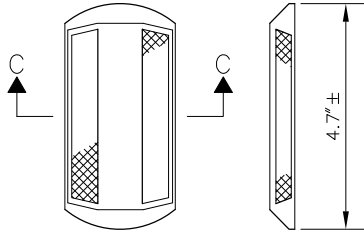

SECTION C-C

LANE MARKER-TYPE 2A
4" PRISMATIC REFLECTIVE MARKER

LANE MARKER-TYPE 2B

REF STD SPEC SEC 9-21




City of Seattle

NOT TO SCALE

TRAFFIC BUTTONS
& LANE MARKERS

STANDARD PLAN NO 710

REV DATE: 2003

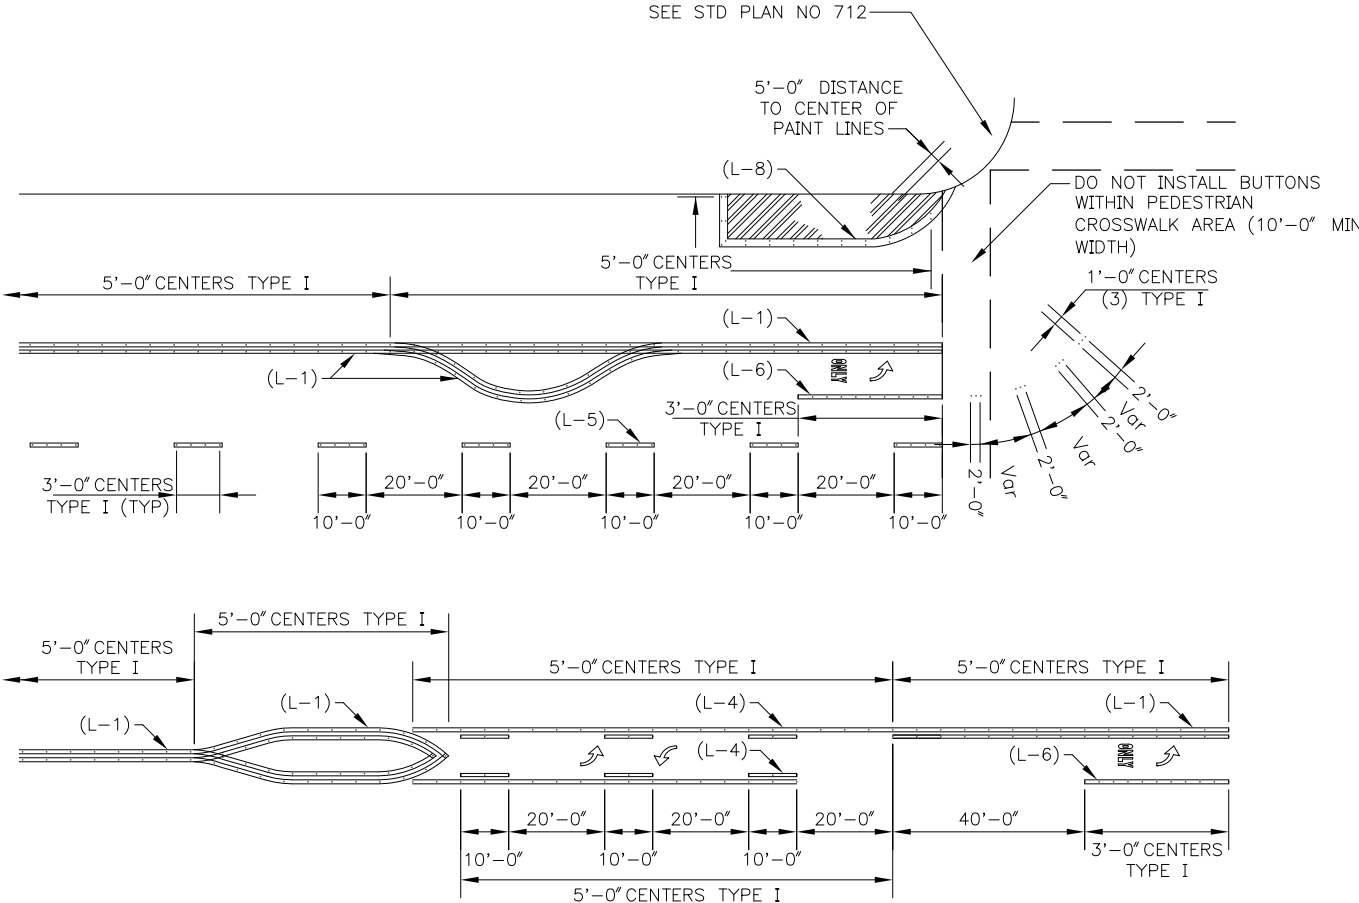

TYPICAL TYPE 1 TRAFFIC BUTTON (4") INSTALLATION DETAILS

TRAFFIC BUTTONS SHALL BE INSTALLED TO CONFORM WITH TYPE OF PAVEMENT MARKING (DESIGNATED AS L-1, L-4, L-5, ETC) AND ARE TO BE ARRANGED AND SPACED AS SHOWN ON THIS DRAWING. COLOR OF TRAFFIC BUTTONS IS TO MATCH COLOR OR PAVEMENT MARKINGS. TRAFFIC BUTTONS SHALL BE INSTALLED PRIOR TO ANY PAINT LINE INSTALLATION, EXISTING CHANNELIZATION IN CONFLICT WITH NEW OR REVISED CHANNELIZATION SHALL BE REMOVED (SEE STD SPEC SEC 2-02.3(3)J)


REF STD SPEC SEC 8-08



City of Seattle

NOT TO SCALE


CHANNELIZATION STANDARD

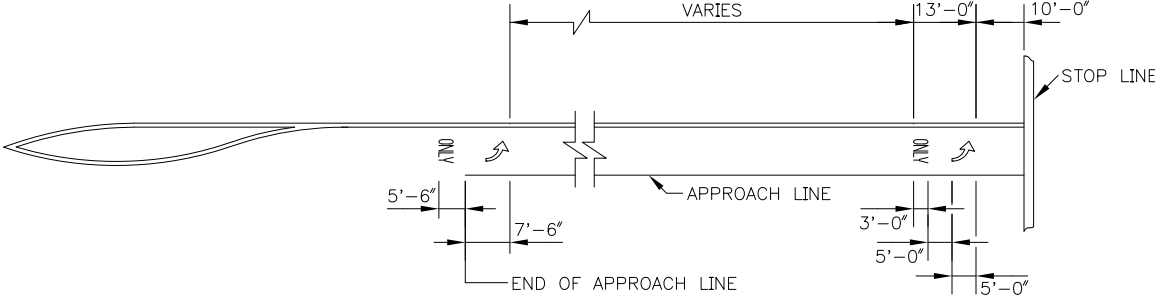

TYPICAL LEFT TURN CHANNELIZATION

NUMBER OF LEGEND SETS REQUIRED BASED ON THE LENGTH OF APPROACH LINES


APPROACH LINE LENGTH	LEGEND SETS
LESS THAN 50 FEET	1 SET AT X-WALK END OF POCKET
50 FEET-120 FEET	2 SETS
125 FEET-300 FEET	3 SETS (SECOND LEGEND LOCATED MIDWAY BETWEEN FIRST AND LAST LEGENDS)
OVER 300 FEET	ADDITIONAL SETS SPACED AT APPROX 100 FT INTERVALS BETWEEN FIRST AND LAST SETS

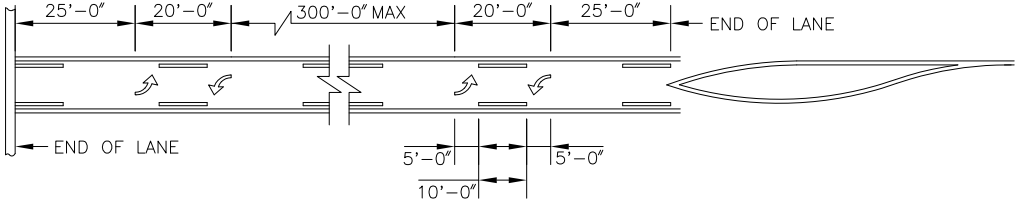

TYPICAL TWO WAY LEFT TURN LANES

NUMBER OF LEGEND SETS REQUIRED BASED ON THE LENGTH OF TYPICAL TWO WAY LEFT TURN LANES

LANE LENGTH	LEGEND SETS
LESS THAN 50 FEET	1 SET (CENTERED BETWEEN BOTH ENDS OF LANE)
50 FEET-300 FEET	2 SETS
OVER 300 FEET	3 SETS (SECOND LEGEND LOCATED MIDWAY BETWEEN FIRST AND LAST LEGENDS)
	ADDITIONAL SETS SPACED AT APPROX 300 FT INTERVALS

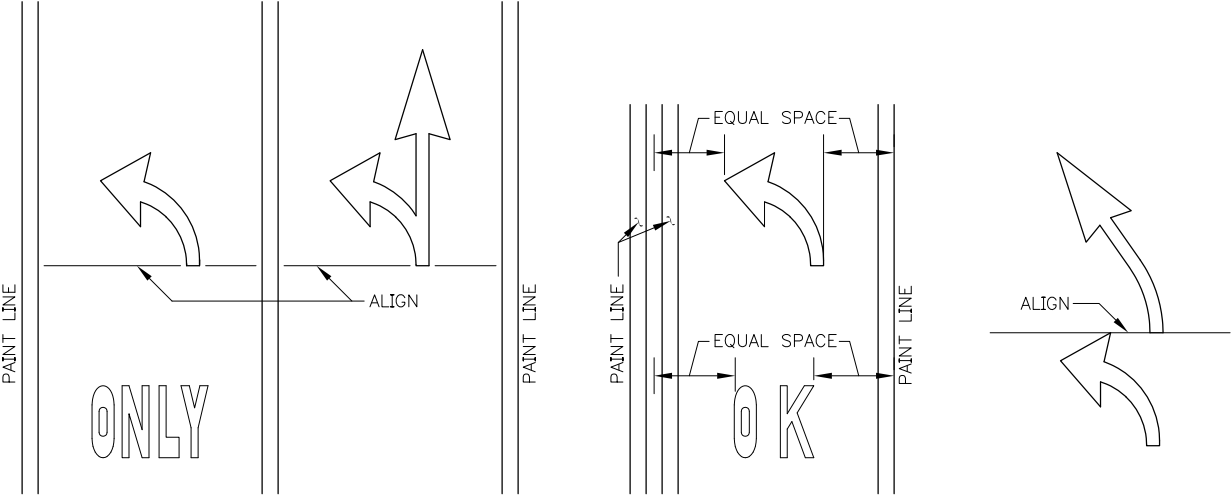

LEGEND PLACEMENT
LEGENDS IN ADJACENT LANES SHALL BE ALIGNED AS SHOWN

LEGENDS SHALL BE CENTERED WITHIN THE LANE TO WHICH THEY APPLY, AS SHOWN


LEGEND COMBINATIONS
OBLIQUE LEFT & 90° LEFT LEGENDS AND OBLIQUE RIGHT & 90° RIGHT LEGENDS MAY BE COMBINED AS SHOWN

REF STD SPEC SEC 8-22




NOT TO SCALE

TYPICAL LEFT TURN CHANNELIZATION AND LEGEND PLACEMENT

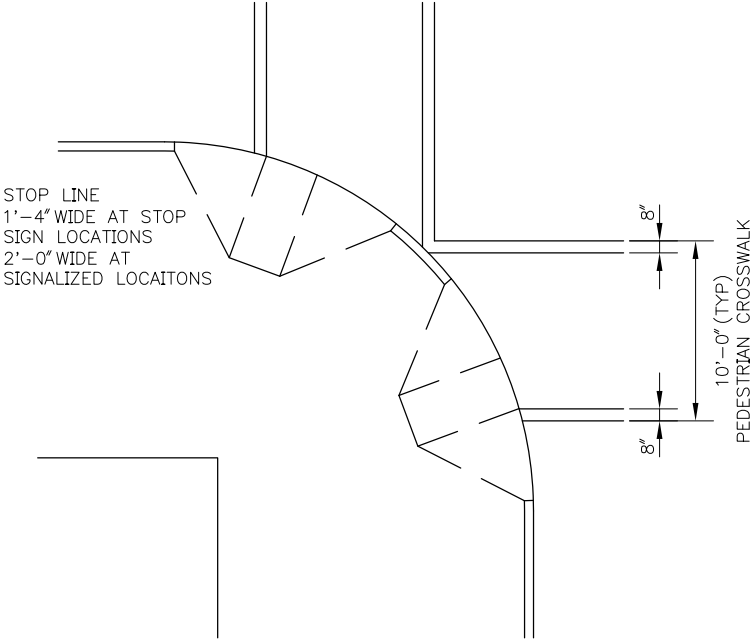

TYPICAL PEDESTRIAN CROSSWALKS & STOP LINES

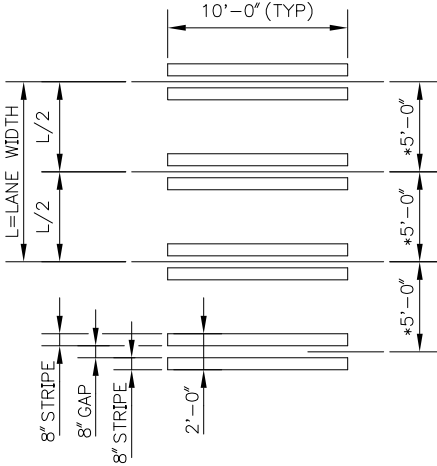

TYPICAL LADDER PEDESTRIAN CROSSWALKS

* WHERE TRAFFIC LANE LINES ARE NOT USED, LADDER BARS SHALL BE 5'-0" CENTER TO CENTER, BEGINNING AT THE MARKED CENTERLINE OF THE ROADWAY

NOTES:

1. EXACT LOCATION OF CROSSWALK LINES AND STOP LINES SHALL BE DESIGNATED BY SEATTLE DEPARTMENT OF TRANSPORTATION
2. EXISTING CROSSWALKS IN CONFLICT WITH NEW OR REVISED CROSSWALKS SHALL BE REMOVED BY MACHINE GRINDING


REF STD SPEC SEC 8-22



City of Seattle

NOT TO SCALE


TYPICAL CROSSWALK & STOP LINE INSTALLATION DETAILS

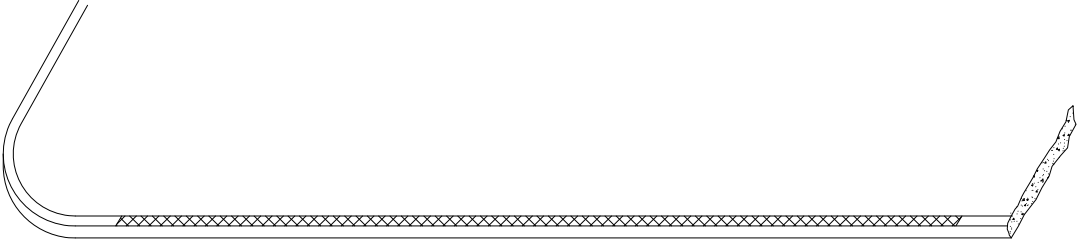


L-10
PASSENGER LOAD ZONE, ETC
(WHITE)




L-11
TOW-AWAY ZONE
(RED)

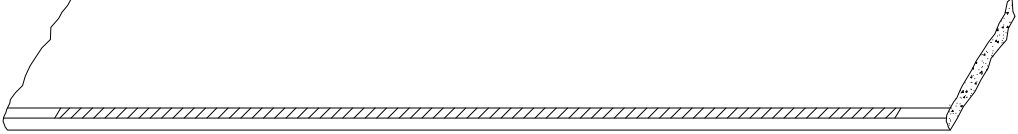

L-12
COMMERCIAL LOAD, TRUCK
LOAD, LOAD & UNLOAD ZONE, ETC
(YELLOW)

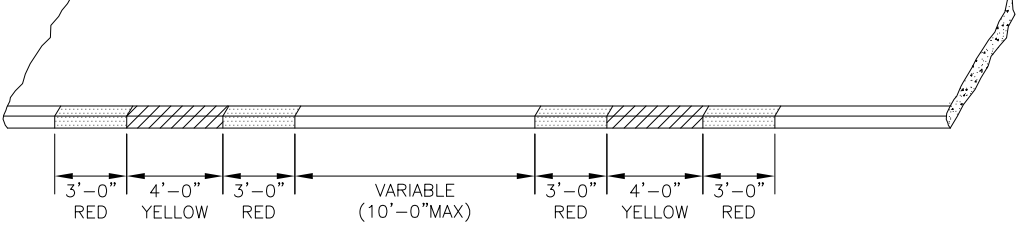

L-13
BUS ZONE (NON PARKING METERED AREAS)
BUS ZONES ARE PAINTED ON TOP & FACE OF CURB

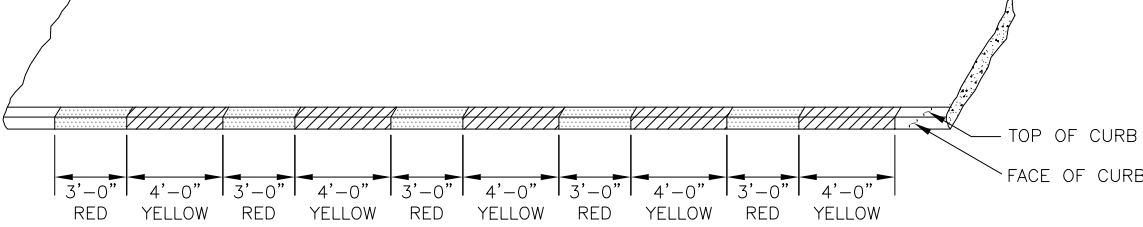

L-13
BUS ZONE (PARKING METERED AREAS)
BUS ZONES ARE PAINTED ON TOP & FACE OF CURB

NOTES:

1. TOTAL LENGTH OF CURB MARKINGS SHALL BE AS SHOWN ON DRAWINGS
2. PAINT SHALL BE APPLIED NEATLY ON THE CURB AND ALL PAINT SMEARS ON ADJACENT SURFACES SHALL BE REMOVED

REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


CURB SPACE
MARKING DETAILS

STANDARD PLAN NO 720a


REV DATE: 2003

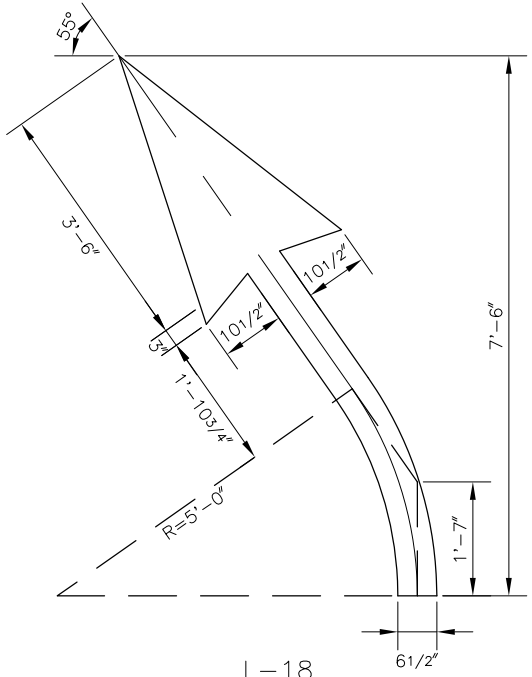


L-18
OBLIQUE LEFT ARROW

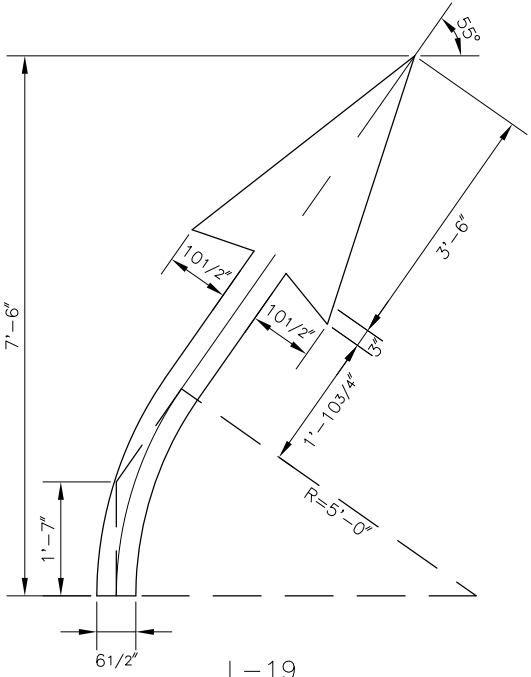

L-19
OBLIQUE RIGHT ARROW

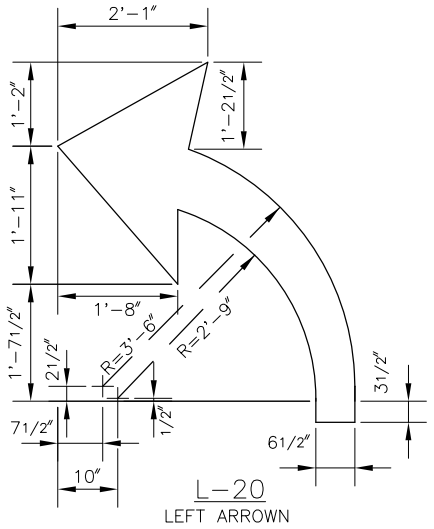

L-20
LEFT ARROW

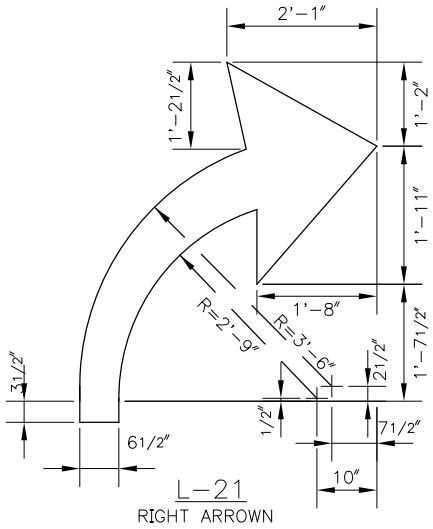

L-21
RIGHT ARROW


REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE


PAVEMENT MARKINGS
LEGENDS/SYMBOLS

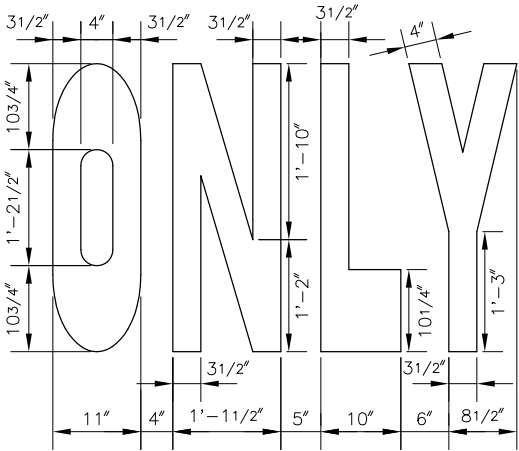


L-25
"ONLY" LEGEND

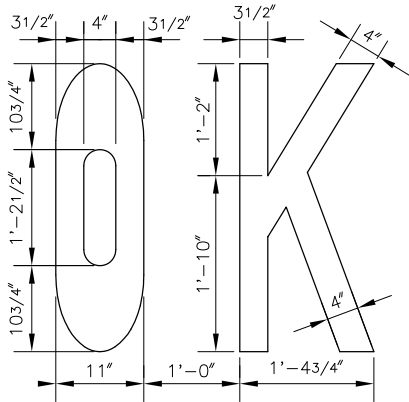

L-26
"OK" LEGEND

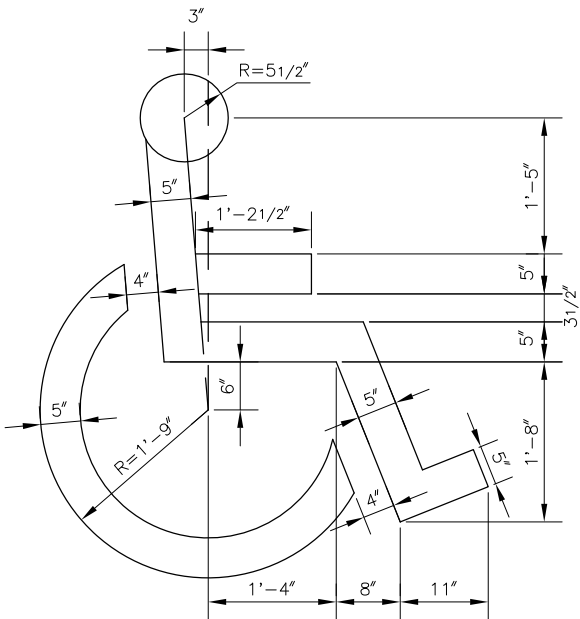

L-29
DISABLED PERSON SYMBOL

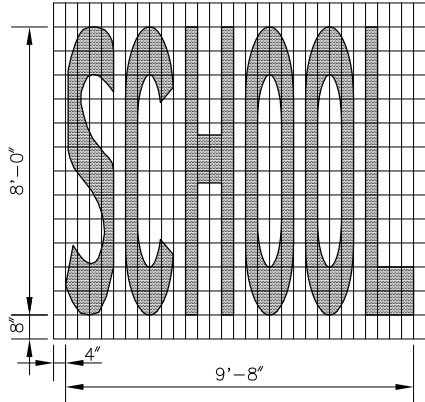

L-35
"SCHOOL" LEGEND

REF STD SPEC SEC 8-22





City of Seattle

NOT TO SCALE

PAVEMENT MARKINGS
LEGENDS/SYMBOLS

STANDARD PLAN NO 722

REV DATE: 2003

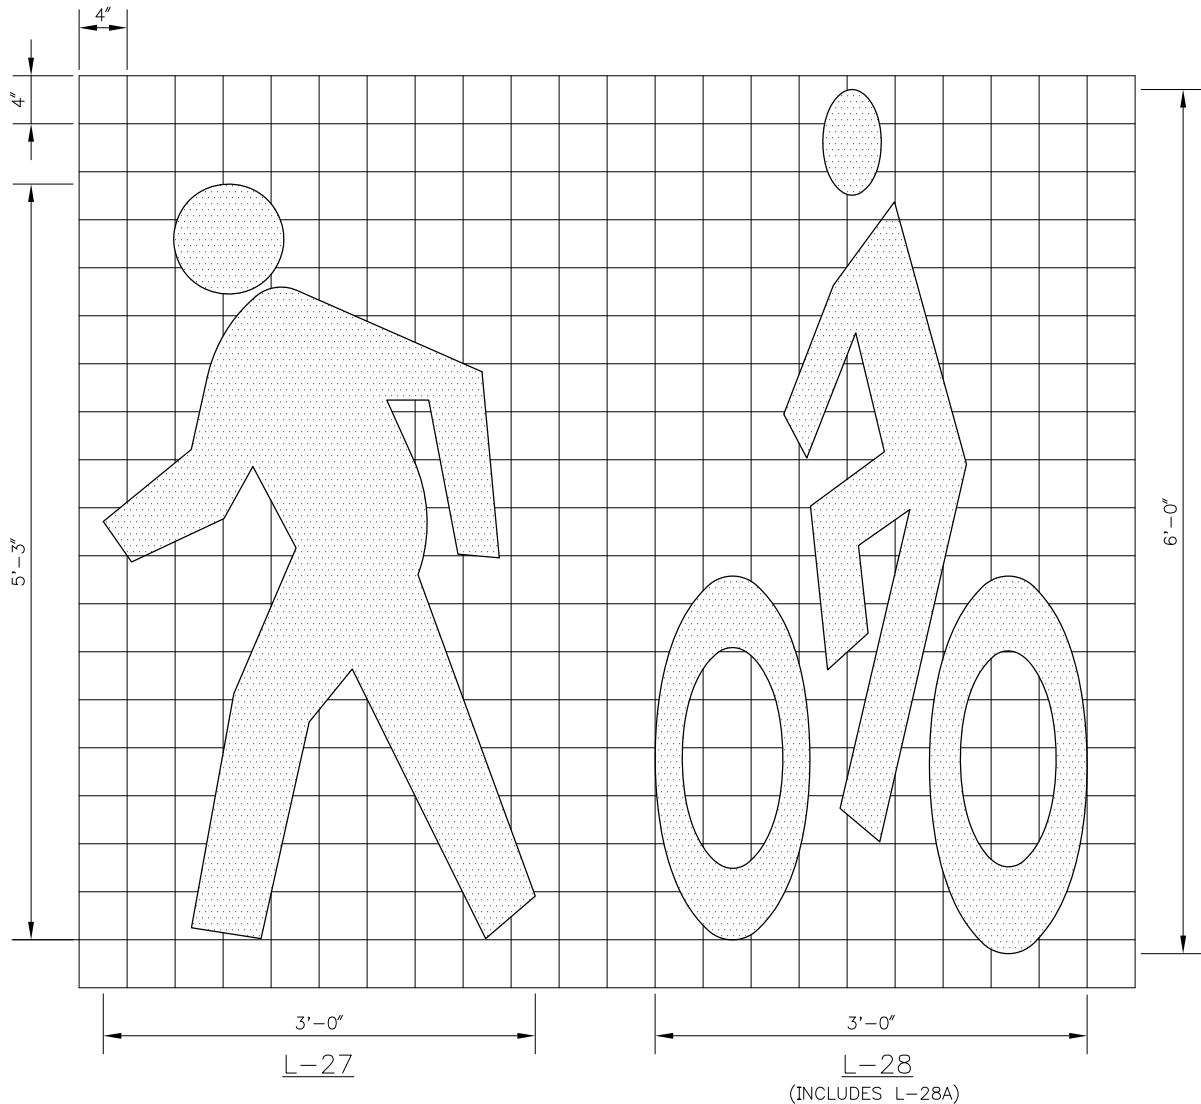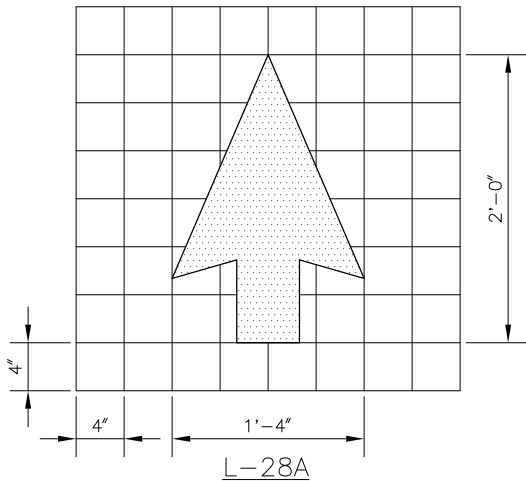

REF STD SPEC SEC 8-22




City of Seattle

NOT TO SCALE

BICYCLIST & PEDESTRIAN SYMBOLS


STANDARD PLAN NO 800

REV DATE: 2003

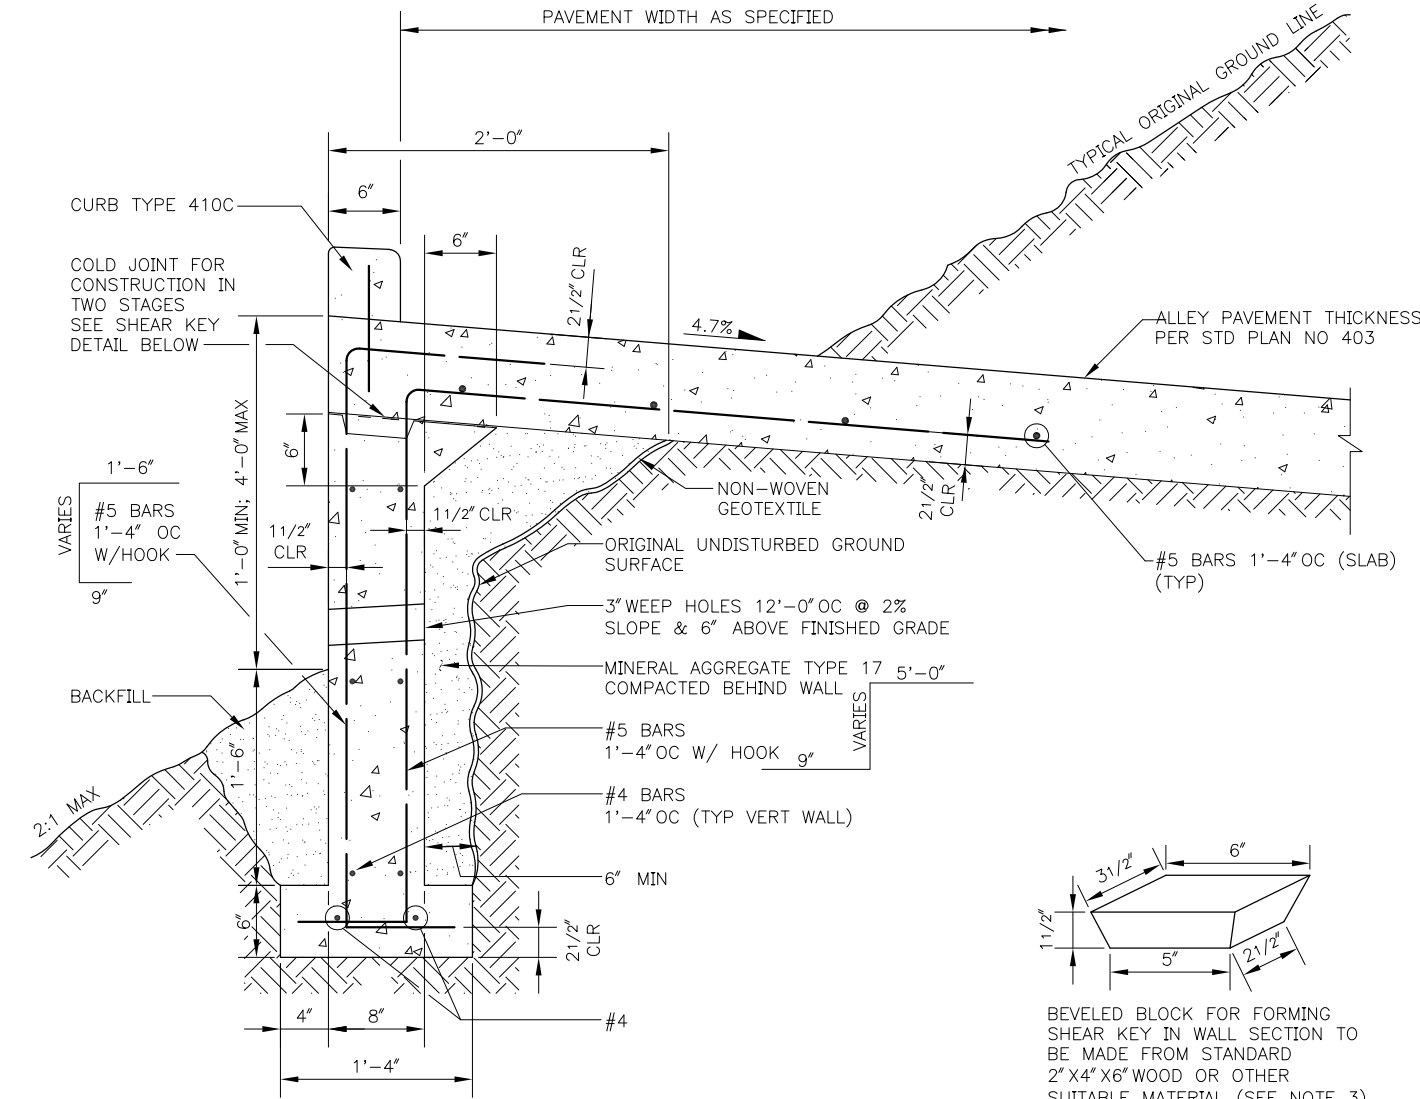

NOTES:

1. BASE OF SUPPORT WALL TO BE BEARING ON COMPACTED SUITABLE MATERIAL
2. BACK FORM FOR SUPPORT WALL MAY BE OMITTED AND CONCRETE PLACED AGAINST NATIVE EARTH WHEN GROUND CONDITIONS PERMIT. CLEARANCE TO REINF STEEL IN BACK FACE SHALL BE 2 1/2"
3. WHEN CONSTRUCTION OF ALLEY PAVEMENT IS NOT PLACED INTEGRAL WITH SUPPORT WALL, SHEAR KEYS SHALL BE INSTALLED 1'-6" ON CENTERS
4. CONCRETE FOR SUPPORT WALL SHALL BE CL 6 (1 1/2)
5. REINFORCING STEEL ASTM A615 GR 60
6. VEHICULAR & PEDESTRIAN RAILING PER STREET DESIGN MANUAL



BEVELED BLOCK FOR FORMING SHEAR KEY IN WALL SECTION TO BE MADE FROM STANDARD 2" X 4" X 6" WOOD OR OTHER SUITABLE MATERIAL (SEE NOTE 3)

SHEAR KEY


REF STD SPEC SEC 5-05



City of Seattle

NOT TO SCALE

SUPPORT WALL

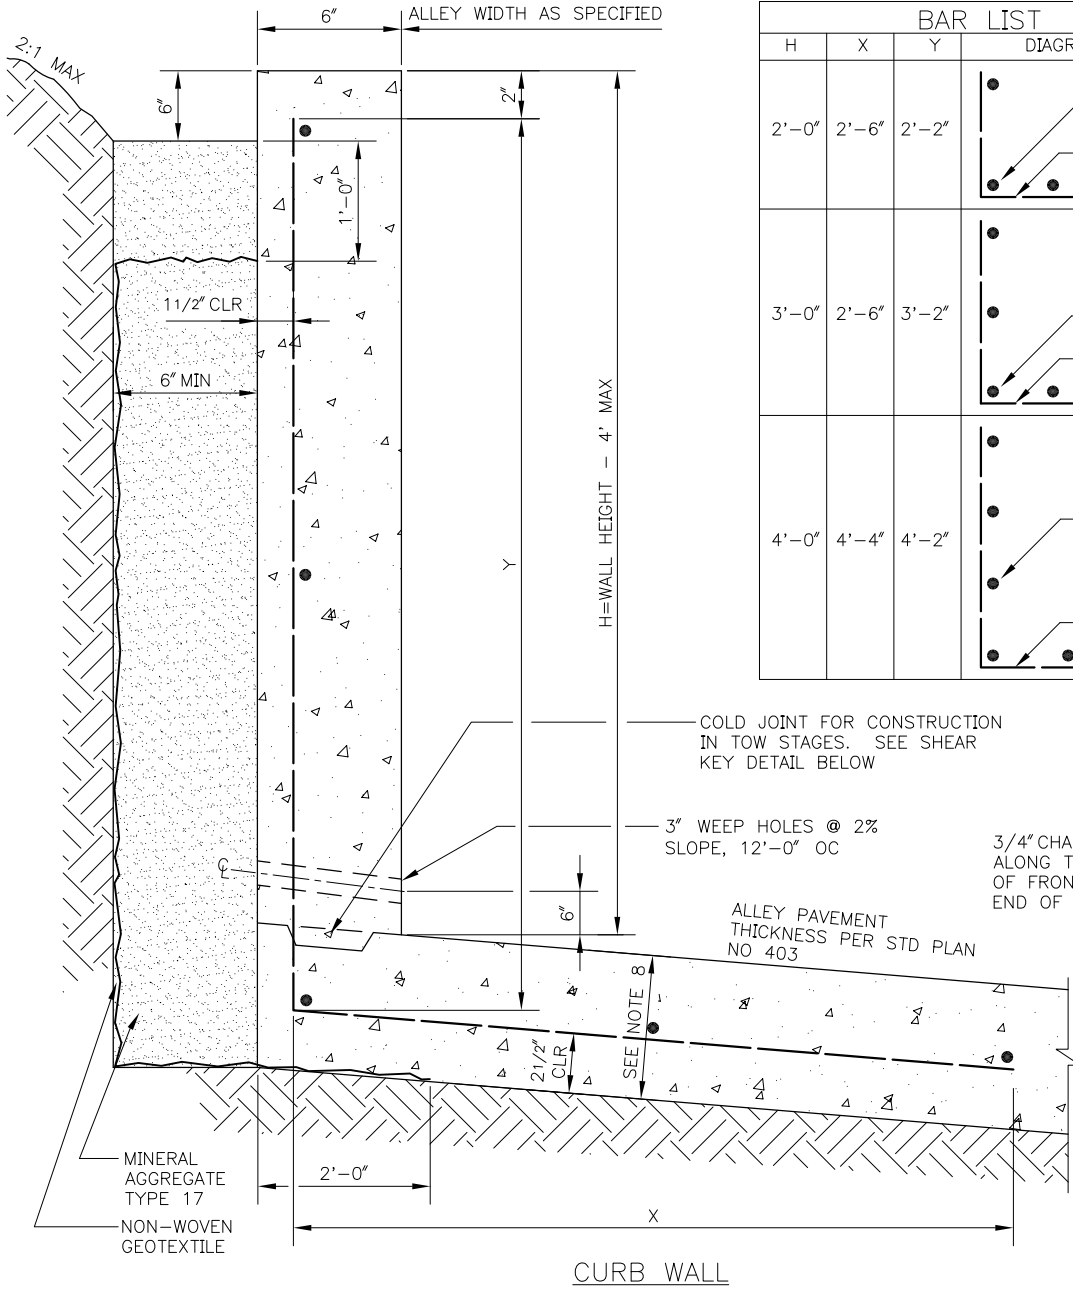


BAR LIST			
H	X	Y	DIAGRAM
2'-0"	2'-6"	2'-2"	(4) #4 #4@1'-6" OC
3'-0"	2'-6"	3'-2"	(5) #4 #4@1'-6" OC
4'-0"	4'-4"	4'-2"	(7) #4 #4@1'-0" OC

COLD JOINT FOR CONSTRUCTION IN TWO STAGES. SEE SHEAR KEY DETAIL BELOW


3" WEEP HOLES @ 2% SLOPE, 12'-0" OC

ALLEY PAVEMENT THICKNESS PER STD PLAN NO 403

3/4" CHAMFER ALONG TOP EDGE OF FRONT AND END OF WALL



CURB WALL DETAIL



SHEAR KEY
BEVELED BLOCK FOR FORMING SHEAR KEY IN WALL SECTION TO BE MADE FROM STANDARD 2" X 4" X 6" WOOD OR OTHER SUITABLE MATERIAL (SEE NOTE 5)

NOTES:

1. MATCH WALL THROUGH JOINTS WITH PAVEMENT THROUGH JOINTS. DISCONTINUE HORIZONTAL REINFORCEMENT AT JOINTS AND MAINTAIN 1 1/2" CLEAR TO ALL REINFORCING AT JOINTS
2. CONC CL 6 (1 1/2) FOR CURB WALL
3. MAX HEIGHT 4'-0" (MIN PAVEMENT WIDTH IS 12'-0" FOR WALLS HIGHER THAN 3'-0")
4. BACK FORM FOR CURB WALL MAY BE OMITTED AND CONC PLACED AGAINST NATIVE EARTH WHEN GROUND CONDITIONS PERMIT. CLEARANCE TO REINF STEEL SHALL BE 2 1/2"
5. WHEN CONSTRUCTION OF WALL IS NOT PLACED INTEGRAL WITH ALLEY PAVEMENT, SHEAR KEY INDENTATIONS SPACED 1'-6" OC SHALL BE INSTALLED IN THE PAVEMENT SLAB
6. REINF STEEL ASTM A615 GR 60
7. ANY RAILING ON TOP OF WALL PER STREET DESIGN MANUAL

REF STD SPEC SEC 5-05



City of Seattle

NOT TO SCALE

CURB WALL