


**SEALING CONDUITS**

**For Conduits with City Light-Installed Cables:**

1. Install fire stop to prevent fire and smoke from spreading from City Light system vaults back to customer's building. See Stock Numbers 012520 and 012521.
2. Seal conduits to limit the likelihood of combustible or toxic gas entering the building (NESC 322B, #4).


**Secondary Conduits**

Secondary services as defined by *Requirements for Electrical Service Connection*, Section 6.1.4 and terminated inside buildings in Meter Socket, C.T. Cabinet, or Service Terminal Box.

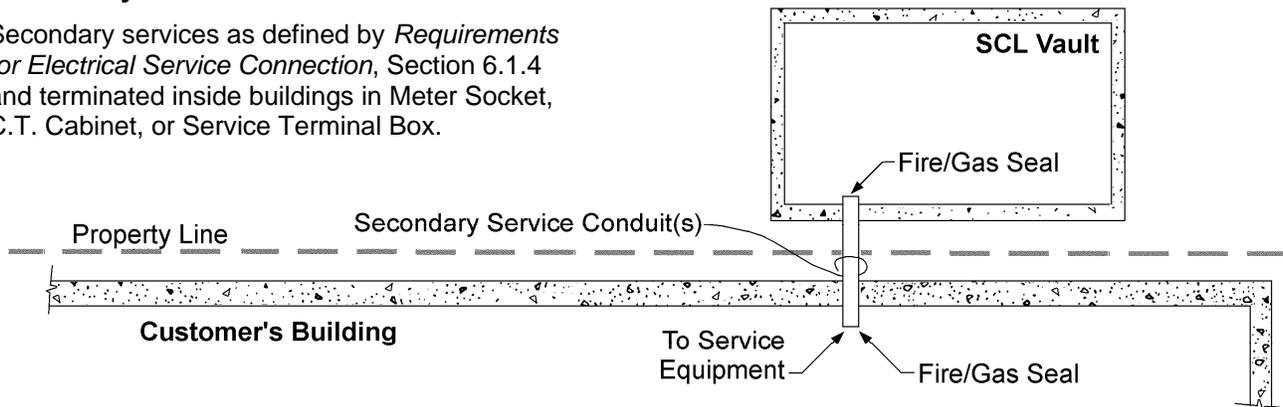

**Primary Conduits**

Primary services as defined by *Requirements for Electrical Service Connection*, Section 6.1.4 and terminated in a vault inside the customer's building.

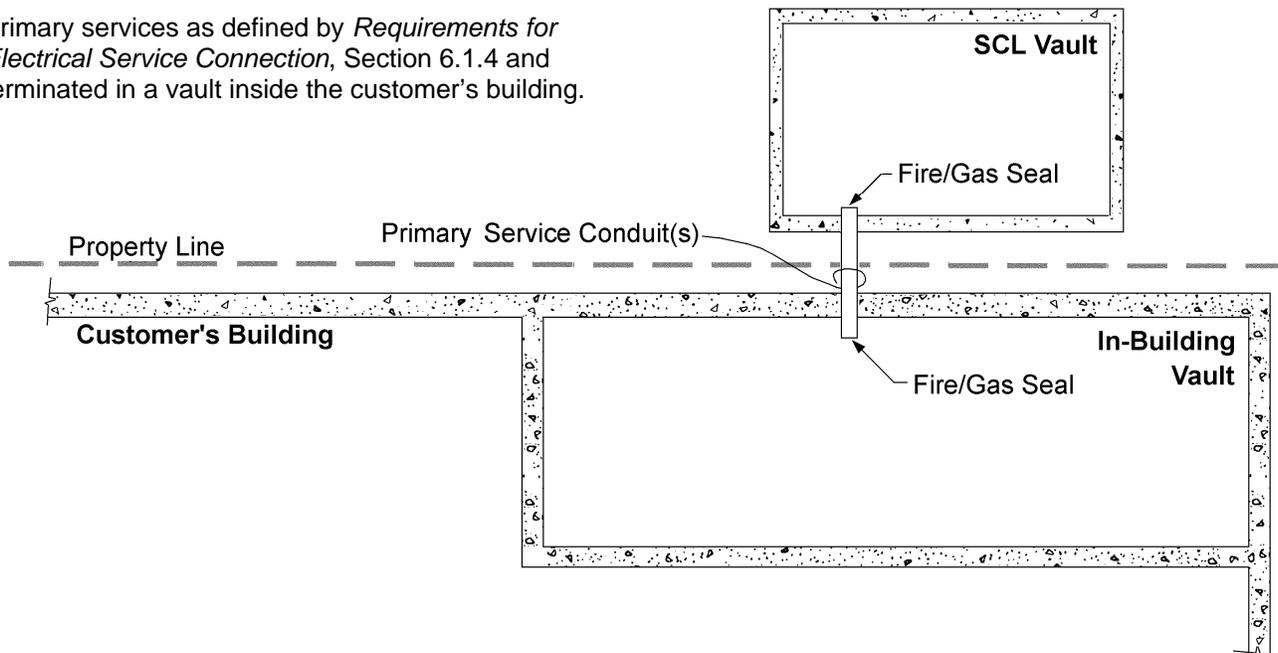

| STANDARDS COORDINATOR | STANDARDS SUPERVISOR | UNIT DIRECTOR |
|-----------------------|----------------------|---------------|
| Charles L. Shaffer    | John Chinner         | Harold Gray   |