
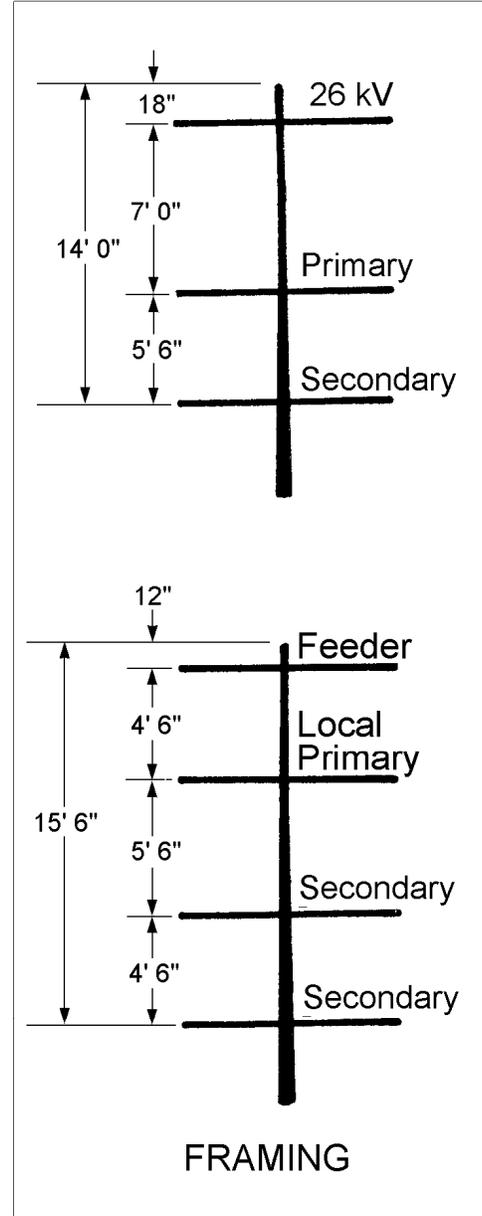


**STANDARD SPACING OF ARMS**

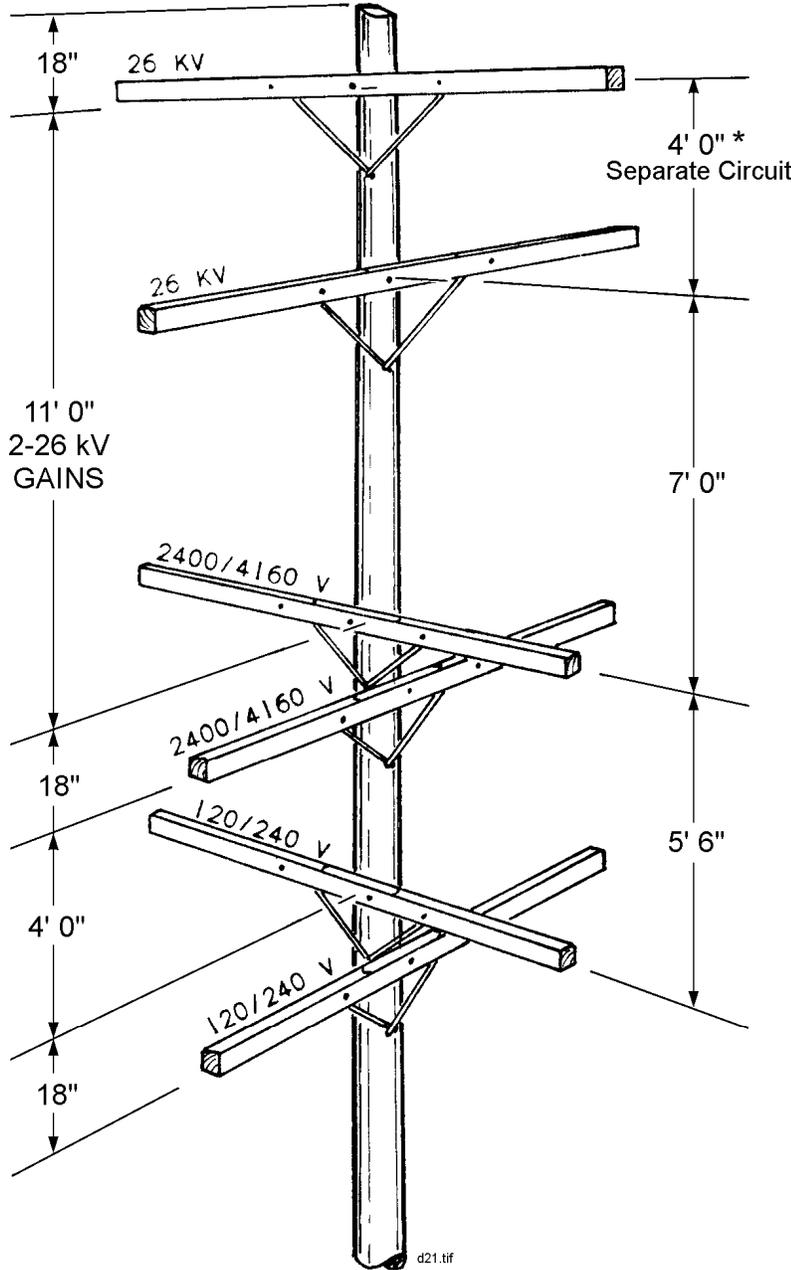

\*Increase 26kV arm spacing to 5 feet for 600 amp feeders within one mile of receiving substations and to 7 feet for 954 ACSR feeders (See D9-51.).

ORIGINATOR	STANDARDS COORDINATOR	STANDARDS SUPERVISOR	UNIT DIRECTOR
<i>Jim S. Horn</i>	<i>Charles L. Shaffer</i>	<i>John Schinner</i>	<i>Betty Robm</i>