



**26 kV CIRCUIT BREAKER**

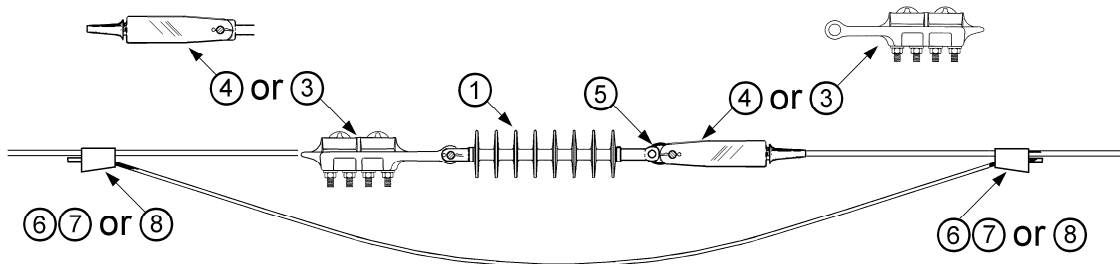

**Preferred Method**

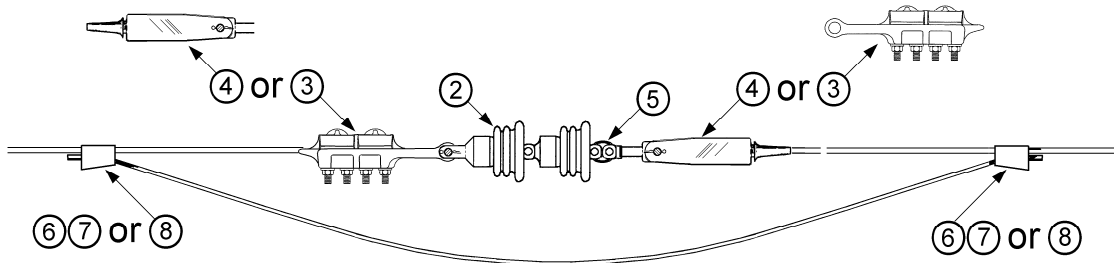

**Alternate Method**

**MATERIAL LIST**

Item	Quantity	Description	Stock No.
1	1	Insulator, Suspension, Polymer	690233
2	2	Insulator, Suspension, Ceramic	690208
3	2	Clamp, deadend, strain For AAC & ACSR	3/0-477 694292
			795-954 694294
4	2	Deadend, automatic feedthrough For copper cables only	#4 581332E
			#2 581333
			2/0 581334
			4/0 581335
			300 581337
5	1	Link, galvanized	696195
6	2	Tap, compression, "C" type, Ampacts	See D14-1
7	2	Clamp, hot line tap, Cu	#8-2/0 580725E
			4/0-#6 580727
8	2	Connector, two bolt, Cu For copper cables only	2/0 (Max) 669379E
			4/0 (Max) 669380E
			350 (Max) 669381E

ORIGINATOR

STANDARDS COORDINATOR

STANDARDS SUPERVISOR

UNIT DIRECTOR

*Jim S. Horn*

*Charles L. Shaffer*

*John Schimmer*

*Hardee Juy*