


REVISIONS		
REV	DATE	MF
DR	CK	APP
W.O. #		
DESCRIPTION		
0	5/10/2006	
AE		
W.O. # 38124-37		

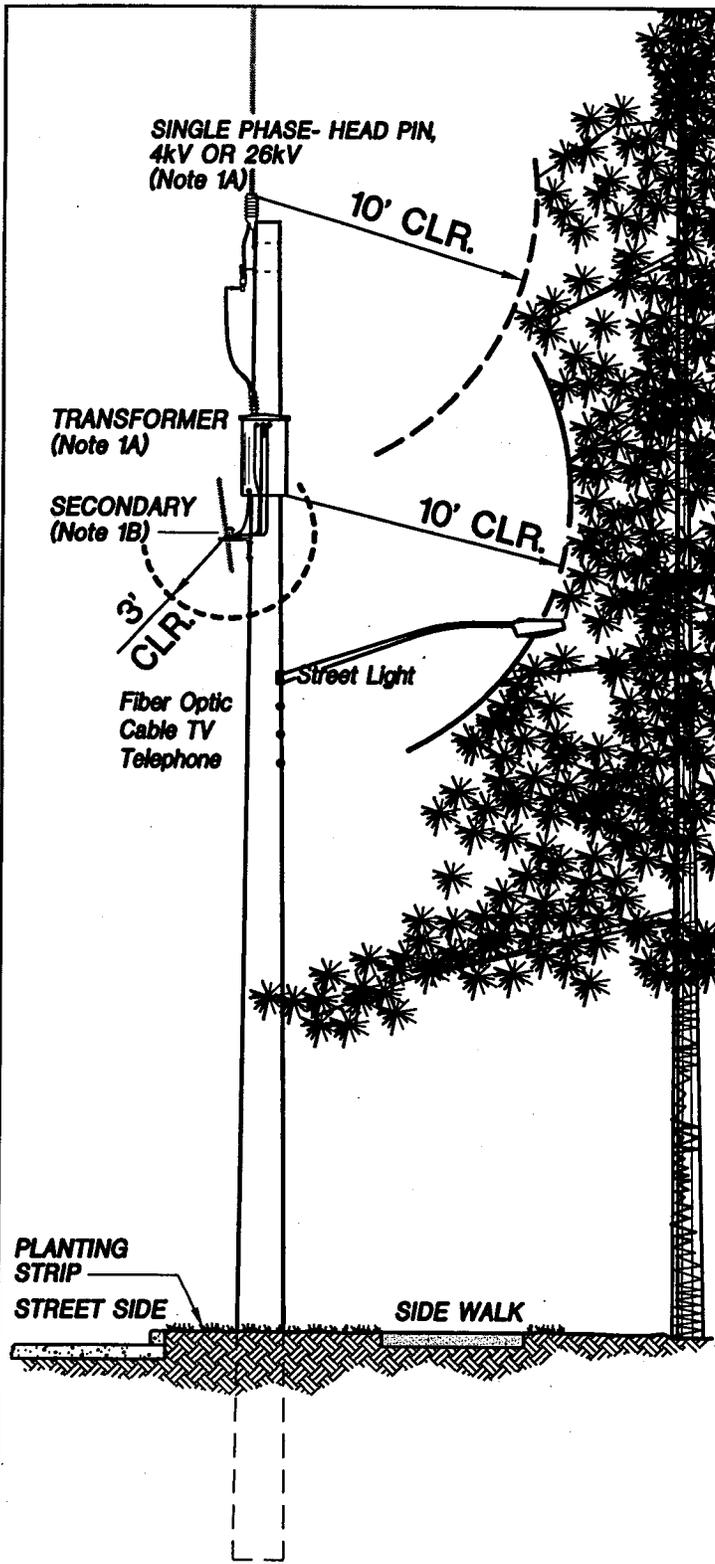

REFERENCES

FOR REFERENCES, SEE TA-2000

NOTES

1. VEGETATION CLEARANCE CRITERIA IS BASED ON WAC-296-24-960, RCW 64.12.035 AND SEATTLE CITY LIGHT BEST PRACTICE

CONDUCTOR TYPE	CLEARANCE
-----------------------	------------------

- | | |
|---|-----------------------------------|
| <p>A. PRIMARY DISTRIBUTION, 4KV-26KV AND TRANSFORMER, SWITCHES & ELECTRICAL EQUIPMENT ON THE POLE ...</p> <p>B. SECONDARY, FIBER OPTIC, CABLE TV AND TELEPHONE CABLE</p> <p>C. TRANSMISSION CONDUCTOR, VOLTAGE > 26KV (NOT SHOWN) APPLICABLE IN SOME LOCATIONS</p> | <p>10'</p> <p>3'</p> <p>16.5'</p> |
|---|-----------------------------------|

2. ILLUSTRATION IS SHOWN FOR A TYPICAL 47' POLE, AND CLEARANCE AT THE POLE. ABOVE CRITERIA ALSO APPLY TO OTHER POLE HEIGHTS AND TO CONDUCTOR/WIRE TO TREE CLEARANCE ALONG THE SPAN

**OVERHEAD DISTRIBUTION
NORTH & SOUTH DISTRIBUTION**



Seattle City Light

**SINGLE PHASE DISTRIBUTION POWERLINE
TREE CLEARANCE
SIDE PRUNING - CONIFER**

DR: A. EDENS	DATE: 05/10/2006	CLASS
CK: <i>A. M.</i>	APP: <i>5-12-06</i>	L
<i>5/10/06</i>	<i>JBS</i>	DRAWING NO.
SCALE NONE	REV. NO. 0	TA-2006