REVISIONS		
REV	DATE	MF
DR	CK	APP
W.O. #		
DESCRIPTION		
0	5/10/2006	
AE		
W.O. # 38124-37		

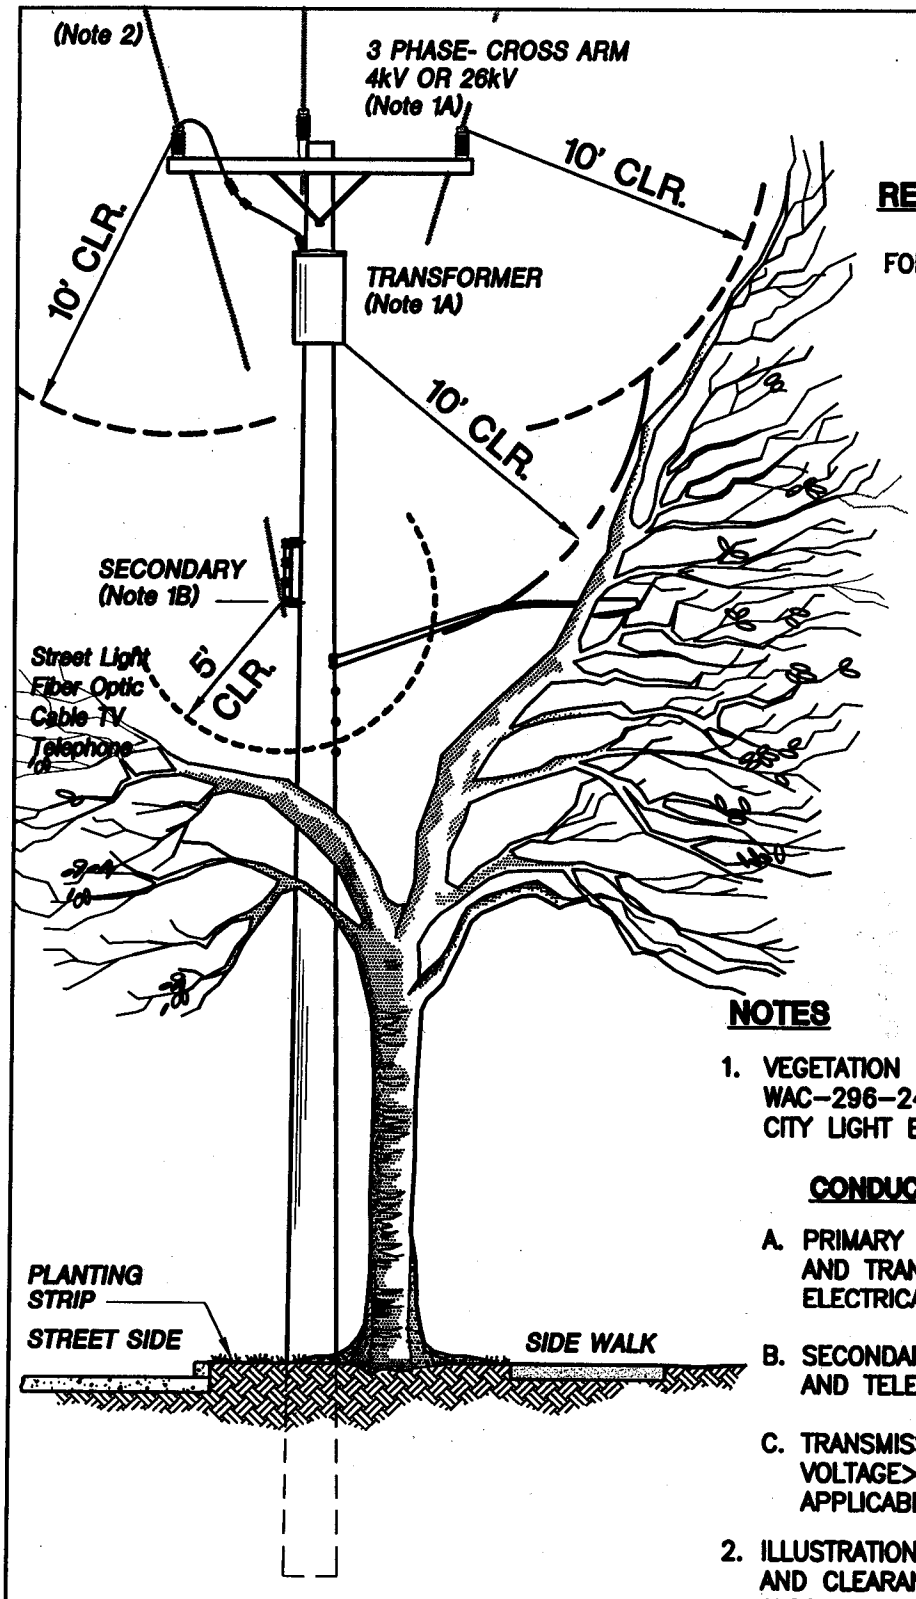

REFERENCES

FOR REFERENCES, SEE TA-2000

NOTES

1. VEGETATION CLEARANCE CRITERIA IS BASED ON WAC-296-24-960, RCW 64.12.035 AND SEATTLE CITY LIGHT BEST PRACTICE

CONDUCTOR TYPE	CLEARANCE
A. PRIMARY DISTRIBUTION, 4KV-26KV AND TRANSFORMER, SWITCHES & ELECTRICAL EQUIPMENT ON THE POLE ...	10'
B. SECONDARY, FIBER OPTIC, CABLE TV AND TELEPHONE CABLE	5'
C. TRANSMISSION CONDUCTOR, VOLTAGE>26KV (NOT SHOWN) APPLICABLE IN SOME LOCATIONS	16.5'

2. ILLUSTRATION IS SHOWN FOR A TYPICAL 47' POLE, AND CLEARANCE AT THE POLE. ABOVE CRITERIA ALSO APPLY TO OTHER POLE HEIGHTS AND TO CONDUCTOR/WIRE TO TREE CLEARANCE ALONG THE SPAN

OVERHEAD DISTRIBUTION
NORTH & SOUTH DISTRIBUTION

3 PHASE DISTRIBUTION POWERLINE TREE CLEARANCE DIRECTIONAL PRUNING - DECIDUOUS

Seattle City Light

DR: A. EDENS	DATE: 05/10/2006	CLASS	L
CK: A Rg 5/10/06	APP: DBS 5-12-06	DRAWING NO.	TA-2001
SCALE NONE	REV. NO. 0		