



W/ CURB
NTS

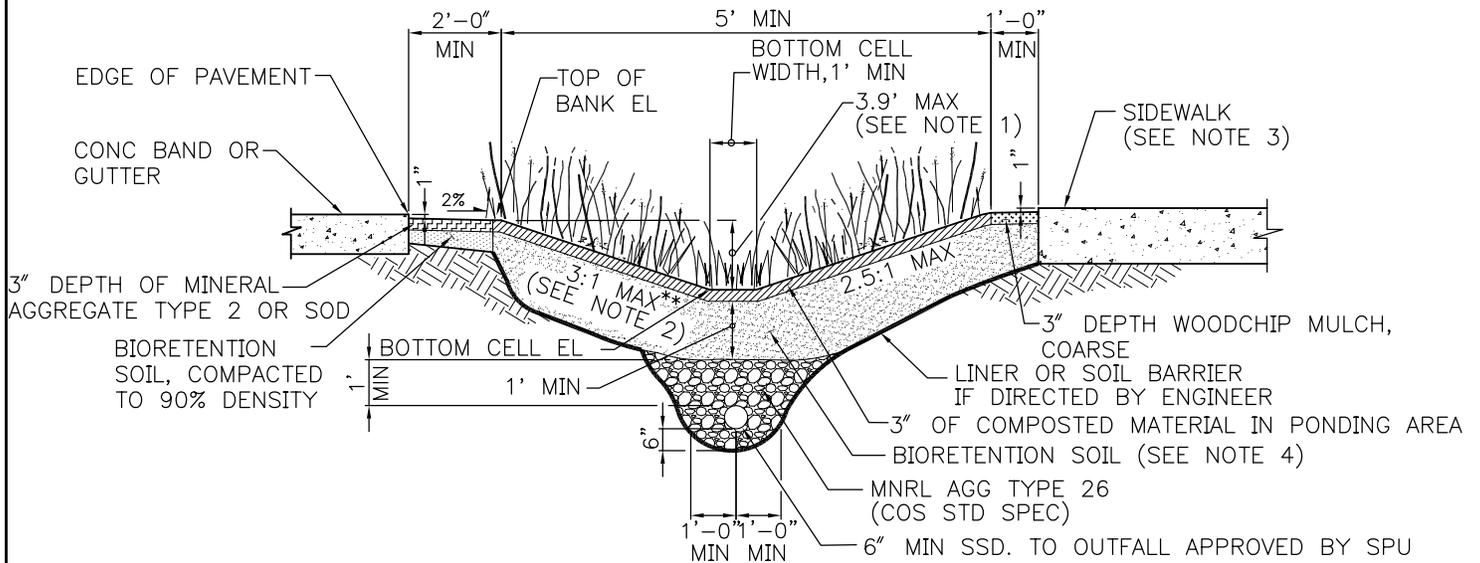

W/O CURB
NTS

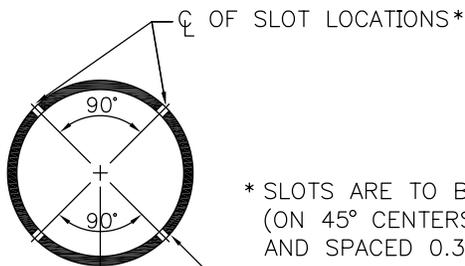

* SLOTS ARE TO BE 0.064" WIDE (ON 45° CENTERS) BY 1.0" LONG AND SPACED 0.3" APART.

PVC (6" MIN DIA) PER ASTM D1785, SCH 40

SSD SLOT DETAIL
NTS

NOTE:

1. DEPTH OVER 4' REQUIRES GUARD RAIL.
2. 4:1 MAX WHEN WITHIN 50- FEET OF INTERSECTIONS
3. SIDEWALK ELEVATION MUST BE SET ABOVE OVERFLOW ELEVATIONS.
4. SCARIFY SUBGRADE 3" MIN BEFORE BIORETENTION SOIL INSTALLATION.

APPLICATION OF THESE DETAILS REQUIRE APPROVAL FROM SDOT AND SPU.



**BIORETENTION, BIOFILTRATION
CELL W/UNDER DRAIN**

JANUARY 2010

FIGURE

6-16