



W/ CURB
NTS

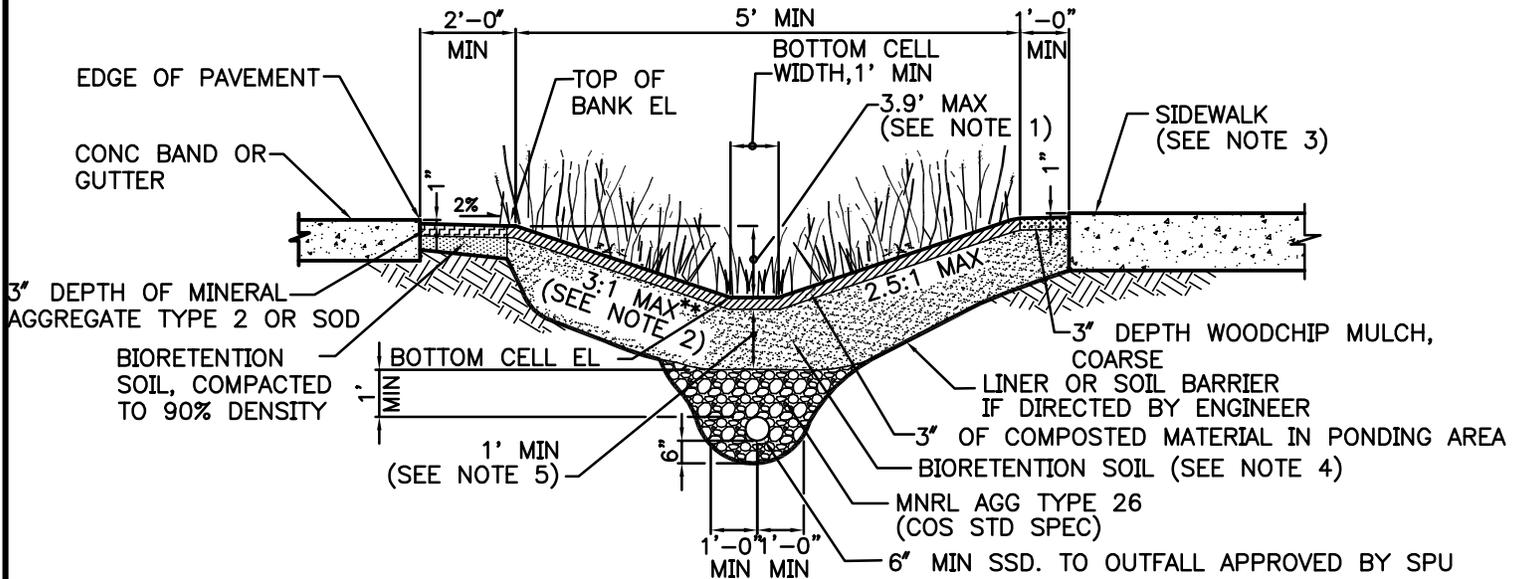

W/O CURB
NTS

- NOTE:
1. DEPTH OVER 4' REQUIRES GUARD RAIL.
 2. 4:1 MAX WHEN WITHIN 50- FEET OF INTERSECTIONS
 3. SIDEWALK ELEVATION MUST BE SET ABOVE OVERFLOW ELEVATIONS.
 4. SCARIFY SUBGRADE 3" MIN BEFORE BIORETENTION SOIL INSTALLATION.
 5. 1.5' MIN IF USED FOR WQ.

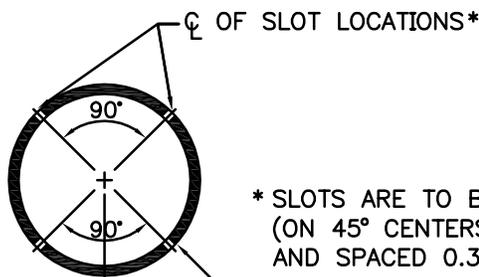

* SLOTS ARE TO BE 0.064" WIDE
(ON 45° CENTERS) BY 1.0' LONG
AND SPACED 0.3' APART.

PVC (6" MIN DIA) PER ASTM D1785, SCH 40

SSD SLOT DETAIL

NTS

APPLICATION OF THESE DETAILS REQUIRE APPROVAL FROM SDOT AND SPU.



**BIORETENTION, BIOFILTRATION
CELL W/UNDER DRAIN**

JANUARY 2010

FIGURE

6-16