


EXISTING POWER LINE  
CAUTION: POWER LINE MAY  
SAG 5-7 FT BETWEEN POLES

14' MINIMUM SCL POWER LINE SETBACK


EXISTING POWER POLE

EXISTING TELE/COMM LINE

EXISTING TELE/COMM LINE

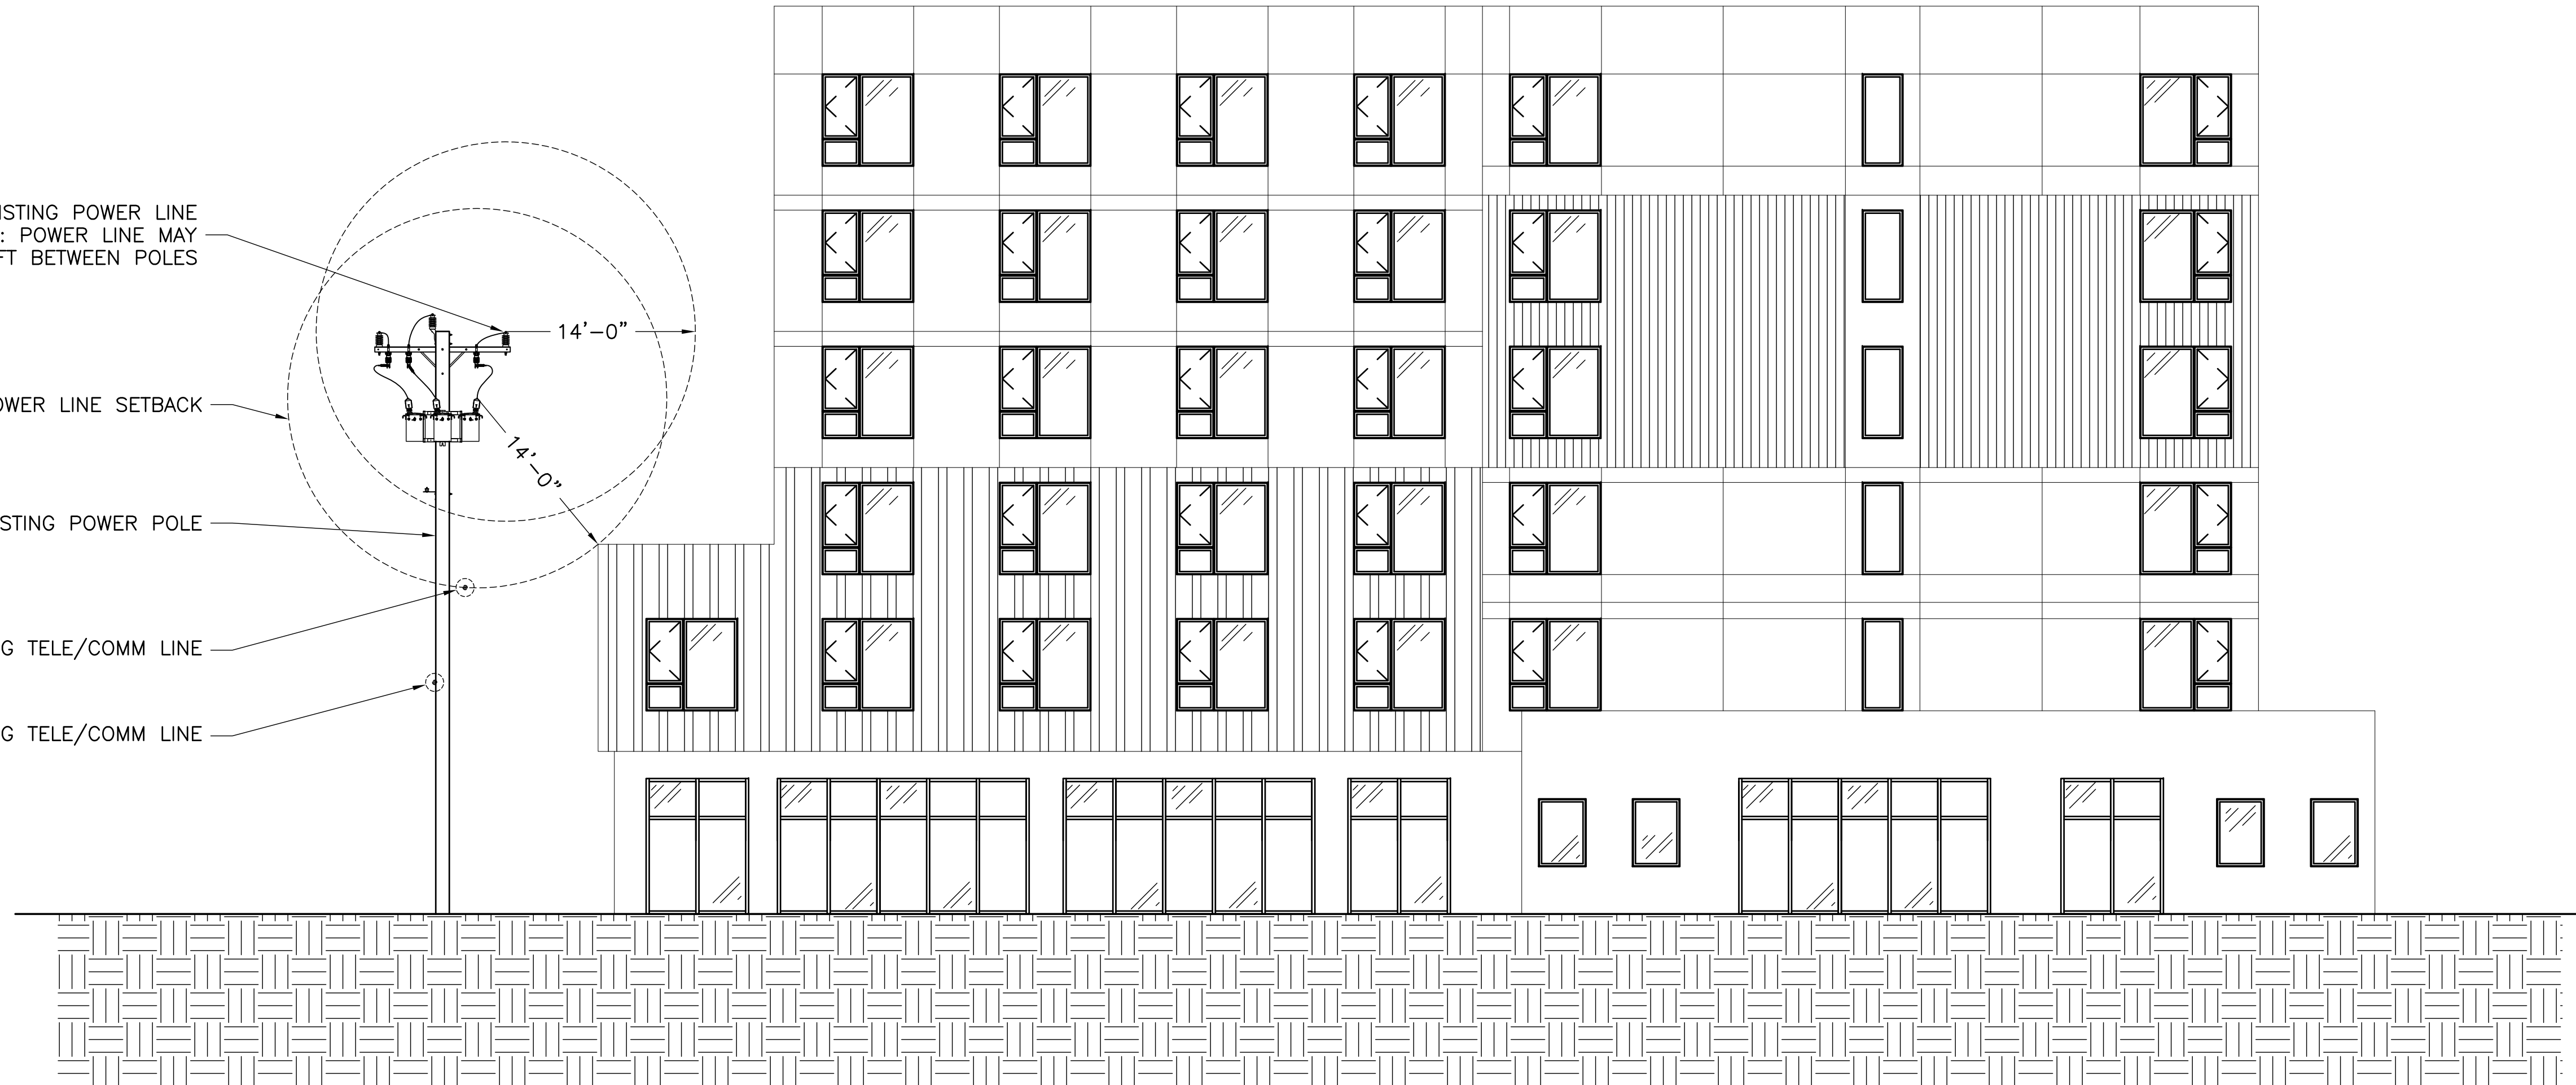

1 ELEVATION  
SCALE 1/8"=1'-0"

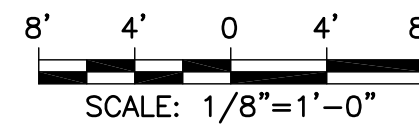

**CUSTOMER REQUIREMENTS**

DOCUMENT CHECKLIST:

CONSTRUCTION STANDARD D2-3

- SCALE BAR
- SURVEYED PROFILE DETAILING MINIMUM 14' CLEARANCE FROM NEAREST CITY LIGHT POWERLINE TO BUILDING STRUCTURE

ONE INCH AT FULL SIZE			
REVISIONS			
REV	DATE	IMAGE	
DRAWN BY: CHECKED BY: APPROVED BY:			
WORK ORDER #:			
DESCRIPTION			

THIS DRAWING IS THE PROPERTY OF THE CITY OF SEATTLE AND ITS SEATTLE CITY LIGHT DEPARTMENT. IT IS PRODUCED SOLELY FOR THE USE BY SEATTLE CITY LIGHT AND OTHER CITY DEPARTMENTS. THE USE, REPRODUCTION, AND TRANSFER OF THIS DRAWING AND/OR ANY INFORMATION CONTAINED IN THE DRAWING REQUIRES THE WRITTEN PERMISSION OF SEATTLE CITY LIGHT.

ENDORSEMENTS

SIGNATURE	DATE
DRAWN: CB	10/15/2017
CHECK:	
APPROVED:	



**Seattle City Light**  
Distribution Engineering

APPROVED FOR SEATTLE CITY LIGHT	
PROJECT ENGINEER	SHEET CONTENTS
QUARTERSECTION NUMBER(S)	SECTION / TOWNSHIP / RANGE

PROJECT TYPE	ELEVATION PLAN	SHEET	1 OF 1
PROJECT NAME		WORK ORDER NO.-TASK	
PROJECT ADDRESS		CITY	
		DRAWING NO.	REV. NO.
			0