


**IN-BUILDING VAULT DETAIL**  
SCALE 1/4"=1'-0"

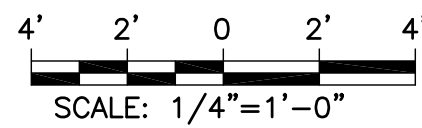

**CUSTOMER REQUIREMENTS**

DOCUMENT CHECKLIST:

CONSTRUCTION STANDARDS 0751.00 AND 0751.60

- PROPOSED VAULT ROOM DIMENSIONS
- DOOR LOCATION(S)
- PRIMARY CONDUIT ENTRANCE LOCATION
- SERVICE ENTRANCE BUS DUCT AND/OR SERVICE ENTRANCE CONDUIT LOCATION
- VENTILATION - INTAKE AND EXHAUST LOCATIONS
- PREFERRED LAYOUT SEE SCL 0751.60 FIG. 9a

ONE INCH AT FULL SIZE	<b>REVISIONS</b>	<small>THIS DRAWING IS THE PROPERTY OF THE CITY OF SEATTLE AND ITS SEATTLE CITY LIGHT DEPARTMENT. IT IS PRODUCED SOLELY FOR THE USE BY SEATTLE CITY LIGHT AND OTHER CITY DEPARTMENTS. THE USE, REPRODUCTION, AND TRANSFER OF THIS DRAWING AND/OR ANY INFORMATION CONTAINED IN THE DRAWING REQUIRES THE WRITTEN PERMISSION OF SEATTLE CITY LIGHT.</small>	<b>ENDORSEMENTS</b>		<b>Seattle City Light</b> Distribution Engineering	PROJECT TYPE	<b>IN-BUILDING VAULT DETAIL</b>	SHEET	<b>1 OF 1</b>
	REV		DATE	IMAGE		SIGNATURE	DATE	PROJECT NAME	
	DRAWN BY:	CHECKED BY:	APPROVED:	APPROVED FOR SEATTLE CITY LIGHT		PROJECT ADDRESS		CITY	
	WORK ORDER #:			PROJECT ENGINEER	SHEET CONTENTS			DRAWING NO.	REV. NO.
	DESCRIPTION			QUARTERSECTION NUMBER(S)	SECTION / TOWNSHIP / RANGE				<b>0</b>