

LITTLE SAIGON INTERNATIONAL

SPECIAL REVIEW DISTRICT



12th Avenue S. and S. Jackson


WATER BOTTLE BILLING STATION

BACKGROUND: SPU had a legacy drinking fountain (1 of 27) at this 12th S. and S. Jackson location in the Little Saigon neighborhood. This neighborhood is part of a broader historic/special review district in the Chinatown International District. The legacy fountain had been vandalized repeatedly and there is substantial outdoor activity in the vicinity. The Friends of Little Saigon and the Chinatown ID Business Improvement Area (CIDBIA) have requested replacing the legacy fountain with a working one.

REFILLABLE WATER STATIONS COMPARED TO LEGACY WATER FOUNTAINS: The water stations are freeze proof and don't have to be turned off for half the year. They're sturdier, they can facilitate filling reusable bottles, and the siting of the water refill stations can be done across various pressure zones, which can help serve an emergency preparedness function. Finally, maintenance is much easier and quicker for the water filling stations as compared to legacy drinking fountains

SPU EMERGENCY WATER ACCESS NETWORK: The EPA emergency manual includes creation of a water access network for preparedness. The water filling station will be one location in the water access network being developed. A water access network will serve SPU ratepayers and employees of SPU. Further, water refill stations will reduce the cost of water for ratepayers by reducing the need to purchase drinking water in an emergency. SPU water costs less than a penny a gallon. Bottled averages about \$1.50. Finally, the blue color and wrap image promotes SPU, the utility's clean water and the utility's solid waste reduction goals.

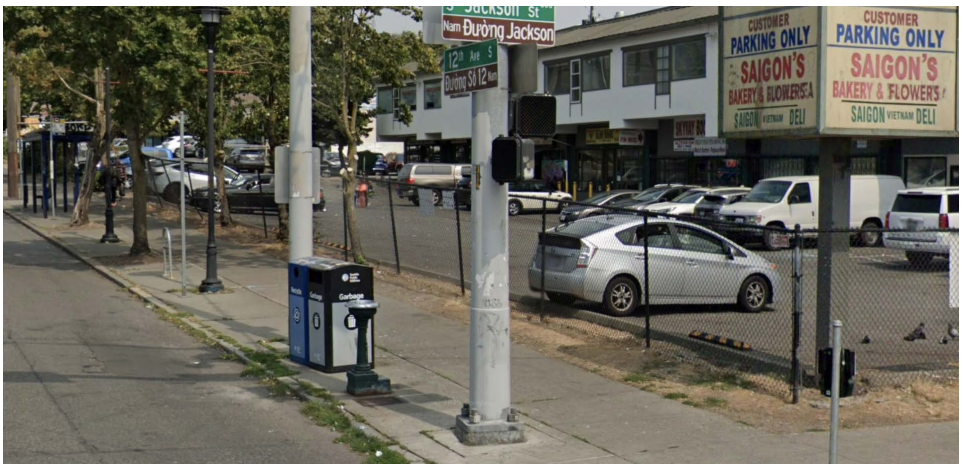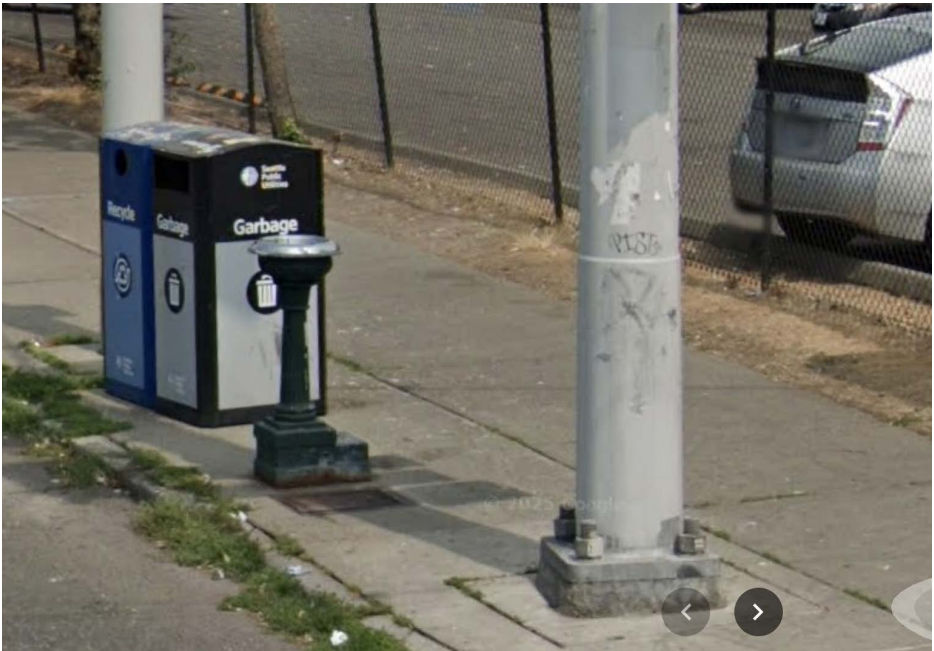

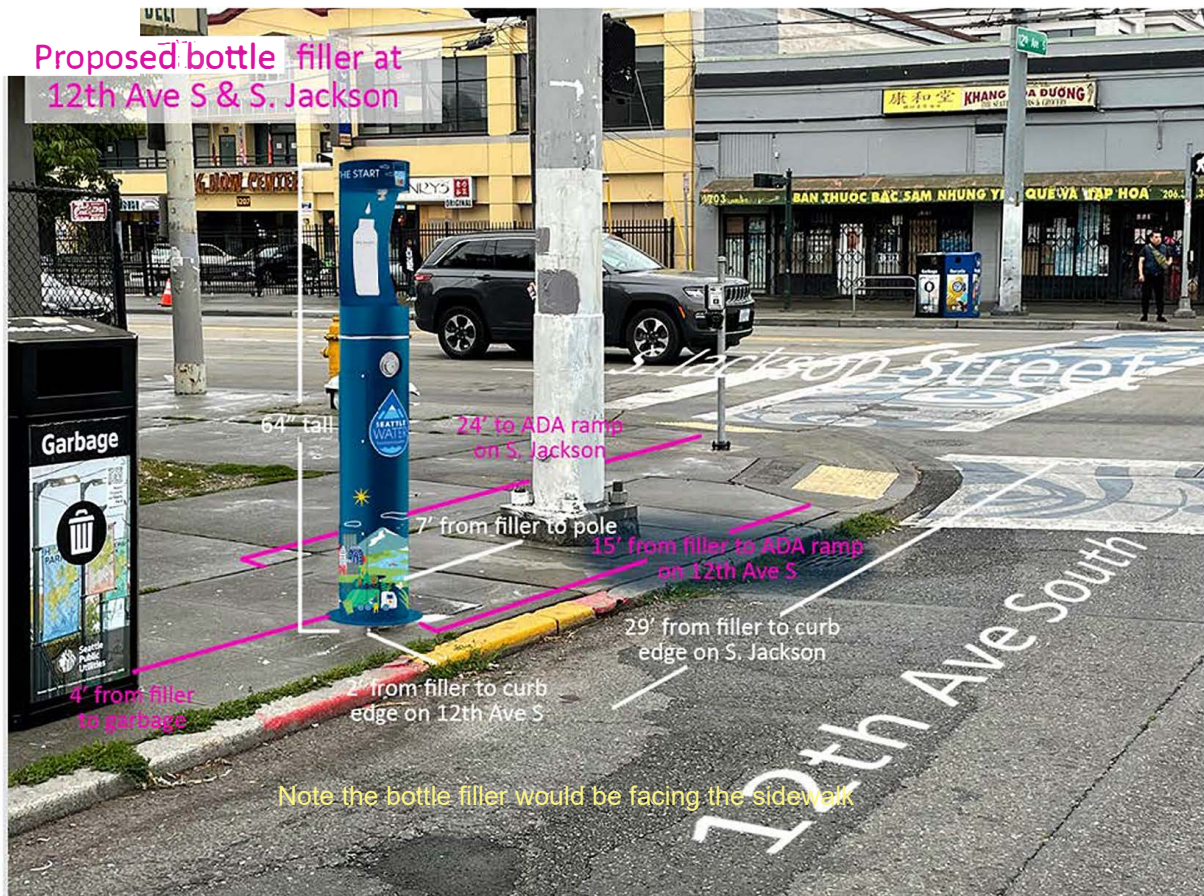



Note: This is an Artist's rendering of your product.
The actual product may vary in appearance.

NOTE: This Seattle Water droplet logo will be centered on the back side of the filling station.

NOTE: The blue background shown represents the metal surface of the filling station and does not print.



31.42" (798mm) circumference
10" (254mm) diameter



14 9/16"
(371mm)

44 1/16"
(1119mm)

PRODUCT SPECIFICATIONS

Outdoor ezH2O[®] Bottle Filling Station Pedestal Non-Filtered Non-Refrigerated. Features shall include Heavy Duty Vandal Resistant, Laminar Flow, 300 Series Stainless. Mechanical Button activation. Product shall be Floor Mount/Freestanding, for Outdoor applications, serving 1 station(s).

Special Features:	Heavy Duty Vandal Resistant, Laminar Flow, 300 Series Stainless
Finish:	Black (BK), Blue (BLU), Evergreen (EVG), Gray (GRY)
Power:	No Electrical Required
Bubbler Style:	No Bubbler
Activation by:	Mechanical Button
Mounting Type:	Floor Mount/Freestanding
Chilling Capacity:	Non-refrigerated
Dimensions (L x W x H):	14" x 14" x 64"
Approx. Shipping Weight:	179 lbs.
Installation Location**:	Outdoor
No. of Stations Served:	1

**When used in non-temperature controlled environments, unit(s) must be adequately winterized and/or protected from extreme heat to prevent damage where climates dictate.

Special Note: To meet the full requirements for ADA please choose LK4430BF1L for adult installations and LK4430BF1M for child ADA. Bottle Filler Stations-1, Choose from 4 color options

- Mechanically-Activated unit continues to supply water in event of service disruptions.
- Laminar flow provides clean fill with minimal splash.



Included with Product: Outdoor Bottle Filler
Ships in one box.

A Century of Tradition and Quality. For more than 100 years, Elkay has been making innovative products and providing exceptional customer care. We take pride in offering plumbing products that make life easier, inspire change and leave the world a better place.



PRODUCT COMPLIANCE

ADA & ICC A117.1

GreenSpec[®]

NSF/ANSI 61 (Q≤1) & 372 (lead free)

NSF REG4



Complies with ADA & ICC A117.1 accessibility requirements when installed according to the requirements outlined in these standards. Installation may require additional components and/or construction features to be fully compliant. Consult the local Authority Having Jurisdiction if necessary.

[Installation Instructions \(PDF\) - 1000003952](#)

Warranty pertains to drinking water applications only. Non-drinking water applications are not covered under warranty.

[Warranty \(PDF\)](#)

PART: _____ QTY: _____

PROJECT: _____

CONTACT: _____

DATE: _____

NOTES: _____

APPROVAL: _____

In keeping with our policy of continuing product improvement, Elkay reserves the right to change product specifications without notice. Please visit elkay.com for the most current version of Elkay product specification sheets. This specification describes an Elkay product with design, quality, and functional benefits to the user. When making a comparison of other producers' offerings, be certain these features are not overlooked.

Optional Accessories		
97890C	Accessory - Direct Bury Adaptor Spec Sheet (PDF)	
4481FP	Outdoor Bottle Filler Foot Pedal Accessory Spec Sheet (PDF)	

In keeping with our policy of continuing product improvement, Elkay reserves the right to change product specifications without notice. Please visit [elkay.com](#) for the most current version of Elkay product specification sheets. This specification describes an Elkay product with design, quality, and functional benefits to the user. When making a comparison of other producers' offerings, be certain these features are not overlooked.

MOUNTING INSTRUCTIONS and PLUMBING CONNECTIONS

Refer to diagrams for plumbing rough-in. Provide solid, well-drained smooth, flat, finished surface to mount pedestal fountain (concrete pad recommended) with adequate support (300 lb. load minimum). To secure unit, use (6) 3/8" minimum fasteners (not provided).

A service supply stop must be installed at the fountain inlet line.


Trap and service stop not included.

Position pedestal over plumbing and secure base to fasteners. Remove access panels and connect supply and water lines. Turn on water supply and check for leaks. Refer to owner's manual for detailed instructions. Reassemble access panels to pedestal.


OPERATING PRESSURES:

Supply water 20 – 105 psi maximum

TOP VIEW

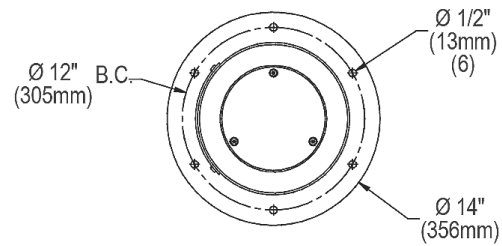

SIDE & FRONT VIEWS

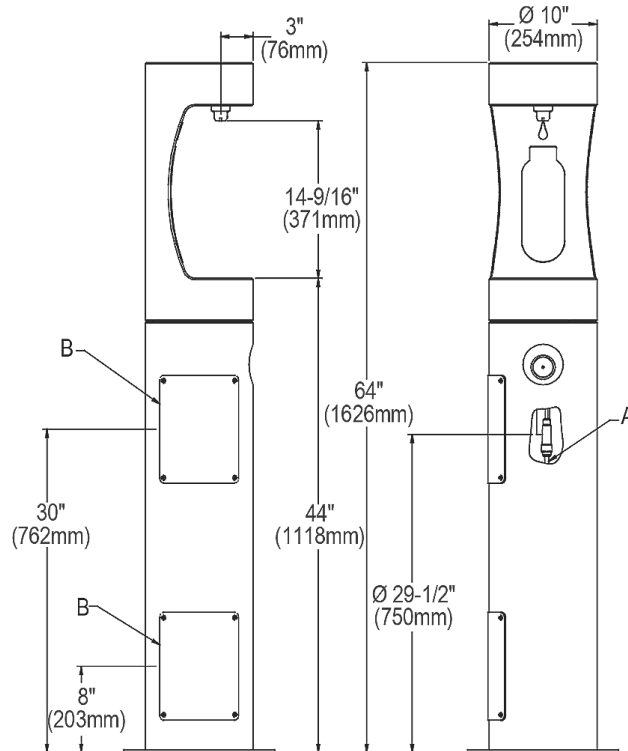

A = 3/8" O.D. Unplated copper tube connect. Shut off valve by others.

B = Access panel(8" x 10")

Note : New Installations Must Use Ground Fault Circuit Interrupter (GFCI).

In keeping with our policy of continuing product improvement, Elkay reserves the right to change product specifications without notice. Please visit elkay.com for the most current version of Elkay product specification sheets. This specification describes an Elkay product with design, quality, and functional benefits to the user. When making a comparison of other producers' offerings, be certain these features are not overlooked.



I hereby affirm that I am the owner of the property located at:

Property Street Address: Northeast corner of 12th Ave. S. and S. Jackson St., in the right of way in front of the property with the address of 1200 S. Jackson

City, State: Seattle, WA

Zip Code: 98104

By signing below, I (the property owner) verify that I have reviewed the proposed project and authorize the individual identified in the following section to act as my authorized agent with regard to the Certificate of Approval Application (including requests for early guidance/project briefings) made to City of Seattle's Historic Preservation Program for the project described below.

Project/Activity for which Application is being made: SPU intends to install a Water Refill Station at 12th and Jackson at the location of a decommissioned out of service fountain. SPU would like to install it at this location to fulfill a community request from Friends of Little Saigon and Chinatown-International District Business Improvement Area (CIDBIA) and to serve ratepayers in the following ways a) contributing an asset to a new water access network for preparedness in accordance with the EPA emergency manual, b) reducing the cost of water for ratepayers by reducing the need to purchase drinking water. Bottled water can cost up to 1,000x what tap water costs. Our tap water runs less than a penny a gallon; bottled averages about \$1.50, and c) informing them about SPU's great water quality and solid waste reduction goals.

Property Owner Printed Name: Seattle Department of Transportation

Property Owner Mailing Address: PO Box 34996

City, State: Seattle, WA

Zip Code: 98124-4996

Property Owner Email Address: 684-Road@seattle.gov

Signature of Building/Property Owner:

Date:


Joel Miller (08/27/2026 17:49:51 PDT)

Permit Applicant/Owner's Authorized Agent Printed Name: Lisa Herbold OB Seattle Public Utilities

Applicant/Agent Mailing Address: 700 5th Avenue, Suite 4900

City, State: Seattle, WA

Zip Code: 98104

Applicant/Agent Email Address: lisa.herbold@seattle.gov

Signature of Applicant/Agent:



8/28/2026