



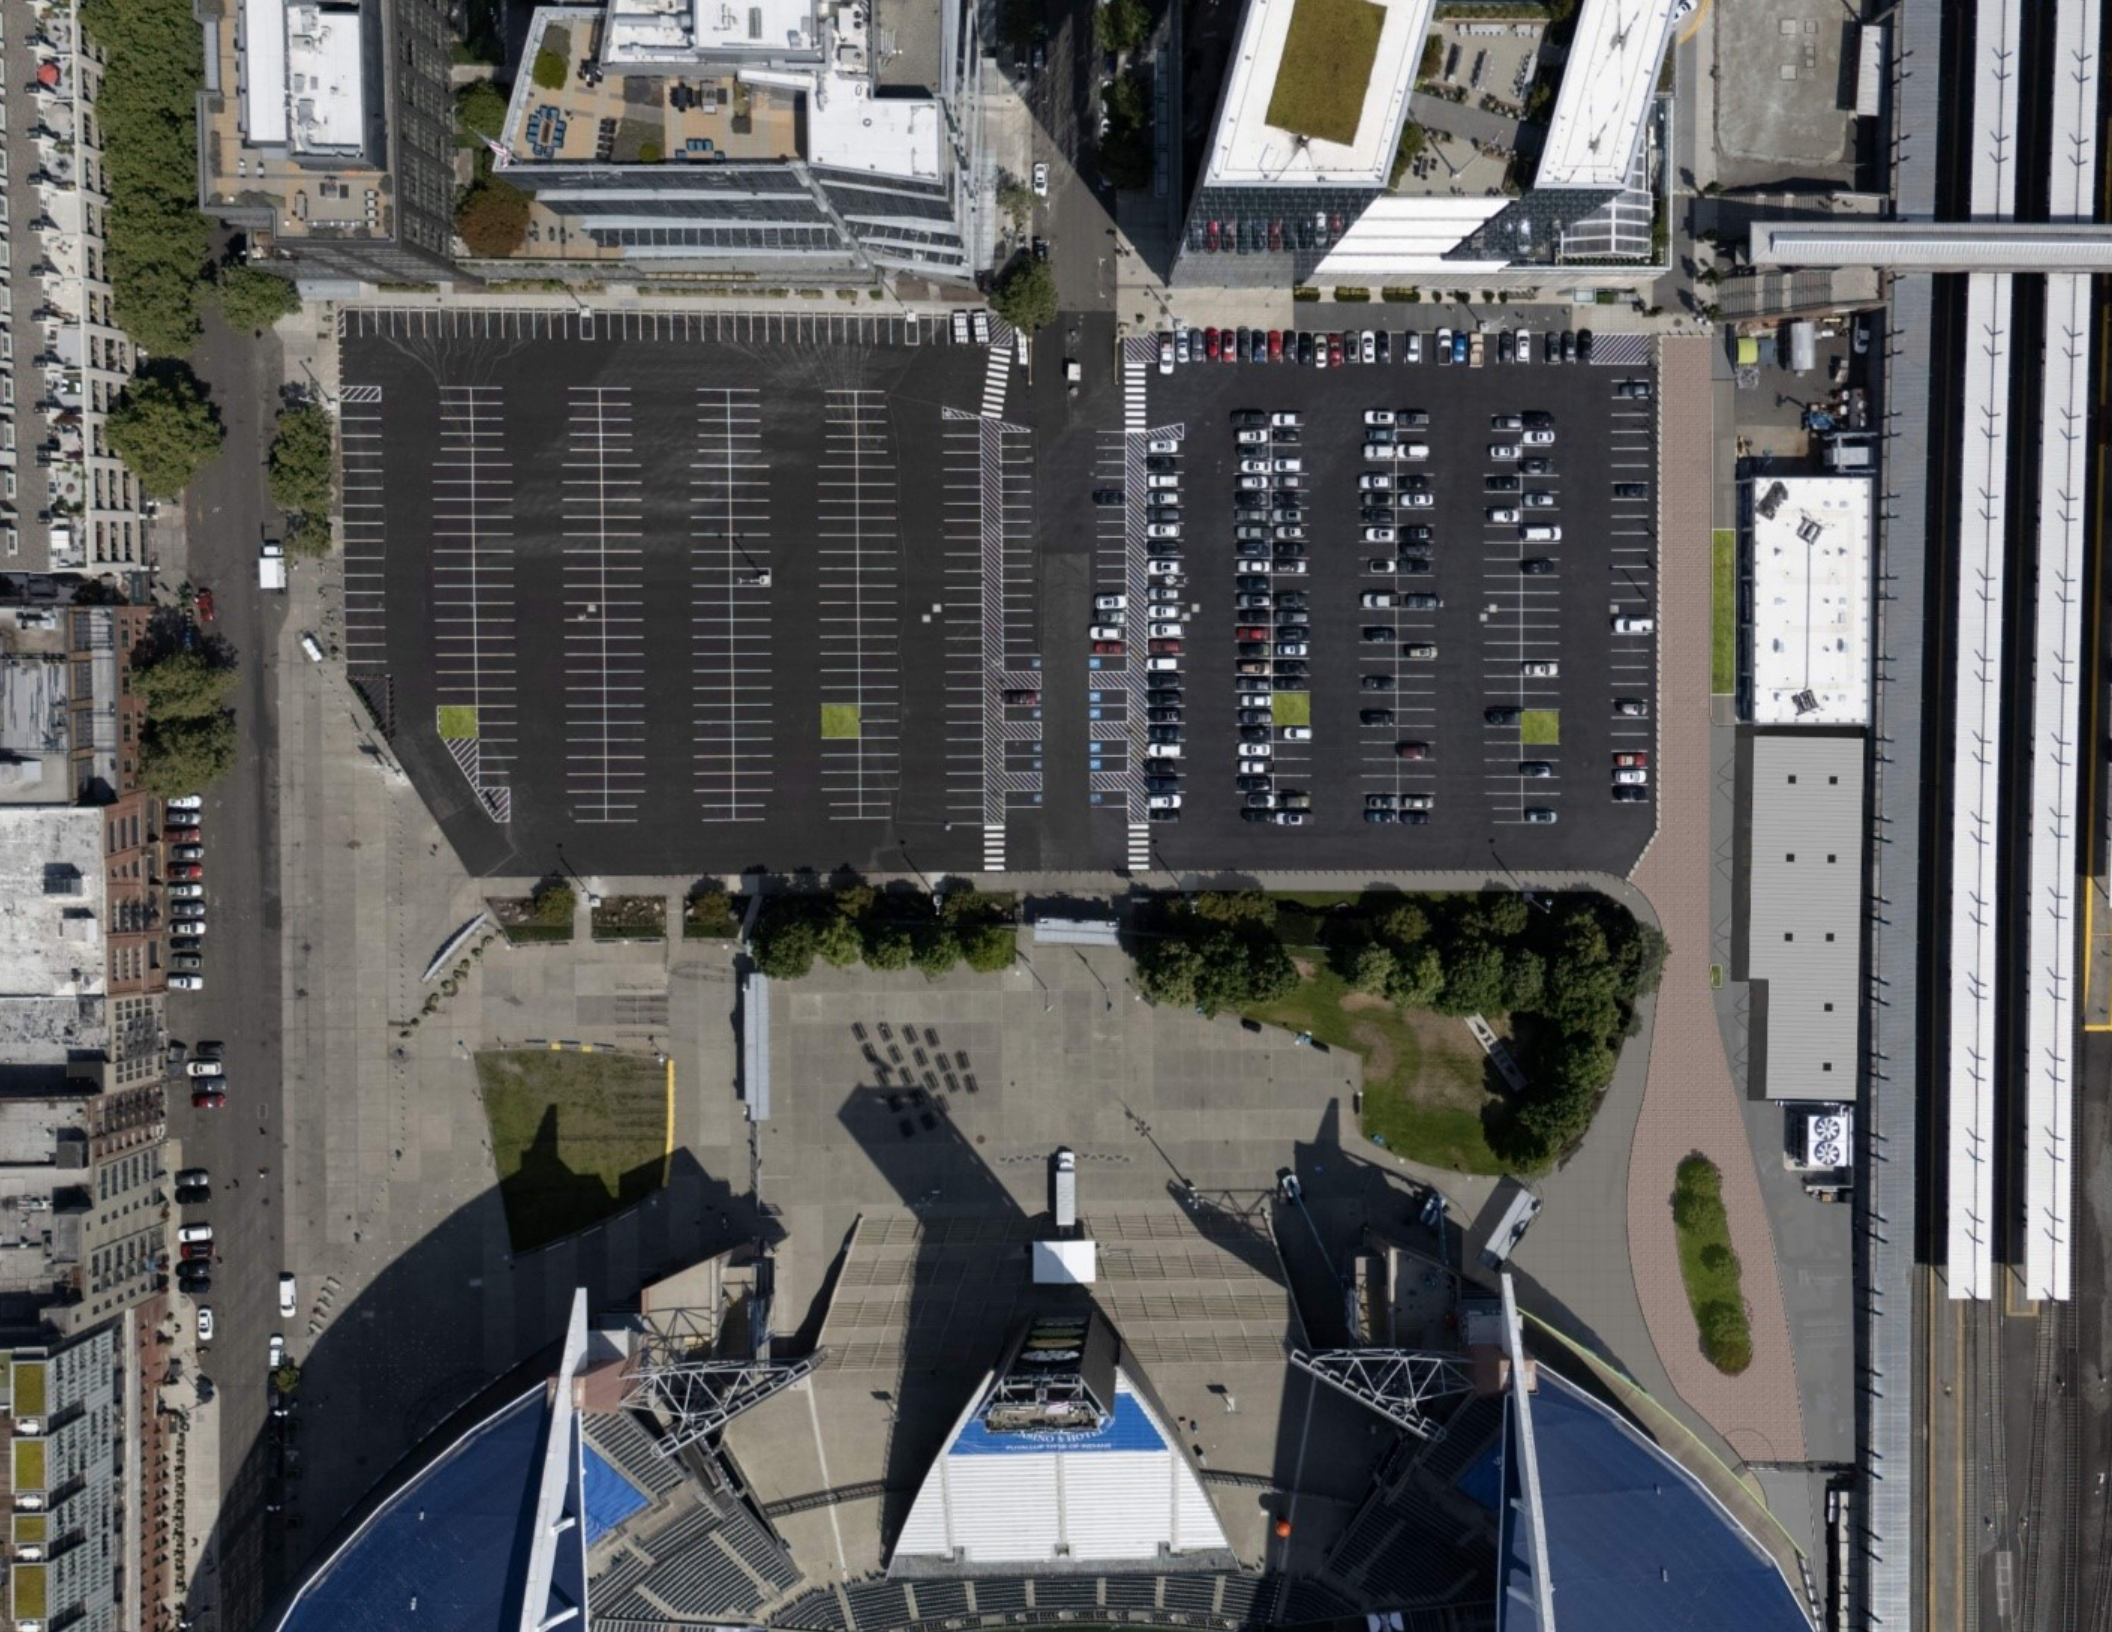

SITE PLAN

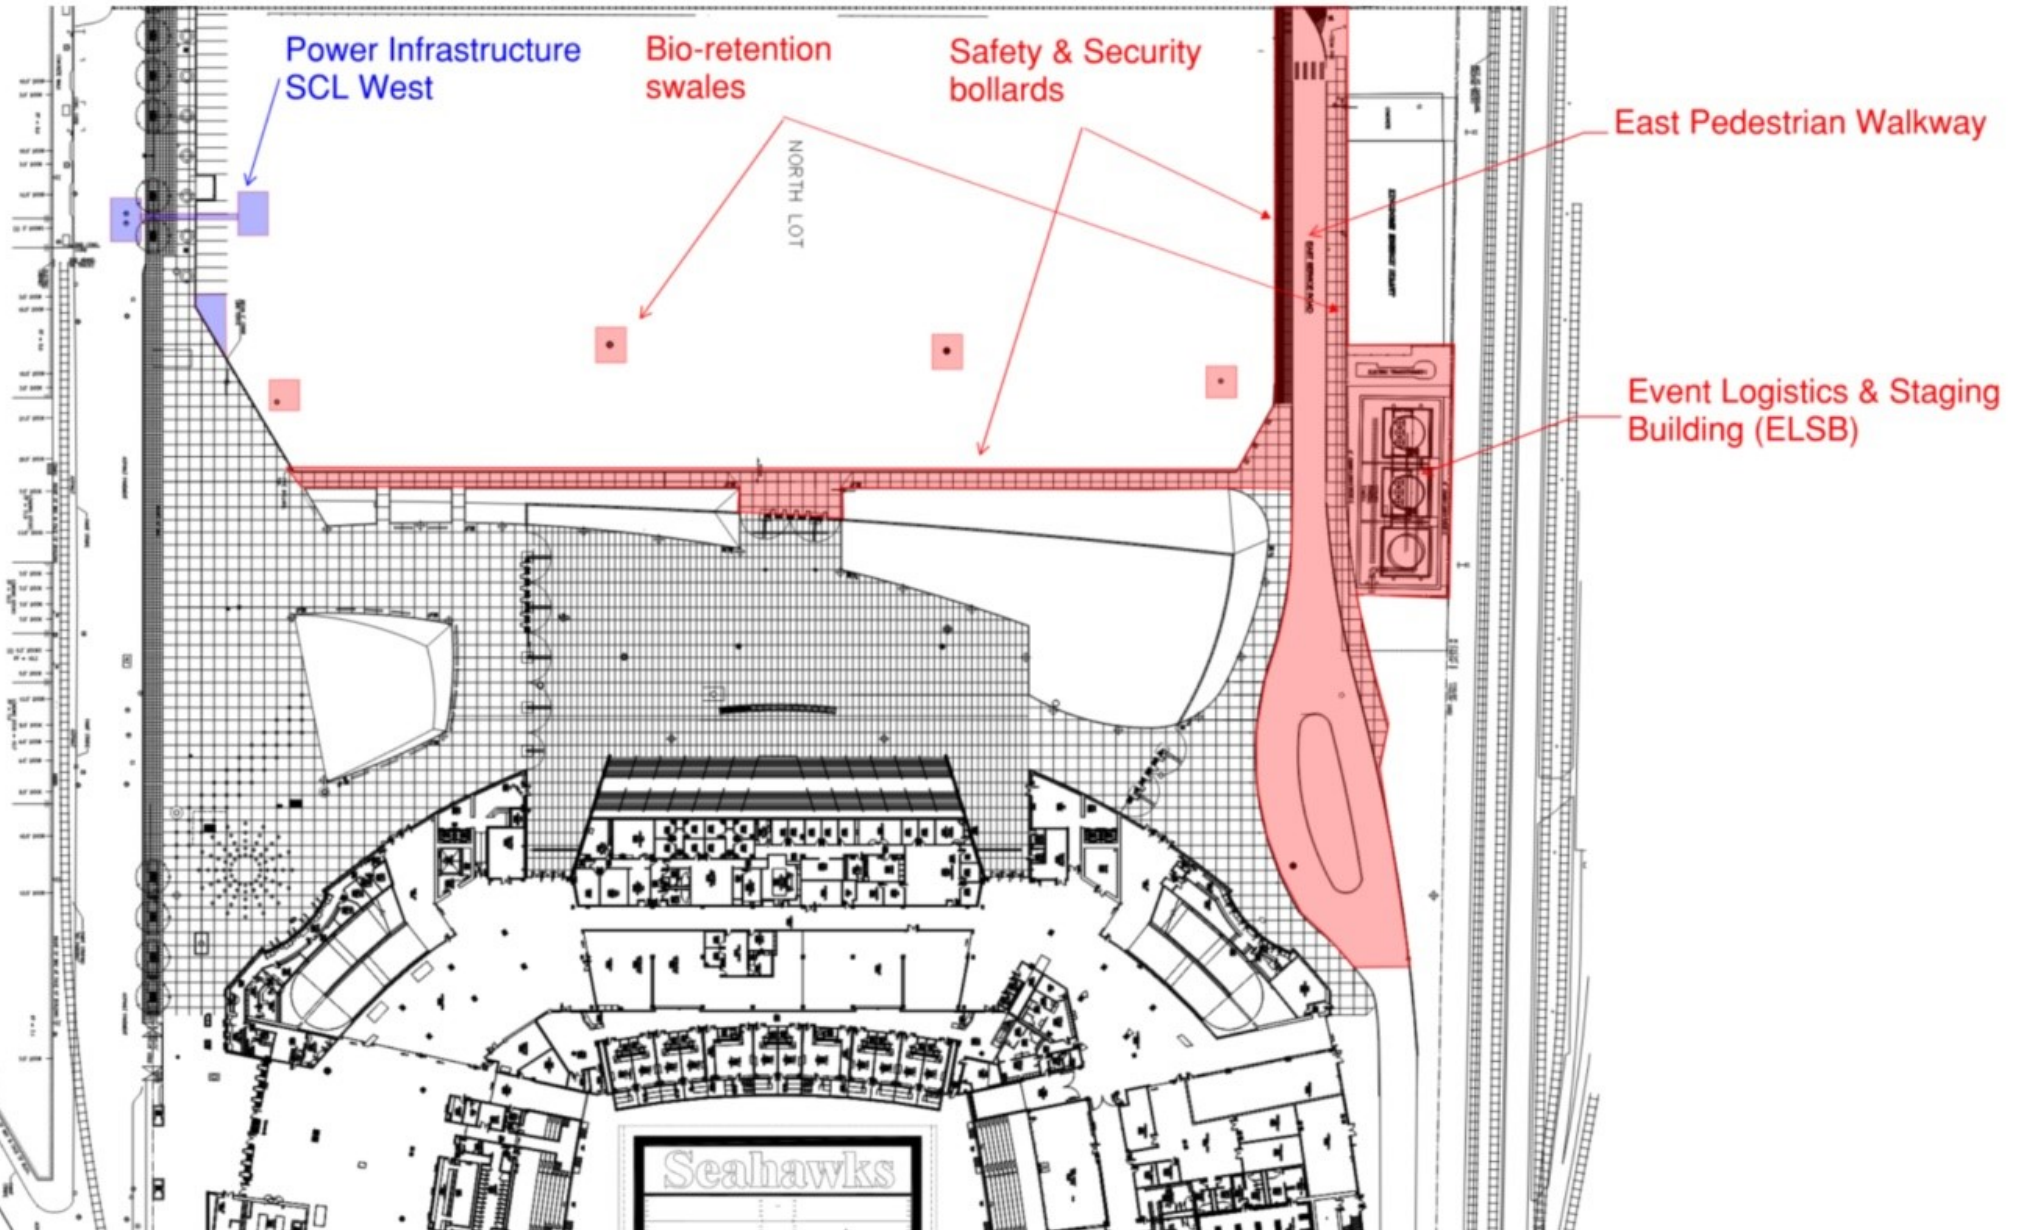

FGI Preservation Board Application July 2025

Event Logistics & Staging Building and Site Improvements

Background

The Kingdome (officially known as King County Stadium) was a multipurpose facility from March 1976 to March 2000. Upon its demolition on March 26, 2000, a new era of stadium and event space was designed and what is known today as Lumen Field and Event Center was built. The Kingdome and Lumen Field share the same approximate footprint.

After the Kingdome was razed, its HVAC cooling towers were decommissioned and left in place. In December 2024, First & Goal Inc. sought authority from the Pioneer Square Preservation Board to demolish the old towers and make way for a usage that meets current and future operational needs. This authority was granted in Certificate of Approval DONH-COA-01553.

The Project

This project proposes the construction of a new, single level Event Logistics and Staging Building (ELSB). The proposed metal structure is approximately 9,000 square feet, with CMU masonry-clad siding on the north, south and east sides, and a sloped metal roof. The highest portion of the building will be twenty-one feet (21') tall. The structure will be roughly the same height as the adjacent Annex building roof and fourteen feet (14') shorter than the soon-to-be demolished Kingdome cooling towers that stand at thirty-five feet (35'). This building will meet critical staging and logistics space needs when we host FIFA World Cup 2026 as well as into the future as we transition between approximately 200 events per year.

We are also proposing a series of adjacent environmental, beautification, and safety site improvements. The most visible is a new, clearly marked pedestrian corridor to enhance wayfinding and safety during ingress and egress to and from major stadium events. This new passageway will be identifiable as a stamped asphalt, terra cotta-colored path that is approximately five hundred feet (500') in length and averages twenty-five feet (25') across, leading from the base of the Weller Street Bridge to Stadium Gate 1. In the event of an emergency, this corridor can also be used as a first responder emergency vehicle access route. During non-event days, this same path will be used for operational stadium vehicle movement.

The final site improvements include safety and security bollards that will be installed along the south and east perimeters of the North Lot to protect pedestrians as they move about the facility exterior. The sidewalks will be replaced in these areas where the new bollards are installed. Stormwater bio-retention swales will be installed along the east edge and under the North Lot to accommodate stormwater impacts from the new improvements.¹ The swales will incorporate plantings/vegetation in compliance with SDCI and SPU stormwater Directors' Rules 10-2021 & DWW-200.

¹ A bioretention swale is a vegetated channel designed to manage stormwater runoff by filtering it through a soil mix, vegetation, and an underdrain system.

Existing Conditions & Future Renderings



*Current overview from right to left: 1. New Fluid Cooling Towers per DONH-COA-01552; 2. Decommissioned Towers to be demolished per DONH-COA-01553 **and** the proposed site for the EL SB; 3. Existing Annex.*



Current view of decommissioned towers and future ELSB location.



Rendering of ELSB, new paved walkway, and eastern bollards.



Current view of eastern access driveway and Stadium Annex.



Rendering of existing annex, new stamped asphalt walkway, bio-retention swales, and bollards.




The bollard style we have selected for the project has a tapered top, a stainless-steel sleeve, and stands at a height of forty-two inches (42"). See details in permit drawings. Photo is for illustrative purposes only.



The fencing selected to run in front of the ELSB will be a black, 'no climb' style that matches the adjacent BNSF Railroad property fencing. It will stand eight feet tall (8'). Photo is for illustrative purposes only.

Event Logistics and Staging Building + Pedestrian Pathway

Color Samples for ELSB


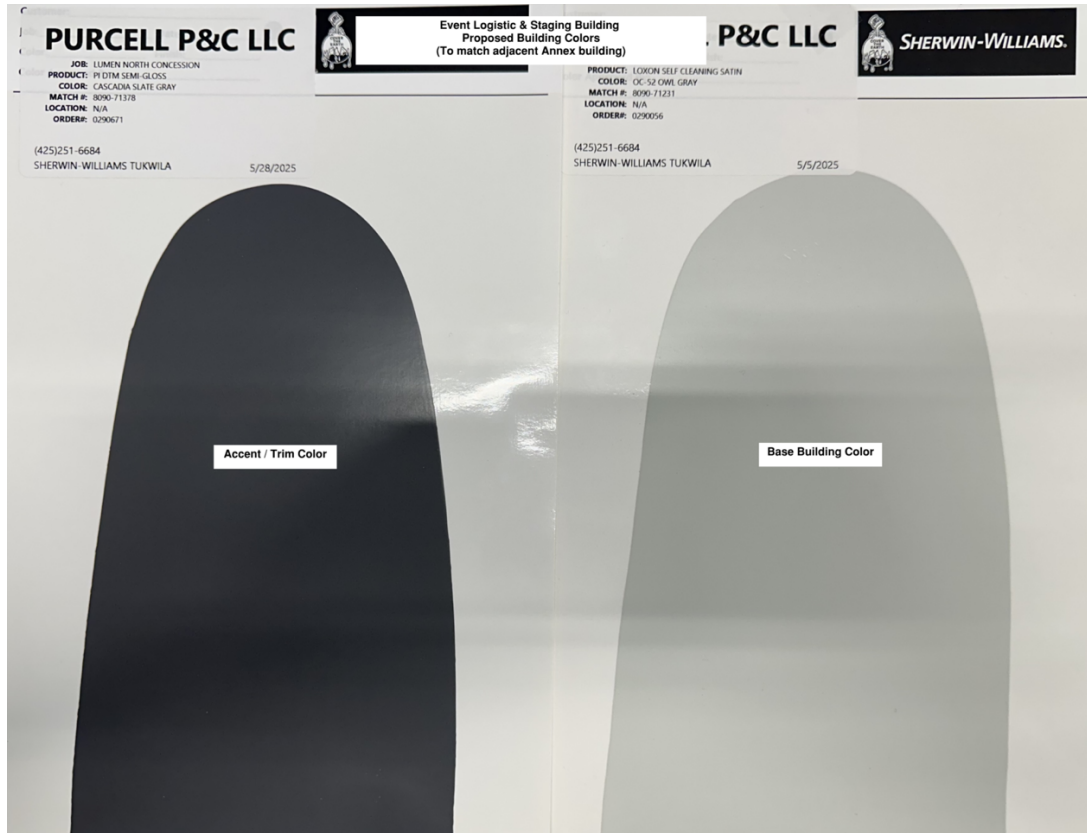


The Event Logistics and Staging building base color is proposed as Owl Gray. The trim and metal roof are Cascadia Slate Gray. These are the **same** colors as the adjacent Annex building shown below.



Event Logistics and Staging Building + Pedestrian Pathway

The new Pedestrian Pathway is designed to be stamped in a British Cobble pattern and is proposed to be the color Terra Cotta per the images below.

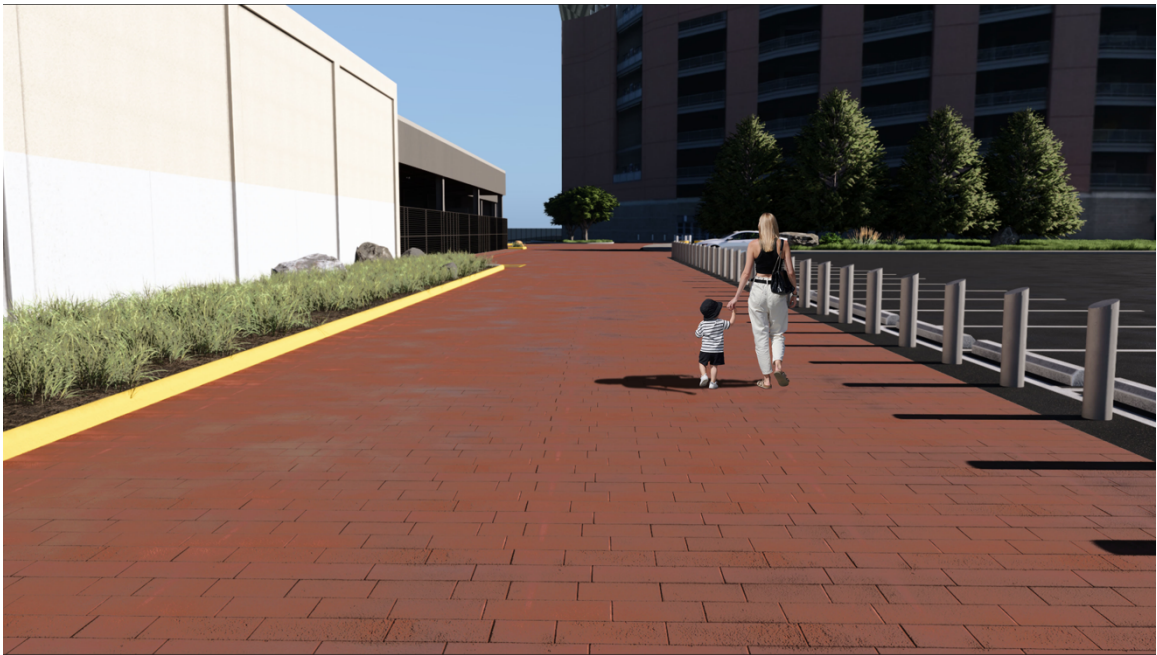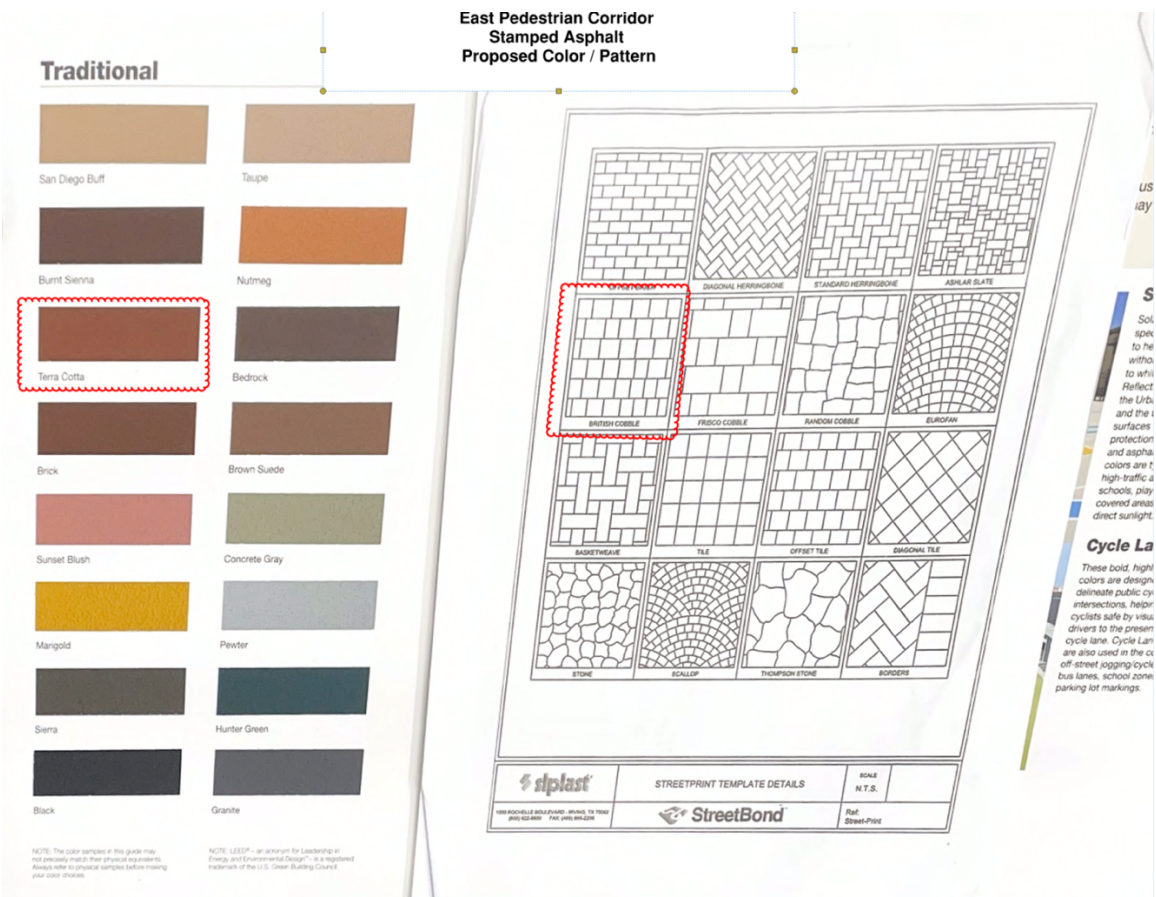



RENDERING



VICINITY / LOCATION MAP

LUMEN FIELD EVENT LOGISTICS & STAGING BUILDING (ELSB)

FIFA UPGRADES - WORLD CUP 2026
LUMEN FIELD

800 OCCIDENTAL AVE S
SEATTLE, WA 98134

PERMIT SET
JUNE 26, 2025


2021 SEATTLE BUILDING CODE (SBC)

CONSTRUCTION TYPE = TYPE V-B, NON-RATED, NON-SPRINKLED
OCCUPANCY = GROUP S-1
SEPARATION OF ELSB FROM ANNEX BUILDING = 5'-0" MIN.
EXISTING SOUTH ANNEX BUILDING WALL = 1 HR RATED
• PER TABLE 705.8, 25% OPENINGS ALLOWED, ONE 45 MIN. RATED DOOR PROVIDED.
NEW NORTH ELSB WALL = 2 HR RATED
NEW ELSB ROOF = NOT RATED

SHEET INDEX

Sheet Number	Sheet Name
G000	COVER SHEET
G001	GENERAL NOTES
G002	SPECIFICATIONS
C001	LEGEND, ABBREVIATIONS, & DRAWING LIST
C002	NOTES
C003	GENERAL KEY PLAN
C101	TEMPORARY EROSION & SEDIMENT CONTROL PLAN
C102	TEMPORARY EROSION & SEDIMENT CONTROL PLAN
C201	SITE DEMOLITION PLAN
C202	SITE DEMOLITION PLAN
C301	SITE & PAVING PLAN
C302	SITE & PAVING PLAN
C401	GRADING PLAN
C402	GRADING PLAN
C501	STORM DRAIN PLAN
C502	STORM DRAIN PLAN
C601	WATER & SEWER PLAN
C602	WATER & SEWER PLAN
C801	SECTIONS & DETAILS
C802	SECTIONS & DETAILS
C803	SECTIONS & DETAILS
C804	SECTIONS & DETAILS
C805	SECTIONS & DETAILS
C811	ONSITE STORMWATER MANAGEMENT PLAN
S000	STRUCTURAL TITLE SHEET
S010	GENERAL NOTES
S011	GENERAL NOTES
S100	FOUNDATION PLAN
S101	FOUNDATION MILD REINFORCING
S102	ROOF PLAN
S300	CONCRETE SECTIONS & DETAILS
S301	CONCRETE SECTIONS & DETAILS
S302	CONCRETE SECTIONS & DETAILS
S303	CONCRETE SECTIONS & DETAILS
S400	MASONRY SECTIONS & DETAILS
S500	STEEL SECTIONS & DETAILS
S501	STEEL SECTIONS & DETAILS
A025	ARCHITECTURAL SITE PLAN
A026	ENLARGED ARCH. SITE PLAN
A050	EDGE OF SLAB PLAN
A100	ARCHITECTURAL PLANS
A200	ARCHITECTURAL ELEVATIONS
A300	ARCHITECTURAL SECTIONS
A400	FOOTING & FOUNDATION DETAILS
A401	WALL / ROOF DETAILS
A402	SKYLIGHT DETAILS

BUUV - FIRE RESISTANCE RATINGS - ANSI/UL 263
BUUV7 - FIRE RESISTANCE RATINGS - CANULC-S101 CERTIFIED FOR CANADA
DESIGN NO. U906
SEPTEMBER 11, 2015
BEARING WALL RATING - 2 HR
NONBEARING WALL RATING - 2 HR
This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used - See Guide BXUV or BXUV7.
*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

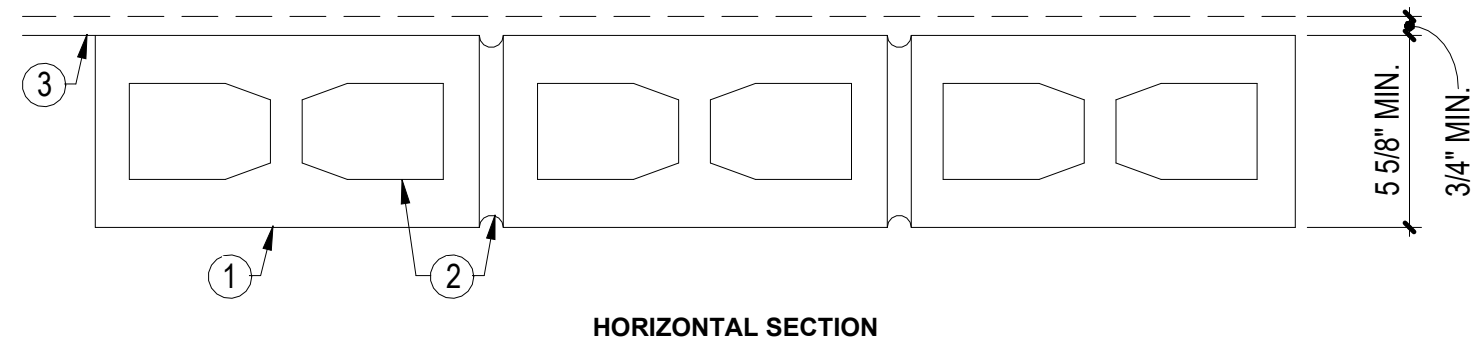

- 1. CONCRETE BLOCKS*** - Nominal 8 by 8 by 16 inches, hollow or solid. Various designs. Classification (2 hr). See CONCRETE BLOCKS category for list of eligible manufacturers.
- ANCHOR CONCRETE PRODUCTS, INC.
 - GAGNE & SON CONCRETE BLOCK, INC.
 - GLENWOOD MASONRY PRODUCTS
- Allowable compressive stress of 57% of maximum allowable compressive stress in accordance with the empirical design method.
- OLDCASTLE APG SOUTH, INC.
 - DBA ADAMS PRODUCTS
 - WESTBROOK CONCRETE BLOCK CO., INC.
- Allowable compressive stress of 75.6% of maximum allowable compressive stress in accordance with the empirical design method.
- 2. MORTAR** - Blocks laid in full bed of mortar, nominal 3/8" thick, of not less than 2 1/4" and not more than 3 1/2" pas of clean sharp sand to one part Portland cement (proportioned by volume) and not more than 50% hydrated lime (by cement volume). Vertical joints staggered.
- 3. PORTLAND CEMENT STUCCO OR GYPSUM PLASTER** - Add 1/2 hour to classification if used. Attached to concrete blocks (Item 1).
- 4. FOAMED PLASTIC*** - (OPTIONAL, NOT SHOWN) - 1 1/2" thick maximum, 4'- 0" wide sheathing attached to concrete blocks (Item 1).
- ATLAS ROOFING CORP. - "ENERGYSHIELD PRO WALL INSULATION" AND "ENERGYSHIELD PRO 2 WALL INSULATION"
 - CARLISLE COATINGS & WATERPROOFING, INC. - TYPE R2+ SHEATH
 - HUNTER PANELS - TYPES XCI-CLASS A, XCI 286
 - RMX OPERATING, LLC - "TSX-8500", "TSX-8510", "THERMASHEATH-XP", "EXOMAXCI", "THERMASHEATH-3", "DURASHEATH-3"
 - THE DOW CHEMICAL CO. - TYPES THERMAX SHEATHING, THERMAX LIGHT DUTY INSULATION, THERMAX HEAVY DUTY INSULATION, THERMAX METAL BUILDING BOARD, THERMAX WHITE FINISH INSULATION, THERMAX CI EXTERIOR INSULATION, THERMAX XARMOR CI EXTERIOR INSULATION, THERMAX IH INSULATION, THERMAX PLUS LINER PANEL, THERMAX HEAVY DUTY PLUS (HDP), AND TUFF-R CI™ INSULATION
- 4A. BUILDING UNITS** - As an alternat to Item 5, minimum 1" thick polyisocyanurate composite foamed plastic insulation boards, nom. 48" by 48" or 96".
- RMX OPERATING, LLC - "THERMASHEATH-SI", "ECOBASECI", "THERMABASE-CI"
- *Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.


2 HR WALL UL LISTING N.T.S.	
AB	Anchor bolt
ACOU	Acoustical
AD	Area Drain
ADJ	Adjustable/Adjacent
ADH	Adhesive
AFF	Above Finish Floor
ALUM	Aluminum
ALT	Alternate
APPROX	Approximate(ly)
APPO	Approved
ATTEN	Attenuation
BEY	Beyond
BD	Board
BLDG	Building
BLK	Block
BLKG	Blocking
BM	Bench Mark
BO	By Others
BOT	Bottom (of)
BRG	Bearing
BRKT	Bracket
BSD	Bar Soap Dish
BMT	Basement
BTWN	Between
BUR	Built-up-Roof
CABT	Cabinet
CB	Chalkboard
CC	Center to Center
CEM	Cement (itious)
CFM	Cubic feet per minute
CH	Cost Hook
CH	Cast Iron
CJ	Control Joint
CLG	Ceiling
CLR	Clear
CMP	Corrugate Metal Pipe
CO	Cleanout
COL	Column
COMB	Combination
CONC	Concrete
CONN	Conned (ion)
CONT	Continuous
CONTR	Construction
CORR	Corridor
CLRM	Classroom
CSK	Countersunk
CT	Ceramic Tile
CTG	Coating
CTR	Center
CY	Cubic Yard (s)
D	Drinking Fountain
DIA	Diameter
DIAG	Diagonal
DIM	Dimension (s)
DN	Down
DR	Door
DS	Downspout
DWG	Drawing
E	East
EA	Each
EDF	Electric Drinking Fountain
EF	Each Face
EJ	Expansion Joint
EHD	Electric Hand Dryer
ELEC	Electric (al)
ELEV	Elevation (view or datum)
EQ	Equal or =
EQUIP	Equipment
EW	Each Way
EWC	Electric Water Cooler
EXH	Exhaust
EXIST	Existing
EXP	Expansion
EXT	Exterior
FA	Fire Alarm
FD	Floor Drain
FDN	Foundation
FE	Fire Extinguisher
FEC	Fire Extinguisher Cabinet
FF	Finish Floor
FH	Fire Hose
FIN	Finish
FINT	Future
FLR	Floor
FLASH	Flashing
FLEX	Flexible
FMI	Full Height Mirror
FOM	Face of Masonry
FOPC	Face of Precast
FOS	Face of Stud
FT	Foot
FTG	Footing
GA	Gauge
GB	Grab Bar
GALV	Galvanized
GC	General Contractor
GEN	General
GFR	Glass fiber reinforced concrete
GL	Glass
GPM	Gallons per minute
GR	Grade
GYP	Gypsum
GYP BD	Gypsum Board
HB	Hose Bibb
HC	Handicap(ped)
HED	Handicap electric hand dryer
HD	Head (or hair dryer)
HDBD	Headboard
HDF	Handicap drinking fountain
HDNR	Hardener
HDWD	Hardwood
HDWR	Hardware
HEWC	Handicap electric water cooler
HHD	Handicap hair dryer
HLAV	Handicap lavatory
HM	Hollow Metal
HSD	Handicap soap dispenser
HSR	Handicap shower head
HWC	Handicap wall mtd wall closet
HORIZ	Horizontal
HSS	Folding shower seat
HR	Hour
HT	Height
HTG	Heating
HTR	Heater
HU	Handicap urinal
HYD	Hydrant
IC	Intercom
ID	Inside diameter
IN	Inch (es)
INDV	Individual
INSUL	Insulation
INT	Interior
INV	Invert
IS	Is
IT	It
JS	Joint
JT	Joint
K	Kitchen
L	Laminate
LAM	Laminate
LAV	Lavatory
LGTH	Length
LKR	Locker
LT	Light
M	Masonry
MAS	Masonry
MAS BLK	Masonry block
MATL	Material
MB	Markerboard
MBH	Mop & broom holder
MC	Mechanical
MECH	Mechanical
MFR	Manufacturer
MH	Manhole
MI	Mirror
MIN	Minimum
MO	Masonry opening
MTD	Mounted
MTG	Mounting height
HT	Height
MTL	Metal
MULL	Mullion
N	North
NIC	Not in contract
NO	Number
NOM	Nominal
NTS	Not to scale
O	Overall
OA	On center
OC	Outside diameter
OD	Office
OPNG	Opening
OPF	Opposite
OSI	Owner Supplied, Contractor Installed
OSOI	Owner Supplied, Owner Installed
P	Page
PA	Public Address
PAR	Parallel
PARTN	Partition
PCP	Portland cement plaster
PLAM	Plastic laminate
PL	Property Line
PLAS	Plaster
PLBG	Plumbing
PLYWD	Plywood
PNL	Panel
PNLG	Paneling
PR	Pair
PRD GYP	Poured Gypsum
PRFAB	Prefabricated
PS	Pure sheaf
PT	Paint
PTD	Painted
R	Radius (or riser)
RA	Return Air
RCP	Reinforced concrete pipe
RD	Roof Drain (or rosg)
RECP	Receptacle
REF	Refrigerator
REIN	Reinforcing (or reinforced)
REV	Reversed
REQD	Required
RFG	Roofing
RM	Room
S	South
SCHED	Schedule
SD	Soap dispenser
SECT	Section
SHT	Sheet
SHWR	Shower
SIM	Similar
SMLS	Seamless
SND	Sanitary napkin dispenser
SNR	sanitary napkin receptor
SPEC	Specification
SPKR	Speaker
SS	Stainless Steel
STD	Standard
STL	Steel
STO	Storage
STRUCT	Structure (al)
SUSP	Suspend (ed)
SYM	Symmetrical
T	Tread
T&B	Top & bottom
T&G	Tongue & Groove
TERM	Terminate
TERR	Terrazzo (or terrace)
TH	Towel hook
TOC	Top of curb
TOM	Top of masonry
TOW	Top of wall
TP	Towel pin
TPD	Toilet paper Dispenser
TS	Tube steel (or towel strip)
TYP	Typical
U	Urinal
UNO	Unless Noted otherwise
US	Utility shelf
V	Vertical
VENT	Ventilate/ventilator/ventilation
VERT	Vertical
VTR	Vent thru roof
VCT	Vinyl composition tile
W	West
WC	Water closet
WD	Wood
WDO	Window
WF	Wide Flange
WH	Wall hydrant
WTF	Structural / section
WV	Welded wire fabric
W	With
WIO	Without
X	By (as 6'x8')
Y	Yard
YD	Yard
SYMBOLS	
/	Per (or by)
&	And
@	At
	Channel Centerline
+/-	Plus / minus

GYPSUM BOARD	300	OCCUPANCY TAG
RIGID INSULATION	300	TOTAL OCCUPANCY FOR EGRESS
CONCRETE	A9	WINDOW TAG
EARTH	E1 A2-1.1 A2	ELEVATION MARKER
GRAVEL	C4 C1 A2-2.1	SECTION MARKER
STEEL	D1 A2-3.1	DETAIL CALLOUT
WOOD	GL-2	GLASS TYPE
CARPET	3	COLUMN GRID MARKER
BATT INSULATION	LEVEL 1 27'-5"	LEVEL MARKER
	40X	WALL TAG
		NORTH ARROW


4 DIMENSIONS
N.T.S.2 SYMBOLS
N.T.S.1 ABBREVIATIONS
N.T.S.

1. GRAPHIC INSTRUCTIONS
ALL DRAWINGS ARE
INTENDED TO BE
COMPLEMENTARY. NOTIFY
THE ARCHITECT OF ANY
DIMENSIONING CRITERIA
ARE AS TO IDENTIFIED ON THE
DOCUMENTS AND AS
ESTABLISHED BY CRITERIA.
THIS INVOLVES
ESTABLISHING TYPICAL
RULES GOVERNING
PARTITION LOCATIONS AND
THEN DIMENSIONING ONLY
THE EXCEPTION TO THESE
RULES. TYPICAL
DIMENSIONING CRITERIA
ARE OUTLINED BELOW:


- A. COLUMN IDENTIFICATION: DETAILS WILL GOVERN ALL
DIMENSIONS AND FEW DIMENSIONS WILL BE SHOWN ON THE
SMALL SCALE PLANS. COLUMN GRIDS ARE REPRESENTED THUS:

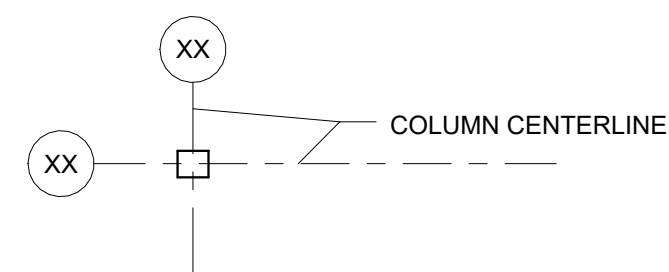


- B. PARTITIONS CENTERED ON COLUMN OR GRID LINES WILL NOT
BE DIMENSIONED ON THE PLANS, BUT DRAWN ACCORDINGLY:

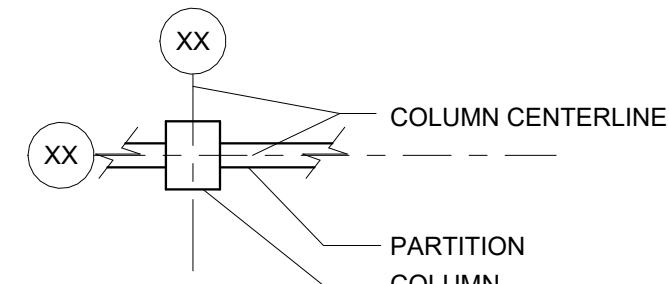


- E. PARTITIONS WITH FINISHED FACE LAYING ON THE COLUMN OR
GRIDLINES WILL NOT BE DIMENSIONED ON THE PLANS, BUT
WILL BE DRAWN ACCORDINGLY:

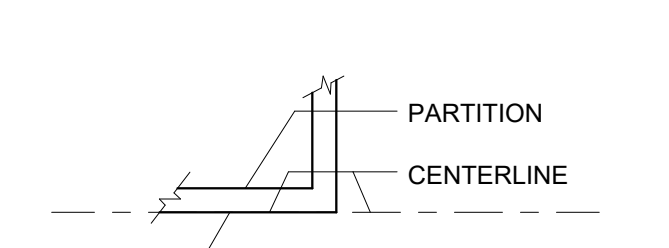


- G. METAL STUD WALLS ARE DIMENSIONED TO THE OUTSIDE FACE
OF FINISH AND WILL BE DRAWN AS FOLLOWS:

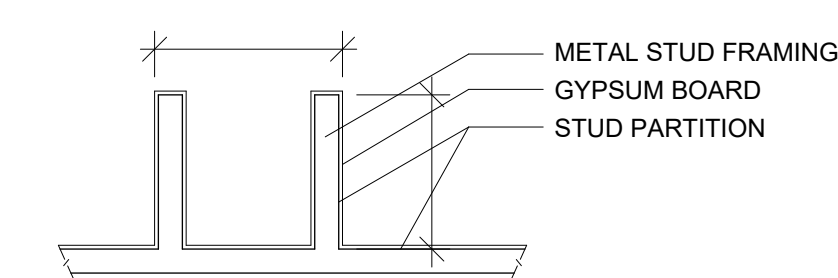


- I. WHEN A WALL BREAKS ON A COLUMN LINE, ITS DIMENSION FROM
THE PARALLEL GRID LINE WILL REMAIN THE SAME.

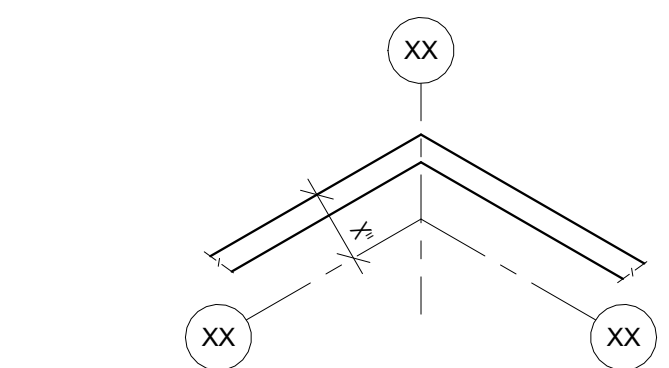


- H. FOR OPENINGS IN PARTITIONS OR WALLS:
1. WHEN NEITHER JAMB OCCURS AT A PARTITION INTERSECTION,
AT A COLUMN OR AT A GRIDLINE, ONE JAMB WILL BE LOCATED
DIMENSIONALLY BY THE DETAIL.
2. WHEN ONE JAMB IS LOCATED BY A PARTITION
INTERSECTION, THE FOLLOWING DIAGRAM APPLIES:

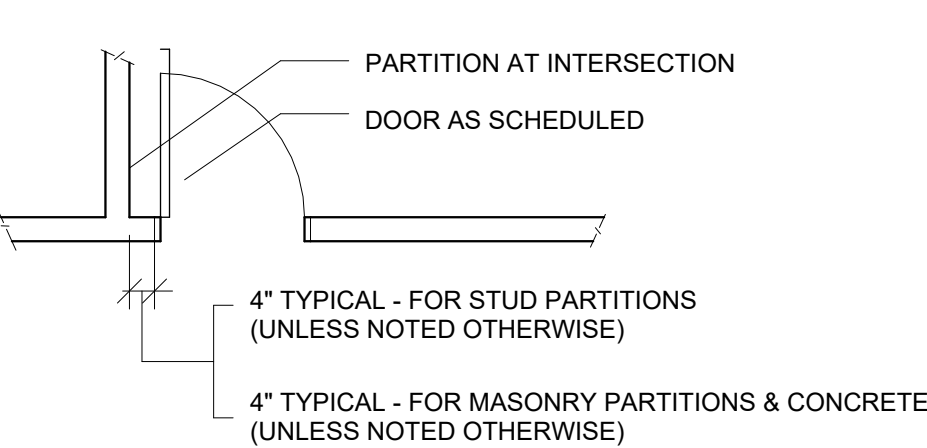


- C. PARTITIONS WITH THE FINISHED FACE FLUSH WITH THE FINISHED FACE OF THE
COLUMN WILL NOT BE DIMENSIONED ON THE PLANS, BUT WILL BE DRAWN ACCORDING:

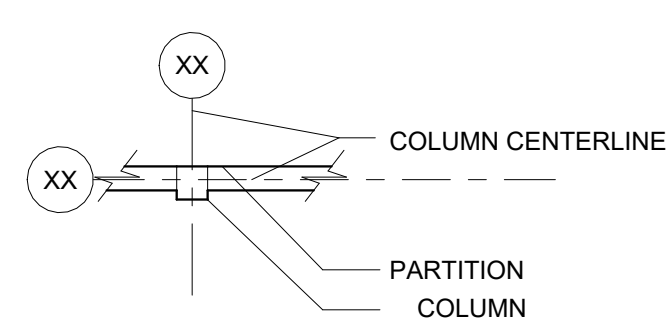


- D. PARTITIONS CENTERED ON WINDOW MULLIONS WILL NOT BE DIMENSIONED ON
PLANS, BUT WILL BE DRAWN ACCORDINGLY:

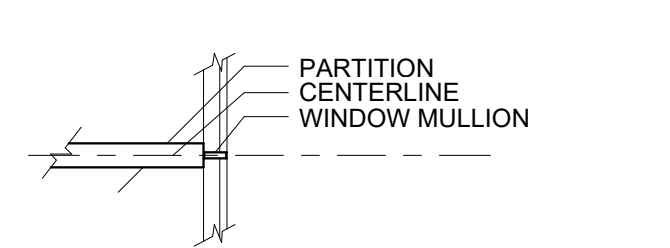


- F. MASONRY WALLS ARE DIMENSIONED (USING NOMINAL DIMENSIONS) FROM THE
FACE OF ONE UNIT TO THE FACE OF ANOTHER UNIT AND WILL BE DRAWN
ACCORDINGLY:

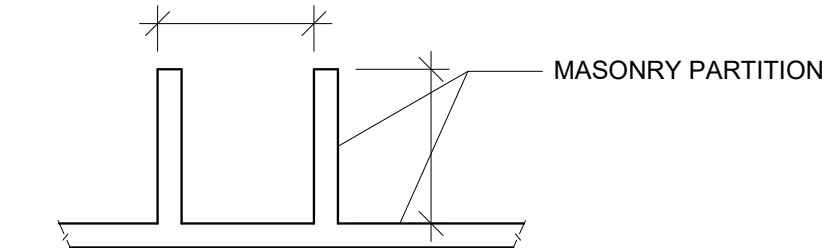


- J. IF A WALL IS DIMENSIONED FROM TWO INTERSECTING, NON-
PERPENDICULAR GRIDS IT WILL BE DIMENSIONED FROM THE INTERSECTION
OF THE GRID LINES

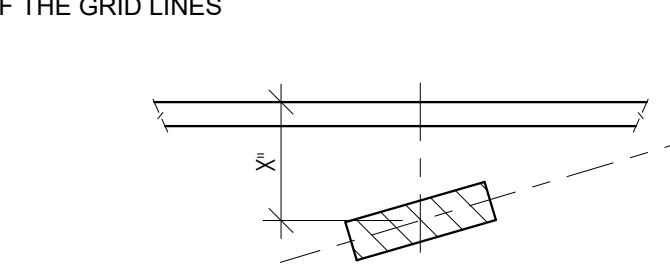

- K. IF A WALL APPEARS THAT IT INTERSECTS WITH THE CORNER OF A COLUMN
AND IS NOT DIMENSIONED IT SHOULD BE ASSUMED THAT IT SHOULD
INTERSECT WITH THE COLUMN CORNER AND WILL BE DRAWN AS FOLLOWS:

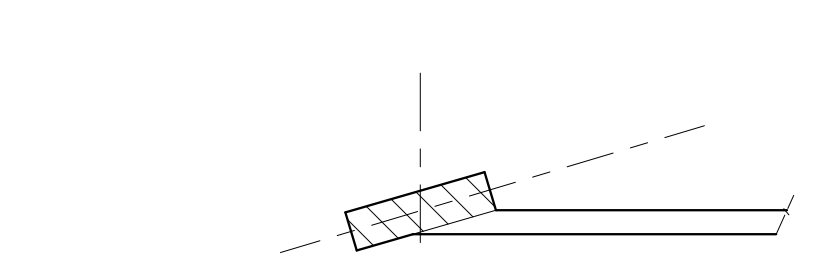

3. WHEN ONE JAMB IS LOCATED BY A COLUMN, THE
FOLLOWING DIAGRAM APPLIES:

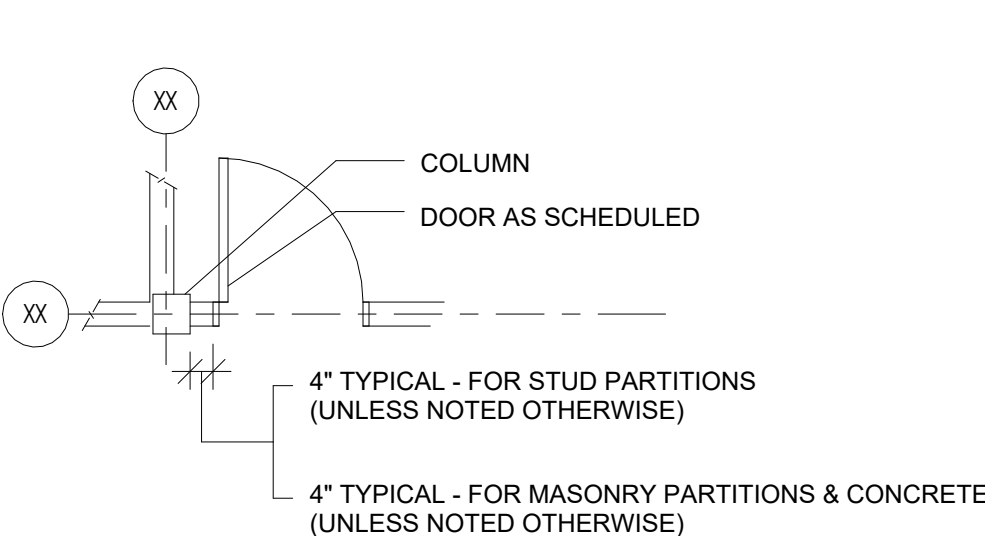

SPECIFICATIONS / BASIS OF DESIGNS:

DIVISION 4 - MASONRY

042000 - CONCRETE UNIT MASONRY

Concrete Masonry Units- ASTM C 90.
1. Masonry Standard: Comply with TMS 602/ACI 530.1/ASCE 6
2. Unit Compressive Strength: Provide units with minimum average net-area compressive strength of 2200 psi.
3. Density Classification: Lightweight
4. Size (Width): Manufactured to dimensions 3/8 inch less than nominal dimensions.
5. Provide bullnose units for outside corners.
6. Fire-Resistance Ratings: Comply with requirements for fire-resistance-rated assembly designs indicated.

Mortar Materials
1. Portland Cement: ASTM C 150, Type I, except Type III may be used for cold-weather construction. Provide natural color or white cement as required to produce mortar color indicated.
- Alkali content shall not be more than 0.1 percent when tested according to ASTM C 114.
2. Hydrated Lime: ASTM C 207, Type S.
3. Portland Cement-Lime Mix: Packaged blend of portland cement and hydrated lime containing no other ingredients.
4. Aggregate for Mortar: ASTM C 144.
- Use washed aggregate consisting of natural sand or crushed stone.
- For joints less than 1/4 inch thick, use aggregate graded with 100 percent passing the No. 16 sieve.

Reinforcement
1. Uncoated-Steel Reinforcing Bars: ASTM A 615 or ASTM A 996, Grade 60.
2. Reinforcing Bar Positioners: Wire units designed to fit into mortar bed joints spanning masonry unit cells and to hold reinforcing bars in center of cells. Units are formed from 0.148-inch steel wire, hot-dip galvanized after fabrication. Provide units designed for number of bars indicated.
3. Masonry-Joint Reinforcement, General: ASTM A 951.
- Exterior Walls: Hot-dip galvanized carbon steel.
- Wire Size for Side and Cross Rods: 0.148-inch diameter.
- Spacing of Cross Rods, Tabs, and Cross Ties: Not more than 16 inches o.c.
- Provide in lengths of not less than 10 feet, w/ prefabricated corner/ tee units
4. Masonry-Joint Reinforcement for Single-Wythe Masonry: Ladder type with single pair of side rods.

Ties and Anchors
1. General: Ties and anchors shall extend at least 1-1/2 inches into veneer but with at least a 5/8-inch cover on outside face.
2. Materials: Provide ties and anchors specified in this article that are made from materials that comply with the following unless otherwise indicated:
-Hot-Dip Galvanized, Carbon-Steel Wire: ASTM A 82, with ASTM A 153, Class B-2 coating.
- Steel Sheet, Galvanized after Fabrication: ASTM A 1008, Commercial Steel, with ASTM A 153, Class B coating.
3. Adjustable Anchors for Connecting to Concrete: Provide anchors that allow vertical or horizontal adjustment but resist 100-lbf tension and compression forces perpendicular to plane of wall without deforming or developing play in excess of 1/16 inch.
- Connector Section: Dovetail tabs for inserting into dovetail slots in concrete and attached to tie section; formed from 0.060-inch-thick steel sheet, galvanized after fabrication.
- Tie Section: Triangular-shaped wire tie made from 0.187-inch-diameter, hot-dip galvanized steel wire.
4. Adjustable Masonry Veneer Anchors: Provide anchors that allow vertical or horizontal adjustment but resist 100-lbf tension and compression forces perpendicular to plane of wall without deforming or developing play in excess of 1/16 inch.
- Fabricate sheet metal anchor sections and other sheet metal parts from 0.075-inch- thick steel sheet, galvanized after fabrication.
- Fabricate wire ties from 0.187-inch- diameter, hot-dip galvanized-steel wire unless otherwise indicated.
- Screw-Attached, Masonry-Veneer Anchors: Wire tie and a gasketed sheet metal anchor section, 1-1/4 inches wide by 6 inches long, with screw holes top and bottom; top and bottom ends bent to form pronged legs of length to match thickness of insulation or sheathing; and raised rib-stiffened strap, 5/8 inch wide by 6 inches long, stamped into center to provide a slot between strap and base for inserting wire tie. Self-adhering, modified bituminous gasket fits behind anchor plate and extends beyond pronged legs.
5. Partition Top Anchors: 0.105-inch-thick metal plate with a 3/8-inch-diameter metal rod 6 inches long welded to plate and with closed-end plastic tube fitted over rod that allows rod to move in and out of tube. Fabricate from steel, hot-dip galvanized after fabrication.
6. Anchor Bolts: Headed steel bolts complying with F1554, Grade 55 weldable, with ASTM A 563 hex nuts and, where indicated, flat washers; hot-dip galvanized to comply with ASTM A 153, Class C; of dimensions indicated.

Embedded Flashing Materials
1. All metal flashing and related accessories to comply with SMACNA's "Architectural Sheet Metal Manual" and as follows:

Misc. Masonry Accessories
1. Compressible Filler: Premolded filler strips complying with ASTM D 1056, Grade RE41E1; compressible up to 35 percent; of width and thickness indicated; formulated from neoprene.
2. Preformed Control-Joint Gaskets: Made from styrene-butadiene-rubber compound, complying with ASTM D 2000, Designation M2AA-805 and designed to fit standard sash block and to maintain lateral stability in masonry wall; size and configuration as indicated.
3. Bond-Breaker Strips: Asphalt-saturated felt complying with ASTM D 226, Type I (No. 15 asphalt felt).
4. Reinforcing Bar Positioners: Wire units designed to fit into mortar bed joints spanning masonry unit cells and hold reinforcing bars in center of cells. Units are formed from 0.148-inch steel wire, hot-dip galvanized after fabrication.
5. Weep/Cavity Vent Products: Use the following unless otherwise indicated:
- Wicking Material: Absorbent rope, made from cotton or UV-resistant synthetic fiber or Round Plastic Weep/Vent Tubing: Medium-density polyethylene, 3/8-inch OD by 4 inches long with extended cotton wick.
6. Mortar Net: Cavity Drainage Material, Free-draining mesh, made from high-density polyethylene, 90% open mesh, that will not degrade within the wall cavity.

Material delivery, storage, handling, field conditions and all execution of work to be per recommendations and requirements of The Concrete Masonry and Hardscapes Association (CMHA).

Warranty- work performed under contract conforms to the requirements and is free of any defects in equipment, material, design furnished, or workmanship performed by the Contractor and their Subcontractors and or Suppliers.
1.This warranty shall continue for a period of two (2) years from the date of Substantial Completion.
2.The Contractor shall restore any work damaged in fulfilling the terms and conditions of this Warranty.

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

074600000 - METAL SIDING

Basis of Design - AEP Span

Series - Flex Series Metal Siding

- Panel Type: Concealed fastener metal siding
- Standard Base Metal: Zinalume® Steel (AZ50)
- Coverage: 12"
- Metal Thickness (Gauge): 22
- Slope: N/A
- Orientation: Vertical
- Paint System: Dura Tech™ 5000 / Dura Tech™ mx (PVDF – 24, 22ga)
- Panel Attachment: Concealed Screw or Concealed Clips
- Performance Certification: ASTM E1592 (Wind Uplift), ASTM E283 (Air Infiltration), ASTM E331 (Water Infiltration), UI 263 (Fire Resistance), ER 309 Building Code Evaluation Report
- Panel Height: 1 1/4"
- Rib Style: Square / Rectangular
- Primary Application: Commercial and Architectural Siding
- Standard Configuration: as shown
- Factory Applied Sealant: No
- Optional Configuration: N/A
- Available Panel Lengths: 5'-0" to 450'-0"
- Other Options (inquire): Direct fastened or Clip attached
- Panel Variations: -

076000 - METAL ROOFING

Basis of Design - AEP Span

Series - Span-Lok hp Metal Roofing

- Panel Type: Concealed fastener metal roofing (standing seam)
- Standard Base Metal: Zinalume® Steel (AZ50)
- Coverage: 12"
- Metal Thickness (Gauge): 22
- Slope: 1:12
- Orientation: Vertical
- Paint System: Dura Tech™ 5000 / Dura Tech™ mx (PVDF – 24, 22ga)
- Panel Attachment: Mechanically Seamed with Concealed Clips
- Performance Certification: UL 580 (Class 90 Wind Uplift), UL 790 (Class A - Fire Rated), ASTM E1592 (Wind Uplift), ASTM E1680 (Air infiltration), ASTM E1646 and E2140 (Water Infiltration), UL2218 (Class 4 Impact Resistance – Hail), ER 309 Building Code Evaluation Report
- Panel Height: 2"
- Rib Style: Standing Seam
- Primary Application: Commercial and Architectural Roofing
- Standard Configuration: Striated
- Factory Applied Sealant: Yes
- Optional Configuration: 2 Pencil Ribs
- Available Panel Lengths: 6'-0" to 45'-0"
- Other Options (inquire): Factory Notching, Factory Swaged
- Panel Variations: -

DIVISION 8 - OPENINGS

086200 - UNIT SKYLIGHTS

Basis of Design - Vellux Commercial

Series - CFC2, Double Dome, NFRC Certified, Curb Mount
Model - 5252
- Frame Finish
- PVC White

- Acrylic Glazing
- Outer- Translucent Glazing
- Inner- Clear Acrylic

- NFRC Certified Performance
- U Factor = 0.64
- SHGC = 0.44
- VT = 60%

- Size - 49 1/4" x 49 1/4"

DIVISION 9 - FINISHES

099113 - EXTERIOR PAINTING

Basis of Design - Sherwin Williams

CMU:
Block Filler: ConFlex Block Filler, CF1W50
Finish (1 coats): Loxon XP

...Of...

CMU (elastomeric system):
Block Filler: ConFlex Block Filler, CF1W50
Finish (2 coats): ConFlex SherLastic Elastomeric Coating, CF16 Series

CMU (acrylic system):
Block Filler: ConFlex Block Filler, CF1W50 or similar
Finish (2 coats): Pro Industrial Acrylic Eg-shel, B66-660 Series / Semi-gloss, B66-650 Series

099600 - HIGH-PERFORMANCE COATINGS

Metal Columns (if shop primed with a universal primer or a zinc):
Polysiloxane Finish
Finish: Sherloxane 800, B80-500 Series

...Of...

Polyurethane Finish
Intermediate: Macropoxy 646, B58-600 Series
Finish: Hi-Solids Polyurethane 250, B65-300 Series

Metal Columns (bare metal field painted):
Polysiloxane Finish
Primer: Macropoxy 646, B58-600 Series
Finish: Sherloxane 800, B80-500 Series

...Of...

Polyurethane Finish
Primer: Macropoxy 646, B58-600 Series
Finish: Hi-Solids Polyurethane 250, B65-300 Series

...Of...

Acrylic Finish (not considered a High-Performance Coating System)
Primer: Pro Industrial ProCryl Primer, B66W1310
Finish (2 coats): Pro Industrial Acrylic Eg-shel, B66-660 Series / Semi-gloss, B66-650 Series

Metal Columns (bare metal shop coated):
Polysiloxane Finish
Primer: Zinc Clad 4100, B69A120
Finish: Sherloxane 800, B80-500 Series

...Of...

Polyurethane Finish
Primer: Zinc Clad 4100, B69A120
Intermediate: Macropoxy 646, B58-600 Series
Finish: Hi-Solids Polyurethane 250, B65-300 Series

DIVISION 32 - EXTERIOR IMPROVEMENTS

323116 - WELDED WIRE FENCES AND GATES

Basis of Design - Wallace Perimeter Security

Series- Rampart 358 - Security Fencing

- Mesh Opening - 3" x .5"
- Gauge of Horizontal Wire - 1 x 8 GA
- Gauge of Vertical Wire - 1 x 8 GA
- Standard Height - 8'-0"
- Standard Length - 8'-3"
- Finish - Powder Coat, color TBD from manufacturer's standard line



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1804 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3000
Seattle, Washington 98101
tel: 206-215-8295

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-5156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134



DATE:
6/26/2025

DRAWINGS ISSUED FOR:
PERMIT SET

title:
SPECIFICATIONS
crawford project no.: K043725

NOTE: THIS SHEET IS FOR REFERENCE ONLY.



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555




ARCHITECT
Crawford Architects CA, Inc.
1804 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8295

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-5156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

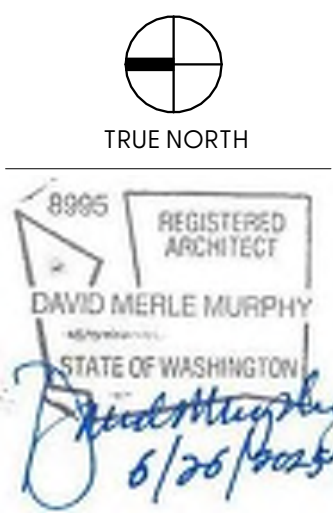


DATE:
6/26/2025


DRAWINGS ISSUED FOR:
PERMIT SET

title:
ARCHITECTURAL SITE PLAN
crawford project no.: K243725

A025
sheet no.
© Crawford Architects 2025

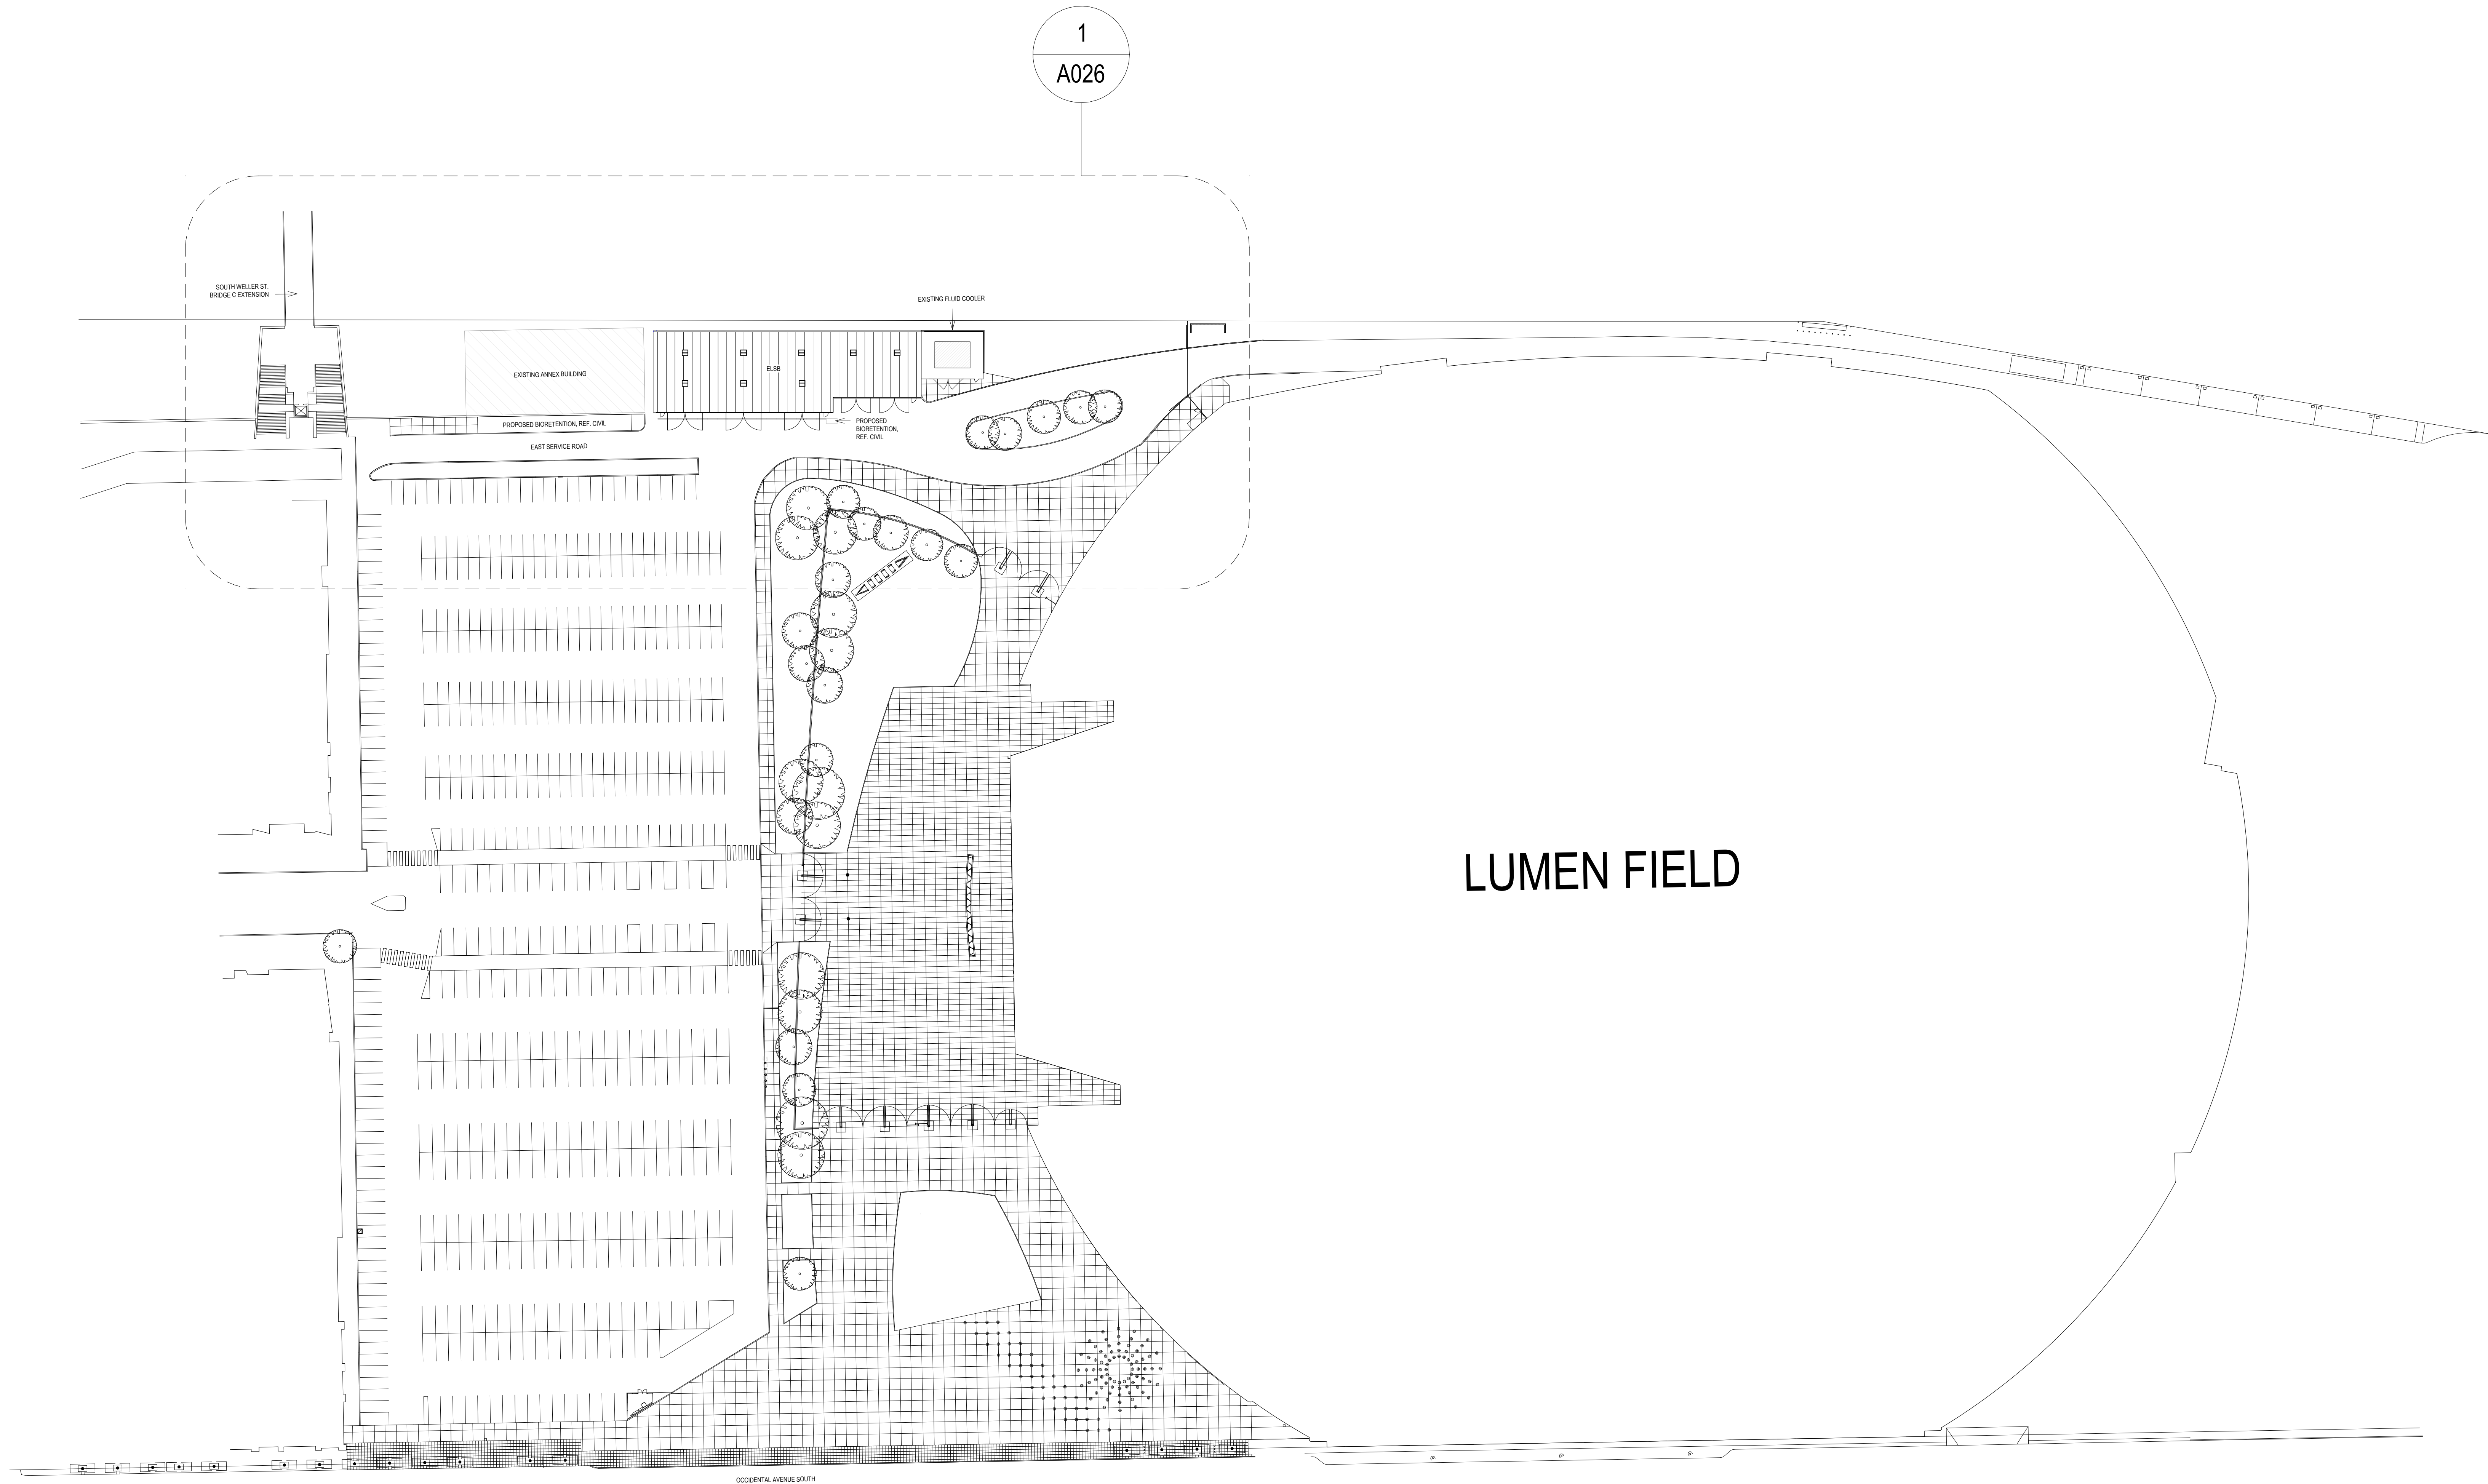

1 ARCHITECTURAL SITE PLAN
A026 1" = 50'-0"

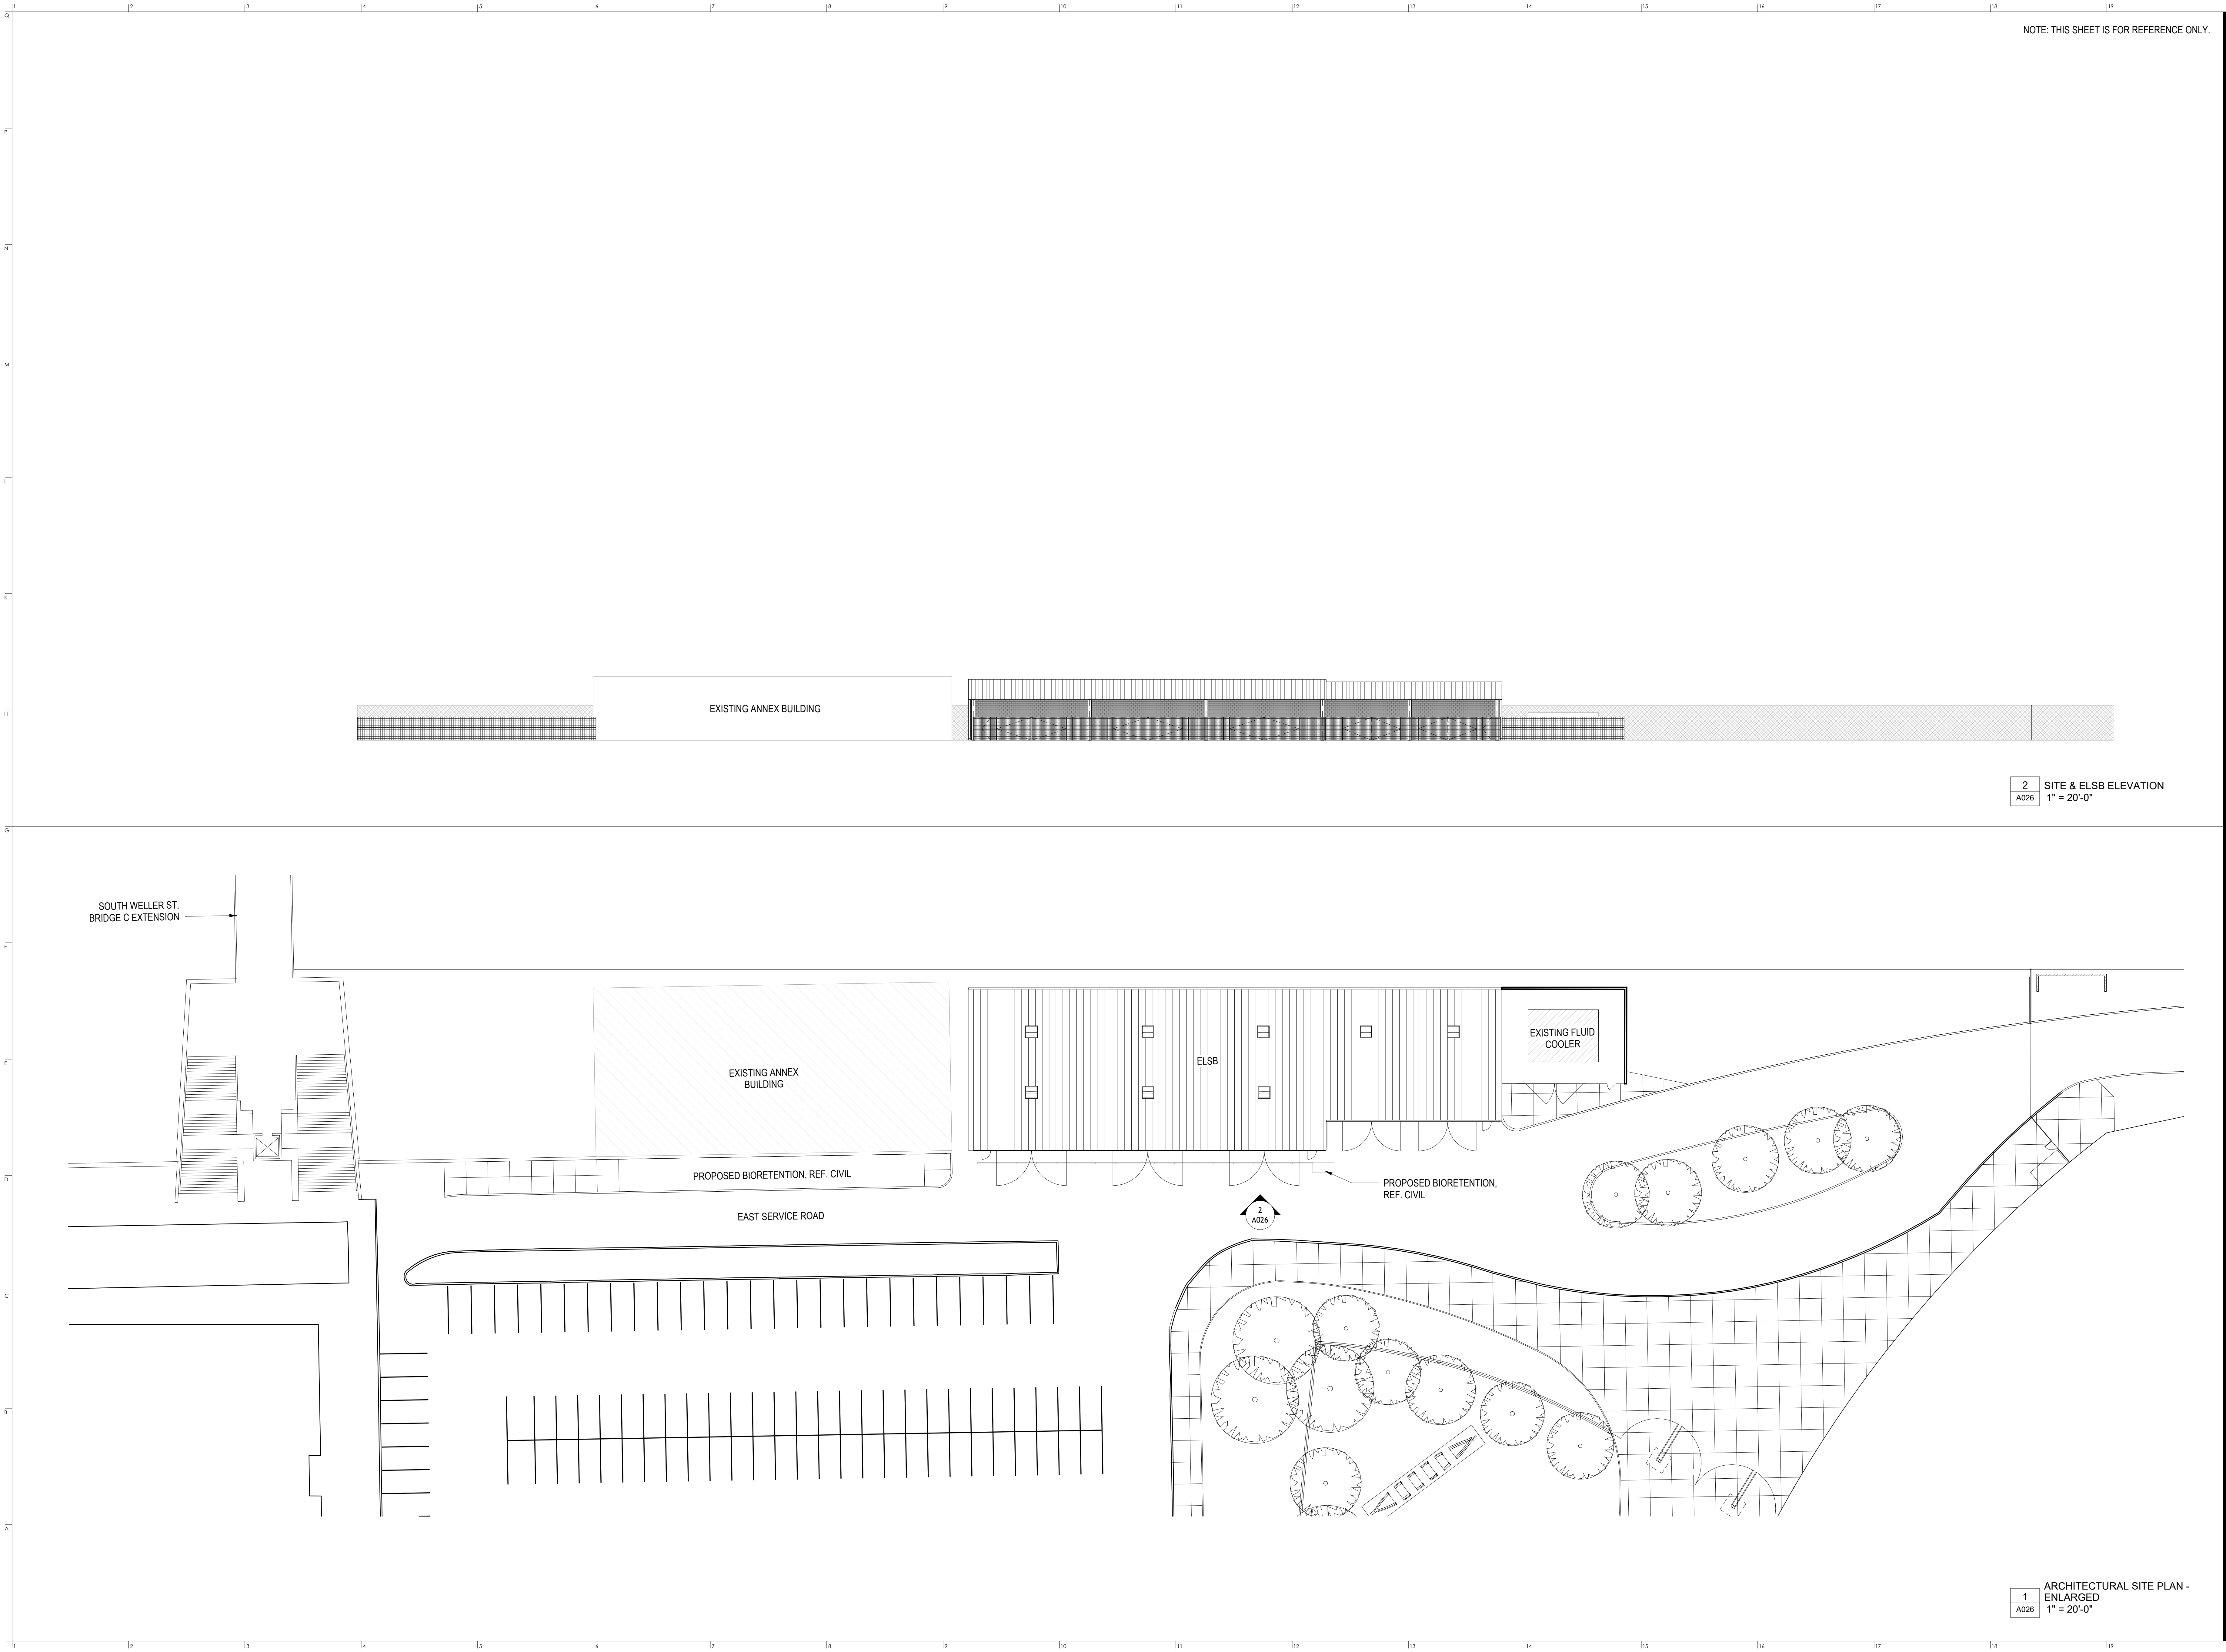

NOTE: THIS SHEET IS FOR REFERENCE ONLY.



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555




ARCHITECT
Crawford Architects CA, Inc.
1804 Locust Street, Suite 100
Kansas City, MO 64109
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8295

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-5156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

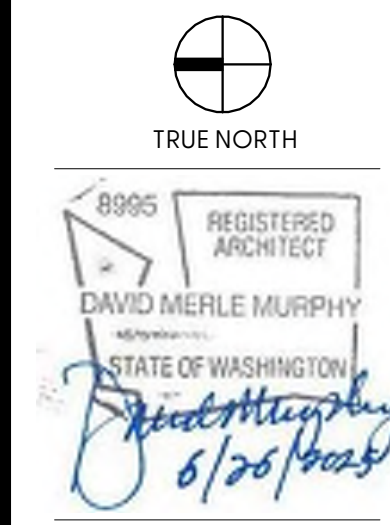


DATE:
6/26/2025


DRAWINGS ISSUED FOR:
PERMIT SET

title:
ENLARGED ARCH. SITE PLAN
crawford project no.: K031325

A026
sheet no.
© Crawford Architects 2025

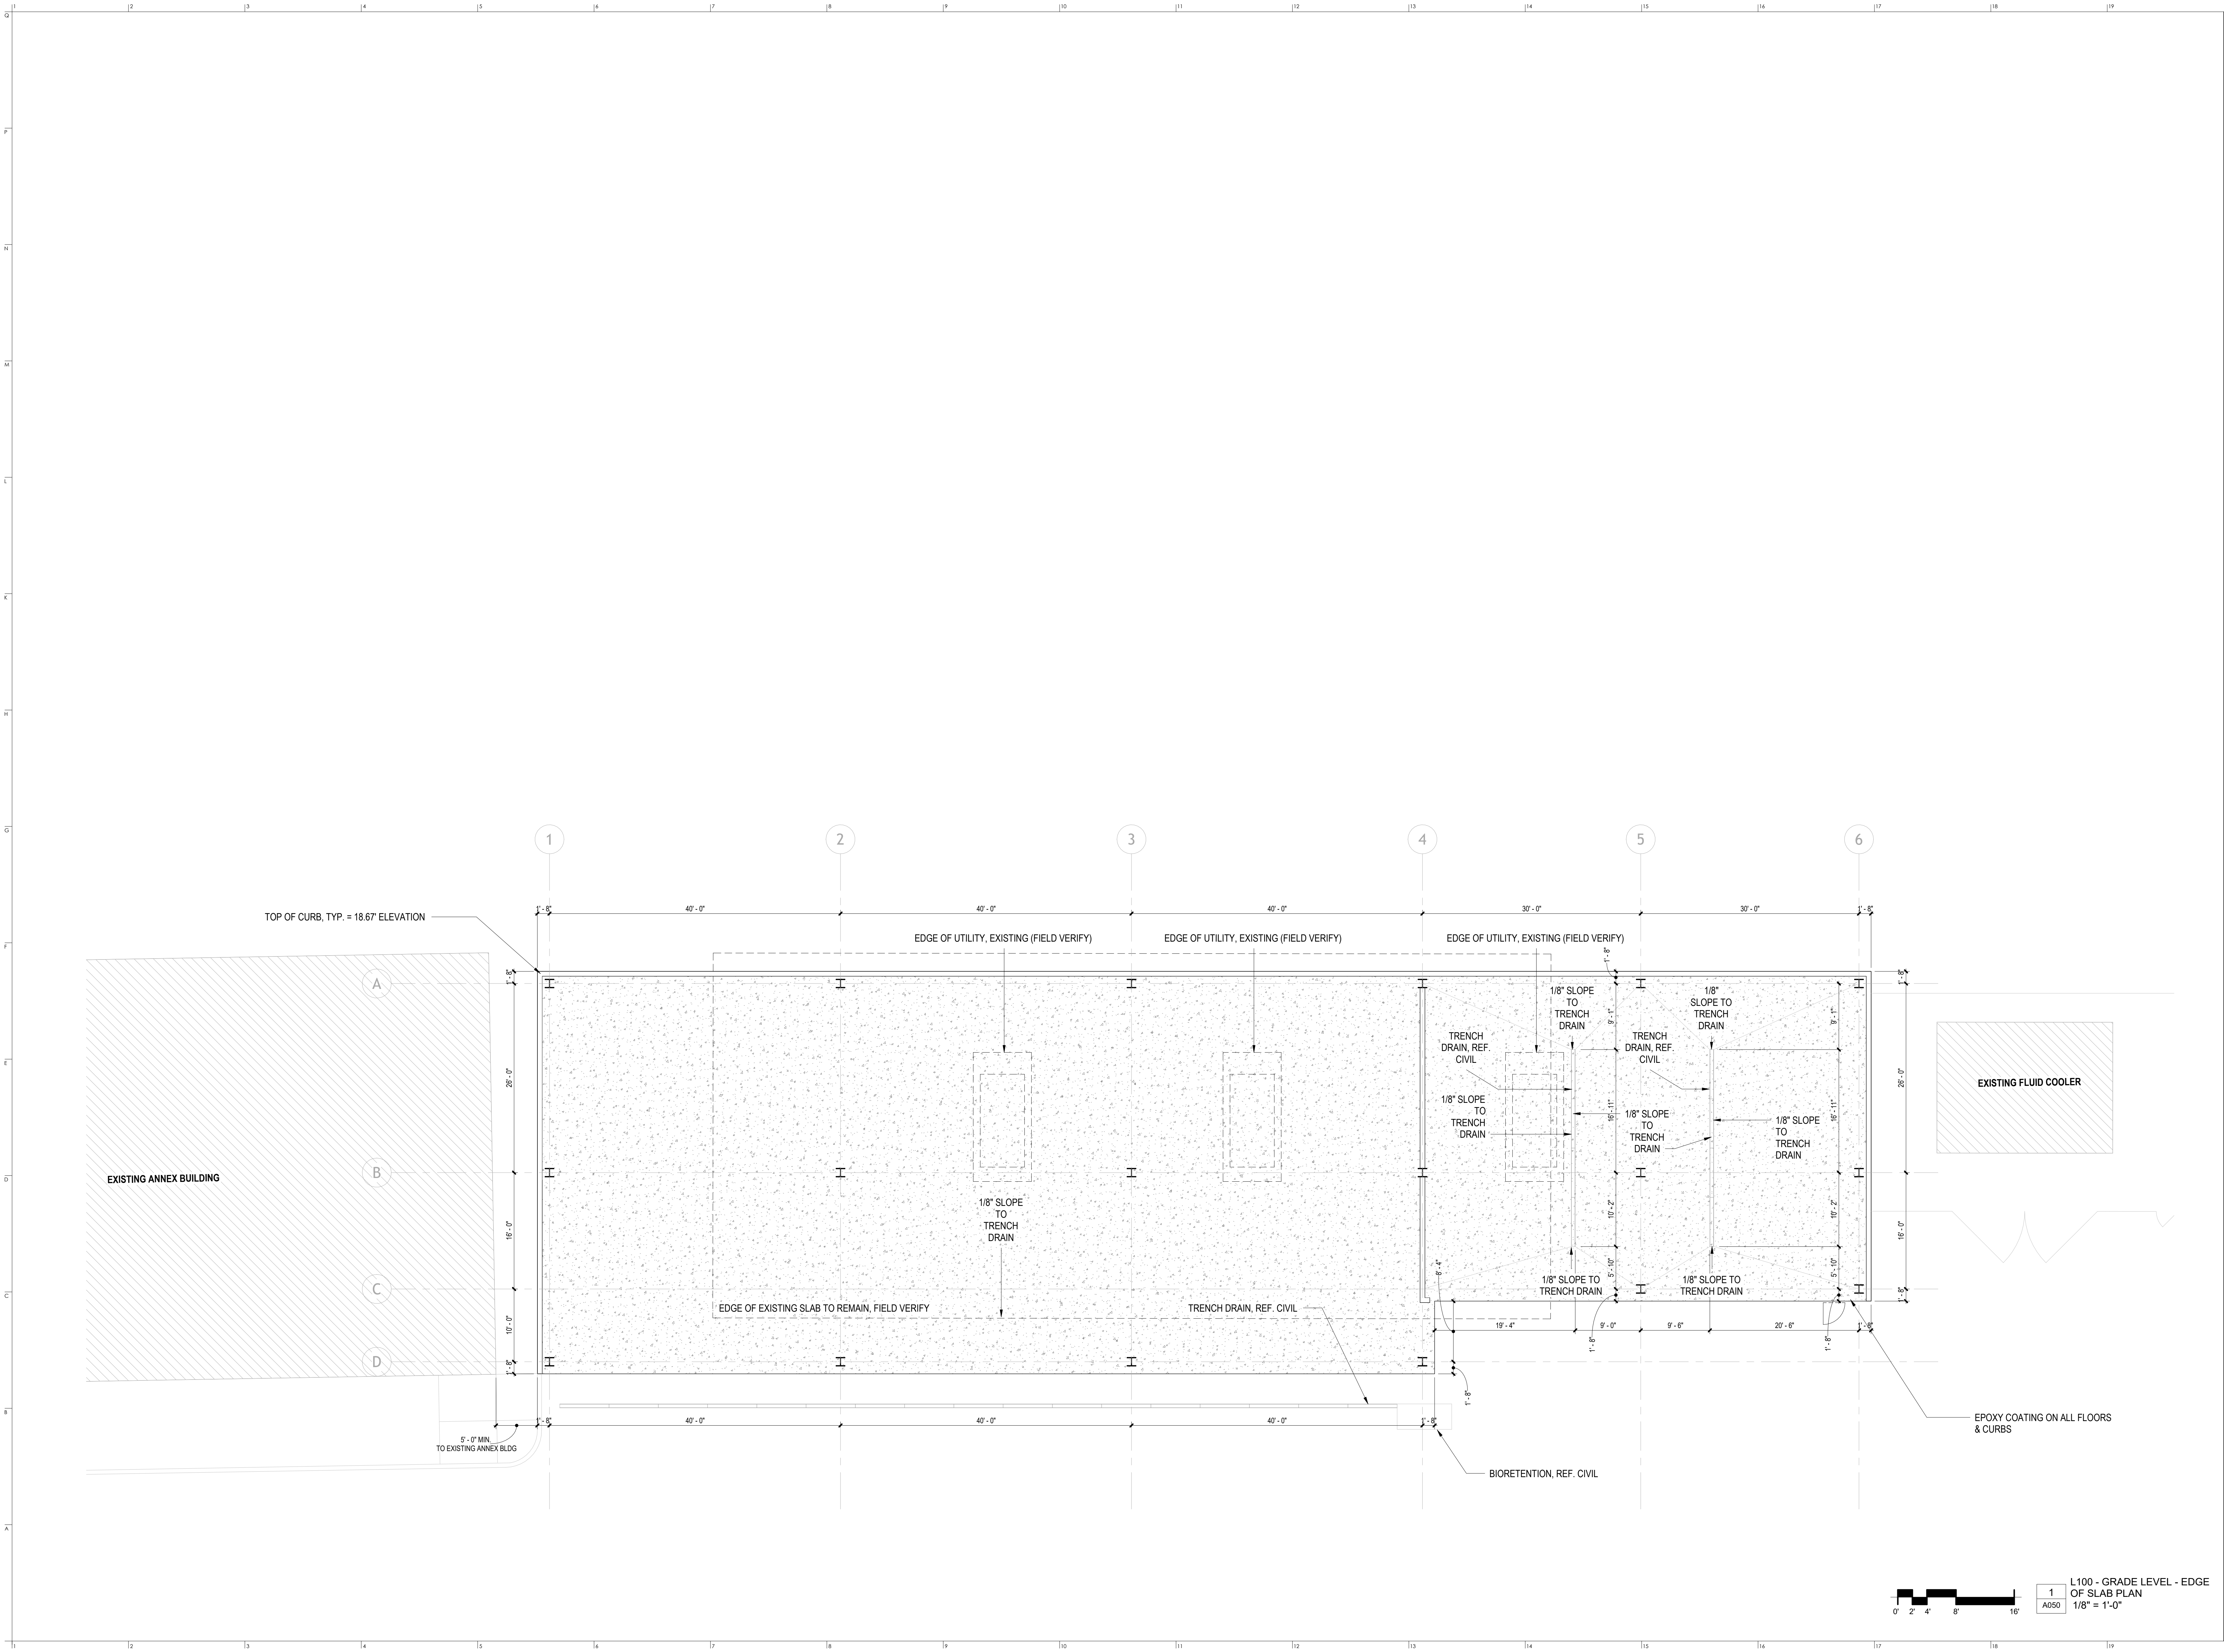


LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

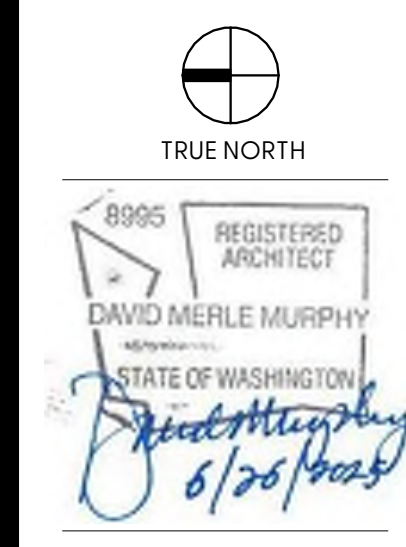


DATE:
6/26/2025


DRAWINGS ISSUED FOR:
PERMIT SET

title:
EDGE OF SLAB PLAN
crawford project no.: K23125

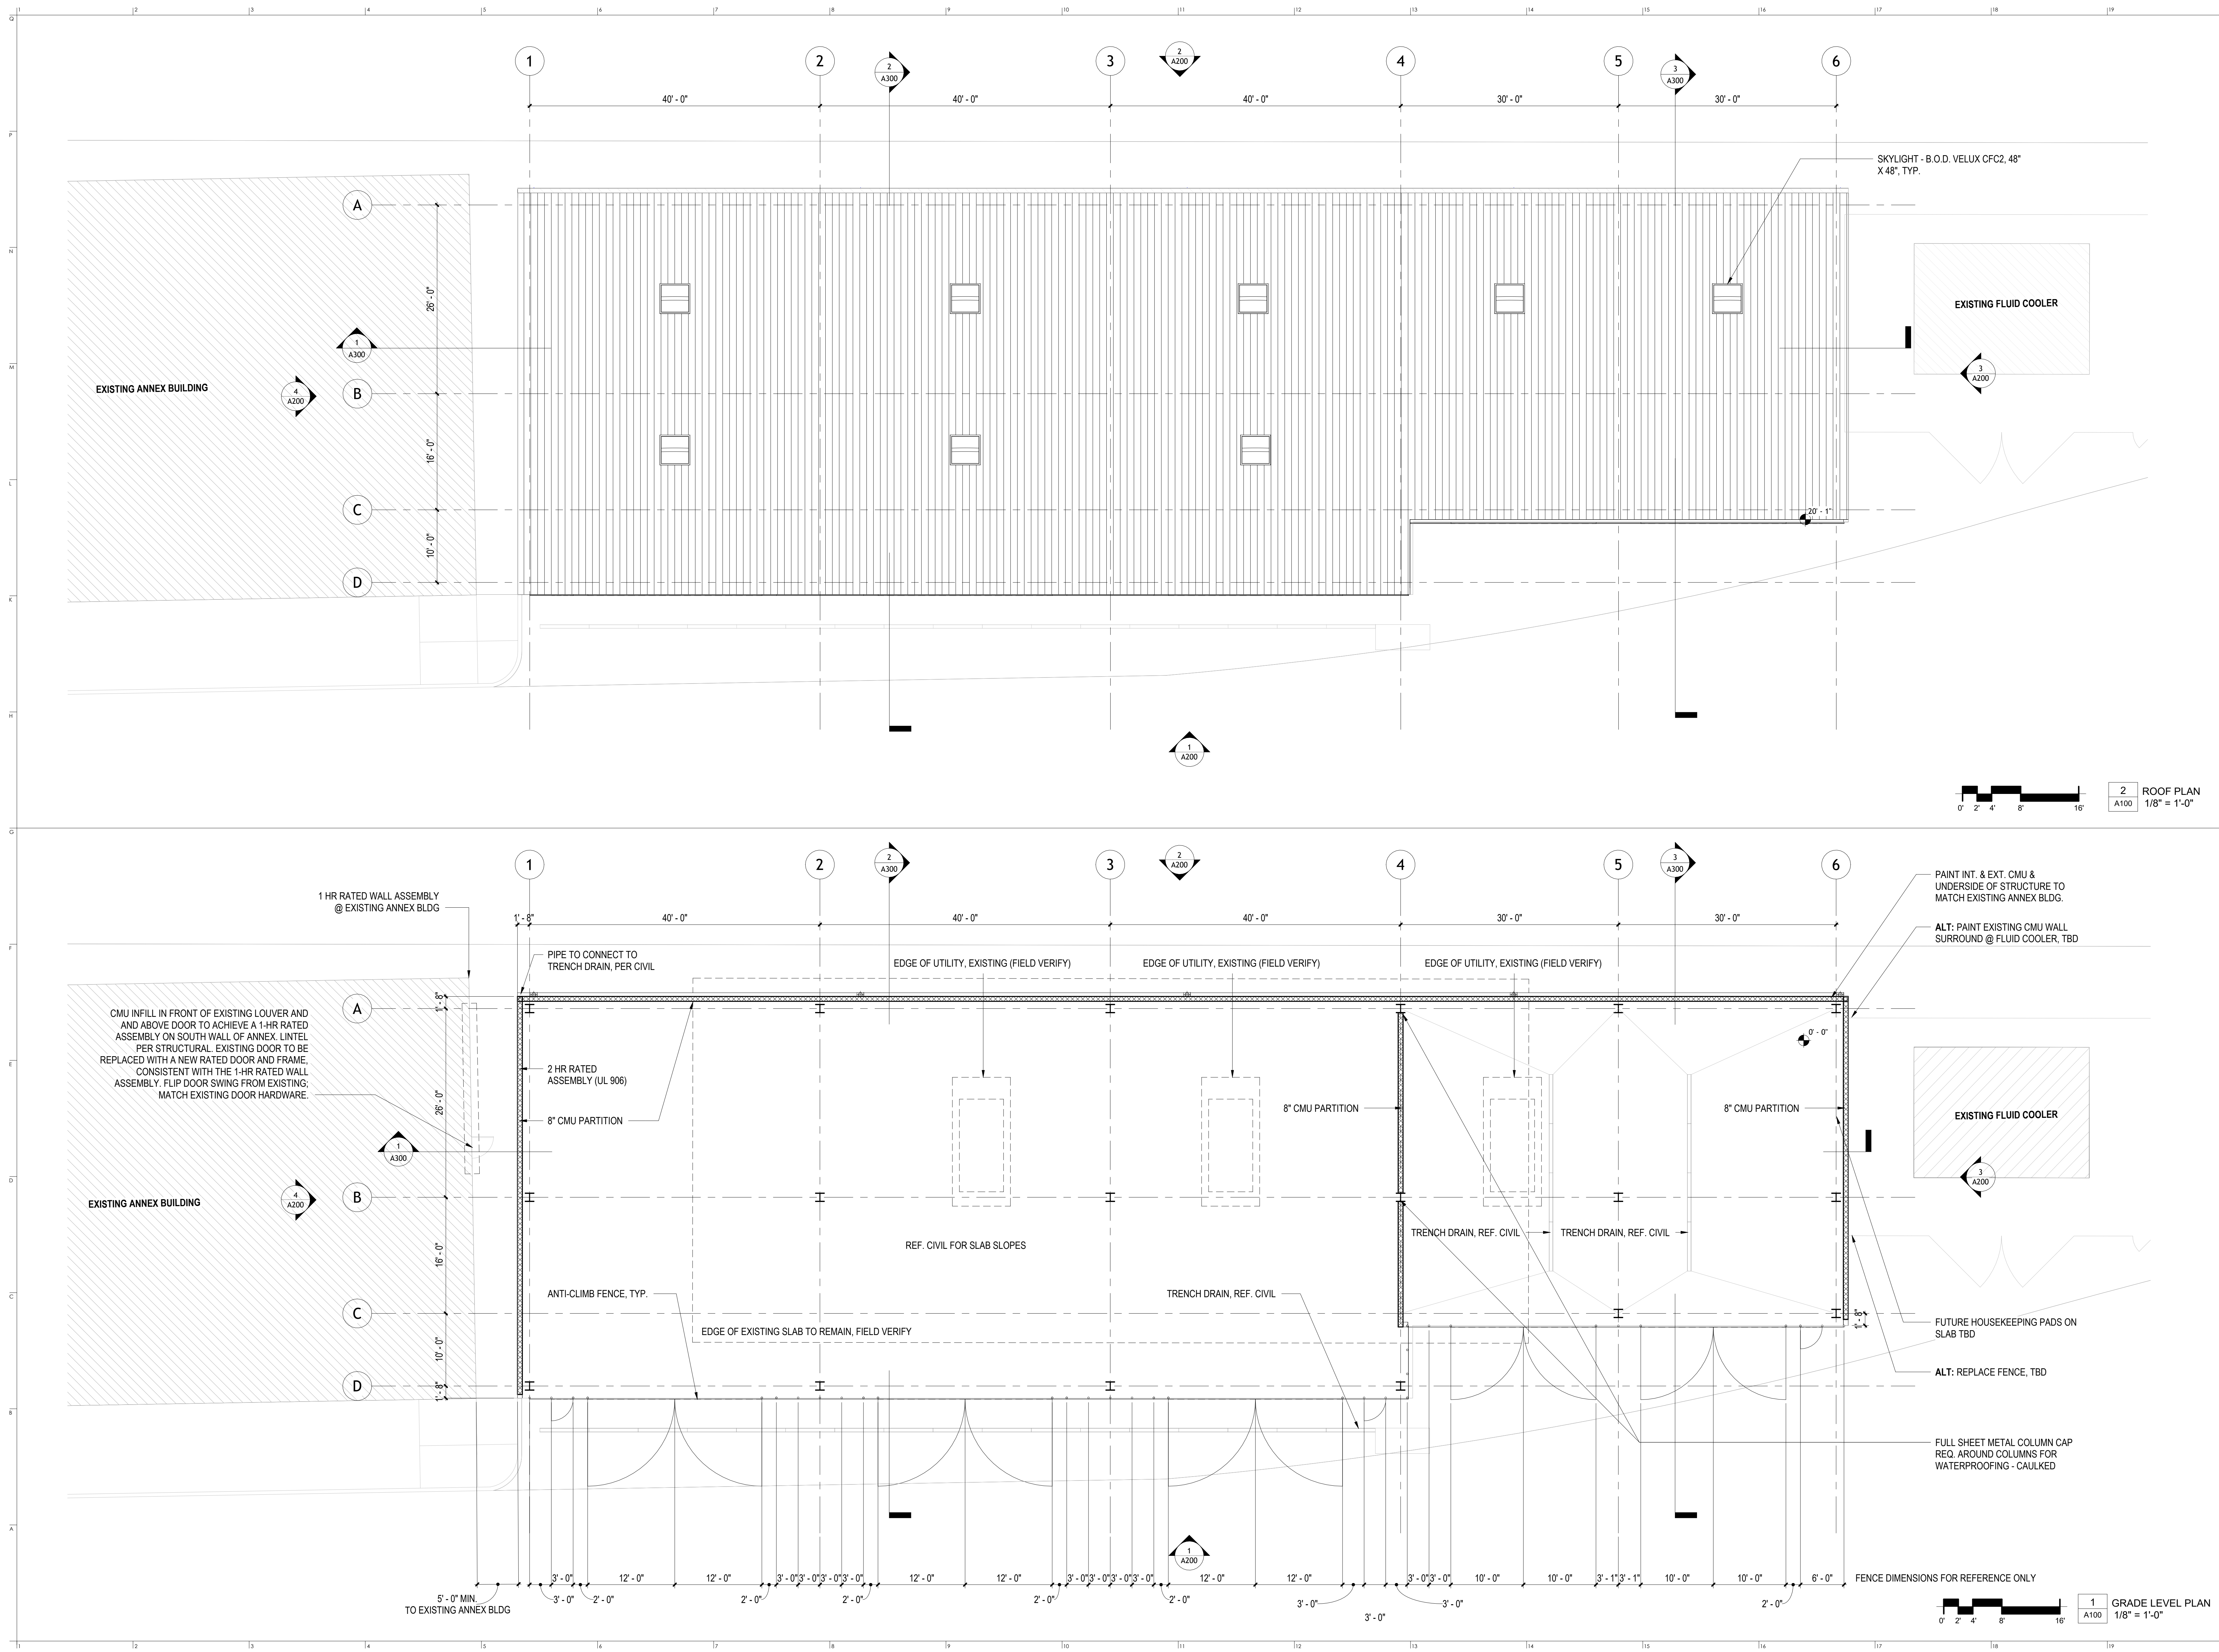


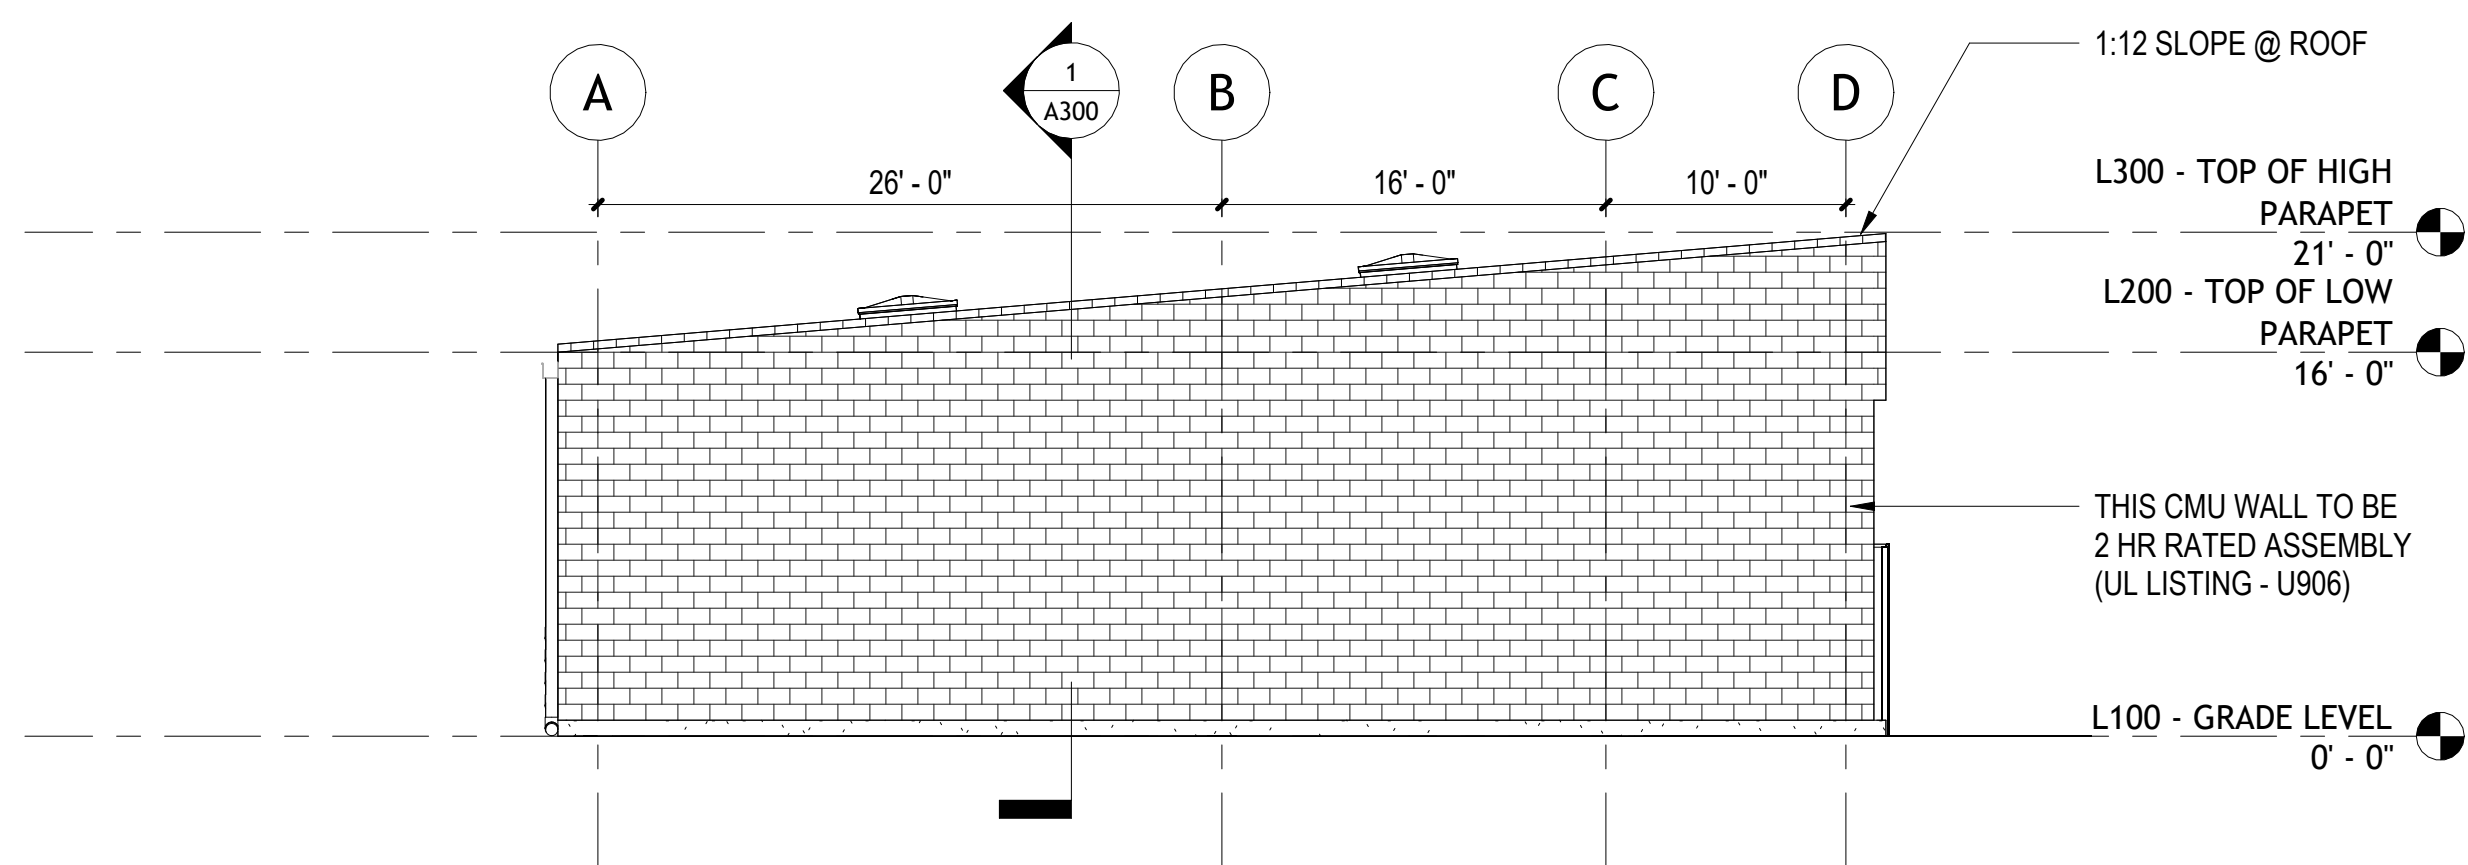


4 ELEVATION - NORTH
A200 1/8" = 1'-0"

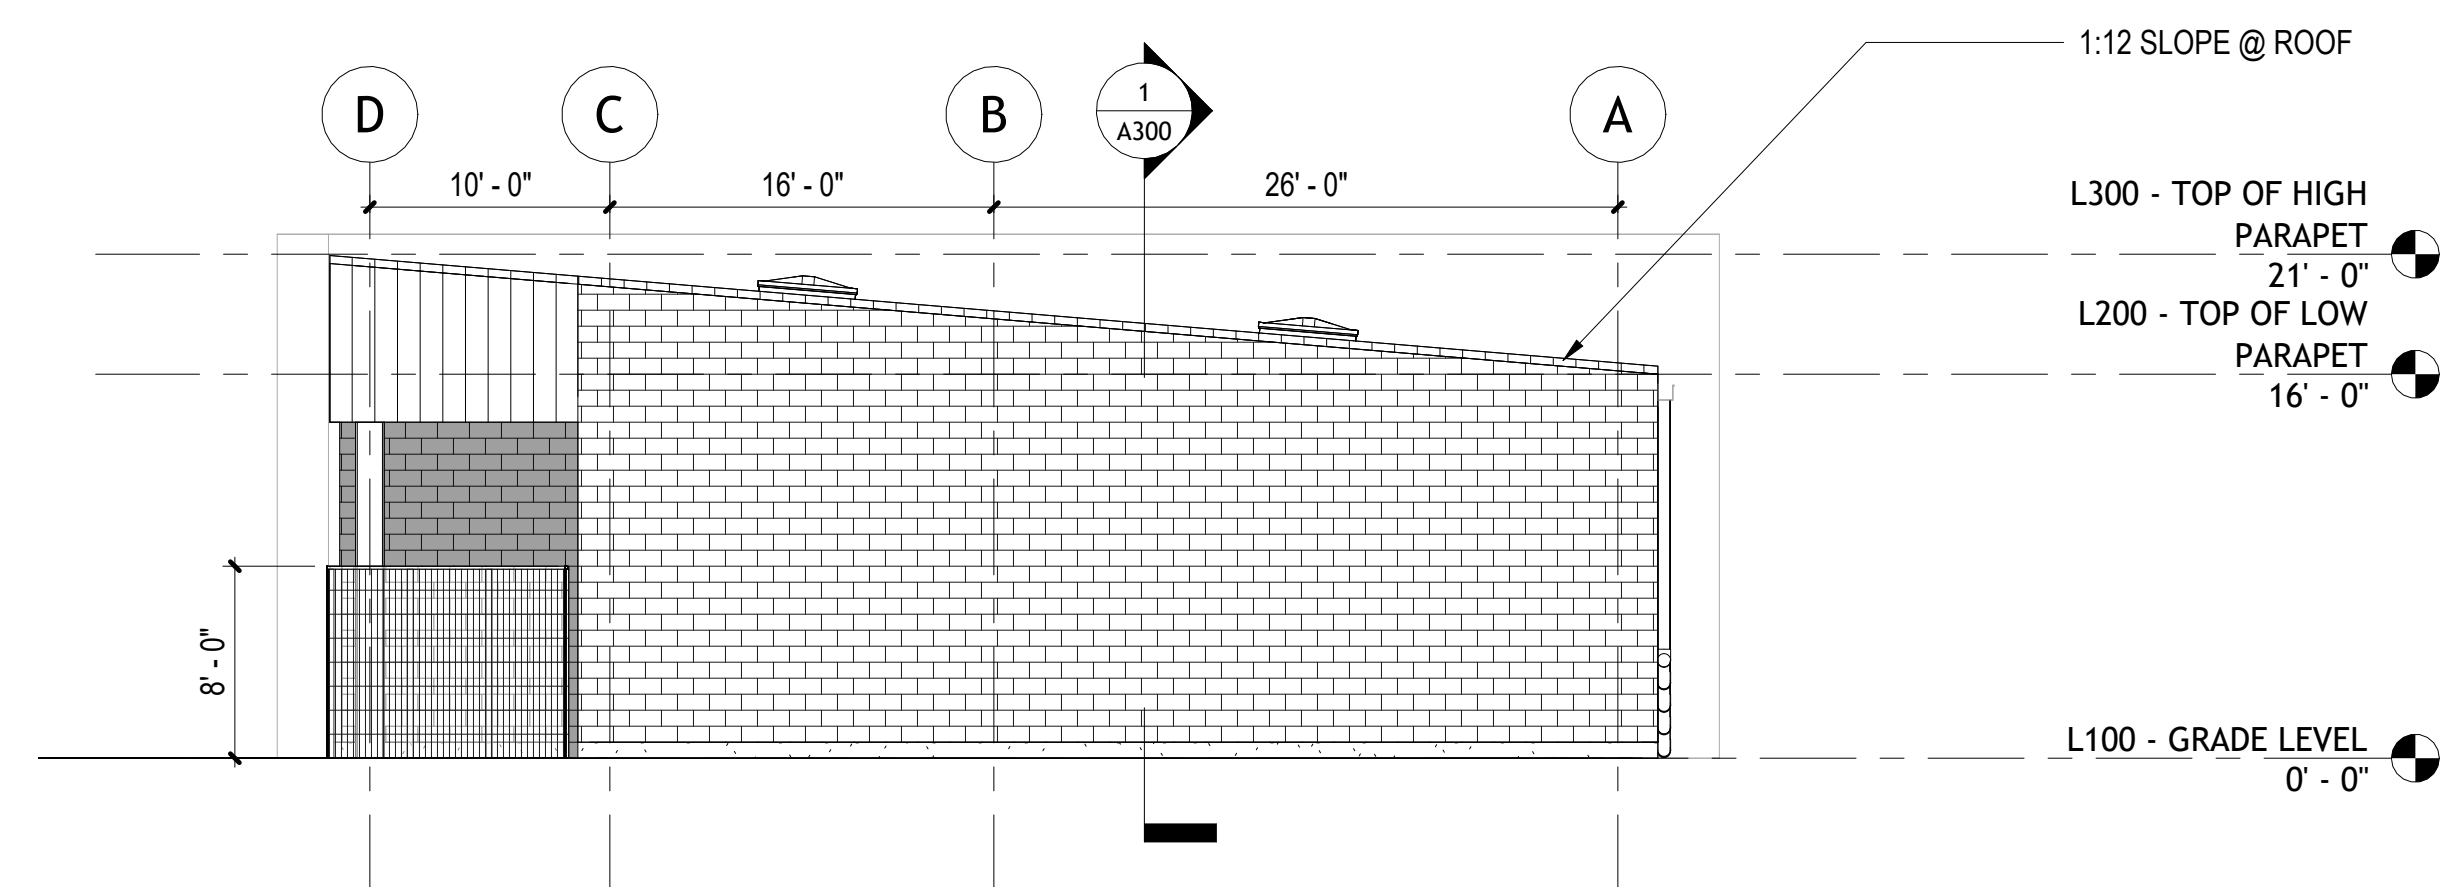


3 ELEVATION - SOUTH
A200 1/8" = 1'-0"

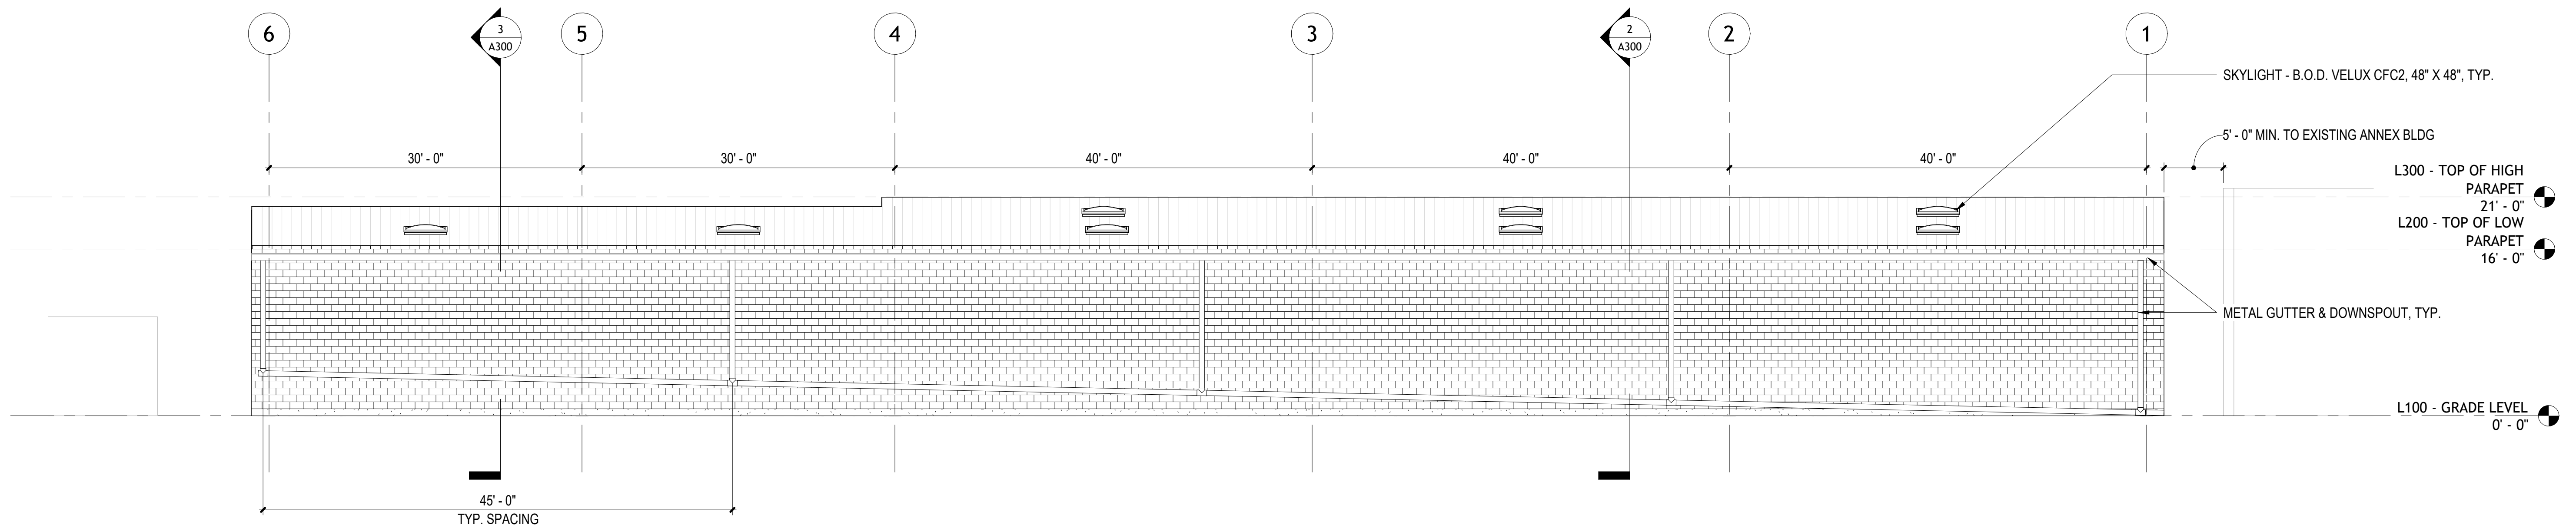


2 ELEVATION - EAST
A200 1/8" = 1'-0"

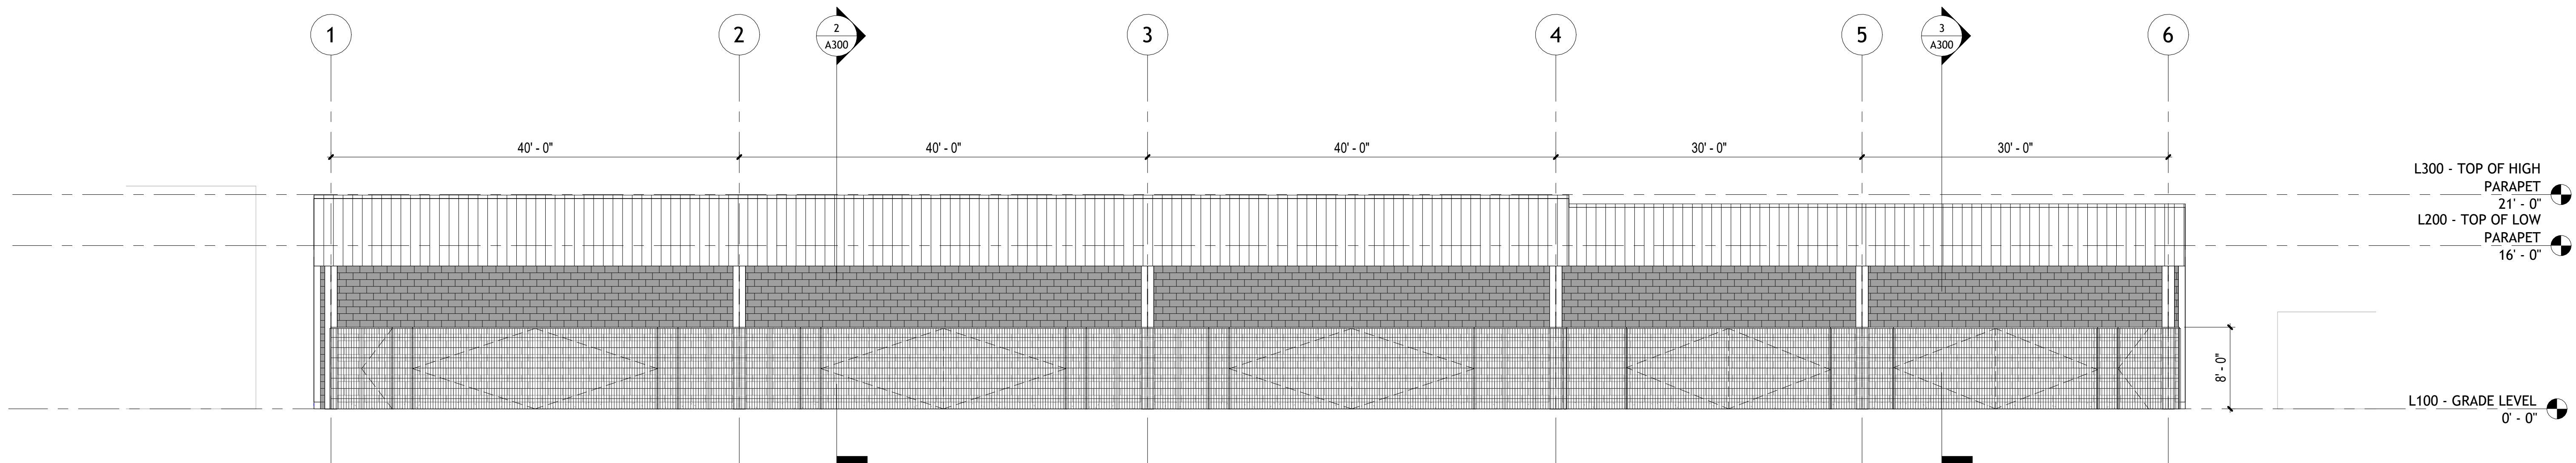


1 ELEVATION - WEST
A200 1/8" = 1'-0"

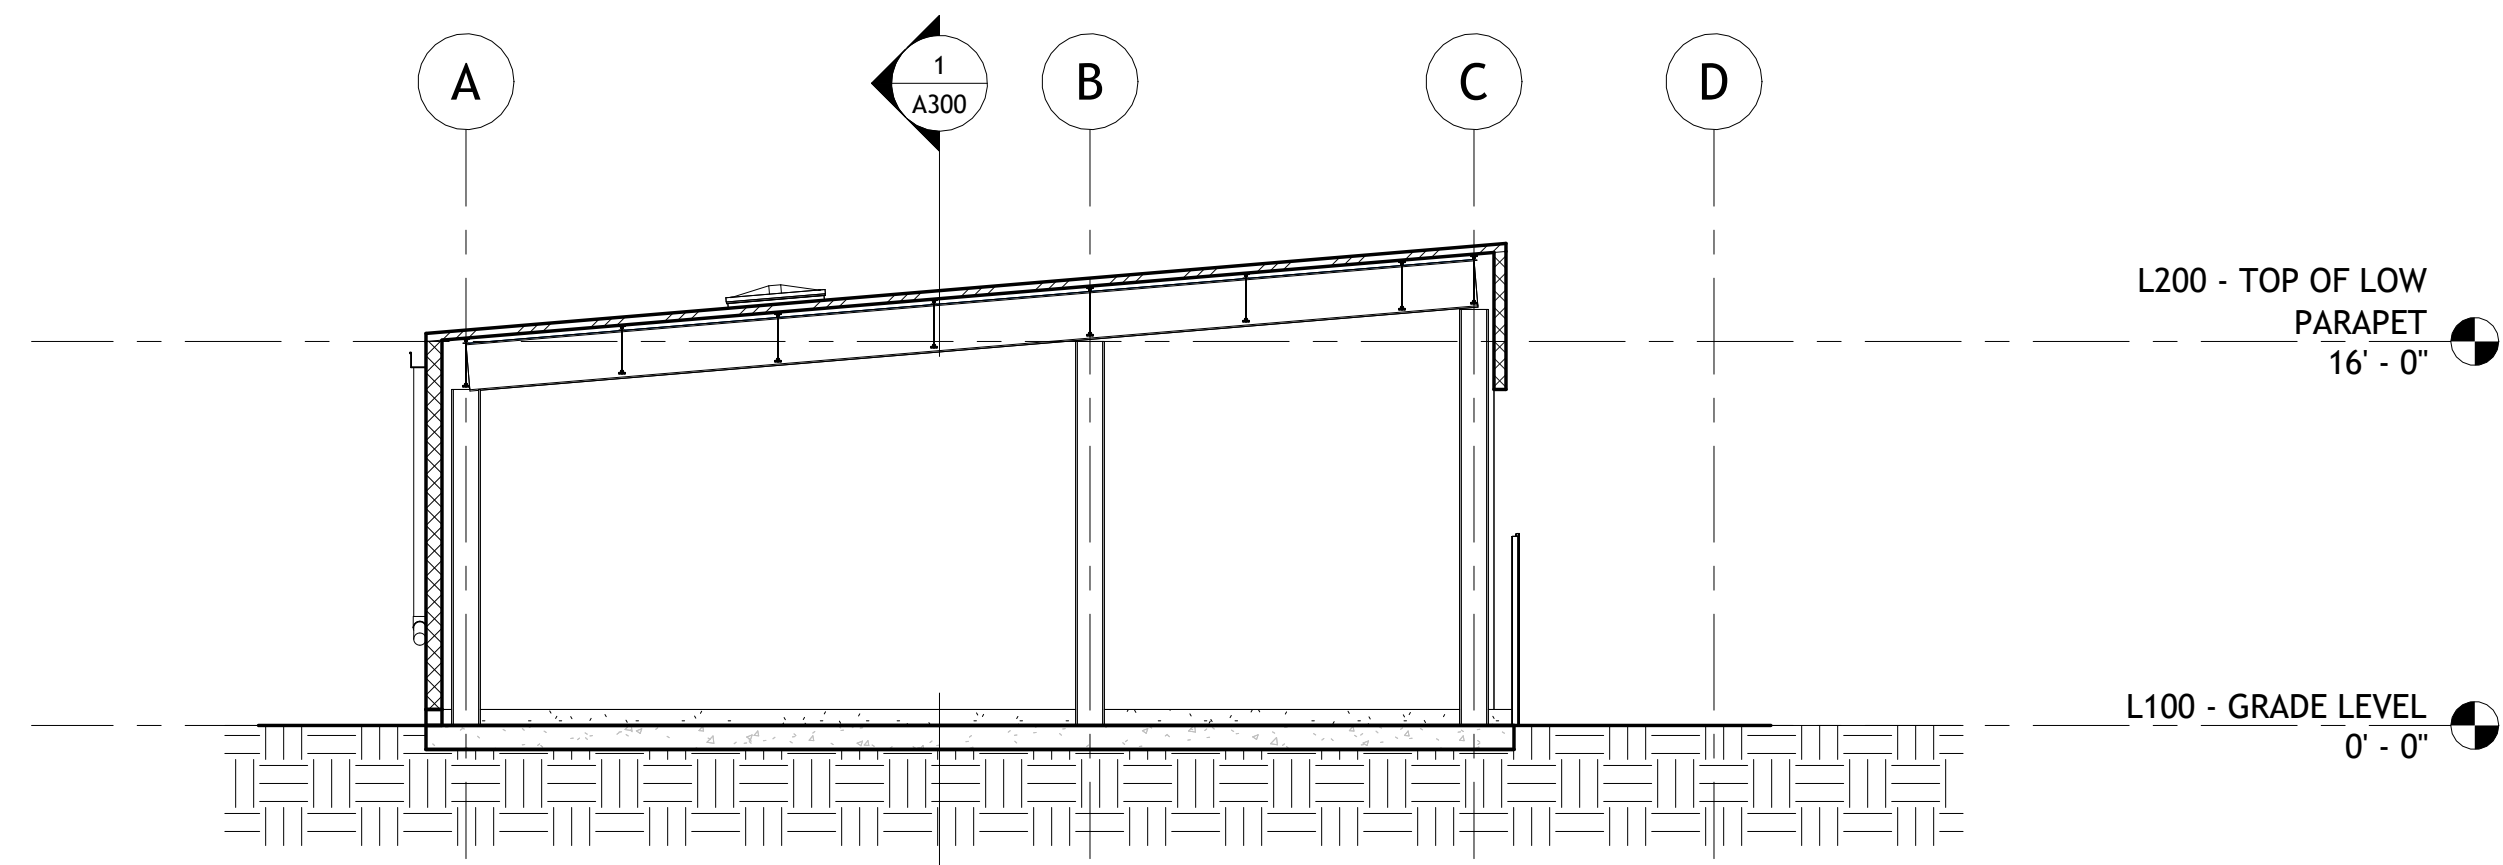


SECTION - TRANSVERSE -
PROJECT SOUTH
1/8" = 1'-0"

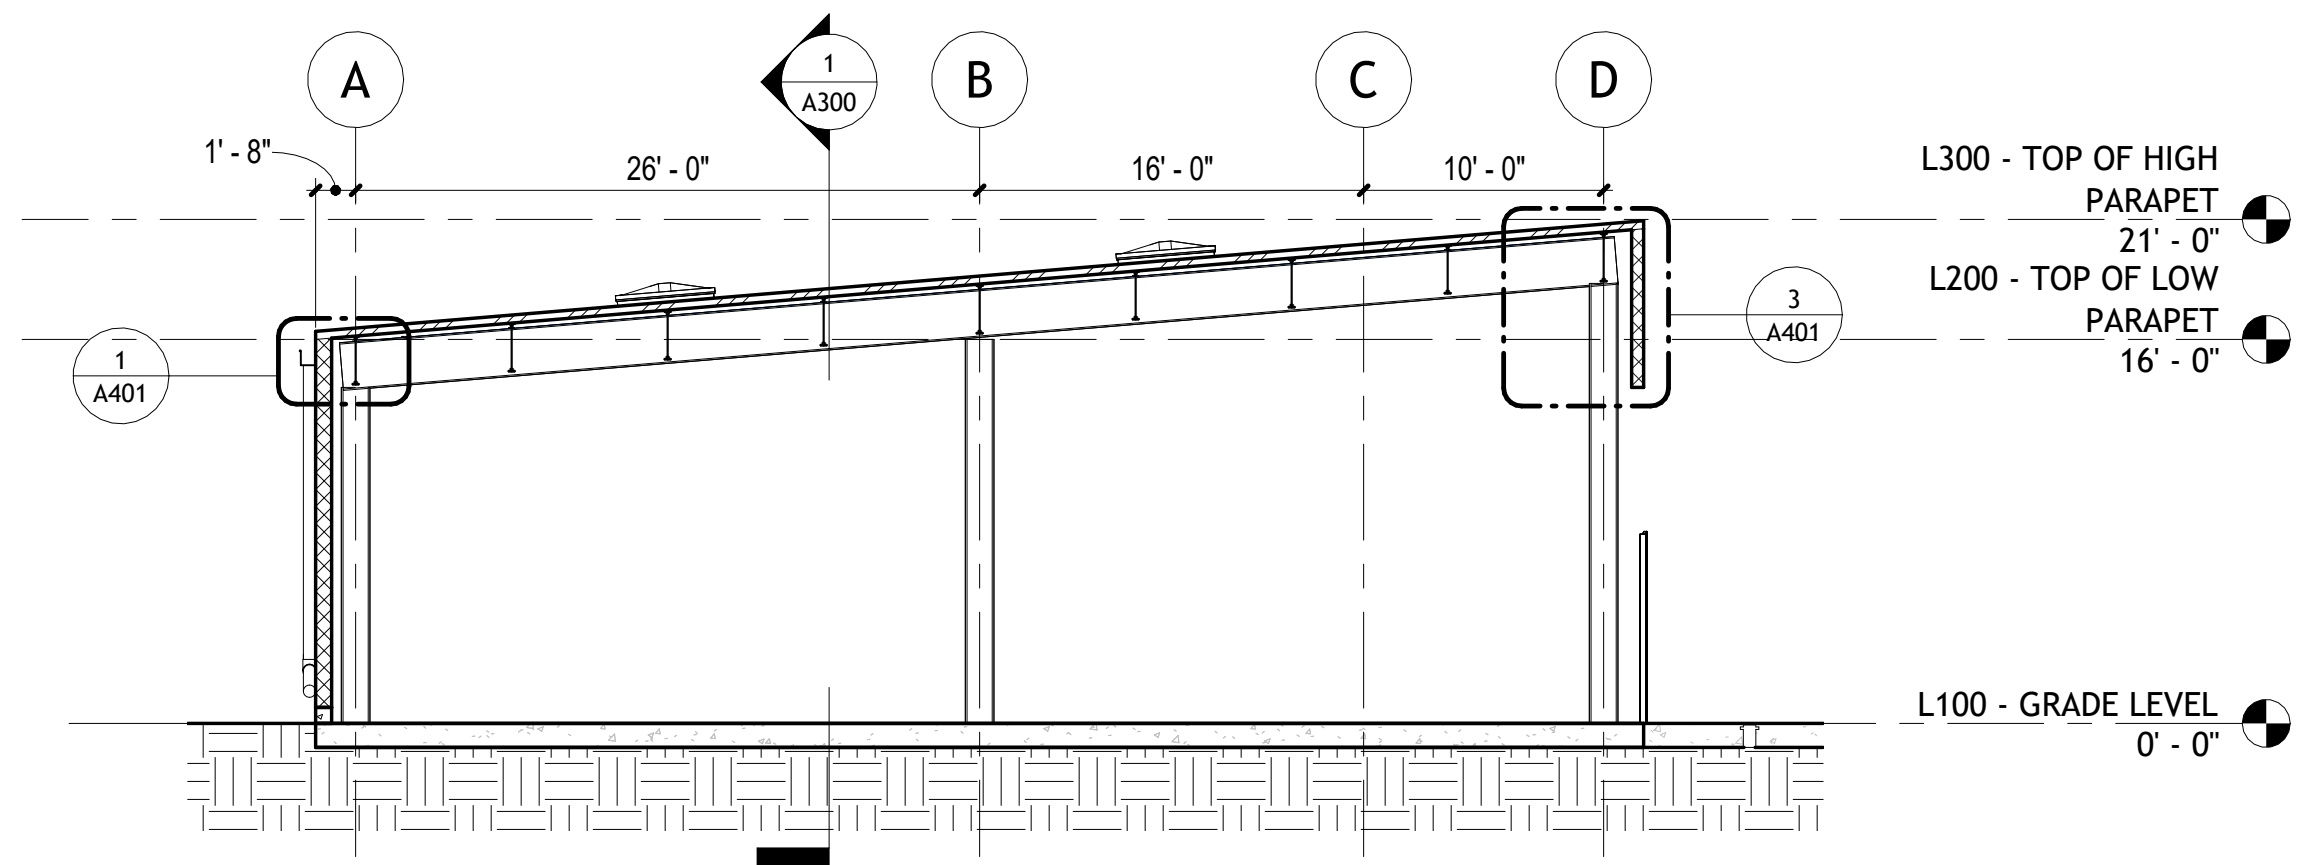


SECTION - TRANSVERSE -
PROJECT NORTH
1/8" = 1'-0"

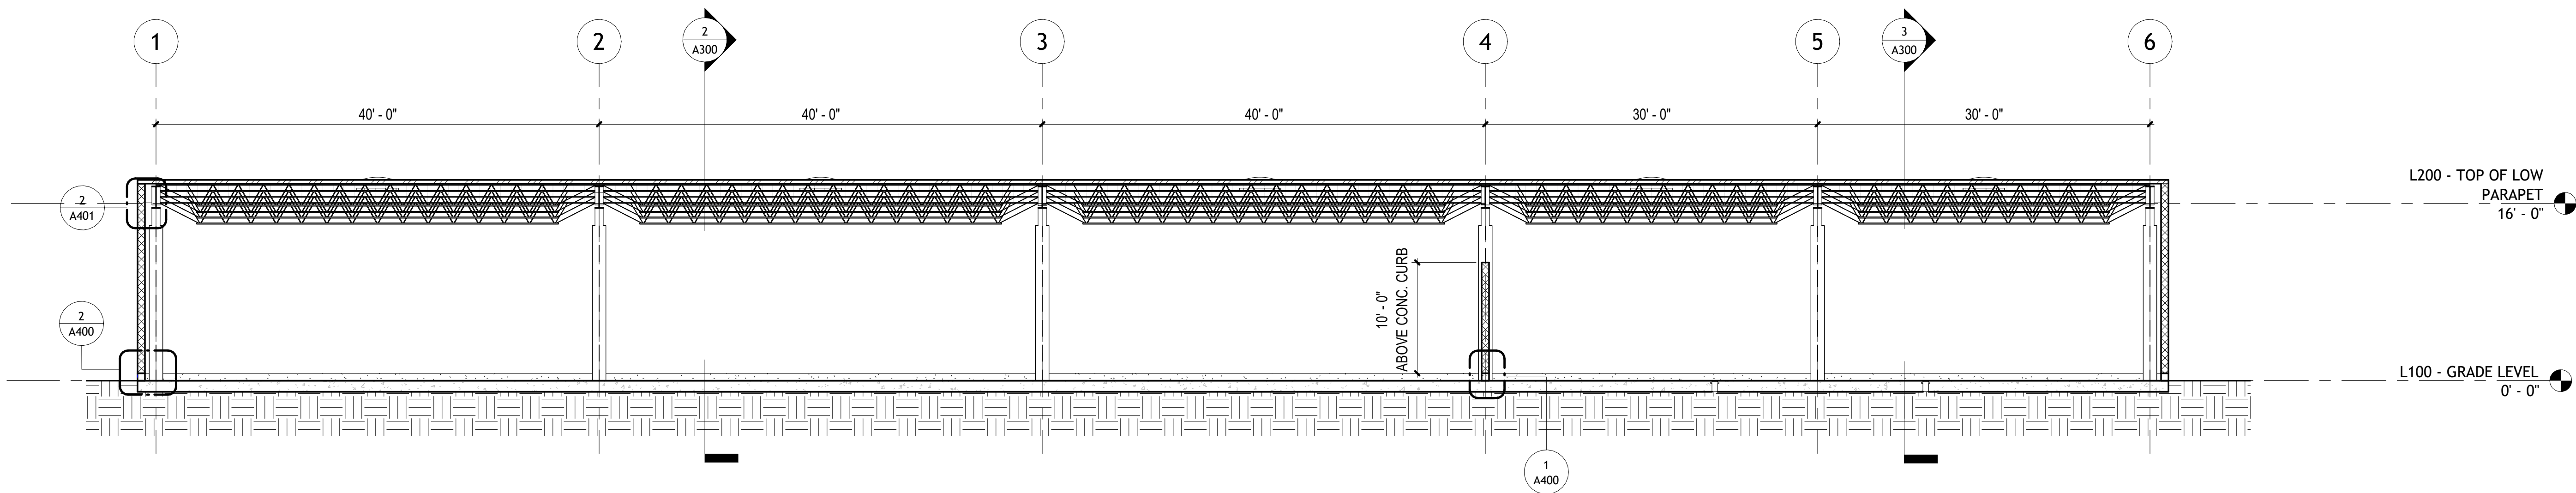

SECTION - LONGITUDINAL
1/8" = 1'-0"

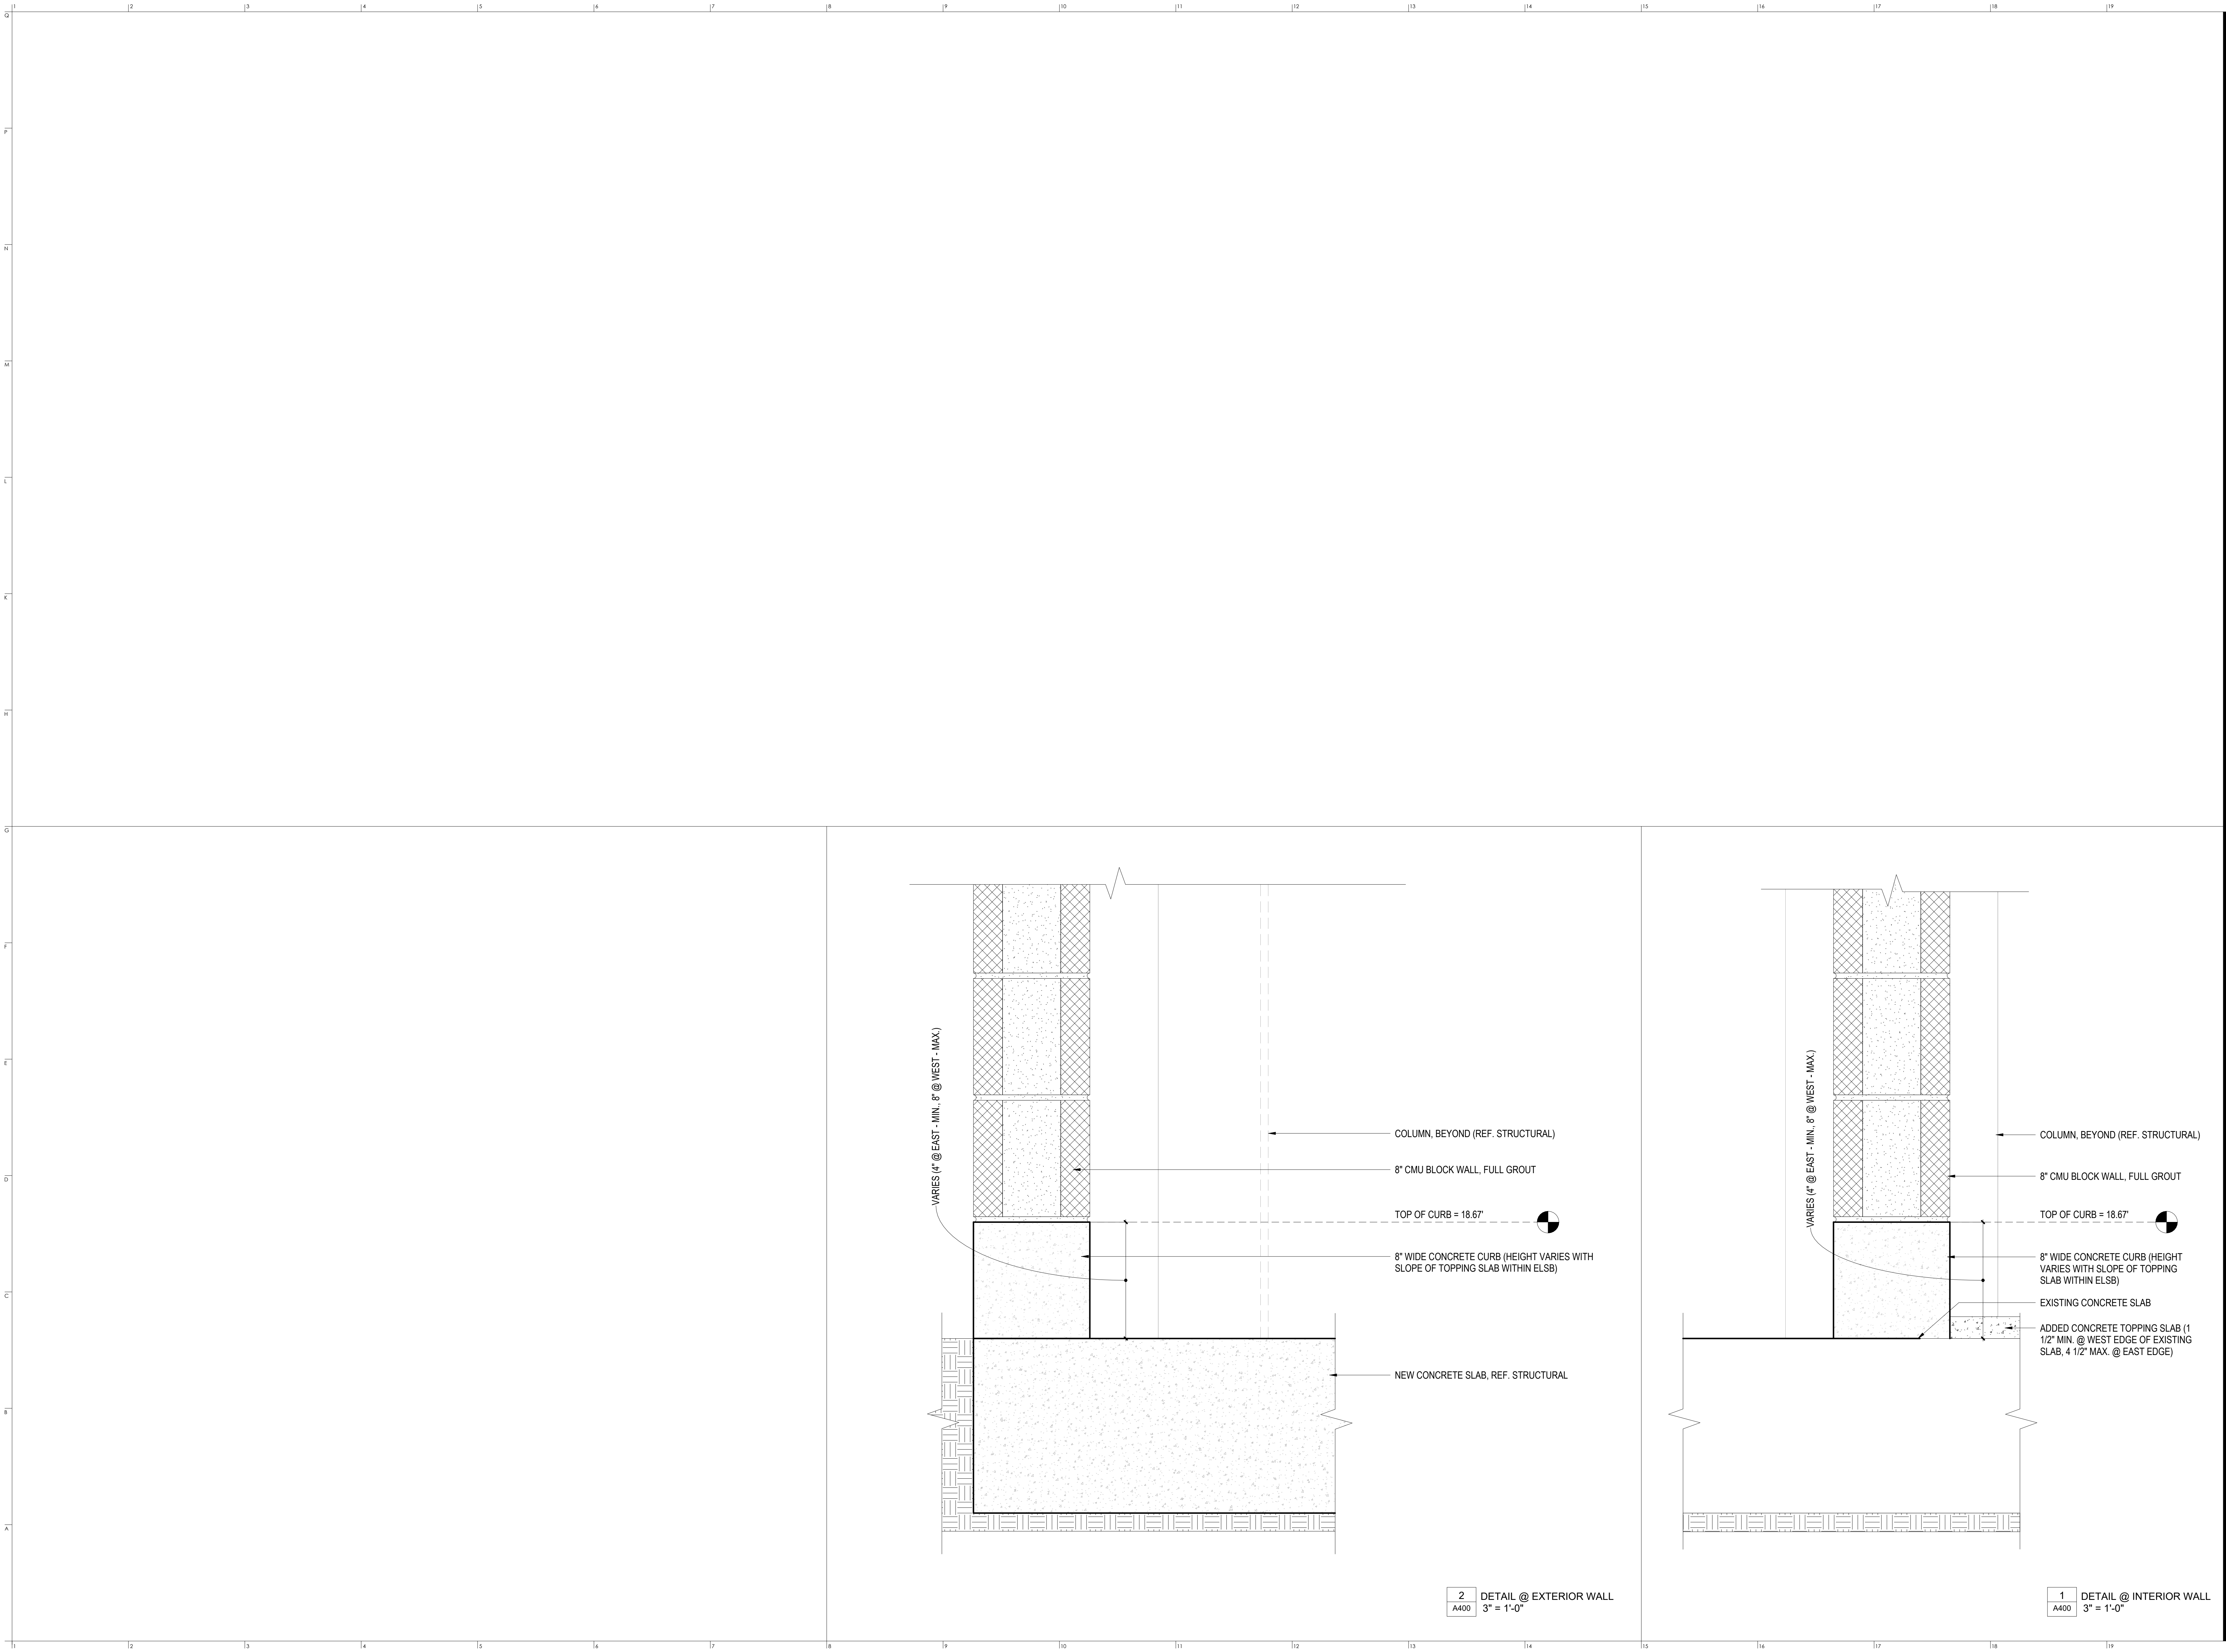

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

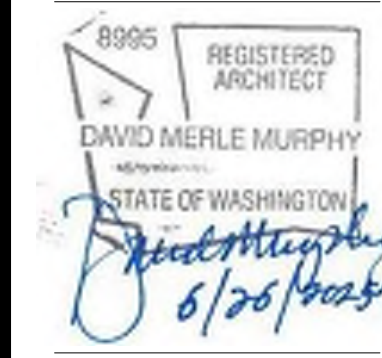

DATE:
6/26/2025

DRAWINGS ISSUED FOR:
PERMIT SET




title:
FOOTING & FOUNDATION DETAILS
crawford project no. : K033725

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1804 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8295

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-5156

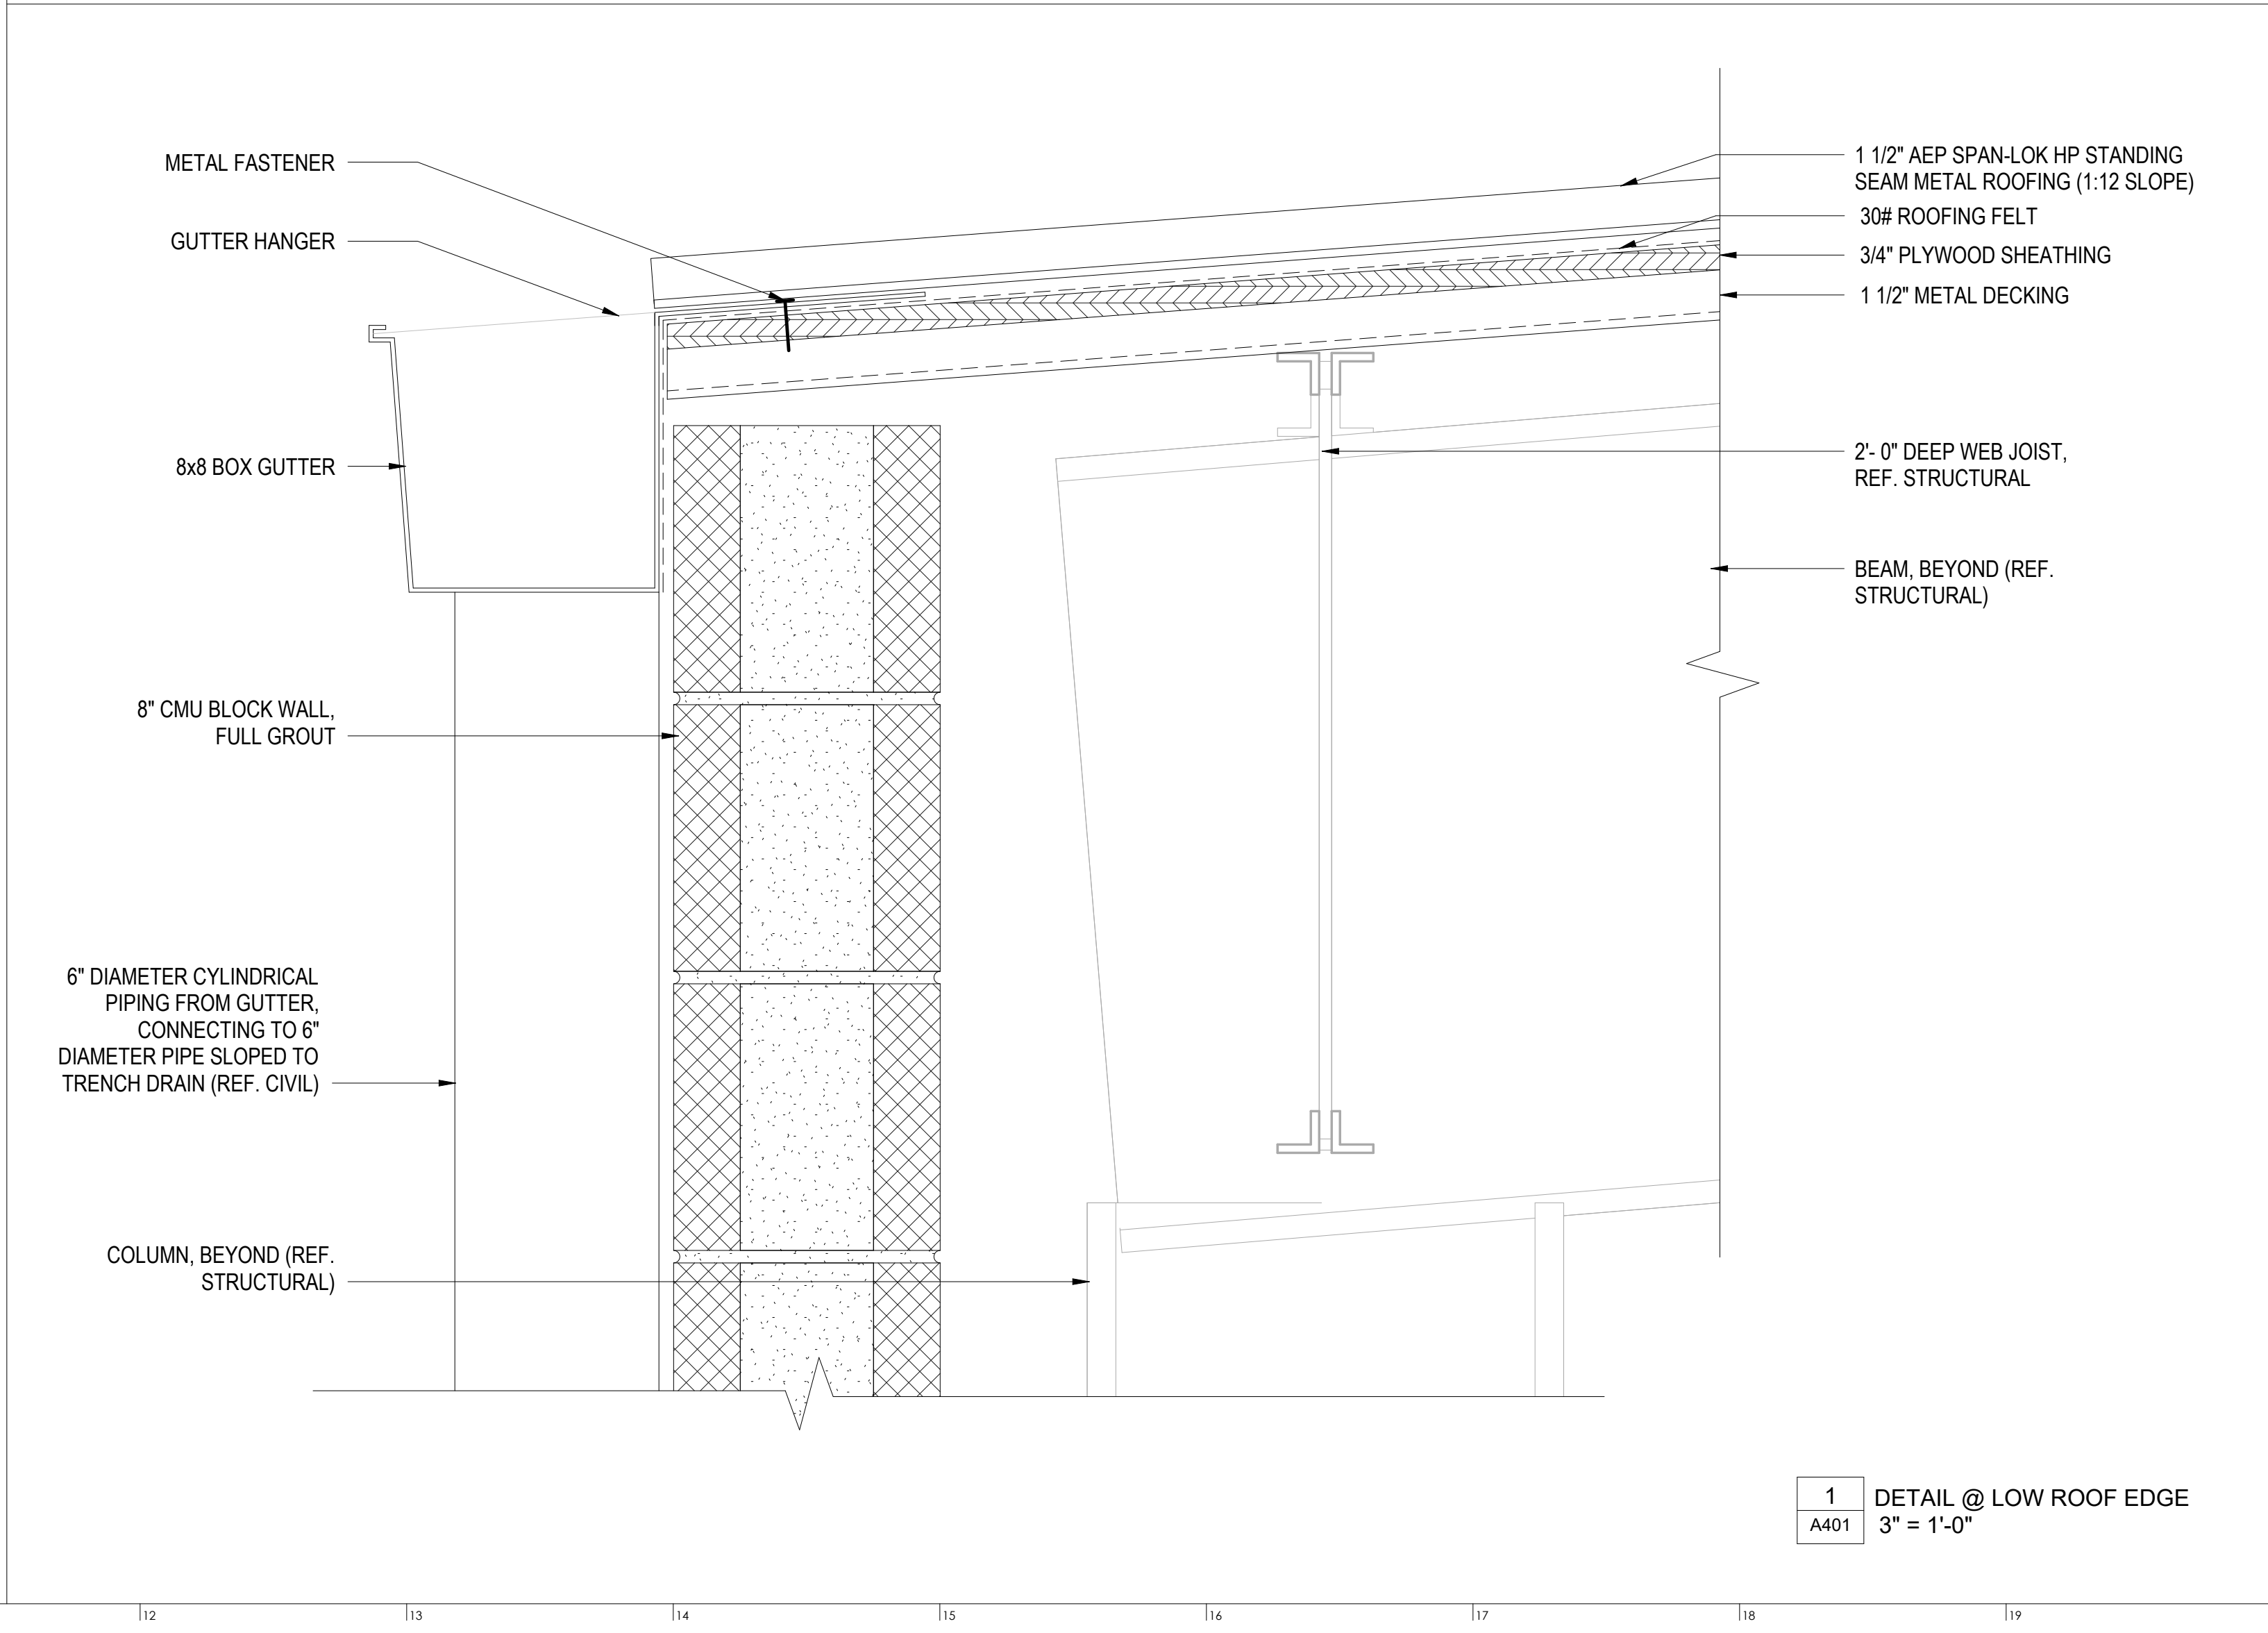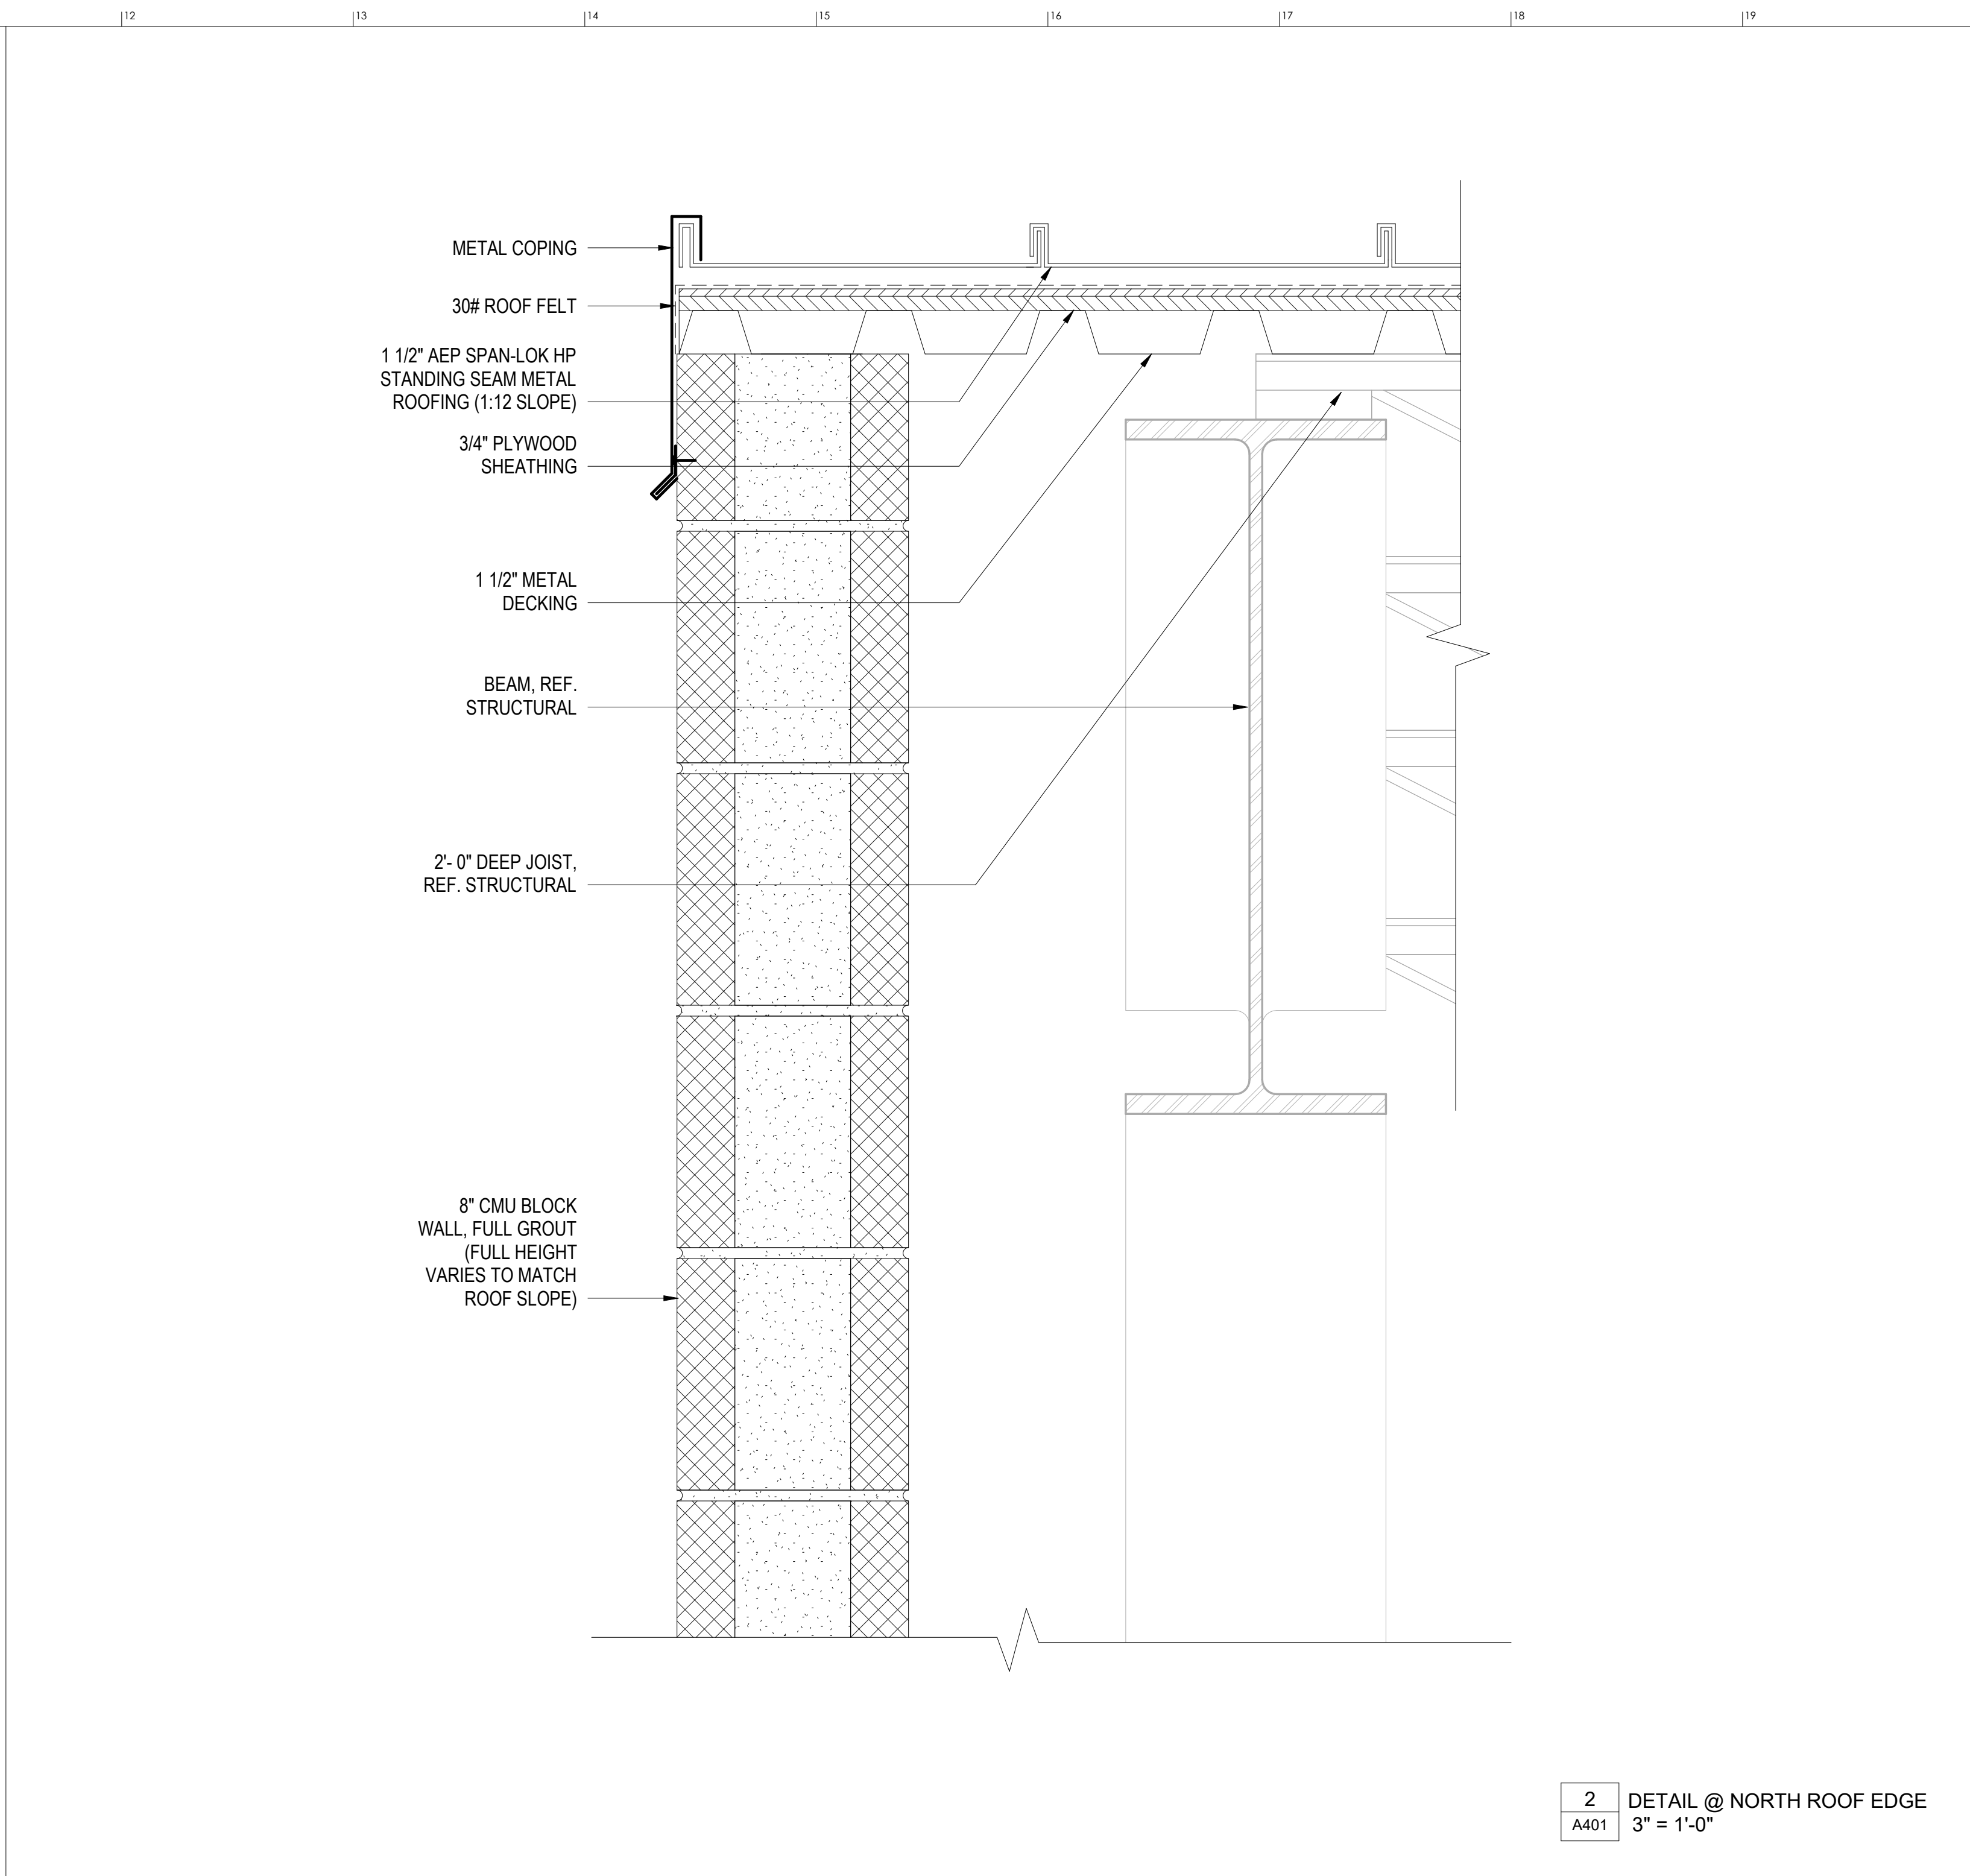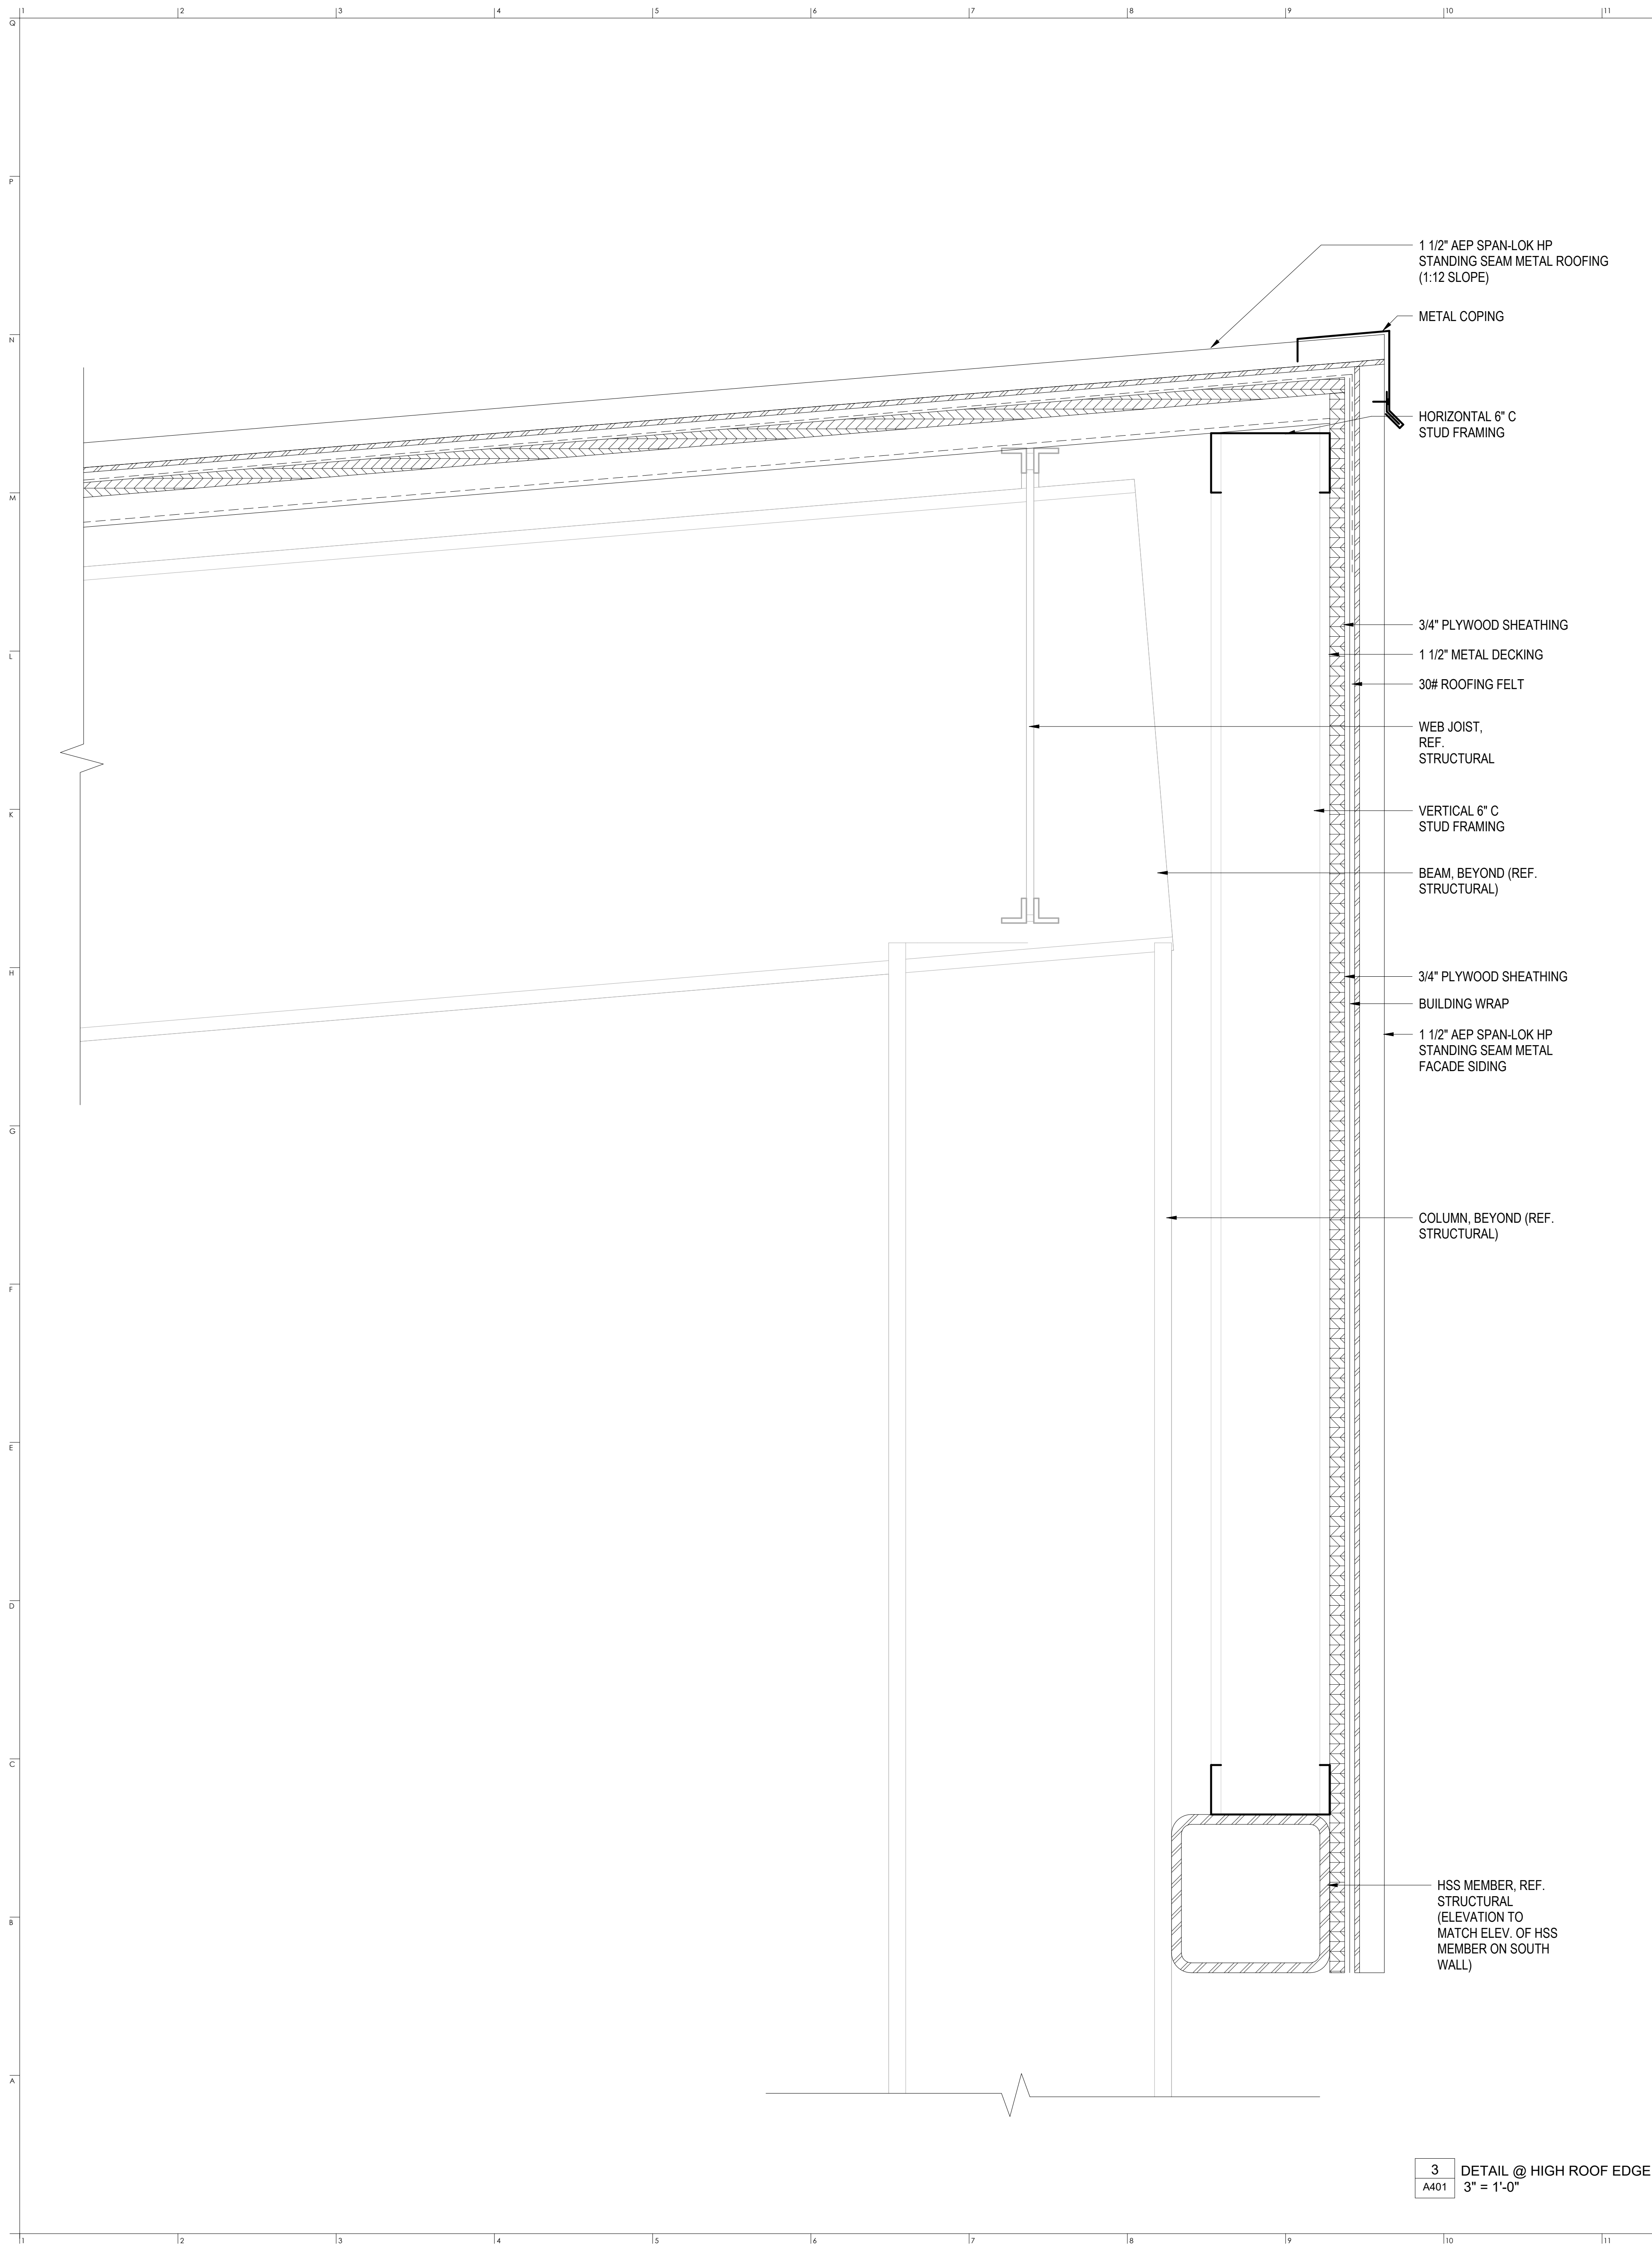

11
G
F
N
K
L
H
G
F
E
D
C
B
A

12

13

14

15

16

17

18

19

10

11

12

13

14

15

16

17

18

19



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1804 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8295


STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-5156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134



DATE:
6/26/2025

DRAWINGS ISSUED FOR:
PERMIT SET
title:
SKYLIGHT DETAILS
crawford project no.: K043725

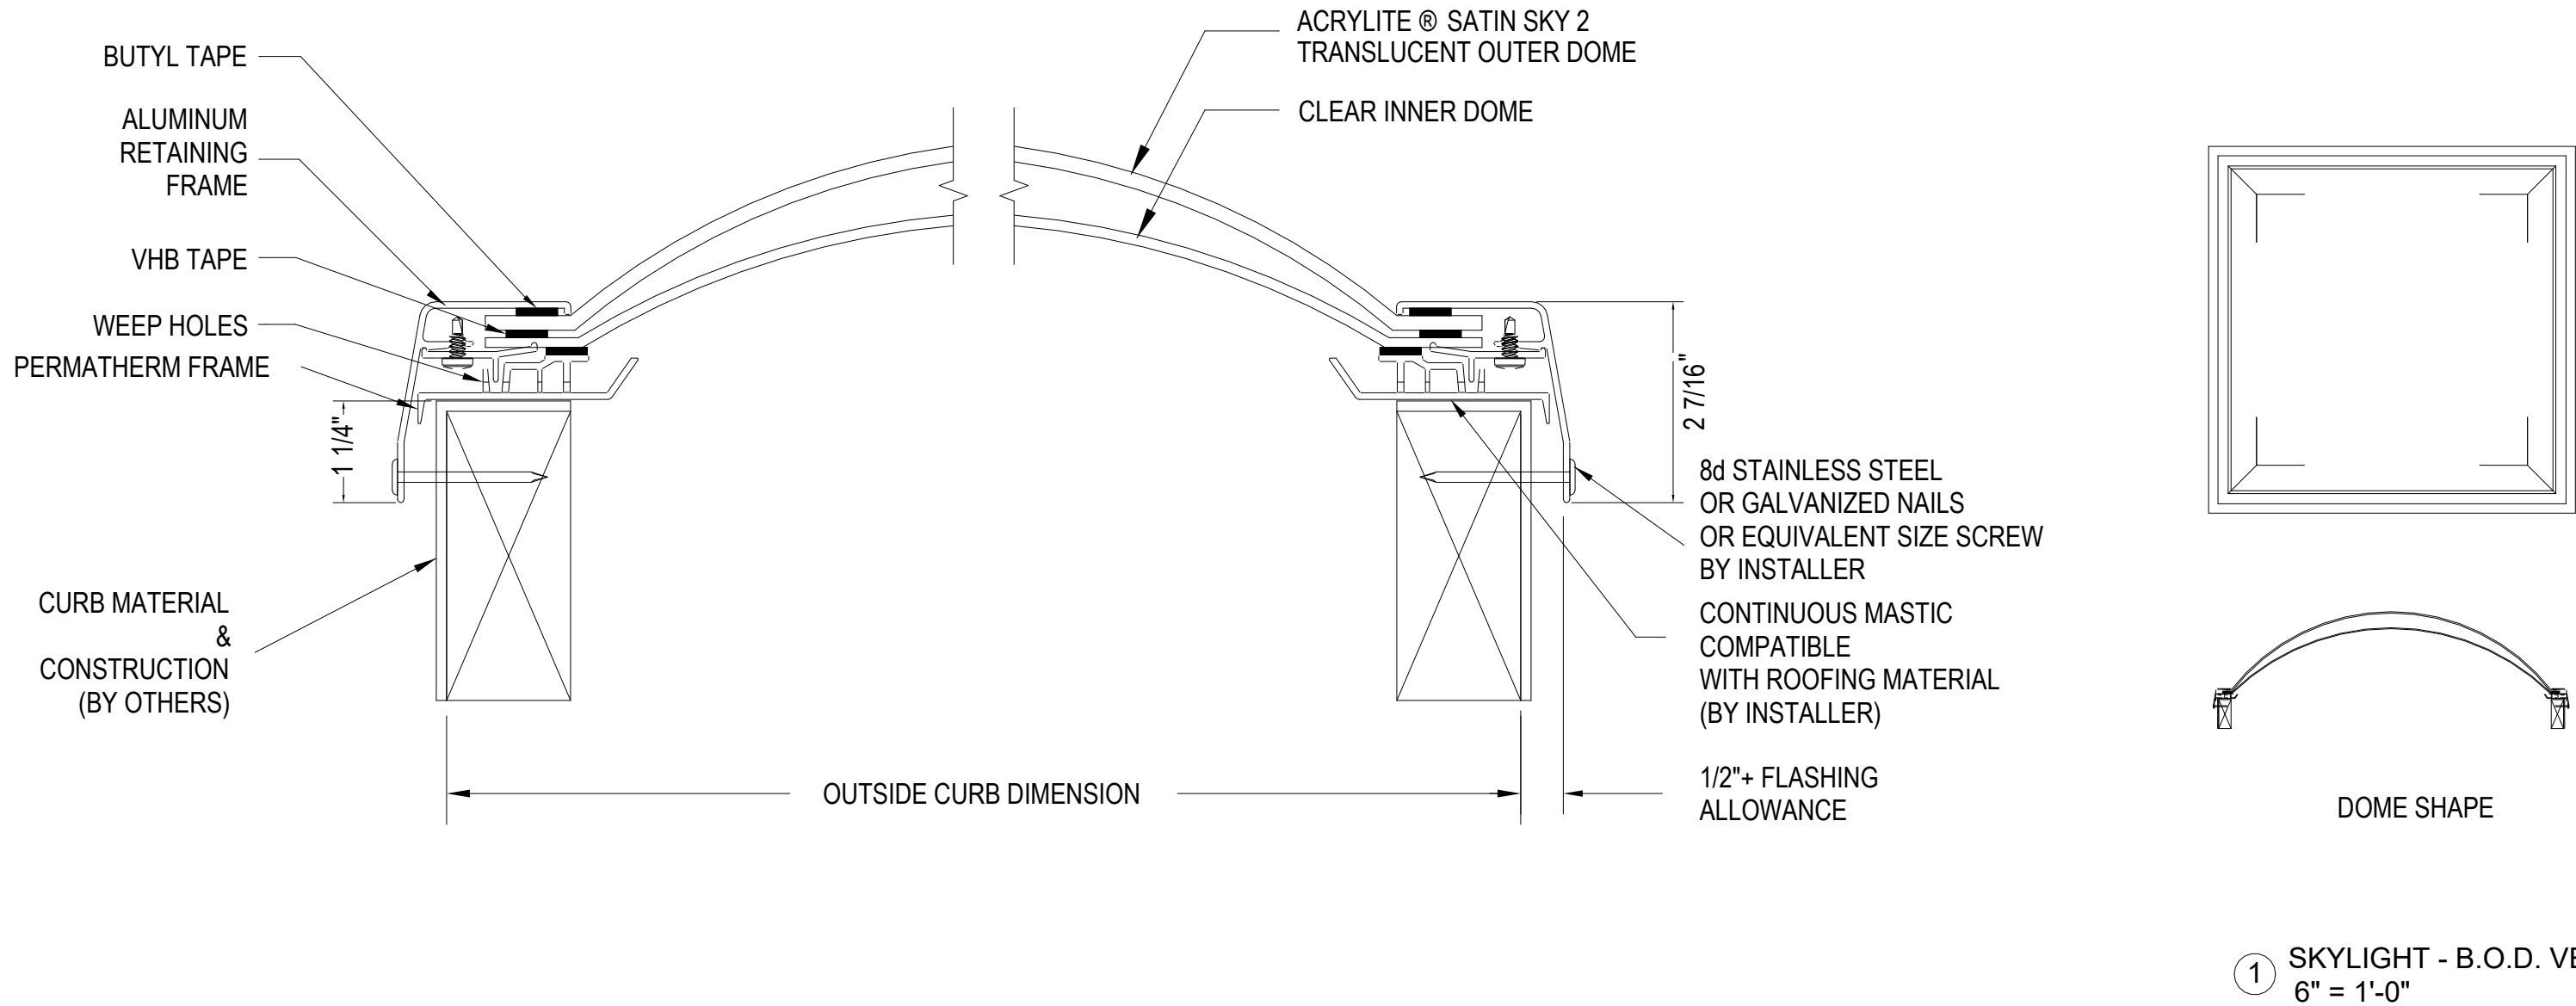

6/25/2025 1:31 PM USER: cdp PATH: J:\LumenField\North\cd\CH\ELSB\CO.0X.dwg LAYOUT: CO.01

LEGEND	
DESCRIPTION	SYMBOL
LIMITS OF WORK	-----
PROPERTY LINE	- - - - -
EASEMENT LINE	-----
CENTERLINE	-----
BOLLARD	●
LIGHT POST FOUNDATION	■
CENTERLINE TYPE 1 CONDUIT	-----
CENTERLINE TYPE 2 CONDUIT	-----
CENTERLINE TYPE 3 CONDUIT	-----
CENTERLINE TYPE 4 CONDUIT	-----
COORDINATE POINT	N 1,433,544.34 E 2,454,789.02
BUILDING	
TREE PROTECTION FENCE	—□—□—

SITE HATCHES	
CONCRETE PAVEMENT PATCH	
ASPHALT PAVEMENT PATCH	
LIGHT-DUTY/PEDESTRIAN CONCRETE PAVEMENT	
HEAVY-DUTY CONCRETE PAVEMENT	
EXPOSED BOLLARD FOUNDATION	
3" MIN STAMPED ASPHALT OVERLAY	
ASPHALT OVERLAY	
CONCRETE OVERLAY	

DEMOLITION LEGEND	
DESCRIPTION	SYMBOL
ITEM TO BE REMOVED	-----
ITEM TO REMAIN	- - - - -
CAP UTILITY, SEE SITE DEMOLITION	-----□-----
REMOVE EXISTING ASPHALT PAVEMENT	
REMOVE EXISTING CONCRETE PAVEMENT	

ABBREVIATIONS							
&	AND	D, Δ	DEFLECTION ANGLE	LB	POUND	RW	RECYCLED WATER
@	AT	DB	DUCTBANK	LF	LINEAR FEET		
Δ, D	DEFLECTION ANGLE	DEG, ^	DEGREE	LOC	LOCATE (-D), LOCATION	S	SLOPE, SOUTH
^, DEG	DEGREE	DEMO	DEMOLISH			SCHED	SCHEDULE
~, DIA	DIAMETER		DEMOLITION	LP	LOW POINT	SD	STORM DRAIN
#	NUMBER	DEPT	DEPARTMENT	LT	LEFT	SDM	STORM DRAIN MANHOLE
%	PERCENT	DET	DETAIL	LVL	LEVEL		
f _c	CONCRETE COMPRESSIVE STRENGTH	DI	DUCTILE IRON			SE	SOUTHEAST
		DIA, ~	DIAMETER	MATL	MATERIAL	SECT	SECTION
		DIAG	DIAGONAL	MAX	MAXIMUM	SHT	SHEET
fy	REINFORCING STEEL YIELD STRENGTH	DICA	DRILLED-IN CONCRETE ANCHOR	MECH	MECHANICAL	SIM	SIMILAR
		DIM	DIMENSION	MFR	MANUFACTURE (-R)	SOG	SLAB ON GRADE
ABAN	ABANDON (-ED)	DIR	DIRECTION	MH	MANHOLE	SPC	SPACE
AC	ASBESTOS CEMENT, ASPHALT CONCRETE/CEMENT	DOM	DOMESTIC	MIC	MONUMENT IN CASE	SPEC	SPECIFICATION
		DS	DOWNSPOUT	MIN	MINIMUM, MINUTE	SQ	SQUARE
AD	AREA DRAIN	DWG	DRAWING	MISC	MISCELLANEOUS	SS	SANITARY SEWER
ADA	AMERICANS WITH DISABILITIES ACT	DWL	DOWEL	MJ	MECHANICAL JOINT	SSMH	SANITARY SEWER MANHOLE
		DWY	DRIVEWAY	ML	MATCHLINE		
ADDL	ADDITIONAL			MON	MONUMENT	ST	STREET
ADJ	ADJACENT, ADJUST (-ED, -MENT, -ABLE)	(E)	EXISTING	MSE	MECHANICALLY STABILIZED EARTH	STA	STATION
AGGR	AGGREGATE	E	EAST (-ING)			STD	STANDARD
ALT	ALTERNATE	EA	EACH	MUTCD	MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES	STL	STEEL
		ECC	ECCENTRIC			STRUC	STRUCTURAL, STRUCTURE
ALTRN	ALTERNATIVE	ECR	END CURB RETURN			SW	SOUTHWEST
ALT	ALTERNATIVE	EC	EXISTING GRADE	N	NORTH (-ING)	SYM	SYMMETRICAL
APPD	APPROVED	EJ	EXPANSION JOINT	NA	NOT APPLICABLE		
APPROX	APPROXIMATE (-LY)	EL	ELEVATION	NE	NORTHEAST	TB	THRUST BLOCK
ARCH	ARCHITECT (-URAL)	ELEC	ELECTRICAL	NIC	NOT IN CONTRACT	TC	TOP OF CURB
ASPH	ASPHALT	EMBED	EMBED (-DED, -MENT)	NOM	NOMINAL	TD	TRENCH DRAIN
ASSY	ASSEMBLY	ENGR	ENGINEER	NTS	NOT TO SCALE	TEMP	TEMPORARY
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS	EOR	ENGINEER OF RECORD	NW	NORTHWEST	TESC	TEMPORARY EROSION AND SEDIMENT CONTROL
		EQ	EQUAL			TOF	TOP OF FOOTING
		EQUIP	EQUIPMENT	OC	ON CENTER	TOW	TOP OF WALL
ATB	ASPHALT TREATED BASE	ESMT	EASEMENT	OD	OUTSIDE DIAMETER	TYP	TYPICAL
AVE	AVENUE	EST	ESTIMATE (-D)	OL	OVERLAY		
		EVC	END VERTICAL CURVE	OPNG	OPENING	UNO	UNLESS NOTED OTHERWISE
		EW	EACH WAY	OPP	OPPOSITE (HAND)	UTIL	UTILITY
BCR	BEGIN CURB RETURN	EXCAV	EXCAVATION	OPT	OPTION (-AL)		
BFP	BACK FLOW PREVENTER	EXIST	EXISTING	ORIG	ORIGINAL	V	VERTICAL
		EXP	EXPANSION	OWS	OIL/WATER SEPARATOR	VAC	VACUUM
BLDG	BUILDING	EXT	EXTERIOR			VB	VALVE BOX
BLK	BLOCK (-ING)			PC	POINT OF CURVATURE	VC	VERTICAL CURVE
BM	BEAM, BENCH MARK	FD	FOUNDATION DRAIN, FOOTING DRAIN	PCC	POINT OF COMPOUND CURVATURE, PORTLAND CEMENT CONCRETE	VDM	VERTICAL DRAINAGE
BMP	BEST MANAGEMENT PRACTICE	FDC	FIRE DEPARTMENT CONNECTION				
BOL	BOLLARD	FDN	FOUNDATION			VERT	VERTICAL
BOT	BOTTOM	FF	FINISHED FLOOR	PED	PEDESTRIAN	VIF	VERIFY IN FIELD
BOW	BOTTOM OF WALL	FG	FINISHED GRADE	PERF	PERFORATED	VOL	VOLUME
BSMT	BASEMENT	FH	FIRE HYDRANT	PERP	PERPENDICULAR	VTB	VERTICAL THRUST BLOCK
BTWN	BETWEEN	FIN	FINISH (-ED)	PI	POINT OF INTERSECTION		
BVC	BEGIN VERTICAL CURVE	FL	FLOOR, FLOWLINE, FLANGE	PIV	POST INDICATOR	W	WATER, WEST, WIDTH
		FM	FORCE MAIN			W/	WITH
CANT	CANTILEVER	FT	FOOT, FEET	PL	PROPERTY LINE, PLATE	W/O	WITHOUT
CB	CATCH BASIN	FTG	FOOTING			WHT	WHITE
CC	CENTER TO CENTER			PLUMB	PLUMBING	WP	WORK POINT
CDF	CONTROLLED DENSITY FILL	G	GAS, GUTTER	POLY	POLYETHYLENE	WPJ	WEAKENED PLANE JOINT
		GA	GAGE, GAUGE	PRC	POINT OF REVERSE CURVATURE	WS	WATER SURFACE
CFS	CUBIC FEET PER SECOND	GAL	GALLON	PROP	PROPERTY	WT	WEIGHT
CI	CAST IRON	GALV	GALVANIZE (-D)	PROT	PROTECTION	WWF	WELDED WIRE FABRIC
CIP	CAST-IN-PLACE	GB	GRADE BREAK	PSF	POUNDS PER SQUARE FOOT	YD	YARD
CJ	CONSTRUCTION JOINT	GEN	GENERAL			YEL	YELLOW
CL	CENTERLINE	GPM	GALLONS PER MINUTE	PSI	POUNDS PER SQUARE INCH		
CLR	CLEAR (-ANCE)	GV	GATE VALVE	PT	POINT OF TANGENCY, POINT		
CMP	CORRUGATED METAL PIPE	H	HORIZONTAL			PV	POWER VAULT
CNR	CORNER	HDPE	HIGH DENSITY POLYETHYLENE			PVC	POLYVINYL CHLORIDE
CO	CLEAN OUT					PVI	POINT OF VERTICAL INTERSECTION
COL	COLUMN	HH	HANDHOLE	PVMT	PAVEMENT	Q	FLOW RATE
COMB	COMBINATION	HMA	HOT MIX ASPHALT			R	RADIUS
COMM	COMMUNICATION	HORIZ	HORIZONTAL			RCMD	RECOMMEND (-ED)
CON	CONCENTRIC	HP	HIGH POINT			RCP	REINFORCED CONCRETE PIPE
CONC	CONCRETE	HT	HEIGHT			RED	REDUCER, REDUCING
COND	CONDUIT, CONDITION	HTB	HORIZONTAL THRUST BLOCK			REF	REFER (-ENCE)
CONN	CONNECT (-ION)	HYD	HYDRANT			REINF	REINFORCE (-D, -MENT), REINFORCING
CONST	CONSTRUCTION					REQD	REQUIRED
CONT	CONTINUATION, CONTINUE, CONTINUOUS	ID	INSIDE DIAMETER			RET	RETAINING
		IE	INVERT ELEVATION			REV	REVISION
CONTR	CONTRACTOR	INCL	INCLUDE (-D), INCLUDING			RIM	RIM ELEVATION
COORD	COORDINATE, COORDINATION					RJ	RESTRAINED JOINT
CORP	CORPORATION	INT	INTERIOR			RL	RAIN LEADER
COS	CITY OF SEATTLE	INV	INVERT			ROW	RIGHT-OF-WAY
CP	CONTROL POINT, CENTER POINT	IRR	IRRIGATION			RPM	RAISED PAVEMENT MARKER
		JT	JOINT			RT	RIGHT
CTB	CEMENT TREATED BASE						
CTR	CENTER						
CU	CUBIC	LARCH	LANDSCAPE ARCHITECT (-URAL)				
CULV	CULVERT	LAT	LATERAL				
CV	COMM VAULT						

- GENERAL NOTES
- EXISTING CONDITIONS SHOWN ARE PER THE PROJECT SITE SURVEY PROVIDED BY BUSH, ROED & HITCHINGS, INC. DATED 9/13/2024. THE CONTRACTOR SHALL VERIFY THE EXISTING CONDITIONS AND NOTIFY THE OWNER'S REPRESENTATIVE OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION ACTIVITIES.
 - HORIZONTAL DATUM IS NAD 83/2011 (EPOCH 2010). REFER TO THE PROJECT SITE SURVEY FOR ADDITIONAL INFORMATION.
 - VERTICAL DATUM IS NAVD 88 REFER TO THE PROJECT SITE SURVEY FOR ADDITIONAL INFORMATION.
 - THE CONTRACTOR SHALL COMPLY WITH THE RECOMMENDATIONS IN THE GEOTECHNICAL REPORT PROVIDED BY TETRA TECH DATED NOVEMBER 27, 2024.
 - WORK SHALL CONFORM TO THE CITY OF SEATTLE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION, 2020 EDITION, AND THE CITY OF SEATTLE STANDARD PLANS, 2020 EDITION. STANDARDS. A COPY OF THESE DOCUMENTS SHALL BE ON-SITE DURING CONSTRUCTION.
 - THE CONTRACTOR IS RESPONSIBLE FOR TRAFFIC CONTROL DURING CONSTRUCTION.
 - THE LIMITS OF WORK INDICATED ON THE CIVIL DRAWINGS APPLY TO THE CIVIL SITE AND UTILITY WORK. WORK OUTSIDE OF THE LIMITS OF WORK MAY BE REQUIRED BY OTHER DISCIPLINES OR TRADES. UNLESS NOTED OTHERWISE, NO CIVIL-RELATED WORK SHALL BE PERFORMED OUTSIDE THE LIMITS OF WORK WITHOUT PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. ANY WORK ADJACENT TO THE LIMITS OF WORK SHALL BE CARRIED OUT ON THE PROJECT SIDE.
 - THE CONTRACTOR SHALL CONTACT THE UTILITY NOTIFICATION CENTER (1-800-424-5555) A MINIMUM OF THREE DAYS PRIOR TO ANY EXCAVATION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE SERVICES OF A PROFESSIONAL UNDERGROUND UTILITY LOCATION SERVICE TO LOCATE AND MAINTAIN MARKINGS THAT INDICATE LOCATIONS OF UNDERGROUND UTILITIES IN THE CONSTRUCTION AREA.

SHEET LIST	
SHEET NUMBER	SHEET TITLE
C0.01	LEGEND, ABBREVIATIONS, AND DRAWING LIST
C0.02	NOTES
C0.03	OVERALL KEY PLAN
C1.01	TEMPORARY EROSION AND SEDIMENT CONTROL PLAN
C1.02	TEMPORARY EROSION AND SEDIMENT CONTROL PLAN
C2.01	SITE DEMOLITION PLAN
C2.02	SITE DEMOLITION PLAN
C3.01	SITE AND PAVING PLAN
C3.02	SITE AND PAVING PLAN
C4.01	GRADING PLAN
C4.02	GRADING PLAN
C5.01	STORM DRAIN PLAN
C5.02	STORM DRAIN PLAN
C6.01	WATER AND SEWER PLAN
C6.02	WATER AND SEWER PLAN
C8.01	SECTIONS AND DETAILS
C8.02	SECTIONS AND DETAILS
C8.03	SECTIONS AND DETAILS
C8.04	SECTIONS AND DETAILS
C8.05	SECTIONS AND DETAILS
C8.06	SECTIONS AND DETAILS
C8.11	ONSITE STORMWATER MANAGEMENT PLAN





CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98033
tel: 816-421-2640
CIVIL ENGINEER
Magnuson Klemm Assoc.
1301 Fifth Avenue, Suite 2000
Seattle, Washington 98101
tel: 206-215-8200
STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

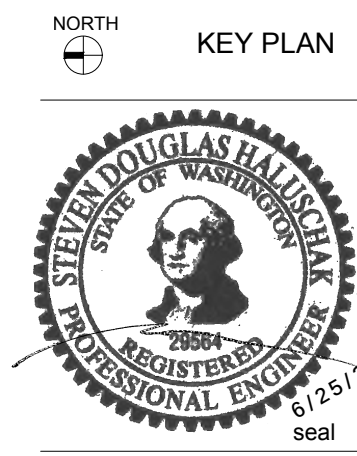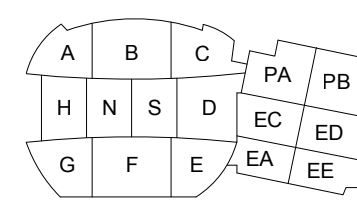

DATE: 6/25/2025
DRAWINGS ISSUED FOR: PERMIT SET
LEGEND, ABBREVIATIONS, AND DRAWING LIST
sheet no. C0.01
© Crawford Architects CA, Inc.

TEMPORARY EROSION AND SEDIMENT CONTROL PLAN NOTES

1. THE TEMPORARY EROSION AND SEDIMENT CONTROL (TESC) PLAN SHALL BE IMPLEMENTED AND APPROVED BY CITY OF SEATTLE PRIOR TO ANY LAND-DISTURBING ACTIVITY ON THE CONSTRUCTION SITE.
2. THE TEMPORARY EROSION AND SEDIMENT CONTROL FACILITIES SHOWN ARE INTENDED TO BE MINIMUM REQUIREMENTS. ADDITIONAL FACILITIES SHALL BE INSTALLED AS NECESSARY AND/OR AS REQUIRED AT THE DISCRETION OF CITY OF SEATTLE.
3. THE IMPLEMENTATION, MAINTENANCE, REPLACEMENT AND ADDITIONS TO THE TEMPORARY EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. ANY DOWNSTREAM DAMAGE DUE TO THE FAILURE BY THE CONTRACTOR TO FULFILL THESE REQUIREMENTS WILL BE THE CONTRACTOR'S LIABILITY.
4. AS CONSTRUCTION PROGRESSES AND SEASONAL CONDITIONS DICTATE, THE TEMPORARY EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE MAINTAINED AND/OR ALTERED AS REQUIRED TO ENSURE CONTINUING EROSION AND SEDIMENT CONTROL. THE TEMPORARY EROSION CONTROL MEASURES SHALL BE MAINTAINED IN A SATISFACTORY CONDITION UNTIL SUCH TIME THAT CONSTRUCTION IS COMPLETE, THE POTENTIAL FOR EROSION HAS PASSED AND THE OWNER'S REPRESENTATIVE HAS GIVEN INSTRUCTIONS TO REMOVE THE EROSION CONTROL MEASURES.
5. ACTIONS MUST BE TAKEN TO MINIMIZE THE TRACKING OF MUD AND SOIL FROM CONSTRUCTION AREAS ONTO PUBLIC ROADWAYS. SEDIMENT SHALL BE REMOVED FROM TRUCKS AND EQUIPMENT PRIOR TO LEAVING THE SITE. IF THE ACTION OF THE VEHICLE TRAVELING OVER THE STABILIZED CONSTRUCTION ENTRANCE IS NOT SUFFICIENT TO REMOVE THE SEDIMENT, THEN THE CONTRACTOR SHALL INSTALL A TIRE WASH FACILITY TO WASH TIRES PRIOR TO MOVING DIRECTLY ONTO A PUBLIC ROAD OR OTHER PAVED AREA. IN THE EVENT OF FAILURE OF THE EROSION CONTROL SYSTEM, RESULTING IN SEDIMENT BEING TRACKED ONTO PAVED SURFACES, STREET SWEEPING SHALL BE EMPLOYED. SOIL TRACKED ONTO THE ROADWAY SHALL BE REMOVED DAILY. STREET SWEEPING IS NOT CONSIDERED A PRIMARY TEMPORARY EROSION AND SEDIMENT CONTROL COMPONENT AND SHALL BE UTILIZED IN THE EVENT OF A FAILURE AND IN ADDITION TO THE PRIMARY TEMPORARY EROSION AND SEDIMENT CONTROL SYSTEMS. IF STREET SWEEPING VEHICLES ARE UTILIZED, THEY SHALL BE OF THE TYPE THAT ACTUALLY REMOVES THE SEDIMENT FROM THE PAVEMENT.
6. THE CONTRACTOR SHALL PLACE CATCH BASIN INSERTS IN CATCH BASINS WITHIN THE LIMITS OF WORK, INCLUDING THOSE SCHEDULED FOR DEMOLITION PRIOR TO THEIR REMOVAL. CATCH BASIN INSERTS MAY BE REQUIRED OUTSIDE THE LIMITS OF WORK.
7. STABILIZE SOILS, INCLUDING STOCKPILES THAT ARE TEMPORARILY EXPOSED, AS SOON AS PRACTICABLE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED, BUT IN NO CASE MORE THAN 14 DAYS AFTER THE CONSTRUCTION ACTIVITY IN THAT PORTION OF THE SITE HAS TEMPORARILY OR PERMANENTLY CEASED.
8. SOIL STOCKPILES SHALL BE LOCATED AWAY FROM CATCH BASINS. STOCKPILES SHALL BE ADEQUATELY CONTAINED.
9. MITIGATION MEASURES SUCH AS DUST SUPPRESSION TECHNIQUES MUST BE IN PLACE DURING DEMOLITION AND CONSTRUCTION EVENTS TO MINIMIZE THE TRACKING AND BROADCASTING OF FUGITIVE PARTICULATE EMISSIONS ONTO PUBLIC ROADWAYS AND ACROSS PROPERTY LINES. THE CONTRACTOR SHALL CONFORM TO ALL CITY, COUNTY, STATE, AND FEDERAL ORDINANCES GOVERNING AIR POLLUTION CONTROL.
10. CONSTRUCTION STORMWATER DISCHARGE FROM THE SITE SHALL MEET THE REQUIREMENTS OF THE CITY OF SEATTLE.
11. THE CONTRACTOR MAY USE ALTERNATIVE METHODS OF TREATMENT OF CONSTRUCTION STORMWATER RUNOFF. THE PROPOSED ALTERNATIVE METHODS MUST MEET THE EFFLUENT QUALITY OUTLINED ABOVE. THE CONTRACTOR SHALL SUBMIT THE ALTERNATE METHODS FOR REVIEW AND APPROVAL PRIOR TO BEGINNING WORK.

SITE DEMOLITION NOTES

1. THE CONTRACTOR SHALL PROVIDE, ERECT AND MAINTAIN ALL TEMPORARY BARRIERS AND SECURITY DEVICES AS NECESSARY FOR THE PROTECTION OF THE ADJACENT PUBLIC IMPROVEMENTS WITHIN THE STREET RIGHT-OF-WAYS.
2. THE CONTRACTOR SHALL COORDINATE THE REMOVAL, ABANDONMENT AND/OR CAPPING OF EXISTING UTILITIES WITH THE APPLICABLE UTILITY AGENCY, INCLUDING BUT NOT LIMITED TO:
 - A. EXISTING WATER CONNECTIONS (SEATTLE PUBLIC UTILITIES).
 - B. EXISTING NATURAL GAS CONNECTIONS (PUGET SOUND ENERGY).
 - C. EXISTING TELEPHONE CONNECTIONS (CENTURY LINK).
 - D. EXISTING SANITARY SEWER (SEATTLE PUBLIC UTILITIES).
 - E. EXISTING POWER CONNECTIONS (SEATTLE CITY LIGHT).
 - F. EXISTING FIBER OPTICS (VARIOUS, CONTRACTOR TO VERIFY).
 - G. EXISTING STORM DRAINAGE (SEATTLE PUBLIC UTILITIES).
3. EXCAVATION FOR REMOVAL OF UTILITIES SHALL BE IN ACCORDANCE WITH THE PROJECT'S MOST RECENT GEOTECHNICAL ENGINEERING REPORT PREPARED BY TETRA TECH, DATED NOVEMBER 27, 2024. THE CONTRACTOR SHALL COMPLY WITH THE REPORT RECOMMENDATIONS.
4. CAP OR PLUG UTILITY SERVICES AT THE LIMITS OF EXCAVATION OR AT THE LIMITS OF DEMOLITION, UNLESS NOTED OTHERWISE.
5. ABANDONMENT OF UTILITY PIPELINES 12 INCHES IN DIAMETER AND LARGER AND ALL UTILITIES THAT CROSS A PUBLIC ROADWAY REGARDLESS OF SIZE SHALL BE BY CAPPING OR PLUGGING THE PIPE ENDS AND PUMPING GROUT FILL MATERIAL INTO THE INTERIOR OF THE PIPELINE USING EQUIPMENT AND MONITORING DEVICES SUFFICIENT TO DETERMINE THE EFFECTIVENESS OF THE GROUTING OPERATION AND TO ENSURE THAT THE PIPELINE IS COMPLETELY FILLED WITH GROUT MATERIAL. THE UTILITY TO BE ABANDONED SHALL FIRST BE CLEARED OF DEBRIS AND DEWATERED TO ENSURE PROPER SETTING OF THE GROUT. THE CONTRACTOR SHALL ESTABLISH AND SUBMIT FOR REVIEW THE GROUT MIXES, EQUIPMENT AND METHODS PROPOSED TO BE USED FOR PLACEMENT OF THE GROUT AND MONITORING OF THE GROUTING OPERATION. GROUT SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 100 PSI.
6. ABANDONMENT OF UTILITY PIPELINES SMALLER THAN 12 INCHES IN DIAMETER SHALL REQUIRE CAPPING OR PLUGGING OF THE PIPE ENDS ONLY, UNLESS NOTED OTHERWISE.
7. REMOVE EXISTING CONCRETE PAVEMENT AND BASE COURSE MATERIAL TO FULL DEPTH.
8. REMOVE EXISTING ASPHALT CONCRETE PAVEMENT AND BASE COURSE MATERIAL TO FULL DEPTH.
9. PROTECT ALL EXISTING STRUCTURES AND FOUNDATIONS TO REMAIN WITHIN THE LIMITS OF WORK DURING CONSTRUCTION UNLESS NOTED OTHERWISE. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING AS REQUIRED IN ORDER TO AVOID IMPACTS TO EXISTING STRUCTURES, FOUNDATIONS AND RETAINING WALLS.
10. PROTECT ALL EXISTING UTILITIES INDICATED TO REMAIN FROM DAMAGE AT ALL TIMES DURING CONSTRUCTION. CONTRACTOR SHALL PROVIDE TEMPORARY SHORING AS REQUIRED TO ENSURE ADEQUATE PROTECTION OF UTILITIES AND APPURTENANCES TO REMAIN. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF DEMOLITION OPERATIONS AND NOTIFY THE OWNER'S REPRESENTATIVE OF ANY DISCREPANCIES.
11. THE CONTRACTOR SHALL VERIFY THAT ALL COMMUNICATIONS WIRES AND CONDUCTORS HAVE BEEN DECOMMISSIONED PRIOR TO REMOVAL OF COMMUNICATIONS CONDUITS AND VAULTS.
12. PRIOR TO THE START OF ANY SITE DEMOLITION, CONTRACTOR SHALL COORDINATE AND DETERMINE WHICH ITEMS, IF ANY, ARE TO BE SALVAGED WITH THE OWNER'S REPRESENTATIVE AND THE OWNER. ANY SPECIAL SALVAGING PROCEDURES THAT ARE TO BE FOLLOWED WILL BE DETERMINED BY THE OWNER'S REPRESENTATIVE AND THE OWNER.
13. DEMOLITION ASSOCIATED WITH ELECTRICAL LINES AND APPURTENANCES SHALL BE COORDINATED WITH THE ELECTRICAL DRAWINGS. DEMOLITION FOR SPECIFIC ELECTRICAL ITEMS INDICATED ON THE DEMOLITION PLANS SHALL NOT BE CARRIED OUT UNTIL POWER SOURCES TO THE ITEMS INDICATED FOR REMOVAL HAVE BEEN MADE SAFE.
14. REMOVAL OF ELECTRICAL DUCTBANK, CONDUITS AND VAULTS SHALL FOLLOW PULLING OF CABLE AND CONDUCTORS.
15. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED CITY OF SEATTLE DEMOLITION AND STREET USE PERMITS BEFORE COMMENCING DEMOLITION ACTIVITIES.
16. PROVIDE TREE PROJECTION FOR ALL SIGNIFICANT TREES ADJACENT TO THE LIMITS OF WORK IN ACCORDANCE WITH THE CITY OF SEATTLE DEPARTMENT OF TRANSPORTATION TREE MANUAL.

SITE AND PAVING NOTES

1. DIMENSIONS AND COORDINATES ARE TO FACE OF CURB, FACE OF BUILDING, OR FACE OF WALL UNLESS NOTED OTHERWISE.
2. APPLY A BITUMINOUS TACK COAT AT LOCATIONS WHERE ASPHALT PAVEMENT ABUTS ANY BUILDING STRUCTURE, UTILITY APPURTENANCE OR OTHER PAVEMENT TYPE.
3. CONCRETE FOR EXTERIOR SITE FACILITIES, INCLUDING BUT NOT LIMITED TO CURBS, SIDEWALKS, PAVING PADS, THRUST BLOCKING, FENCE POST AND BOLLARD FOUNDATIONS, RAMPS, AND UTILITY STRUCTURES SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 033000, "CAST-IN-PLACE CONCRETE" AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS. MAXIMUM WATER/CEMENT RATIO SHALL BE 0.45 AND CONCRETE SHALL HAVE 5 PLUS OR MINUS 0.5 PERCENT AIR ENTRAINMENT. CONCRETE FOR RETAINING WALLS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 033000, "CAST-IN-PLACE CONCRETE" AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS. MAXIMUM WATER/CEMENT RATIO SHALL BE 0.45 AND CONCRETE SHALL HAVE 5 PLUS OR MINUS 0.5 PERCENT AIR ENTRAINMENT. CONCRETE FOR PAVING SHALL BE IN ACCORDANCE WITH SPECIFICATION 033000, "CAST-IN-PLACE CONCRETE" AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 5,000 PSI AT 28 DAYS. MAXIMUM WATER/CEMENT RATIO SHALL BE 0.45 AND CONCRETE SHALL HAVE 5 PLUS OR MINUS 0.5 PERCENT AIR ENTRAINMENT.
4. PROVIDE AN EXPANSION JOINT AT LOCATIONS WHERE CONCRETE WALK OR CONCRETE PAVEMENT ABUT STRUCTURAL FOUNDATION, COLUMN OR WALL, AND FIXED OBJECTS.
5. EXTERIOR CONCRETE PAVEMENT JOINTS SHALL BE WEAKENED PLANE [CONTROL] JOINTS WITH A MAXIMUM SPACING OF X (NOTE TO ENGR: SPACING IS THICKNESS OF CONCRETE IN FEET * 24) FEET ON CENTER. PAVEMENT PANEL LENGTH TO WIDTH RATIO SHALL NOT EXCEED 1.25. AT THE CONTRACTOR'S OPTION, CONTRACTOR MAY SUBSTITUTE CONSTRUCTION JOINTS FOR WEAKENED PLANE [CONTROL] JOINTS. JOINTS SHALL BE COORDINATED WITH LANDSCAPE PLANS.

GRADING NOTES

1. SPOT ELEVATIONS ARE TO TOP OF PAVEMENT, GUTTER ELEVATION OR FINISHED GRADE UNLESS NOTED OTHERWISE.
2. ADJUST UTILITY ACCESS COVERS, FOR UTILITIES TO REMAIN, TO FINISH GRADE.
3. TOP ELEVATION FOR VAULTS SHALL MATCH FINISH GRADE. SLOPE VAULT LIDS AS REQUIRED.
4. SLOPES ARE SHOWN FOR INFORMATIONAL PURPOSES ONLY. CONSTRUCTION SHALL BE BASED ON SPOT ELEVATIONS.

STORM DRAIN NOTES


1. A COPY OF THE APPROVED DRAINAGE CONTROL PLANS MUST BE ON THE JOB SITE WHENEVER CONSTRUCTION IS IN PROGRESS.
2. UNLESS NOTED OTHERWISE, THE CONTRACTOR MAY USE ANY COMBINATION OF PREFABRICATED FITTINGS (TEES, BENDS AND WYES) AT LOCATIONS WHERE STORM CONNECTION POINTS OF INTERSECTION (PI) OR BENDS ARE INDICATED. PREFABRICATED FITTINGS MAY BE ADJUSTED AS REQUIRED TO MAINTAIN POSITIVE SLOPE AND DRAINAGE. WHERE SPECIFICALLY INDICATED, THE CONTRACTOR SHALL PROVIDE THE FITTINGS AS SHOWN.
3. REQUIRED STORM WATER FACILITIES MUST BE CONSTRUCTED AND IN OPERATION PRIOR TO ANY PAVING UNLESS OTHERWISE APPROVED.
4. INSTALL CATCH BASIN INSERTS UNDER ALL CATCH BASIN AND AREA DRAIN GRATES IMMEDIATELY AFTER INSTALLATION. PROTECTION SHALL BE REMOVED AFTER FINAL PAVING AND/OR LANDSCAPING HAS BEEN ESTABLISHED.
5. STORM DRAIN PIPE DISCHARGING FROM AN AREA DRAIN SHALL BE INSTALLED WITH A MINIMUM SLOPE OF 2 PERCENT UNLESS NOTED OTHERWISE.
6. LENGTHS OF PIPING SHOWN ON STORM DRAIN ARE FROM CENTER OF STRUCTURE, FITTING OR POINT OF INTERSECTION AND ARE SHOWN FOR INFORMATION ONLY. ALL PIPING SHALL BE INSTALLED AT THE LOCATION SHOWN ON THE PLANS AND LOCATED BY COORDINATES OR DIMENSIONS.
7. COORDINATE POINTS AND ELEVATIONS SHOWN FOR ALL CATCH BASINS, CLEANOUTS, AREA DRAINS AND MANHOLES ARE TO THE CENTER OF THE FRAME AND GRATE OR COVER, UNLESS NOTED OTHERWISE.
8. TOP ELEVATION FOR ALL DRAINAGE STRUCTURES WITH SOLID COVERS SHALL MATCH FINISH GRADE UNLESS NOTED OTHERWISE.
9. TRENCHING FOR STORM DRAINS SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 284 AND PIPE BEDDING SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 285.
10. STORM DRAIN MATERIALS AND CONSTRUCTION SHALL CONFORM TO CITY OF SEATTLE STANDARD SPECIFICATIONS.
11. STORM DRAIN PIPING SHALL BE PVC ASTM D3034, SDR-35, UNLESS NOTED OTHERWISE.
12. CONTRACTOR SHALL VERIFY EXISTING AND NEW UTILITY CROSSINGS PRIOR TO STORM DRAIN INSTALLATION.
13. CONTRACTOR SHALL ADJUST THE RIM ELEVATION OF EXISTING STRUCTURES TO REMAIN TO THE FINISHED GRADE ELEVATION.

UTILITY NOTES

1. WATER LINES LESS THAN 12 INCHES IN DIAMETER SHALL HAVE A MINIMUM OF 3 FEET OF COVER OVER THE TOP OF PIPE. WATER LINES 12 INCHES OR LARGER IN DIAMETER SHALL HAVE 4 FEET OF COVER OVER THE TOP OF PIPE. MAINTAIN A MINIMUM OF 12 INCHES CLEAR AT CROSSINGS WITH UTILITIES OTHER THAN SANITARY SEWER LINES. WATER LINES SHALL PASS UNDER THE OTHER UTILITY IF THE MINIMUM SPECIFIED COVER CANNOT BE OBTAINED.
2. MAINTAIN A MINIMUM OF 18 INCHES CLEAR BETWEEN CROSSINGS OF WATER LINES AND SANITARY SEWER LINES. WATER LINES SHALL CROSS ABOVE SANITARY SEWER LINES.
3. PROVIDE HORIZONTAL AND VERTICAL BENDS WHERE INDICATED. WHERE A POINT OF INTERSECTION (HORIZONTAL OR VERTICAL) IS SHOWN AND THE DEFLECTION ANGLE IS MORE OR LESS THAN A STANDARD BEND, USE A COMBINATION OF THE STANDARD BEND AND JOINT DEFLECTION OF THE PIPE TO MEET THE ALIGNMENT SHOWN. MAXIMUM JOINT DEFLECTION IS 3 DEGREES OR THE MAXIMUM THAT IS RECOMMENDED BY THE PIPE MANUFACTURER, WHICHEVER IS SMALLER.
4. PROVIDE HORIZONTAL AND VERTICAL THRUST BLOCKING AT ALL HORIZONTAL AND VERTICAL BENDS IN ACCORDANCE WITH THE CITY OF SEATTLE. THE CONTRACTOR MAY PROVIDE RESTRAINED JOINTS IN LIEU OF HORIZONTAL AND/OR VERTICAL THRUST BLOCKING AT LOCATIONS WHERE INSTALLATION OF THE THRUST BLOCKING WILL INTERFERE WITH OTHER CONSTRUCTION. SEE SPECIFICATION FOR REQUIREMENTS.
5. CAPPED WATER LINES OR TEES SHALL HAVE HORIZONTAL THRUST BLOCKING.
6. COORDINATE POINTS AND ELEVATIONS SHOWN FOR ALL MANHOLES ARE TO THE CENTER OF THE MANHOLE, UNLESS NOTED OTHERWISE.
7. THE CONTRACTOR SHALL VERIFY ALL EXISTING AND NEW UTILITY CROSSINGS PRIOR TO WATER AND SANITARY SEWER SYSTEM INSTALLATION.
8. TRENCHING FOR WATER LINES SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 284 AND PIPE BEDDING SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 285.
9. TRENCHING FOR SANITARY SEWERS SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 284 AND PIPE BEDDING SHALL CONFORM TO CITY OF SEATTLE STANDARD PLAN 285.
10. LENGTHS OF PIPING SHOWN ON STORM DRAIN ARE FROM CENTER OF STRUCTURE, FITTING OR POINT OF INTERSECTION AND ARE SHOWN FOR INFORMATION ONLY. ALL PIPING SHALL BE INSTALLED AT THE LOCATION SHOWN ON THE PLANS AND LOCATED BY COORDINATES OR DIMENSIONS.
11. VERIFY LOCATIONS OF LATERAL BUILDING CONNECTIONS WITH THE PLUMBING DRAWINGS PRIOR TO INSTALLATION.
12. UTILITY CROSSINGS SHOWN ON THE UTILITY PROFILES ARE FOR THE CONTRACTOR'S INFORMATION AND REFERENCE. THE CONTRACTOR SHALL VERIFY ALL EXISTING AND NEW UTILITY CROSSINGS PRIOR TO UTILITY SYSTEM INSTALLATION.
13. SANITARY SEWER MATERIALS AND CONSTRUCTION SHALL CONFORM TO CITY OF SEATTLE STANDARD SPECIFICATIONS.
14. WATER MATERIALS AND CONSTRUCTION SHALL CONFORM TO CITY OF SEATTLE STANDARD SPECIFICATIONS.
15. SANITARY SEWER PIPE SHALL BE CLASS 50 DUCTILE IRON WHERE COVER IS LESS THAN 3.00 FEET, OTHERWISE, SANITARY SEWER PIPE SHALL BE PVC ASTM D3034, SDR-35, UNLESS NOTED OTHERWISE.
16. WATER LINE PIPE SHALL BE HDPE DR11 UNLESS NOTED OTHERWISE.



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555




ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8202

STRUCTURAL ENGINEER
Lund Opsehl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

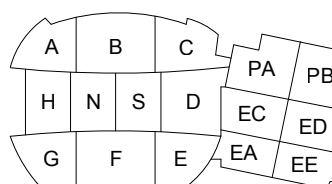

NORTH
KEY PLAN

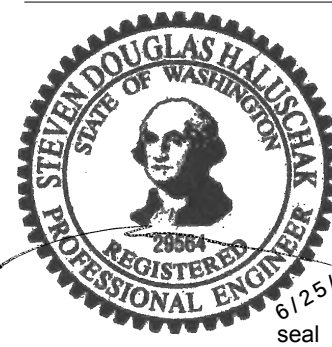


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

RE:
NOTES


Crawford project no.: KC40923



Overall Key Plan

sheet no
© Copyright Architects 2002

6/25/2025 12:20 PM USER: cdp PATH: J:\LumenField\North\GL\VELSB\C1\0X.dwg LAYOUT: C1.01

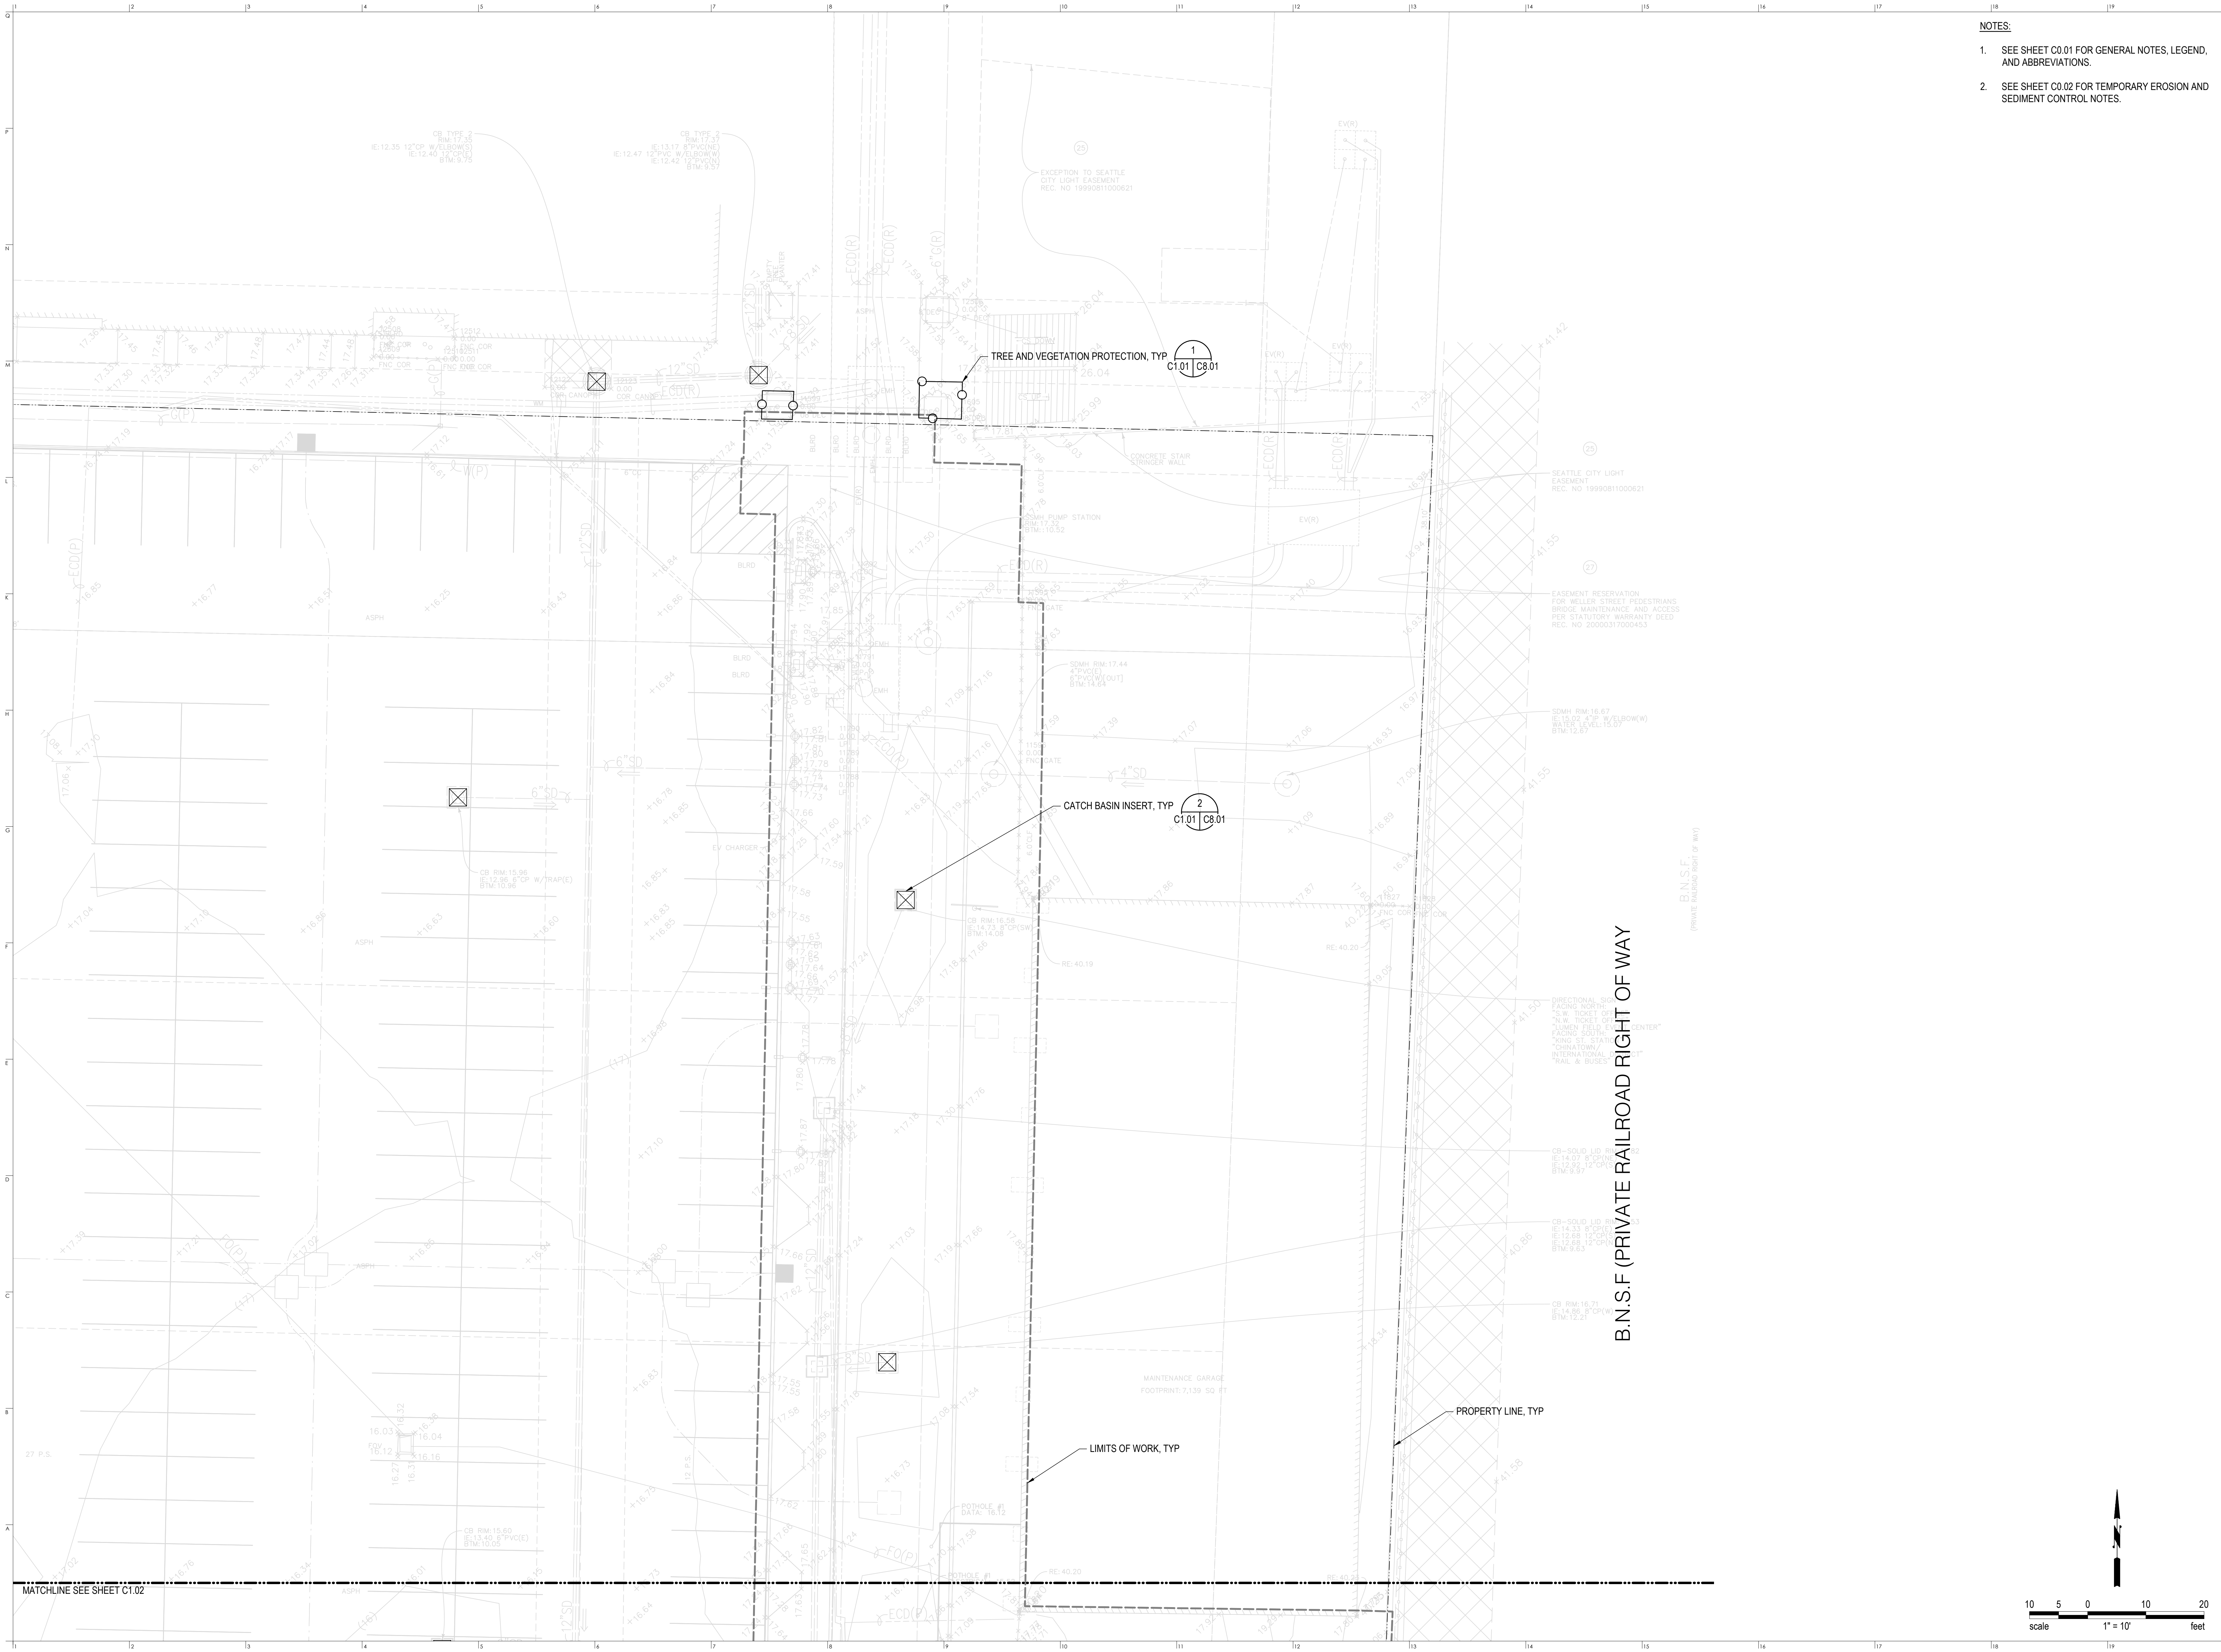

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR TEMPORARY EROSION AND SEDIMENT CONTROL NOTES.

LUMEN
FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Local Street, Suite 100
Kirkland City, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 2200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98141
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

NORTH
KEY PLAN

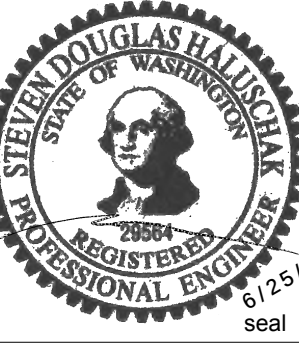

DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

DATE:
6/25/2025

C1.01
sheet no.



- NOTES:
1. SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 2. SEE SHEET C0.02 FOR TEMPORARY EROSION AND SEDIMENT CONTROL NOTES.

LUMEN
FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134


A	B	C	PA	PB
H	N	S	D	PA
G	F	E	EA	EE

NORTH
KEY PLAN

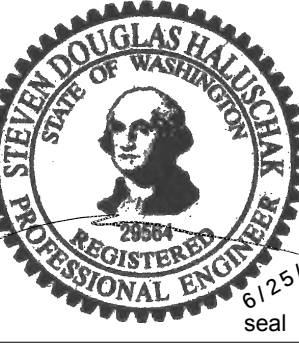

DATE: 6/25/2025
DRAWINGS ISSUED FOR: PERMIT SET
TITLE: TEMPORARY EROSION AND SEDIMENT CONTROL PLAN
Crawford project no.: KC00523

C1.02
sheet no.

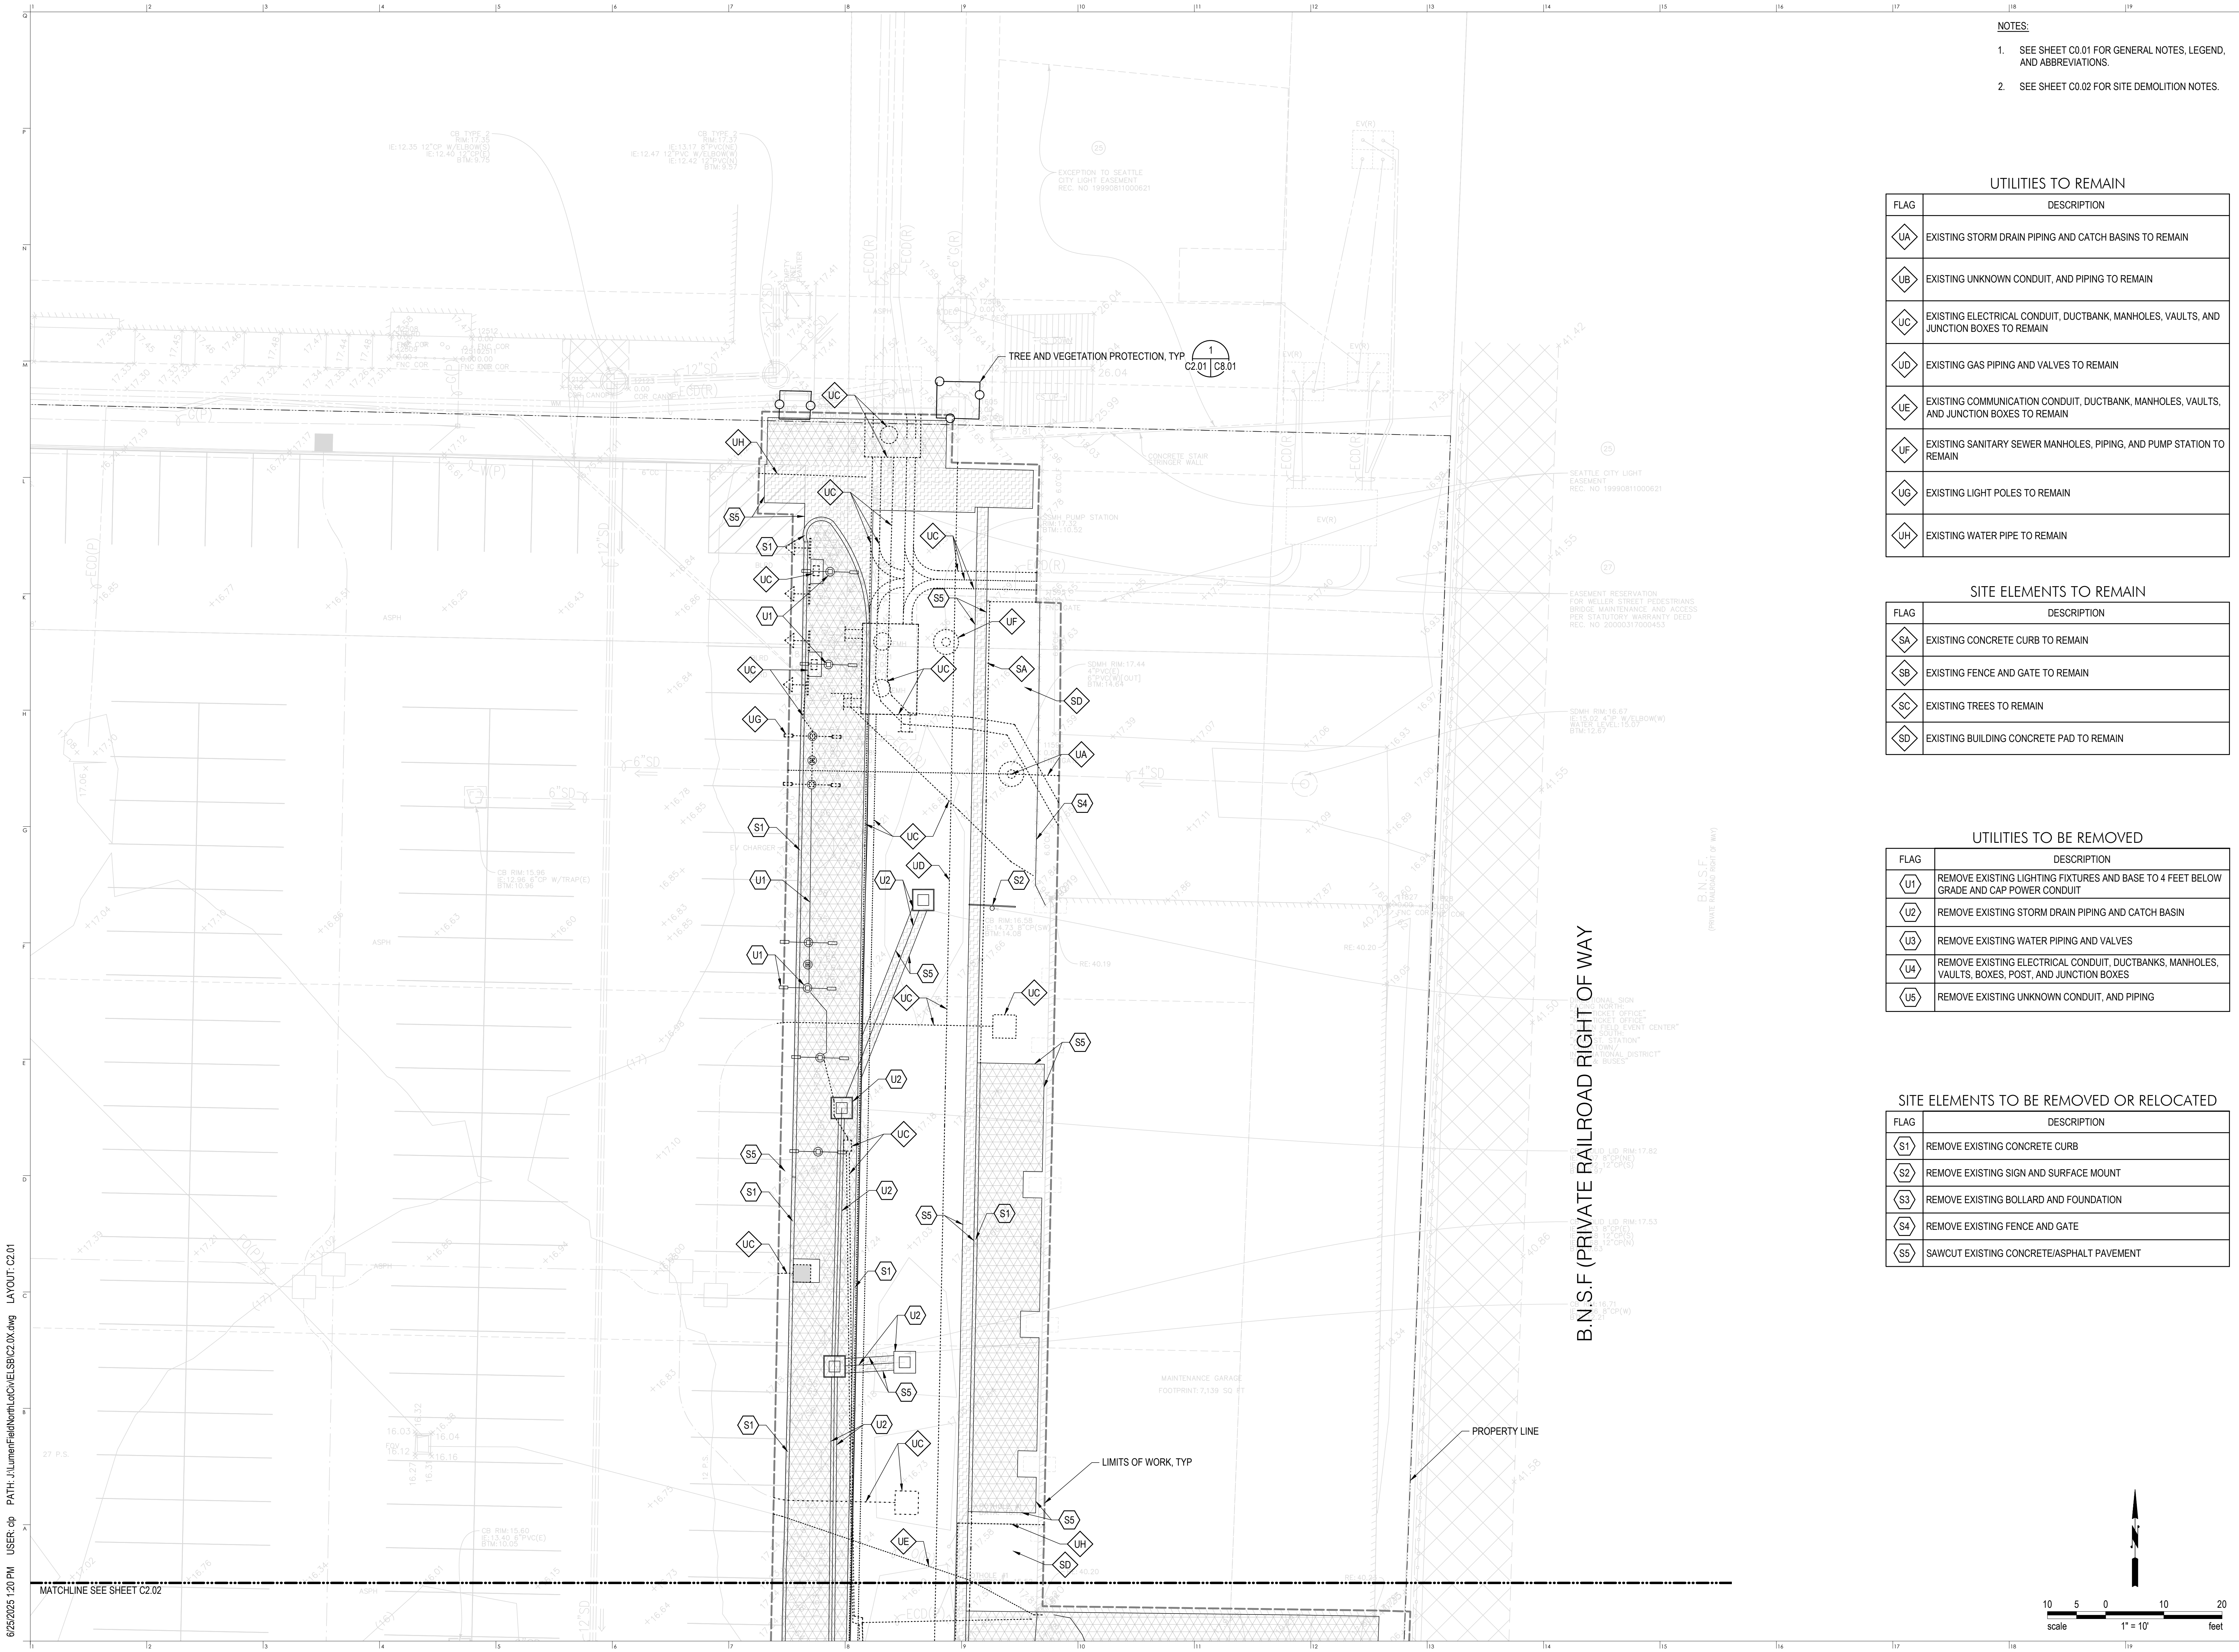

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR SITE DEMOLITION NOTES.

UTILITIES TO REMAIN	
FLAG	DESCRIPTION
UA	EXISTING STORM DRAIN PIPING AND CATCH BASINS TO REMAIN
UB	EXISTING UNKNOWN CONDUIT, AND PIPING TO REMAIN
UC	EXISTING ELECTRICAL CONDUIT, DUCTBANK, MANHOLES, VAULTS, AND JUNCTION BOXES TO REMAIN
UD	EXISTING GAS PIPING AND VALVES TO REMAIN
UE	EXISTING COMMUNICATION CONDUIT, DUCTBANK, MANHOLES, VAULTS, AND JUNCTION BOXES TO REMAIN
UF	EXISTING SANITARY SEWER MANHOLES, PIPING, AND PUMP STATION TO REMAIN
UG	EXISTING LIGHT POLES TO REMAIN
UH	EXISTING WATER PIPE TO REMAIN

SITE ELEMENTS TO REMAIN	
FLAG	DESCRIPTION
SA	EXISTING CONCRETE CURB TO REMAIN
SB	EXISTING FENCE AND GATE TO REMAIN
SC	EXISTING TREES TO REMAIN
SD	EXISTING BUILDING CONCRETE PAD TO REMAIN

UTILITIES TO BE REMOVED	
FLAG	DESCRIPTION
U1	REMOVE EXISTING LIGHTING FIXTURES AND BASE TO 4 FEET BELOW GRADE AND CAP POWER CONDUIT
U2	REMOVE EXISTING STORM DRAIN PIPING AND CATCH BASIN
U3	REMOVE EXISTING WATER PIPING AND VALVES
U4	REMOVE EXISTING ELECTRICAL CONDUIT, DUCTBANKS, MANHOLES, VAULTS, BOXES, POST, AND JUNCTION BOXES
U5	REMOVE EXISTING UNKNOWN CONDUIT, AND PIPING

SITE ELEMENTS TO BE REMOVED OR RELOCATED	
FLAG	DESCRIPTION
S1	REMOVE EXISTING CONCRETE CURB
S2	REMOVE EXISTING SIGN AND SURFACE MOUNT
S3	REMOVE EXISTING BOLLARD AND FOUNDATION
S4	REMOVE EXISTING FENCE AND GATE
S5	SAWCUT EXISTING CONCRETE/ASPHALT PAVEMENT

LUMEN FIELD

CLIENT

First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT

Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640

CIVIL ENGINEER

Magnuson Klemencic Assoc.
1301 Fifth Avenue, Suite 2000
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER

Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-8156

LUMEN FIELD

EVENT LOGISTICS AND STAGING BUILDING (ELSB)

800 Occidental Ave S Seattle, WA 98134

A B C D E F G H I J K L M N O P Q R S T U V W X Y Z

KEY PLAN

6/25/26


DATE: 6/25/2025

DRAWINGS ISSUED FOR: PERMIT SET

SITE DEMOLITION PLAN

sheet no. KC0023

6/25/2025 12:01 PM USER: cdp PATH: \\LumenField\North\GIS\ELSB\C2.0X.dwg LAYOUT: C2.02

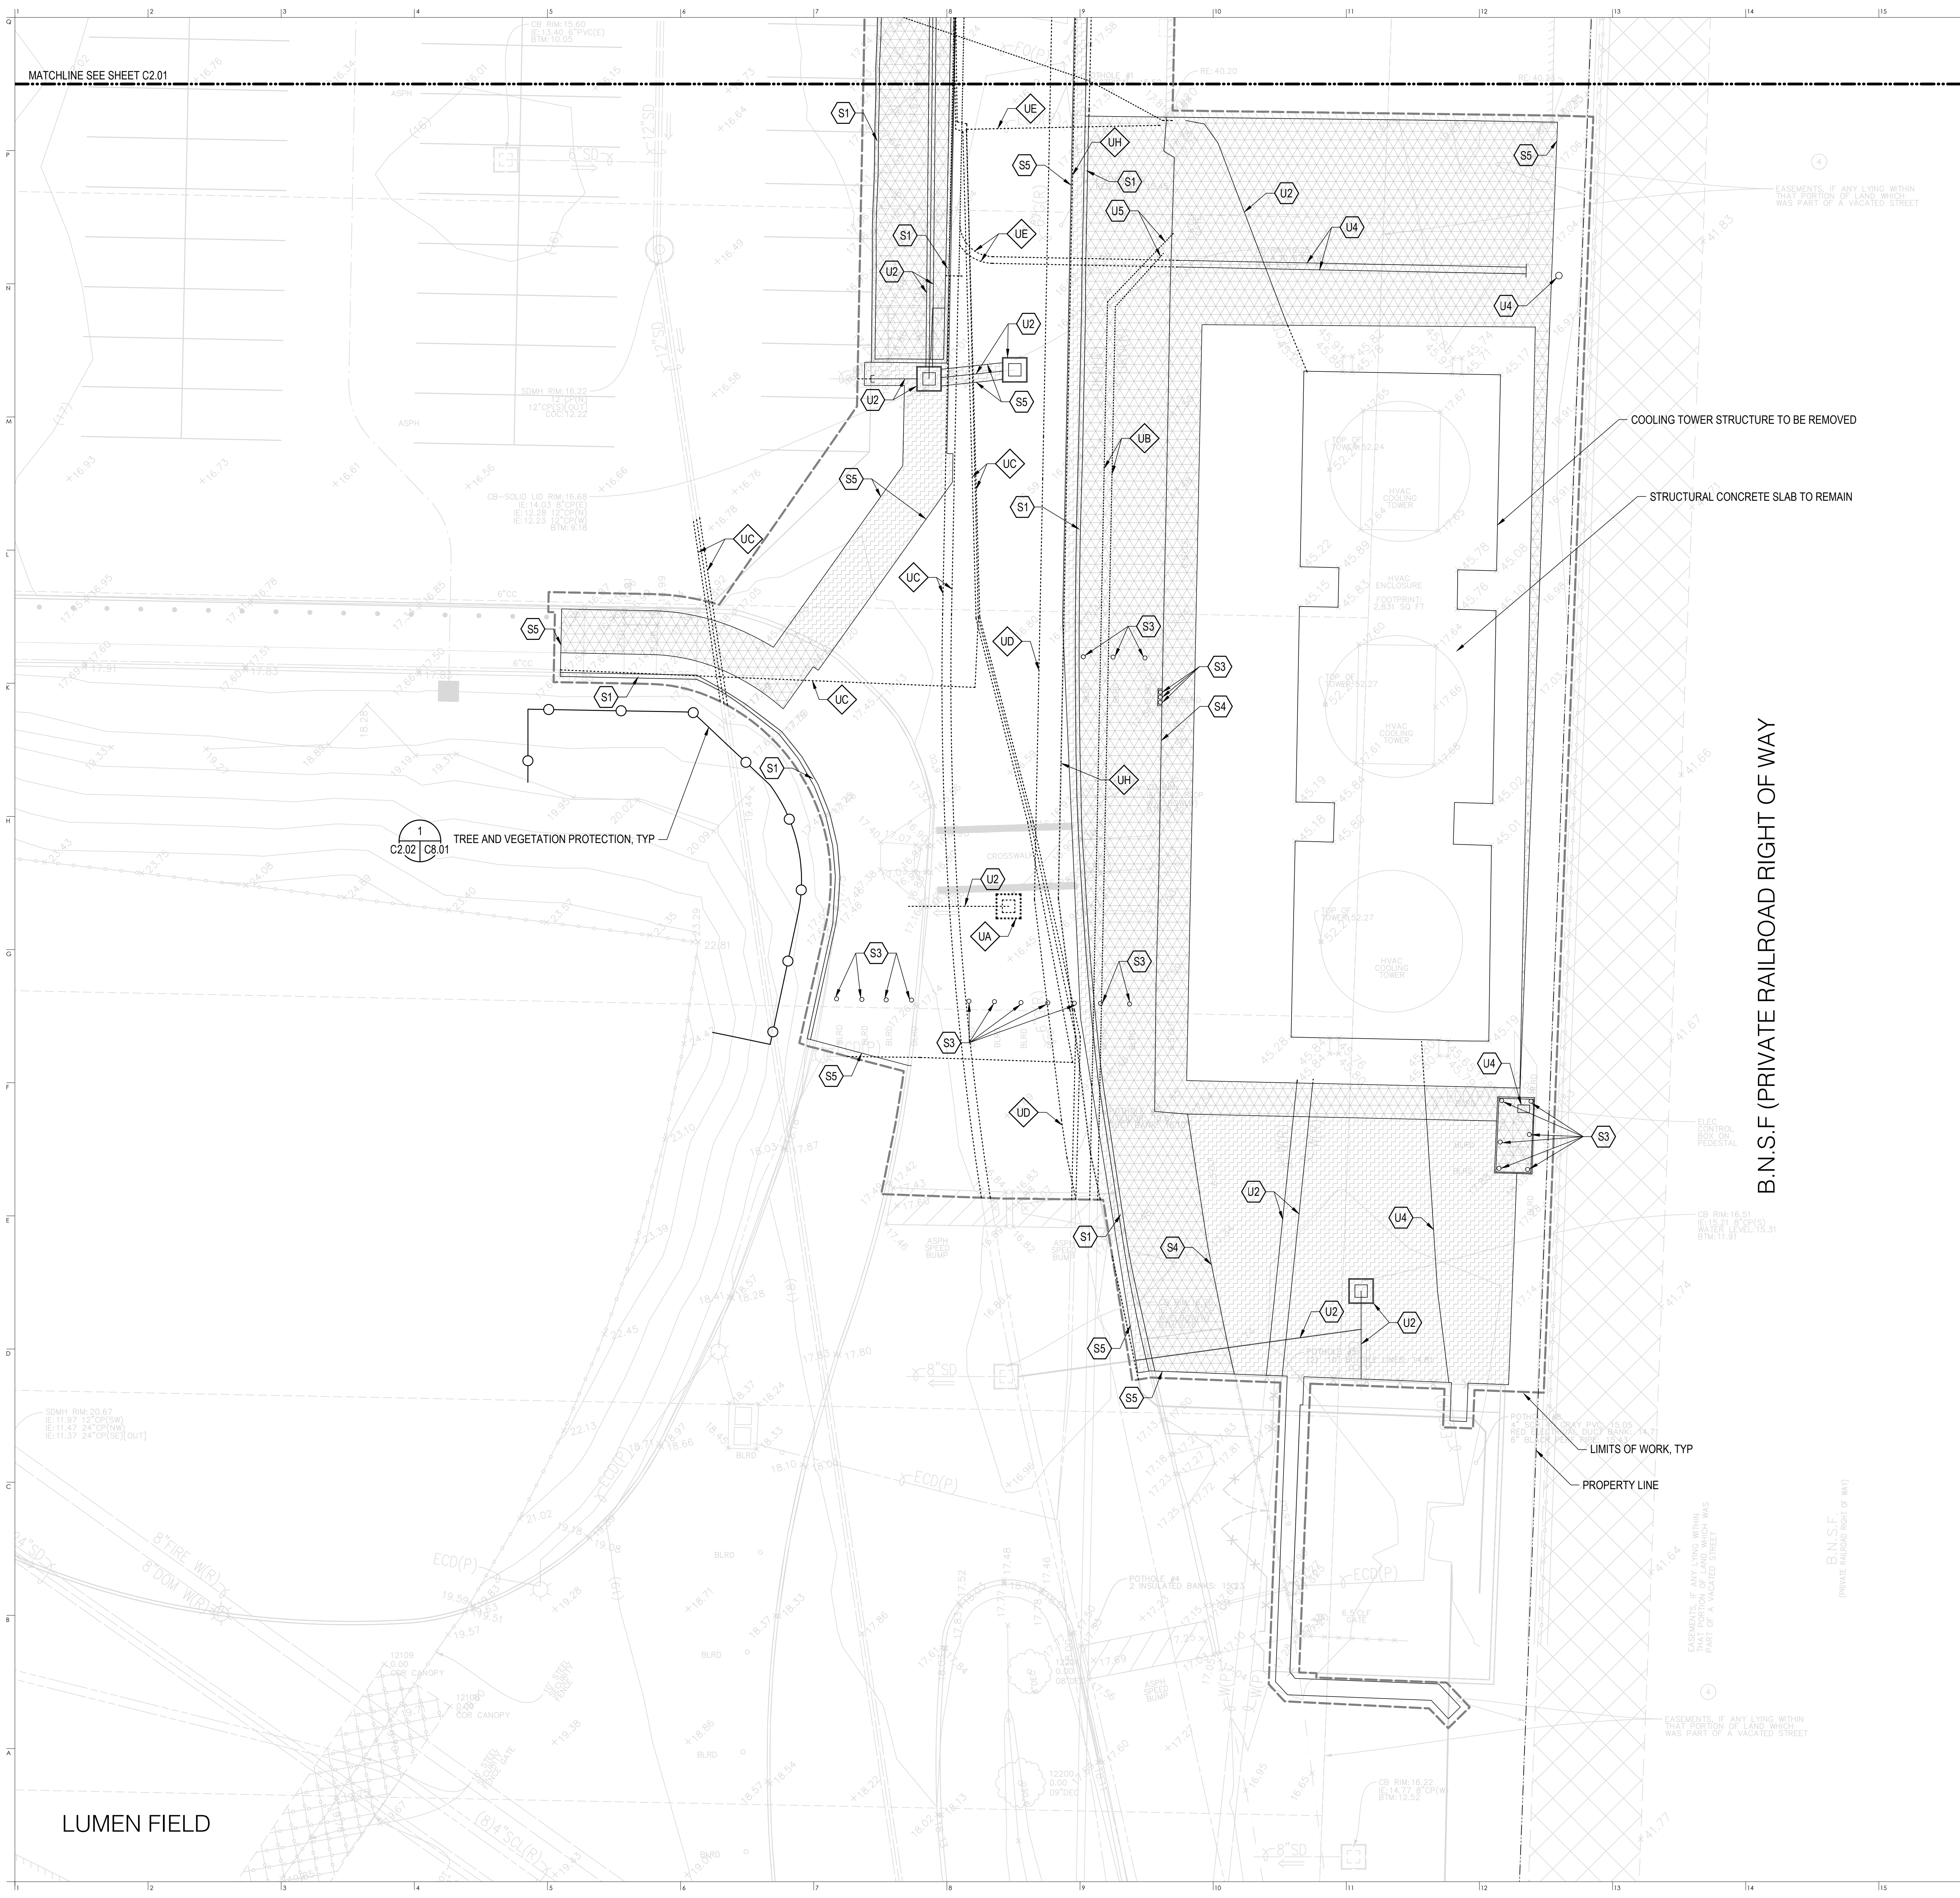


NOTES:

1. SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
2. SEE SHEET C0.02 FOR SITE DEMOLITION NOTES.
3. SEE SHEET C02.01 FOR SITE DEMOLITION FLAG NOTES.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



CRAWFORD

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsehl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98141
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

NORTH
KEY PLAN

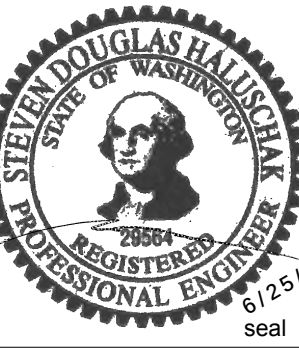


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

FILE:
SITE DEMOLITION PLAN
Crawford project no.: KC0053

C2.02
sheet no.

6/25/2025 1:19 PM USER: cdp PATH: J:\LumenField\North\CB\LSB\C3.0X.dwg LAYOUT: C3.01

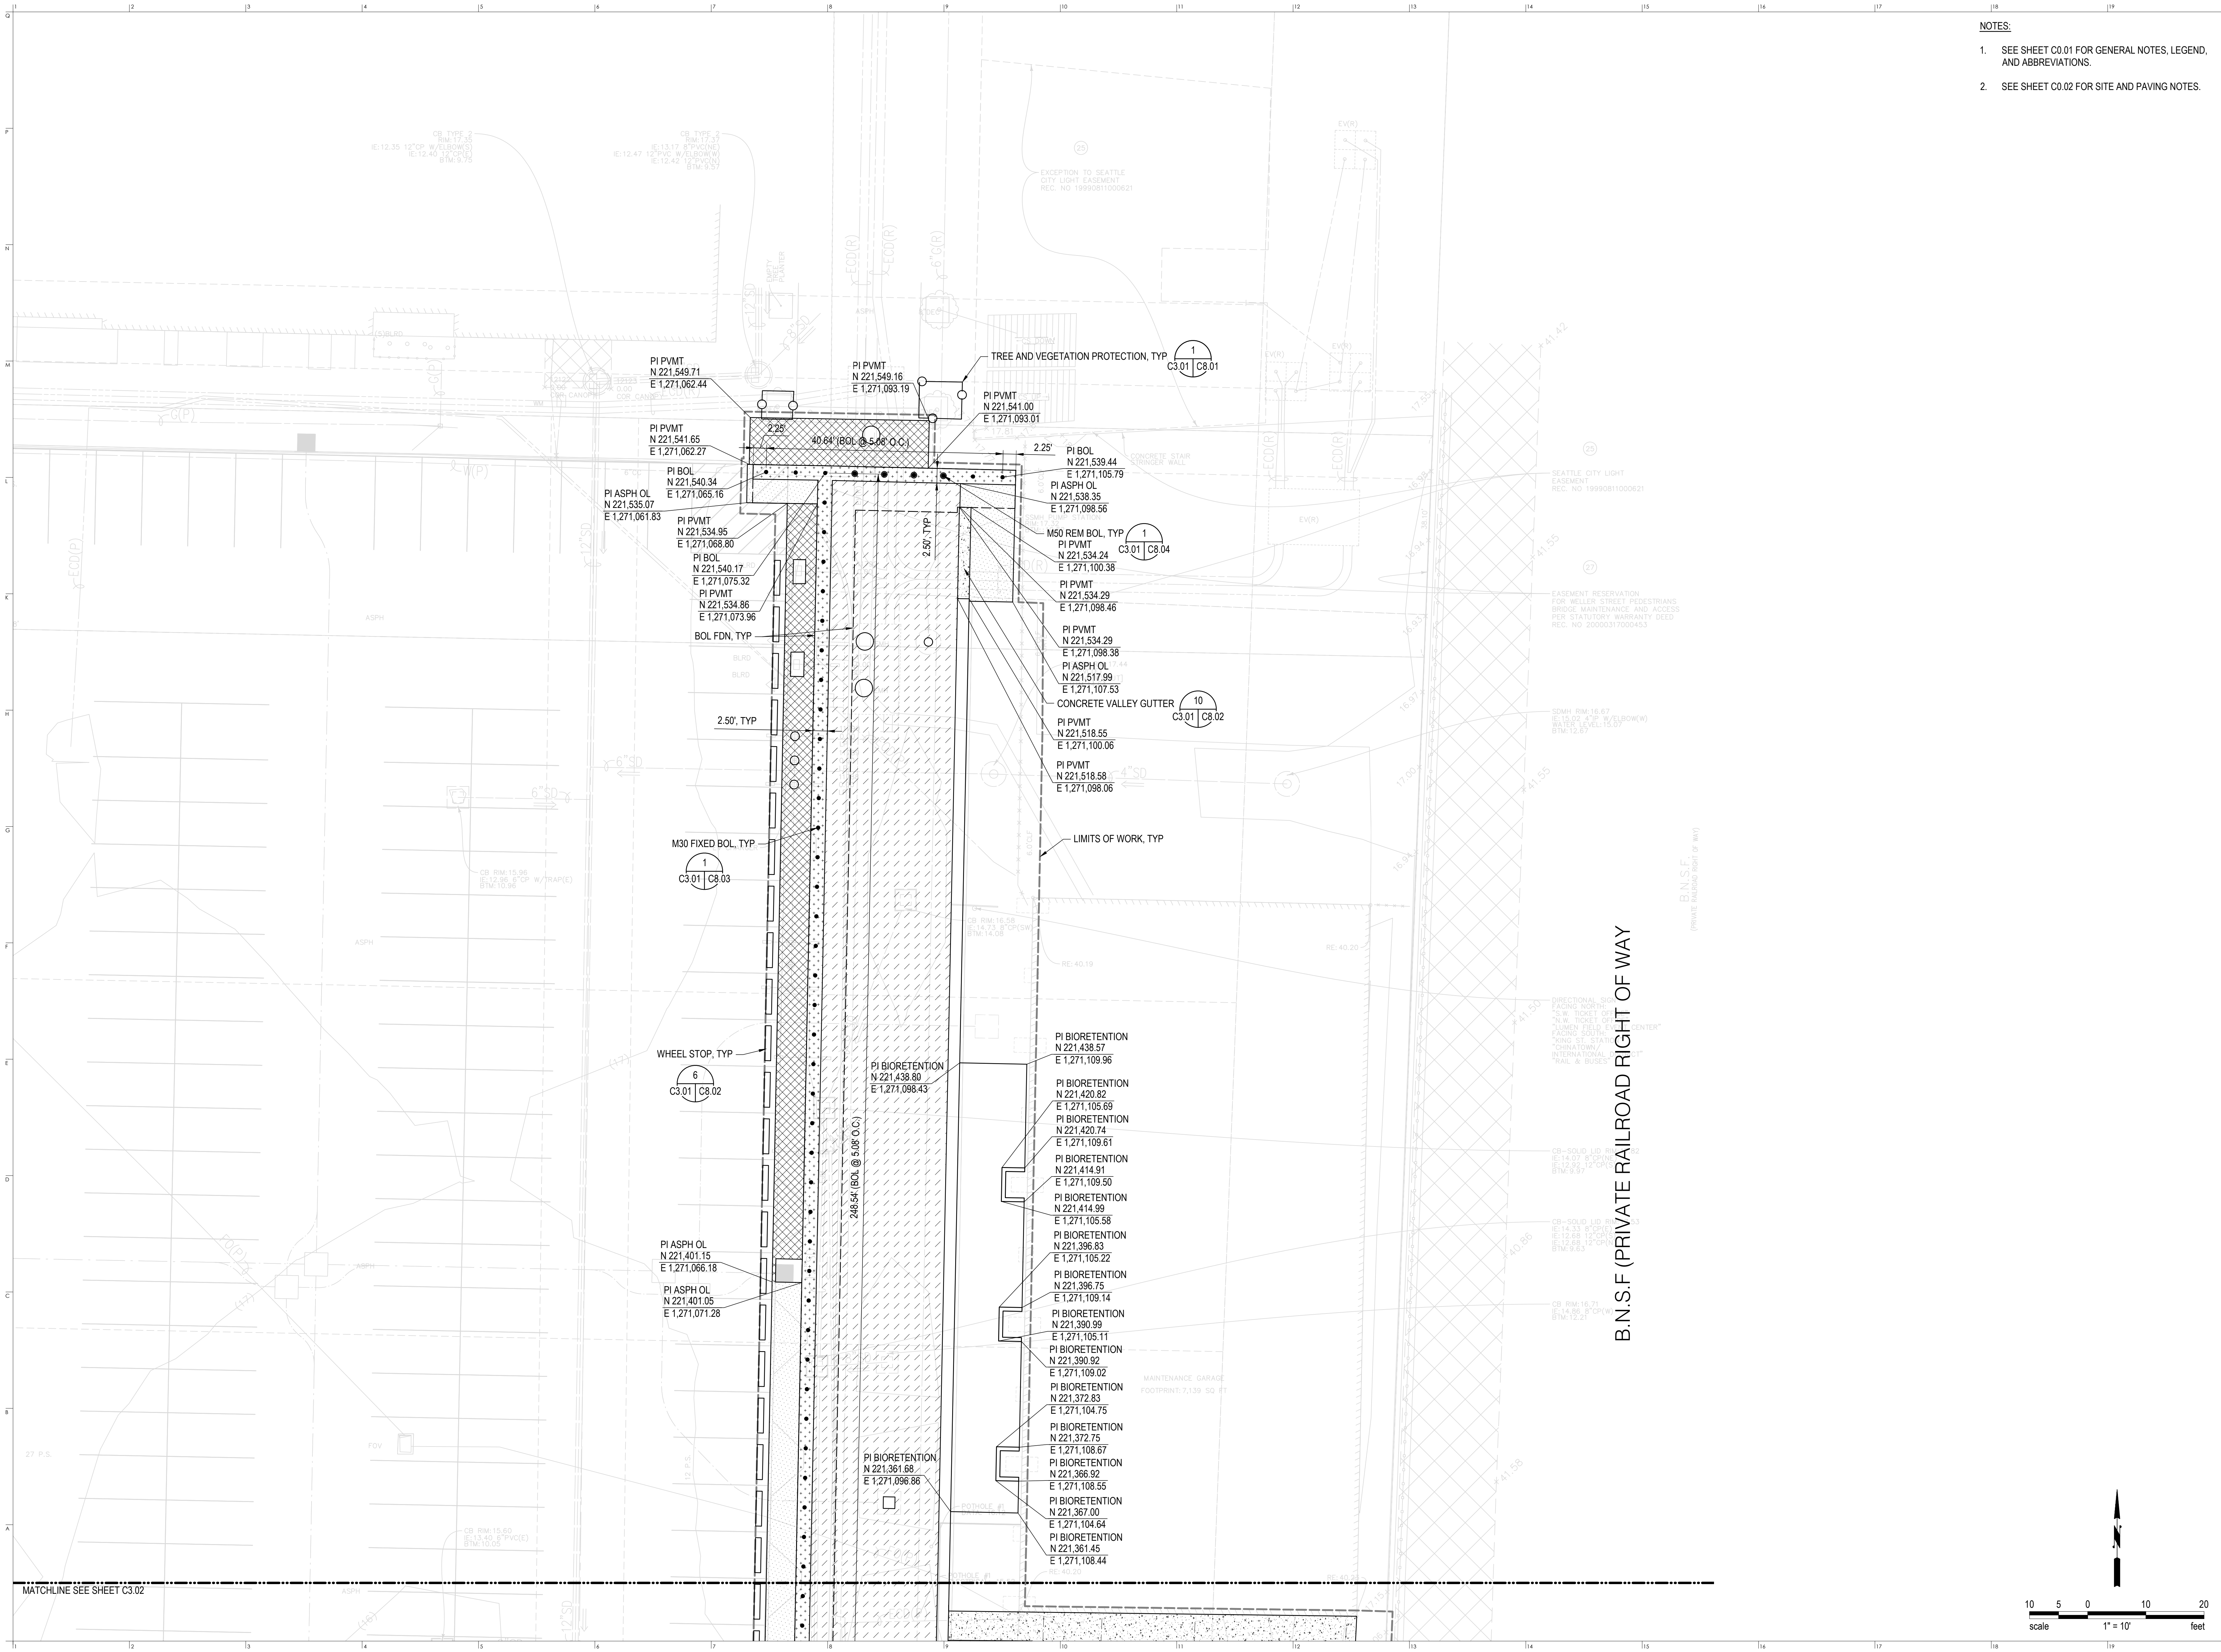

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR SITE AND PAVING NOTES.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-8156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE


NORTH
KEY PLAN

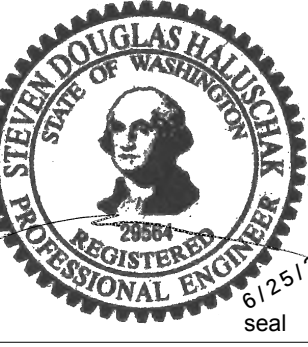


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

SITE AND PAVING PLAN
Crawford Project No.: KC40923

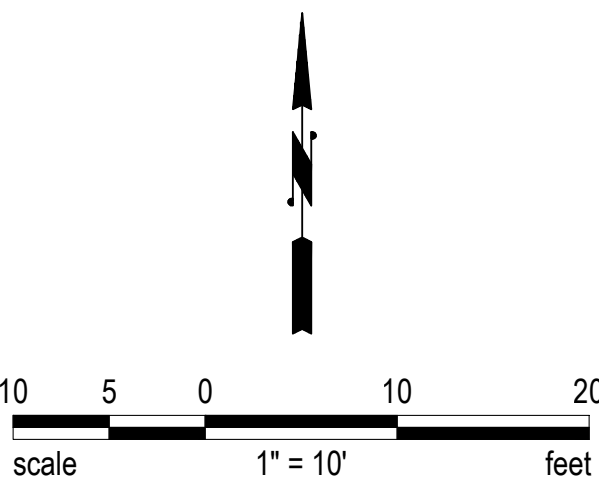

C3.01
sheet no.

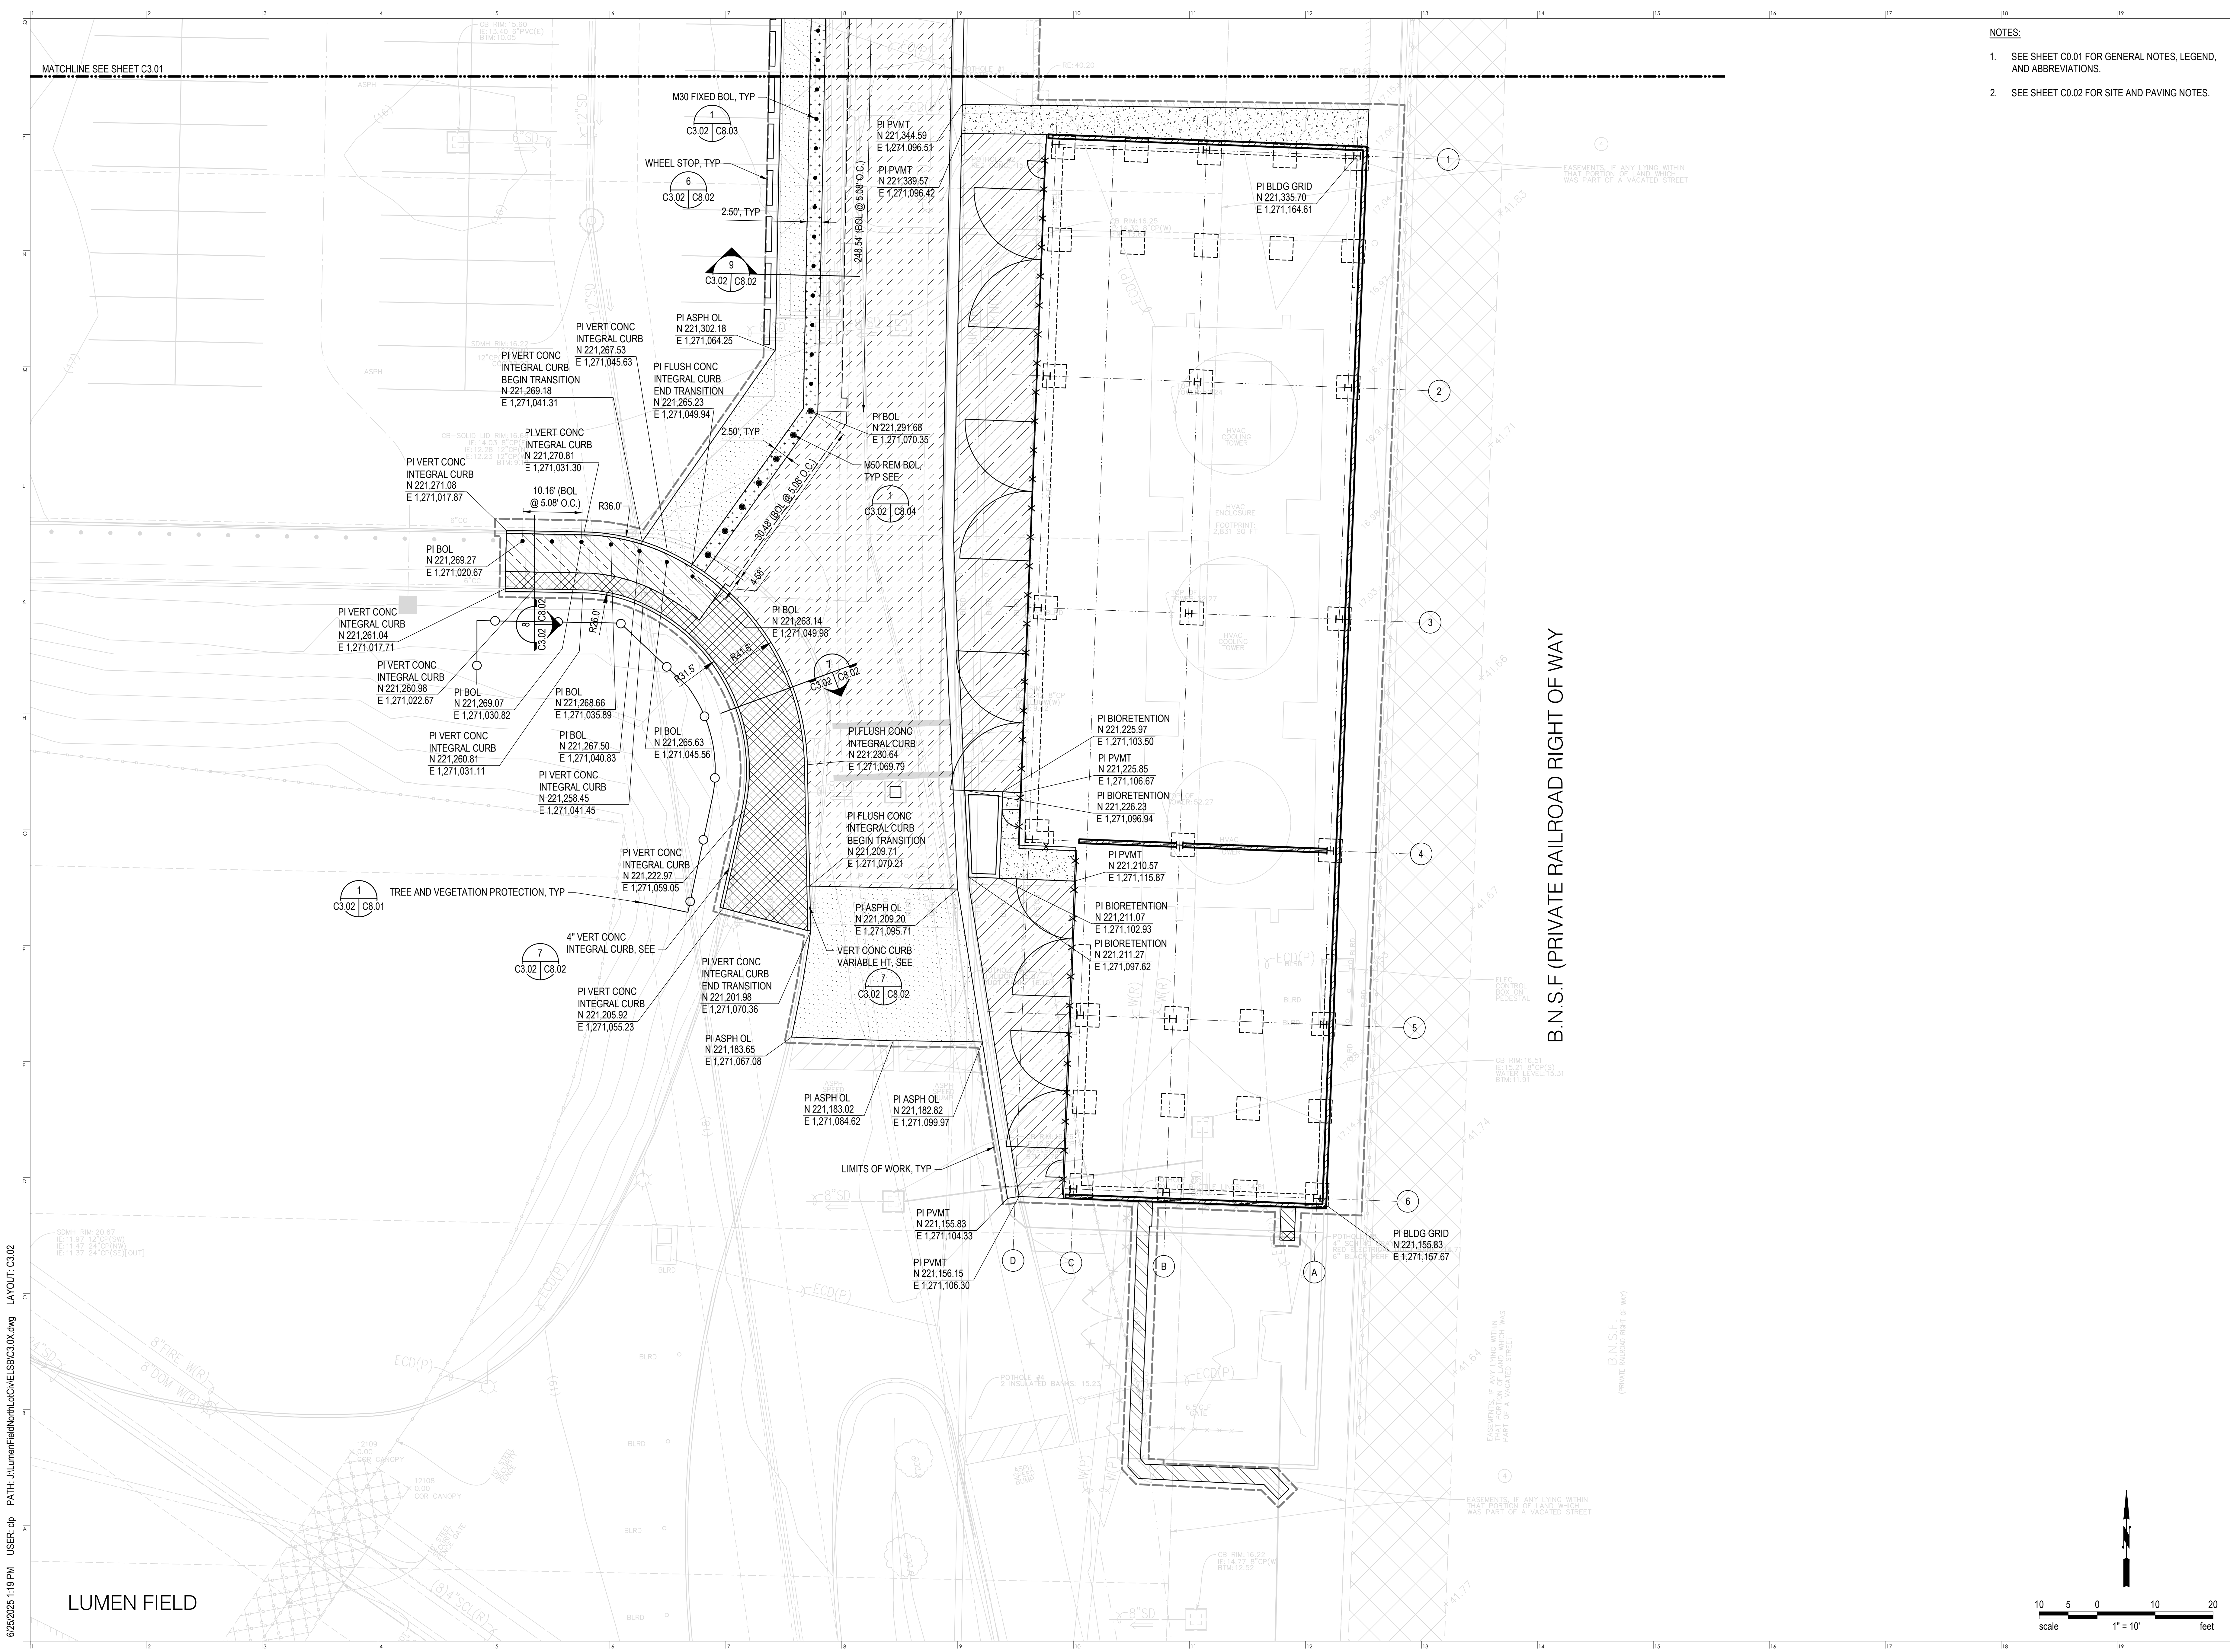

- NOTES:
- SEE SHEET C3.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C3.02 FOR SITE AND PAVING NOTES.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opeshli
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

KEY PLAN

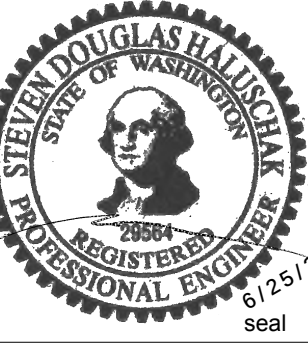


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

SITE AND PAVING PLAN
Crawford project no.: KC40923

C3.02
sheet no.

6/25/2025 1:19 PM USER: cdp PATH: J:\LumenField\North\GWS\BSC4\0X.dwg LAYOUT: C4.01

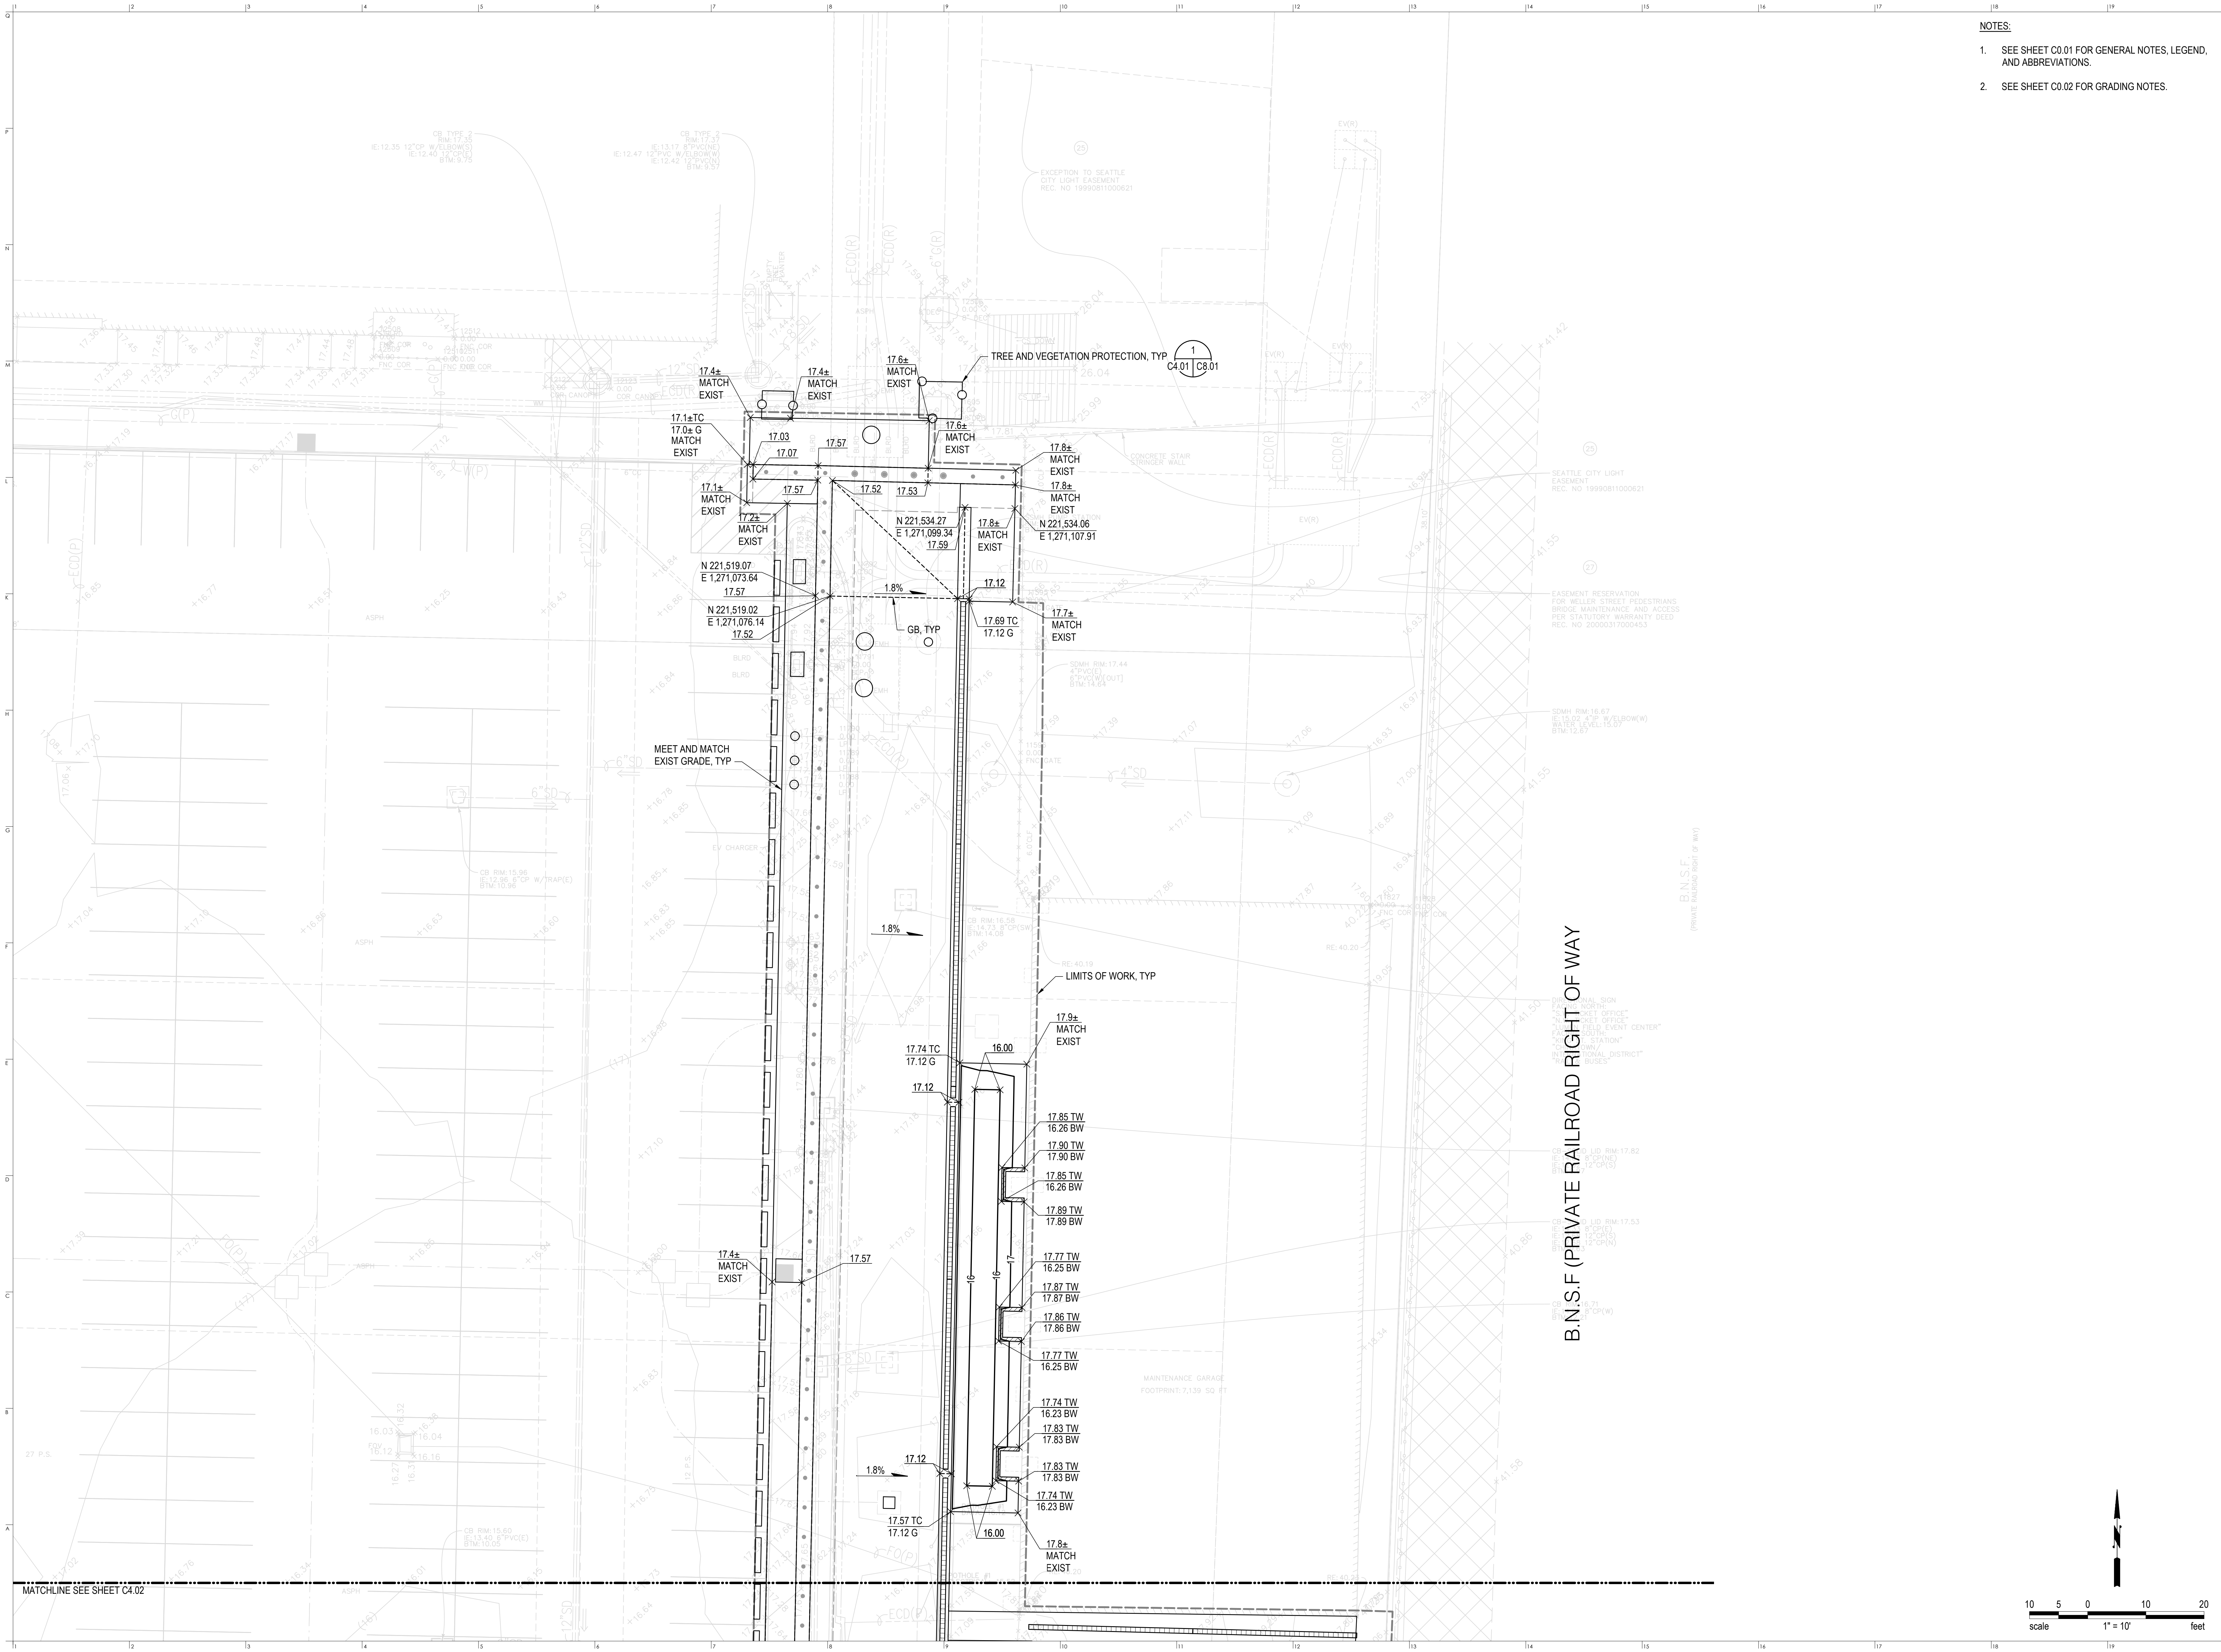

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR GRADING NOTES.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

CRAWFORD

ARCHITECT
Crawford Architects CA, Inc.
1604 Local Street, Suite 100
Kirkland City, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 2000
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-8156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

NORTH
KEY PLAN

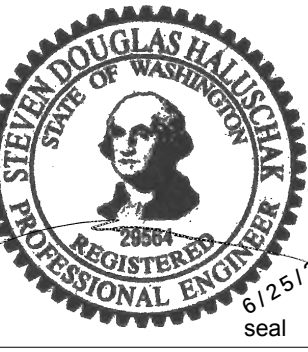

DATE:
6/25/2025


DRAWINGS ISSUED FOR:
PERMIT SET

DATE:
6/25/2025

RE:
GRADING PLAN

PROJECT NO.: KC40523

C4.01
sheet no.

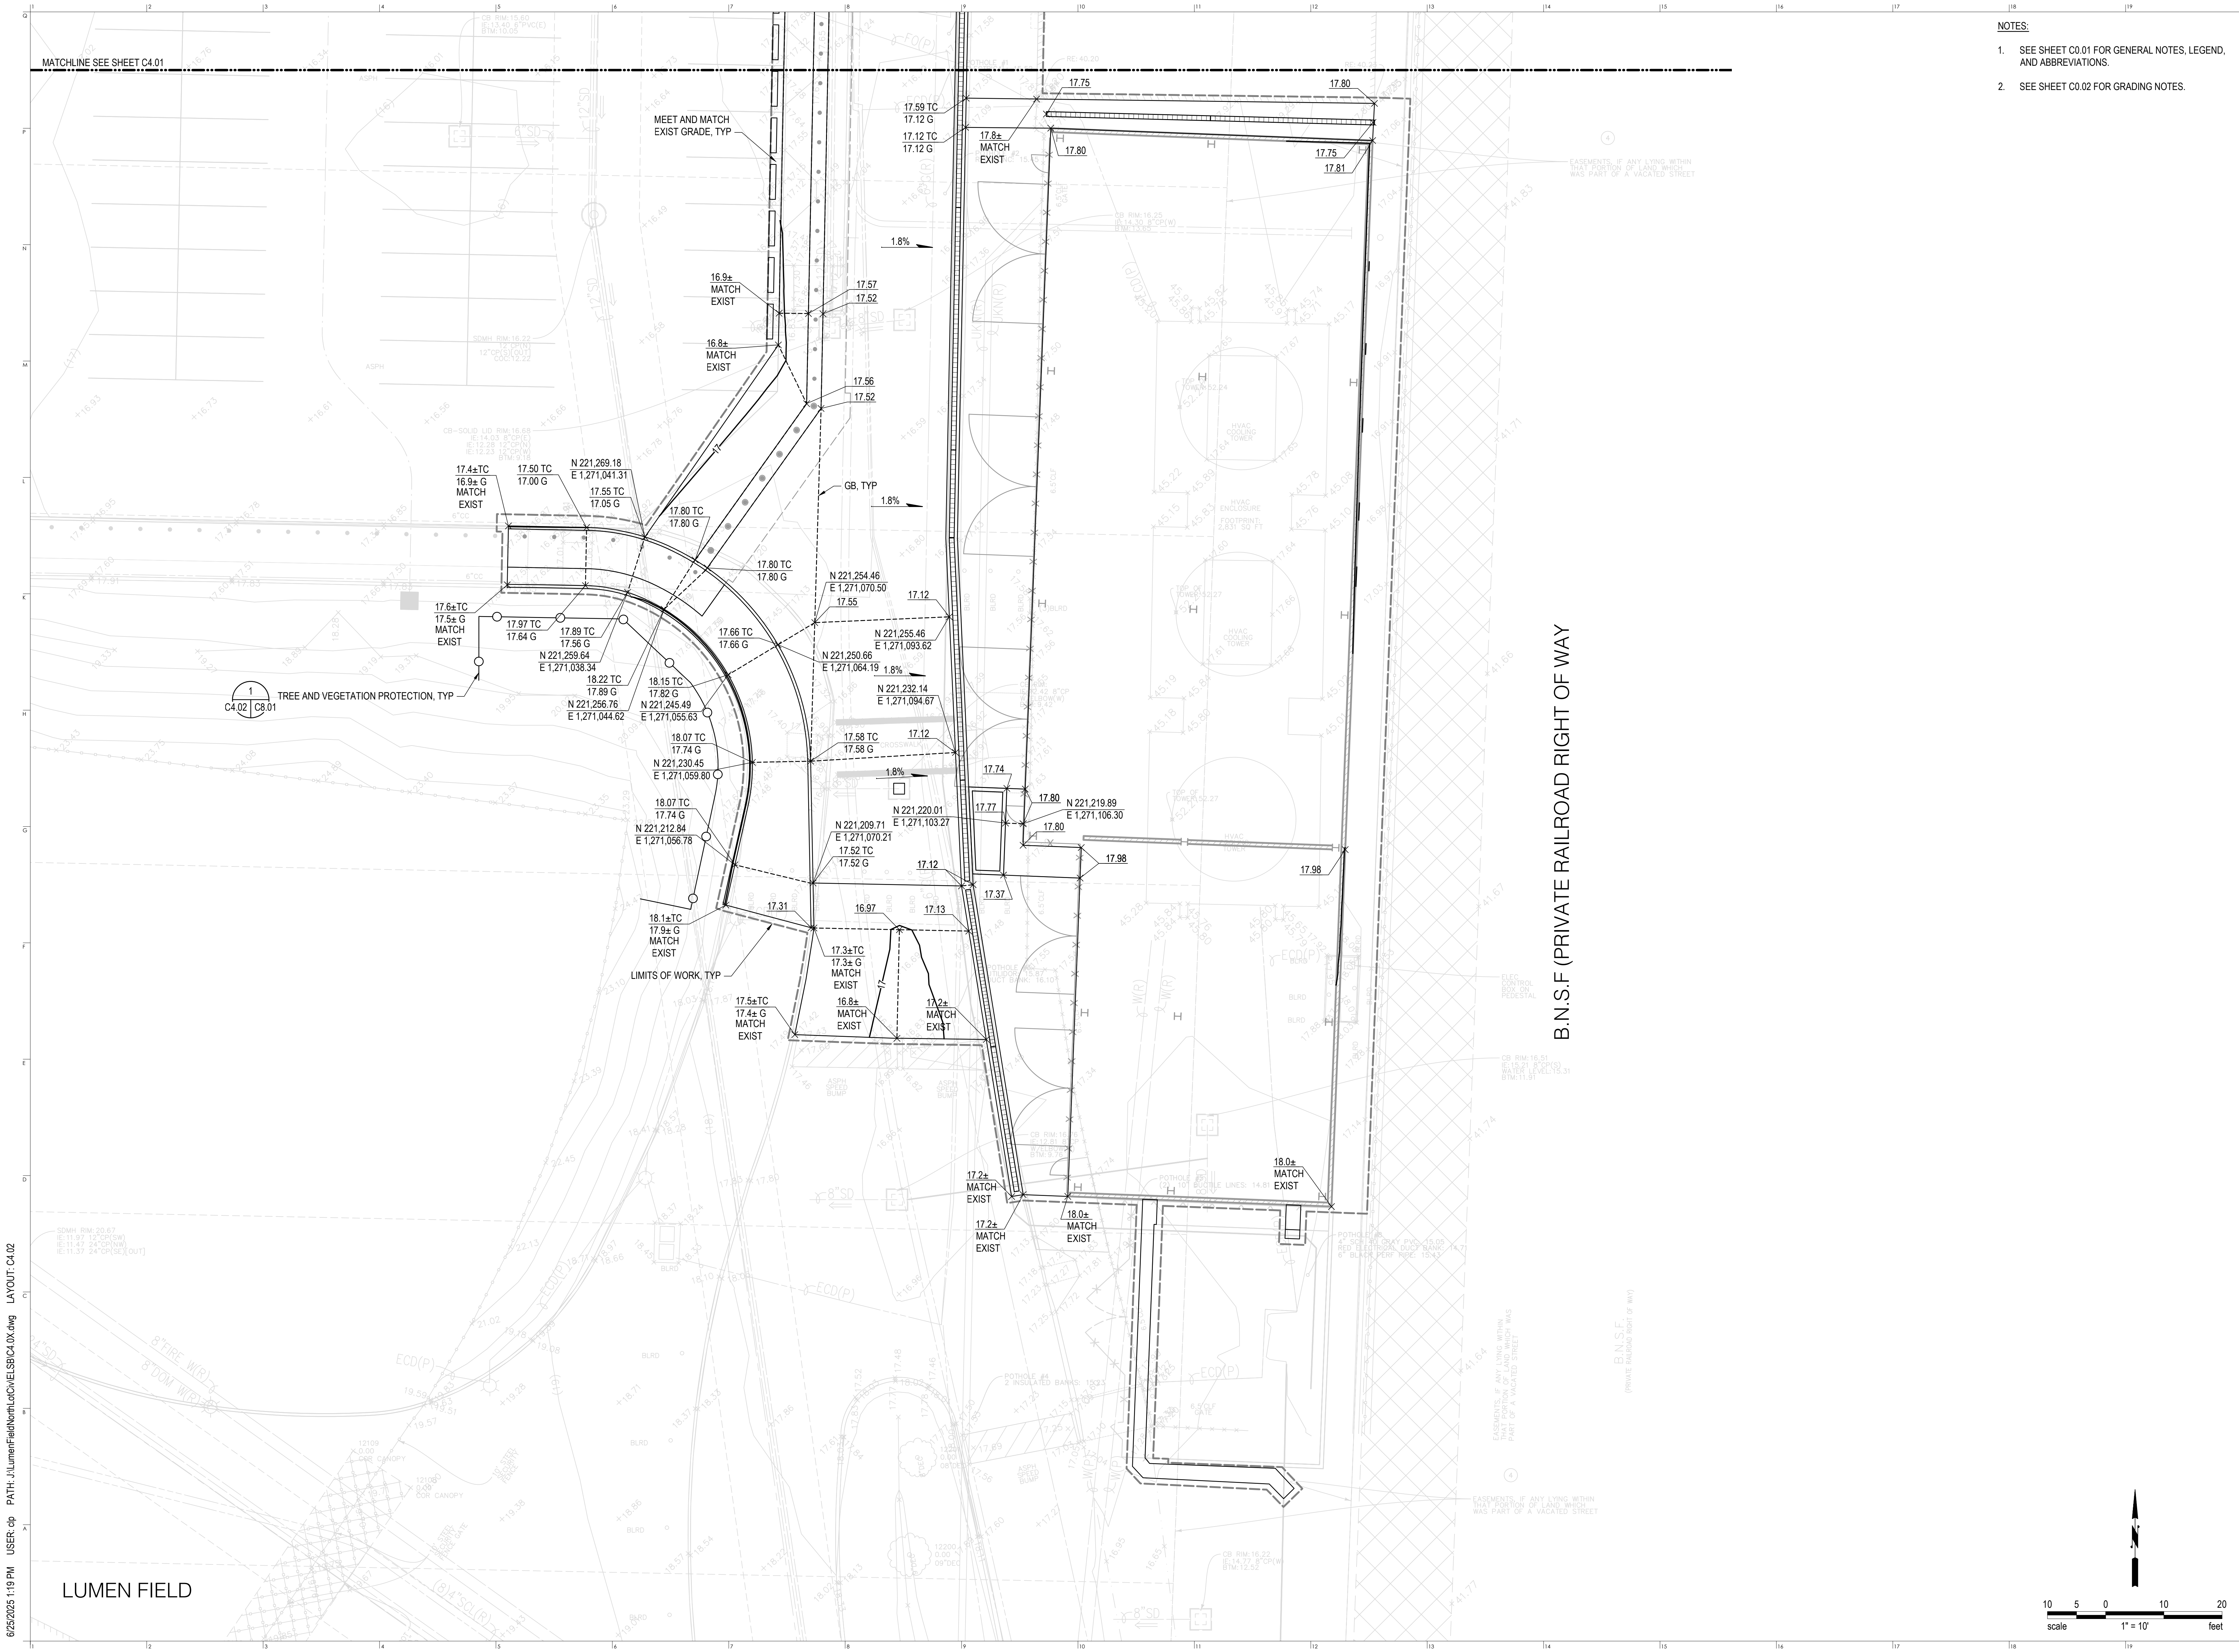

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR GRADING NOTES.

LUMEN
FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kennesaw City, MO 64116
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opeshli
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

NORTH
KEY PLAN

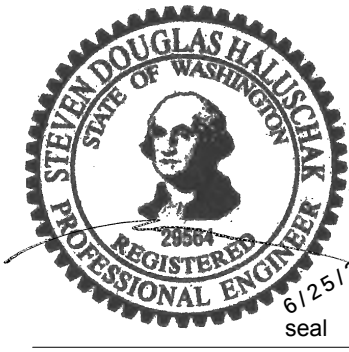

DATE:
6/25/2025


DRAWINGS ISSUED FOR:
PERMIT SET

DATE:
6/25/2025

PROJECT:
GRADING PLAN

PROJECT NO.:
KC00523

C4.02
sheet no.

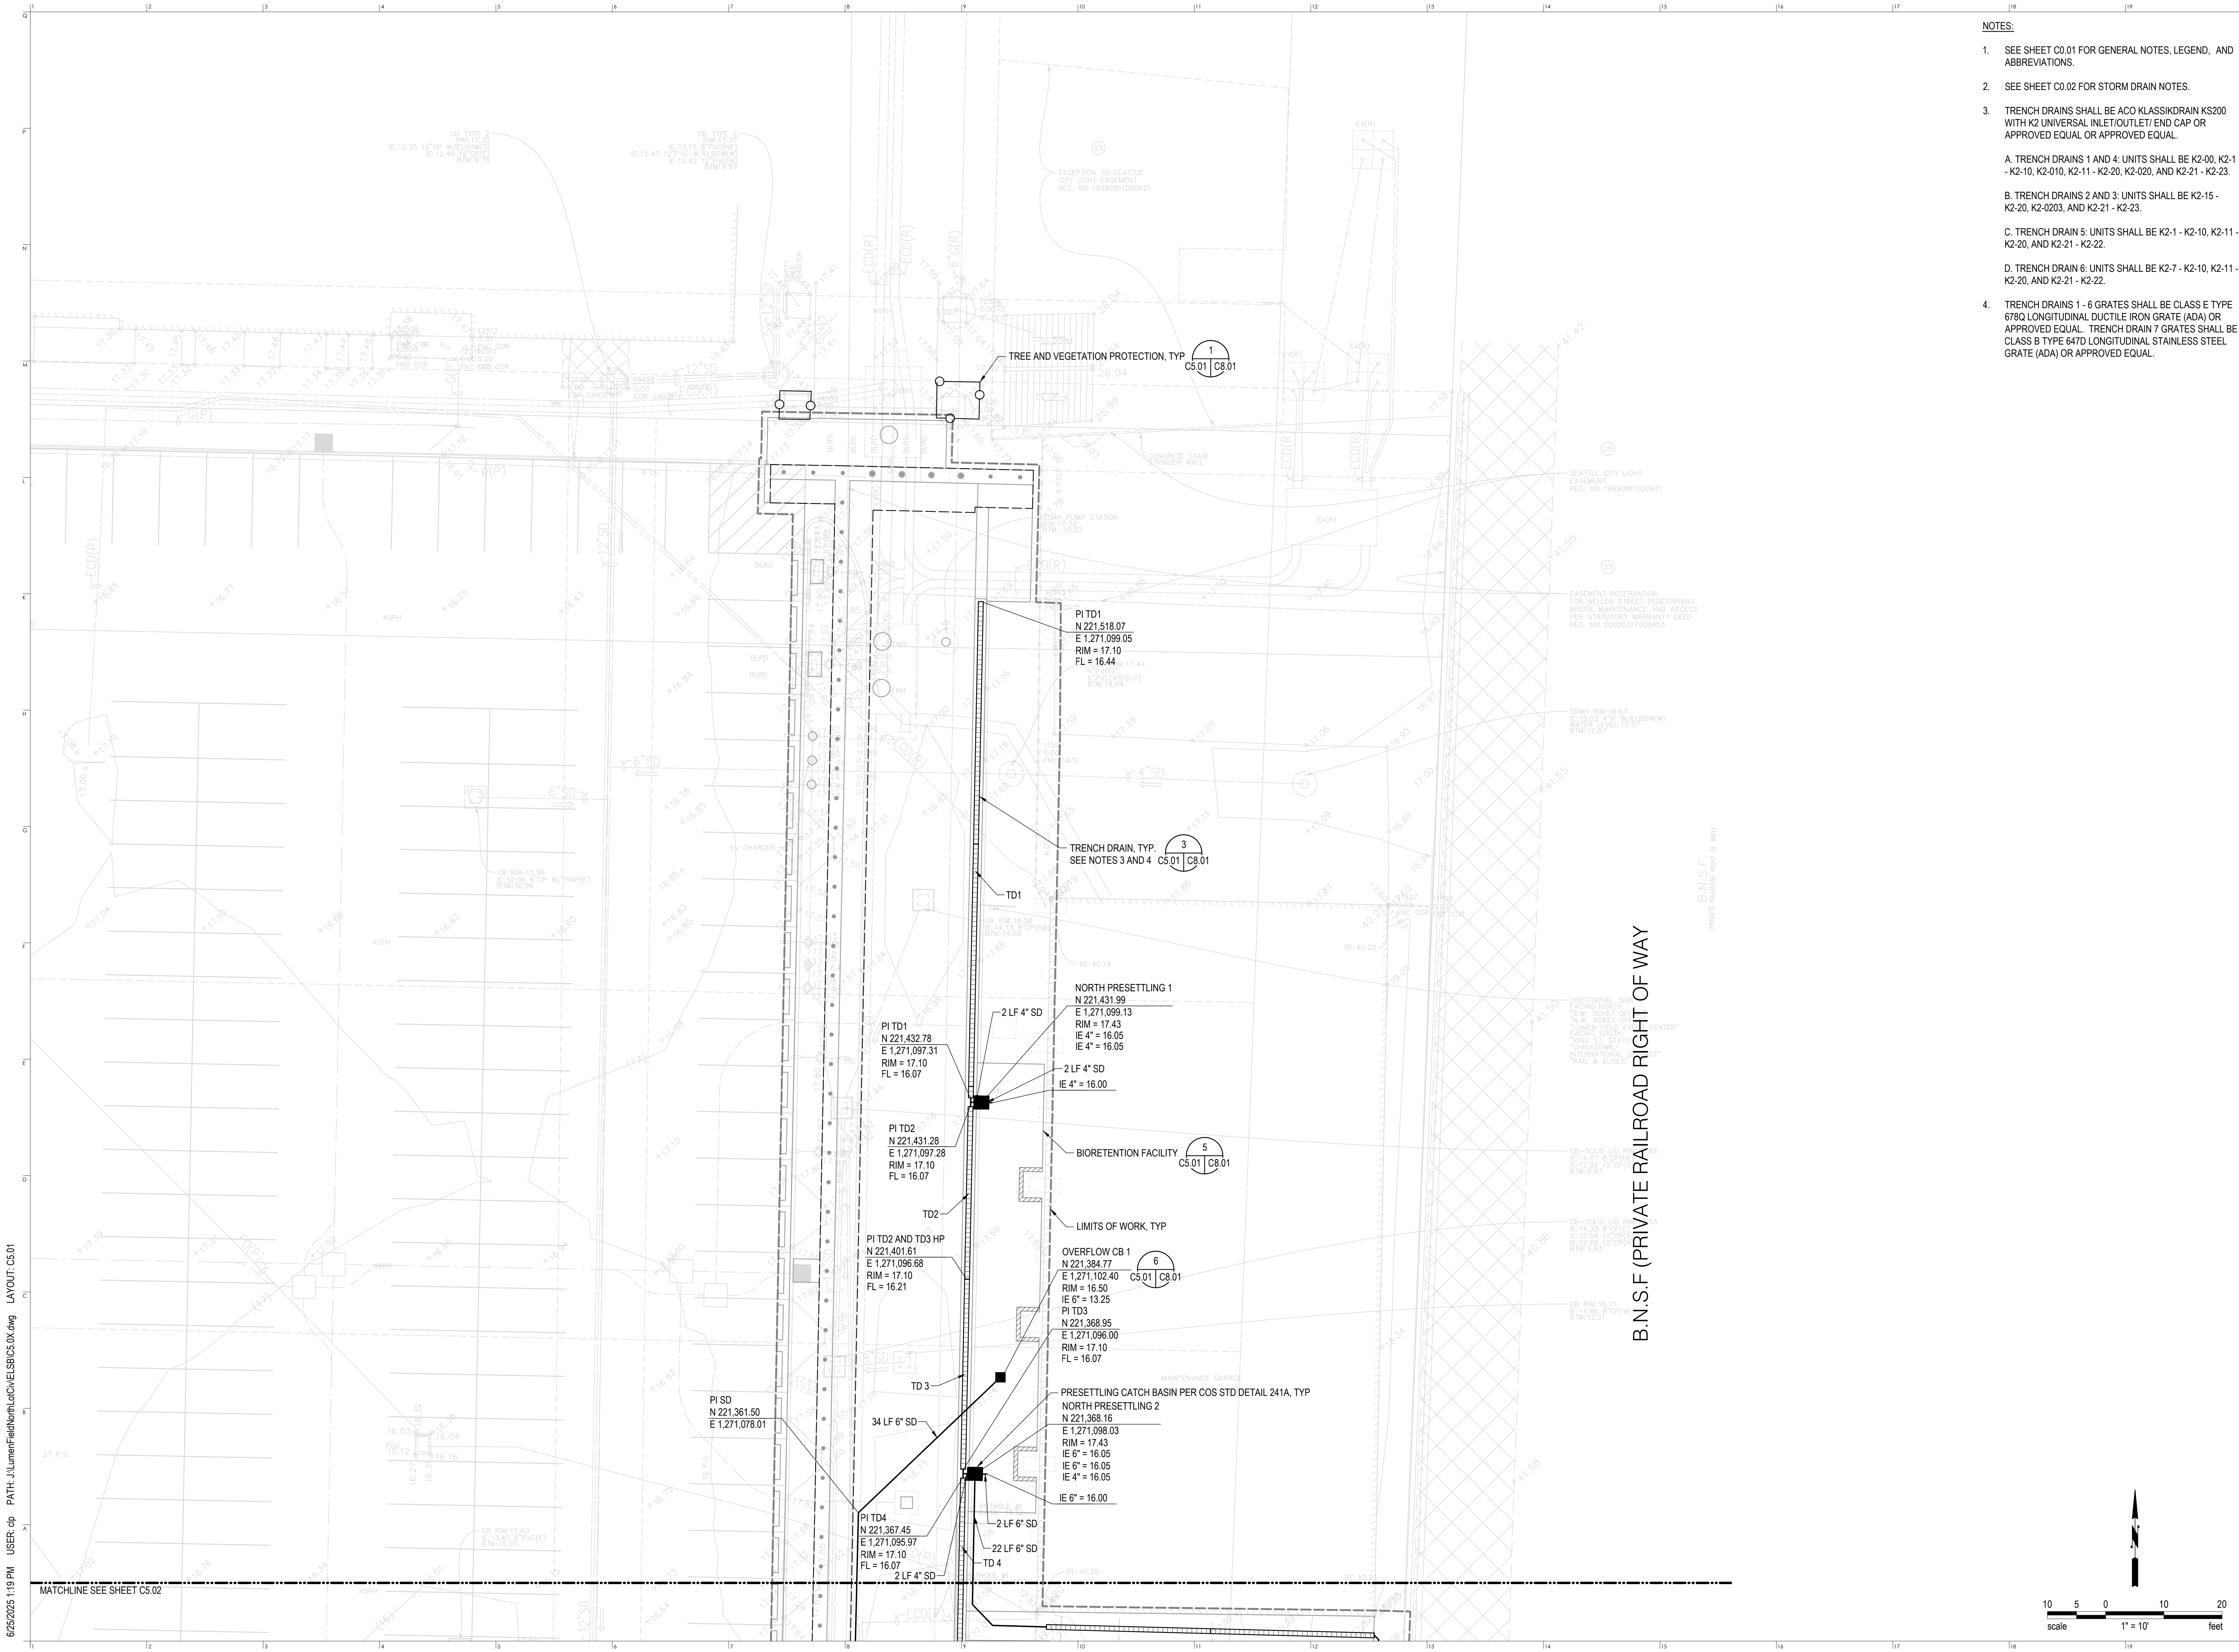

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR STORM DRAIN NOTES.
 - TRENCH DRAINS SHALL BE ACO KLASSIKDRAIN KS200 WITH K2 UNIVERSAL INLET/OUTLET/ END CAP OR APPROVED EQUAL OR APPROVED EQUAL.
 - A. TRENCH DRAINS 1 AND 4: UNITS SHALL BE K2-00, K2-1 - K2-10, K2-010, K2-11 - K2-20, K2-020, AND K2-21 - K2-23.
 - B. TRENCH DRAINS 2 AND 3: UNITS SHALL BE K2-15 - K2-20, K2-0203, AND K2-21 - K2-23.
 - C. TRENCH DRAIN 5: UNITS SHALL BE K2-1 - K2-10, K2-11 - K2-20, AND K2-21 - K2-22.
 - D. TRENCH DRAIN 6: UNITS SHALL BE K2-7 - K2-10, K2-11 - K2-20, AND K2-21 - K2-22.
 - TRENCH DRAINS 1 - 6 GRATES SHALL BE CLASS E TYPE 678Q LONGITUDINAL DUCTILE IRON GRATE (ADA) OR APPROVED EQUAL. TRENCH DRAIN 7 GRATES SHALL BE CLASS B TYPE 647D LONGITUDINAL STAINLESS STEEL GRATE (ADA) OR APPROVED EQUAL.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

CRAWFORD

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640

CIVIL ENGINEER
Magnuson Klemencic Assoc.
1301 Fifth Avenue, Suite 2000
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-8156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

KEY PLAN


NORTH

SEAL OF THE CITY OF SEATTLE
OFFICIAL RECORD
6/25/2025
cdp


DATE: 6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

RE: STORM DRAIN PLAN
Crawford project no.: KC00523

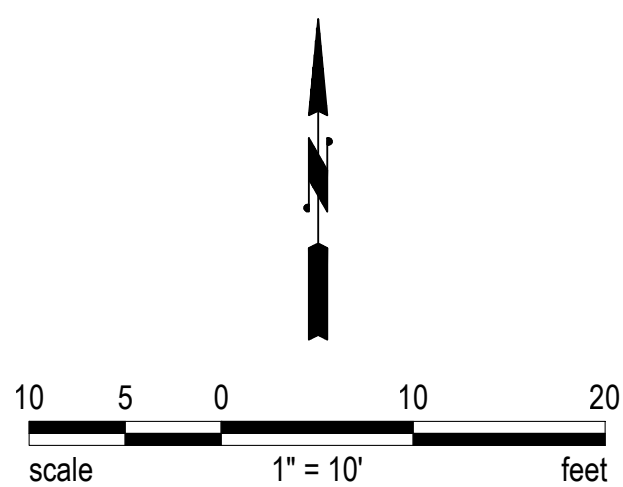

6/25/2025 1:19 PM USER: cdp PATH: \\LumenField\North\GWS\ELSB\C5.0X.dwg LAYOUT: C5.02

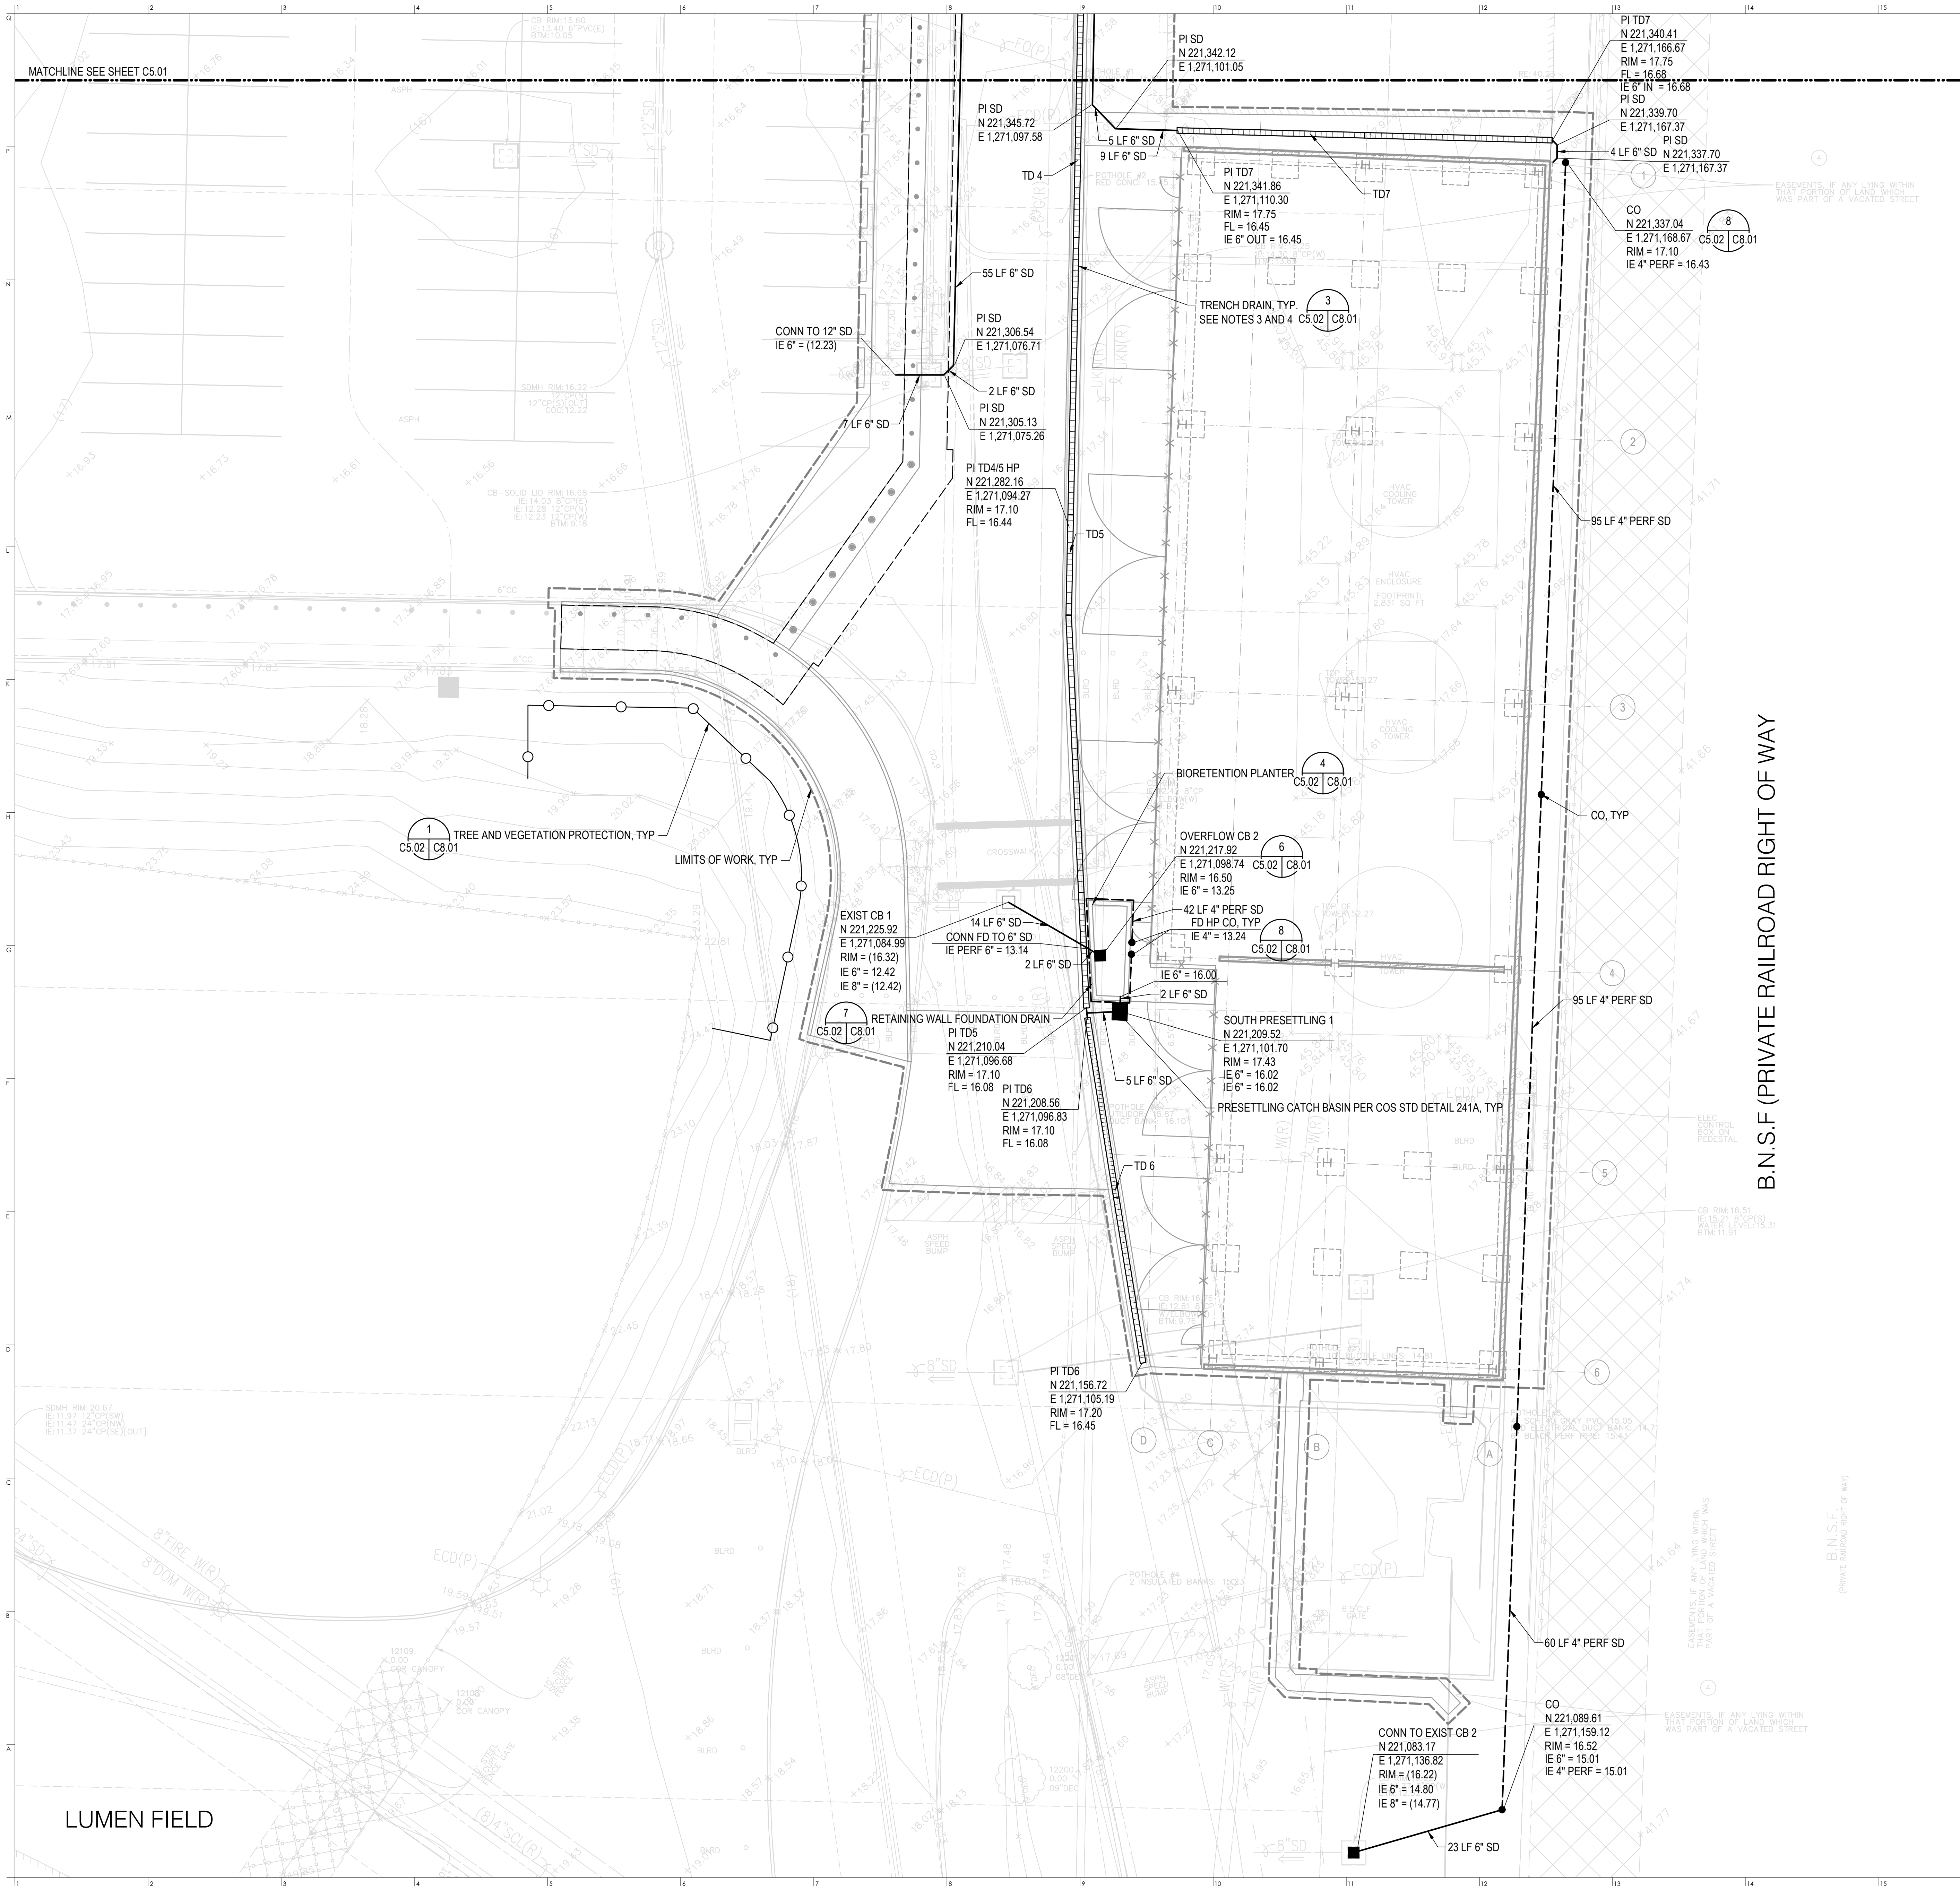

NOTES:

- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
- SEE SHEET C0.02 FOR STORM DRAIN NOTES.
- TRENCH DRAINS SHALL BE ACO KLASSIKDRAIN KS200 WITH K2 UNIVERSAL INLET/OUTLET/ END CAP OR APPROVED EQUAL OR APPROVED EQUAL.

A. TRENCH DRAINS 1 AND 4: UNITS SHALL BE K2-00, K2-1 - K2-10, K2-010, K2-11 - K2-20, K2-020, AND K2-21 - K2-23.

B. TRENCH DRAINS 2 AND 3: UNITS SHALL BE K2-15 - K2-20, K2-0203, AND K2-21 - K2-23.

C. TRENCH DRAIN 5: UNITS SHALL BE K2-1 - K2-10, K2-11 - K2-20, AND K2-21 - K2-22.

D. TRENCH DRAIN 6: UNITS SHALL BE K2-7 - K2-10, K2-11 - K2-20, AND K2-21 - K2-22.
- TRENCH DRAINS 1 - 6 GRATES SHALL BE CLASS E TYPE 678Q LONGITUDINAL DUCTILE IRON GRATE (ADA) OR APPROVED EQUAL. TRENCH DRAIN 7 GRATES SHALL BE CLASS B TYPE 647D LONGITUDINAL STAINLESS STEEL GRATE (ADA) OR APPROVED EQUAL.

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640

CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 3200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsehl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE


NORTH
KEY PLAN



DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

TITLE:
STORM DRAIN PLAN
Crawford project no.: KC00523

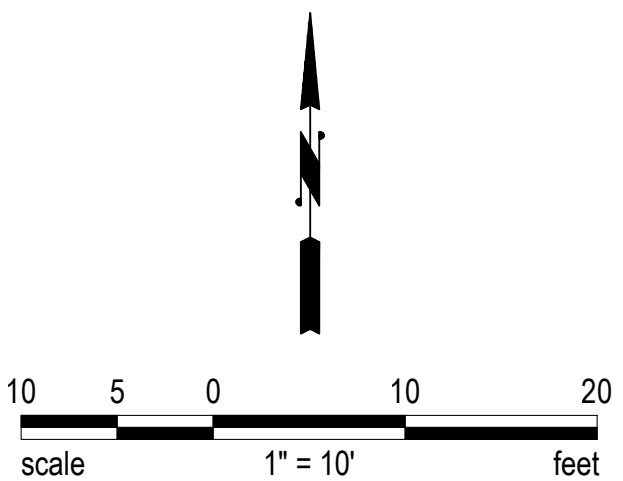

C5.02
sheet no.

6/25/2025 1:19 PM USER: cdp PATH: J:\LumenField\North\CL\VELS\B\CL\06.dwg LAYOUT: C6.01



- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR WATER NOTES.
 - SEE SHEET C0.02 FOR SANITARY SEWER NOTES.

LUMEN
FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Local Street, Suite 100
Kirkland City, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 2200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98141
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	EC
G	F	E	EA	EE

NORTH
KEY PLAN

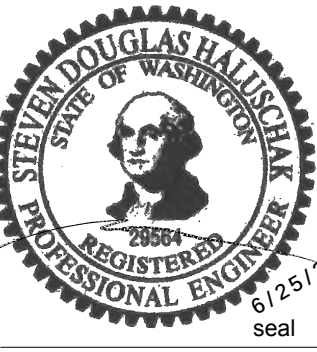


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

WATER AND SEWER PLAN
Crawford project no.: KC00523

C6.01
sheet no.

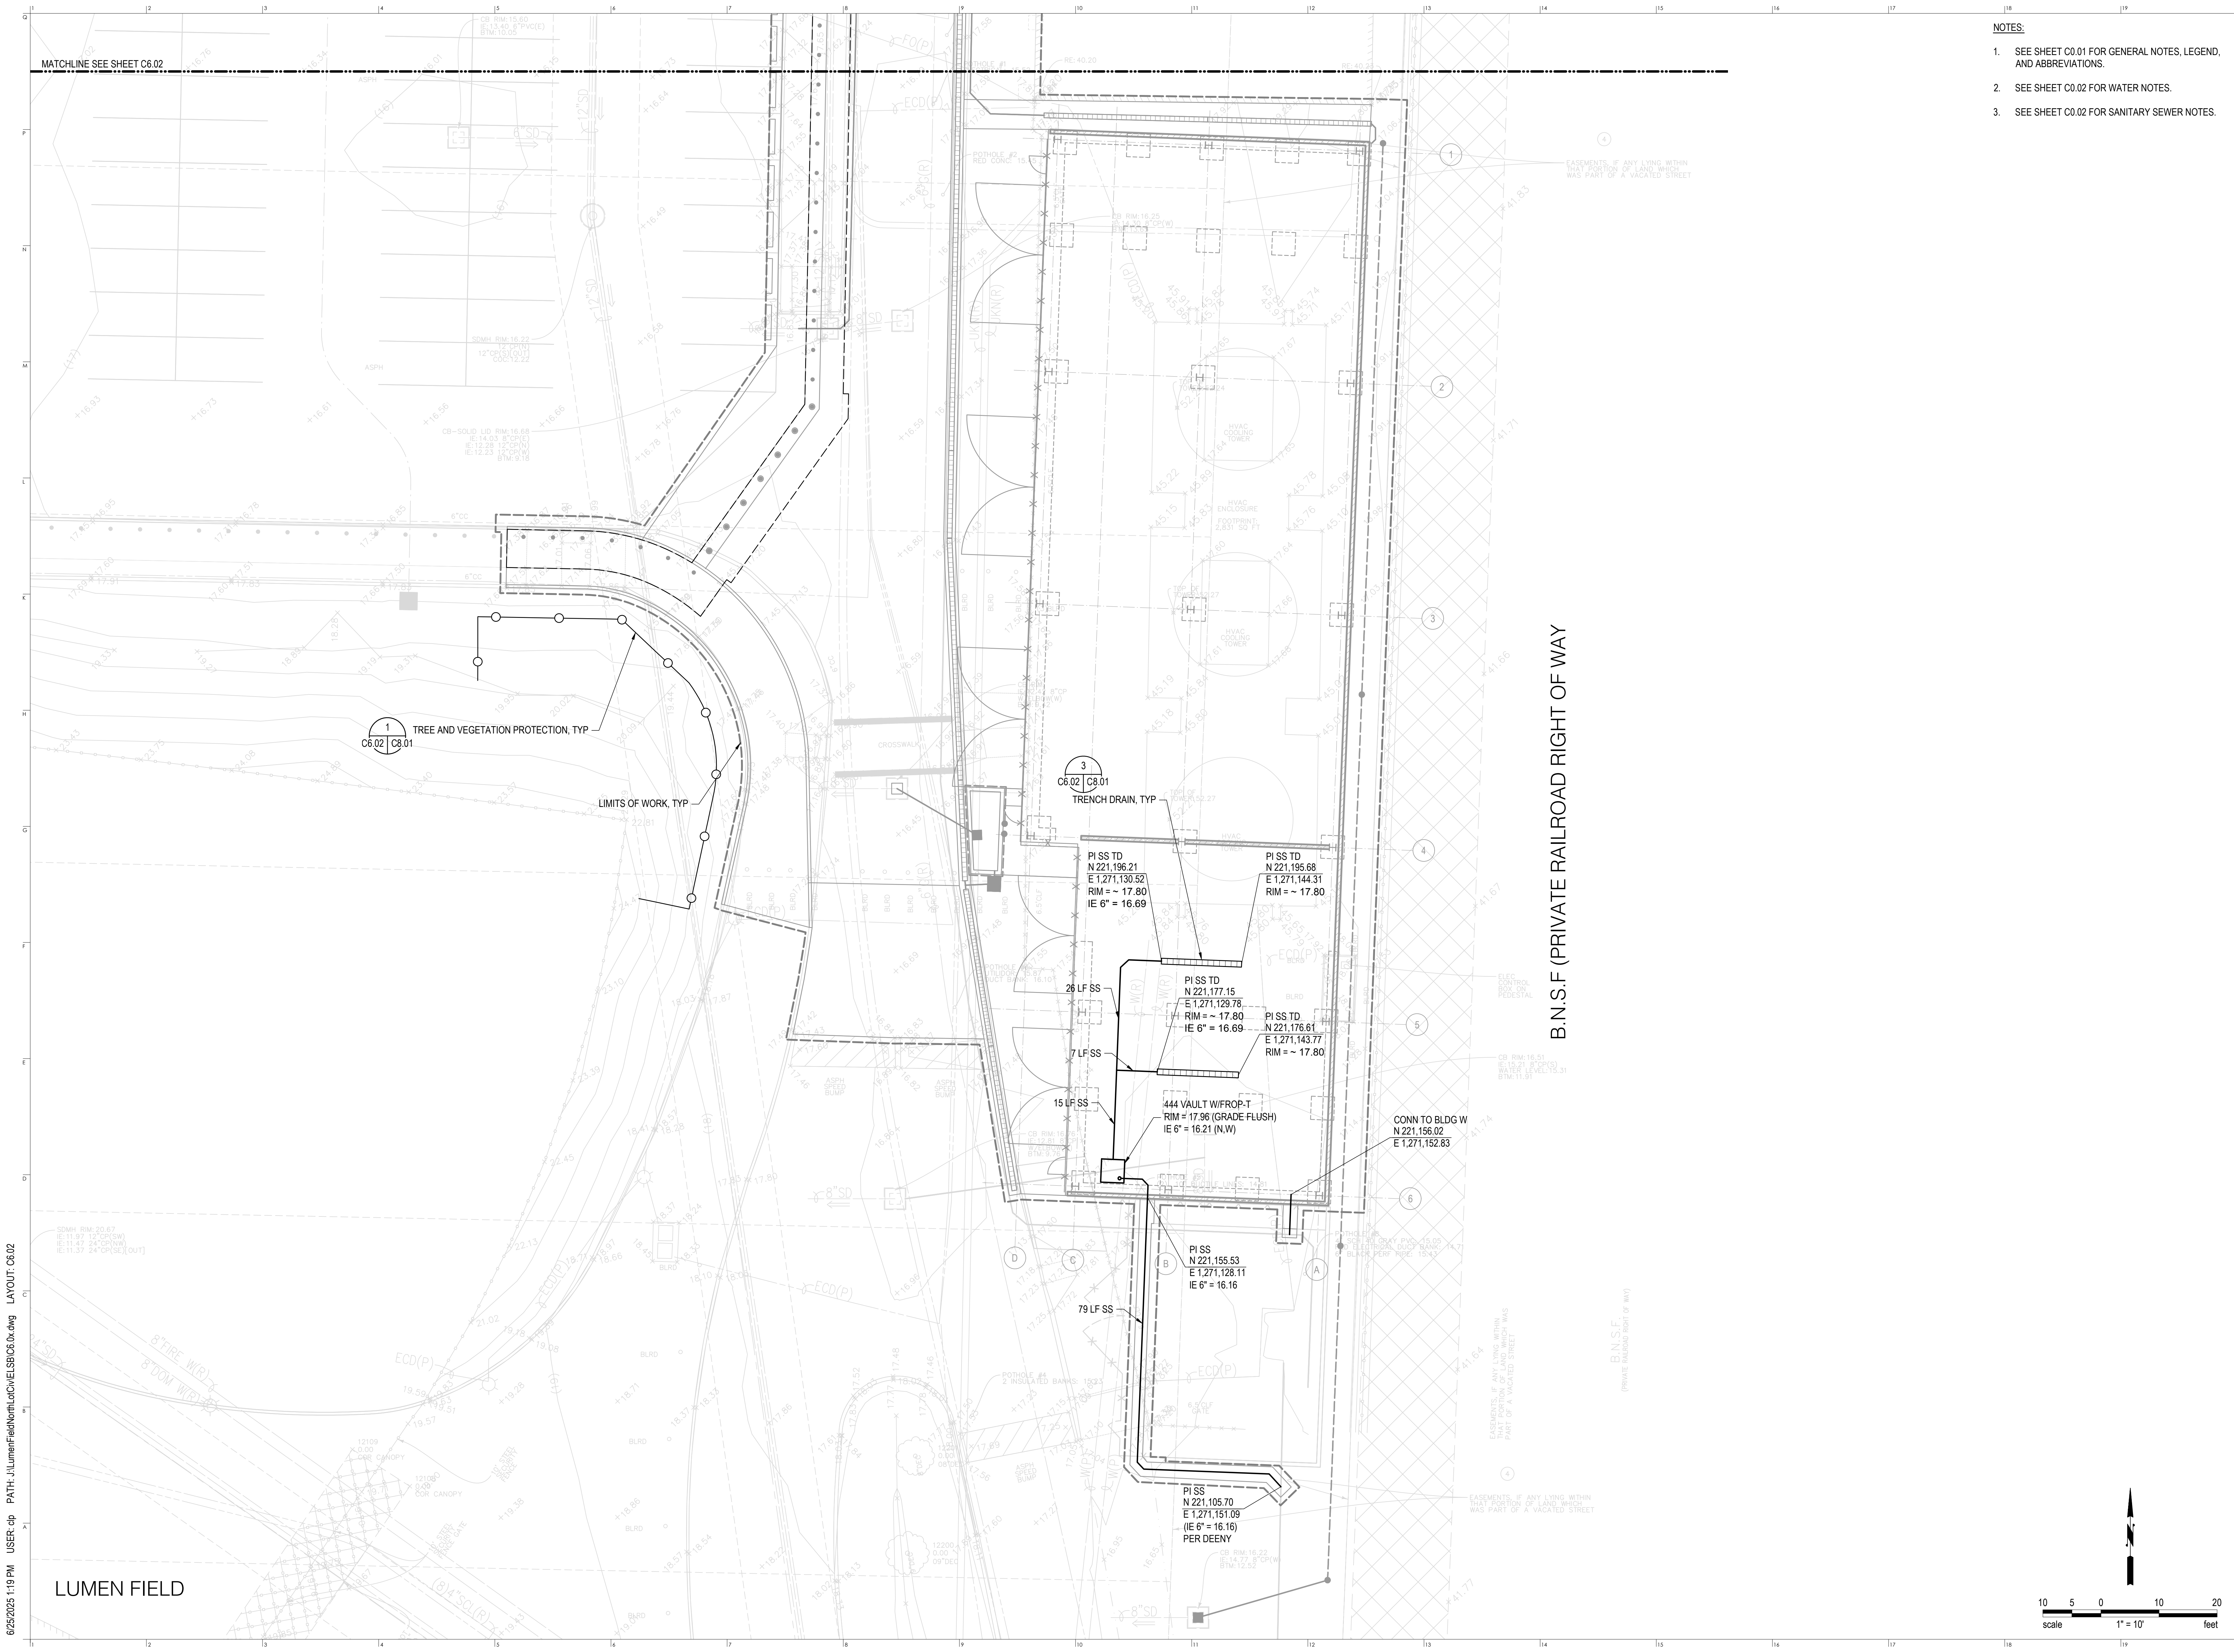

- NOTES:
- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
 - SEE SHEET C0.02 FOR WATER NOTES.
 - SEE SHEET C0.02 FOR SANITARY SEWER NOTES.

LUMEN
FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555



ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opeshli
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

A	B	C	PA	PB
H	N	S	D	PA
G	F	E	EA	EE

KEY PLAN

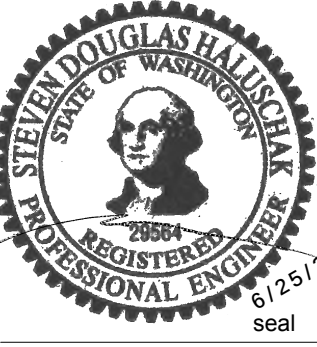

DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

WATER AND SEWER PLAN
crawford project no.: KC00523

C6.02
sheet no.

6/25/2025 1:18 PM USER: dp PATH: J:\LumenField\North\CB\CB.0X.dwg LAYOUT: C8.01


TREE & VEGETATION PROTECTION

TREE PROTECTION FENCING AND SIGN

- CHAIN LINK FENCE REQUIRED (NO ORANGE CONSTRUCTION FENCE OR PLYWOOD)
- MINIMUM 6' HIGH
- FENCE SHALL BE SUPPORTED BY RIGID POSTS DRIVEN INTO THE GROUND AT 8' MAXIMUM INTERVALS
- MUST BE INSTALLED PRIOR TO DEMOLITION OR GROUND DISTURBANCE
- KEPT IN PLACE FOR THE DURATION OF CONSTRUCTION
- NO DUMPING OF ANY MATERIALS IN THE PROTECTION AREA
- NO SOIL DISTURBANCE OR ACTIVITY ALLOWED WITHIN FENCED AREA: MATERIAL STORAGE/STOCKPILING, PARKING, EXCAVATION, DUMPING, OR WASHING
- MODIFICATIONS OF THESE REQUIREMENTS BY APPROVAL OF SDCI PLANNER ONLY
- IF ROOTS GREATER THAN 2 INCH FOUND OUTSIDE OF FENCING, PROTECT BY HAND EXCAVATION AND, IF NECESSARY, CUT CLEANLY AND KEEP MOIST
- USE 3 INCHES OR DEEPER WOOD CHIP MULCH OUTSIDE FENCED AREAS TO PROTECT FEEDER ROOTS


VEGETATION PROTECTION (DOES NOT APPLY TO TREES)

- ORANGE MESH OR SIMILAR OPEN MATERIAL
- PROTECT VEGETATION OUTSIDE CONSTRUCTION ZONE WITH FENCING AS SHOWN

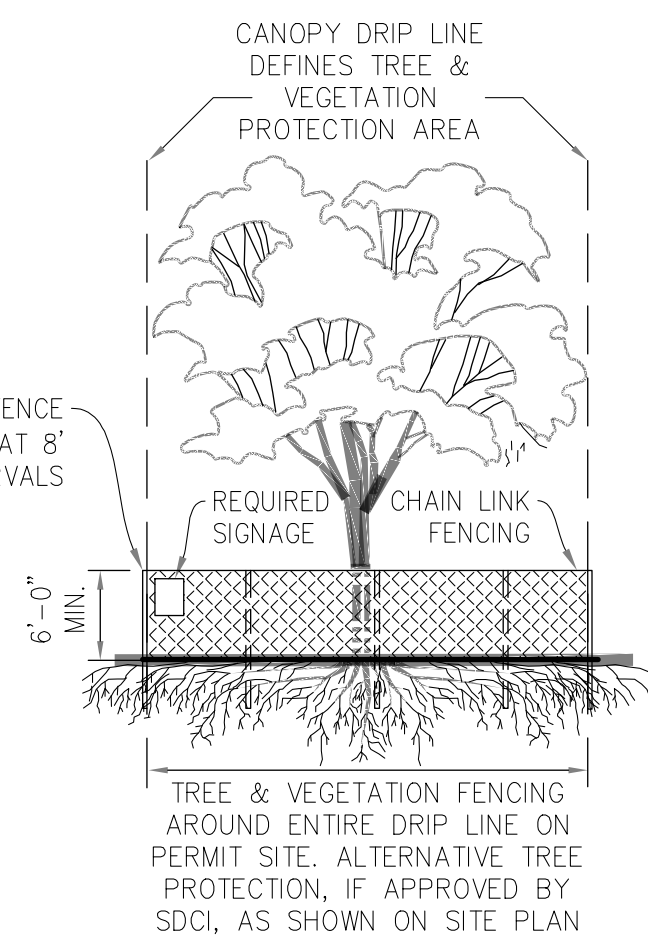

LINK TO REQUIRED TREE PROTECTION SIGNAGE:

SYMBOL:

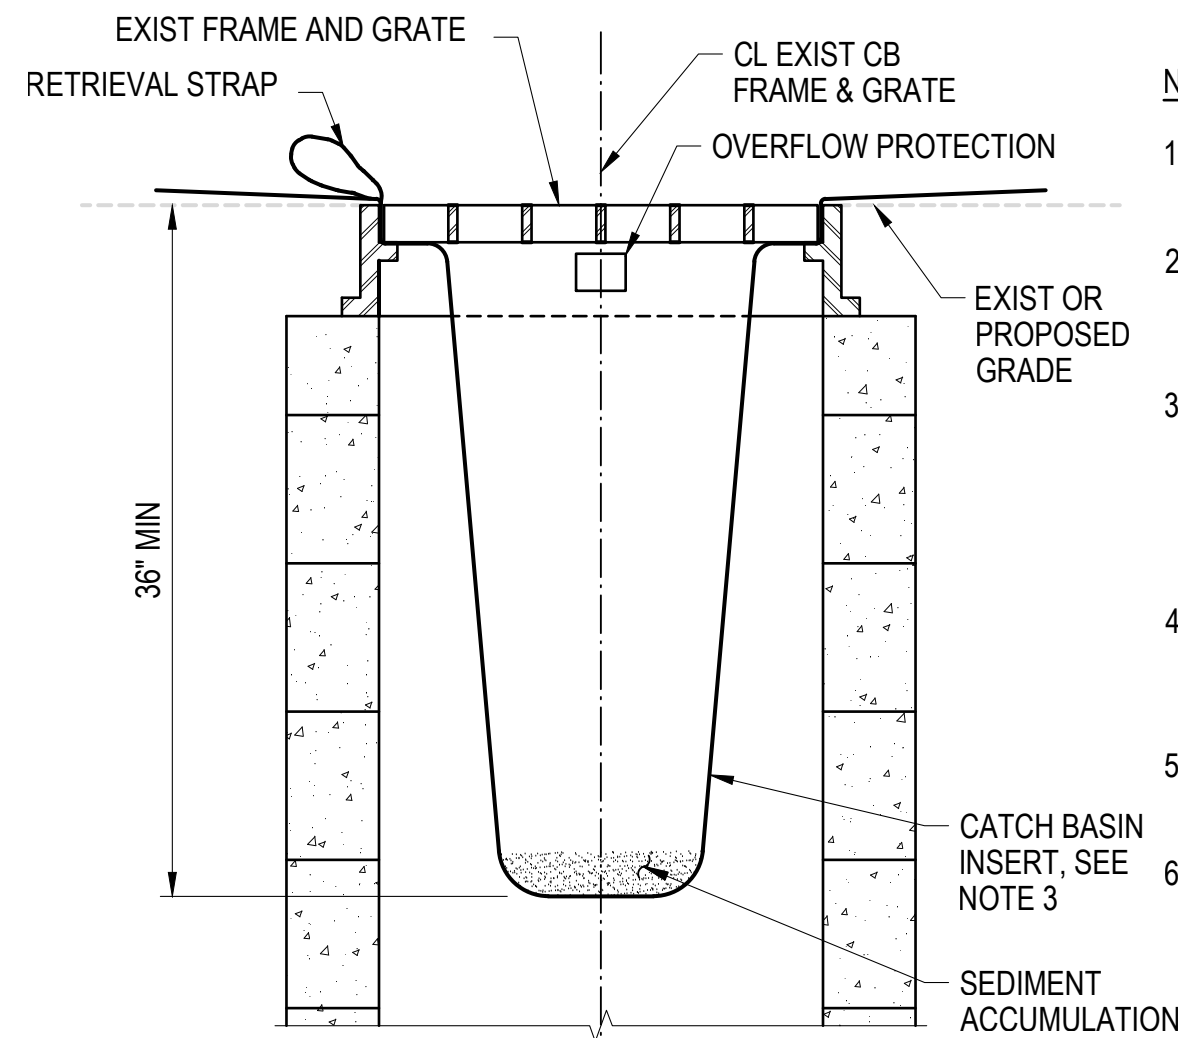


CATCH BASIN INSERT

NTS

NOTES:

- CATCH BASIN INSERTS SHALL BE PROVIDED IN THE CATCH BASINS NOTED ON PLAN.
- INSERTS SHALL BE INSTALLED PRIOR TO CLEARING AND GRADING ACTIVITY, OR UPON PLACEMENT OF NEW CATCH BASIN.
- CATCH BASIN INSERT SHALL BE STREAMGUARD SEDIMENT CATCH BASIN INSERT #3003 BY BOWHEAD ENVIRONMENTAL AND SAFETY OR ULTRA-DRAIN GUARD CATCH BASIN INSERT BY ULTRA TECH.
- CATCH BASIN INSERTS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- SEDIMENT SHALL BE REMOVED FROM THE UNIT WHEN IT BECOMES HALF FULL.
- SEDIMENT REMOVAL SHALL BE ACCOMPLISHED BY REMOVING THE INSERT, EMPTYING AND RE-INSERTING IT INTO THE CATCH BASIN.

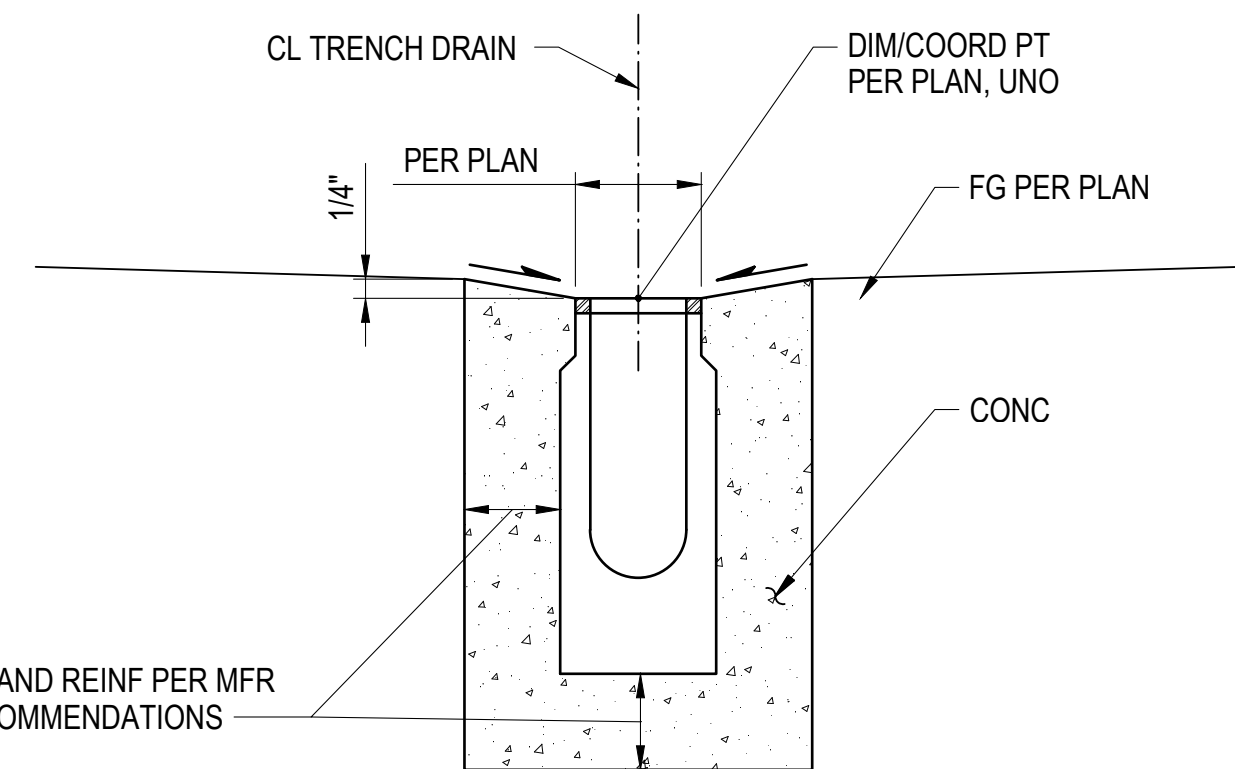


TRENCH DRAIN

NTS

TREE AND VEGETATION PROTECTION

NTS

C0.03, C1.01, C1.02, C2.01, C2.02, C3.01, C3.02, C4.01, C4.02, C5.01, C5.02, C6.01, C6.02 | C8.01

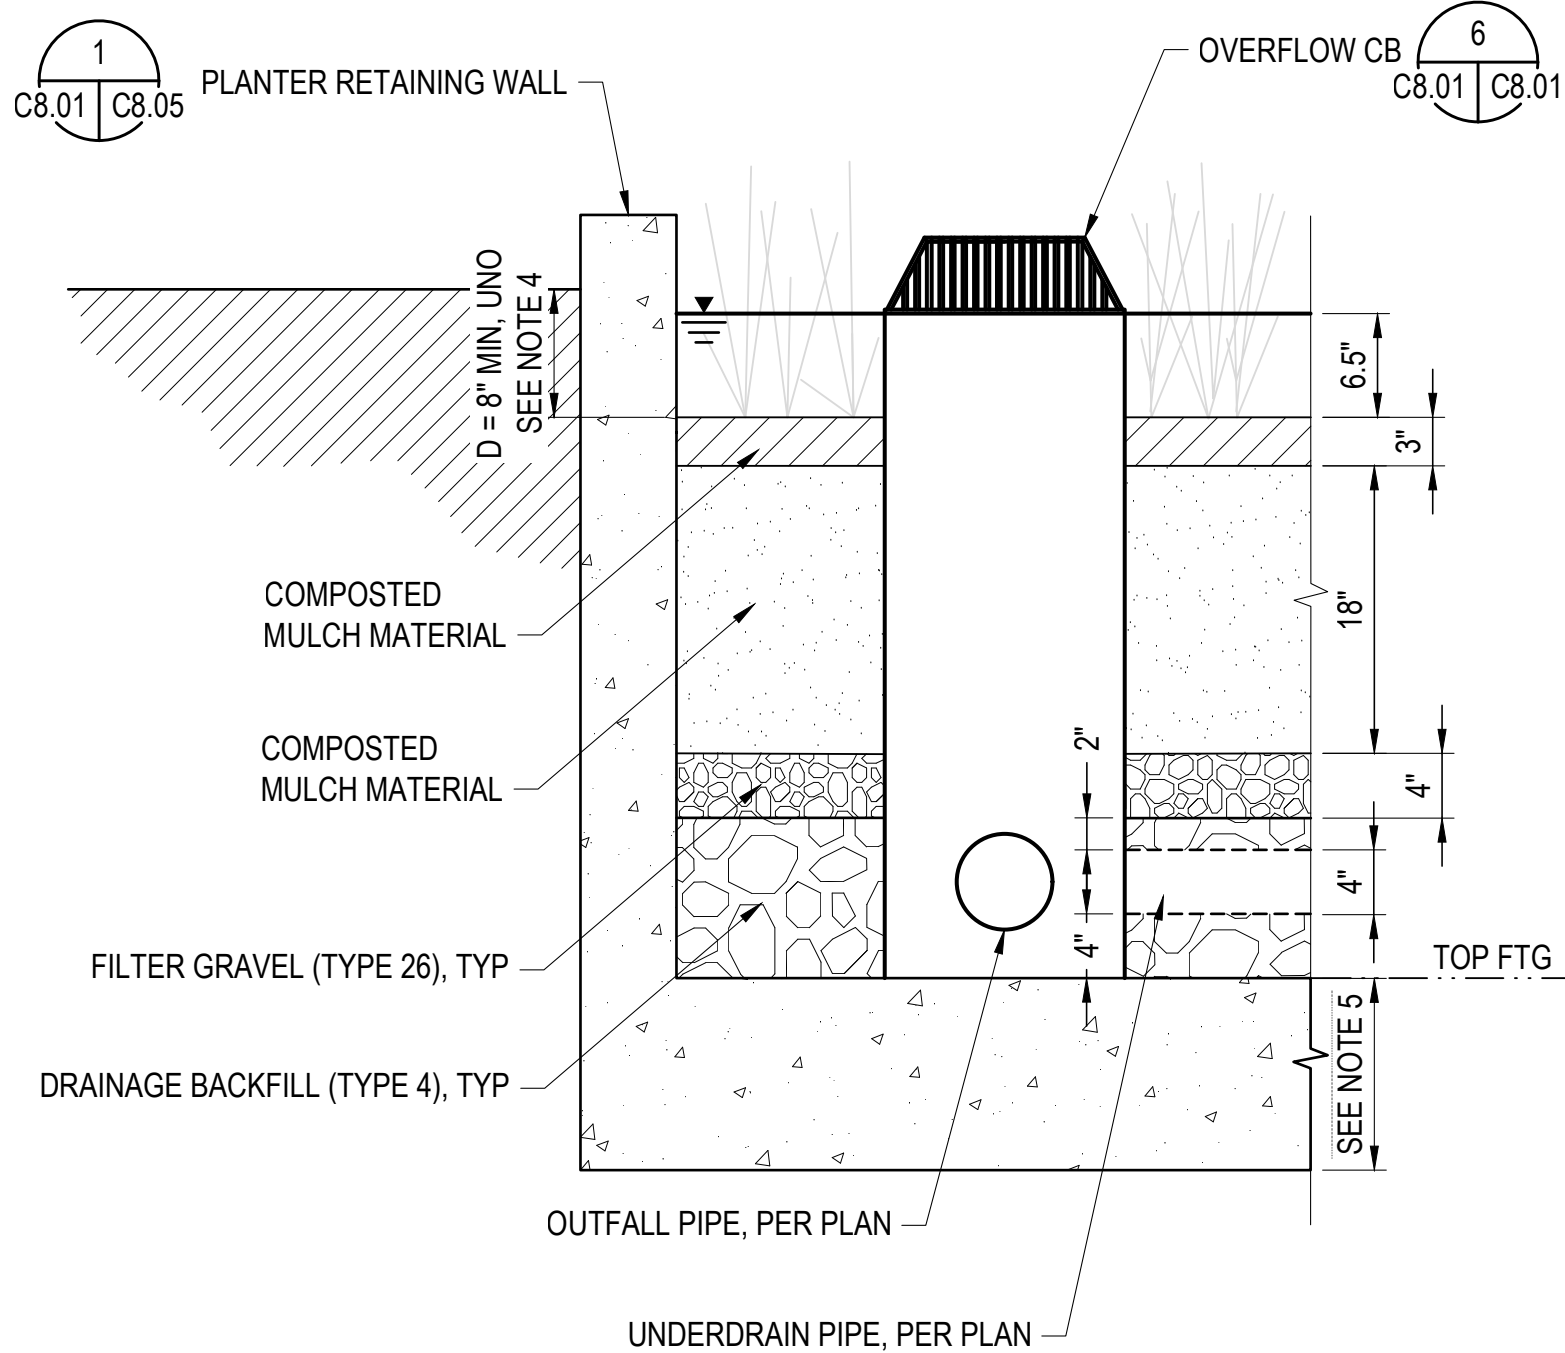


BIORETENTION PLANTER

NTS

NOTES:


- BIORETENTION FACILITIES SHALL CONFORM TO LANDSCAPE ARCHITECT SPECIFICATIONS AND THESE NOTES. ALL MATERIALS INDICATED IN SUBSEQUENT NOTES SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR REVIEW PRIOR TO INSTALLATION.
- MULCH FOR BOTTOM OF FACILITY (BELOW OVERFLOW RISER) SHALL BE COMPOST MULCH PER CITY OF SEATTLE STANDARD SPECIFICATION 9-14.4 (8/66). MULCH SHALL BE WELL AGED, UNIFORM IN COLOR, AND FREE OF FOREIGN MATERIAL INCLUDING PLANT MATERIAL. WELL AGED MULCH IS DEFINED AS MULCH THAT HAS BEEN STOCKPILED OR STORED FOR AT LEAST TWELVE (12) MONTHS.
- BIORETENTION SOIL MIXTURE SHALL COMPLY WITH THE CITY OF SEATTLE STANDARD SPECIFICATION 7-21, AND SHALL HAVE A LONG-TERM INFILTRATION RATE OF 2 INCHES/HOUR.
- DEPTH (D) AT AREA C SHALL BE A MINIMUM OF 6-1/2 INCHES.
- FOOTING DEPTH PER PLANTER RETAINING WALL DETAIL 2/C8.03.
- PERFORATED PIPE SHALL BE SLOTTED PIPE PER CITY OF SEATTLE STANDARD PLAN 291.

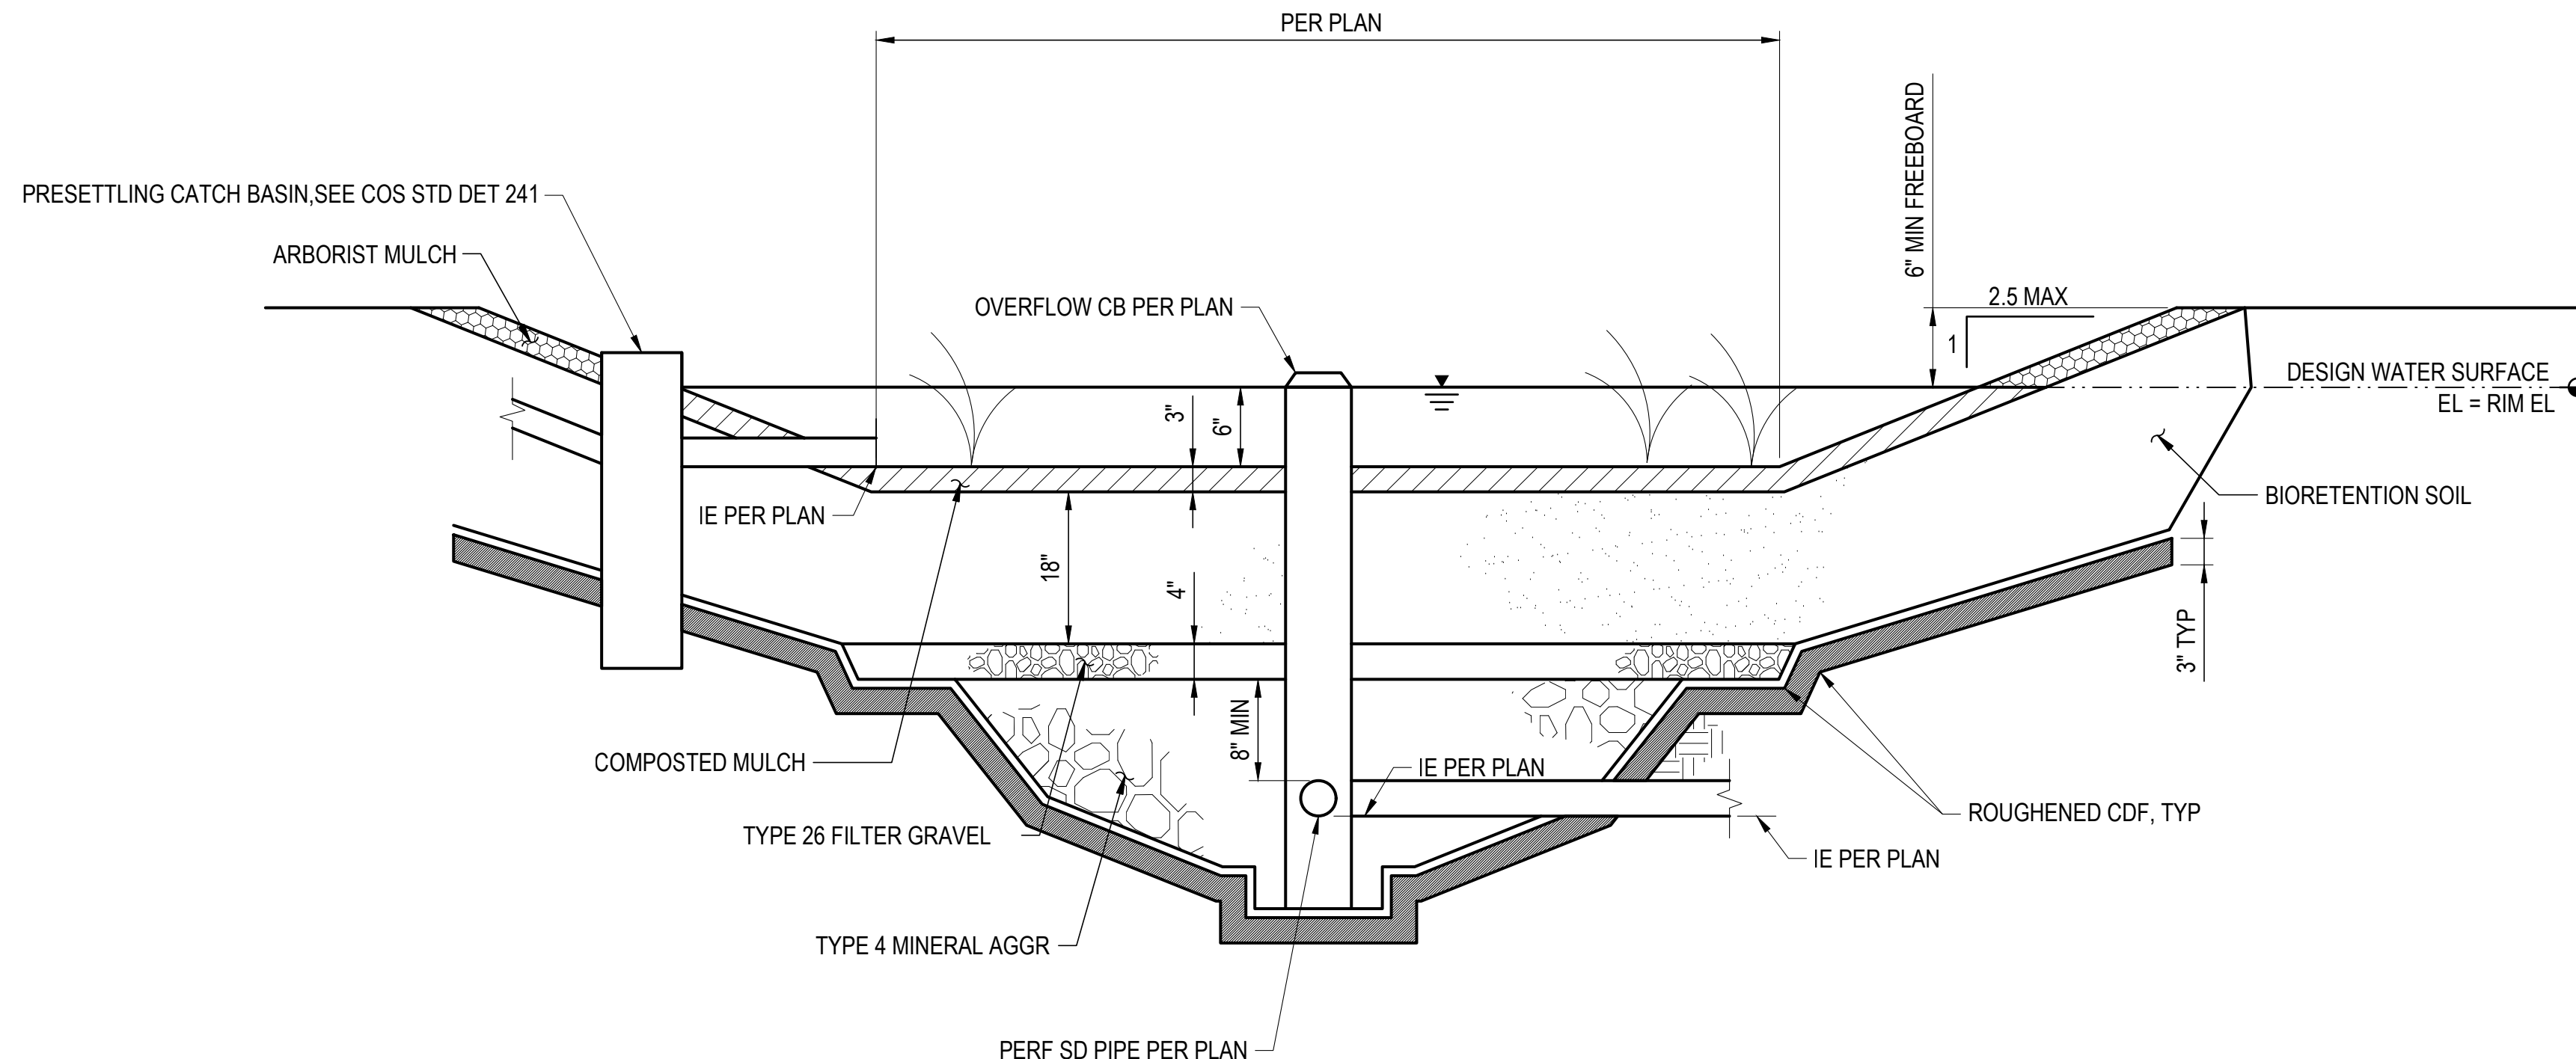

SECTION A

BIORETENTION FACILITY

NTS

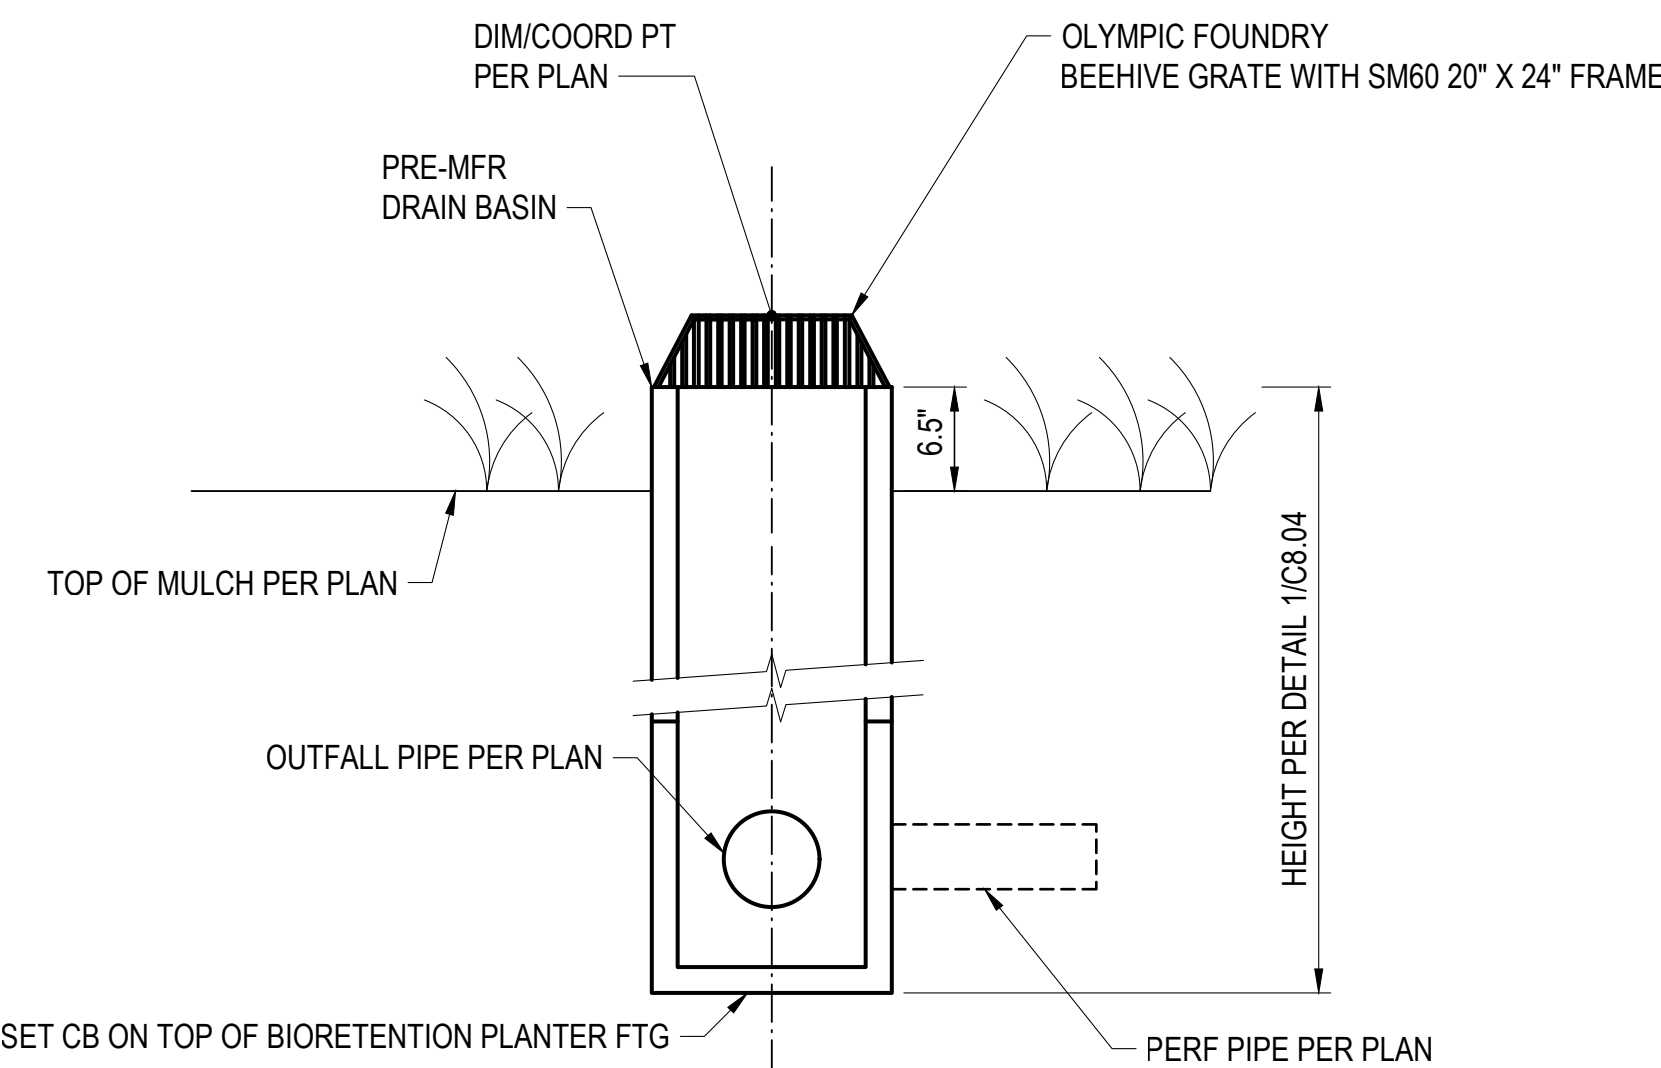


NOTES:

- OVERFLOW CATCH BASIN SHALL BE TYPE 26 CB WITH 12" RISER.

OVERFLOW CATCH BASIN

NTS

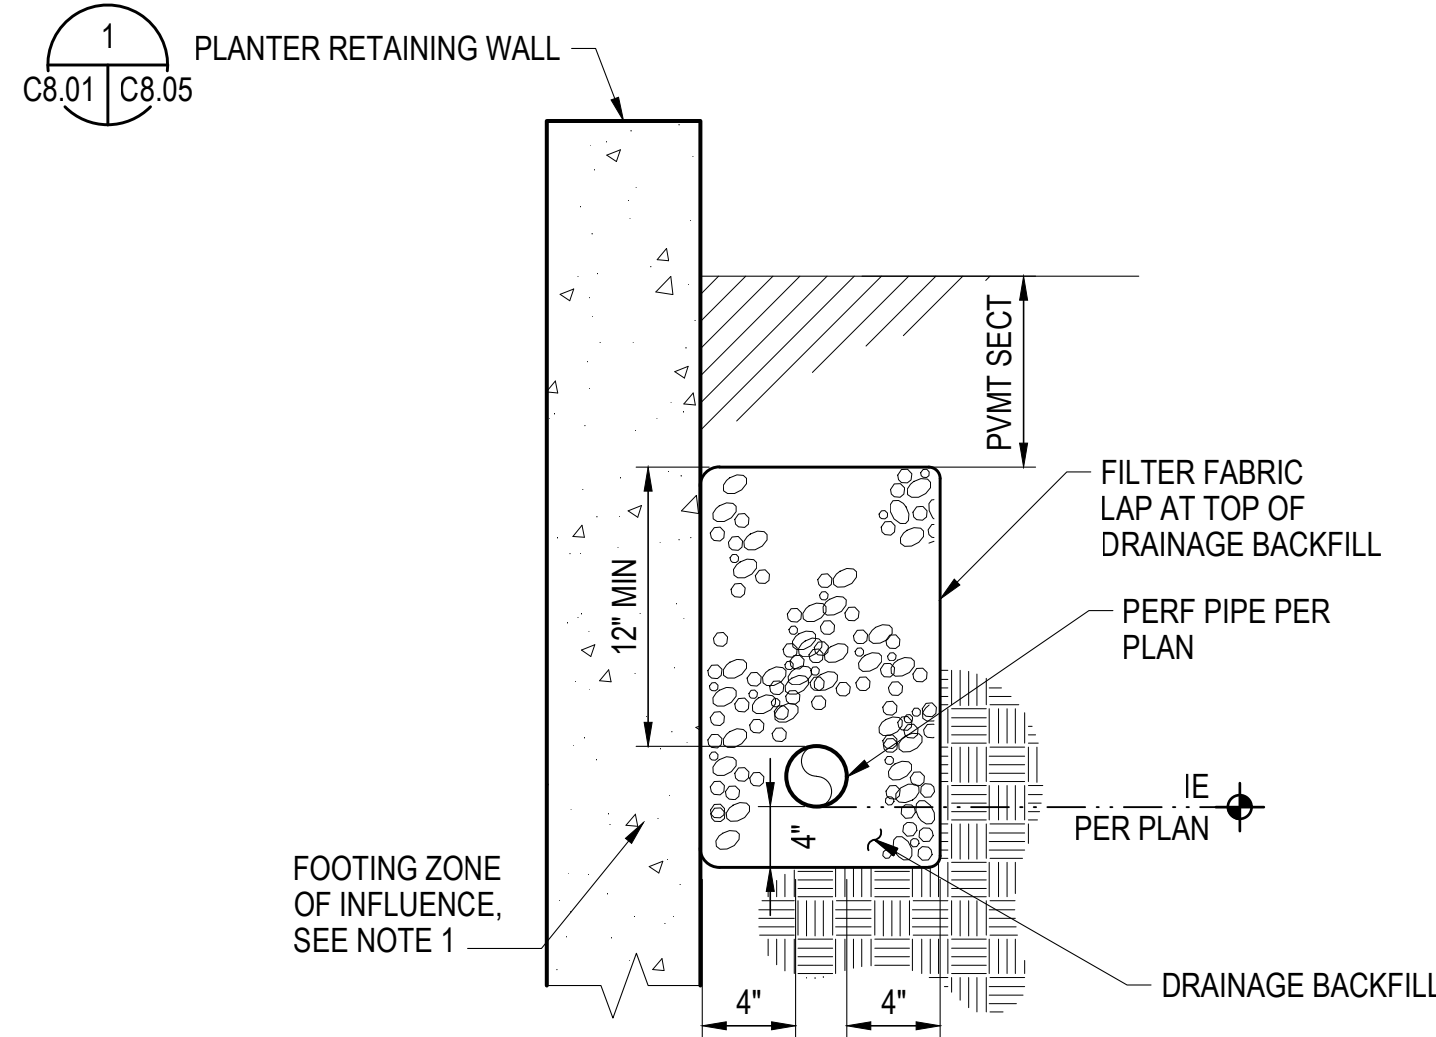


NOTES:

- HORIZONTAL BENDS BETWEEN CLEANOUTS AND PIPE SERVED BY DOWNSTREAM CLEANOUT SHALL NOT EXCEED 90 DEGREES.

RETAINING WALL FOUNDATION DRAIN

NTS

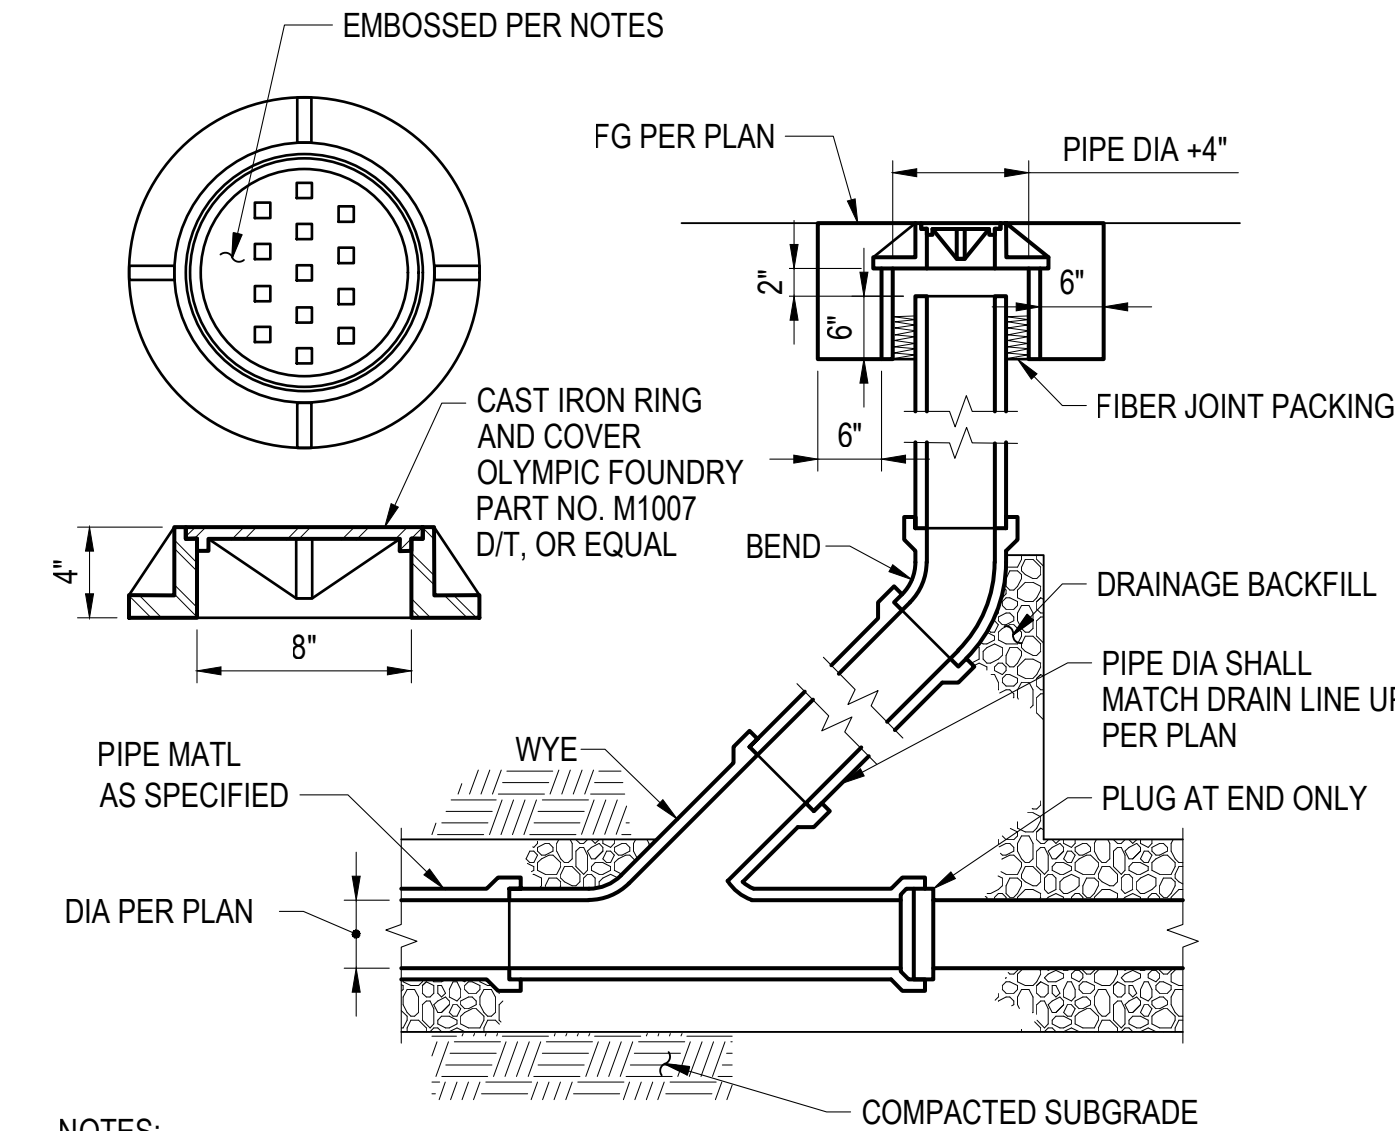

NOTES:

- STORM DRAIN SHALL HAVE "SD" EMBOSSED ON LID.
- FOUNDATION DRAIN SHALL HAVE "FD" EMBOSSED ON LID.

CLEANOUT

NTS

LUMEN FIELD

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555




ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opsell
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

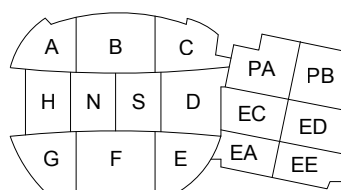

NORTH
KEY PLAN

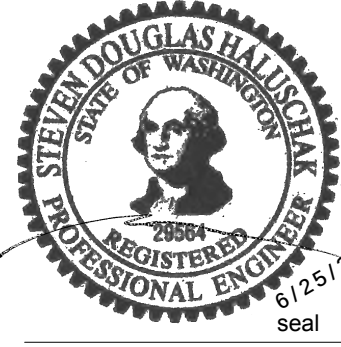


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

REVISIONS
SECTIONS AND DETAILS
Crawford project no.: KC40923

C8.01
sheet no.


6/25/2025 1:18 PM USER: dp PATH: J:\LumenField\North\CB\CB.CX.dwg LAYOUT: C8.02

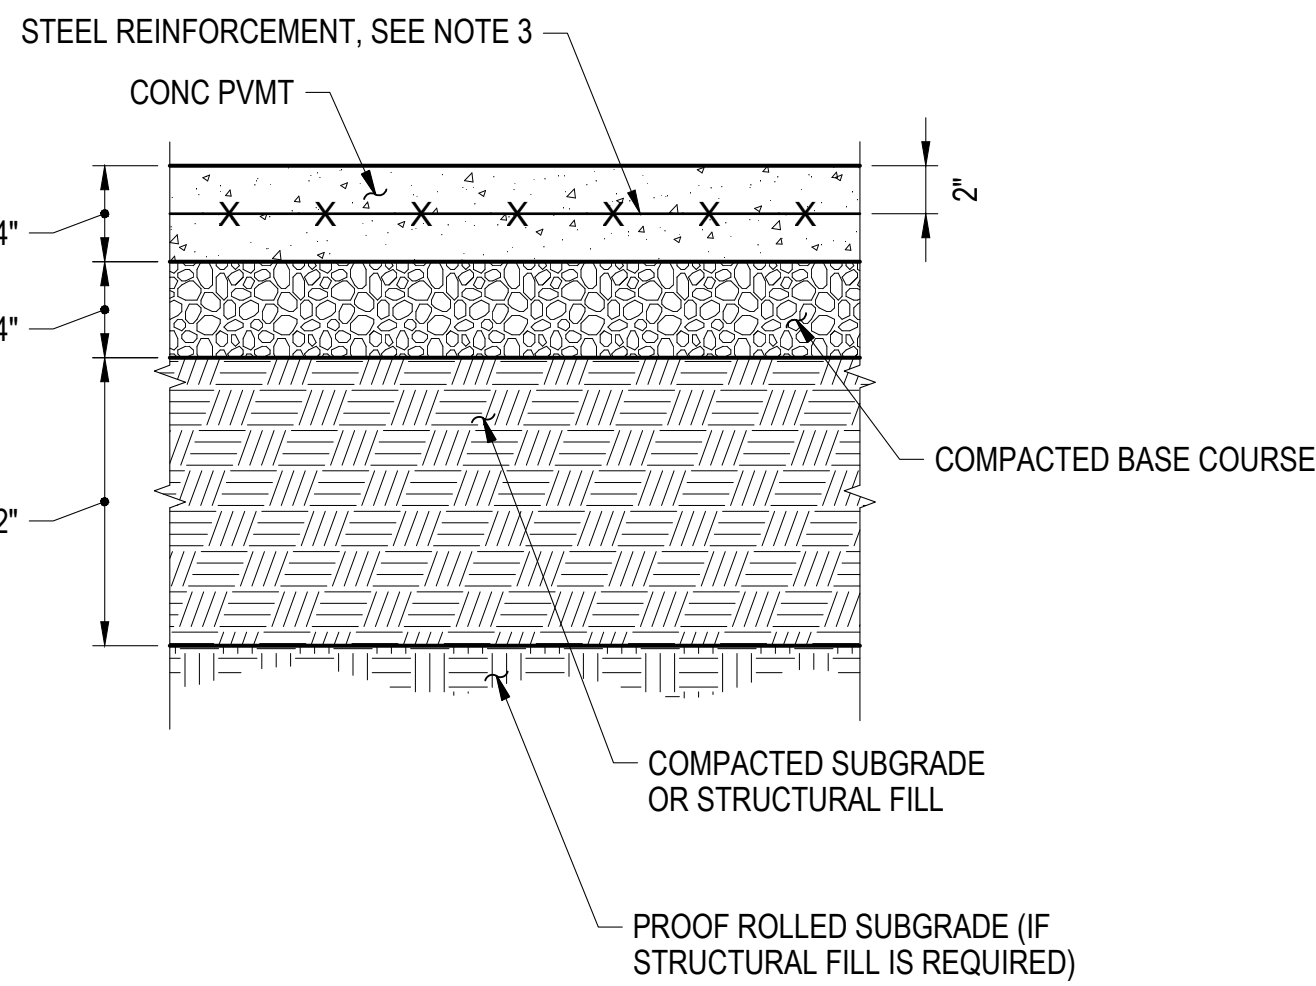

NOTES:

1. PROVIDE EXPANSION JOINT WHEN PAVEMENT ABUTS FIXED OBJECTS, CONCRETE CURBS AND PADS, STRUCTURAL FOUNDATION, AND/OR RIMS.
2. PROVIDE WEAKENED PLANE JOINTS AS FOLLOWS:
 - 8'-0" OC MAXIMUM
 - PANELS SHALL HAVE MAXIMUM LENGTH TO WIDTH RATIO OF 1.25
3. WHERE LENGTH TO WIDTH RATIO IS EXCEEDED OR PANELS ARE NON-RECTANGULAR, AND/OR WHERE INDICATED ON DRAWINGS, PROVIDE 6x6 W2.9xW2.9 WELDED WIRE MESH REINFORCEMENT.


LIGHT-DUTY/PEDESTRIAN CONCRETE PAVEMENT
NTS

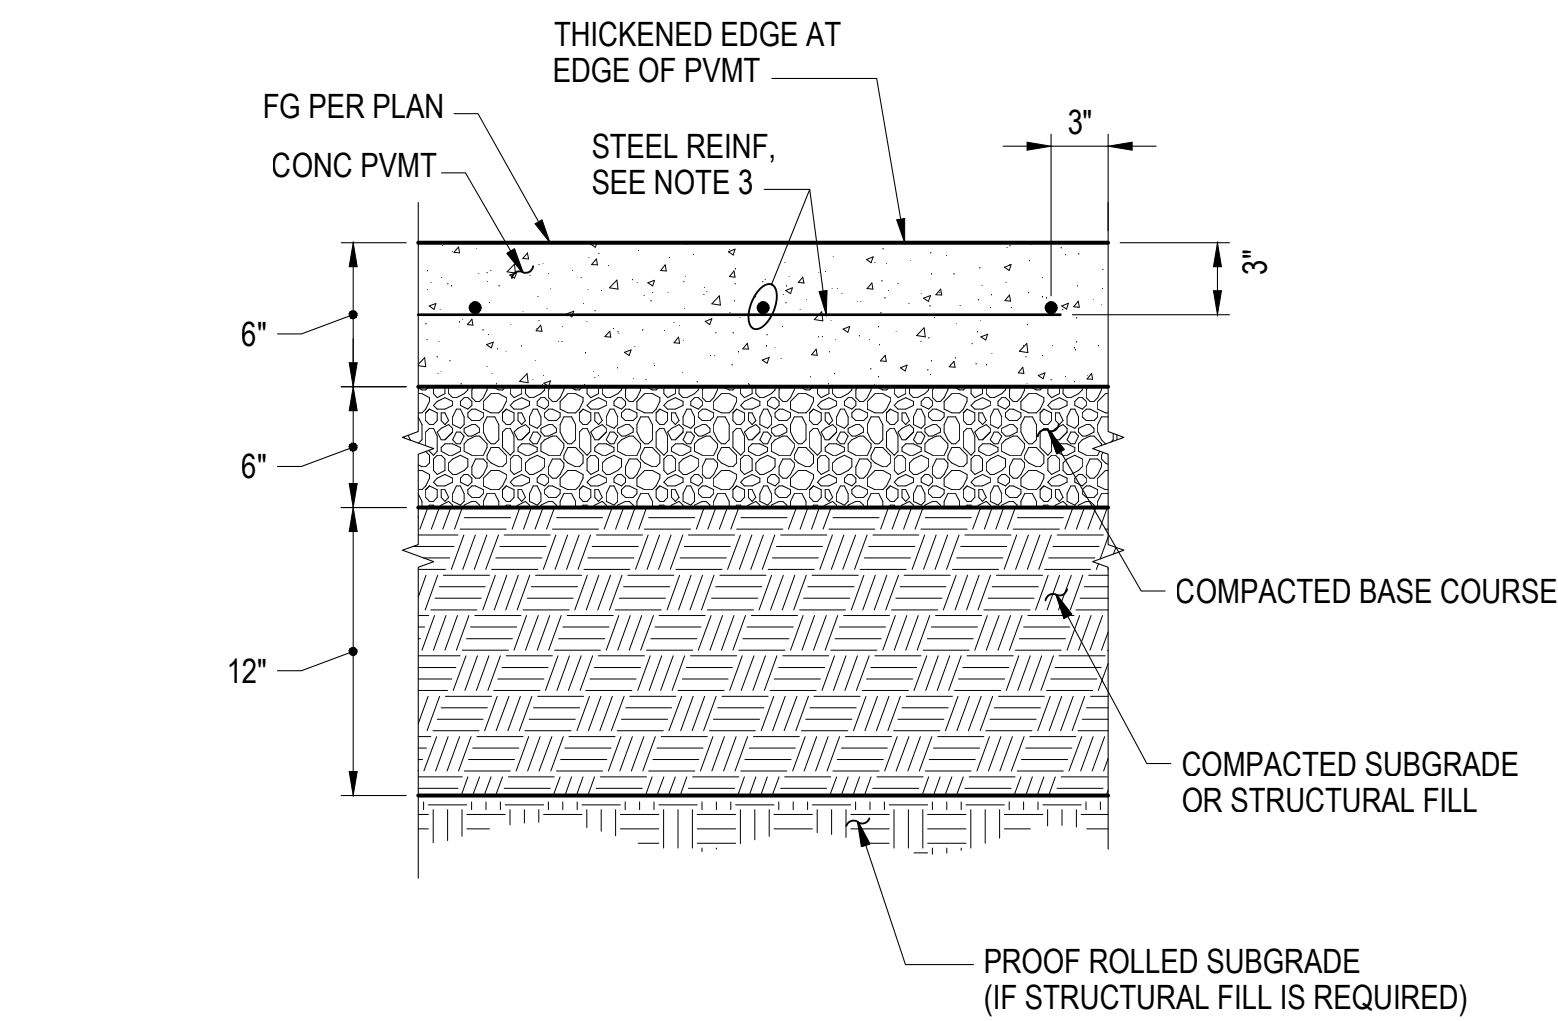


NOTES:

1. PROVIDE EXPANSION JOINT WHEN PAVEMENT ABUTS FIXED OBJECTS, CONCRETE CURBS AND PADS, STRUCTURAL FOUNDATION, AND/OR RIMS.
2. UNLESS NOTED OTHERWISE, PROVIDE WEAKENED PLANE JOINTS AS FOLLOWS:
 - 12'-0" OC MAXIMUM
 - PANELS SHALL HAVE MAXIMUM LENGTH TO WIDTH RATIO OF 1.25
3. WHERE LENGTH TO WIDTH RATIO IS EXCEEDED OR PANELS ARE NON-RECTANGULAR, AND/OR WHERE INDICATED ON DRAWINGS, PROVIDE REINFORCING WITH #5 @ 18" OC. EW.


HEAVY-DUTY CONCRETE PAVEMENT
NTS

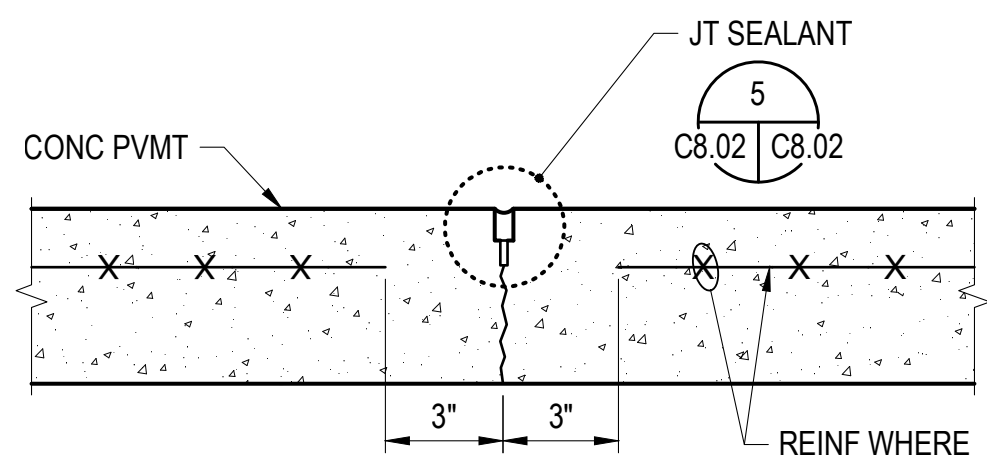


WEAKEND PLAN JOINT (WPJ)
NTS

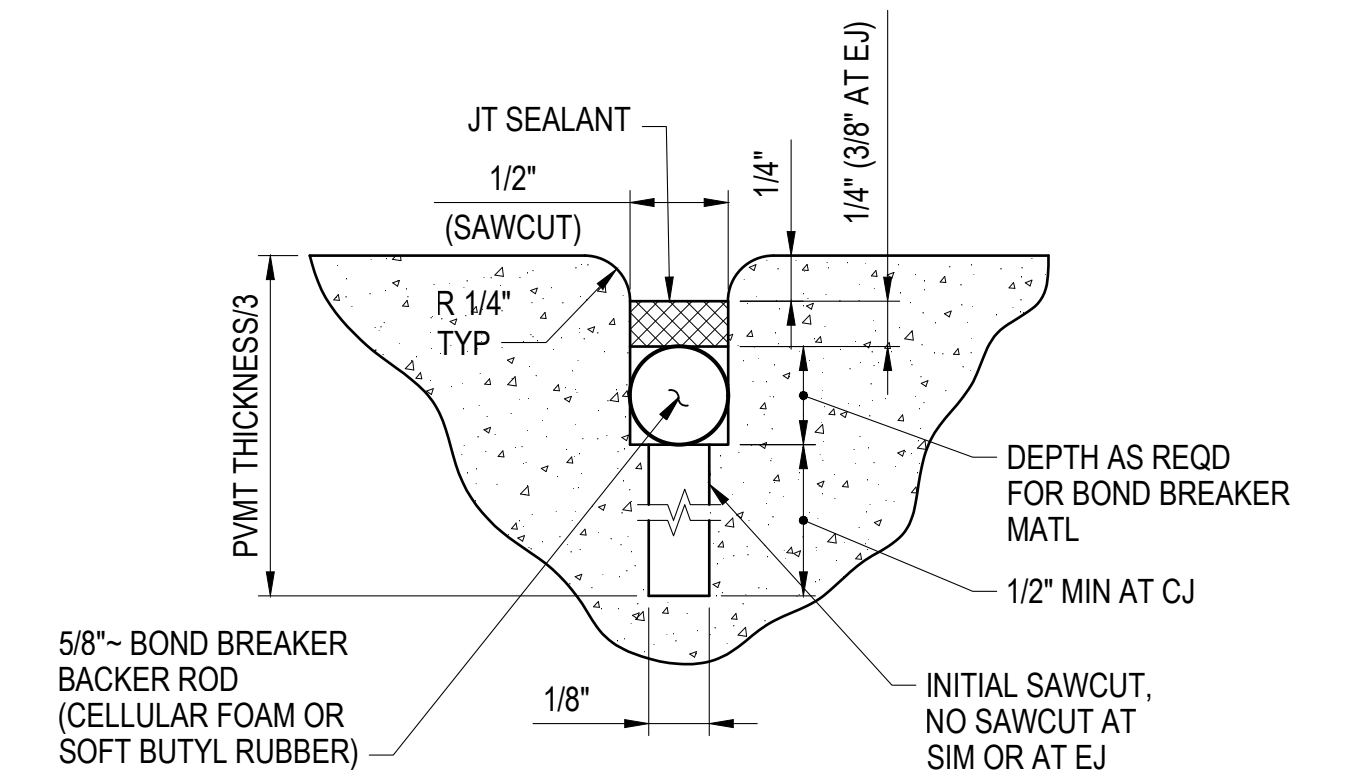

JOINT SEALANT
NTS

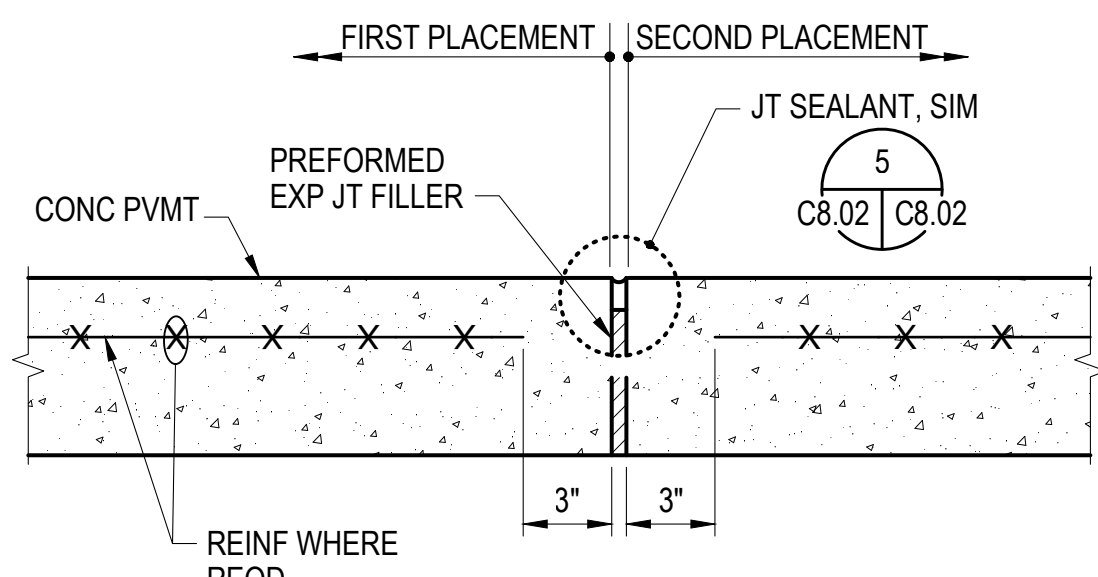


EXPANSION JOINT (EJ)
NTS

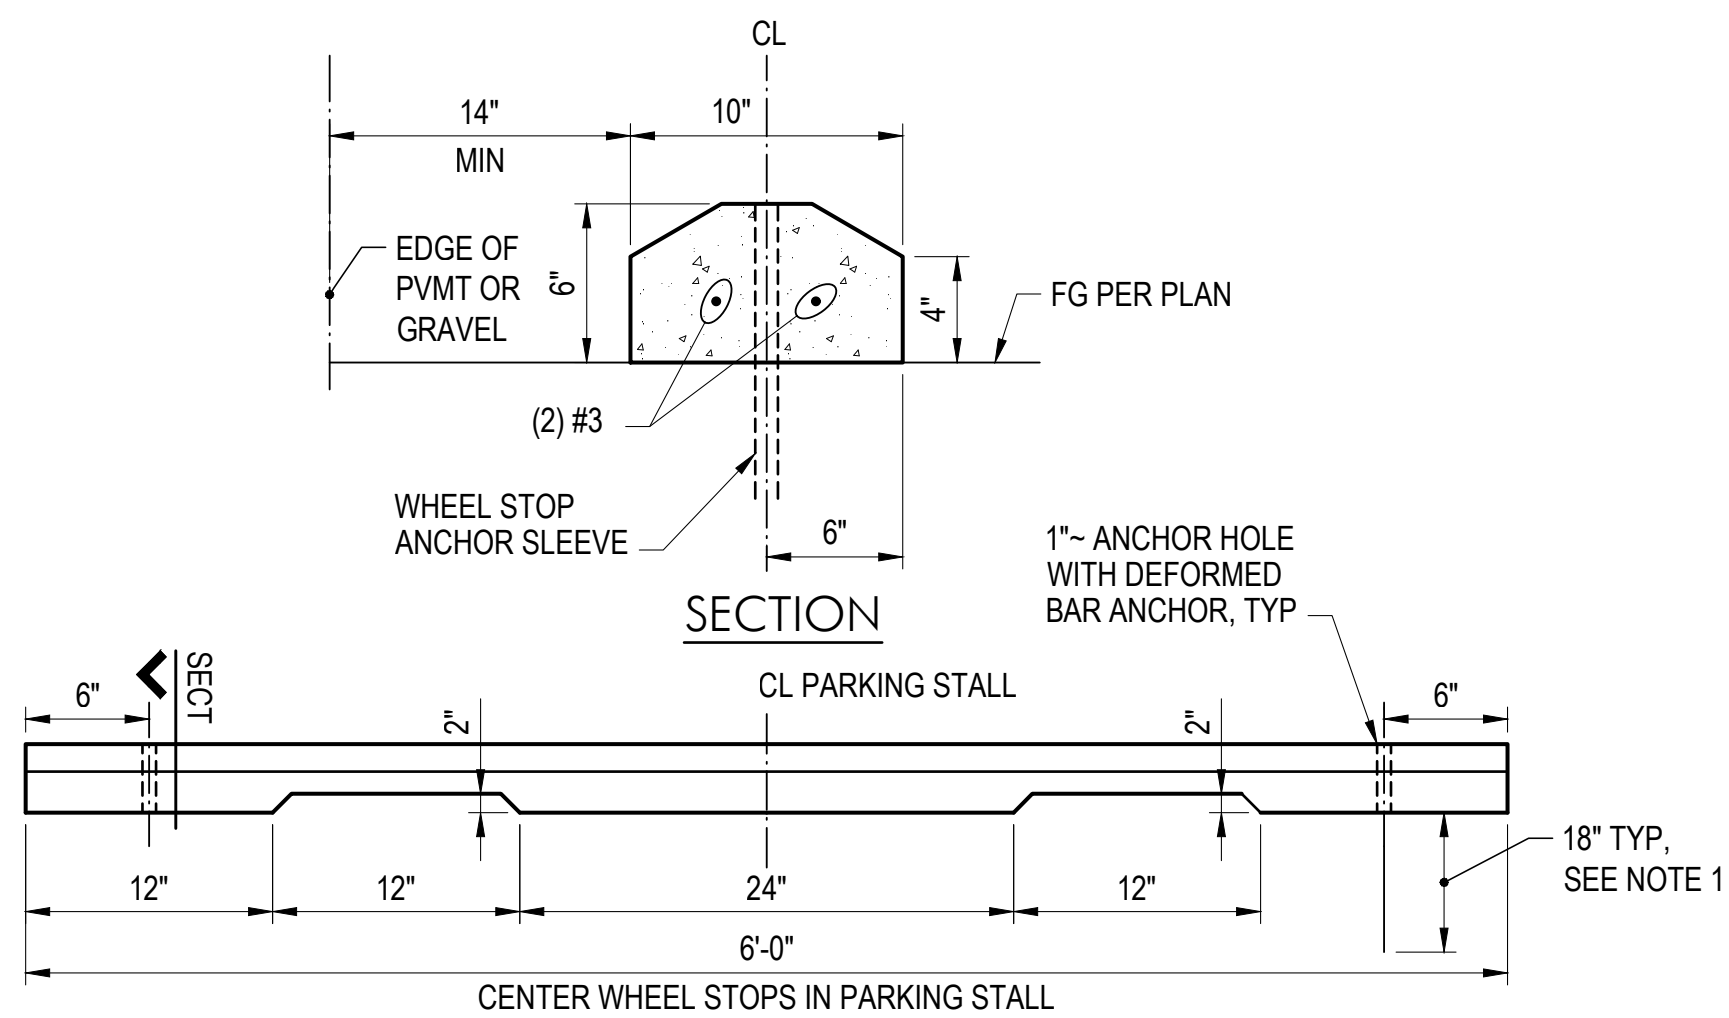

NOTES:

1. AT CONTRACTOR'S OPTION WITH APPROVAL OF ENGINEER, USE EPOXY BONDING AGENT IN PLACE OF DEFORMED BARS.


WHEEL STOP
NTS

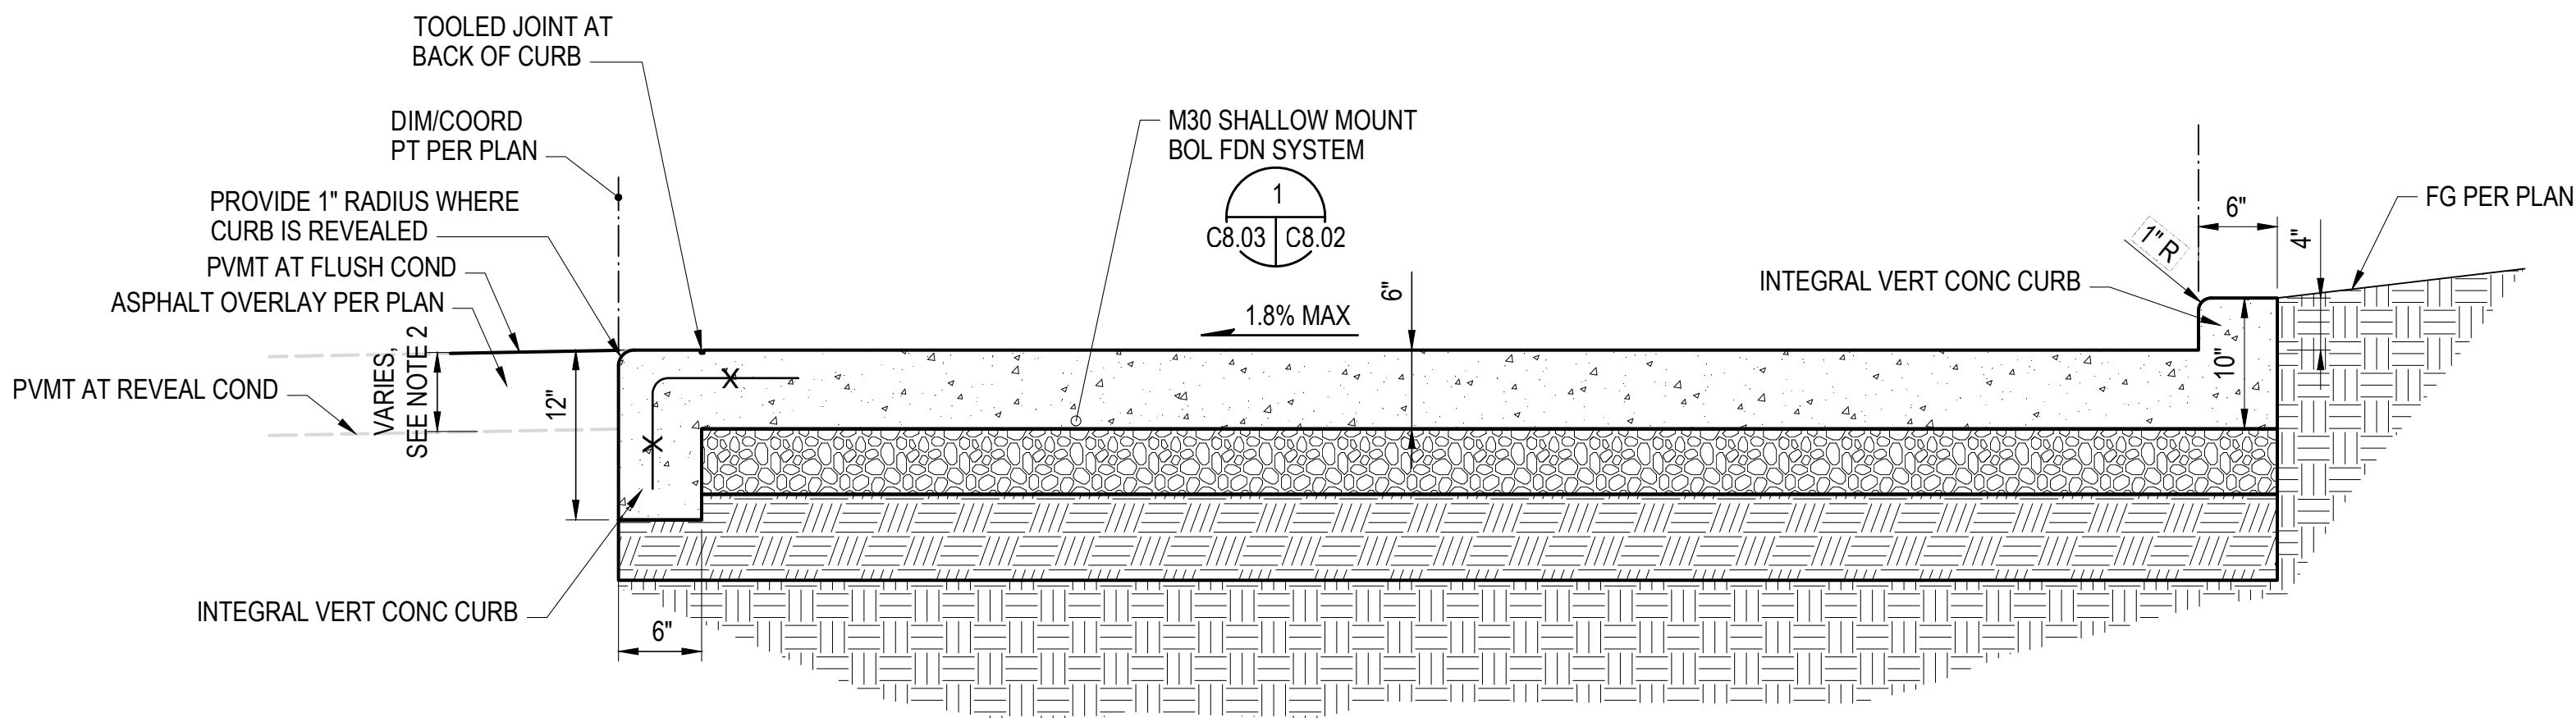

NOTES:

1. PROVIDE TRANSVERSE JOINTS AS FOLLOWS:
 - + WEAKENED PLANE JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT, 7'-6" OC MIN, 12'-6" OC MAX, 10'-0" OC TYP
 - + EXPANSION JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT EXPANSION JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT/WALK, 50'-0" OC MAX
 - AT POINTS OF CURVATURE AND POINTS OF TANGENCY
2. CURB HEIGHT VARIES PER PLAN.


SIDEWALK/CURB PAVEMENT PATCH
NTS

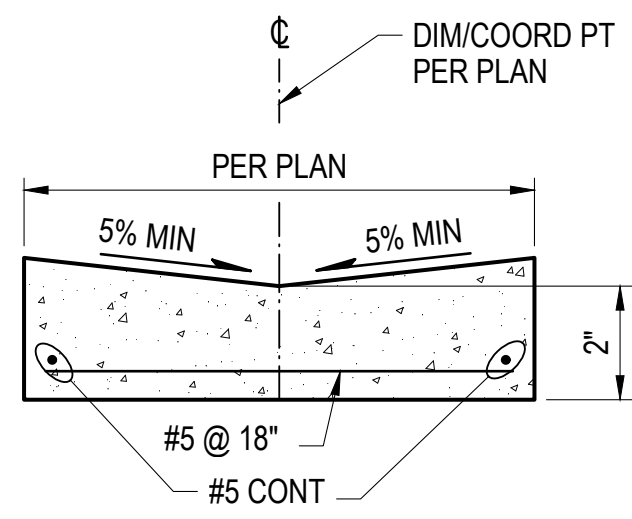

NOTES:

1. PROVIDE TRANSVERSE JOINTS AS FOLLOWS:
 - + WEAKENED PLANE JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT, 7'-6" OC MIN, 12'-6" OC MAX, 10'-0" OC TYP
 - + EXPANSION JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT EXPANSION JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT/WALK, 50'-0" OC MAX
 - AT POINTS OF CURVATURE AND POINT OF TANGENCY
2. GUTTERS SHALL HAVE LIGHT BROOM FINISH.


CONCRETE VALLEY GUTTER
NTS

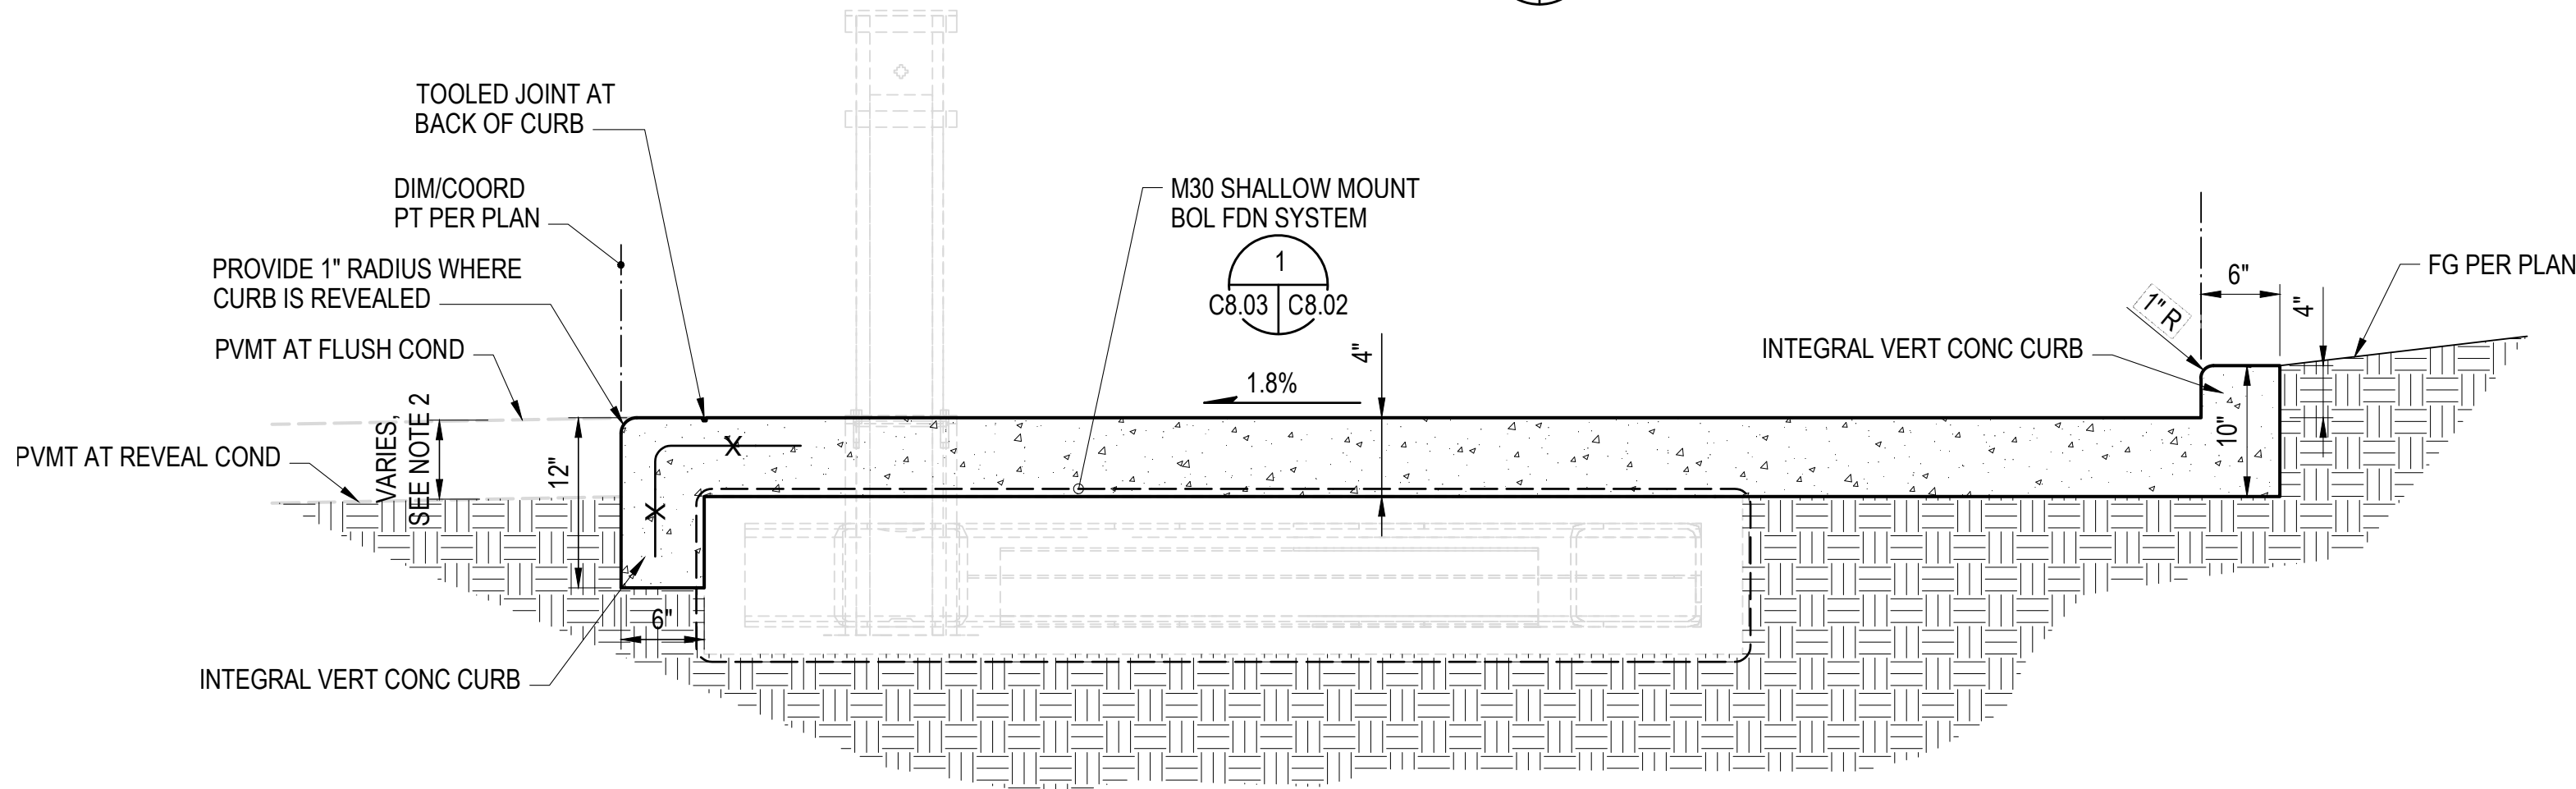

NOTES:

1. PROVIDE TRANSVERSE JOINTS AS FOLLOWS:
 - + WEAKENED PLANE JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT, 7'-6" OC MIN, 12'-6" OC MAX, 10'-0" OC TYP
 - + EXPANSION JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT EXPANSION JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT/WALK, 50'-0" OC MAX
 - AT POINTS OF CURVATURE AND POINTS OF TANGENCY
2. CURB HEIGHT VARIES PER PLAN.

SIDEWALK PAVEMENT REPLACEMENT AT BOLLARDS
NTS

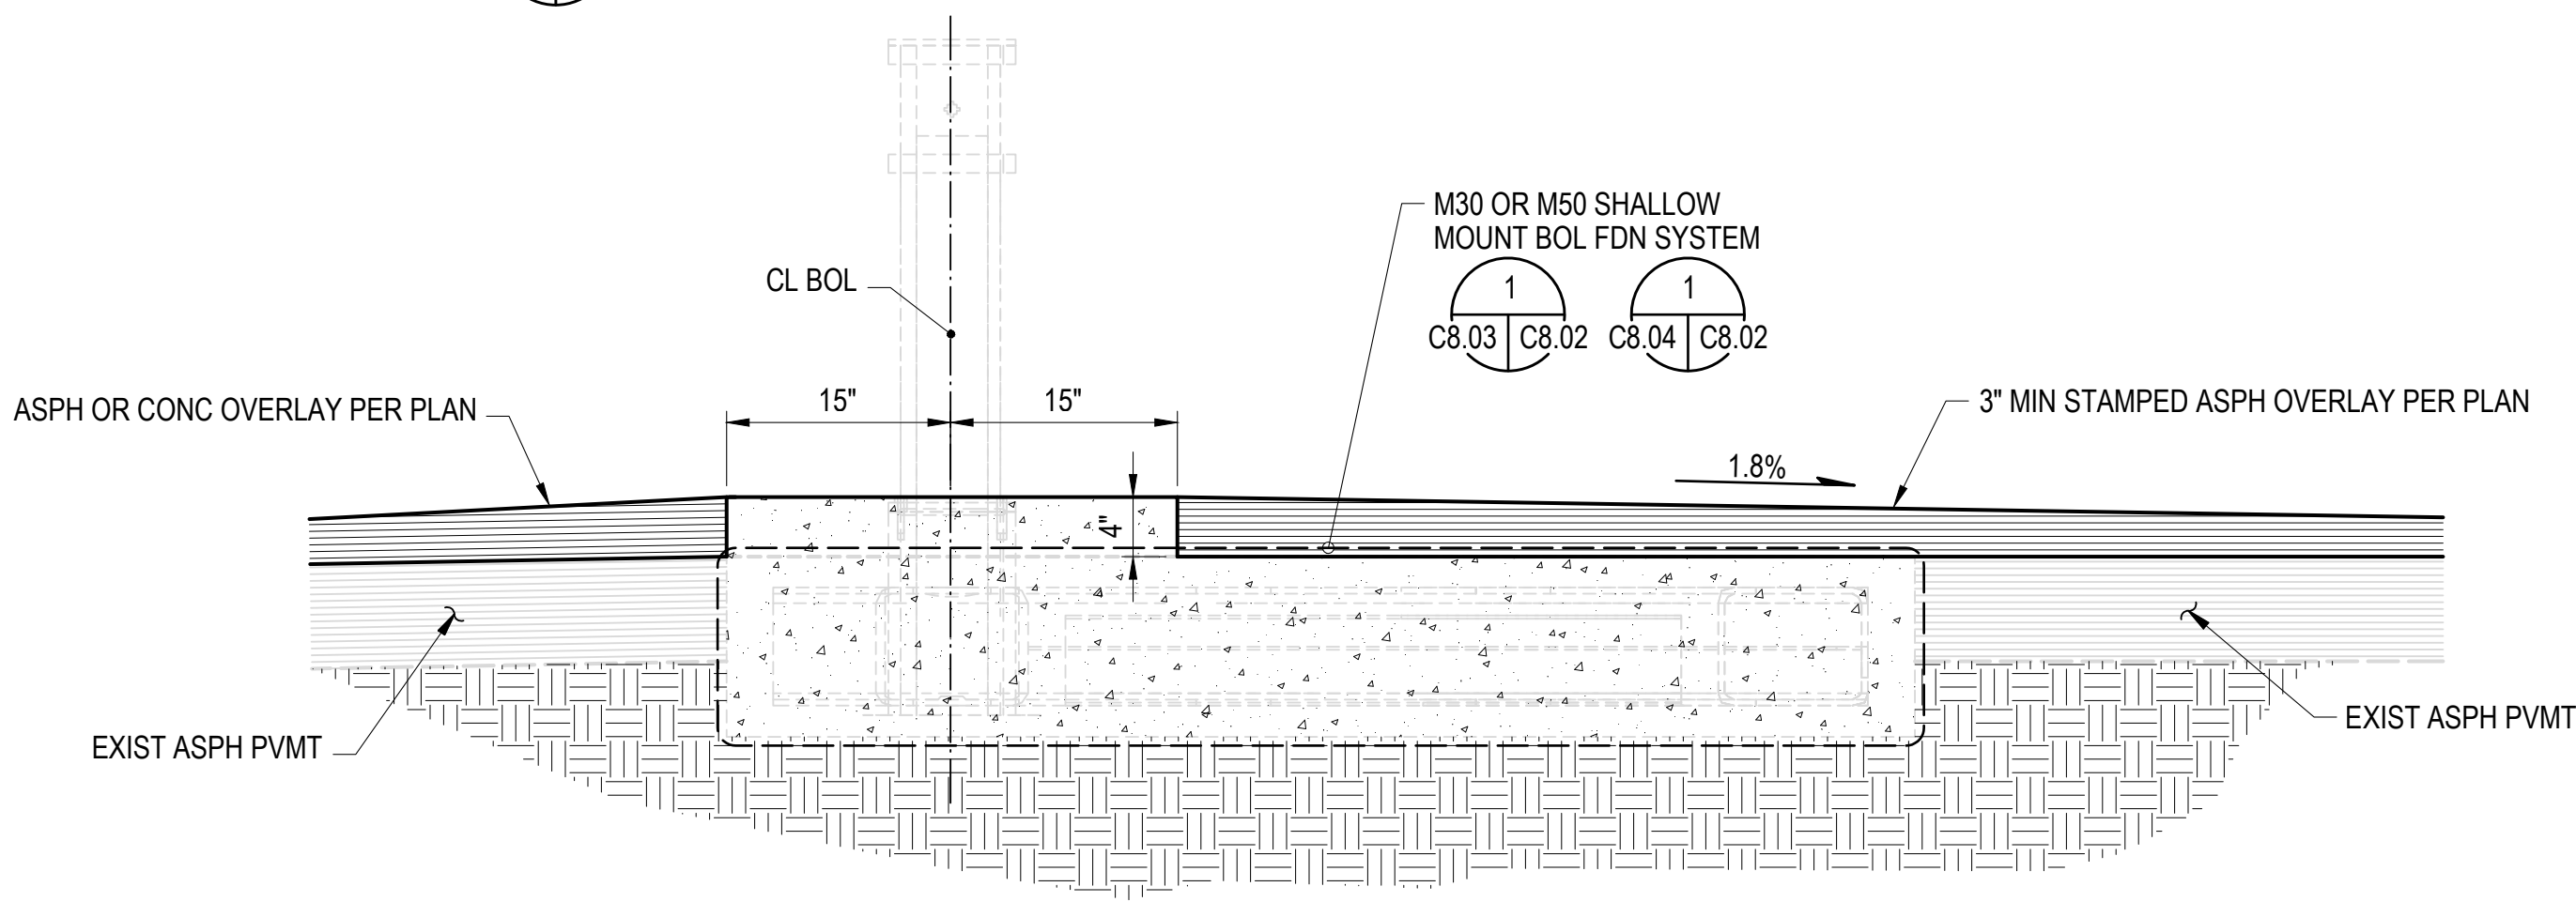


NOTES:

1. PROVIDE TRANSVERSE JOINTS AS FOLLOWS:
 - + WEAKENED PLANE JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT, 7'-6" OC MIN, 12'-6" OC MAX, 10'-0" OC TYP
 - + EXPANSION JOINTS:
 - ALIGNED WITH PEDESTRIAN PAVEMENT EXPANSION JOINTS
 - WHERE NOT ABUTTING PEDESTRIAN PAVEMENT/WALK, 50'-0" OC MAX
 - AT POINTS OF CURVATURE AND POINTS OF TANGENCY

PAVEMENT REPLACEMENT AND OVERLAY AT BOLLARDS
NTS

6/25/2025 1:18 PM USER: cdp PATH: J:\LumenField\North\Lo\VELS\IC3.C3.0X.dwg LAYOUT: C8.03

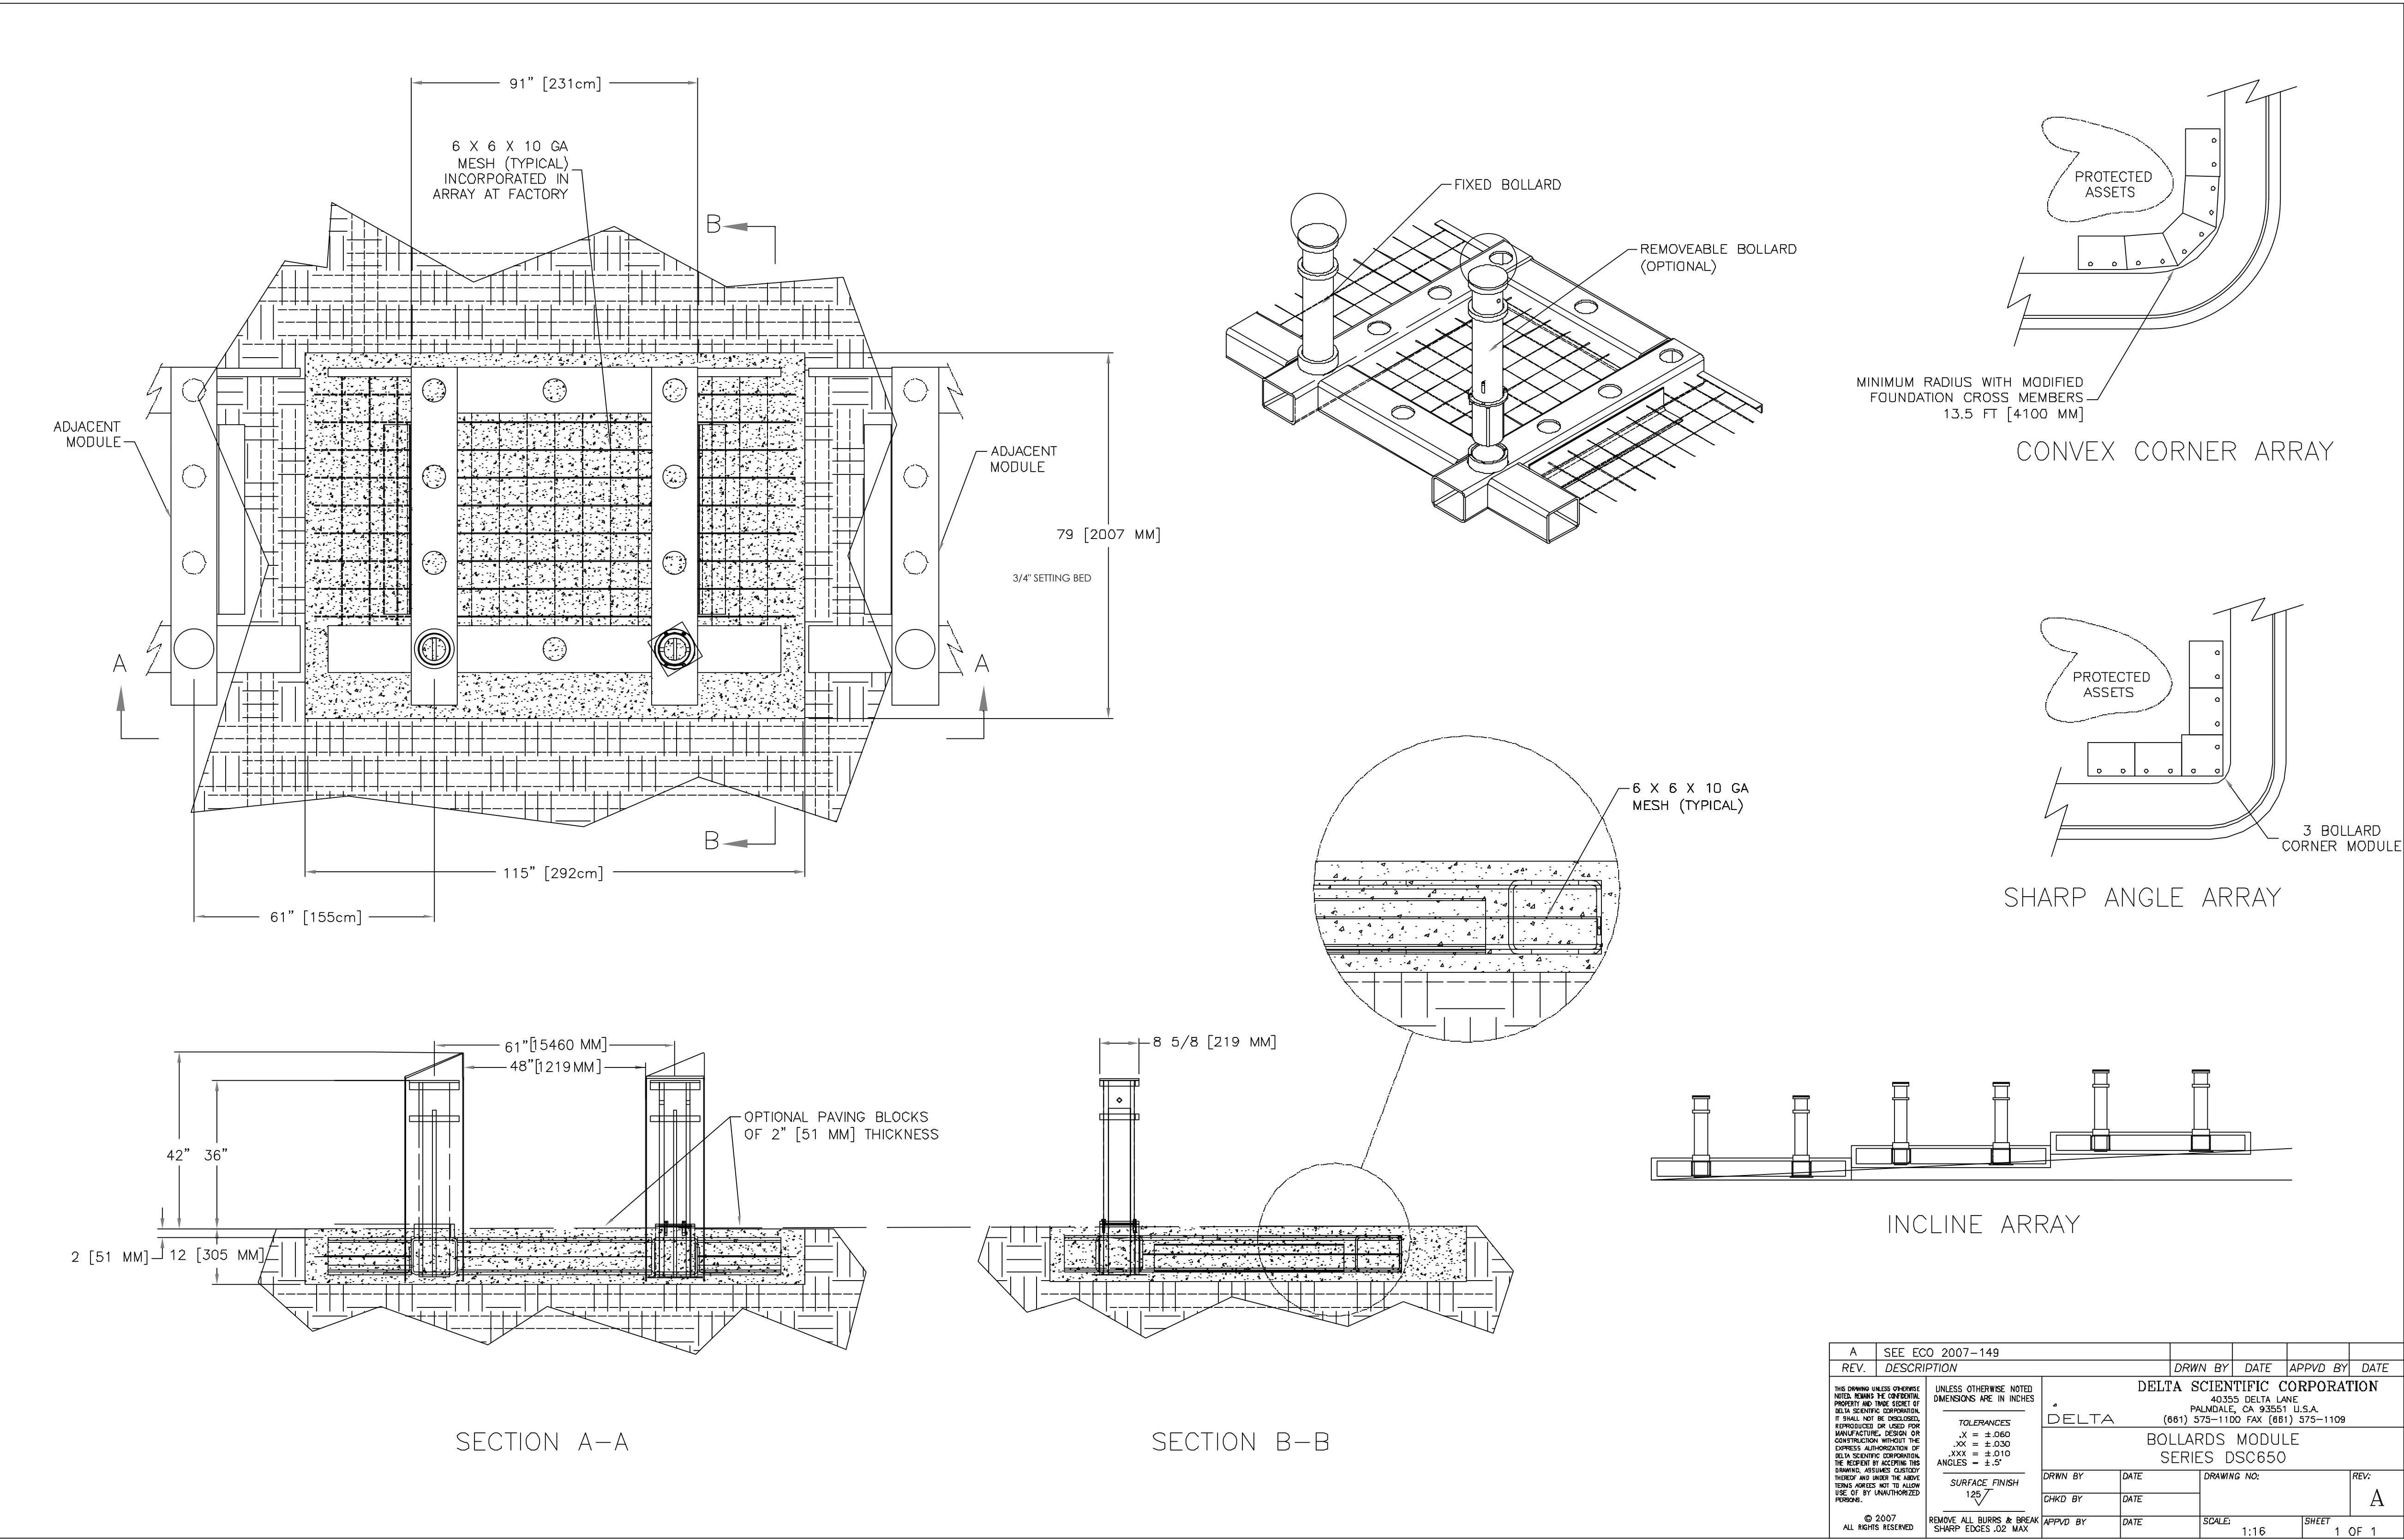

M30 P1 SHALLOW MOUNT FIXED BOLLARD
NTS

1
C3.01, C3.02, C8.02 | C8.03

LUMEN
FIELD


CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8200

STRUCTURAL ENGINEER
Lund Opsehl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98141
tel: 206-402-9156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

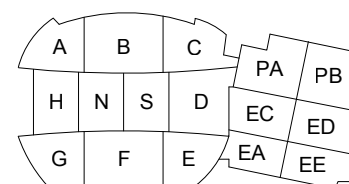

NORTH
KEY PLAN

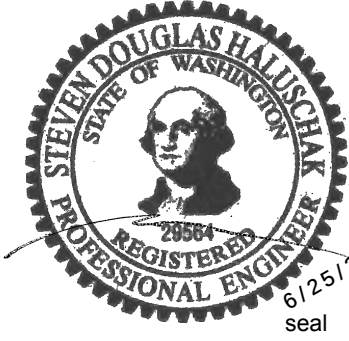


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET

RE: SECTIONS AND DETAILS
Crawford project no.: KC00523

C8.03
sheet no.

6/25/2025 1:18 PM USER: cdp PATH: J:\LumenField\North\LoC\NELS\BIC3.CX.dwg LAYOUT: C8.04

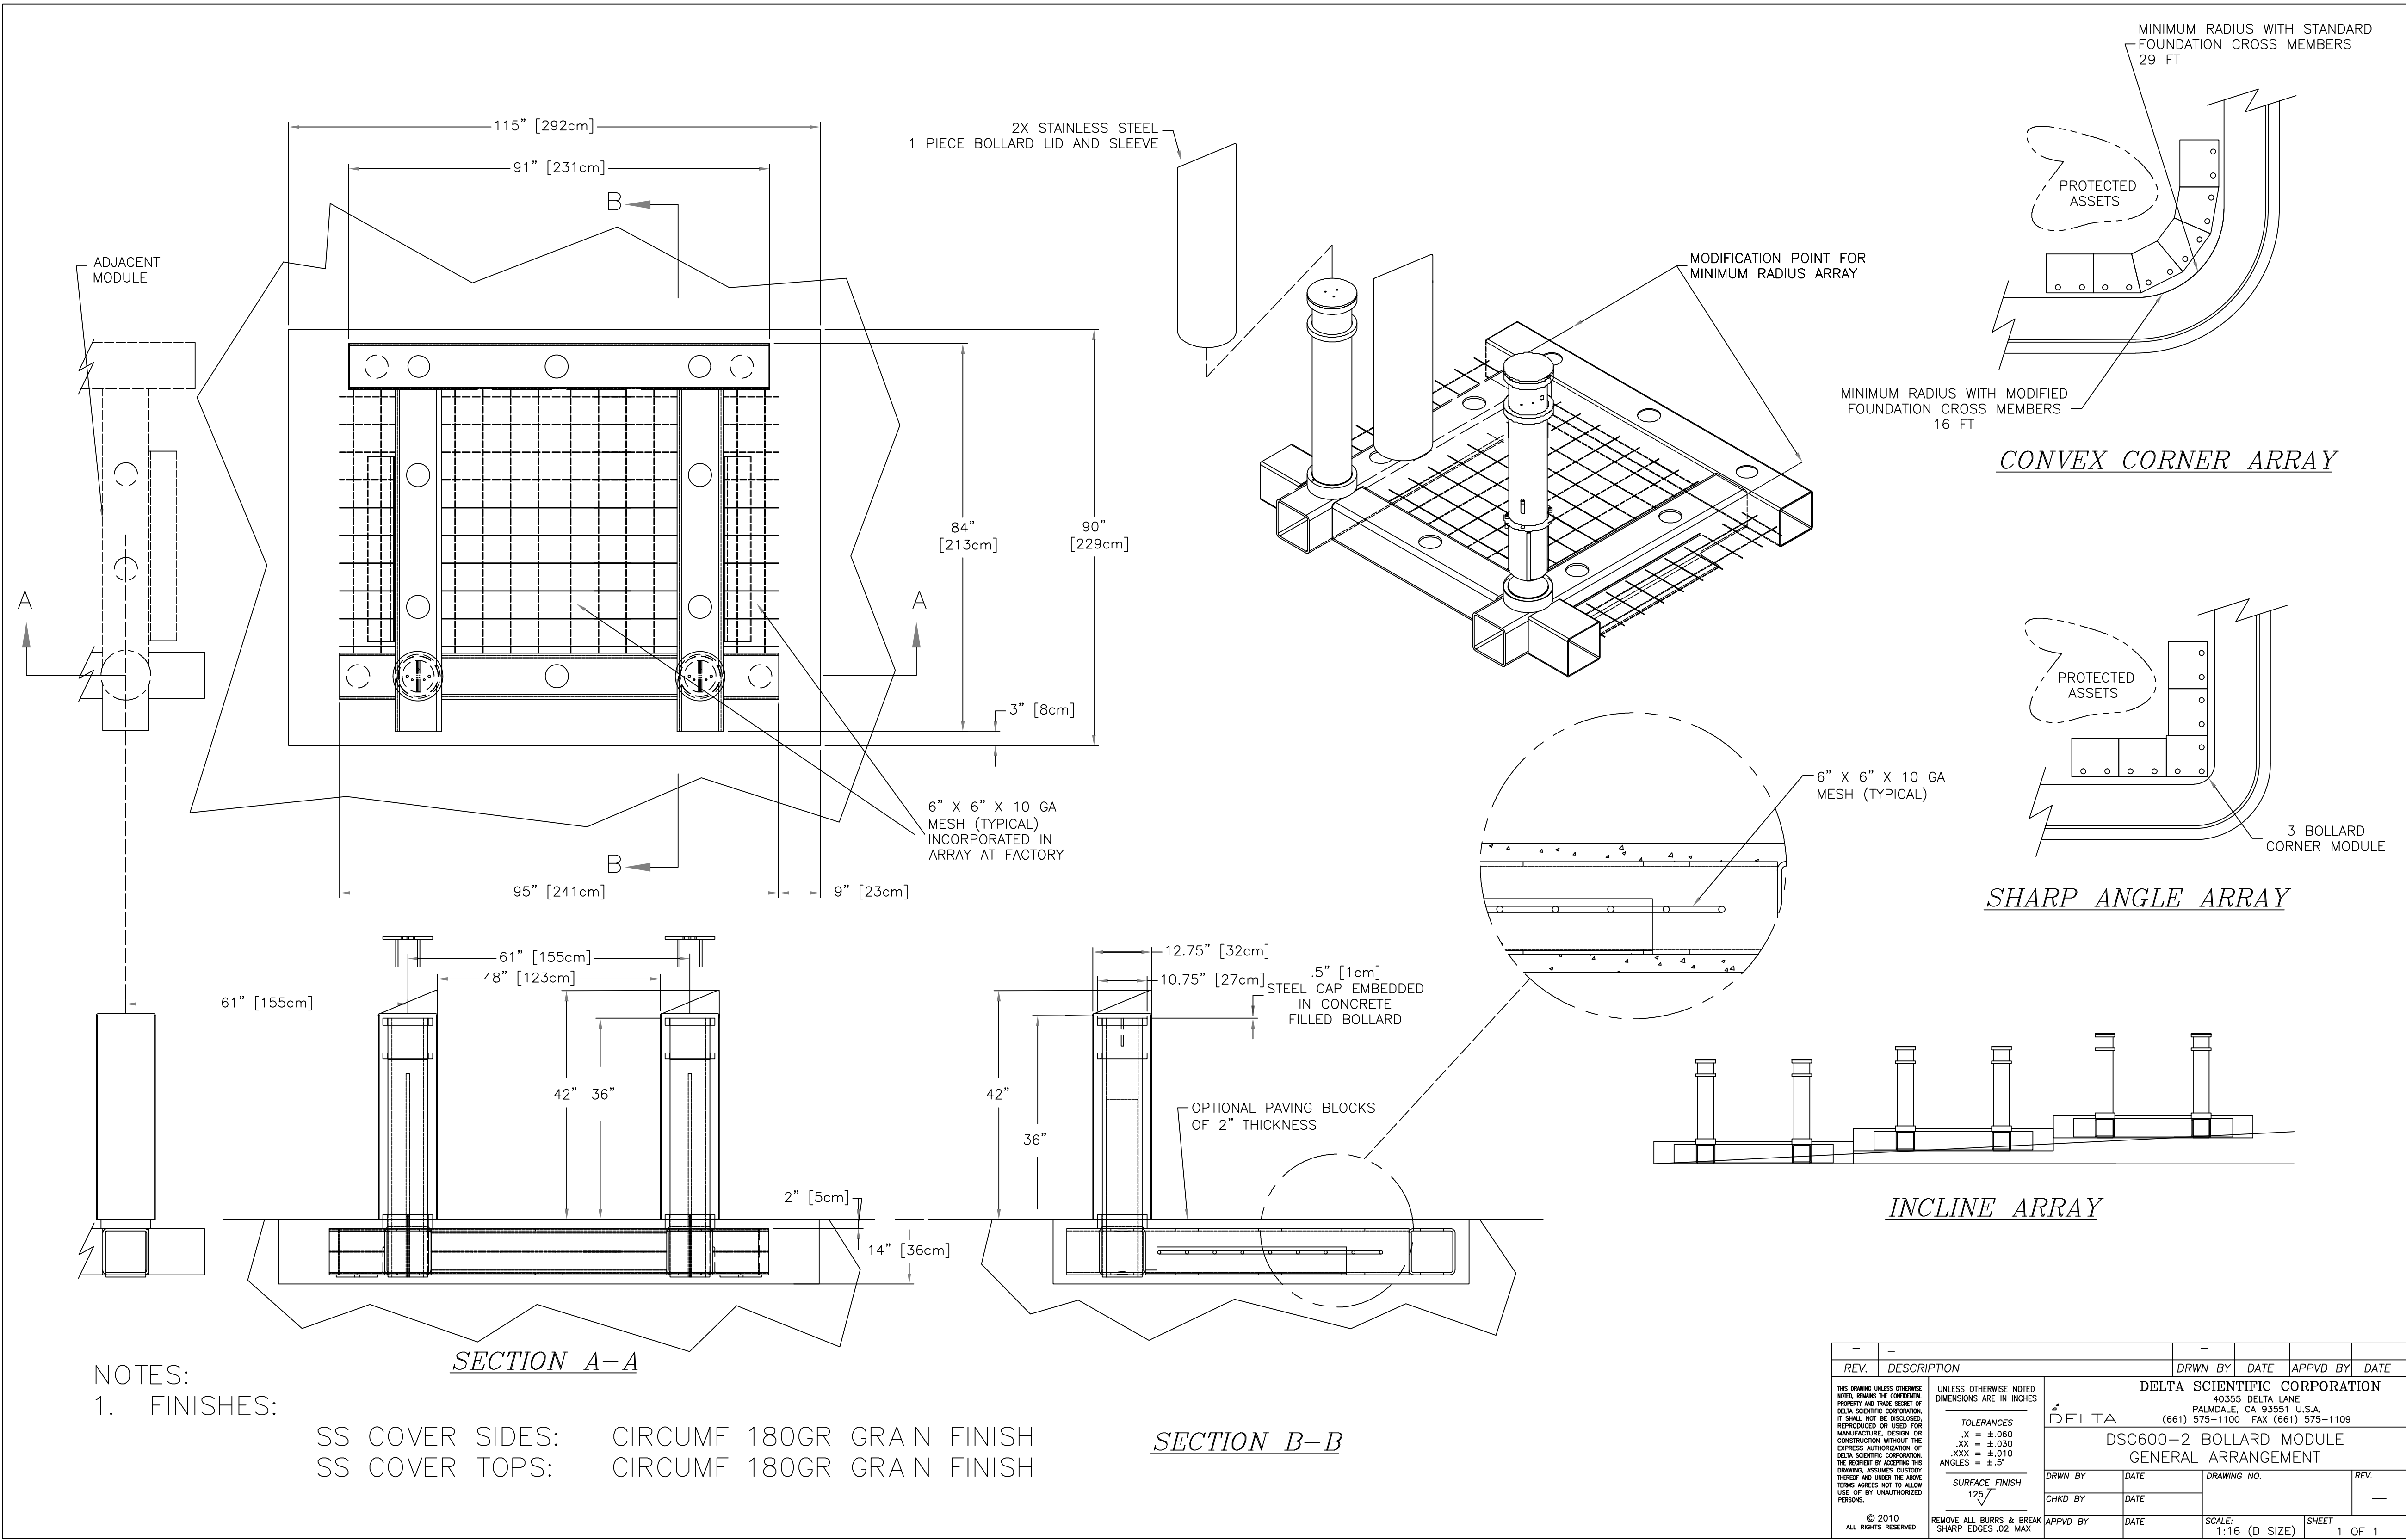

M50 P1 SHALLOW MOUNT REMOVABLE BOLLARD SYSTEM DETAIL
NTS

1
C3.01, C3.02, C6.02 | C8.04



CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555




ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kansas City, MO 64108
tel: 816-421-2640


CIVIL ENGINEER
Magnusson Klemencic Assoc.
1301 Fifth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-215-8200

STRUCTURAL ENGINEER
Lund Opeshli
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98141
tel: 206-402-8156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

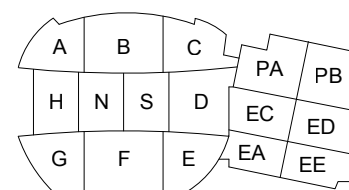

NORTH
KEY PLAN

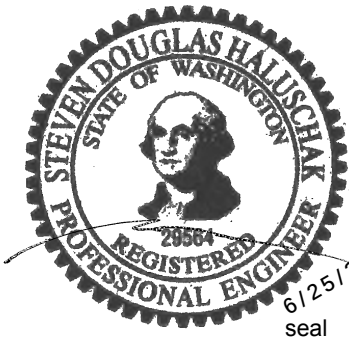


DATE:
6/25/2025

DRAWINGS ISSUED FOR:
PERMIT SET


RE: SECTIONS AND DETAILS
crawford project no.: KC00523

6/25/2025 1:18 PM USER: cdp PATH: J:\LumenField\North\Lo\CH\EL\SB\CS\0X.dwg LAYOUT: C8.05

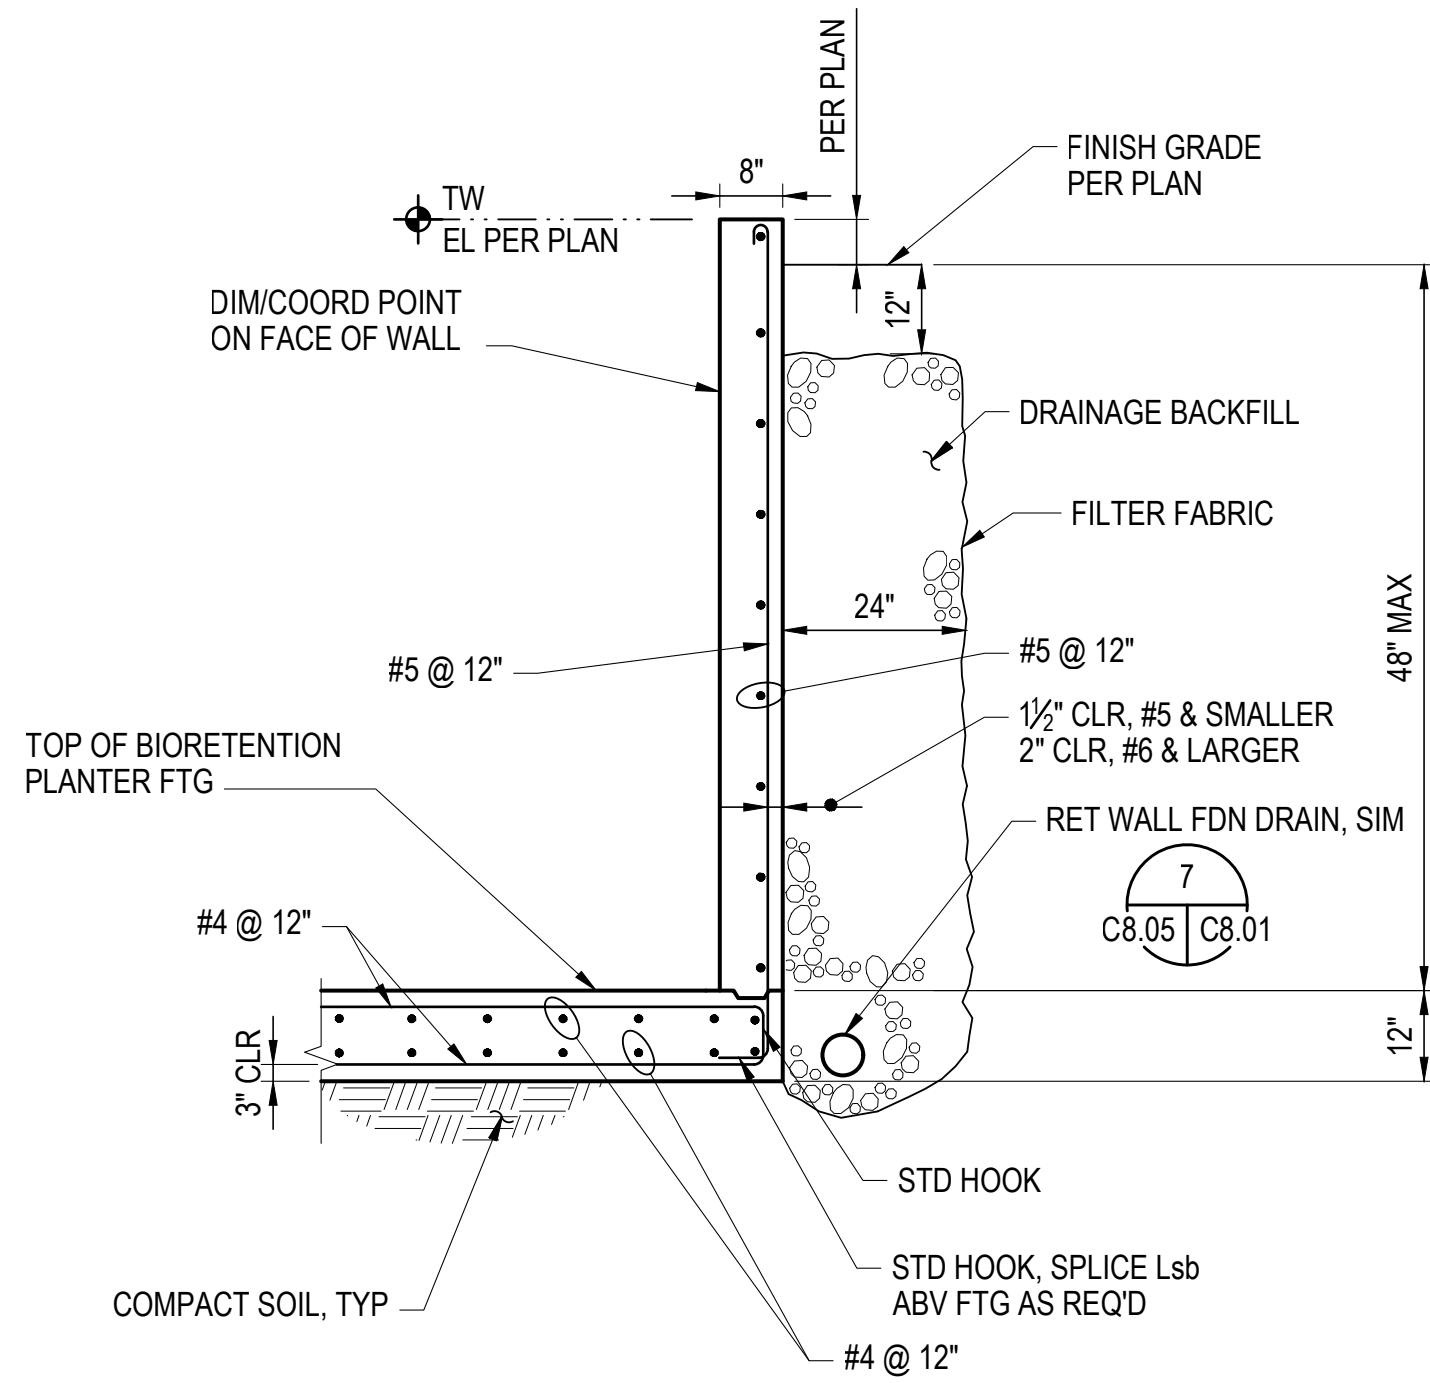


PLANTER RETAINING WALL
NTS

1
C8.01 | C8.05

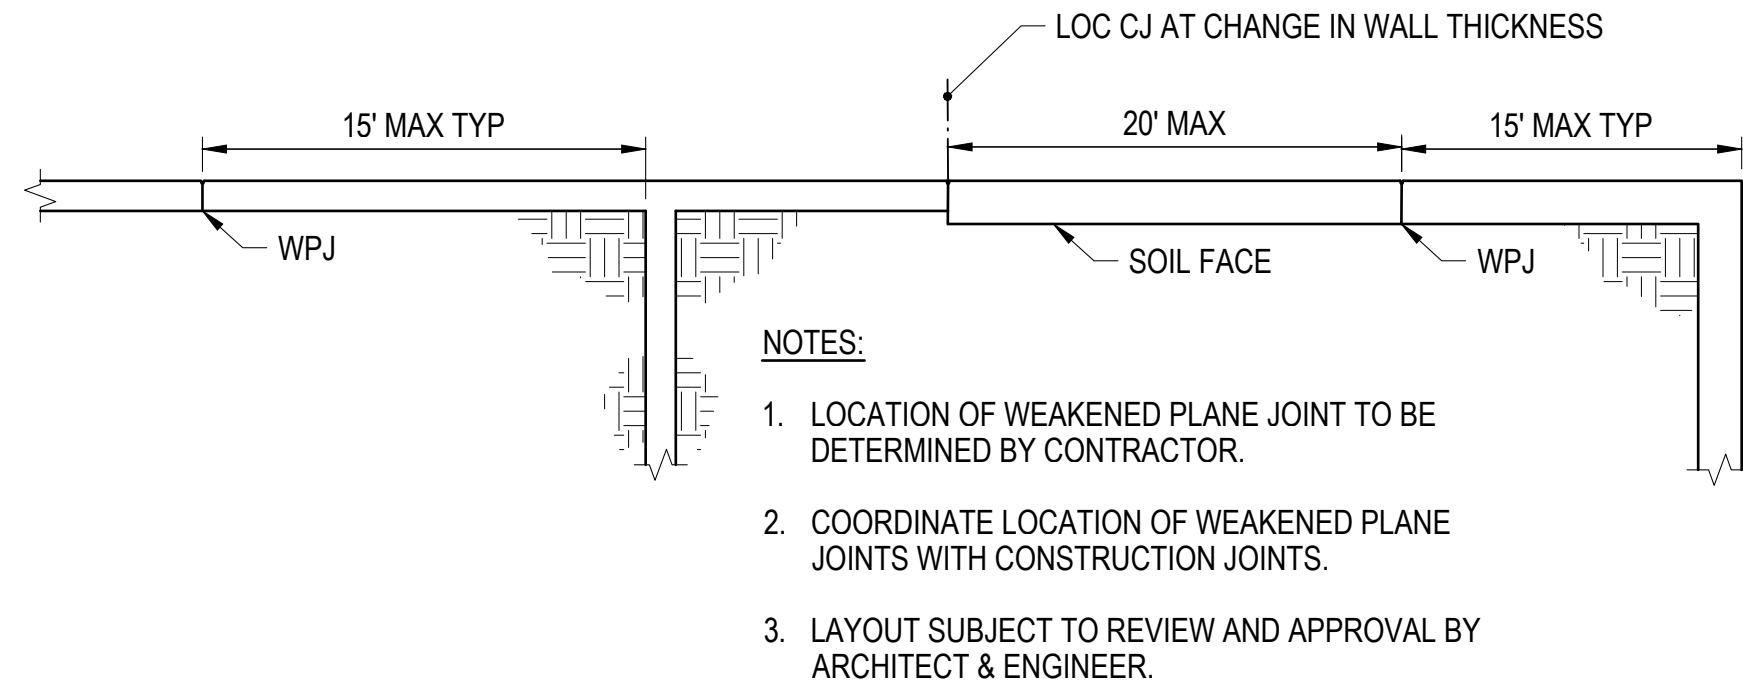


JOINT LAYOUT DETAIL
NTS

2
C8.05 | C8.05

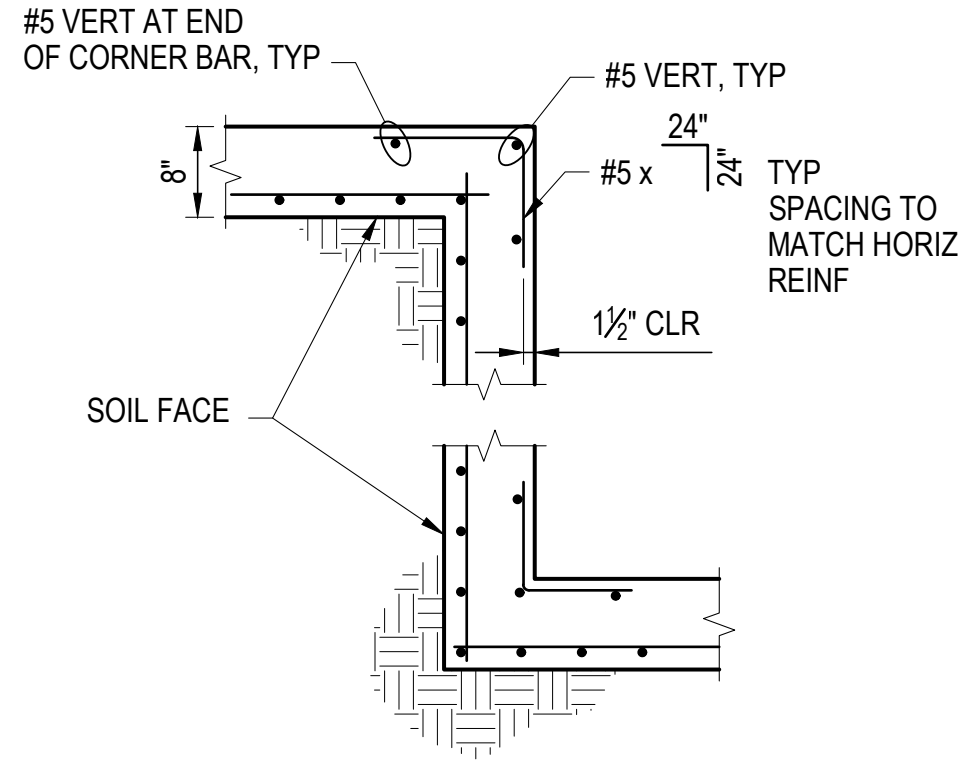


WALL CORNER REINFORCEMENT
NTS

4
C8.05 | C8.05

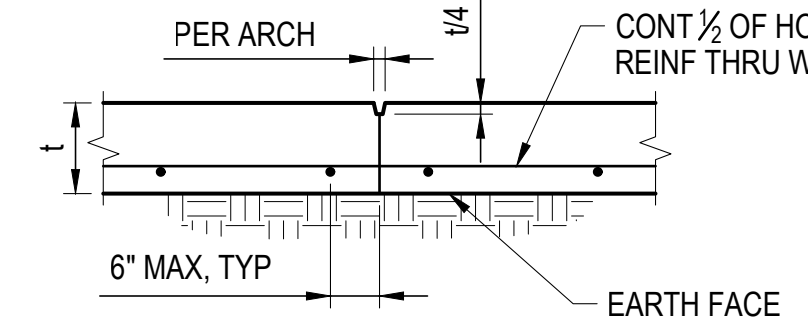


WEAKENED PLANE JOINT (WPJ) REINFORCEMENT
NTS

3
C8.05 | C8.05

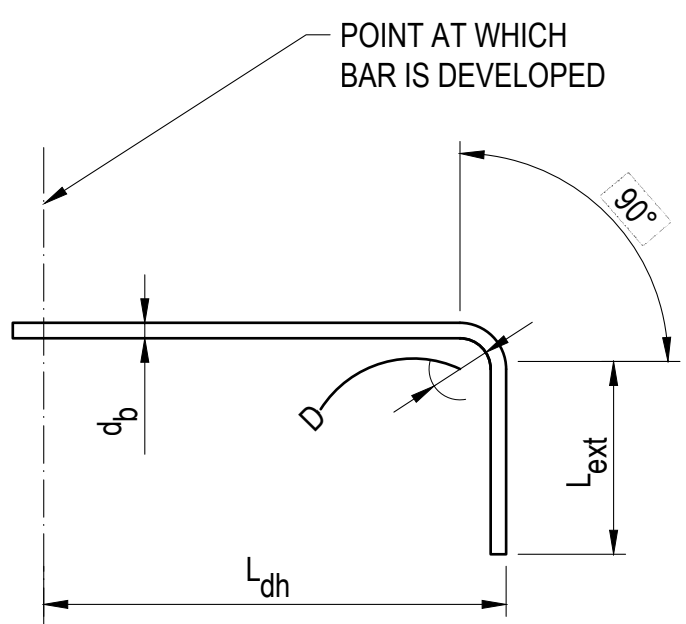

90 DEGREE HOOK

STANDARD HOOK			
ALL GRADES (D) FINISHED BEND DIAMETER			
BAR SIZE	D	90° HOOKS	180° HOOKS
		Lext	Lext
#3	2.25	4.5	2.5
#4	3	6	2.5
#5	3.75	7.5	2.5

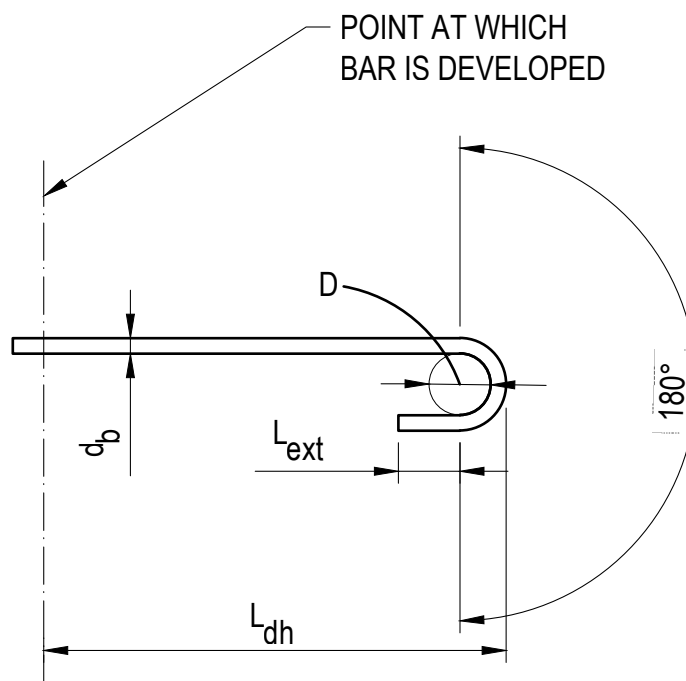

180 DEGREE HOOK

f'c = 4,000 PSI / GRADE 60						
BAR SIZE	Ld	Lt	Lsb	Lsbt	Ldt	Ldh
#3	15	19	19	25	6	6
#4	19	25	25	33	7	6
#5	24	31	31	41	9	8


NOTES:

- NOTATIONS:
db: NOMINAL BAR DIAMETER (INCHES)
Ld: TENSION DEVELOPMENT LENGTH (INCHES) FOR REINFORCEMENT SATISFYING THE FOLLOWING REQUIREMENTS:
SLABS AND WALLS: CLEAR SPACING > 2db, AND CONCRETE CLEAR COVER > db
BEAMS AND COLUMNS: CLEAR SPACING > db, AND CONCRETE CLEAR COVER > db
Lt: DEVELOPMENT LENGTH OF BARS IN THICK CONCRETE = 1.3 X Ld (INCHES)
Lb: DEVELOPMENT LENGTH OF BARS OR DOWELS IN COMPRESSION = 19 X db (INCHES)
Lc: TIED COLUMN LAP SPLICE IN COMPRESSION = 30 X db (INCHES)
Lcs: SPIRAL COLUMN LAP SPLICE IN COMPRESSION = 22.5 X db (INCHES)
Lsb: TYPICAL LAP SPLICE LENGTH = 1.3 X Ld (INCHES)
Lsbt: LAP SPLICE LENGTH OF HORIZONTAL BARS IN THICK CONCRETE = 1.69 X Ld (INCHES)
Ldh: DEVELOPMENT LENGTH IN TENSION OF STANDARD HOOK, WITH SIDE COVER ≥ 2 1/2" AND END COVER ≥ 2" (INCHES)
Ldt: DEVELOPMENT LENGTH IN TENSION OF HEADED BAR (INCHES)
D: FINISHED BEND DIAMETER (INCHES)
Lext: STRAIGHT EXTENSION AT THE END OF A HOOK (INCHES)
- MULTIPLY VALUES IN THE TABLE BY 1.5 IF CLEAR SPACING OR CONCRETE COVER DO NOT MEET THE REQUIREMENTS FOR Ld IN NOTE 1.
- "HORIZONTAL BARS IN THICK CONCRETE" REFERS TO BARS WITH MORE THAN 12" OF FRESH CONCRETE CAST BELOW. THIS INCLUDES BEAMS, SLABS, FOUNDATIONS, AND WALLS.
- MULTIPLY VALUES IN THE TABLE BY 1.33 FOR USE WITH LIGHTWEIGHT AGGREGATE CONCRETE. FOR EPOXY COATED REINFORCEMENT, MULTIPLY VALUES IN THE TABLES BY 1.5 WITH THE EXCEPTION OF LDH WHICH IS TO BE MULTIPLIED BY 1.2.
- WHEN BARS OF DIFFERENT SIZES ARE LAP SPliced IN TENSION, SPLICE LENGTH SHALL BE THE LARGER OF LD OF LARGER BAR AND LSB OF SMALLER BAR, OR LT AND LSBT FOR BARS IN THICK CONCRETE.
- FOR HOOKED BARS WITH CENTER-TO-CENTER SPACING LESS THAN 6DB, MULTIPLY LDH VALUES BY 1.6.

5
C8.05 | C8.05

TYPICAL REINFORCING DETAILS
NTS

6/25/2025 1:18 PM USER: cdp PATH: \\LumenField\North\CD\LEVELS\C8.11.dwg LAYOUT: C8.11

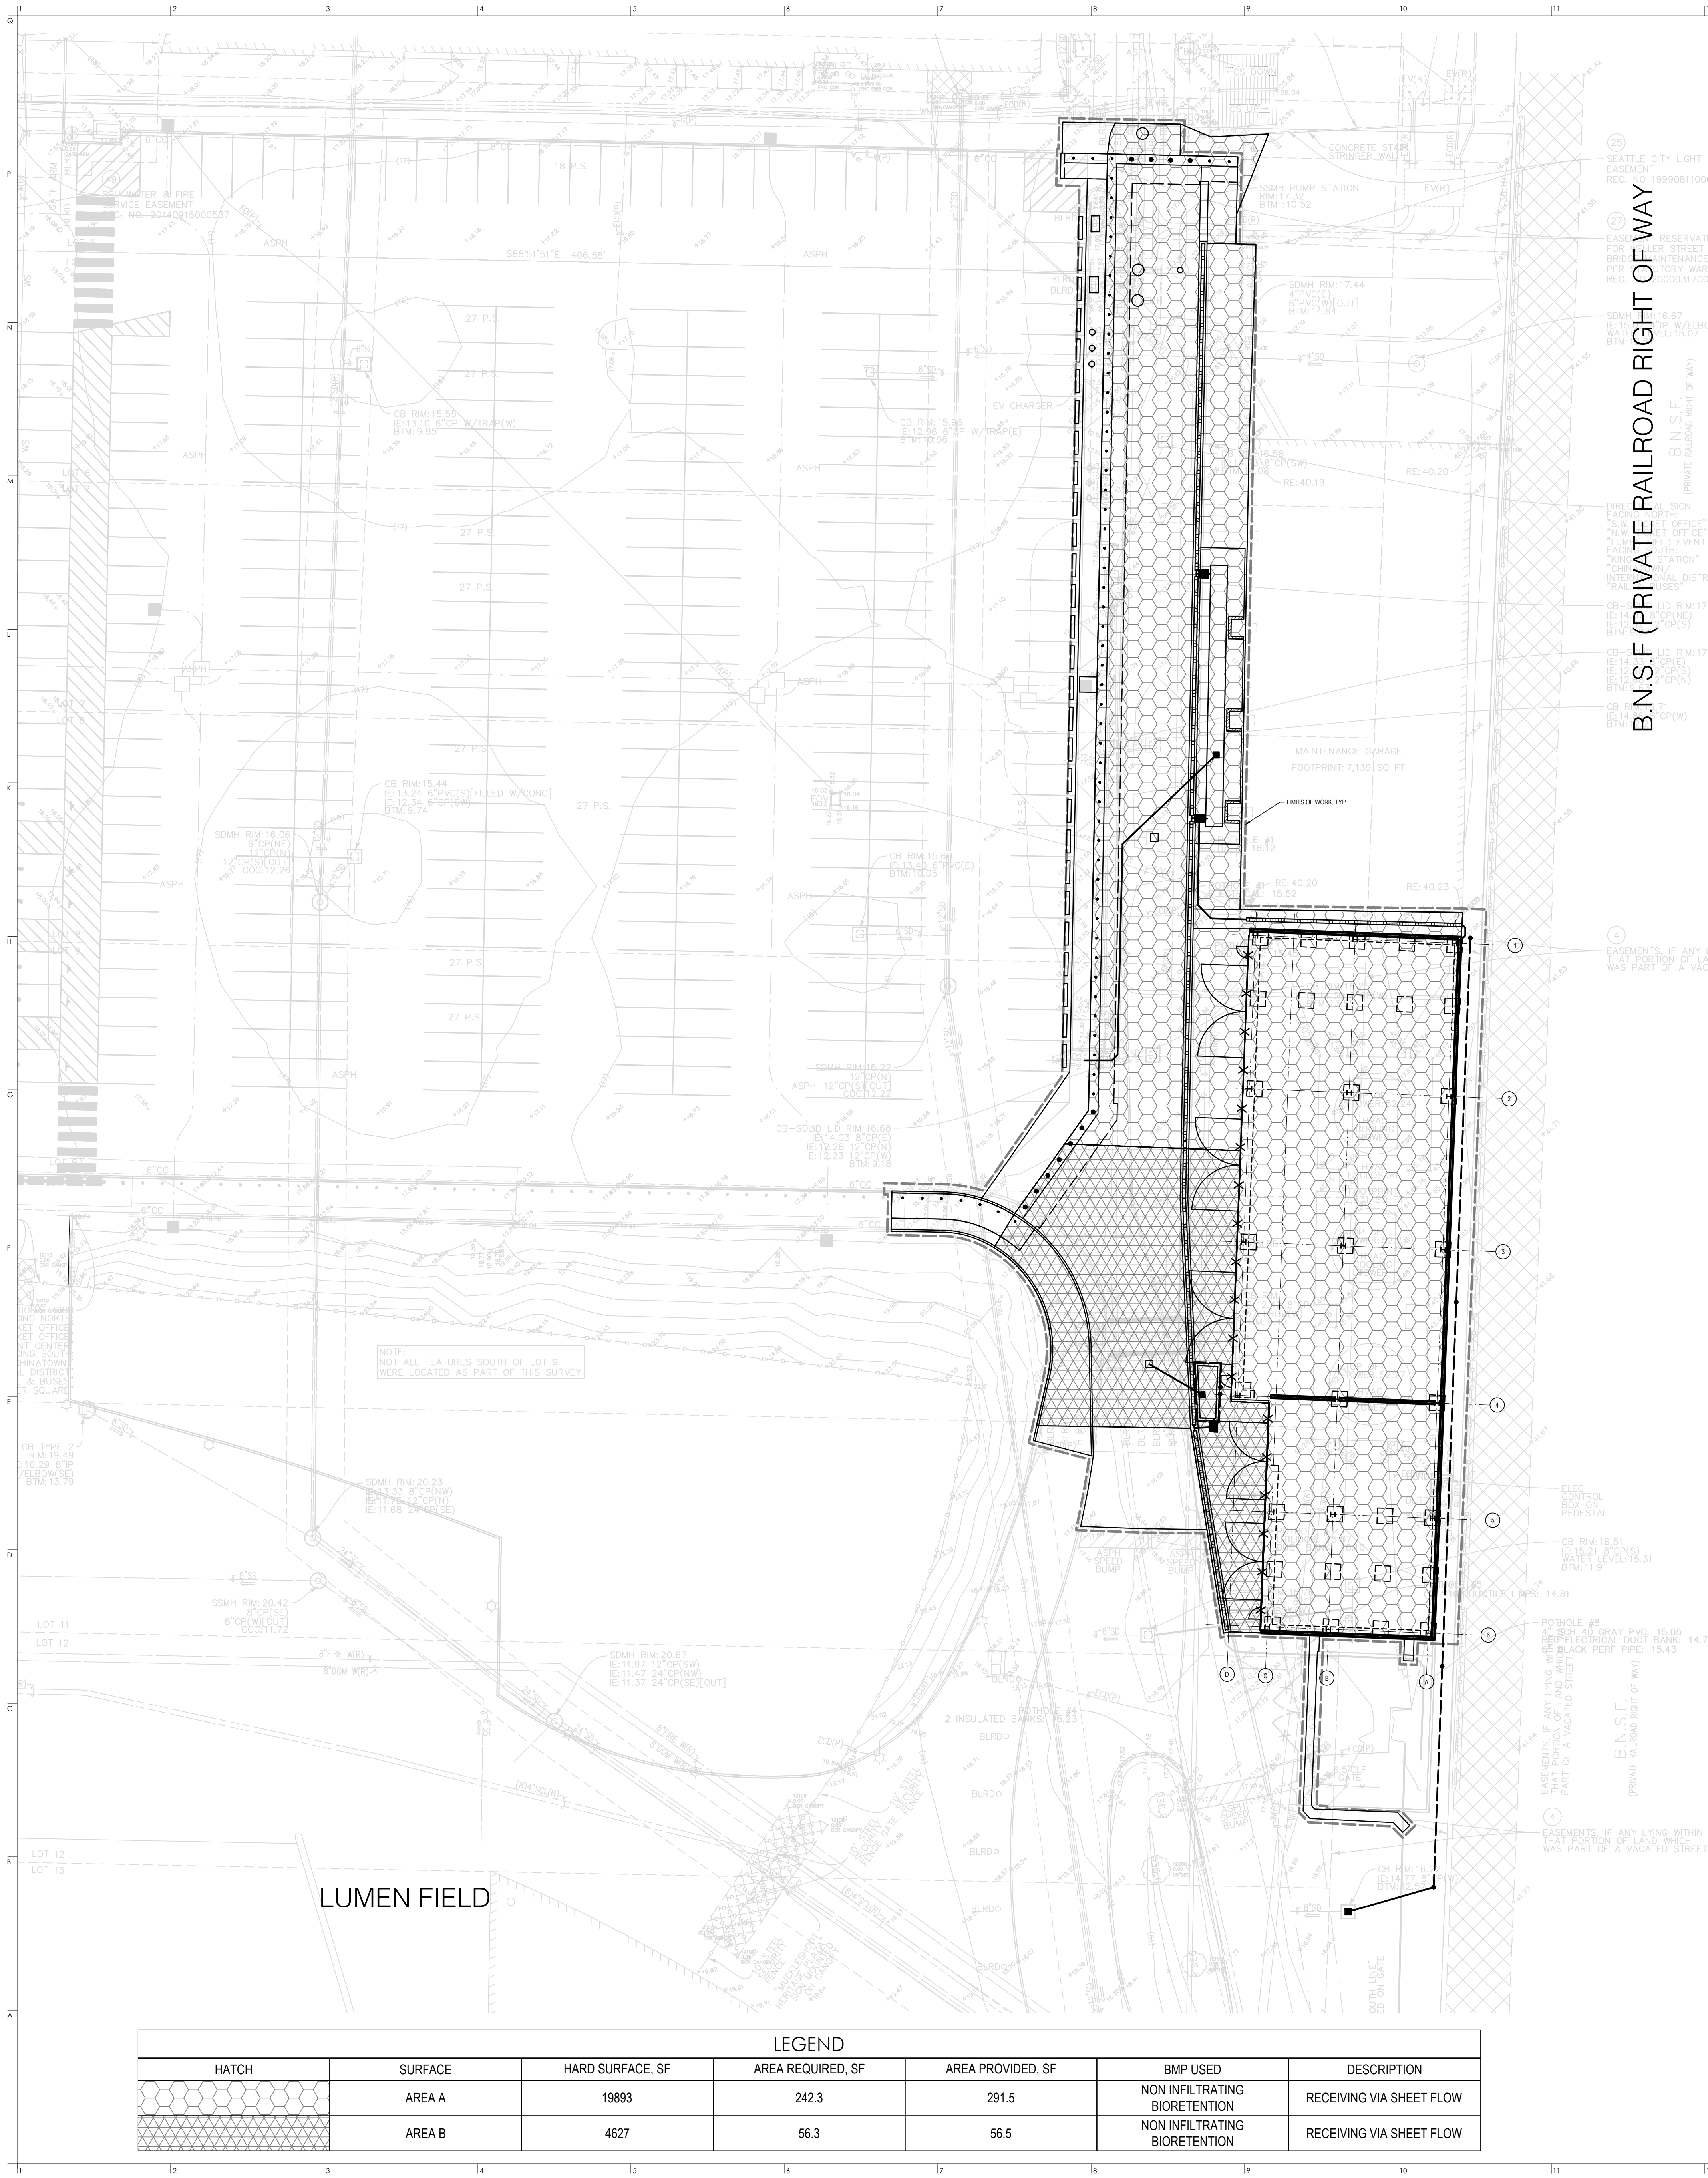

LEGEND						
HATCH	SURFACE	HARD SURFACE, SF	AREA REQUIRED, SF	AREA PROVIDED, SF	BMP USED	DESCRIPTION
	AREA A	19893	242.3	291.5	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW
	AREA B	4627	56.3	56.5	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW

B.N.S.F (PRIVATE RAILROAD RIGHT OF WAY)

DRAINAGE & WASTERWATER CONTROL PLAN REQUIREMENTS
THIS PLAN SHALL SHOW A SITE PLAN INCLUDING ALL DRAINAGE FEATURES (HARD SURFACES, BMPs, DRAIN LINES, CATCH BASINS, INLETS, PUMPS, ETC.) AND ALL SIDE SEWER FEATURES (SERVICE DRAIN SIDE SEWERS AND SANITARY SIDE SEWERS AND THEIR APPROVED POINTS OF CONNECTION).

SEE THE INSTRUCTIONS FOR THE DRAINAGE CONTROL PLAN IN VOLUME 1, CHAPTER 8 OF THE 2021 CITY OF SEATTLE STORMWATER MANUAL FOR SITE PLAN AND DRAINAGE ELEMENTS REQUIRED ON THIS PLAN.

THE DETAILS SHOWN IN THIS ARE A SELECTION OF COMMONLY USED ON-SITE STORMWATER MANAGEMENT BMPs. SEE THE CITY OF SEATTLE STORMWATER MANUAL, (DIRECTOR'S RULES SDCI 10-2021/SPU DWW-200), VOLUME 3, CHAPTER 5 FOR ADDITIONAL ON-SITE STORMWATER MANAGEMENT BMPs AND ADDITIONAL REQUIREMENTS FOR ALL BMPs.

ON-SITE STORMWATER MANAGEMENT PLANTINGS

- PLANTS SHALL BE SITED ACCORDING TO SUN, SOIL, WIND AND MOISTURE REQUIREMENTS.
- AT A MINIMUM, PROVISIONS MUST BE MADE FOR SUPPLEMENTAL IRRIGATION DURING THE FIRST TWO GROWING SEASONS.

BIORETENTION CELLS, PLANTERS AND RAIN GARDENS
FOR A LIST OF APPROVED PLANTS FOR BIORETENTION/RAIN GARDEN FACILITIES, SEE APPENDIX E, SECTION E-9 OF THE 2021 CITY OF SEATTLE STORMWATER MANUAL.

- VEGETATION COVERAGE OF SELECTED PLANTS MUST ACHIEVE 90-PERCENT COVERAGE WITHIN 2 YEARS OR ADDITIONAL PLANTINGS SHALL BE PROVIDED, UNLESS DESIGNED BY A LICENSED LANDSCAPE ARCHITECT, PROVIDE A MINIMUM OF 1 PLANT PER EVERY 2 SQUARE FEET OF BIORETENTION BOTTOM AND SLOPED SIDE AREA.
- PROVIDE A MINIMUM OF THREE DIFFERENT SPECIES OF SHRUBS AND HERBACEOUS PLANTS IN EACH FACILITY.

- VEGETATED ROOF NOTES**
- APPROPRIATE PLANTS INCLUDE SUCCULENTS, GRASSES, HERBS, AND WILDFLOWERS THAT ARE ADAPTED TO HARCH CONDITIONS. PLANTS MAY BE INSTALLED AS PRE-GROWN MATS, INDIVIDUAL PLUGS, CUTTINGS, OR SPREAD AS SEEDS.
 - VEGETATION COVERAGE OF SELECTED PLANTS MUST ACHIEVE 90-PERCENT COVERAGE WITHIN 2 YEARS OR ADDITIONAL PLANTINGS SHALL BE PROVIDED.

SIDE SEWER AND DRAINAGE PERMIT NOTES

- SIDE SEWERS AND DRAINAGE FACILITIES SHALL BE CONSTRUCTED PER THE REQUIREMENTS FOR DESIGN OF SIDE SEWERS (DRAINAGE & WASTEWATER) (DIRECTOR'S RULES SDCI 4-2011/SPU 2011-004) AND PER 2021 SEATTLE STORMWATER MANUAL, (DIRECTOR'S RULE SDCI 10-2021/SPU DWW-200).
- A SEPARATE DRAINAGE AND SIDE SEWER PERMIT IS REQUIRED FOR ALL ONSITE DRAINAGE ELEMENTS AND SIDE SEWERS/SERVICE DRAINS. APPROVAL OF THIS PLAN IS REQUIRED PRIOR TO OBTAINING A DRAINAGE AND SIDE SEWER PERMIT.
- RE-USE OF EXISTING SIDE SEWERS WHEN THERE WILL BE AN INCREASE IN LIVING UNITS REQUIRES THE EVALUATION AND CERTIFICATION (PE EVAL/CERT) OF THE EXISTING SIDE SEWER BY A PROFESSIONAL ENGINEER PRIOR TO FINALIZING THE SIDE SEWER AND DRAINAGE PERMIT. IN MOST CASES, THE SIDE SEWER MUST BE LINED ALL THE WAY TO THE MAIN. SEE (DIRECTOR'S RULES SDCI 4-2011/SPU 2011-004) AND SMC 21.16.240.
- IN ORDER TO ADD UNITS TO AN EXISTING SIDE SEWER A EXISTING LETTER STATING THE INTENT TO ADD UNITS TO THE SHARED SIDE SEWER MUST BE SENT TO ALL PROPERTY OWNERS OF PARCELS SERVED BY THE SHARED SIDE SEWER AT LEAST 30 DAYS PRIOR TO APPLYING FOR THE SIDE SEWER PERMIT. SEE SMC 21.16.240.C. A RECEIPT OF CERTIFIED MAILING AND TEH CERTIFICATION/ATTESTATION OF MAILING NOTIFICATION MUST BE SUBMITTED TO SDCI PRIOR TO PERMIT ISSUANCE.
- DEVIATIONS FROM THE APPROVED DRAINAGE AND WASTEWATER CONTROL PLAN MAY REQUIRE A FORMAL POST-SUBMITTAL REVISION FOR PLAN REVIEW AND APPROVAL. POST-SUBMITTAL REVISIONS MUST BE SUBMITTED ELECTRONICALLY THROUGH THE SDCI PROJECT PORTAL.

On-site Stormwater Management Calculator

Site and Drainage Control Summary

Version 01-04-2023

To use the On-Site List Calculator you must select "Enable Content" when the Security Warning appears.

Project Information

Site Address800 Occidental Ave S, Seattle, WA 98134SDCI Project Number

Primary ContactScott LeeSDOT Project Number

Project TypeParcel-BasedPrimary Contact E-mail or Phonev-scottl@seahawksfgi.com

Is this project "Closely Related" to other SDCI construction permits/projects?☒ Yes☐ No

"Closely Related" SDCI Construction Permit Numbers7050292-CN, 7019202-CN, and 7057296-DM

Is this project associated with a Short Plat or Subdivision?☐ Yes☒ NoSDCI MAP Number

Was the project lot created or altered in size after Jan 1, 2016?☐ Yes☒ No

Total Site Area28,849 sf→ Total Closely Related and/or Short Plat/Subdivision Site Area0 sf

Total New plus Replaced Hard Surface Area (NPRHS)17,712 sf→ Total Closely Related and/or Short Plat/Subdivision NPRHS745 sf

Total New and/or Replaced Lawn/Landscaping886 sf→ Total Closely Related and/or Short Plat/Subdivision NPRHS745 sf

Undisturbed and Protected Site Area2,386 sf→ Total Existing Hard Surface Area (Prior to Project)28,849 sf

Site Information

Note: Reference the Preliminary Assessment Report (PAR) to complete this section.

Approved Point of Stormwater DischargePublic Storm Drain Main

Drainage BasinDesignated Receiving Water

Is the downstream drainage system considered Capacity Constrained by SPU?No

Approved Point of Wastewater DischargePublic Sanitary Sewer Main

Approved Point of Sub-Surface DischargePublic Storm Drain Main

Required Flow Control Standard☐ Pre-Developed Pasture☐ Pre-Developed Forest☐ Peak Control☐ Wetland Protection☐ Existing Conditions☒ None

Project will permanently discharge groundwater?☒ No

Required Water Quality Treatment Standard☐ Oil Control☐ Enhanced☐ Basic☒ None

Total Pollution Generating Hard Surface Area4,178 sf→ w/ Closely Related/Short Plat/Subdiv.745 sf

Total Pollution Generating Pervious Surface Area0 sf→ w/ Closely Related/Short Plat/Subdiv.0 sf

Environmentally Critical Areas☒ Yes☐ No

☐ Steep Slope☐ Potential Slide☐ Riparian Corridor☐ Wetland☐ Liquefaction☐ Flood Prone☐ Landfill☐ Known Landslide☐ Fish / Wildlife☐ Pest / Groundwater Management☐ Shoreline Habitat

Is there soil and/or groundwater contamination on this site?☐ No☒ YesSource Control is required☐ No☒ Yes

Infiltration Information

Is infiltration investigation required?☐ No☒ Why?Other

Is infiltration on the site feasible?Explain: Site in liquefaction zone with shallow groundwater

Site Measured Infiltration Rate× Infiltration Rate Correction Factor0.5 = 0Site Design Inf Rate

On-site Stormwater Management (select List Approach or Performance Standard)

☒ On-site List Approach (Pre-sized) Calculator -- Complete the Surface tabs and BMP Sizing tabs. (Most commonly used)

☐ On-site Performance Standard -- Stormwater modeling by Civil Engineer☐ (Also for No Off-site Point of Discharge)

Number of roof areas1Note total area entered on surface tabs (plus permeable pavement facility area) exceeds the total new plus replaced hard surface area entered above.

Number of other surface areas2

Surface	Surfaces Description	On-site BMP	Contrib. Area (sf)	Facility Size (sf)	Facility Configuration
1	Roof Area A Roof	Non-Infiltrating Bioretention #1	9,486	232 sf	Sloped sides 6 inch
2	Surface Area A Non-Roof	Non-Infiltrating Bioretention #1	9,882	+	Sloped sides 6 inch
3	Surface Area B Non-Roof	Non-Infiltrating Bioretention #2	4,627	56 sf	Vertical sides 6 inch
Total New/Replaced Roof Area		9,486	Total Roof Area Managed		9,486
Total New/Replaced Other Surface Area		14,509	Total Other Surface Managed		14,509
Total Area Managed		23,995 sf	Total Volume Managed On Site		173,394 gal
Estimated compost required for soil amendment		5,4932 cy	Volume of compost will be verified by the Inspector.		

CLIENT
First & Goal Inc.
800 Occidental Ave S
Seattle, WA 98134
tel: 206-381-7555

ARCHITECT
Crawford Architects CA, Inc.
1604 Locust Street, Suite 100
Kirkland, WA 98148
tel: 816-421-2040

CIVIL ENGINEER
Magnuson Klemm Assoc.
1301 Fifth Avenue, Suite 2000
Seattle, Washington 98101
tel: 206-215-8900

STRUCTURAL ENGINEER
Lund Opahl
1215 Fourth Avenue, Suite 1200
Seattle, Washington 98101
tel: 206-402-8156

LUMEN FIELD
EVENT LOGISTICS AND STAGING BUILDING (ELSB)
800 Occidental Ave S Seattle, WA 98134

KEY PLAN

DATE: 6/25/2025

DRAWINGS ISSUED FOR: PERMIT SET
TITLE: ONSITE STORMWATER MANAGEMENT PLAN
Crawford Project No.: KC40523

C8.11
sheet no.
© Crawford Architects

LUMEN FIELD

LUMEN FIELD North Lot Security Plan - Phase 2

800 OCCIDENTAL AVE S. SEATTLE, WASHINGTON

CODE REVIEW INFORMATION

GOVERNING CODES
2021 SEATTLE BUILDING CODE
2021 SEATTLE EXISTING BUILDING CODE
2021 SEATTLE ENERGY CODE
2021 NATIONAL ELECTRICAL CODE
2021 SEATTLE MECHANICAL CODE
2021 SEATTLE PLUMBING CODE
2021 SEATTLE FIRE CODE

PARCEL NUMBER: 766620-4876

LEGAL DESCRIPTION: LOTS 5-35, BLK 285 & LOTS 5-35, BLK 325, SEATTLE TIDE LANDS & VAC 3RD AVE S (VO#10552) EXCEPT POR OF LOT 5, BLK 325 LYING N OF ADJUSTED LINE PER LBA# 9806721 & EXCEPT POR OF LOT 5, BLK 285, & VAC 3RD AVE S (VO #10552) LYING N OF THE ADJUSTED LINE PER LBA#9806720





1 SITE PLAN - PROJECT LOCATION
1:10000



DRAWING LIST	
Sheet Number	Sheet Title
C0.01	GENERAL NOTES, LEGEND, NOTES, ABBREVIATIONS, AND DRAWING LIST
C0.02	NOTES
C0.03	OVERALL KEY PLAN
C2.01	SITE DEMOLITION PLAN
C2.02	SITE DEMOLITION PLAN - AREAS A, B, C, AND D
C3.01	SITE, PAVING, AND GRADING PLAN
C3.02	SITE, PAVING, AND GRADING PLAN - AREAS A, B, C, AND D
C5.01	STORM DRAINAGE PLAN - AREAS A, B, C, AND D
C8.01	SECTIONS AND DETAILS
C8.02	SECTIONS AND DETAILS
C8.03	SECTIONS AND DETAILS
C8.04	SECTIONS AND DETAILS
C8.05	SECTIONS AND DETAILS
C8.11	ONSITE STORMWATER MANAGEMENT PLAN



6/17/2025 1:09 PM USER: op PATH: \\LumenField\NorthLot\SECURITY PH2 (Previously PHB)\C0.0X.dwg LAYOUT: ----

LEGEND	
DESCRIPTION	SYMBOL
LIMITS OF WORK	-----
PROPERTY LINE	-.-.-.-.-
EASEMENT LINE	-----
CENTERLINE OF SWALE	----->
BOLLARD	●●
COORDINATE POINT	N 1,433,544.34 E 2,454,789.02
BUILDING	
TREE PROTECTION FENCE	○-----○

DEMOLITION LEGEND	
DESCRIPTION	SYMBOL
ITEM TO BE REMOVED	-----
ITEM TO REMAIN	
CAP UTILITY, SEE SITE DEMOLITION	-┐
FULL DEPTH PAVEMENT REMOVAL	

SITE HATCHES	
FULL DEPTH ASPHALT PAVEMENT PATCH	
SIDEWALK PAVEMENT OVER M30 SHALLOW BOLLARD FOUNDATION	

STORM LEGEND	
DESCRIPTION	SYMBOL
OVERFLOW CB	-----■
PERFORATED STORM PIPE	-----4" SD

ABBREVIATIONS							
& @ Δ, D ^, DEG ~, DIA # % fc	AND AT DEFLECTION ANGLE DEGREE DIAMETER NUMBER PERCENT CONCRETE COMPRESSIVE STRENGTH REINFORCING STEEL YIELD STRENGTH	DB DEG, ^ DEMO DEPT DET DI DIA, ~ DIAG DICA	DUCTBANK DEGREE DEMOLISH DEMOLITION DEPARTMENT DETAIL DUCTILE IRON DIAMETER DIAGONAL DRILLED-IN CONCRETE ANCHOR DIMENSION DIRECTION DOMESTIC DOWNSPOUT DRAWING DOWEL DRIVEWAY	LF LOC LP LT LVL MATL MAX MECH MFR MH MIC MIN MISC MJ ML MON MSE	LINEAR FEET LOCATE (-D), LOCATION LOW POINT LEFT LEVEL MATERIAL MAXIMUM MECHANICAL MANUFACTURE (-R) MANHOLE MONUMENT IN CASE MINIMUM, MINUTE MISCELLANEOUS MECHANICAL JOINT MATCHLINE MONUMENT MECHANICALLY STABILIZED EARTH MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES	S SCHED SD SDMH SE SECT SHT SIM SOG SPC SPEC SQ SS SSMH ST STA STD STL STRUC SW SYM	SLOPE, SOUTH SCHEDULE STORM DRAIN STORM DRAIN MANHOLE SOUTHEAST SECTION SHEET SIMILAR SLAB ON GRADE SPACE SPECIFICATION SQUARE SANITARY SEWER SANITARY SEWER MANHOLE STREET STATION STANDARD STEEL STRUCTURAL, STRUCTURE SOUTHWEST SYMMETRICAL
fy							
ABAN AC AD ADA	ABANDON (-ED) ASBESTOS CEMENT, ASPHALT CONCRETE AREA DRAIN AMERICANS WITH DISABILITIES ACT						
ADDL ADJ AGGR ALT	ADDITIONAL ADJACENT, ADJUST (-ED, -MENT, -ABLE) AGGREGATE ALTERNATE, ALTERNATIVE	(E) E EA ECC ECR EG	EXISTING EAST (-ING) EACH ECCENTRIC END CURB RETURN EXISTING GRADE				
APPD APPROX ARCH ASPH ASSY ASTM	APPROVED APPROXIMATE (-LY) ARCHITECT (-URAL) ASPHALT ASSEMBLY AMERICAN SOCIETY FOR TESTING AND MATERIALS	EJ EL ELEC EMBED ENGR EOR EQ	EXPANSION JOINT ELEVATION ELECTRICAL EMBED (-DED, -MENT) ENGINEER ENGINEER OF RECORD EQUAL	NA NE NIC NOM NTS NW	NOT APPLICABLE NORTHEAST NOT IN CONTRACT NOMINAL NOT TO SCALE NORTHWEST	TB TC TD TEMP TESC	THRUST BLOCK TOP OF CURB TRENCH DRAIN TEMPORARY TEMPORARY EROSION AND SEDIMENT CONTROL
ATB AVE	ASPHALT TREATED BASE AVENUE	EQUIP ESMT EST EVC EW	EQUIPMENT EASEMENT ESTIMATE (-D) END VERTICAL CURVE EACH WAY	OC OD OPNG OPP OPT ORIG OWS	ON CENTER OUTSIDE DIAMETER OPENING OPPOSITE (HAND) OPTION (-AL) ORIGINAL OIL/WATER SEPARATOR	TOF TOW TYP UNO	TOP OF FOOTING TOP OF WALL TYPICAL UNLESS NOTED OTHERWISE
BCR BFP BLDG BLK BM BMP	BEGIN CURB RETURN BACK FLOW PREVENTER BUILDING BLOCK (-ING) BEAM, BENCH MARK BEST MANAGEMENT PRACTICE	EXCAV EXIST EXP EXT	EXCAVATION EXISTING EXPANSION EXTERIOR			V VAC VB VC VDM	VERTICAL VACUUM VALVE BOX VERTICAL CURVE VERTICAL DRAINAGE MATERIAL
BOL BOT BOW BSMT BTWN BVC	BOLLARD BOTTOM BOTTOM OF WALL BASEMENT BETWEEN BEGIN VERTICAL CURVE	FDN FF FG FH FIN FL	FOUNDATION FINISHED FLOOR FINISHED GRADE FIRE HYDRANT FINISH (-ED) FLOOR, FLOWLINE, FLANGE	PED PERF PERP PI PIV	PEDESTRIAN PERFORATED PERPENDICULAR POINT OF INTERSECTION POST INDICATOR	VERT VIF VOL VTB	VERTICAL VERIFY IN FIELD VOLUME VERTICAL THRUST BLOCK
CANT CB CC CDF	CANTILEVER CATCH BASIN CENTER TO CENTER CONTROLLED DENSITY	FM FT FTG	FORCE MAIN FOOT, FEET FOOTING	PL PLUMB POLY PRC	PROPERTY LINE, PLATE PLUMBING POLYETHYLENE POINT OF REVERSE CURVATURE	W W/ W/O WHT WP WPJ	WATER, WEST, WIDTH WITH WITHOUT WHITE WORK POINT WEAKENED PLANE JOINT
CFS CI CIP CJ CL CLR CMP	FILL CUBIC FEET PER SECOND CAST IRON CAST-IN-PLACE CONSTRUCTION JOINT CENTERLINE CLEAR (-ANCE) CORRUGATED METAL PIPE	G GA GAL GALV GB GEN GPM GV	GAS, GUTTER GAGE, GAUGE GALLON GALVANIZE (-D) GRADE BREAK GENERAL GALLONS PER MINUTE GATE VALVE	PROP PROT PSF PSI PT	PROPERTY PROTECTION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH POINT OF TANGENCY, POINT	WS WT WWF YD YEL	WATER SURFACE WEIGHT WELDED WIRE FABRIC YARD YELLOW
CNR CO COL COMB COMM CON CONC COND CONN CONST CONT	CORNER CLEAN OUT COLUMN COMBINATION COMMUNICATION CONCENTRIC CONCRETE CONDUIT, CONDITION CONNECT (-ION) CONSTRUCTION CONTINUATION, CONTINUE, CONTINUOUS	H HDPE HH HMA HORIZ HP HT HTB HYD ID IE IN INCL INFO INT INV IRR	HORIZONTAL HIGH DENSITY POLYETHYLENE HANDHOLE HOT MIX ASPHALT HORIZONTAL HIGH POINT HEIGHT HORIZONTAL THRUST BLOCK HYDRANT	PV PVC PVI PVMT Q R RCMD RCP	POWER VAULT POLYVINYL CHLORIDE POINT OF VERTICAL INTERSECTION PAVEMENT FLOW RATE RADIUS RECOMMEND (-ED) REINFORCED CONCRETE PIPE		
CONTR COORD	CONTRACTOR COORDINATE, COORDINATION	IN INCL INFO INT INV IRR	INVERT ELEVATION INCH INCLUDE (-D), INCLUDING INFORMATION INTERIOR, INTERSECTION INVERT IRRIGATION	RED REF REINF REQD RET REV RIM RJ RL ROW RPM	REDUCER, REDUCING REFER (-ENCE) REINFORCE (-D, -MENT), REINFORCING REQUIRED RETAINING REVISION RIM ELEVATION RESTRAINED JOINT RAIN LEADER RIGHT-OF-WAY RAISED PAVEMENT MARKER		
CORP COS CP	CORPORATION CITY OF SEATTLE CONTROL POINT, CENTER POINT	IN INCL INFO INT INV IRR	INVERT ELEVATION INCH INCLUDE (-D), INCLUDING INFORMATION INTERIOR, INTERSECTION INVERT IRRIGATION	RT RW	RIGHT RECYCLED WATER		
CTB CTR CU CULV CV	CEMENT TREATED BASE CENTER CUBIC CULVERT COMM VAULT	JT LARCH LAT LB	JOINT LANDSCAPE ARCHITECT (-URAL) LATERAL POUND				
D, Δ	DEFLECTION ANGLE						

- GENERAL NOTES
1.

EXISTING CONDITIONS SHOWN ARE PER THE PROJECT SITE SURVEY PROVIDED BY BUSH, ROED & HITCHINGS, INC. DATED 9/13/2024. THE CONTRACTOR SHALL VERIFY THE EXISTING CONDITIONS AND NOTIFY THE OWNER'S REPRESENTATIVE OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION ACTIVITIES.
2.

HORIZONTAL DATUM IS NAD 83/2011 (EPOCH 2010). REFER TO THE PROJECT SITE SURVEY FOR ADDITIONAL INFORMATION.
3.

VERTICAL DATUM IS NAVD 88 REFER TO THE PROJECT SITE SURVEY FOR ADDITIONAL INFORMATION.
4.

THE CONTRACTOR SHALL COMPLY WITH THE RECOMMENDATIONS IN THE GEOTECHNICAL REPORT PROVIDED BY TETRA TECH DATED NOVEMBER 27, 2024.
5.

WORK SHALL CONFORM TO THE CITY OF SEATTLE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION, 2020 EDITION, AND THE CITY OF SEATTLE STANDARD PLANS, 2020 EDITION. STANDARDS. A COPY OF THESE DOCUMENTS SHALL BE ON-SITE DURING CONSTRUCTION.
6.

THE CONTRACTOR IS RESPONSIBLE FOR TRAFFIC CONTROL DURING CONSTRUCTION.
7.

THE LIMITS OF WORK INDICATED ON THE CIVIL DRAWINGS APPLY TO THE CIVIL SITE AND UTILITY WORK. WORK OUTSIDE OF THE LIMITS OF WORK MAY BE REQUIRED BY OTHER DISCIPLINES OR TRADES. UNLESS NOTED OTHERWISE, NO CIVIL-RELATED WORK SHALL BE PERFORMED OUTSIDE THE LIMITS OF WORK WITHOUT PRIOR APPROVAL FROM THE OWNER'S REPRESENTATIVE. ANY WORK ADJACENT TO THE LIMITS OF WORK SHALL BE CARRIED OUT ON THE PROJECT SIDE.
8.

THE CONTRACTOR SHALL CONTACT THE UTILITY NOTIFICATION CENTER (1-800-424-5555) A MINIMUM OF THREE DAYS PRIOR TO ANY EXCAVATION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE SERVICES OF A PROFESSIONAL UNDERGROUND UTILITY LOCATION SERVICE TO LOCATE AND MAINTAIN MARKINGS THAT INDICATE LOCATIONS OF UNDERGROUND UTILITIES IN THE CONSTRUCTION AREA.

DRAWING LIST	
Sheet Number	Sheet Title
C0.01	GENERAL NOTES, LEGEND, NOTES, ABBREVIATIONS, AND DRAWING LIST
C0.02	NOTES
C0.03	OVERALL KEY PLAN
C2.01	SITE DEMOLITION PLAN
C2.02	SITE DEMOLITION PLAN - AREAS A, B, C, AND D
C3.01	SITE, PAVING, AND GRADING PLAN
C3.02	SITE, PAVING, AND GRADING PLAN - AREAS A, B, C, AND D
C5.01	STORM DRAINAGE PLAN - AREAS A, B, C, AND D
C8.01	SECTIONS AND DETAILS
C8.02	SECTIONS AND DETAILS
C8.03	SECTIONS AND DETAILS
C8.04	SECTIONS AND DETAILS
C8.05	SECTIONS AND DETAILS
C8.11	ONSITE STORMWATER MANAGEMENT PLAN

LUMEN FIELD NORTH LOT

SECURITY PLAN - PHASE 2


FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134



MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

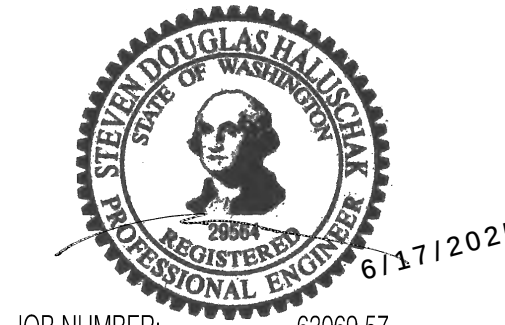

JOB NUMBER: 63069.57

NO.	DATE	DESCRIPTION
-----	------	-------------

DRAWN BY: MKA

DESIGNED BY: BMN

CHECKED BY: SDH

DATE: JUNE 17, 2025

GENERAL NOTES, LEGEND, NOTES, ABBREVIATIONS, AND DRAWING LIST

LAYOUT: ---

- PATH: J:\LumenFieldNorthLotCiv\SECURITY PH2 (Previously PH1B)\C0.OX.dwg

LAYOUT: ---

- PATH: J:\LumenFieldNorthLotCiv\SECURITY PH2 (Previously PH1B)\C0.OX.dwg

LAYOUT: ---

- PATH: J:\LumenFieldNorthLotCiv\SECURITY PH2 (Previously PH1B)\C0.OX.dwg


LAYOUT: ---

- PATH: J:\LumenFieldNorthLotCiv\SECURITY PH2 (Previously PH1B)\C0.OX.dwg

LAYOUT: ---

LAYOUT: ---


LAYOUT: ---



LAYOUT: ---

LAYOUT: ---

LAYOUT: ---



LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---

LAYOUT: ---


LAYOUT: ---

LAYOUT: ---

Tree	Species	DSH	CRZ	Avg. Crown Radius (Drip)	Condition Rating	Risk Rating	Recommendations
35	ACER PALMATUM	7.3"	17'	16'	GOOD	LOW	RETAIN AND MONITOR; TREE PROTECTION PLAN TO BE FOLLOWED FOR EACH TREE
36	ACER PALMATUM	10.2"	13'	18'	GOOD	LOW	RETAIN AND MONITOR; TREE PROTECTION PLAN TO BE FOLLOWED FOR EACH TREE
37	PLANTUS X ACERFOLIA	9.6"	10'	27'	FAIR	LOW	RETAIN AND MONITOR; TREE PROTECTION PLAN TO BE FOLLOWED FOR EACH TREE
38	PLANTUS X ACERFOLIA	11.0"	11'	30'	FAIR	LOW	RETAIN AND MONITOR; TREE PROTECTION PLAN TO BE FOLLOWED FOR EACH TREE
39	PLANTUS X ACERFOLIA	10.6"	11'	26'	FAIR	LOW	RETAIN AND MONITOR; TREE PROTECTION PLAN TO BE FOLLOWED FOR EACH TREE

NOTES:

1. ANY CLEARANCE PRUNING WILL BE COMPLETED BY AN SDCI REGISTERED PROVIDER TO ANSI A300 PRUNING STANDARDS.

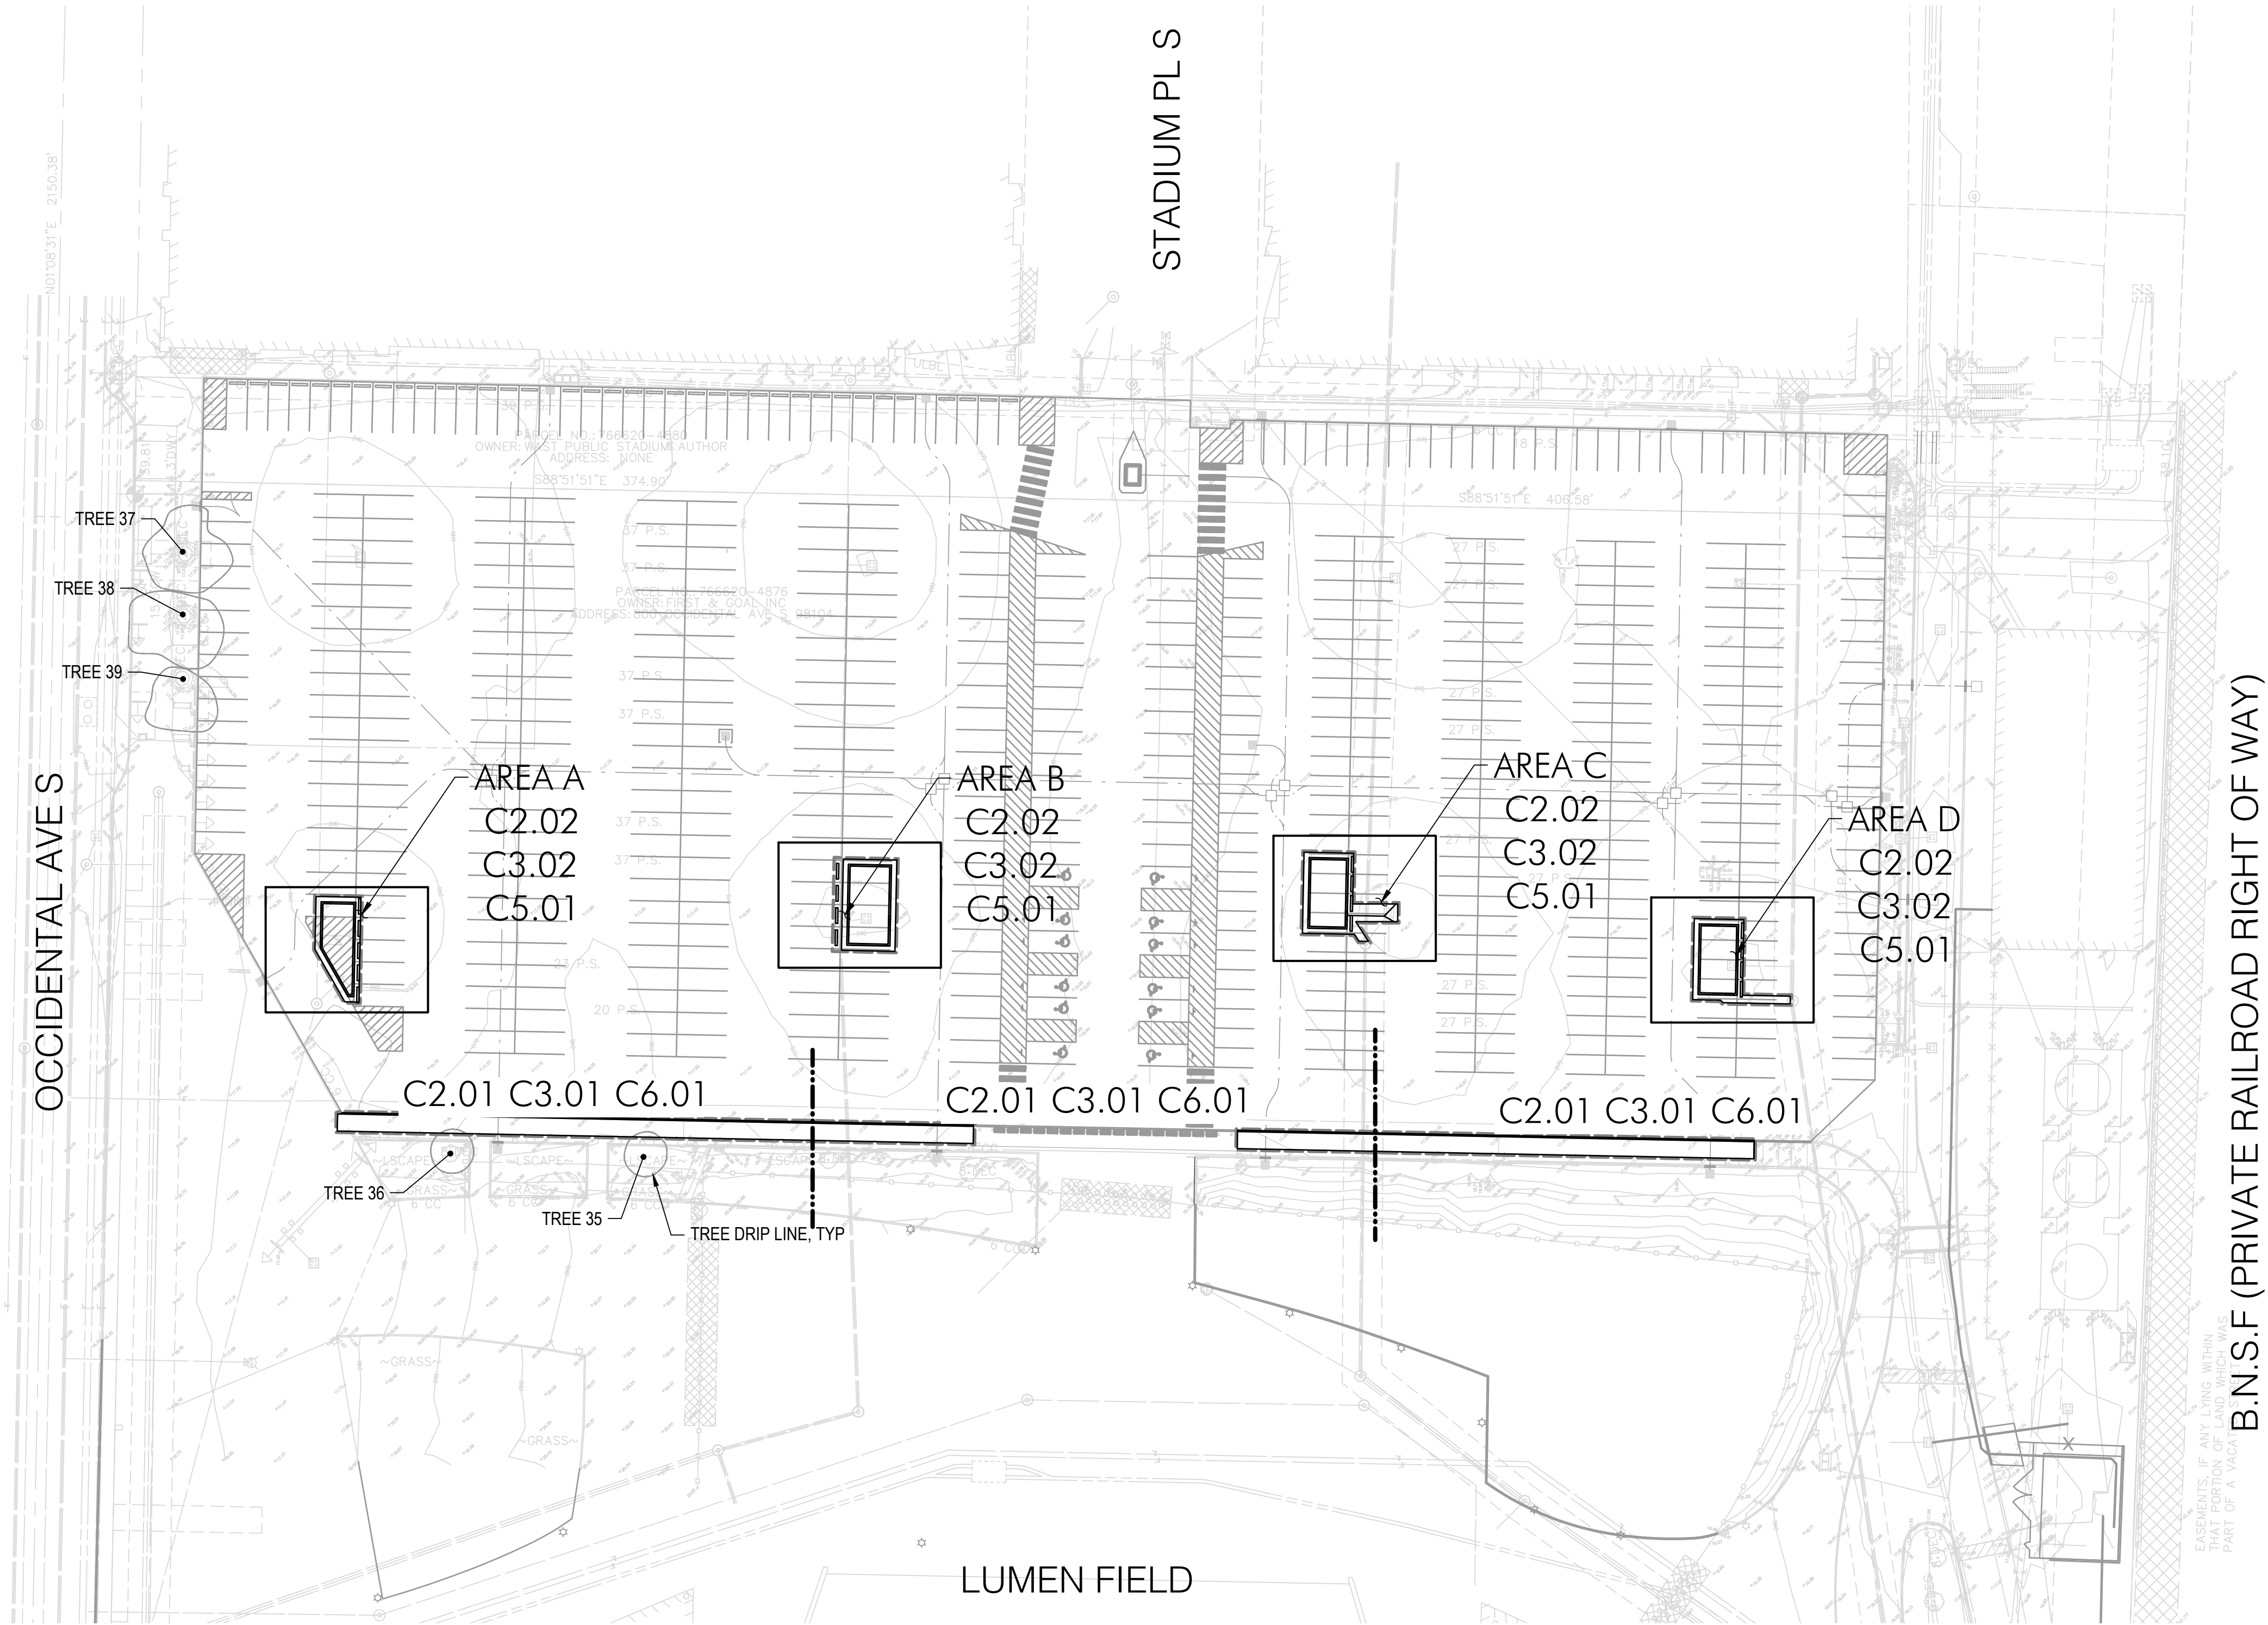

LUMEN FIELD
NORTH LOT

SECURITY PLAN - PHASE 2


FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134



MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

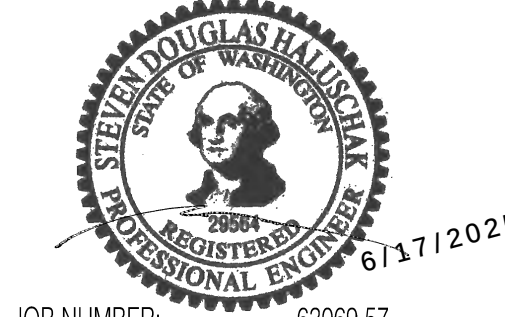

JOB NUMBER: 63069.57

NO.	DATE	DESCRIPTION
-----	------	-------------

DRAWN BY: MKA

DESIGNED BY: BMN


CHECKED BY: SDH

DATE: JUNE 17, 2025

OVERALL KEY
PLAN

SHEET 3 OF 14

C0.03

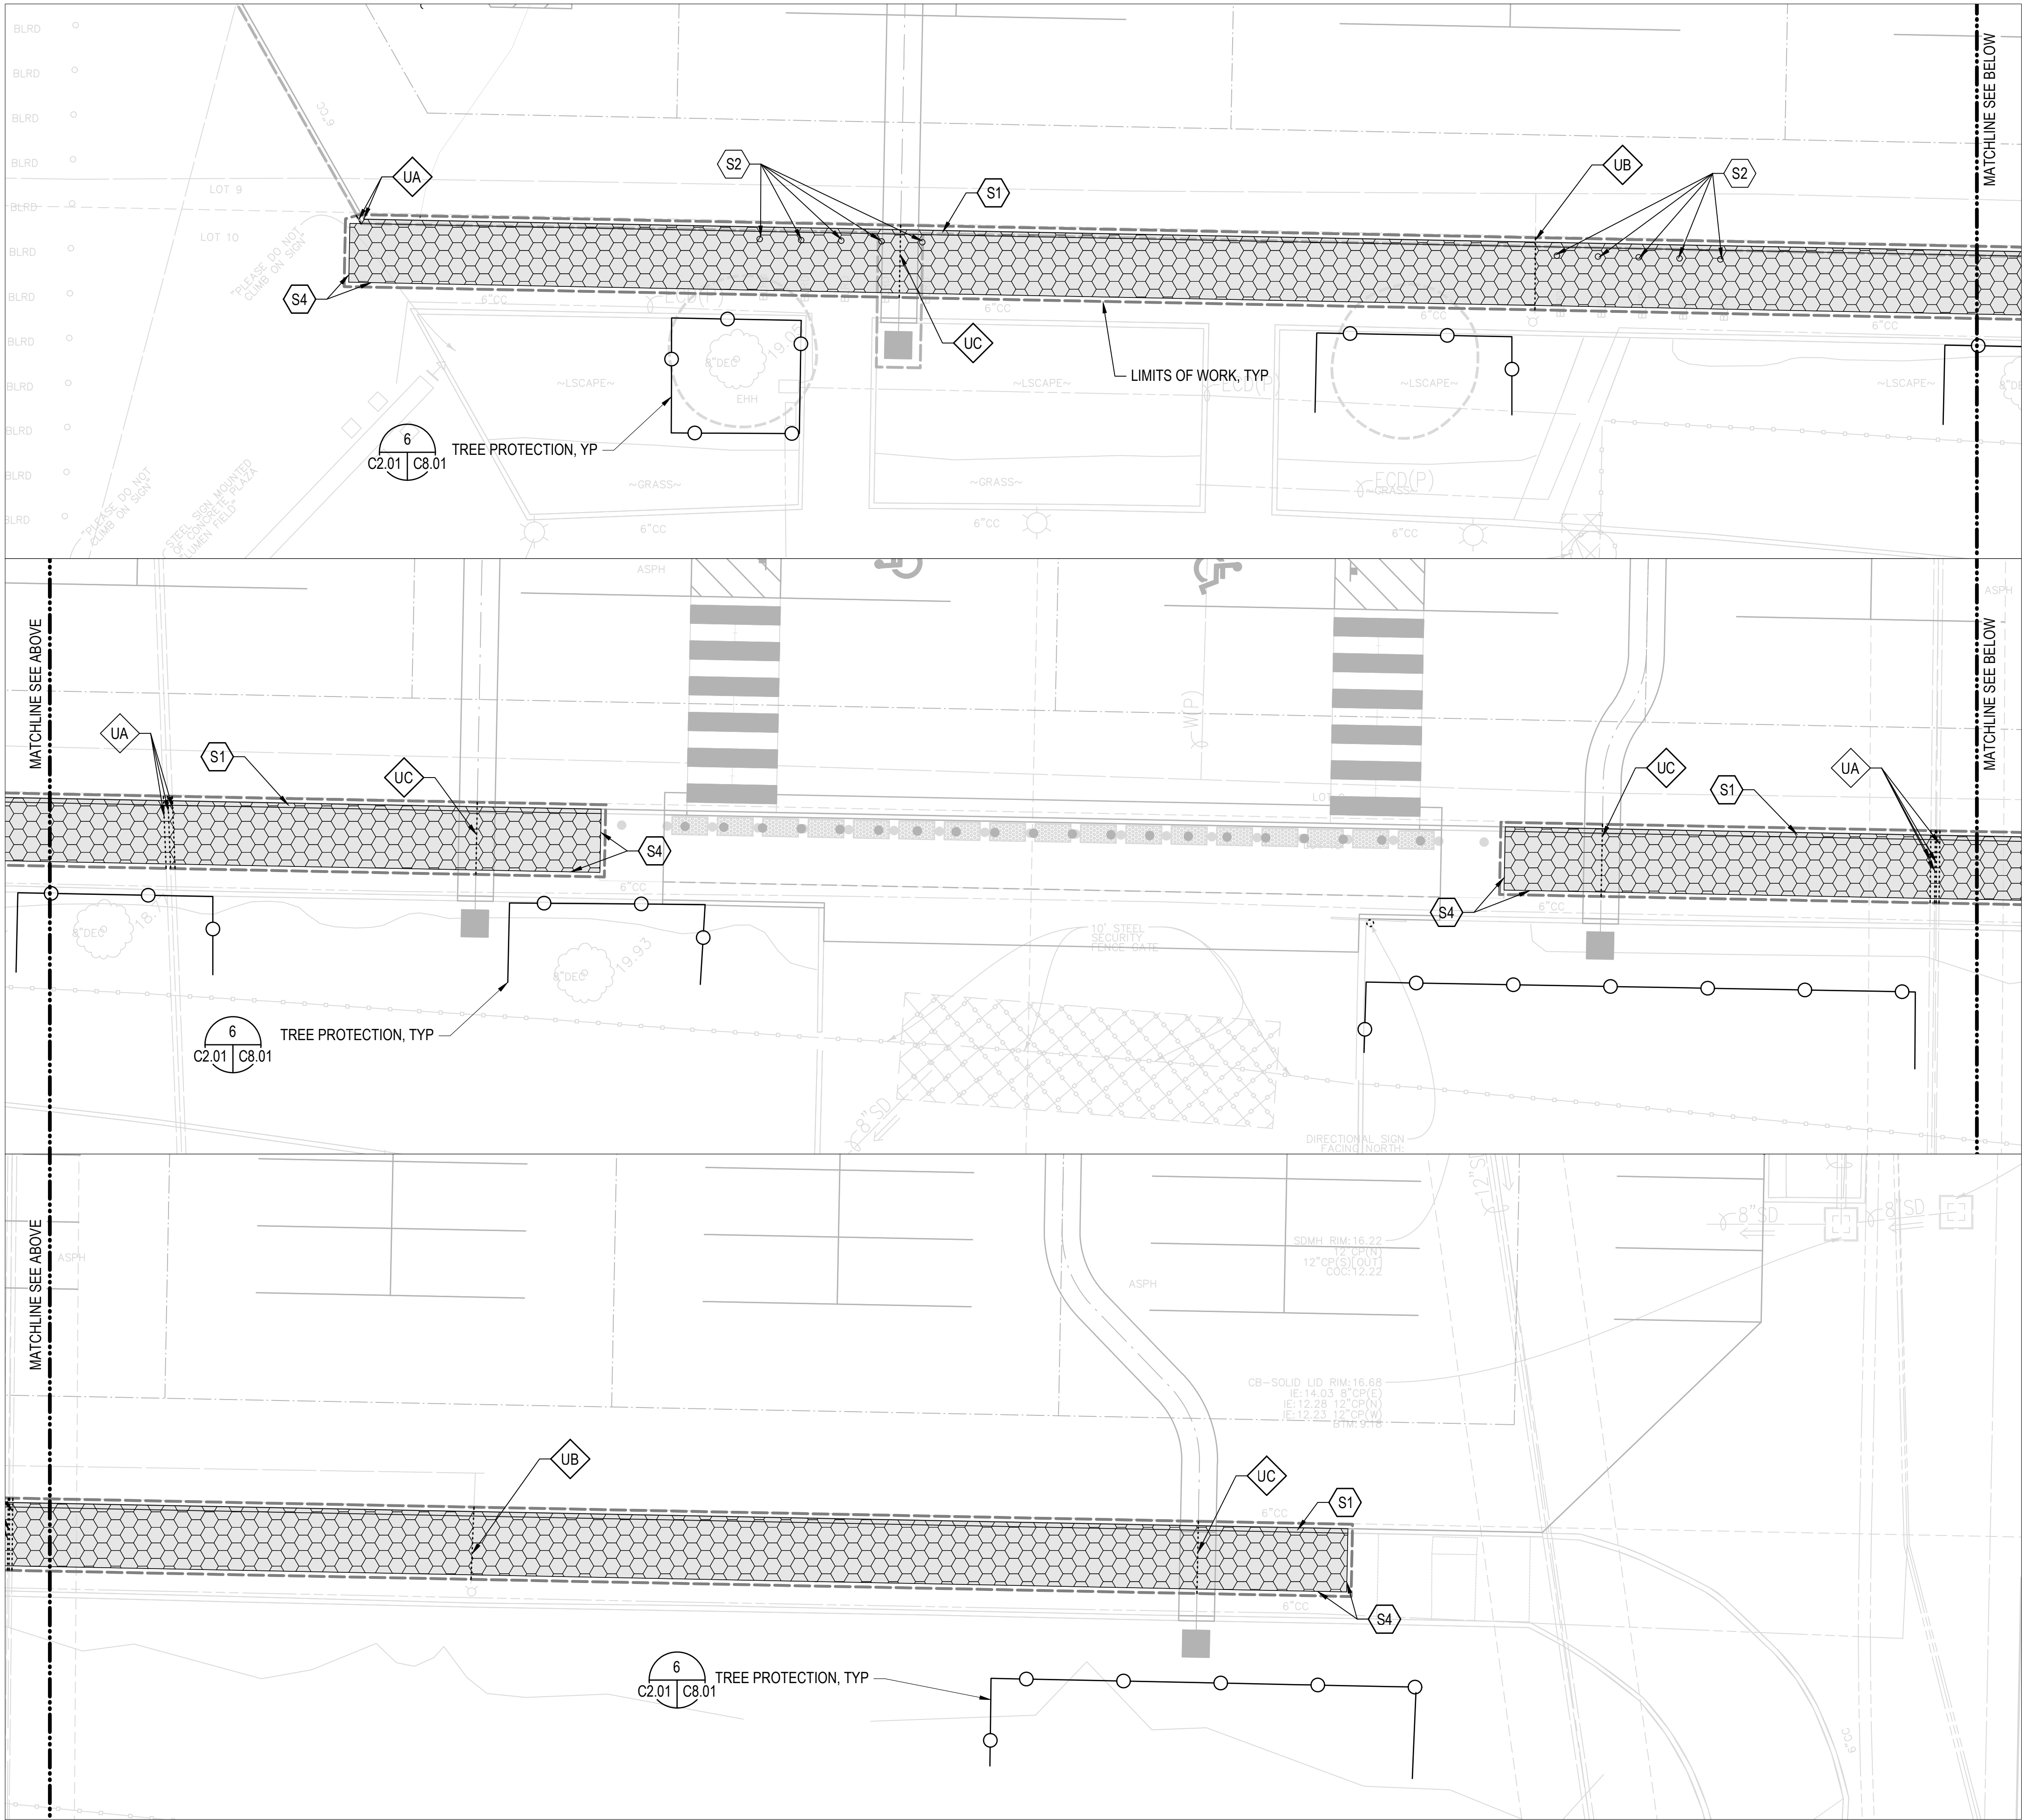

NOTES:

- SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
- SEE SHEET C0.02 FOR SITE DEMOLITION NOTES.
- SEE SHEET C0.03 FOR TREE INFORMATION AND REQUIREMENTS

UTILITIES TO REMAIN


FLAG	DESCRIPTION
UA	EXISTING STORM DRAIN PIPING AND CATCH BASINS TO REMAIN
UB	EXISTING WATER PIPING AND VALVES TO REMAIN
UC	EXISTING POWER CONDUIT, DUCTBANK, MAINTENANCE HOLES, VAULTS, AND JUNCTION BOXES TO REMAIN
UD	EXISTING STORM DRAIN PIPING PLUG AND ABANDON

SITE TO REMAIN

FLAG	DESCRIPTION
SA	EXISTING CONCRETE CURB TO REMAIN

SITE ELEMENTS TO BE REMOVED OR RELOCATED

FLAG	DESCRIPTION
S1	REMOVE EXISTING CONCRETE CURB
S2	REMOVE BOLLARD AND FOUNDATION
S3	REMOVE EXISTING STORM DRAIN PIPING AND CATCH BASINS
S4	REMOVE AND SAWCUT EXISTING CONCRETE/ASPHALT PAVEMENT

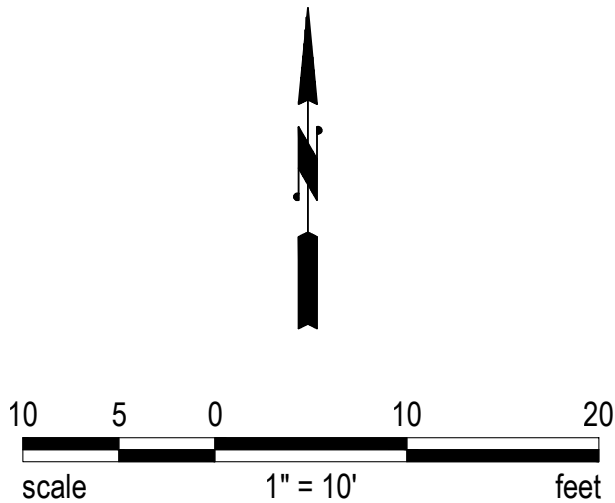

LUMEN FIELD
NORTH LOT


SECURITY PLAN - PHASE 2

FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134

MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

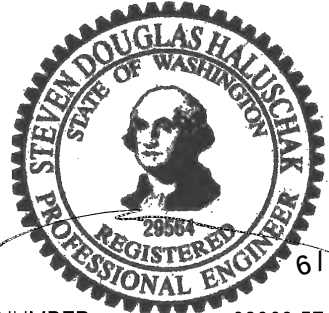

JOB NUMBER: 63069.57

NO. DATE DESCRIPTION

DRAWN BY: MKA

DESIGNED BY: BMN

CHECKED BY: SDH


DATE: JUNE 17, 2025

SITE DEMOLITION
PLAN


SHEET 4 OF 14

C2.01


6/7/2025 1:07 PM USER: op PATH: \\LumenField\NorthLot\SECURITY PH2 (Previously PH1B)\C2.02X.dwg LAYOUT: ----

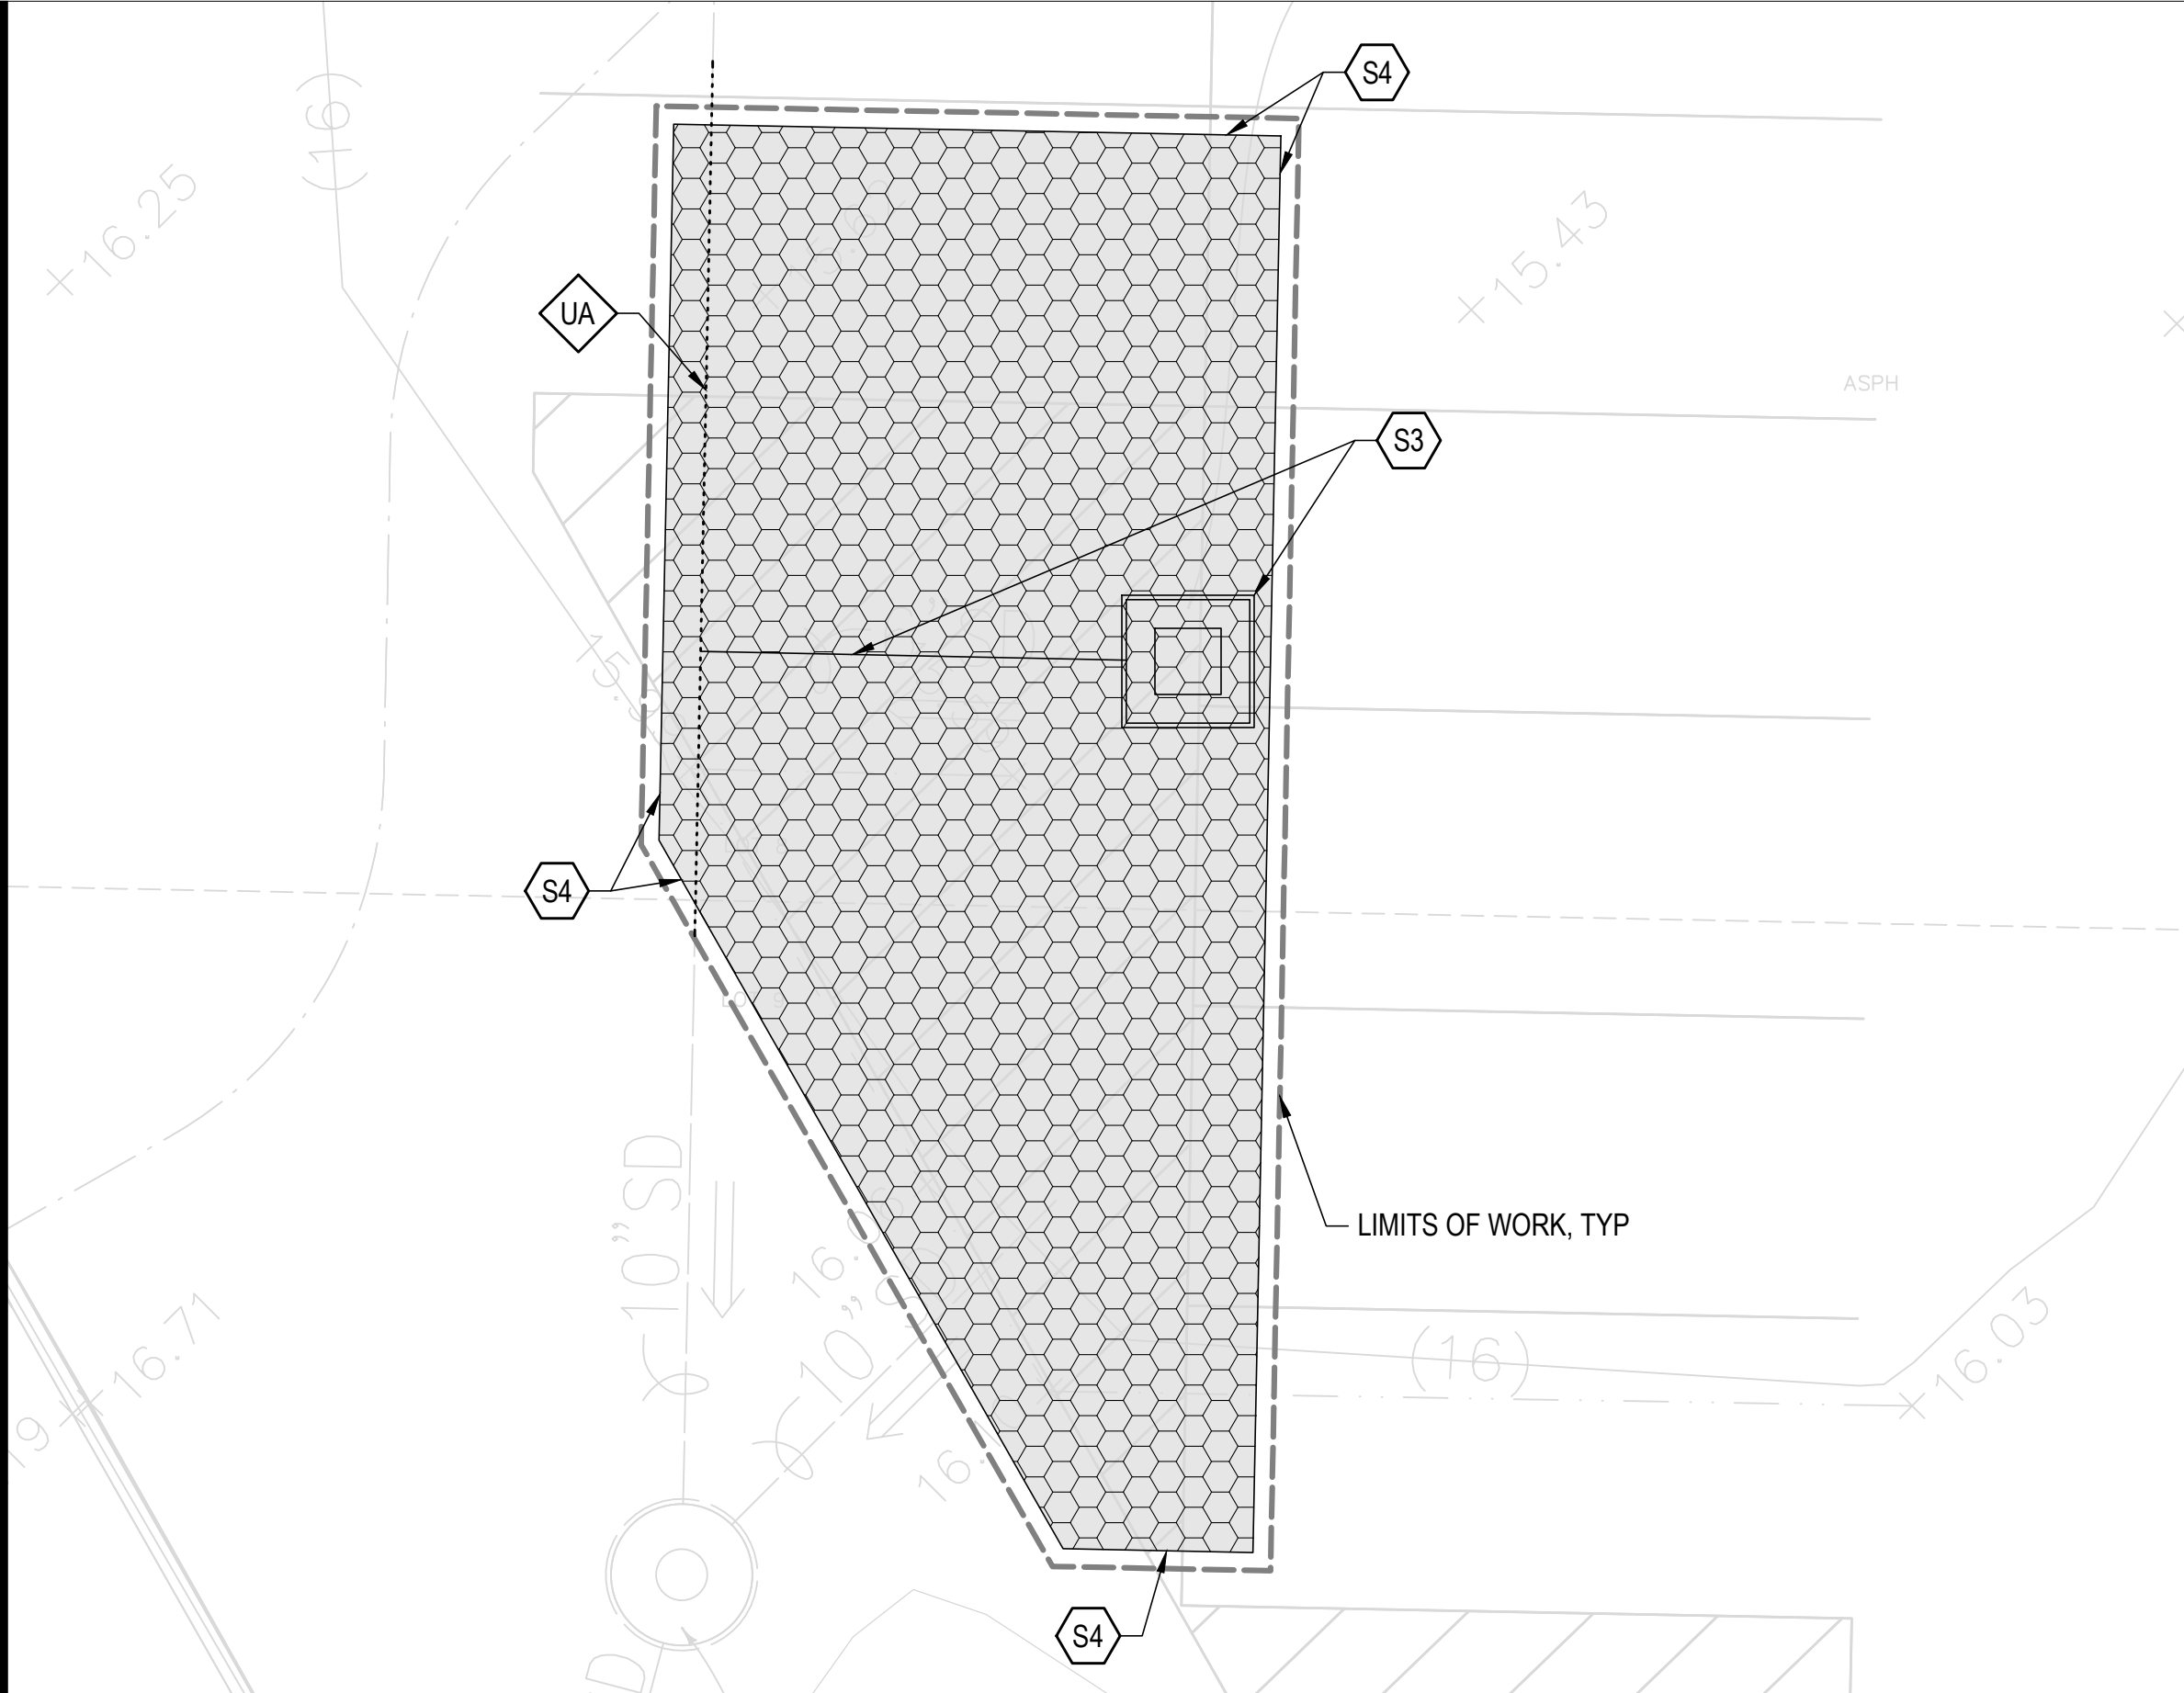


SITE DEMOLITION PLAN - AREA A
SCALE: 1" = 5'

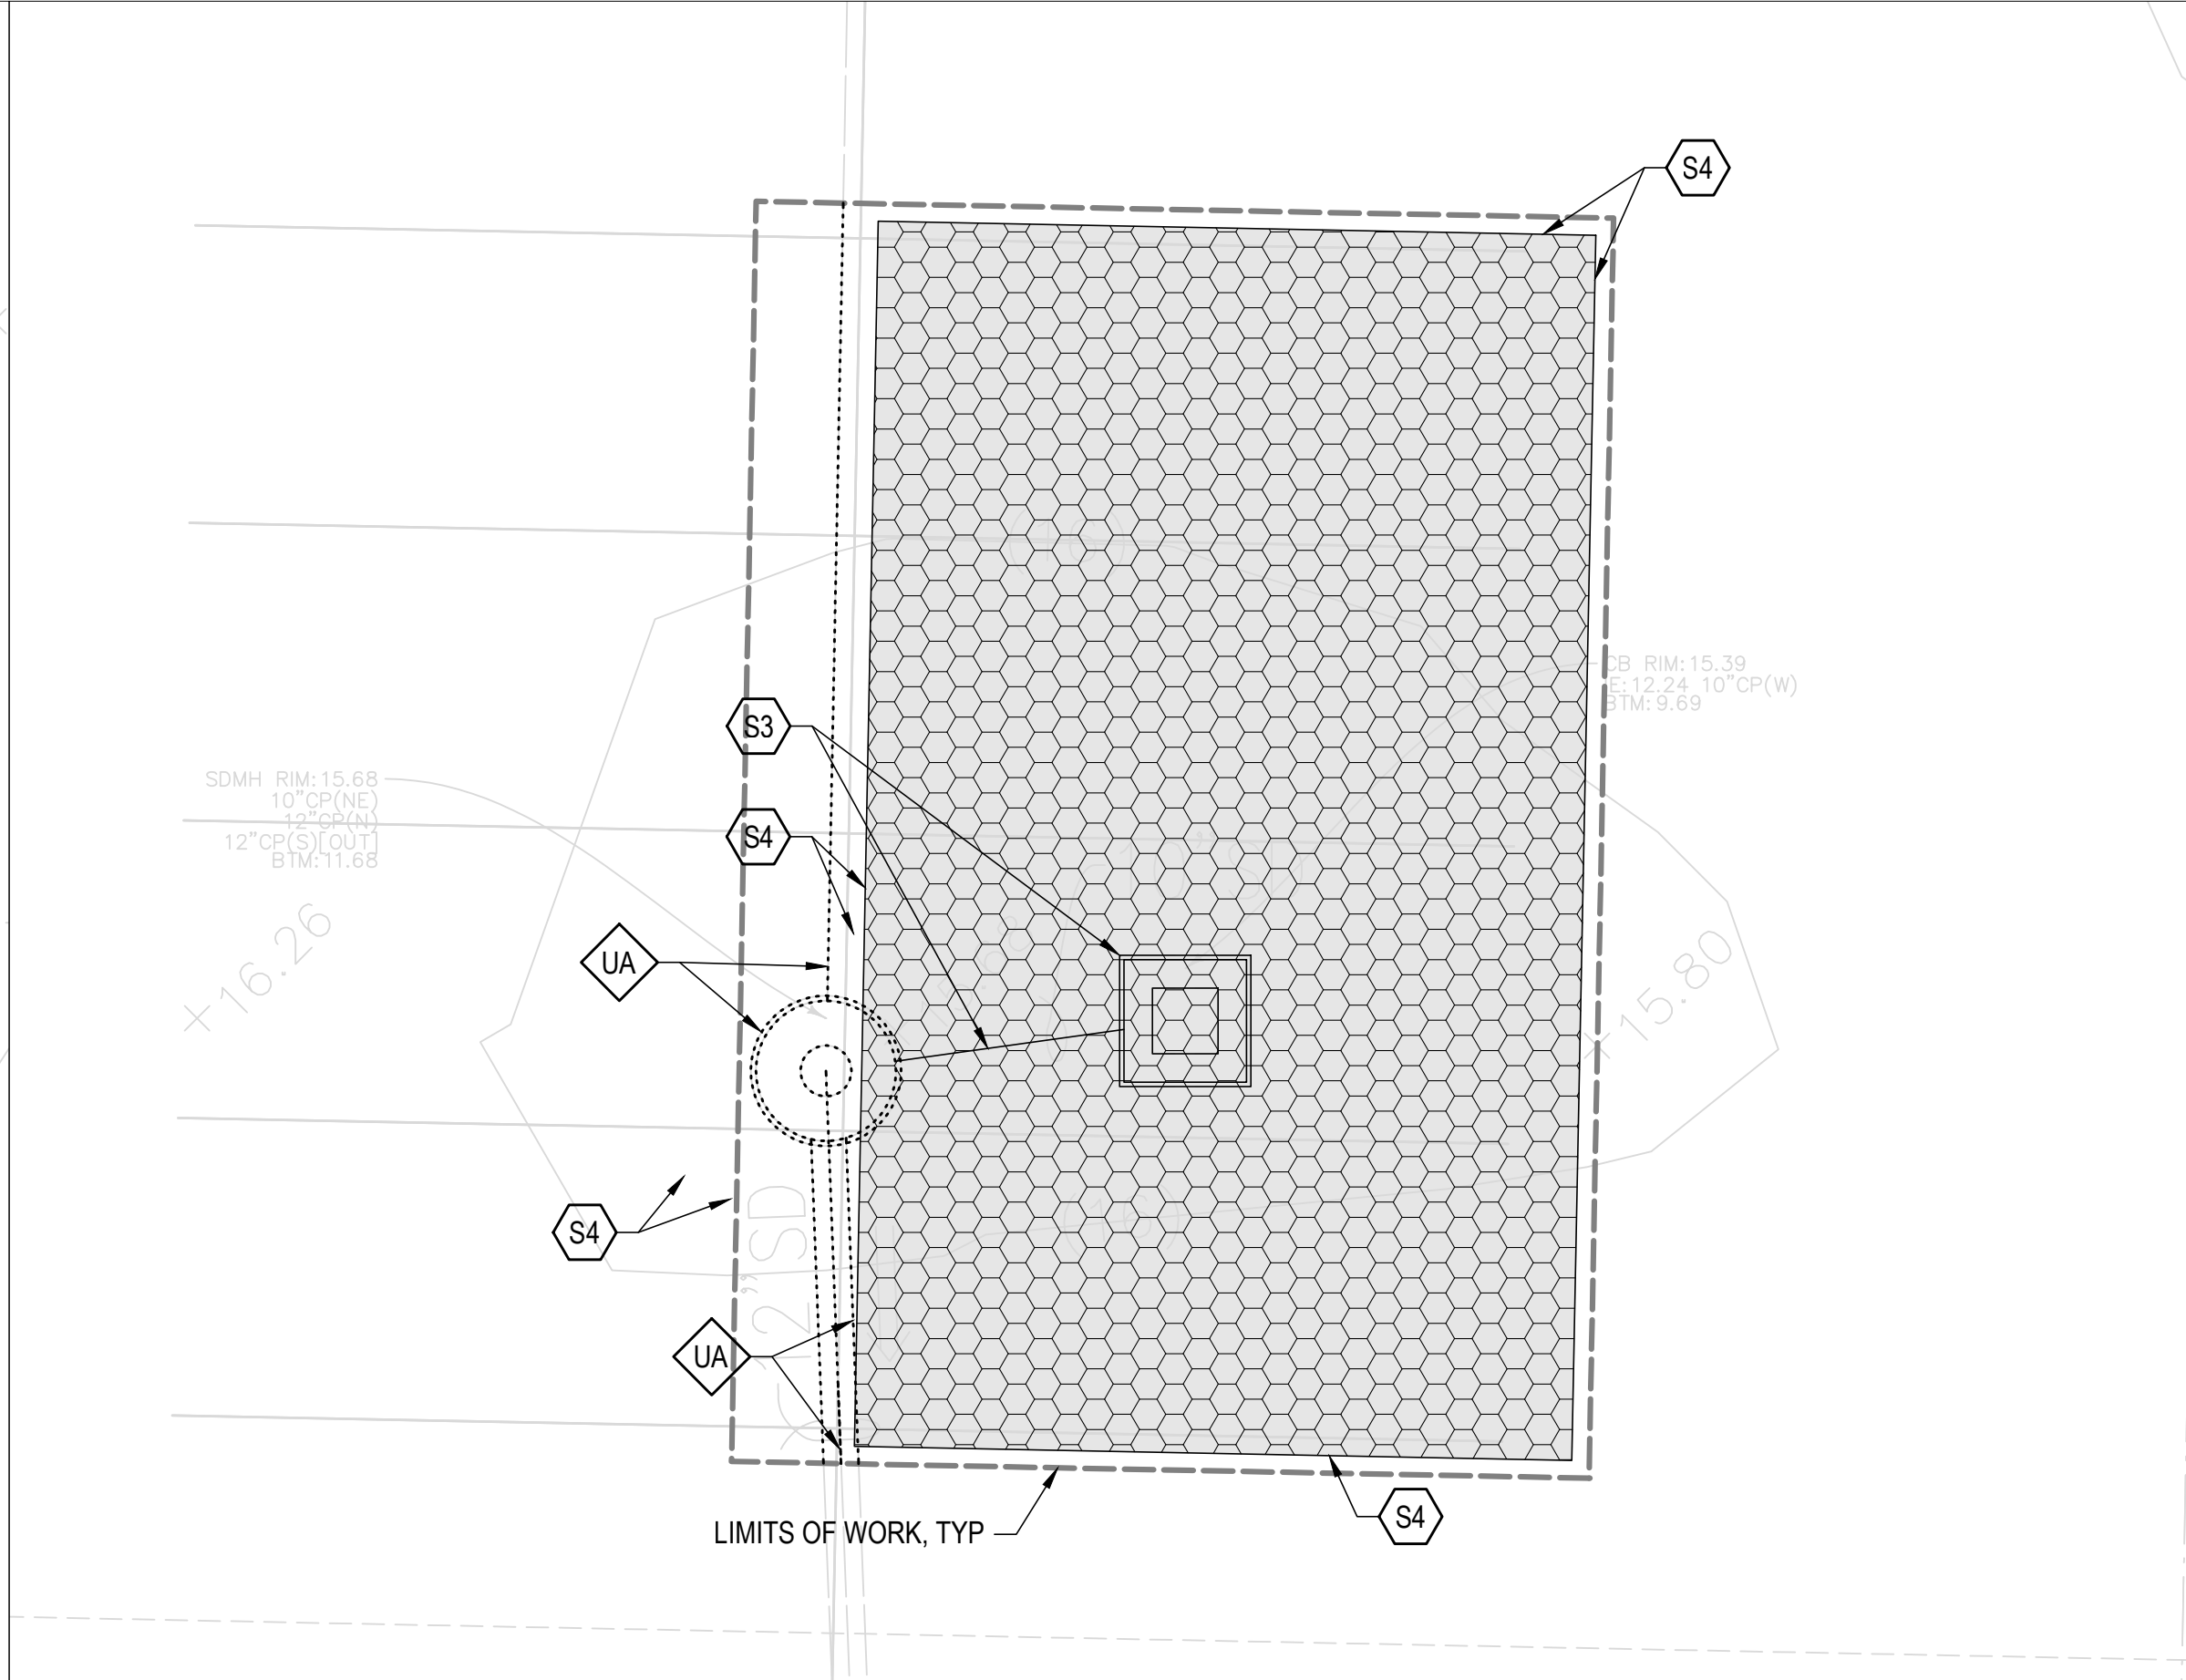

SITE DEMOLITION PLAN - AREA B
SCALE: 1" = 5'

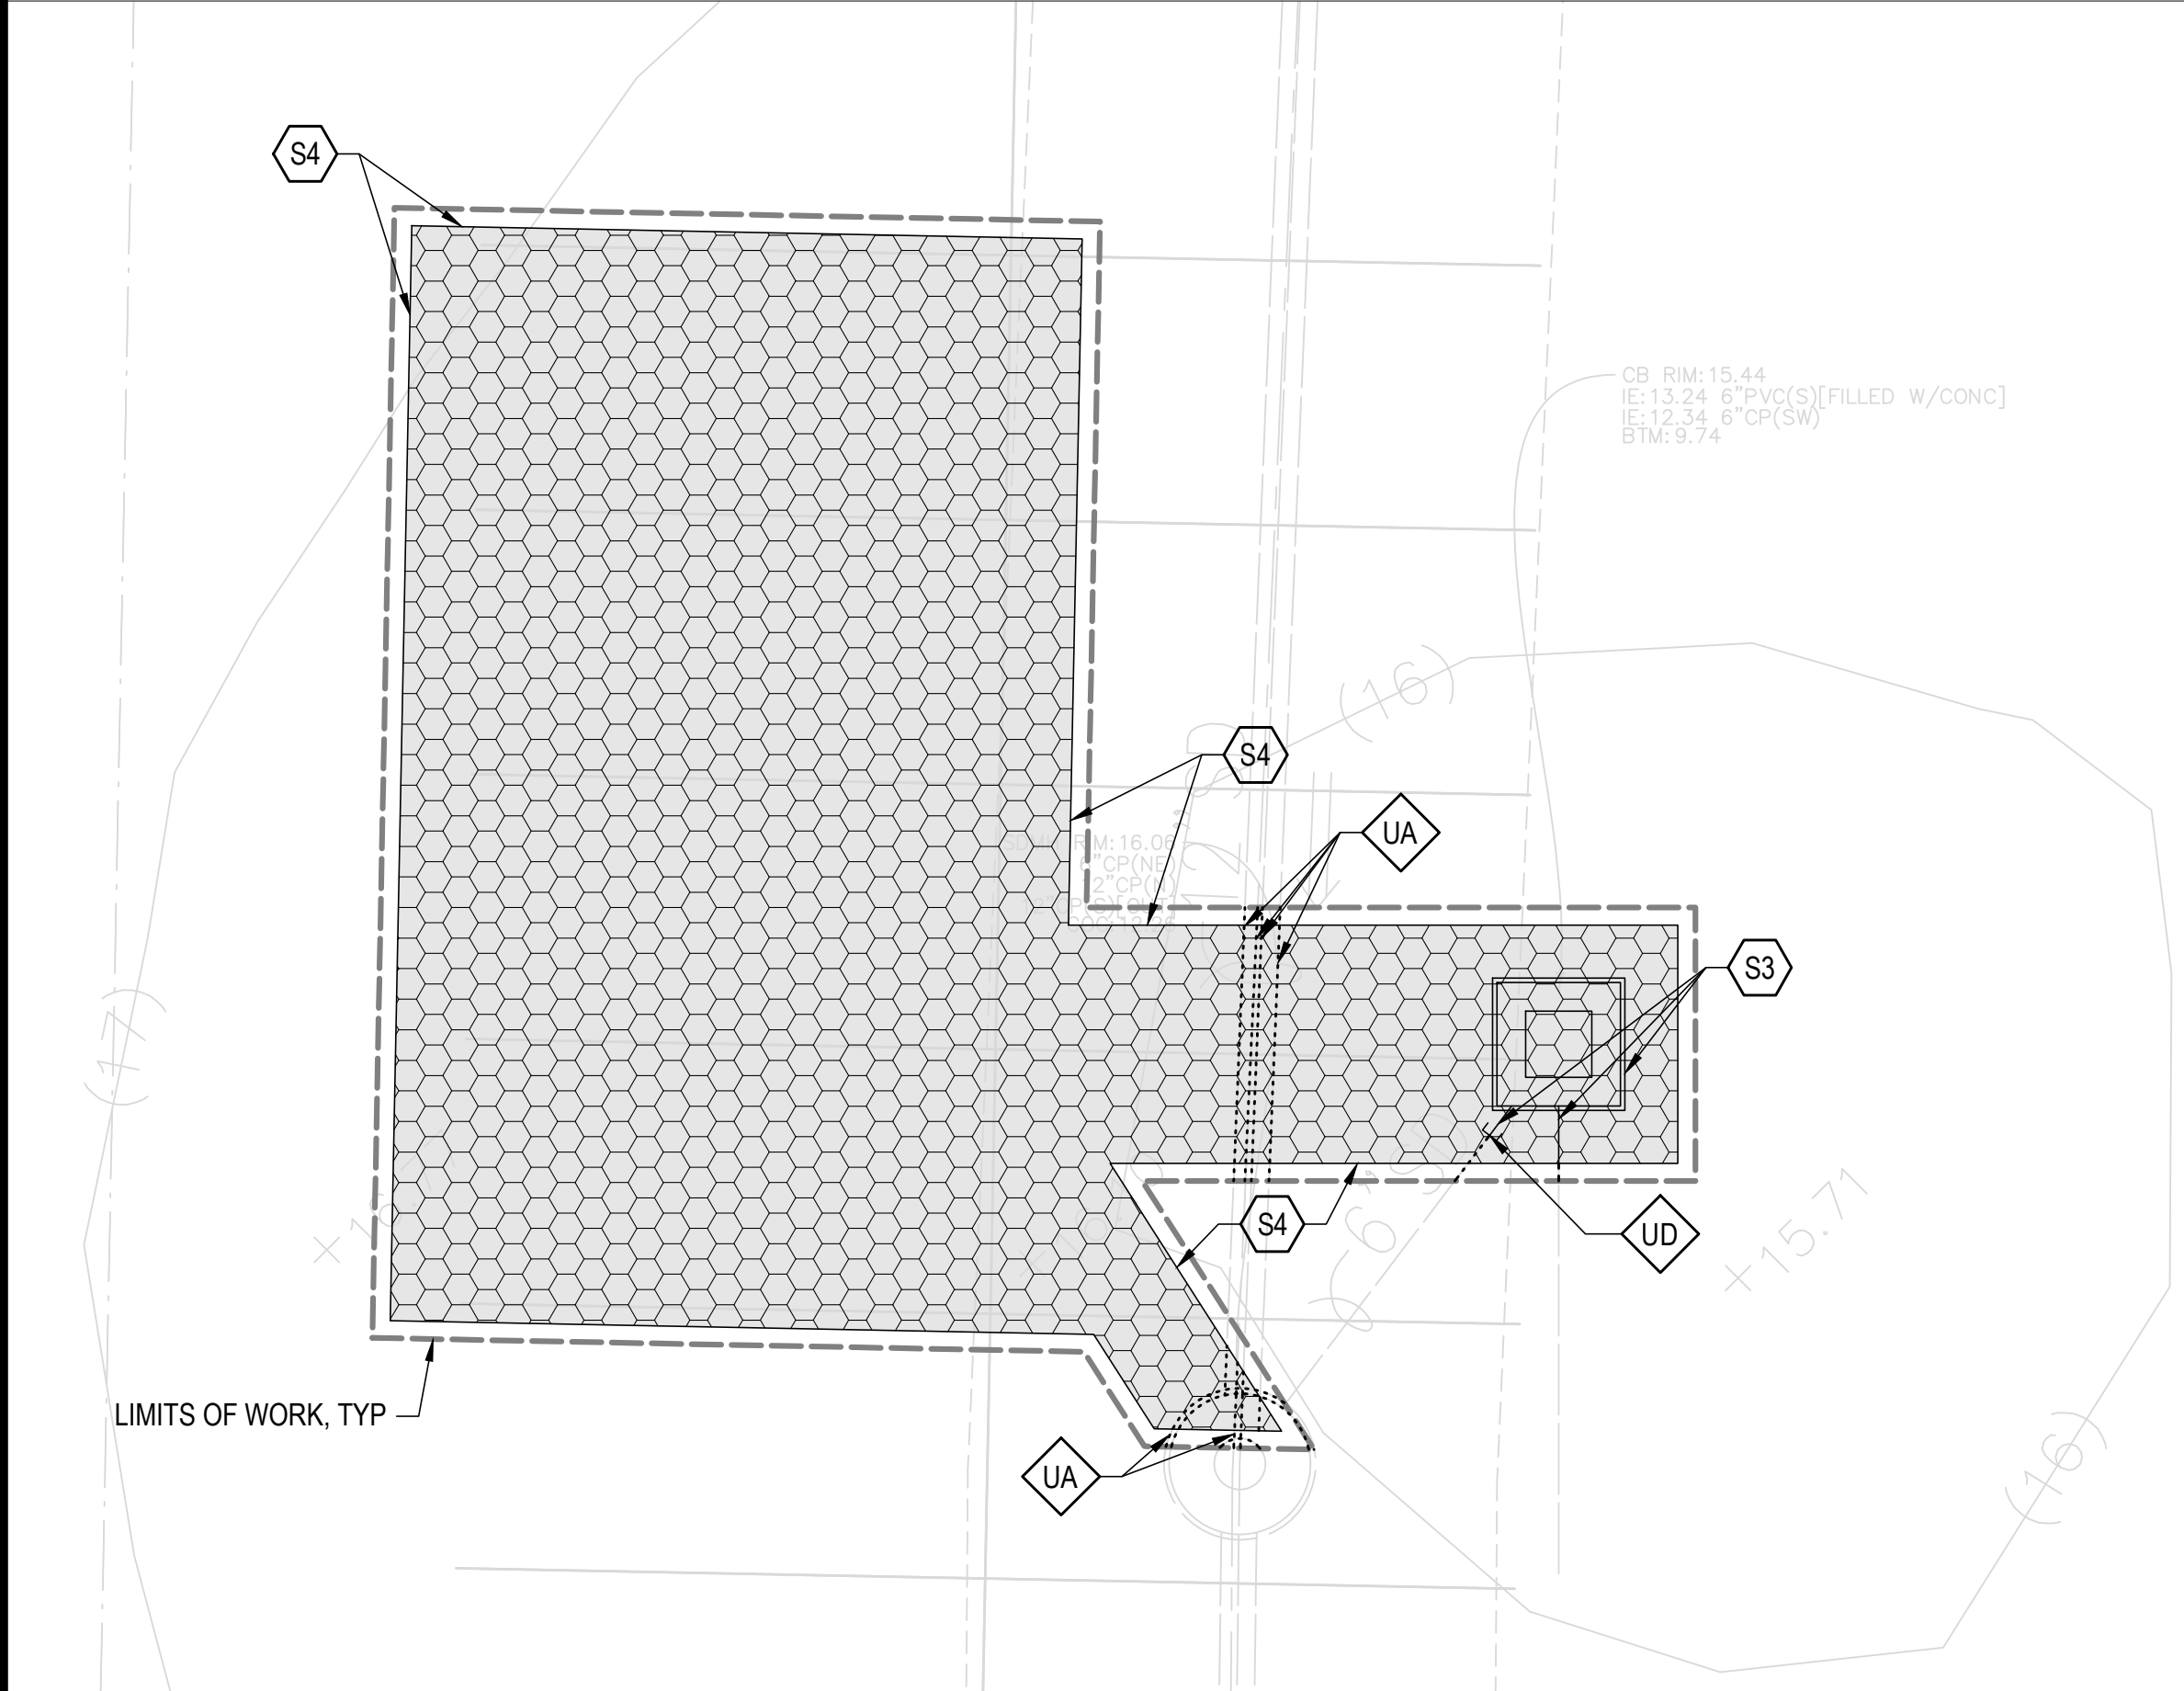

SITE DEMOLITION PLAN - AREA C
SCALE: 1" = 5'

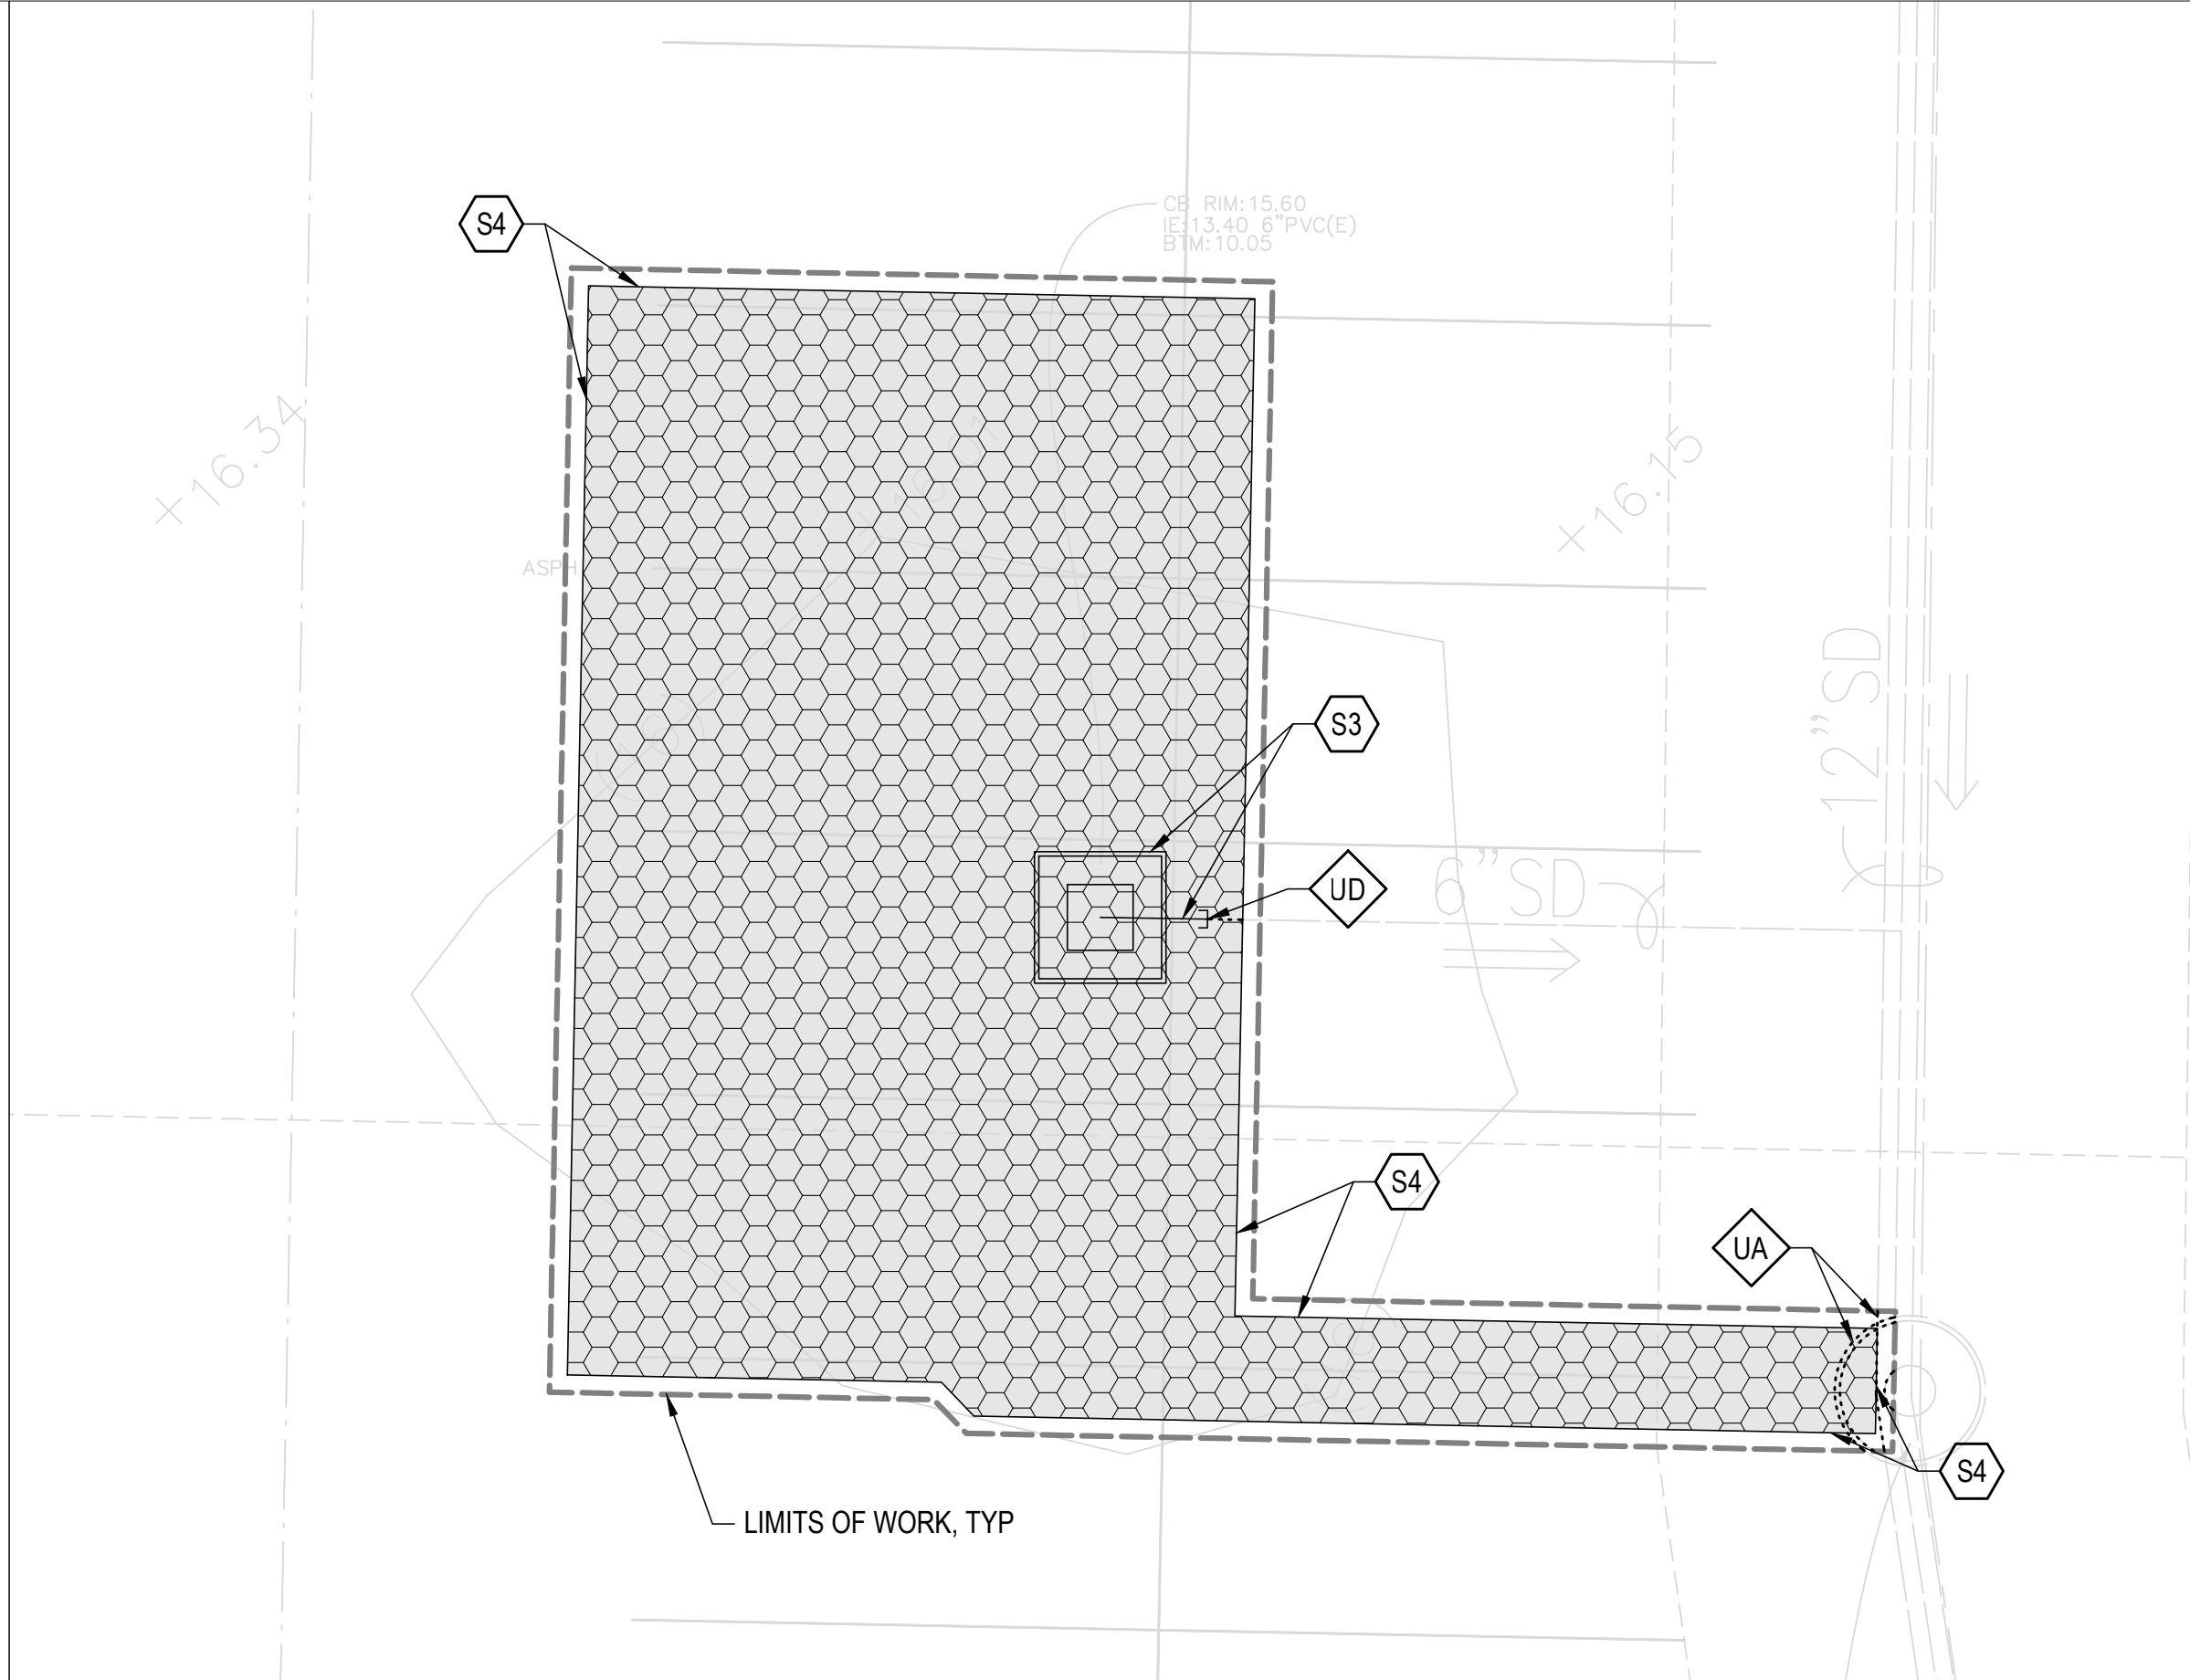

SITE DEMOLITION PLAN - AREA D
SCALE: 1" = 5'

NOTES:

1. SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
2. SEE SHEET C0.02 FOR SITE DEMOLITION NOTES.
3. SEE SHEET C2.01 FOR SITE DEMOLITION FLAG NOTES.
4. SEE SHEET C3.02 FOR PAVEMENT LOCATION INFORMATION.


LUMEN FIELD
NORTH LOT

SECURITY PLAN - PHASE 2

FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134

MAGNUSSON
KLEMENCIC
ASSOCIATES
Structural + Civil Engineers

PERMIT DOCUMENTS

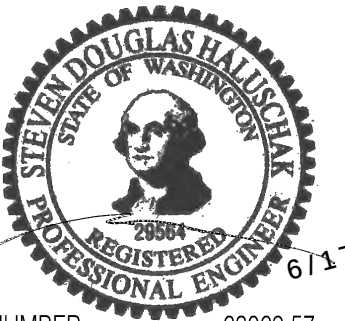


JOB NUMBER: 63089.57

NO.	DATE	DESCRIPTION

SITE DEMOLITION
PLAN - AREAS A, B,
C, AND D


SHEET 5 OF 14

C2.02

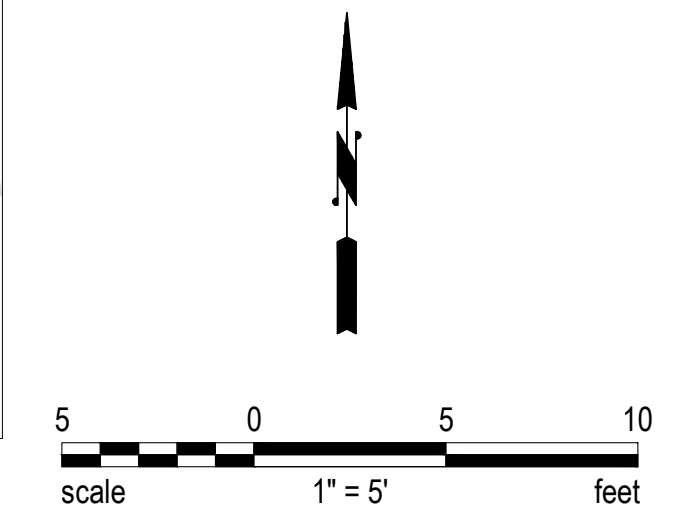



1. SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
2. SEE SHEET C0.02 FOR SITE AND PAVING NOTES.
3. SEE SHEET C0.03 FOR TREE INFORMATION AND REQUIREMENTS.

SECURITY PLAN - PHASE 2





**Structural + Civil Engineers**[illegible]

SITE, PAVING, AND GRADING PLAN

C3.01

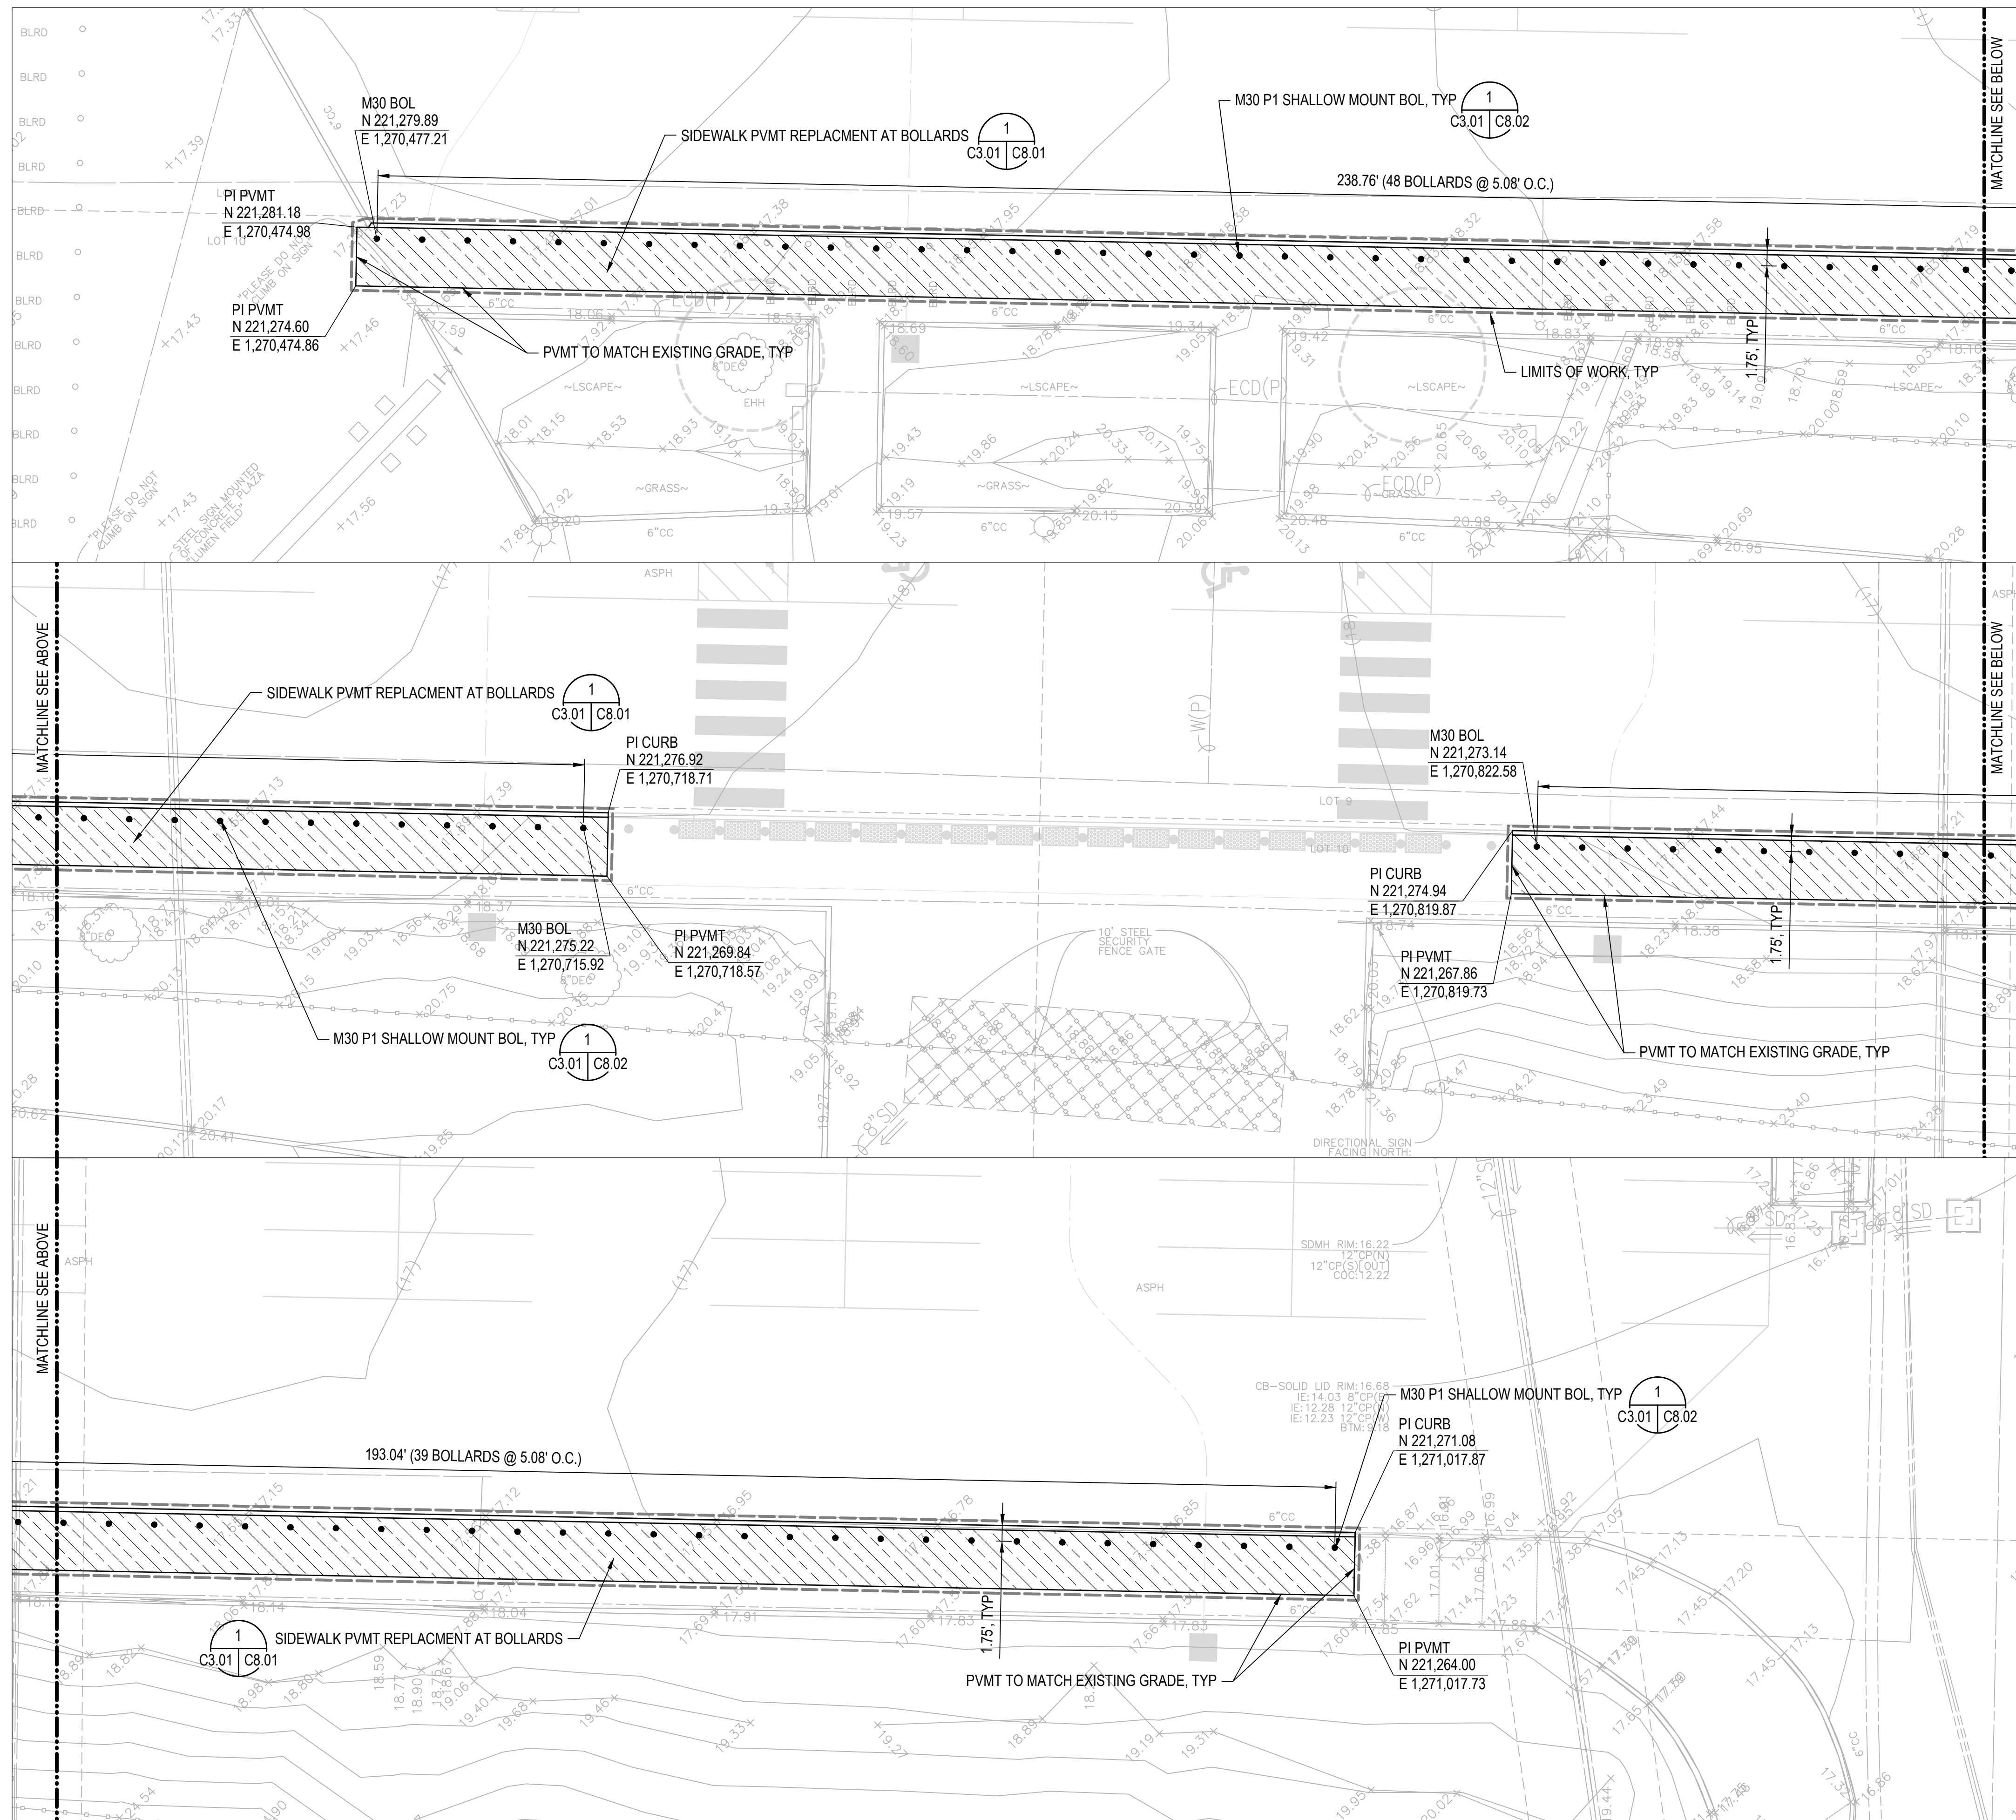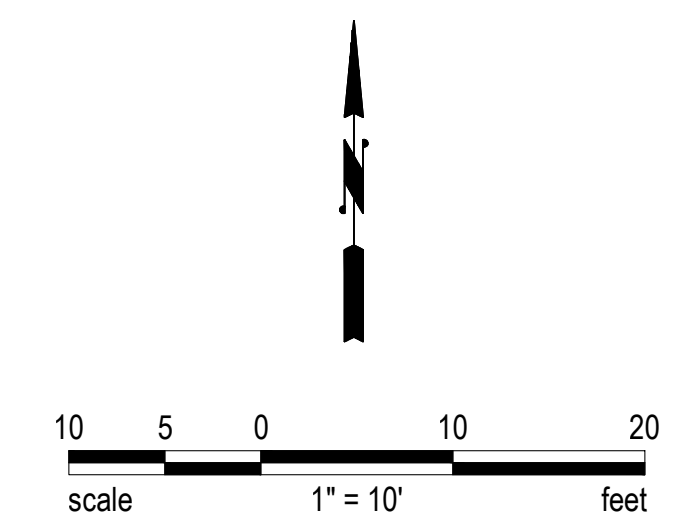

6/17/2025 1:07 PM USER: cjp PATH: J:\LumenFieldNorth\ofCiv\SECURITY PH2 (Previously PH1B)\C3.0X.dwg LAYOUT: ----

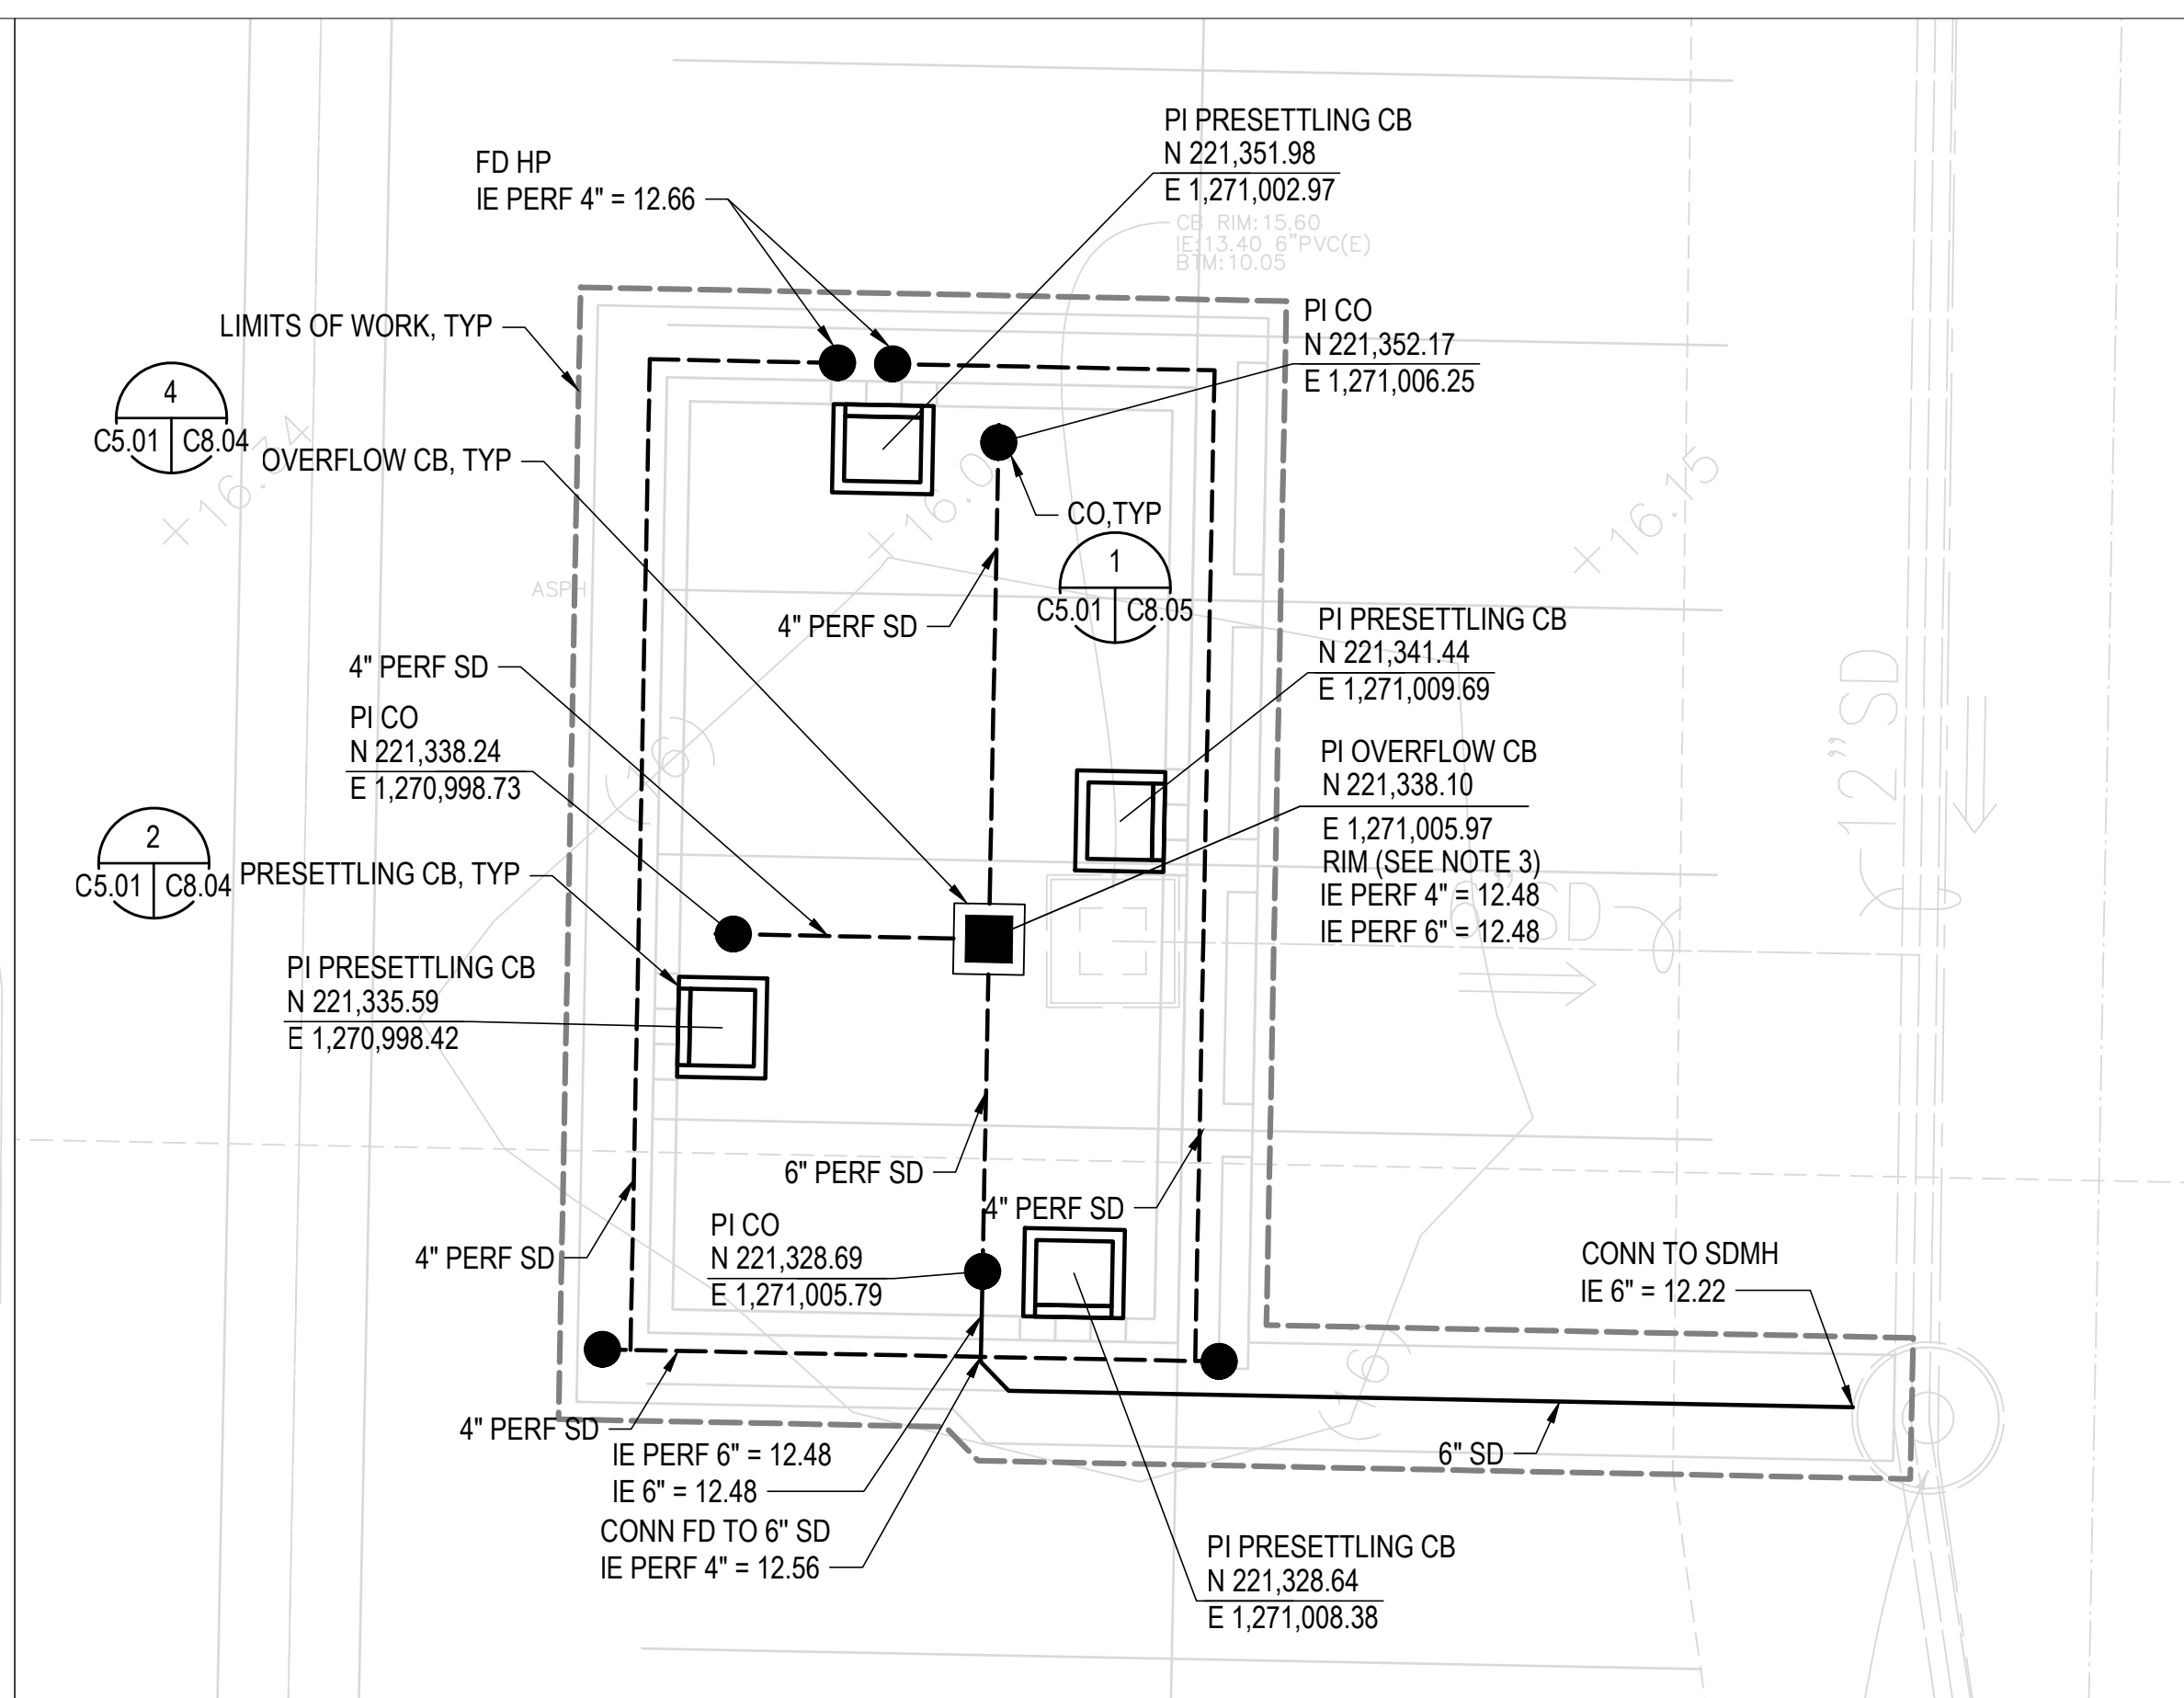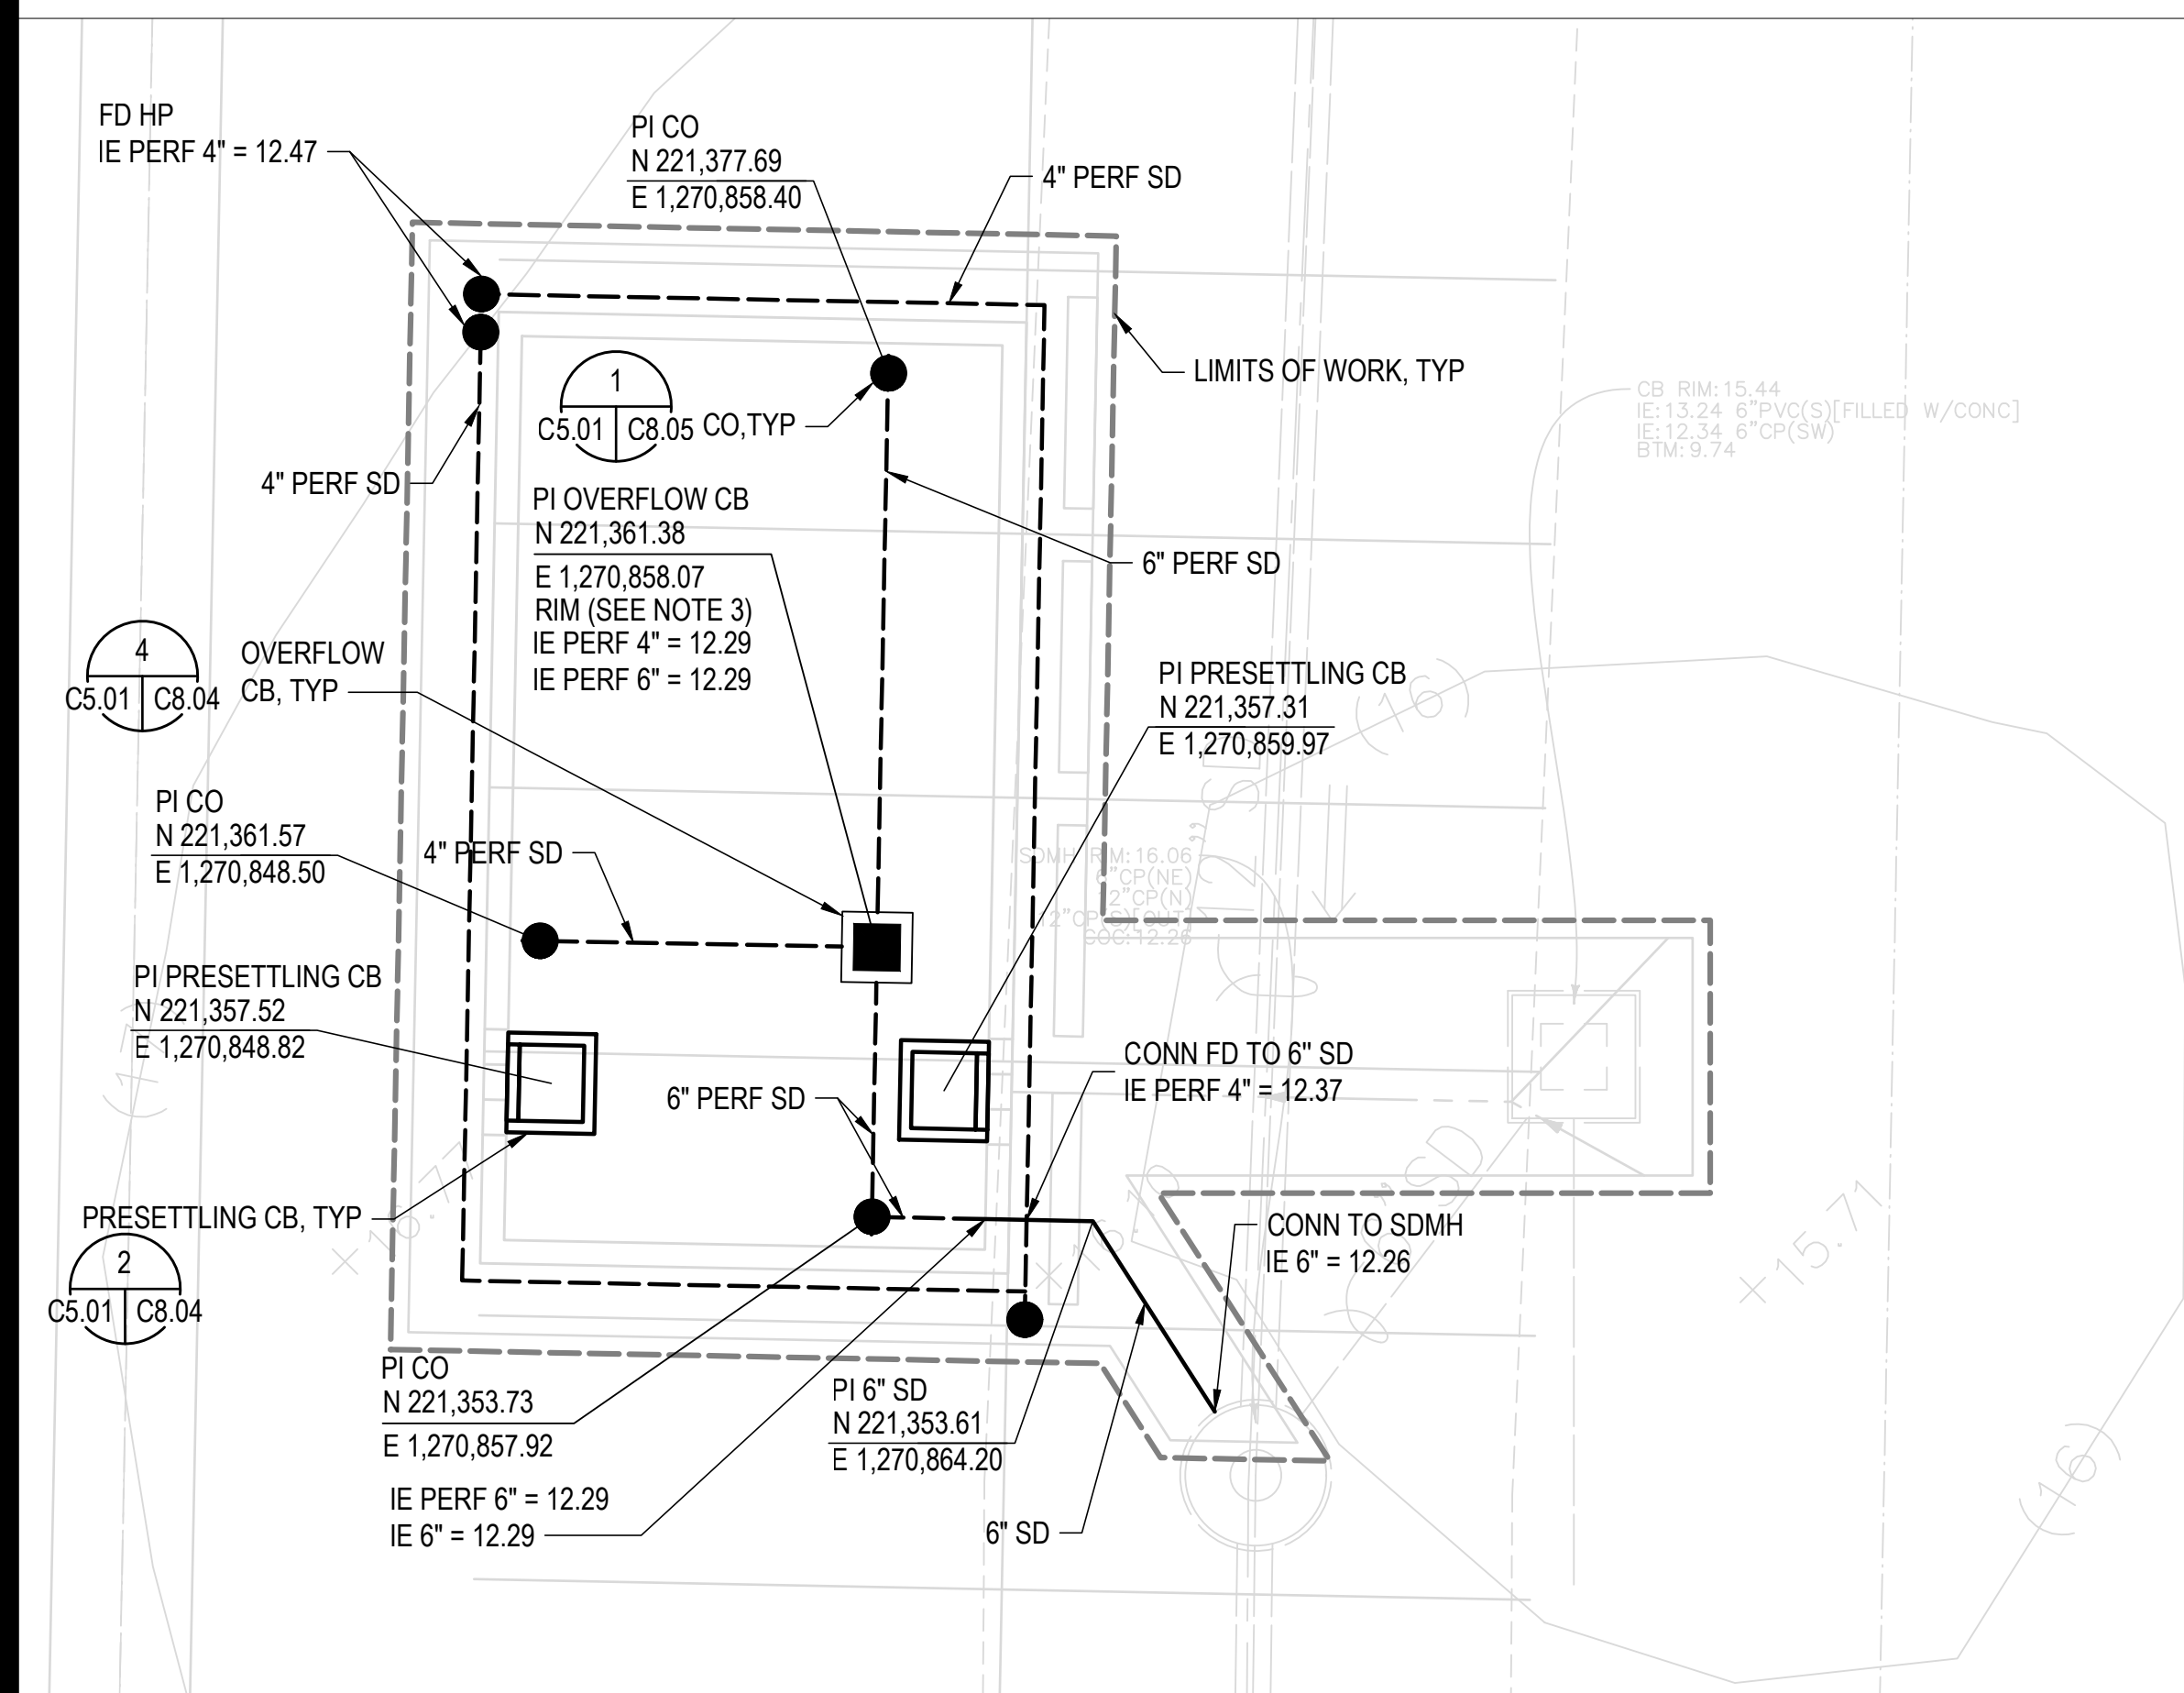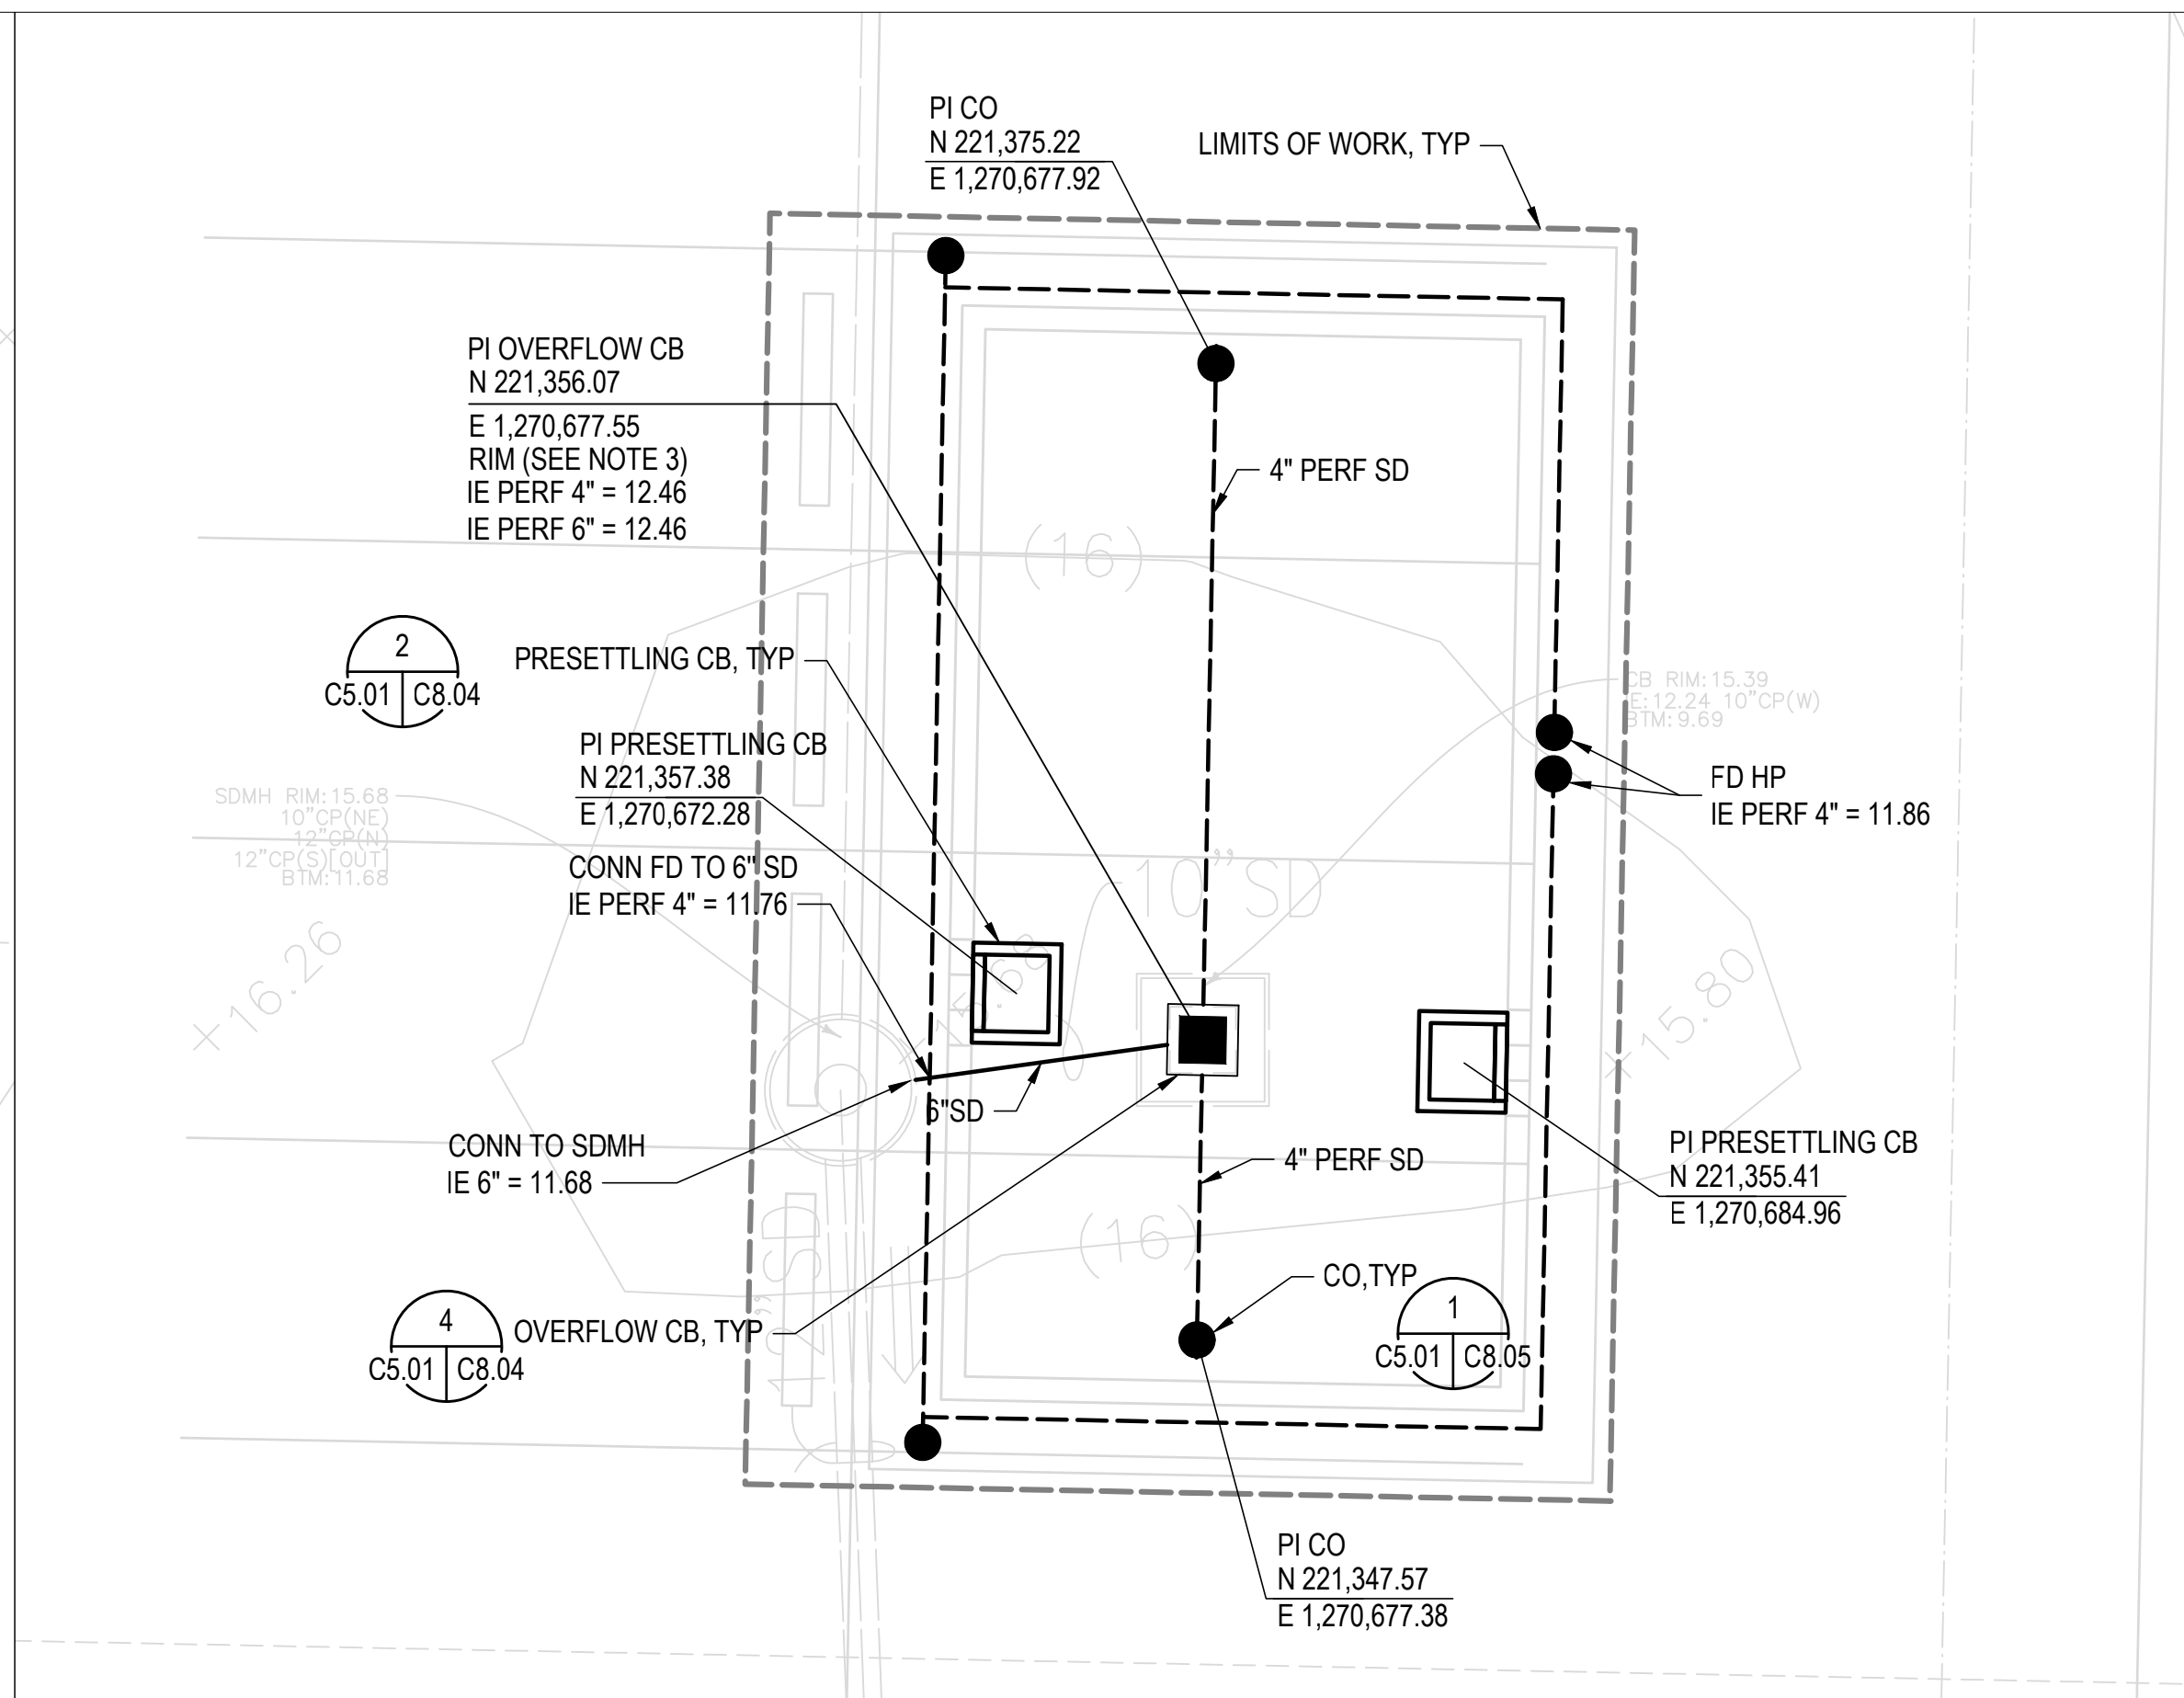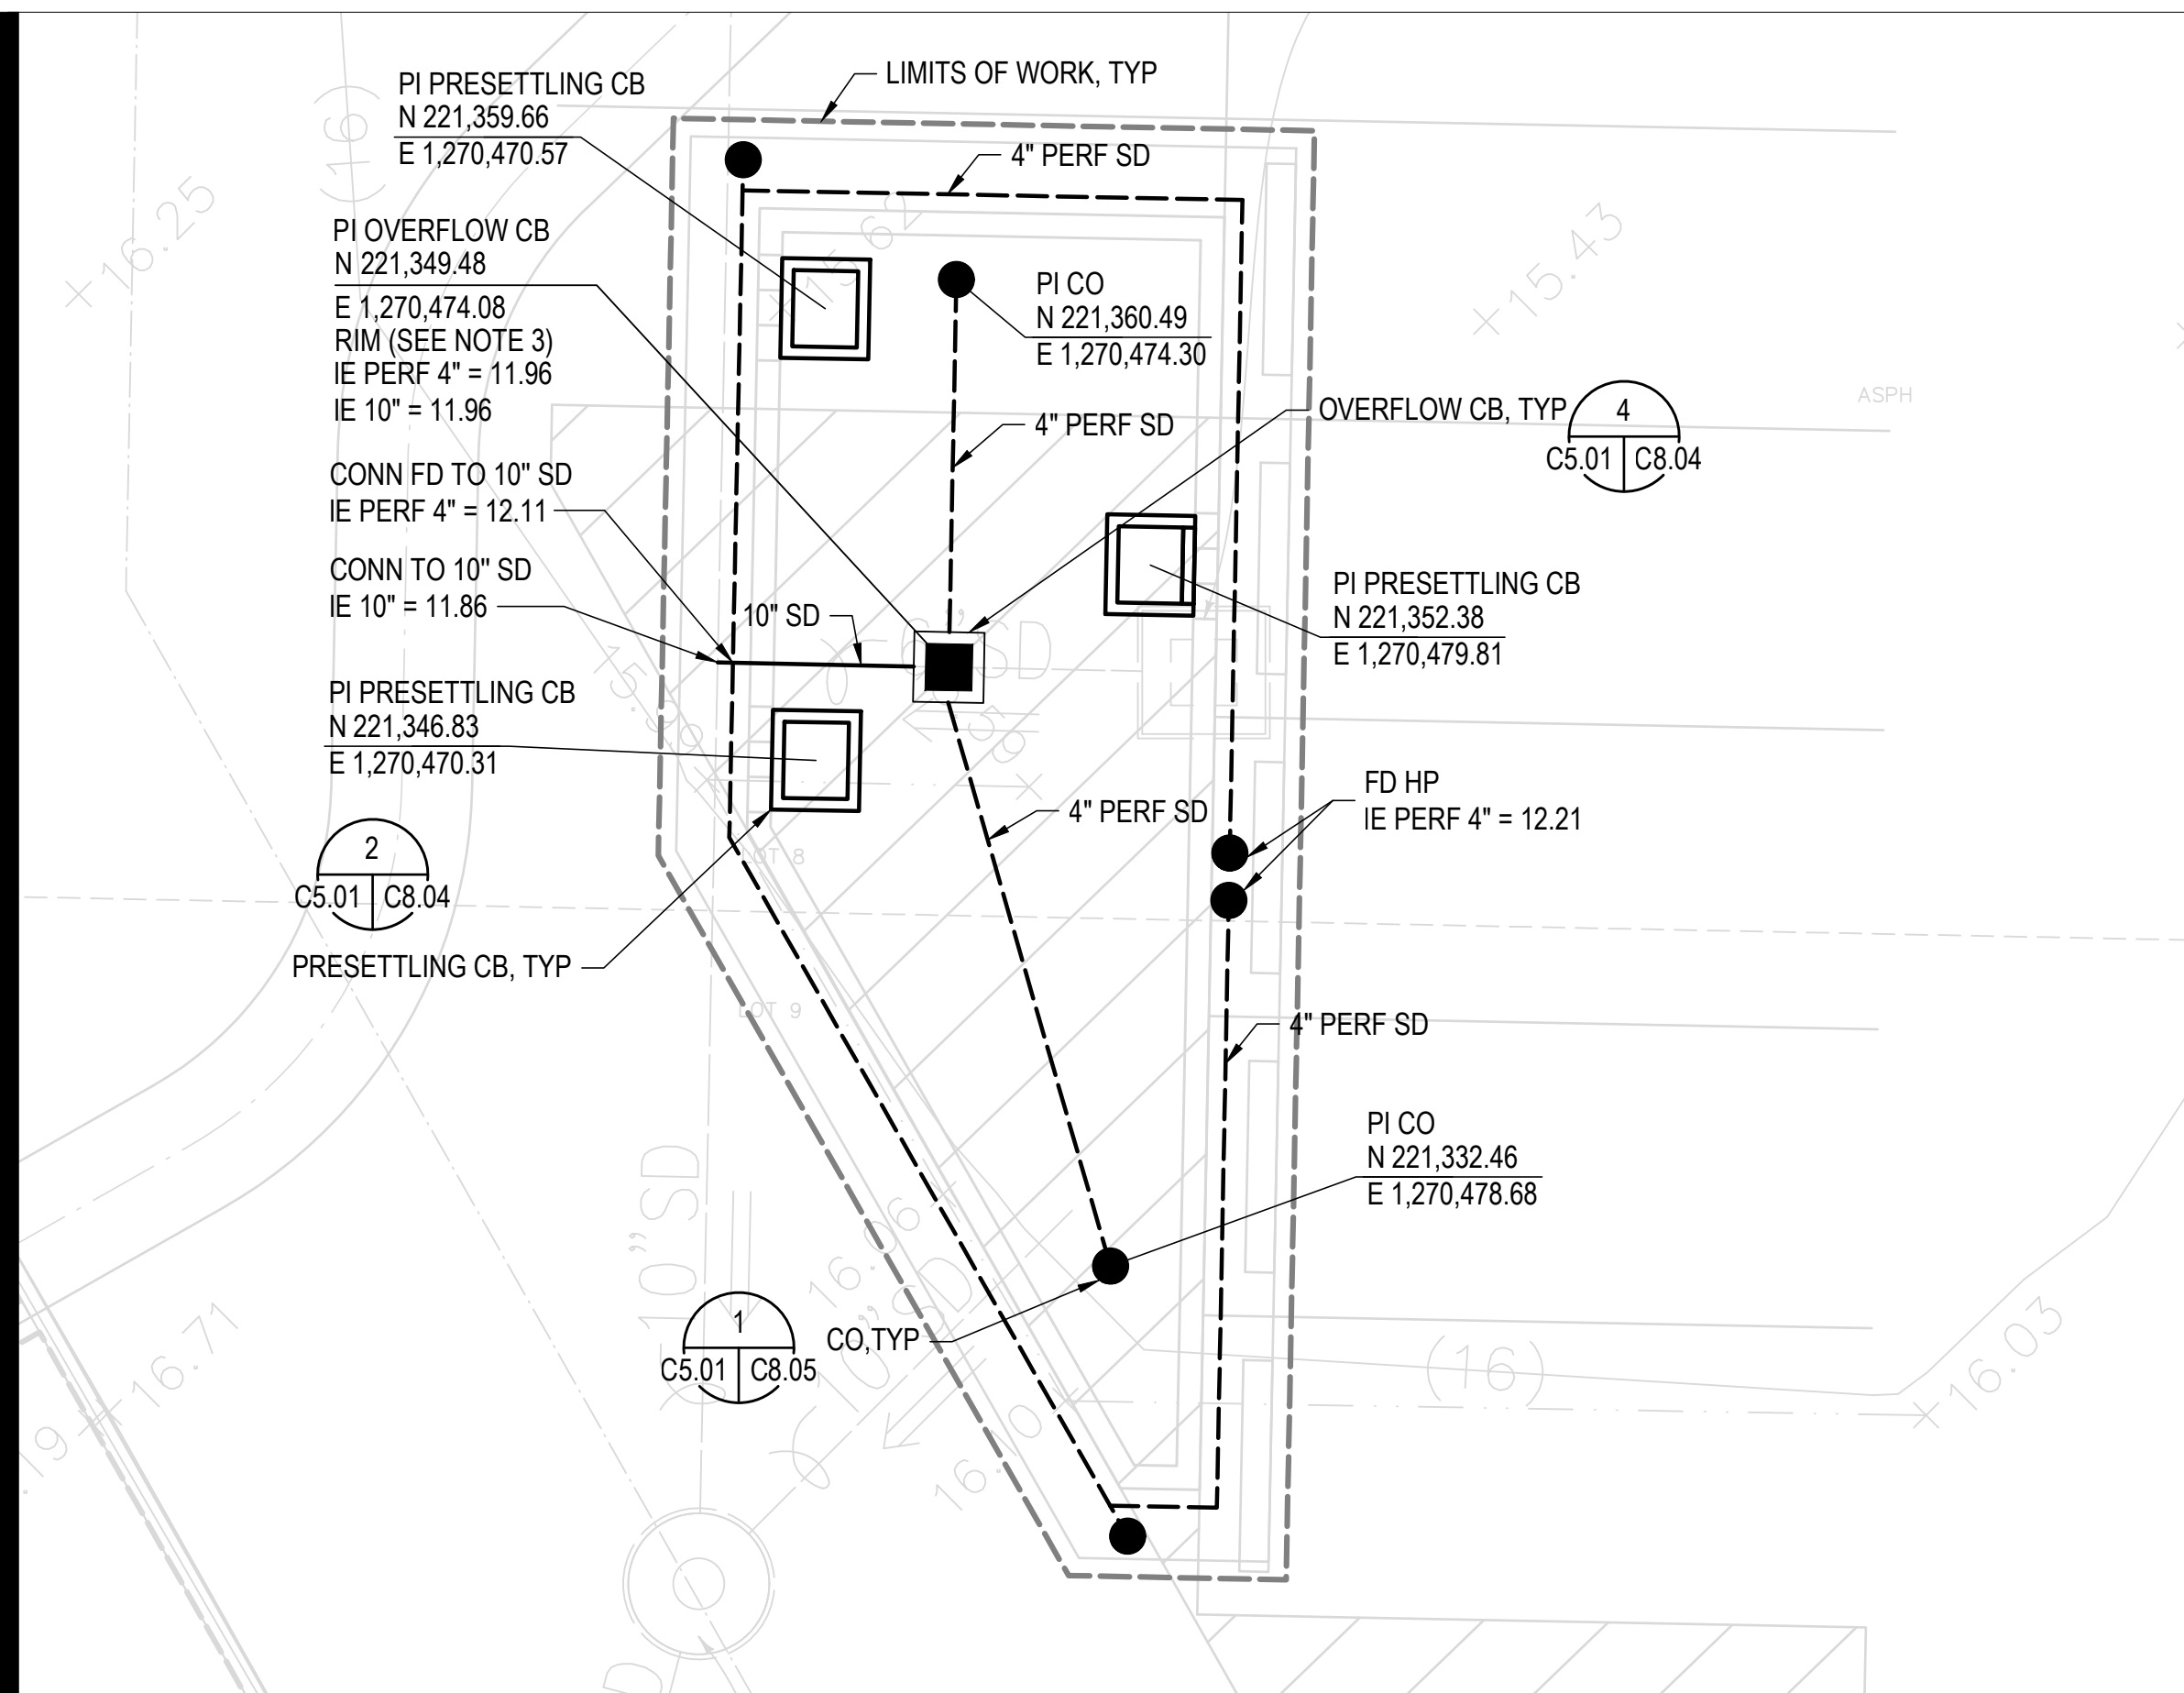


NOTES:

1. SEE SHEET C0.01 FOR GENERAL NOTES, LEGEND, AND ABBREVIATIONS.
2. SEE SHEET C0.02 FOR STORM DRAINAGE NOTES.
3. SEE DETAIL 1 ON SHEET C8.04 FOR OVERFLOW CB RIM ELEVATION.

LUMEN FIELD NORTH LOT

SECURITY PLAN - PHASE 2


FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134

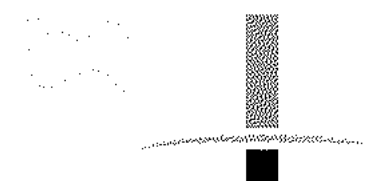

MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

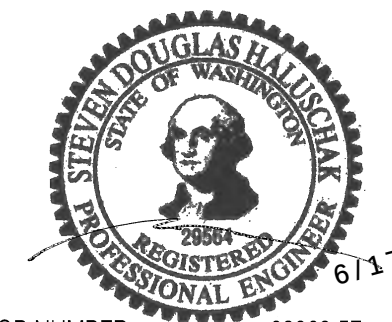


JOB NUMBER: 63069.57

NO.	DATE	DESCRIPTION
DRAWN BY:	MKA	
DESIGNED BY:	BMN	
CHECKED BY:	SDH	
DATE:	JUNE 17, 2025	

STORM DRAINAGE PLAN - AREAS A, B, C, AND D


SHEET 8 OF 14

C5.01

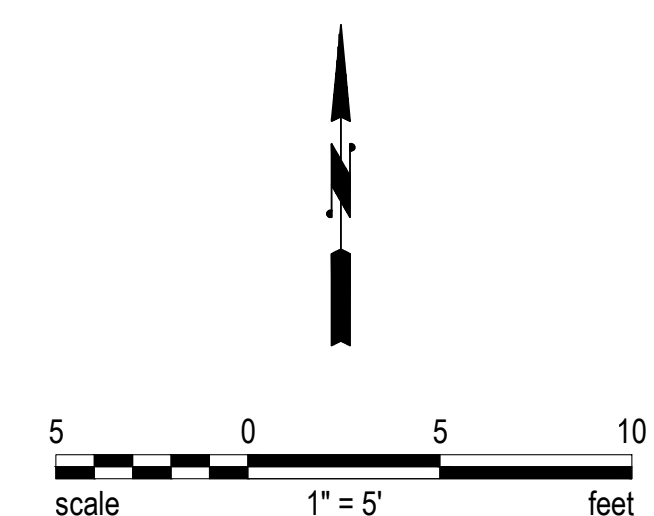


JOB NUMBER: 63069.57





DATE: JUNE 17, 2025

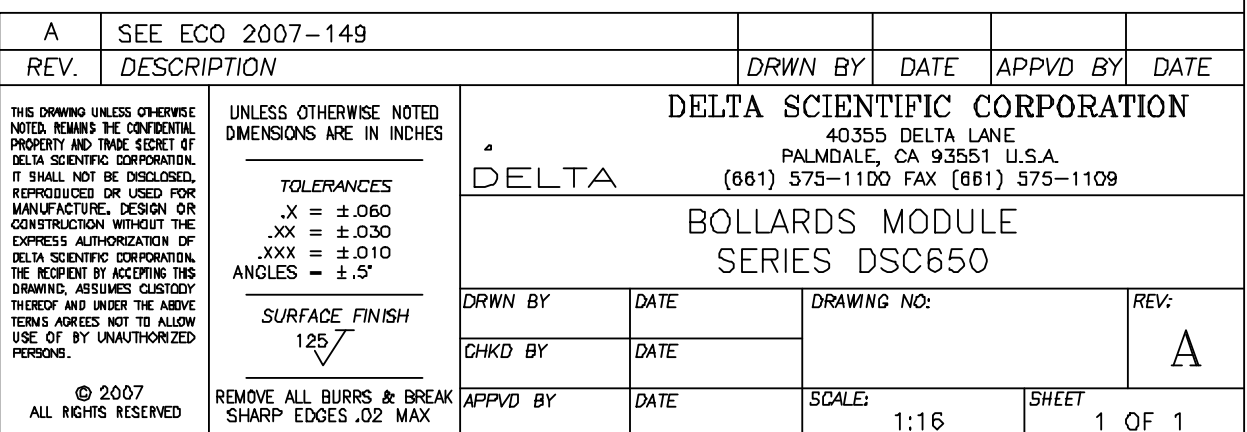

6/7/2025 1:05 PM USER: op PATH: \\LumenField\NorthLot\SECURITY PH2 (Previously PHB)\C8.03.dwg LAYOUT: -----

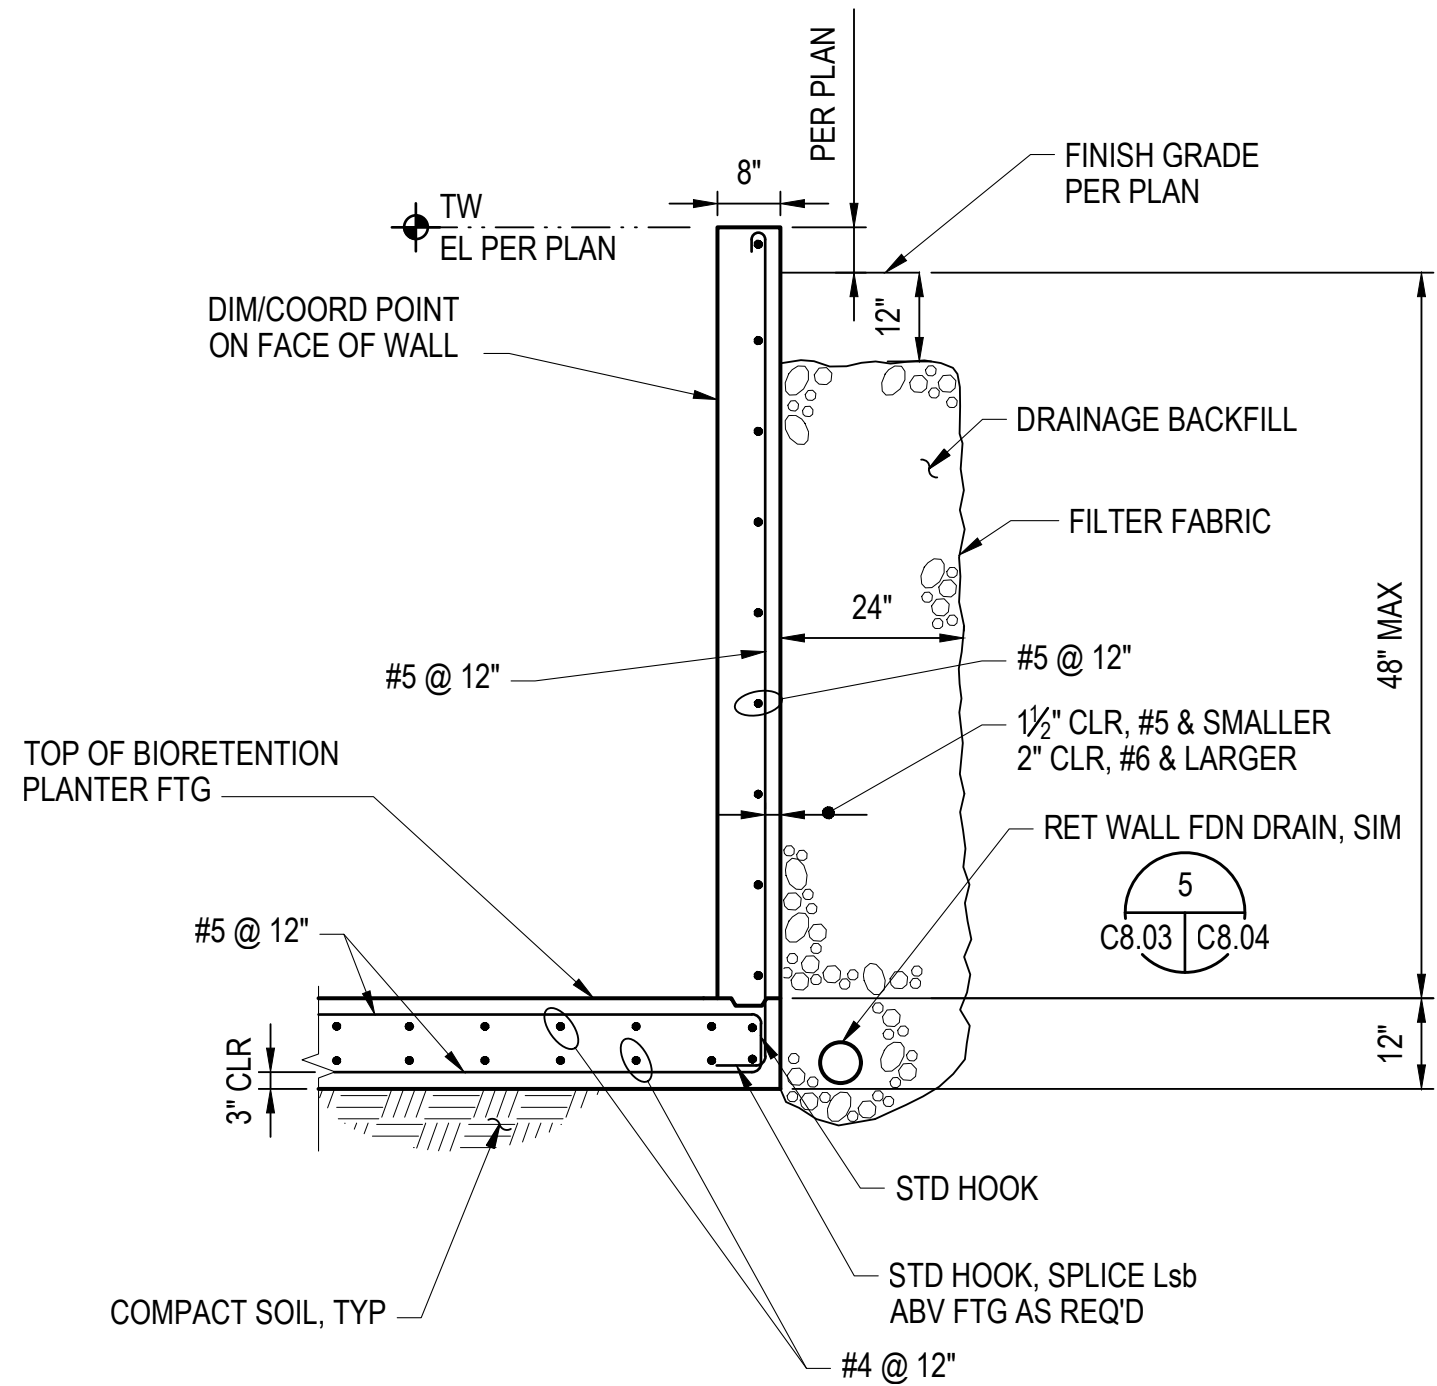


NOTES:

1. INSTALL SLEEVES FOR UTILITIES PER STRUCTURAL DRAWINGS AS REQUIRED.
2. SEE DETAIL  FOR TYPICAL REINFORCING DETAIL.
3. PROVIDE WEAKENED PLANE (CONTRACTION) JOINTS AT 20 FEET ON CENTER MAXIMUM. SEE DETAIL  FOR JOINT LAYOUT INFORMATION.
4. SEE DETAIL  FOR WEAKENED PLANE (CONTRACTION) JOINT. DIMENSIONS AND REINFORCEMENT.
5. WHERE NOT INDICATED OTHERWISE, PROVIDE WALL CORNER REINFORCEMENT IN ACCORDANCE WITH DETAIL .



PLANTER RETAINING WALL

NTS




JOINT LAYOUT DETAIL

NTS

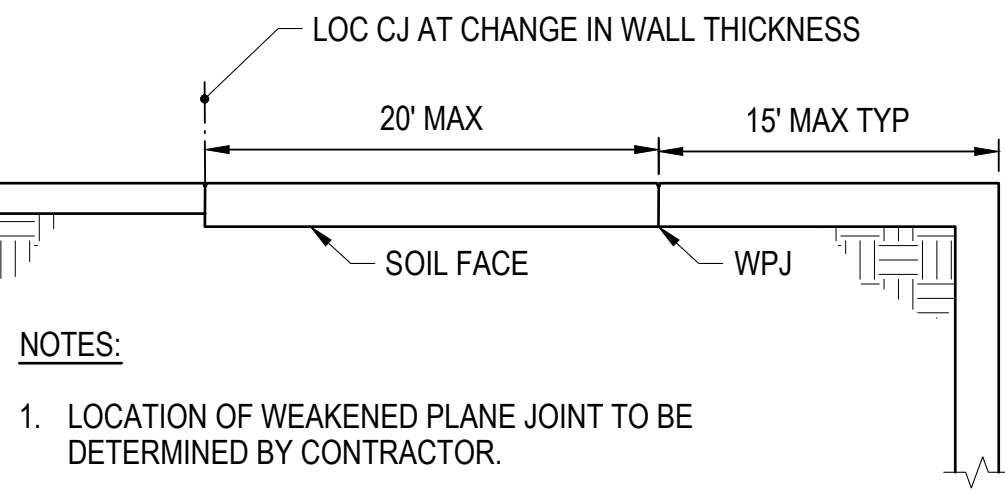



NOTES:

1. LOCATION OF WEAKENED PLANE JOINT TO BE DETERMINED BY CONTRACTOR.
2. COORDINATE LOCATION OF WEAKENED PLANE JOINTS WITH CONSTRUCTION JOINTS.
3. LAYOUT SUBJECT TO REVIEW AND APPROVAL BY ARCHITECT & ENGINEER.

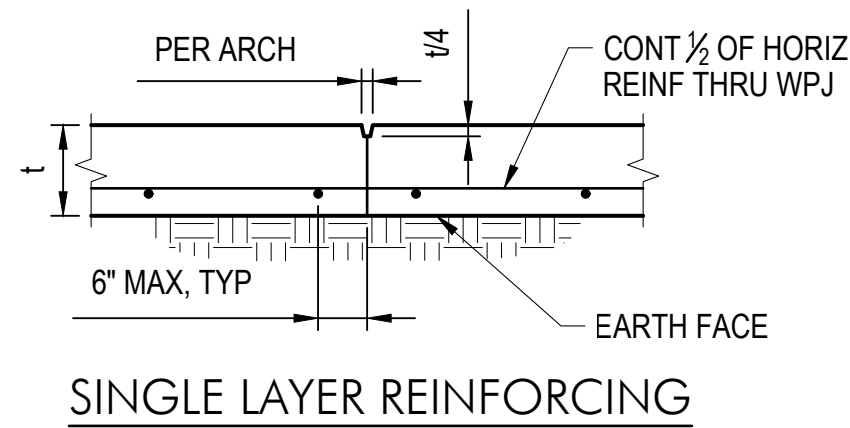



WEAKENED PLANE JOINT (WPJ) REINFORCEMENT

NTS

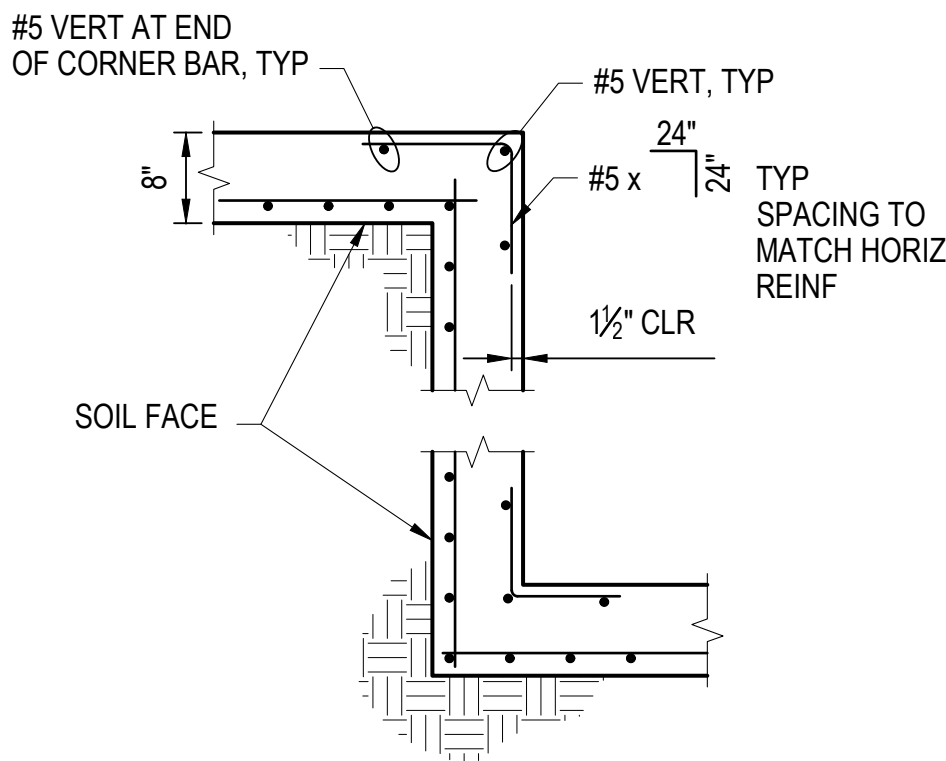

WALL CORNER REINFORCEMENT

NTS

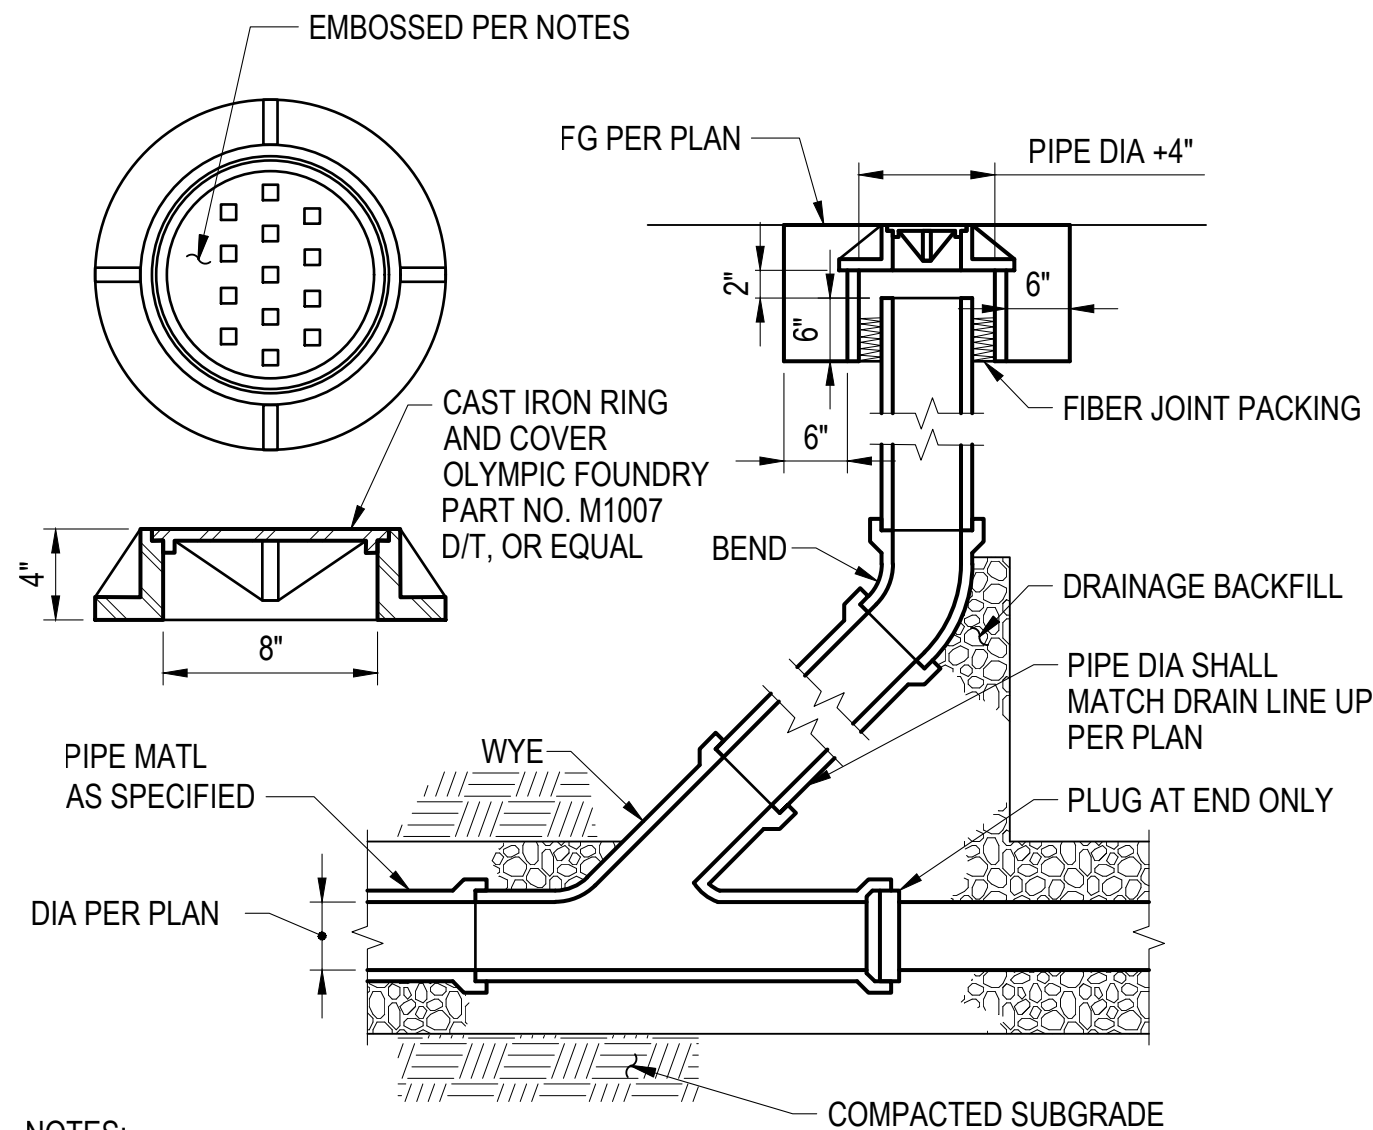


NOTES:

1. STORM DRAIN SHALL HAVE "SD" EMBOSSED ON LID.
2. FOUNDATION DRAIN SHALL HAVE "FD" EMBOSSED ON LID.

CLEANOUT

NTS



LUMEN FIELD NORTH LOT


SECURITY PLAN - PHASE 2

FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134

MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

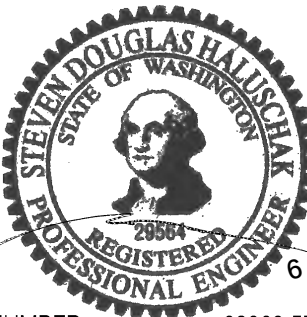

JOB NUMBER: 63069.57

NO.	DATE	DESCRIPTION

DRAWN BY: MKA

DESIGNED BY: BMN


CHECKED BY: SDH

DATE: JUNE 17, 2025

SECTIONS AND DETAILS


SHEET 11 OF 14

C8.03

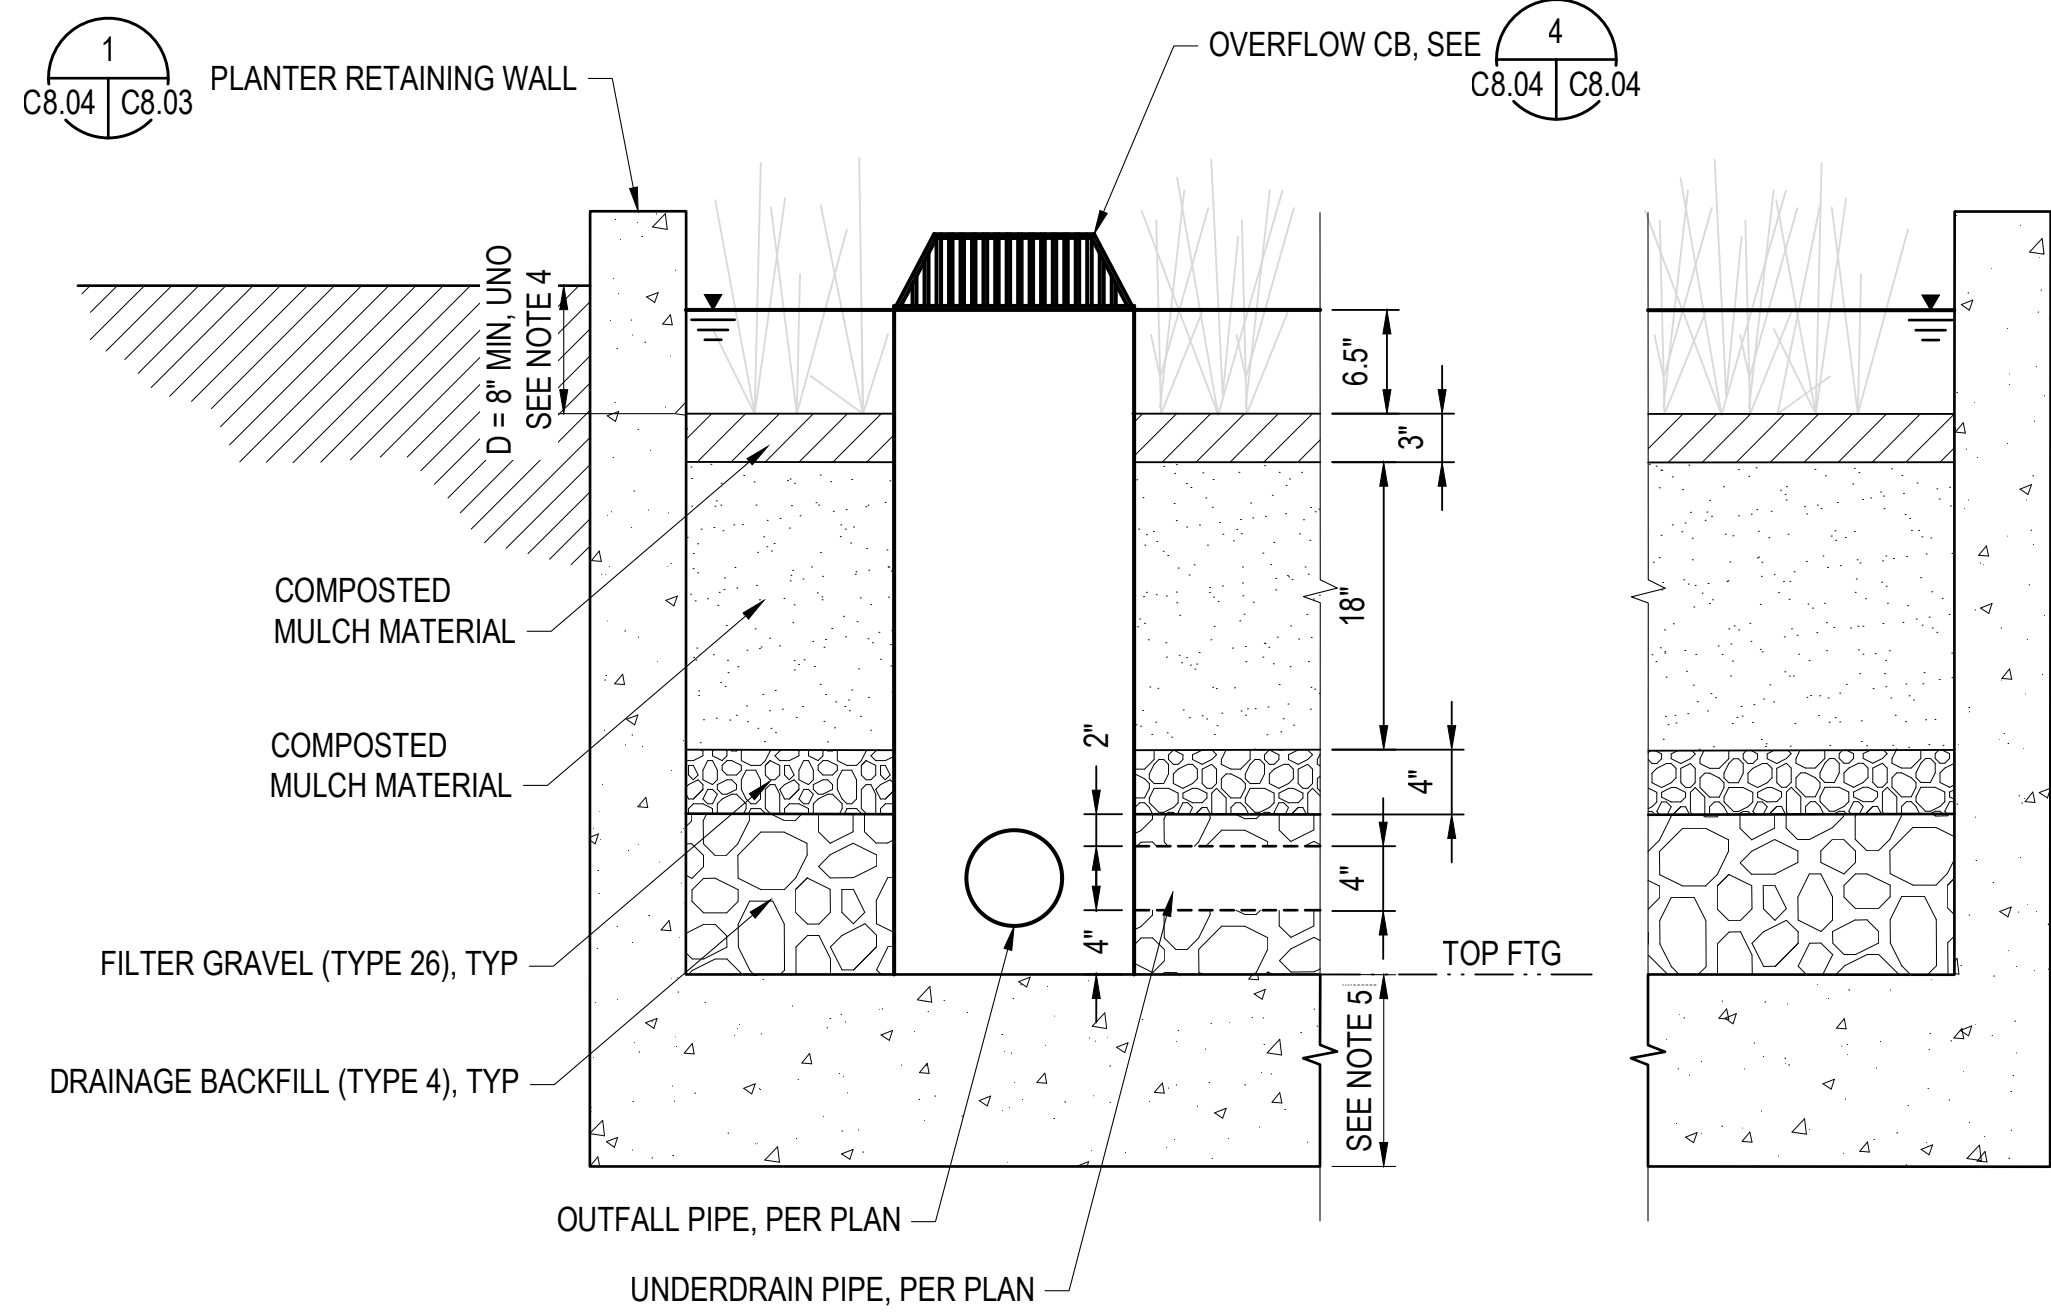


BIORETENTION PLANTER
NTS

- NOTES:
- BIORETENTION FACILITIES SHALL CONFORM TO LANDSCAPE ARCHITECT SPECIFICATIONS AND THESE NOTES. ALL MATERIALS INDICATED IN SUBSEQUENT NOTES SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR REVIEW PRIOR TO INSTALLATION.
 - MULCH FOR BOTTOM OF FACILITY (BELOW OVERFLOW RISER) SHALL BE COMPOST MULCH PER CITY OF SEATTLE STANDARD SPECIFICATION 9-14.4(8)6B. MULCH SHALL BE WELL AGED, UNIFORM IN COLOR, AND FREE OF FOREIGN MATERIAL INCLUDING PLANT MATERIAL. WELL AGED MULCH IS DEFINED AS MULCH THAT HAS BEEN STOCKPILED OR STORED FOR AT LEAST TWELVE (12) MONTHS.
 - BIORETENTION SOIL MIXTURE SHALL COMPLY WITH THE CITY OF SEATTLE STANDARD SPECIFICATION 7-21, AND SHALL HAVE A LONG-TERM INFILTRATION RATE OF 2 INCHES/HOUR.
 - DEPTH (D) AT AREA C SHALL BE A MINIMUM OF 6-1/2 INCHES.
 - FOOTING DEPTH PER PLANTER RETAINING WALL DETAIL 2/C8.03.
 - PERFORATED PIPE SHALL BE SLOTTED PIPE PER CITY OF SEATTLE STANDARD PLAN 291.

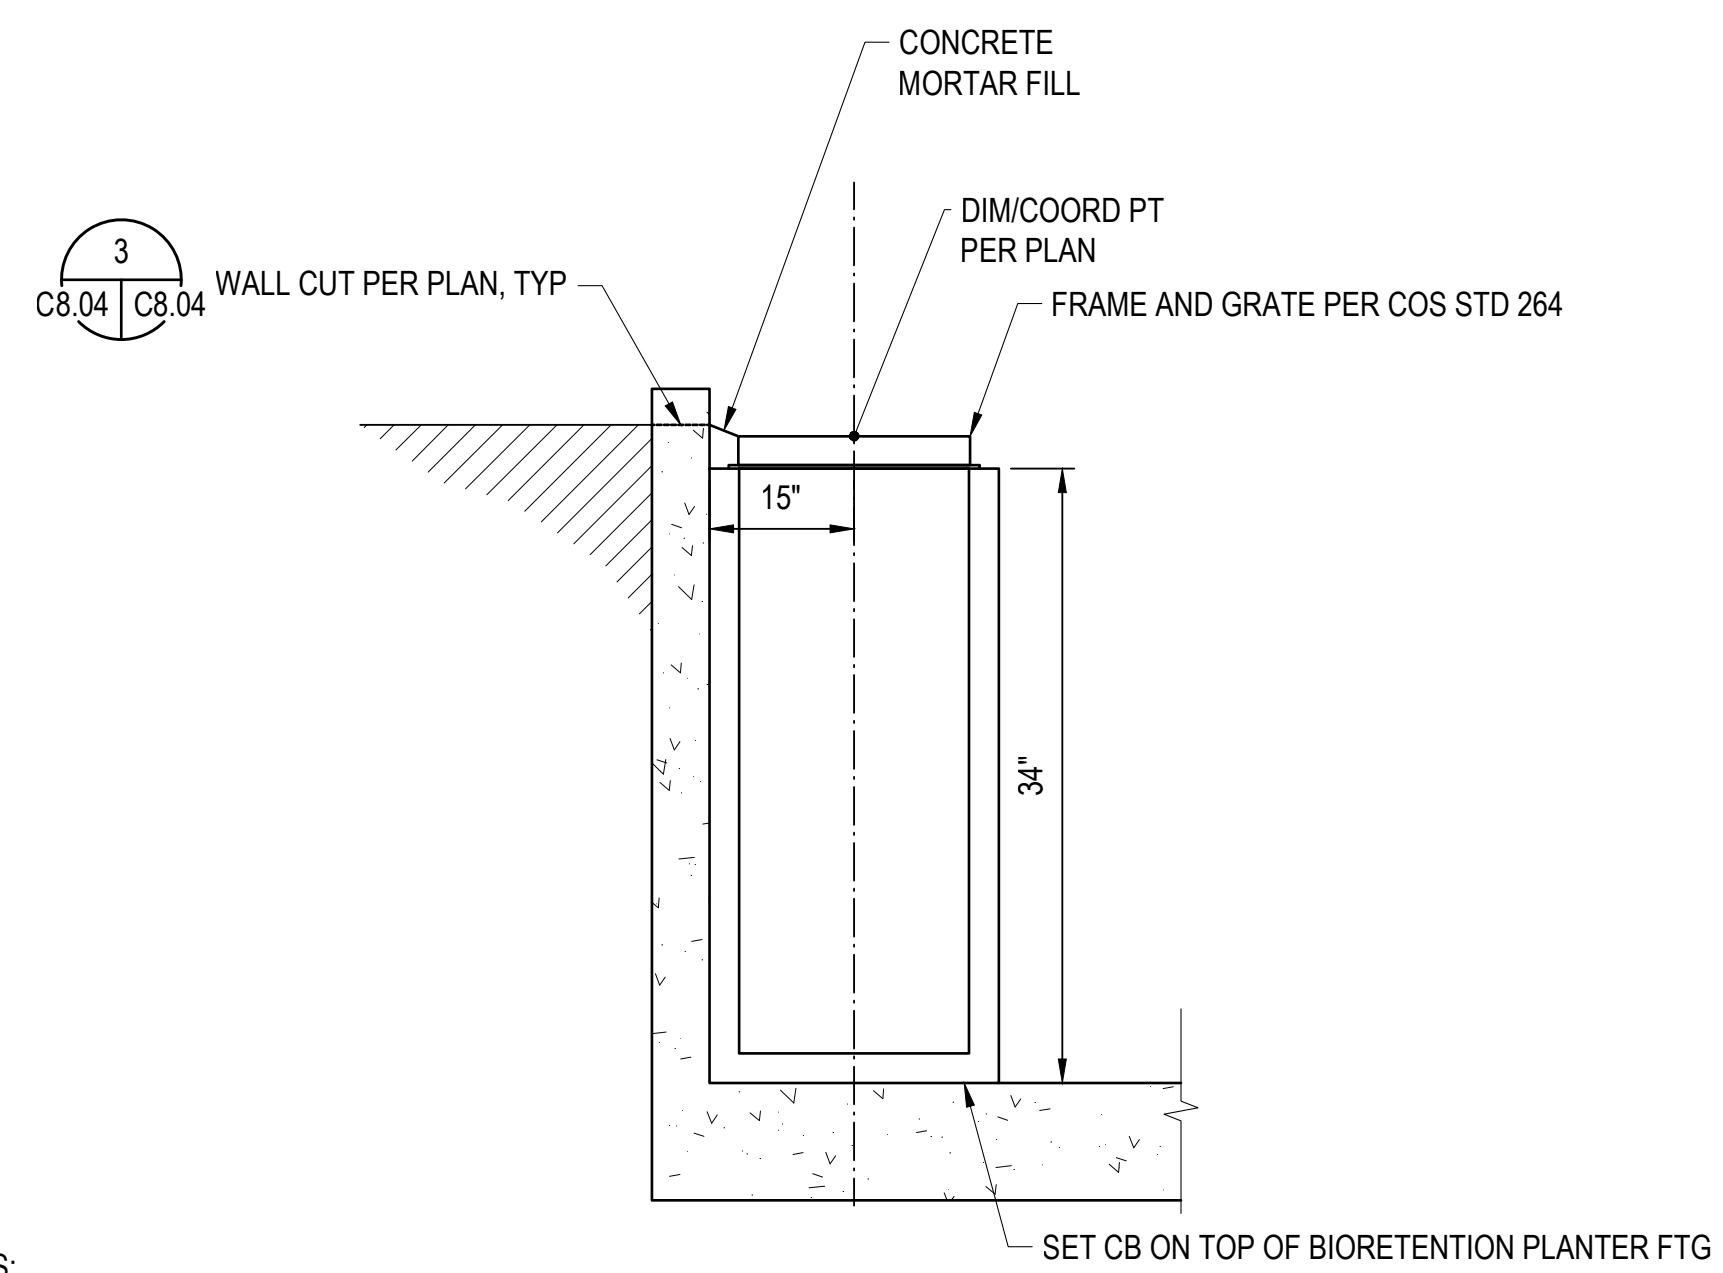


- NOTES:
- PRESETTLING CATCH BASIN SHALL BE TYPE 15 CB WITH NO RISER.

PRESETTLING CATCH BASIN
NTS

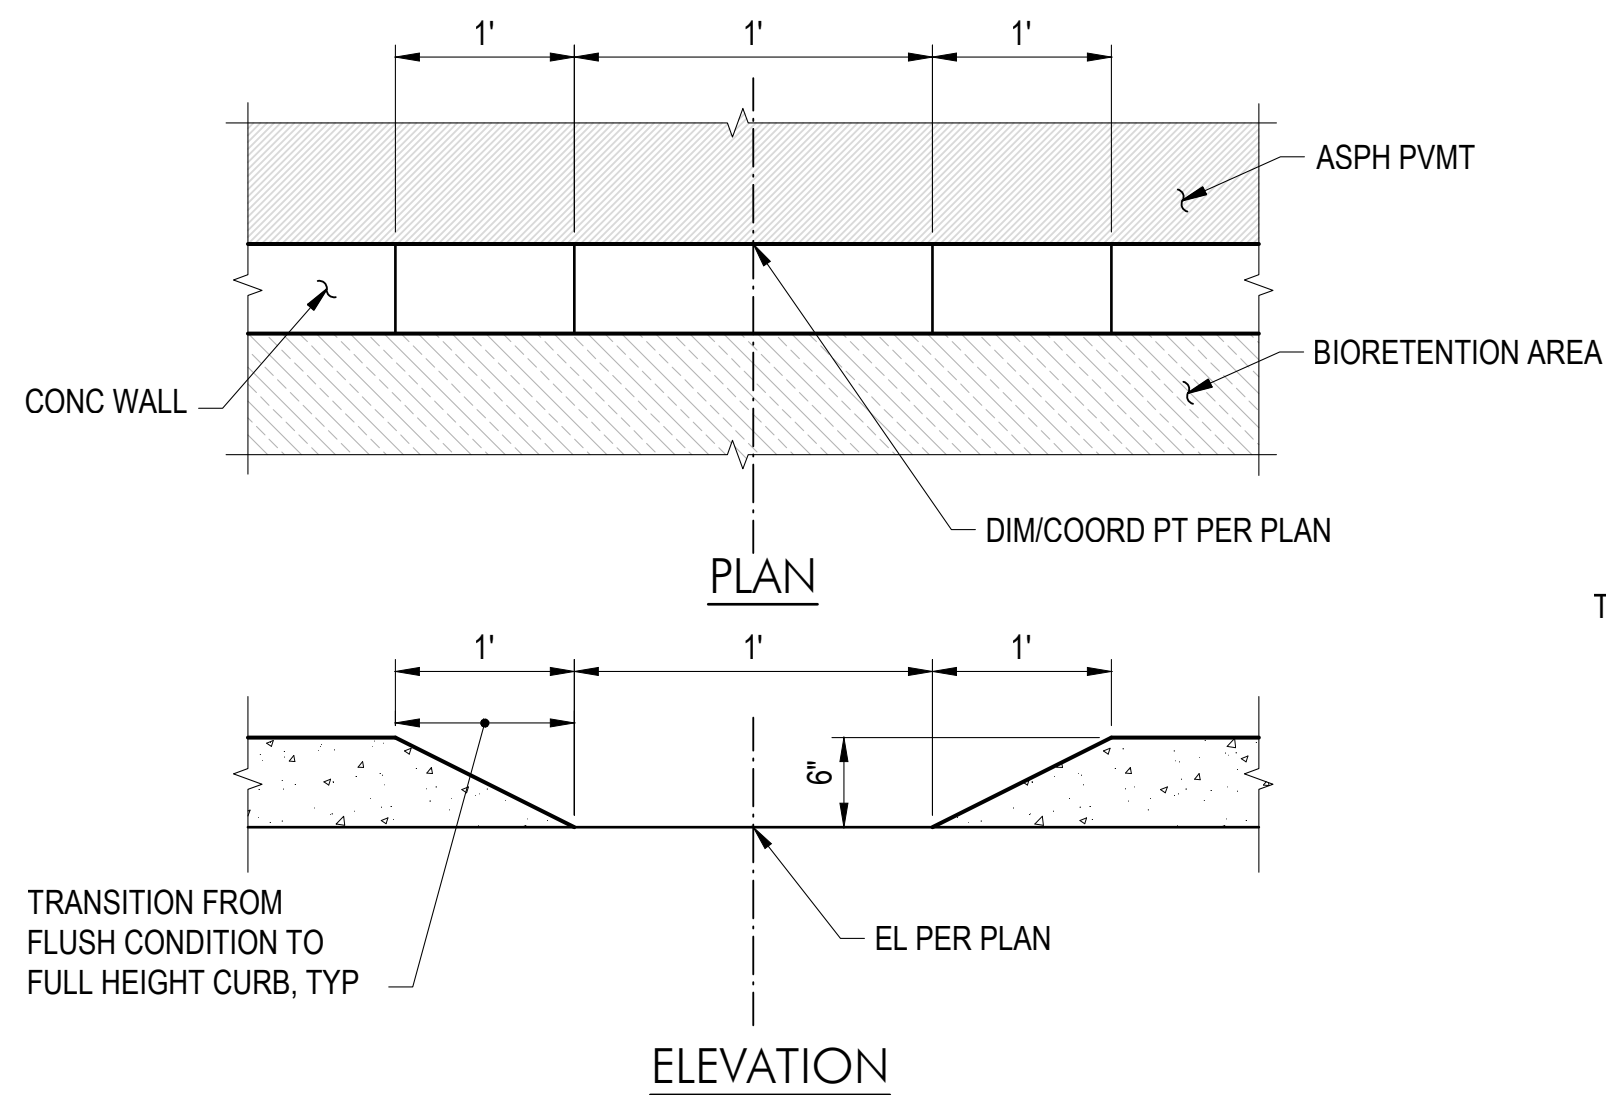


WALL CUT
NTS

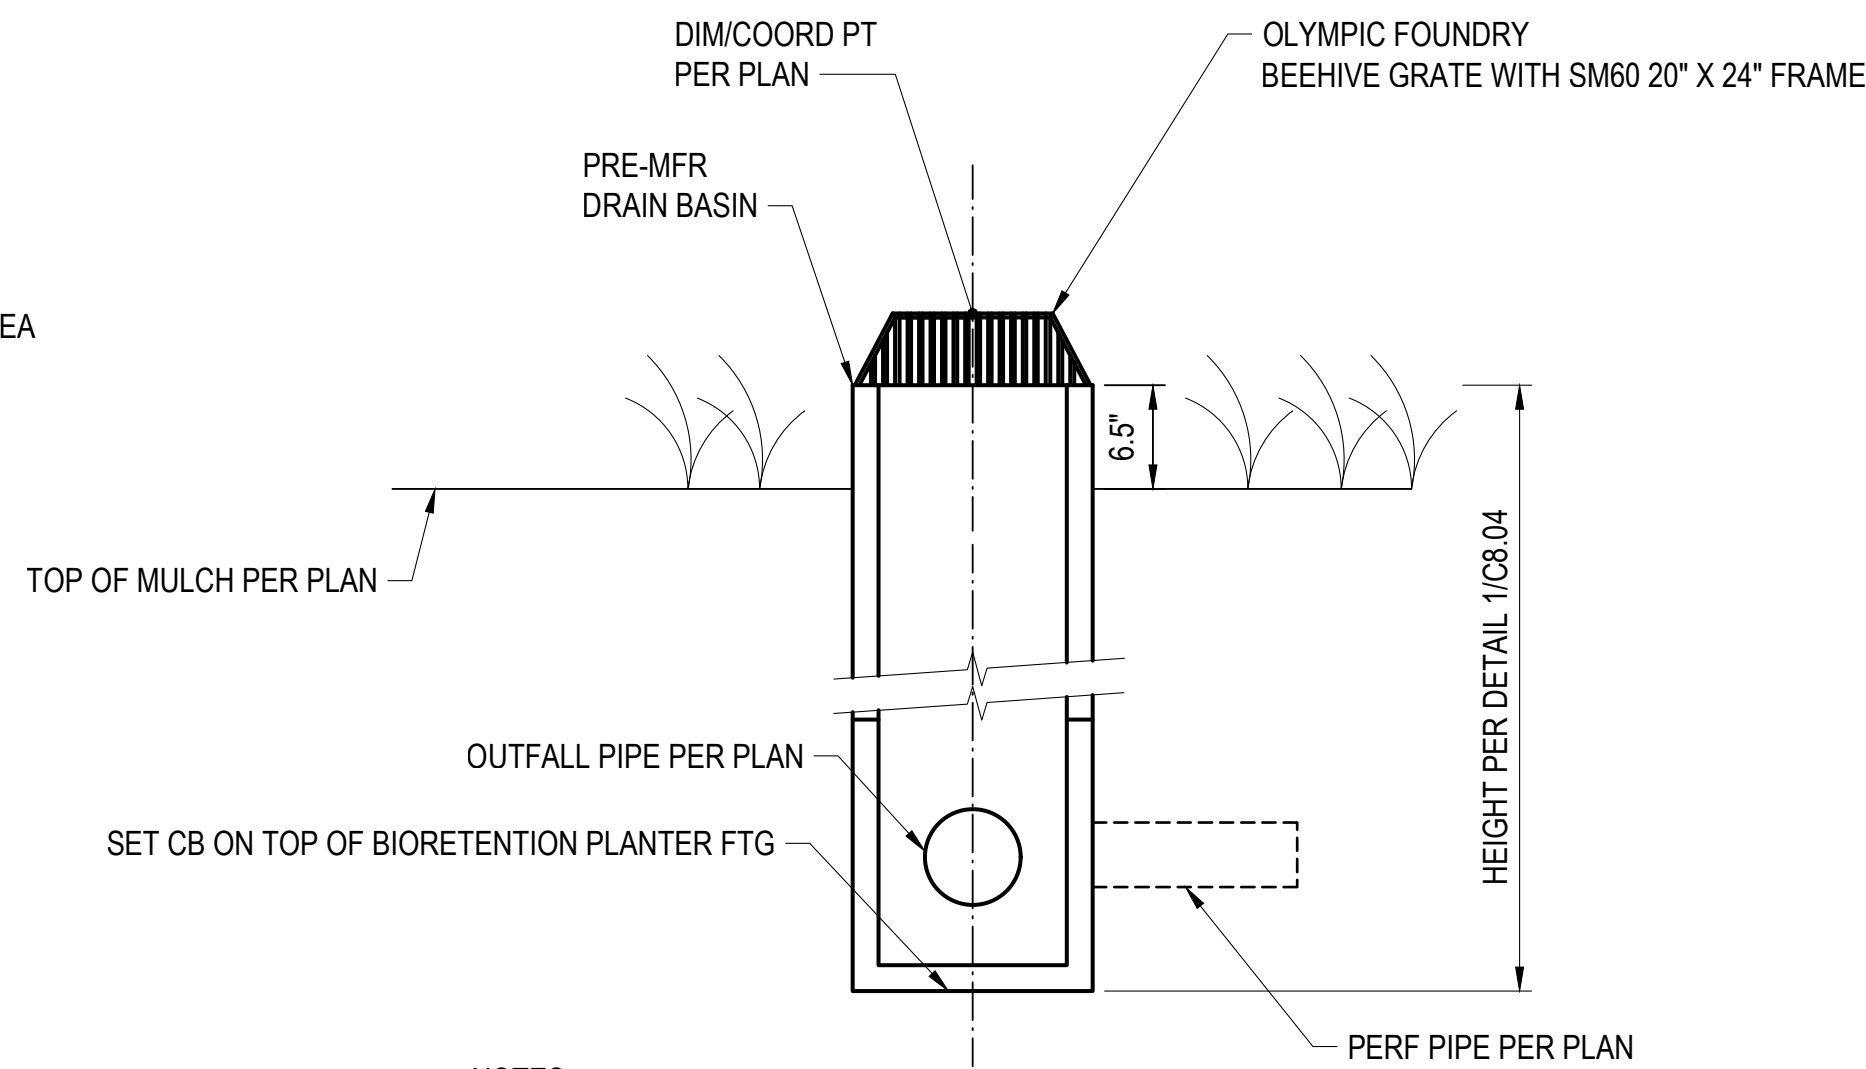

- NOTES:
- OVERFLOW CATCH BASIN SHALL BE TYPE 26 CB WITH 12" RISER.

OVERFLOW CATCH BASIN
NTS

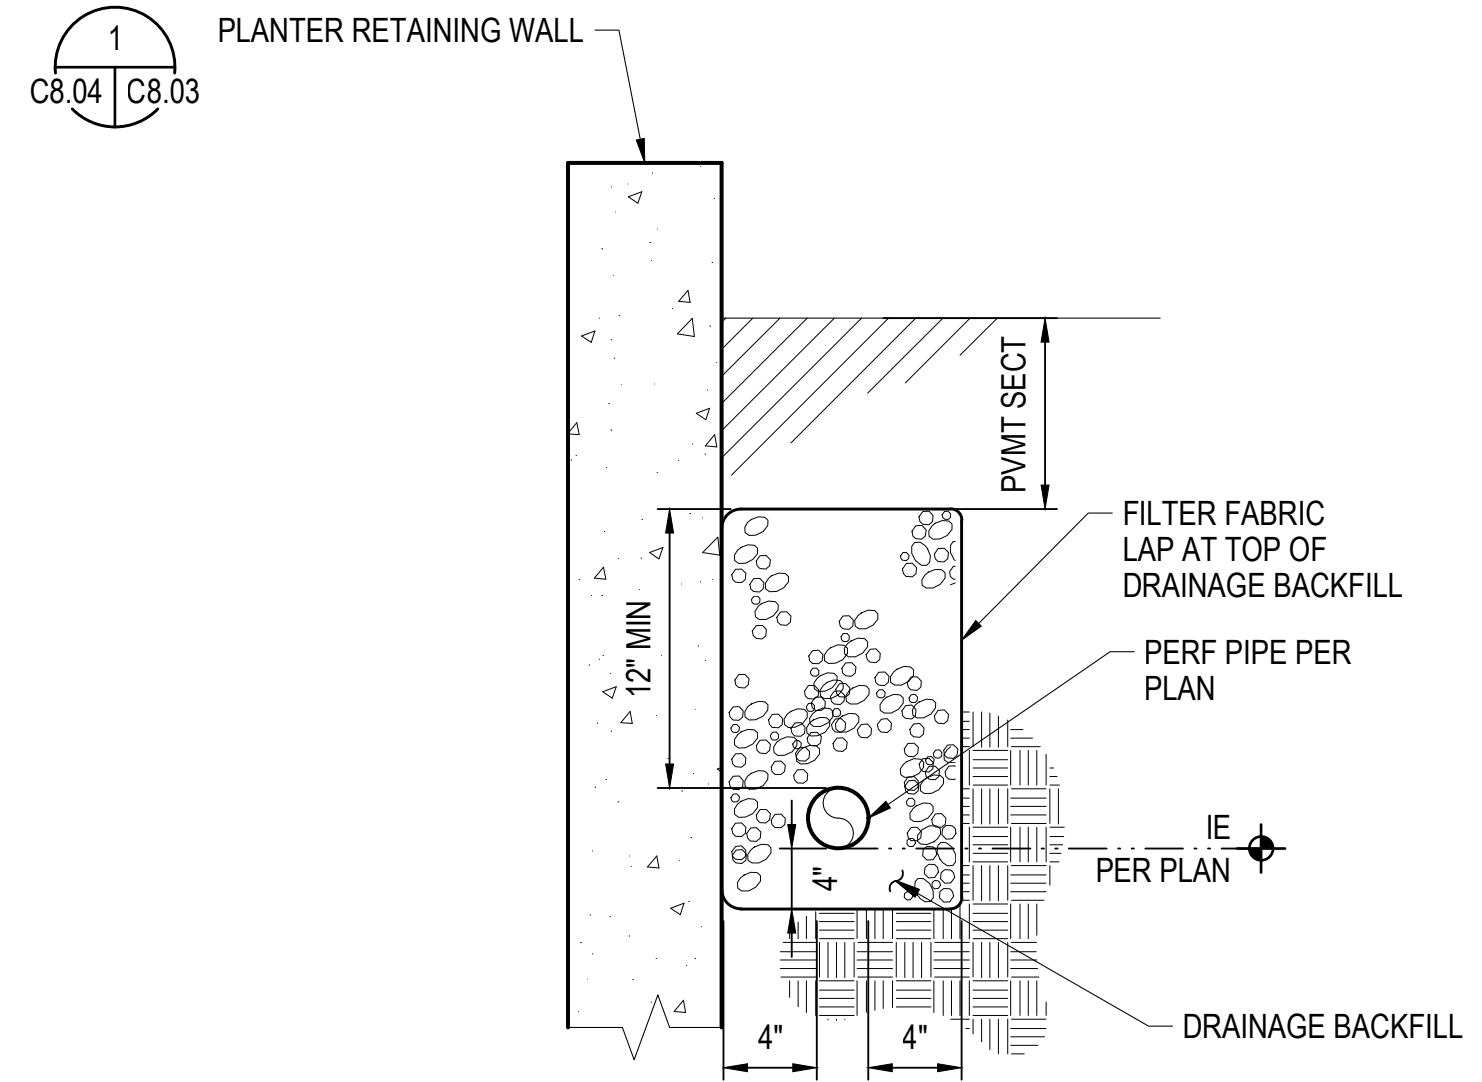

- NOTES:
- HORIZONTAL BENDS BETWEEN CLEANOUTS AND PIPE SERVED BY DOWNSTREAM CLEANOUT SHALL NOT EXCEED 90 DEGREES.

RETAINING WALL FOUNDATION DRAIN
NTS

LUMEN FIELD NORTH LOT


SECURITY PLAN - PHASE 2

FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134

MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

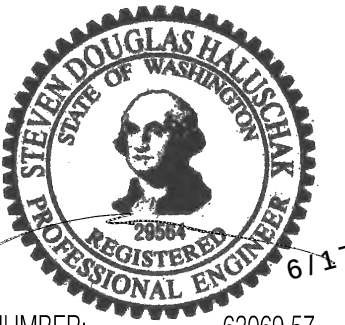


JOB NUMBER: 63089.57

NO.	DATE	DESCRIPTION
DRAWN BY:	MKA	
DESIGNED BY:	BMN	
CHECKED BY:	SDH	
DATE:	JUNE 17, 2025	

SECTIONS AND DETAILS


SHEET 12 OF 14

C8.04

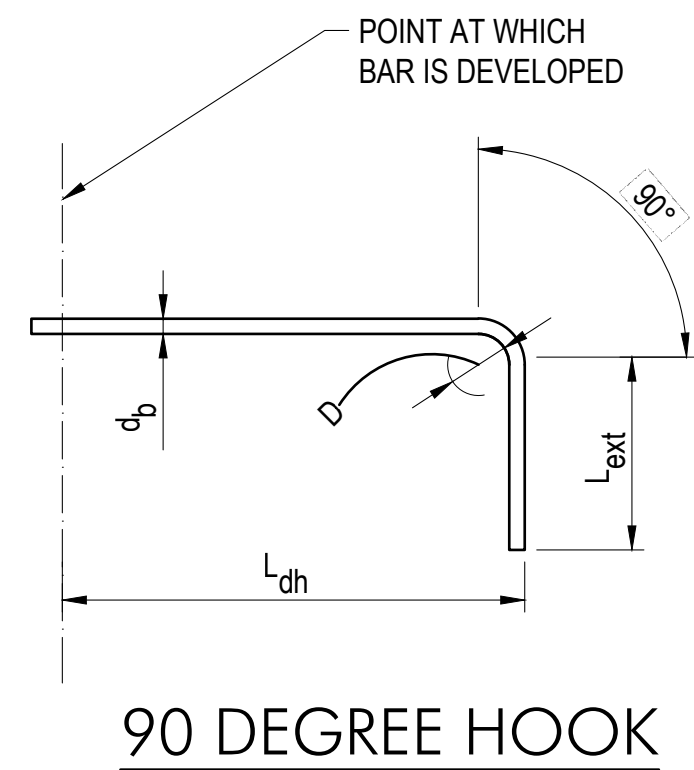

STANDARD HOOK			
ALL GRADES (D) FINISHED BEND DIAMETER			
BAR SIZE	D	90° HOOKS	180° HOOKS
		Left	Left
#3	2.25	4.5	2.5
#4	3	6	2.5
#5	3.75	7.5	2.5

f _c = 4,000 PSI / GRADE 60						
BAR SIZE	Ld	Lt	Lsb	Lsbt	Ldt	Ldh
#3	15	19	19	25	6	6
#4	19	25	25	33	7	6
#5	24	31	31	41	9	8

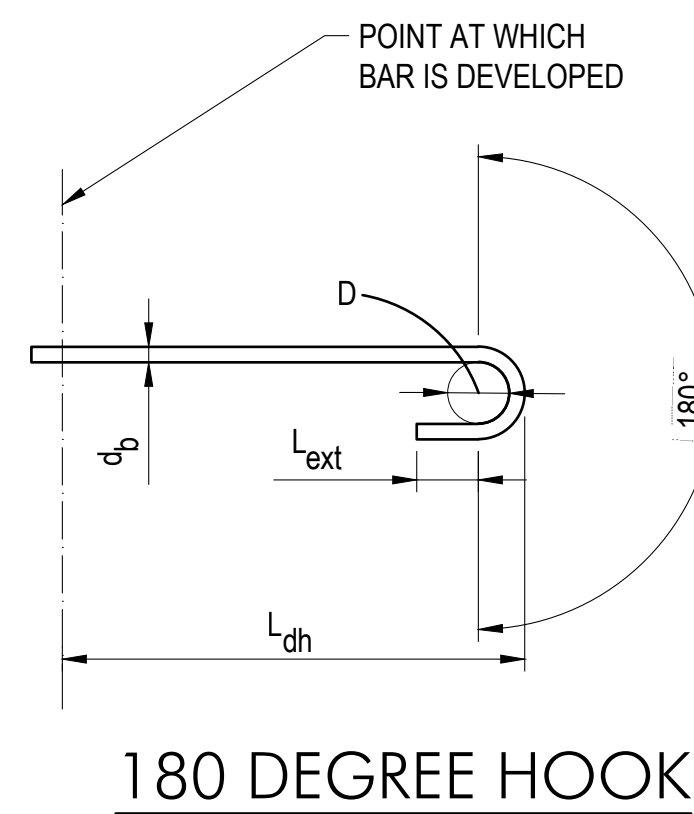

TYPICAL REINFORCING DETAILS

NTS

NOTES:

3. NOTATIONS:
- db: NOMINAL BAR DIAMETER (INCHES)
- Ld: TENSION DEVELOPMENT LENGTH (INCHES) FOR REINFORCEMENT SATISFYING THE FOLLOWING REQUIREMENTS:
- SLABS AND WALLS: CLEAR SPACING > 2db, AND CONCRETE CLEAR COVER > db
- BEAMS AND COLUMNS: CLEAR SPACING > db, AND CONCRETE CLEAR COVER > db
- Lt: DEVELOPMENT LENGTH OF BARS IN THICK CONCRETE = $1.3 \times L_d$ (INCHES)
- Lb: DEVELOPMENT LENGTH OF BARS OR DOWELS IN COMPRESSION = $19 \times db$ (INCHES)
- Lc: TIED COLUMN LAP SPLICE IN COMPRESSION = $30 \times db$ (INCHES)
- Lcs: SPIRAL COLUMN LAP SPLICE IN COMPRESSION = $22.5 \times db$ (INCHES)
- Lsb: TYPICAL LAP SPLICE LENGTH = $1.3 \times L_d$ (INCHES)
- Lsbt: LAP SPLICE LENGTH OF HORIZONTAL BARS IN THICK CONCRETE = $1.69 \times L_d$ (INCHES)
- Ldh: DEVELOPMENT LENGTH IN TENSION OF STANDARD HOOK, WITH SIDE COVER ≥ 2 1/2" AND END COVER ≥ 2 " (INCHES)
- Ldt: DEVELOPMENT LENGTH IN TENSION OF HEADED BAR (INCHES)
- Dt: FINISHED BEND DIAMETER (INCHES)
- Lext: STRAIGHT EXTENSION AT THE END OF A HOOK (INCHES)
2. MULTIPLY VALUES IN THE TABLE BY 1.5 IF CLEAR SPACING OR CONCRETE COVER DO NOT MEET THE REQUIREMENTS FOR Ld IN NOTE 1.
3. "HORIZONTAL BARS IN THICK CONCRETE" REFERS TO BARS WITH MORE THAN 12" OF FRESH CONCRETE CAST BELOW. THIS INCLUDES BEAMS, SLABS, FOUNDATIONS, AND WALLS.
4. MULTIPLY VALUES IN THE TABLE BY 1.33 FOR USE WITH LIGHTWEIGHT AGGREGATE CONCRETE. FOR EPOXY COATED REINFORCEMENT, MULTIPLY VALUES IN THE TABLES BY 1.5 WITH THE EXCEPTION OF LDH WHICH IS TO BE MULTIPLIED BY 1.2.
5. WHEN BARS OF DIFFERENT SIZES ARE LAP SPICED IN TENSION, SPLICE LENGTH SHALL BE THE LARGER OF LD OF LARGER BAR AND LSB OF SMALLER BAR, OR LT AND LSBT FOR BARS IN THICK CONCRETE.
6. FOR HOOKED BARS WITH CENTER-TO-CENTER SPACING LESS THAN 6DB, MULTIPLY LDH VALUES BY 1.6.

LUMEN FIELD NORTH LOT

SECURITY PLAN - PHASE 2


FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134



MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

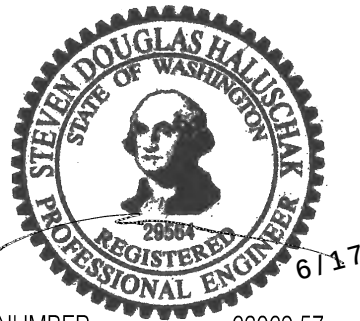

JOB NUMBER: 63069.57

NO.	DATE	DESCRIPTION
-----	------	-------------

DRAWN BY: MKA

DESIGNED BY: BMN

CHECKED BY: SDH

DATE: JUNE 17, 2025

SECTIONS AND DETAILS

SHEET 13 OF 14

C8.05

THIS PLAN SHALL SHOW A SITE PLAN INCLUDING ALL DRAINAGE FEATURES (HARD SURFACES, BMPS, DRAIN LINES, CATCH BASINS, INLETS, PUMPS, ETC.) AND ALL SIDE SEWER FEATURES (SERVICE DRAIN SIDE SEWERS AND SANITARY SIDE SEWERS AND THEIR APPROVED POINTS OF CONNECTION).

THE DETAILS SHOWN IN THIS ARE A SELECTION OF COMMONLY USED ON-SITE STORMWATER MANAGEMENT BMPs. SEE THE CITY OF SEATTLE STORMWATER MANUAL, (DIRECTOR'S RULES SDCI 10-2021/SPU DWW-200), VOLUME 3, CHAPTER 5 FOR ADDITIONAL ON-SITE STORMWATER MANAGEMENT BMPs AND ADDITIONAL REQUIREMENTS FOR ALL BMPs.

1. PLANTS SHALL BE SITED ACCORDING TO SUN, SOIL, WIND AND MOISTURE REQUIREMENTS.

1. FOR A LIST OF APPROVED PLANTS FOR BIORETENTION/RAIN GARDEN FACILITIES, SEE APPENDIX E, SECTION E-9 OF THE 2021 CITY OF SEATTLE STORMWATER MANUAL.

3. PROVIDE A MINIMUM OF THREE DIFFERENT SPECIES OF SHRUBS AND HERBACEOUS PLANTS IN EACH FACILITY.

1. APPROPRIATE PLANTS INCLUDE SUCCULENTS, GRASSES, HERBS, AND WILDFLOWERS THAT ARE ADAPTED TO HARCH

2. VEGETATION COVERAGE OF SELECTED PLANS MUST ACHIEVE 80-PERCENT COVERAGE WITHIN 2 YEARS OR ADDITIONAL PLANTINGS SHALL BE PROVIDED.

3. A LANDSCAPE MANAGEMENT PLAN SHALL BE DEVELOPED AND IMPLEMENTED

1. SIDE SEWERS AND DRAINAGE FACILITIES SHALL BE CONSTRUCTED PER THE REQUIREMENTS FOR DESIGN OF SIDE SEWERS (DRAINAGE & WASTEWATER) (DIRECTOR'S RULES SDCI 4-2011/SPU 2011-004) AND PER 2021 SEATTLE STORMWATER MANUAL (DIRECTOR'S RULE SDCI 10-2021/SPU DWW-200).

2. A SEPARATE DRAINAGE AND SIDE SEWER PERMIT IS REQUIRED FOR ALL ONSITE DRAINAGE ELEMENTS AND SIDE SEWERS/SERVICE DRAINS. APPROVAL OF THIS PLAN IS REQUIRED PRIOR TO OBTAINING A DRAINAGE AND SIDE SEWER PERMIT.

3. RE-USE OF EXISTING SIDE SEWERS WHEN THERE WILL BE AN INCREASE IN LIVING UNITS REQUIRES THE EVALUATION AND CERTIFICATION (PE EVAL/CERT) OF THE EXISTING SIDE SEWER BY A PROFESSIONAL ENGINEER PRIOR TO FINALIZING THE SIDE SEWER AND DRAINAGE PERMIT. IN MOST CASES, THE SIDE SEWER MUST BE LINED ALL THE WAY TO THE MAIN. SEE (DIRECTOR'S RULES SDCI 4-2011/SPU 2011-004) AND SMC 21.16.240.

4. IN ORDER TO ADD UNITS TO AN EXISTING SIDE SEWER A CERTIFIED LETTER STATING THE INTENT TO ADD UNITS TO THE SHARED SIDE SEWER MUST BE SENT TO ALL PROPERTY OWNERS OF PARCELS SERVED BY THE SHARED SIDE SEWER AT LEAST 30 DAYS PRIOR TO APPLYING FOR THE SIDE SEWER PERMIT. SEE SMC 21.16.240.C. A RECEIPT OF CERTIFIED MAILING AND THE CERTIFICATION/ATTESTATION OF MAILING NOTIFICATION MUST BE SUBMITTED TO SDCI PRIOR TO PERMIT ISSUANCE.

5. DEVIATIONS FROM THE APPROVED DRAINAGE AND WASTEWATER CONTROL PLAN MAY REQUIRE A FORMAL POST-SUBMITTAL REVISION FOR PLAN REVIEW AND APPROVAL. POST-SUBMITTAL REVISIONS MUST BE SUBMITTED ELECTRONICALLY THROUGH THE SDCI PROJECT PORTAL.

REINFORCED CONCRETE
STRUCTURAL STEEL
WATER & FIRE SERVICE EXEMPT
ELEVATOR

STADIUM
REINFORCED CONCRETE

NOTE:
NOT ALL FEATURES SOUTH OF LOT 9
WERE LOCATED AS PART OF THIS SURVEY

LEGEND						
HATCH	SURFACE	HARD SURFACE, SF	AREA REQUIRED, SF	AREA PROVIDED, SF	BMP USED	DESCRIPTION
	AREA A	23,615	283.4	287.0	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW
	AREA B	30,976	371.7	426.8	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW
	AREA C	25,107	301.3	327.8	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW
	AREA D	21,997	264.0	312.3	NON INFILTRATING BIORETENTION	RECEIVING VIA SHEET FLOW

On-site Stormwater Management Calculations Site and Drainage Control Summary									
Version 01-04-2023									
To use the On-Site List Calculator you must select "Enable Content" when the Security Warning appears.									
Project Information									
Site Address	800 Occidental Ave S, Seattle, WA 98134			SDCI Project Number					
Primary Contact	Scott Lee			SDOT Project Number					
Project Type	Parcel-Based			Primary Contact E-mail or Phone	v-ScottL@SeahawksFGI.com				
Is this project "Closely Related" to other SDCI construction permits/projects? ☒ Yes ☐ No									
"Closely Related" SDCI Construction Permit Numbers				7050292-CN, 7019202-CN, and 7057296-DM					
Is this project associated with a Short Plat or Subdivision? ☐ Yes ☒ No SDCI MUP Number _____									
Was the project lot created or altered in size after Jan 1, 2016? ☐ No ☐ Yes									
Total Site Area	114,045	sf	→	Total Closely Related and/or Short Plat/Subdivision Site Area	186,468	sf	→		
Total New plus Replaced Hard Surface Area (NPRHS)	1,714	sf	→						
Total New and/or Replaced Lawn/Landscaping	0	sf	→	Total Closely Related and/or Short Plat/Subdivision NPRHS	0	sf	→		
Undisturbed and Protected Site Area	112,331	sf	→						
Total Existing Hard Surface Area To Remain	99,981	sf	→	Total Existing Hard Surface Area (Prior to Project)	101,695	sf	→		
Site Information									
Note: Reference the Preliminary Assessment Report (PAR) to complete this section.									
Approved Point of Stormwater Discharge	Public Storm Drain Main								
Drainage Basin	Designated Receiving Water								
Is the downstream drainage system considered Capacity Constrained by SPU? ☐ No ☐ Yes									
Approved Point of Wastewater Discharge	Public Sanitary Sewer Main								
Approved Point of Sub-Surface Discharge	Public Storm Drain Main								
Required Flow Control Standard	☐ Pre-Developed Pasture			☐ Pre-Developed Forest			☐ Peak Control		
	☐ Wetland Protection			☐ Existing Conditions			☒ None		
Project will permanently discharge groundwater? ☒ No ☐ Yes									
Required Water Quality Treatment Standard	☐ Oil Control			☐ Enhanced			☒ Basic		
Total Pollution Generating Hard Surface Area	0	sf	→	w/ Closely Related/Short Plat/Subdiv.	0	sf	→		
Total Pollution Generating Pervious Surface Area	0	sf	→	w/ Closely Related/Short Plat/Subdiv.	0	sf	→		
Environmentally Critical Areas	☒ Yes			☐ No					
☐ Steep Slope ☐ Potential Slide ☐ Riparian Corridor ☐ Wetland ☒ Liquefaction ☐ Flood Prone ☐ Landfill ☐ Known Landslide ☐ Fish / Wildlife ☐ Peat / Groundwater Management ☐ Shoreline Habitat									
Is there soil and/or groundwater contamination on this site?				☐ No ☐ Yes			Source Control is required ☐ No ☐ Yes		
Infiltration Information									
Is infiltration investigation required? ☐ No ☐ Yes Why?									
Is infiltration on the site feasible? ☐ No ☐ Yes Explain: Site in liquefaction zone with shallow groundwater									
Site Measured Infiltration Rate _____ x Infiltration Rate Correction Factor 0.5 = 0 Site Design Inf Rate _____									
On-site Stormwater Management (select List Approach or Performance Standard) ☐ ☒									
☒ On-site List Approach (Pre-sized) Calculator -- Complete the Surface tabs and BMP Sizing tabs (Most commonly used)									
☐ On-site Performance Standard -- Stormwater modeling by Civil Engineer ☐ (Also for No Off-site Point of Discharge)									
Number of roof areas 0 Note total area entered on surface tabs (plus permeable pavement facility area) exceeds the total new plus replaced hard surface area entered above.									
Number of other surface areas 4									
Surface	Surfaces Description	On-site BMP	Contrib. Area (sf)	Facility Size (sf)	Facility Configuration				
1	Surface-Area A	Non-Infiltrating Bioretention #1	23,615	283 sf	Vertical sides 6 inch				
2	Surface-Area B	Non-Infiltrating Bioretention #2	30,976	372 sf	Vertical sides 6 inch				
3	Surface-Area C	Non-Infiltrating Bioretention #3	25,107	301 sf	Vertical sides 6 inch				
4	Surface-Area D	Non-Infiltrating Bioretention #4	21,997	264 sf	Vertical sides 6 inch				
Total New/Replaced Roof Area			0		Total Roof Area Managed		0		
Total New/Replaced Other Surface Area			101,695		Total Other Surface Managed		101,695		
Total Area Managed			101,695 sf		Total Volume Managed On Site		734,871 gal		
Estimated compost required for soil amendment			0 cy		Volume of compost will be verified by the Inspector.				

LUMEN FIELD NORTH LOT

SECURITY PLAN - PHASE 2


FIRST & GOAL
800 OCCIDENTAL AVE S
SEATTLE, WA 98134



MAGNUSSON
KLEMENCIC
ASSOCIATES

Structural + Civil Engineers

PERMIT DOCUMENTS

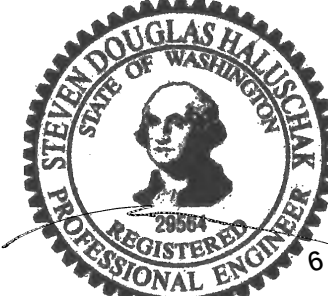

JOB NUMBER: 63069.5

NO.	DATE	DESCRIPTION
DRAWN BY:		MKA
DESIGNED BY:		BMN
CHECKED BY:		SDH
DATE:		JUNE 17, 2025

ONSITE STORMWATER MANAGEMENT PLAN

SHEET 13 OF 14

C8.11

