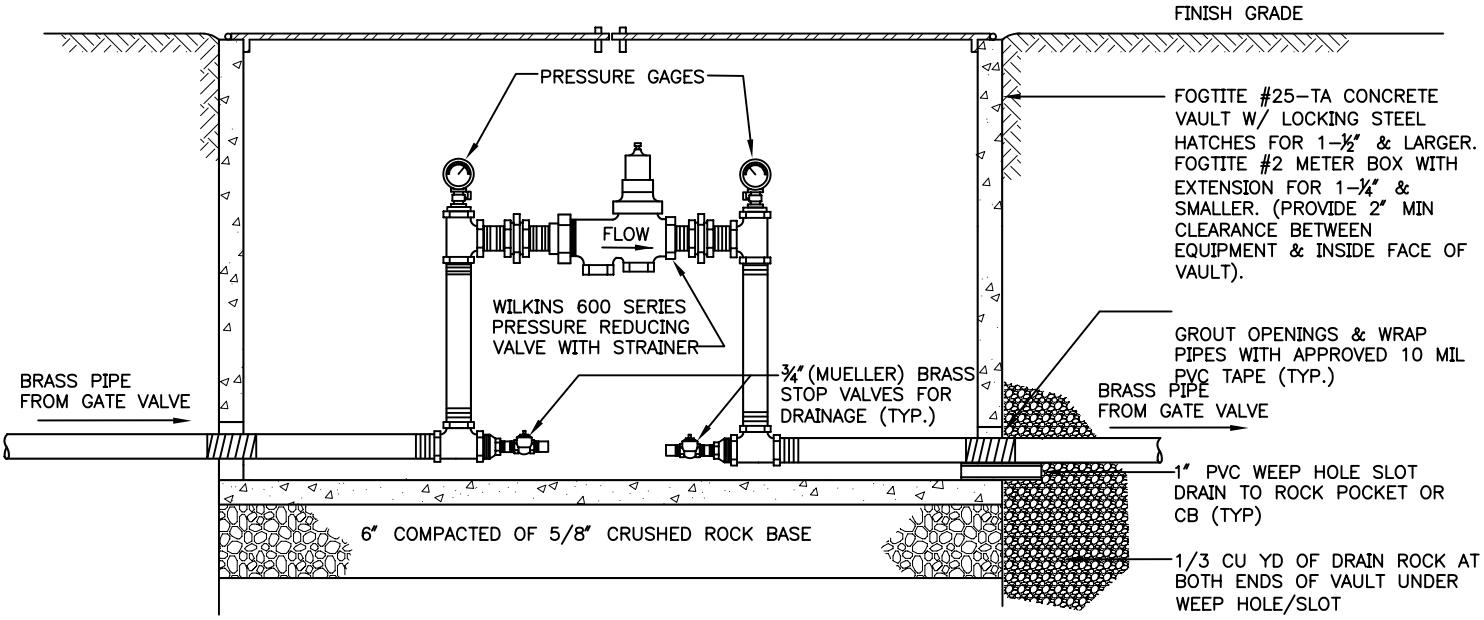

NOTES: USE TEFLON TAPE ON ALL THREADED FITTINGS.
WRAP PIPES WITH 10 MIL. PVC TAPE AT ALL GROUTED OPENINGS.

PRV/STRAINER ASSEMBLY IN CONCRETE VAULT
(LOCATE UPSTREAM FROM EXISTING DCVA)

City of Seattle Department of Parks & Recreation	**PRV IN TA-25 CONCRETE VAULT (1-1/2" & LARGER)** **STD. DETAIL NO. 32 84 19.19**