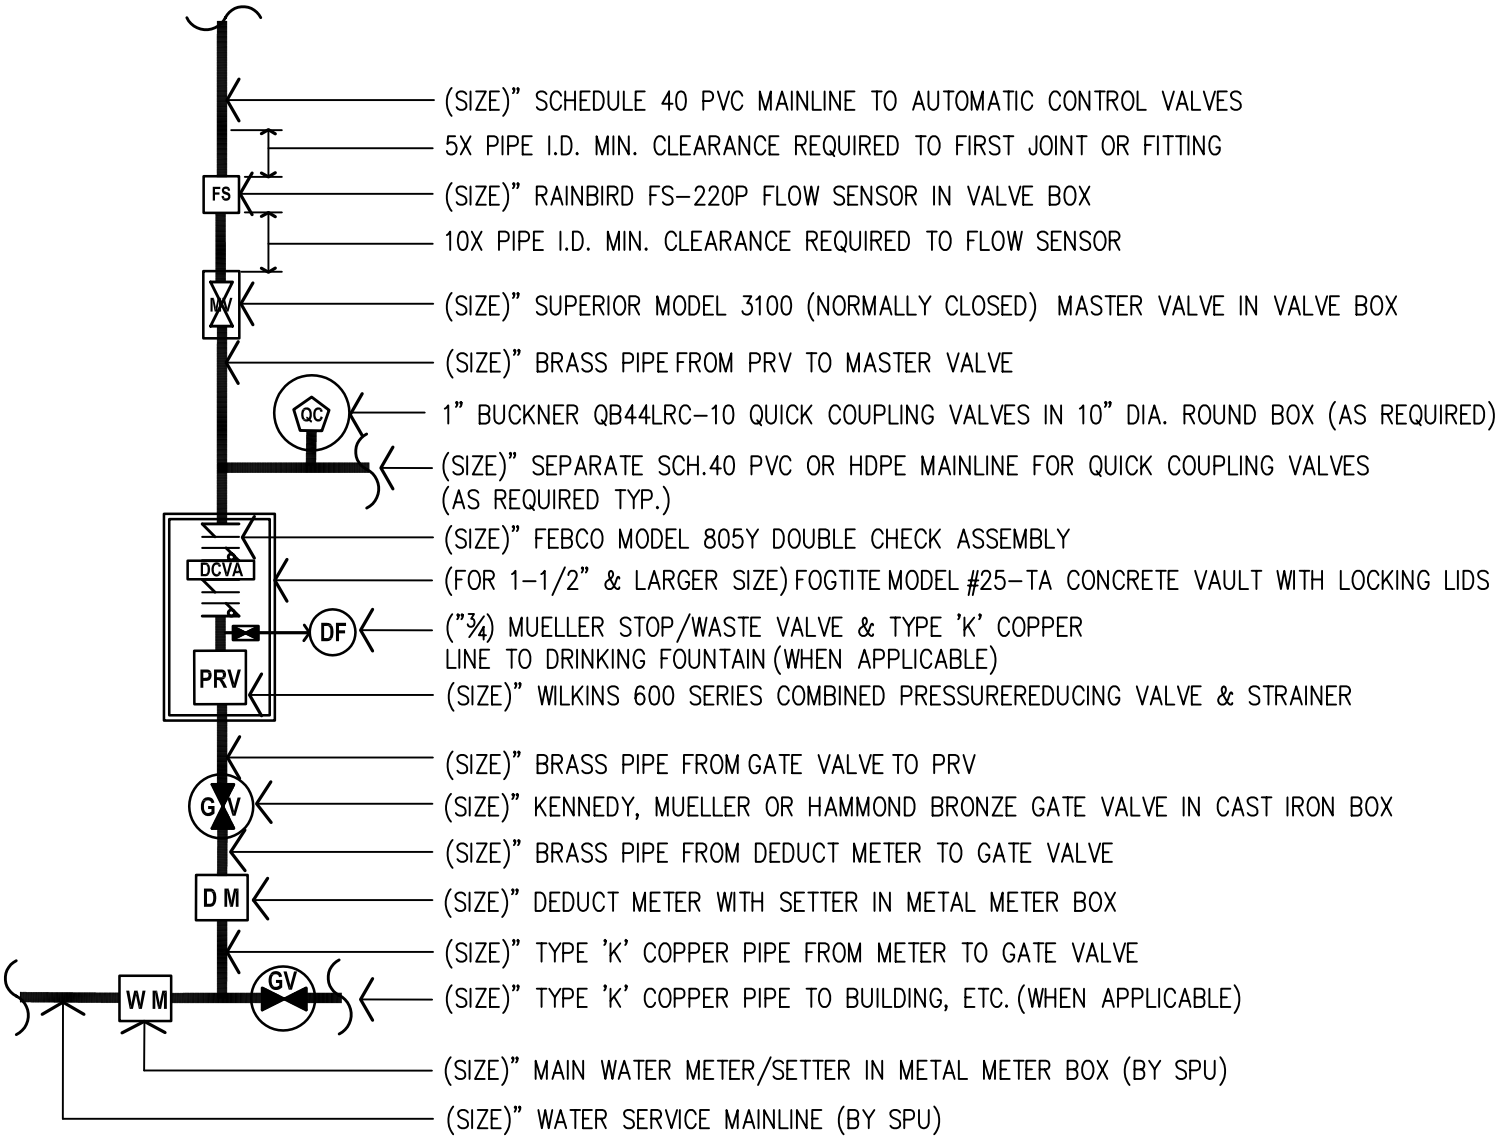

NOTES:

1. ALL COMPONENTS OF SCHEMATIC POINT OF CONNECTION SHALL BE INSTALLED PER SPR STANDARD DETAILS.
2. BACKFLOW PREVENTION DEVICE INSTALLATIONS REQUIRE INSPECTION, TESTING & CERTIFICATION BY SPU INSPECTION SERVICES. (SEE SPECIFICATIONS).
3. FOR 1-¼" & SMALLER SIZED PRV/DCVA APPLICATIONS USE FOGTITE #2 METER BOX.

STANDARD POINT OF CONNECTION SCHEMATIC DIAGRAM

FOR STANDARD MAXICOM IRRIGATION SYSTEM APPLICATIONS

City of Seattle Department of Parks & Recreation	**STANDARD POINT OF CONNECTION DIAGRAM** **STD. DETAIL NO. 32 84 00.13**