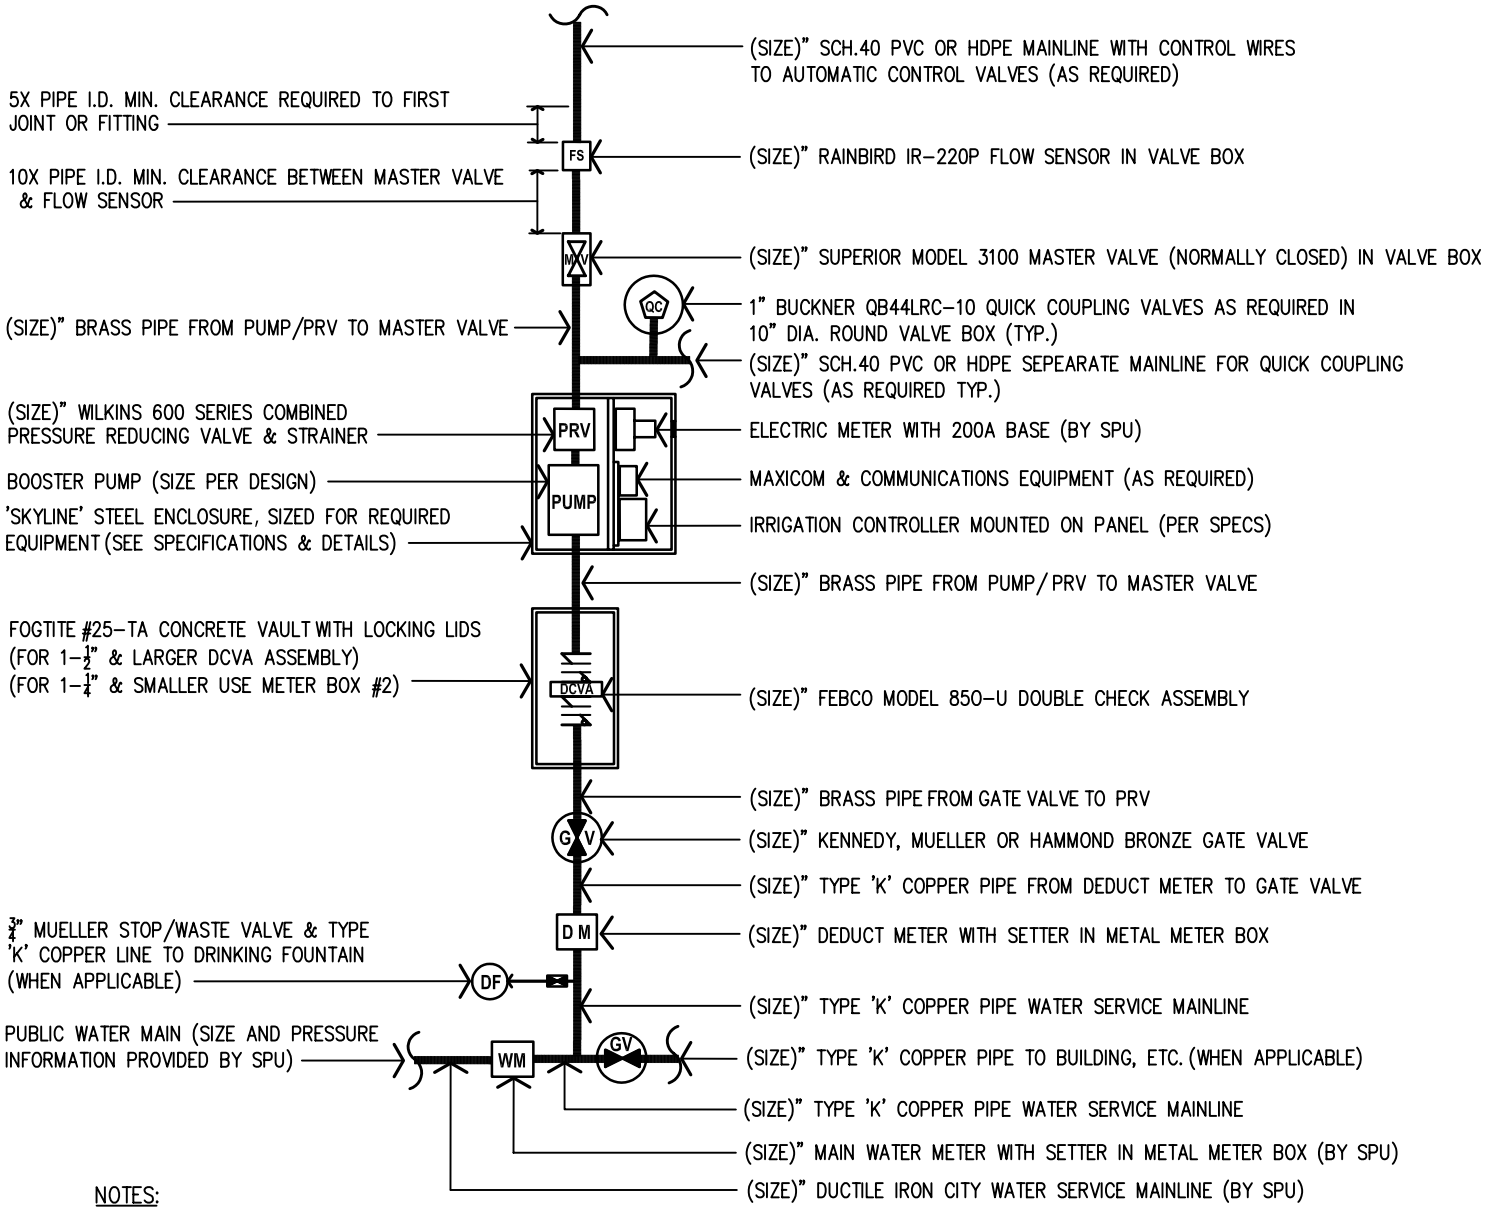

NOTES:

1. ALL COMPONENTS OF SCHEMATIC POINT OF CONNECTION SHALL BE INSTALLED PER SPR STANDARD SPECIFICATIONS AND DETAILS.

2. INSTALLATION AND TESTING OF DCVA AND ANY POTABLE WATER COMPONENTS SUCH AS A DRINKING FOUNTAIN SHALL BE COMPLETED BY A LISENCED PLUMBER.

3. BACKFLOW PREVENTION DEVICE INSTALLATIONS REQUIRE INSPECTION AND CERTIFICATION BY SPU INSPECTION SERVICES. (SEE SPECIFICATIONS).

STANDARD POINT OF CONNECTION SCHEMATIC DIAGRAM

FOR STANDARD MAXICON SYSTEM APPLICATIONS WHEN A BOOSTER PUMP IS REQUIRED

City of Seattle **Department of Parks & Recreation**	**STANDARD POINT OF CONNECTION (WITH BOOSTER PUMP) DIAGRAM** **STD. DETAIL NO. 32 84 00.16**