ENCLOSURE CABINET NOTES:

1. 'SKYLINE' NEMA 3R RAINPROOF CABINET.
2. 12 GA. PRE-GALVANIZED STEEL, WELDED SEAM CONSTRUCTION.
3. TWO SCREENED, GASKETED LOUVERED VENTS.
4. REMOVABLE EQUIPMENT MOUNTING PANEL (AS REQIRED).
5. VANDALPROOF LOCKABLE SLIDE BAR ACROSS FRONT DOOR.
6. PADMOUNT DESIGN WITH 2" INSIDE FLANGE ON BOTTOM.
7. DOOR: 3 POINT LATCH WITH CONCEALED HINGE, LIFT-OFF TYPE (UPON OPENING) CLOSED CELL NEOPRENE GASKET.
8. PAINT: OVEN BAKED ENAMEL (DARK GREEN OUTSIDE, WHITE INSIDE, PRE-GALVANIZED METAL TREATED WITH COPPER SULFATE PRIOR TO PAINTING.
9. ACTUAL CABINET DIMENSIONS ARE PROJECT SPECIFIC AND WILL BE SPECIFIED ON THE DRAWINGS.
10. METER READING WINDOW WITH REINFORCED GLASS & SCREEN.

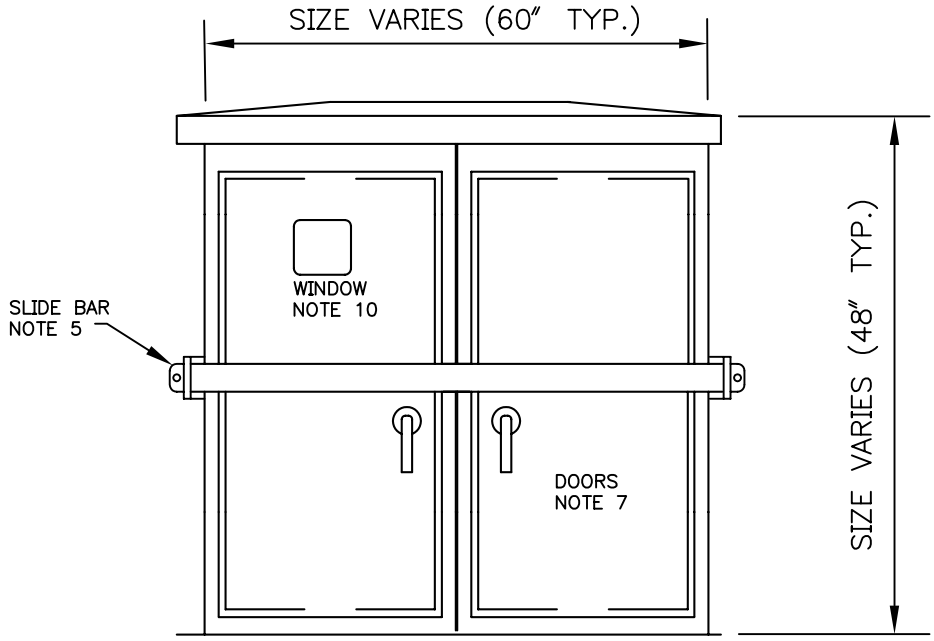

IRRIGATION CONTROL PANEL

1. HYBRID CONTROLLER: RAINBIRD ESP-XX-MC, SAT OR SITE-W CONTROLLER WITH REMOTE RECEIVER CARD (#01060UP).
2. LEVITON 5280-W GFI OUTLET
3. RAINBIRD PT1502 FLOW MONITOR.
4. DATAREMOTE CELLULAR COMMUNICATION EQUIPMENT (#CDS-9022-1X-V).
5. DATAREMOTE POWER SUPPLY. (APS MODEL #AD-740-1150/SCG).
6. CELLULAR ANTENNA WITH ADAPTER & CABLE (INSTALLED ON TOP OF ENCLOSURE OR BUILDING AS REQUIRED).
7. RJ-11 PHONE JACK (AS REQ.).
8. TERMINAL BOX W/ TERMINAL STRIPS.
9. GROUND LUG.
10. 2" CONDUIT FOR STATION ZONE CONTROL WIRES.
11. 1" CONDUIT FOR GROUND WIRE FROM GROUNDING GRID (TYP.).
12. TRC COMMANDER REMOTE TRANSMITTERS (2 UNITS PER PROJECT TYP.).
13. PULSE DECODER (OPTIONAL AS REQUIRED).
14. MPAN2436A BACK PANEL (TYP.)

NOTES: DATAREMOTE CELLULAR EQUIPMENT IS NOT USED IF PHONE SERVICE IS HARDLINED AT FACILITY. PHONE JACK IS USED FOR HARDLINE OPTION. REFER TO DETAIL #02810.68 FOR GROUNDING.

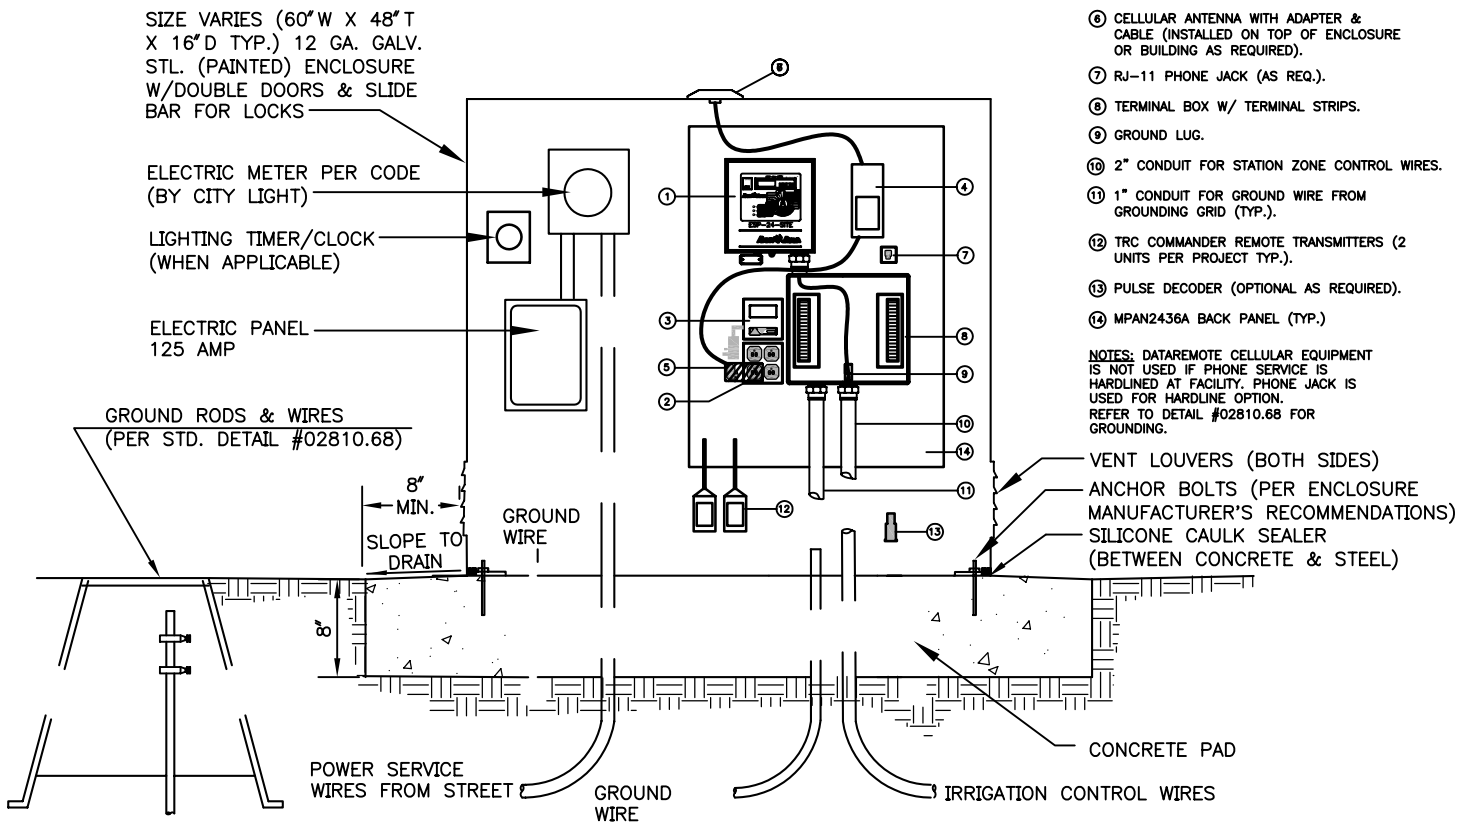

City of Seattle
Department of Parks & Recreation

IRRIGATION CONTROLLER ENCLOSURE WITH ELECTRICAL METER/PANEL DETAILS

STD. DETAIL NO. **02810.67**