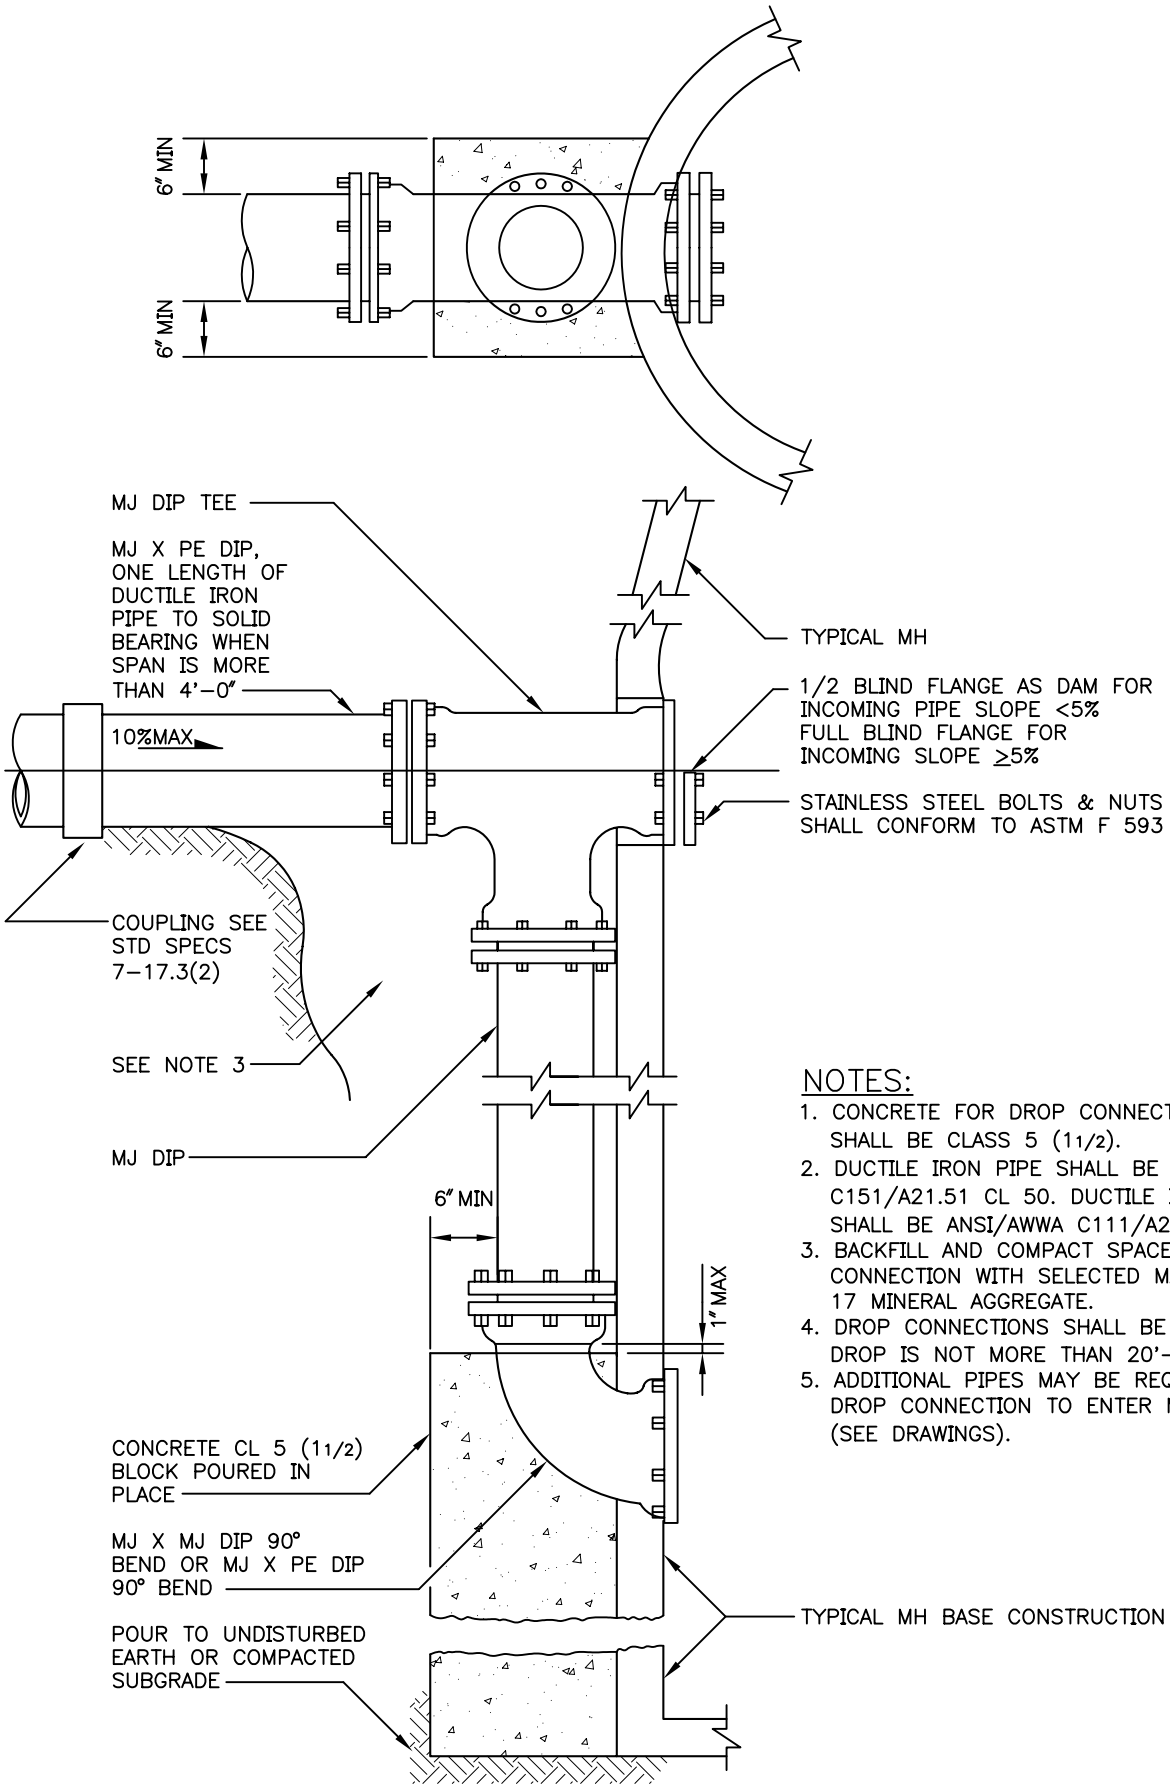

NOTES:

1. CONCRETE FOR DROP CONNECTION SUPPORT SHALL BE CLASS 5 (1 1/2).
2. DUCTILE IRON PIPE SHALL BE ANSI/AWWA C151/A21.51 CL 50. DUCTILE IRON FITTINGS SHALL BE ANSI/AWWA C111/A21.11.
3. BACKFILL AND COMPACT SPACE AROUND DROP CONNECTION WITH SELECTED MATERIAL OR TYPE 17 MINERAL AGGREGATE.
4. DROP CONNECTIONS SHALL BE USED WHERE DROP IS NOT MORE THAN 20'-0".
5. ADDITIONAL PIPES MAY BE REQUIRED FOR DROP CONNECTION TO ENTER MH STRUCTURE (SEE DRAWINGS).

DUCTILE IRON OUTSIDE DROP CONNECTION

City of Seattle **Department of Parks & Recreation**	**MAINTENANCE HOLE - OUTSIDE DROP CONNECTION** **STD. DETAIL NO. 33 49 13.29**