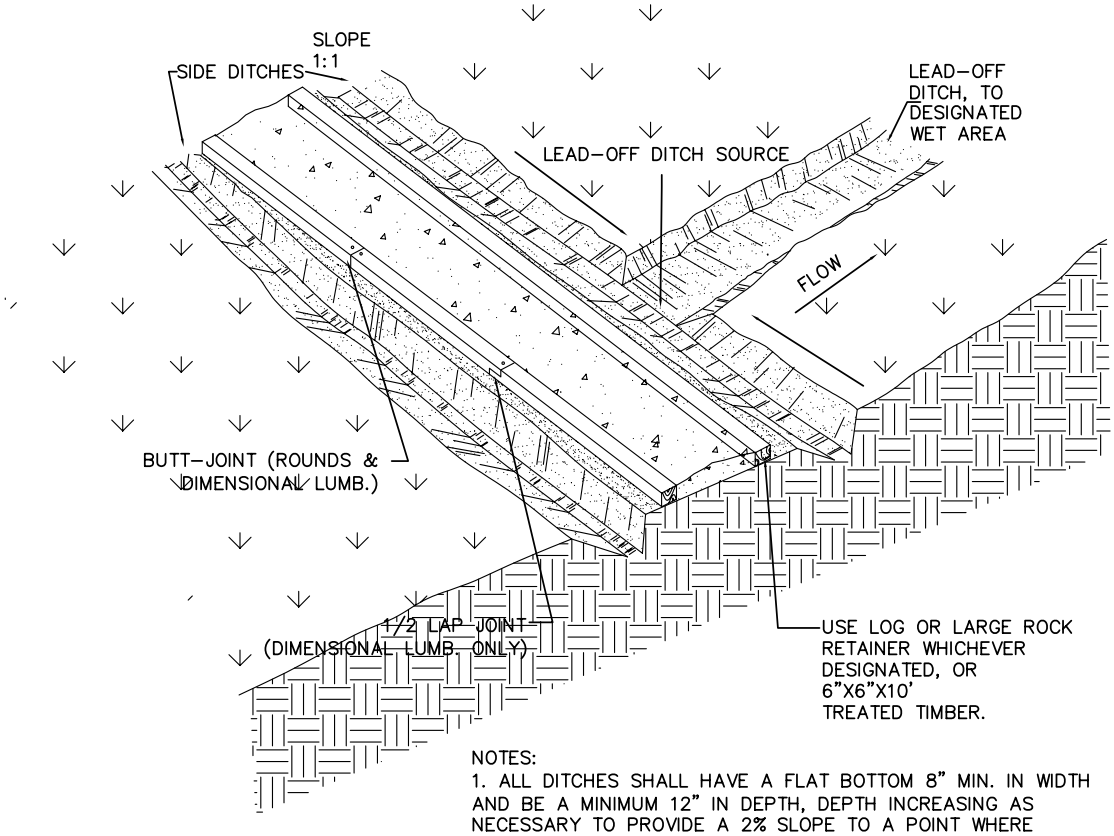

NOTES:

1. ALL DITCHES SHALL HAVE A FLAT BOTTOM 8" MIN. IN WIDTH AND BE A MINIMUM 12" IN DEPTH, DEPTH INCREASING AS NECESSARY TO PROVIDE A 2% SLOPE TO A POINT WHERE NATURAL GRADE ALLOWS FOR DISCHARGE. LEAD-OFF DITCHES SHALL BE EXCAVATED INTO NATURALLY OCCURING WET AREAS (SEASONAL OR PERMANENT).

2. OPTIONAL TREATED POLES 6"-8" DIA. FROM APPROVED SOURCE.

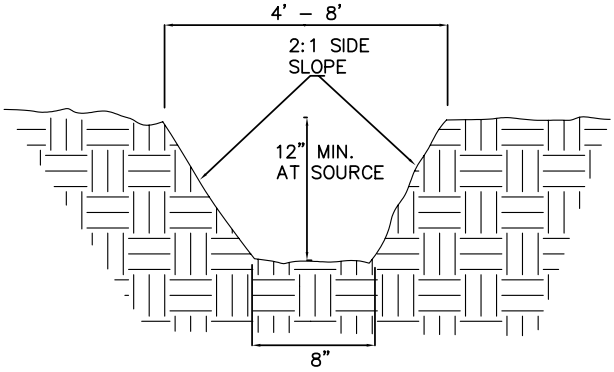

LEAD-OFF DITCH

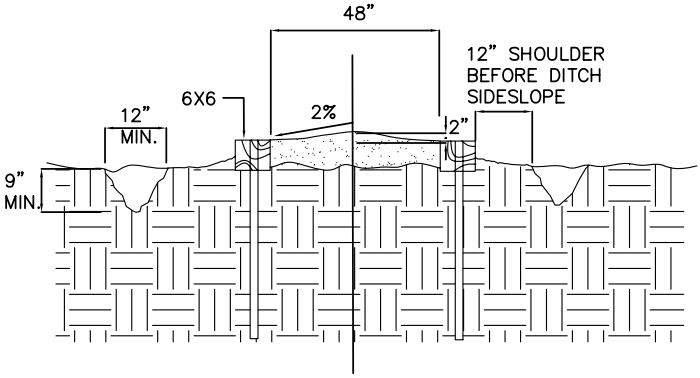

SIDE DITCHES

City of Seattle Department of Parks & Recreation	**LEADOFF DITCH DETAILS** **STD. DETAIL NO. 32 60 00.39**